


NOTE:
ALL SPRINKLER MATERIALS & INSTALLATION SHALL COMPLY WITH NFPA 13, STATE & LOCAL CODES. FIRE SPRINKLER CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING HIS OWN FLOW READINGS FOR PURPOSE OF DESIGN. CONTRACTOR TO VERIFY FLOW, SIZE & SPACING REQUIREMENTS TO DETERMINE ADEQUATE SERVICE. SUBMIT DRAWINGS FOR APPROVAL PRIOR TO STARTING CONSTRUCTION.

1 NEW FIRE SPRINKLER RISER DETAIL
NOT TO SCALE

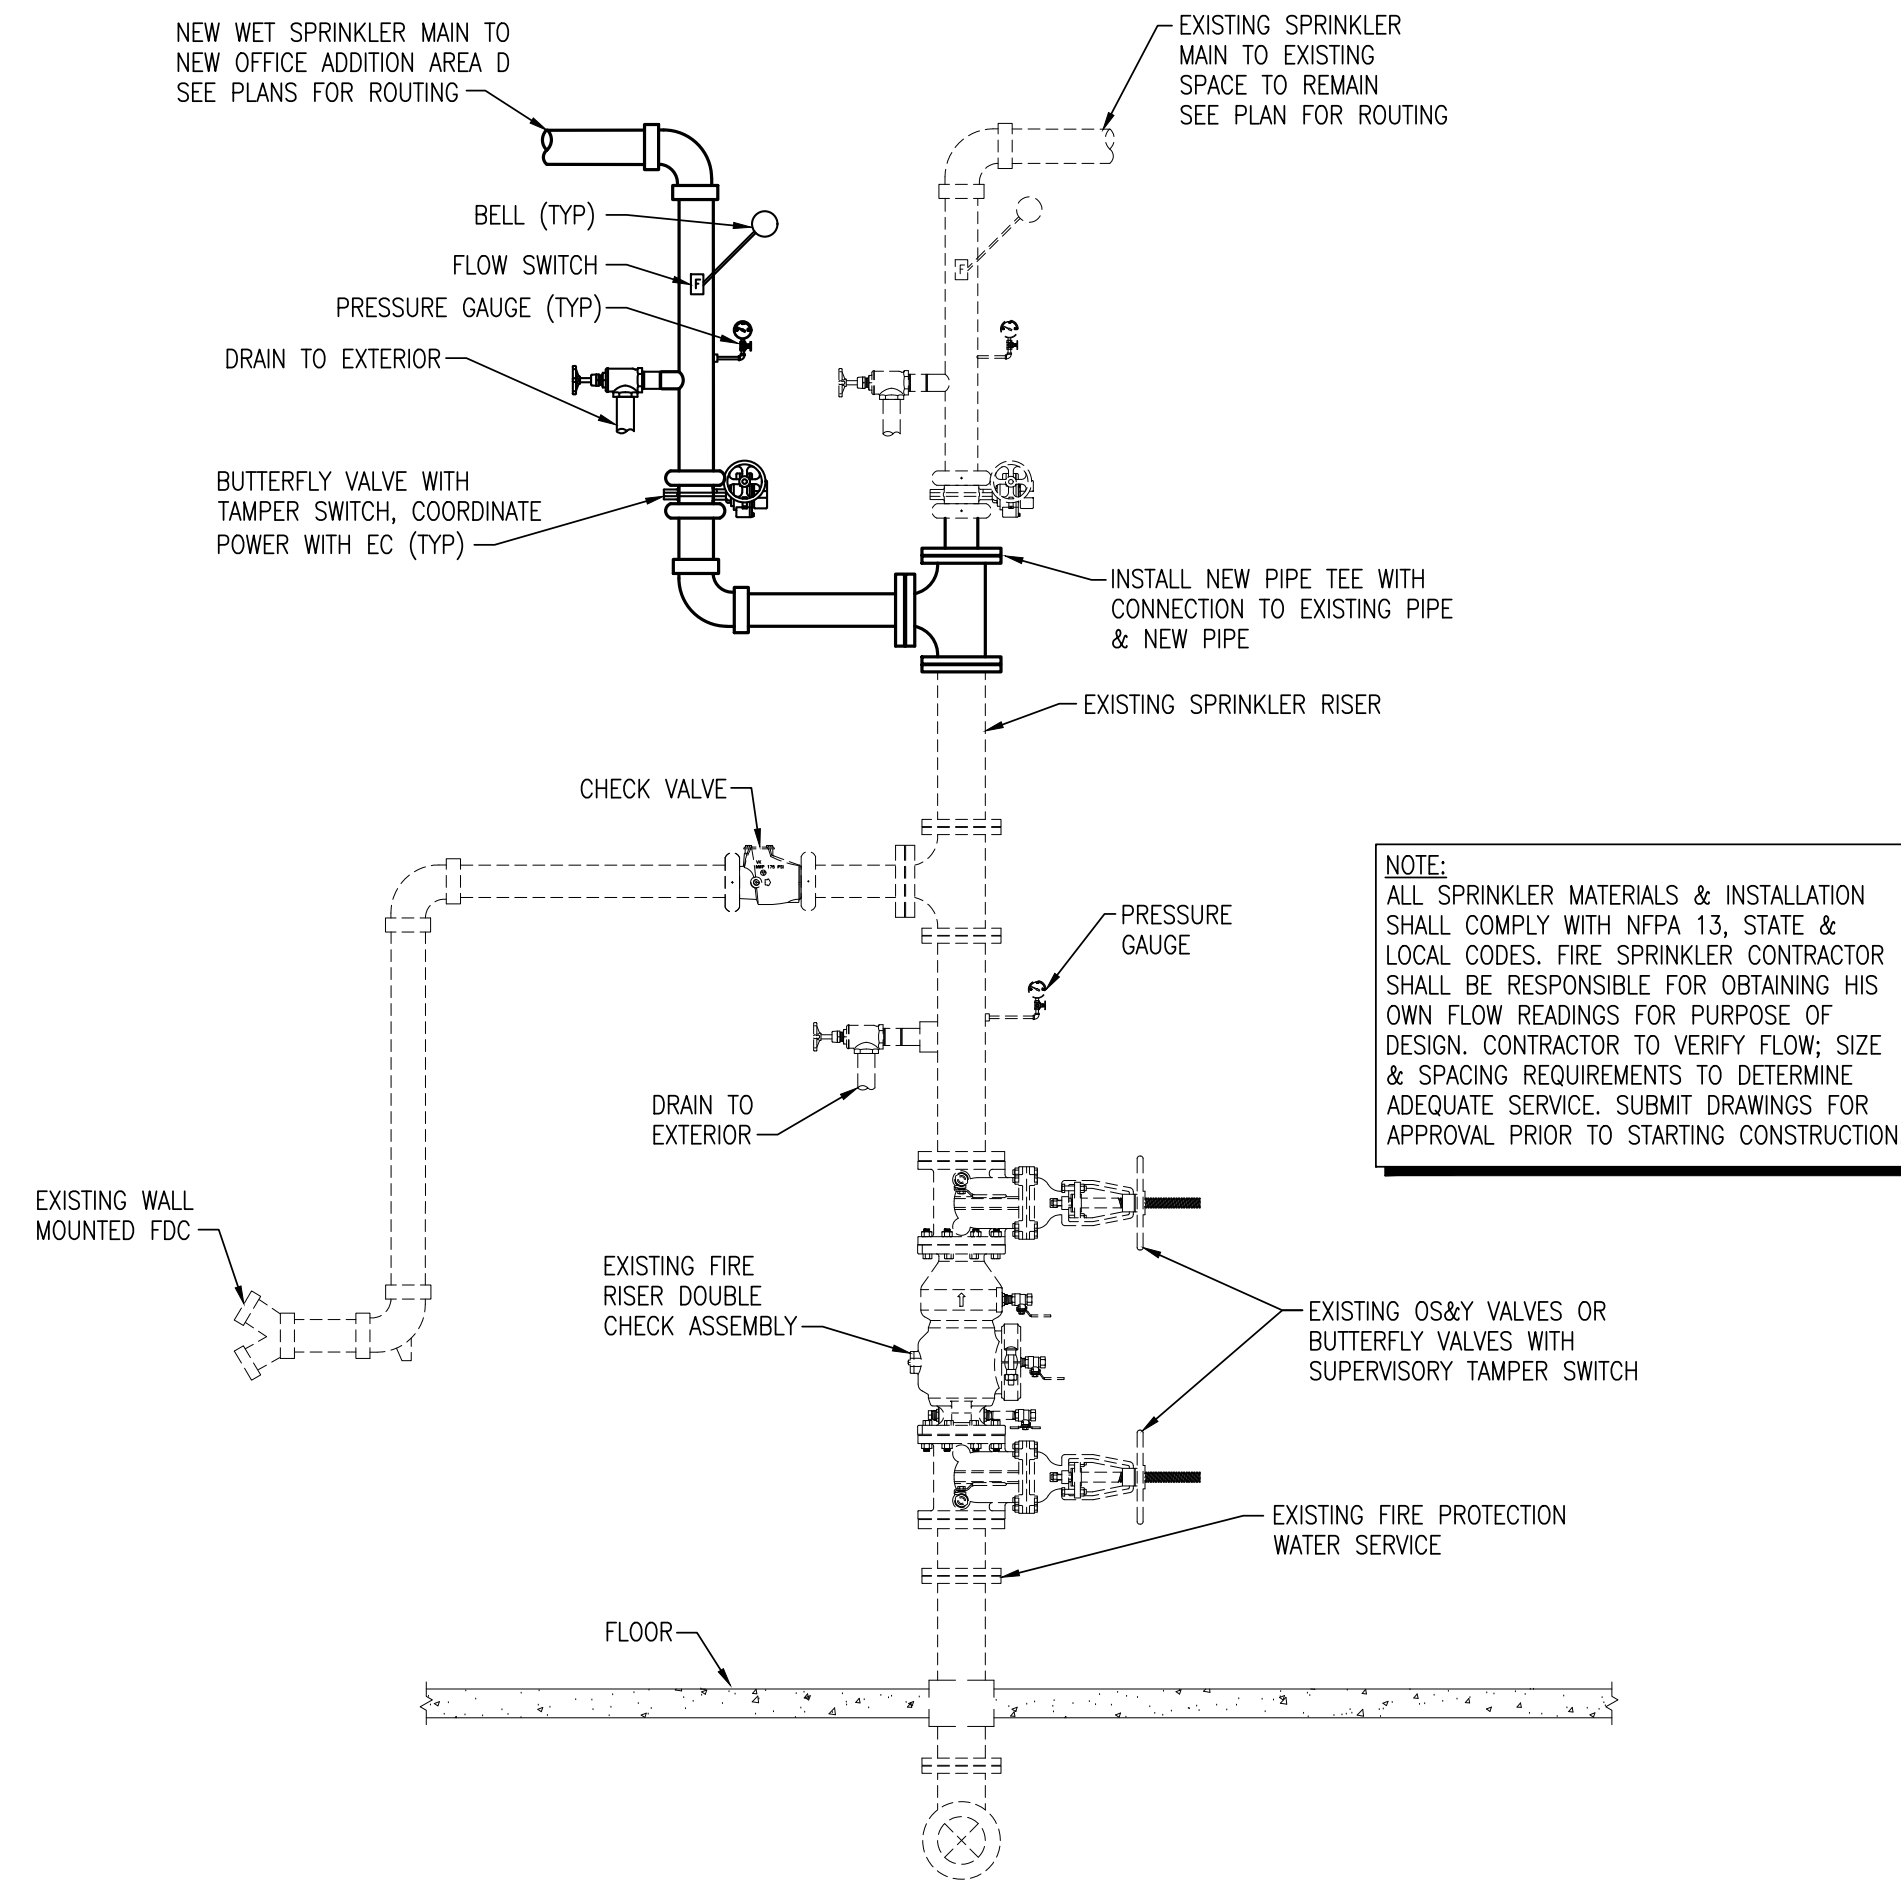

NOTE:
ALL SPRINKLER MATERIALS & INSTALLATION SHALL COMPLY WITH NFPA 13, STATE & LOCAL CODES. FIRE SPRINKLER CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING HIS OWN FLOW READINGS FOR PURPOSE OF DESIGN. CONTRACTOR TO VERIFY FLOW, SIZE & SPACING REQUIREMENTS TO DETERMINE ADEQUATE SERVICE. SUBMIT DRAWINGS FOR APPROVAL PRIOR TO STARTING CONSTRUCTION.

2 EXISTING FIRE SPRINKLER RISER DETAIL
NOT TO SCALE

FIRE PROTECTION ABBREVIATIONS			
AG	ABOVE GRADE	FT	FOOT (FEET)
ADD	ADDENDUM	GAL	GALLON
ADDL	ADDITIONAL	GC	GENERAL CONTRACTOR
ADJ	ADJUSTABLE	GPM	GALLONS PER MINUTE
AFF	ABOVE FINISH FLOOR	MC	MECHANICAL CONTRACTOR
AFG	ABOVE FINISH GRADE	MECH	MECHANICAL
ALT	ALTERNATE	MIN	MINIMUM
BG	BELOW GRADE	NTS	NOT TO SCALE
CI	CAST IRON	PC	PLUMBING CONTRACTOR
COL	COLUMN	PLBG	PLUMBING
CW	COLD WATER	QTY	QUANTITY
DN	DOWN	SCH	SCHEDULE
EC	ELECTRICAL CONTRACTOR	SPEC	SPECIFICATIONS
FD	FLOOR DRAIN	SS	STAINLESS STEEL
FDC	FIRE DEPARTMENT CONNECTION	TEMP	TEMPERATURE
FLR	FLOOR	TYP	TYPICAL
FP	FIRE PROTECTION	W/	WITH

FIRE PROTECTION SYMBOL LEGEND	
	SHUTOFF VALVE
	CHECK VALVE
	DOUBLE CHECK VALVE
	END CAP
	FIRE DEPARTMENT CONNECTION (FDC)
	BELL

FIRE PROTECTION PIPING LINETYPES	
LINETYPE	DESCRIPTION
	NEW - ABOVE GRADE
	NEW - BELOW GRADE

- FIRE PROTECTION GENERAL NOTES**
- CONTRACTOR SHALL PROVIDE DESIGN FOR SPRINKLER SYSTEMS FOR NEW OFFICE ADDITION AND CLASSROOM ADDITION. OFFICE AREA TO BE SERVED BY EXISTING FIRE RISER IN MEDIA CENTER. CLASSROOM ADDITION TO BE SERVED BY NEW FIRE RISER.
 - COORDINATE INSTALLATION OF SPRINKLER PIPING AND ALL COMPONENTS WITH OTHER TRADES, OWNER, AND GENERAL CONTRACTOR.
 - FIRE PROTECTION SYSTEM TO COMPLY WITH NFPA 13, INSURANCE CARRIER AND ALL APPLICABLE STATE AND LOCAL CODES.
 - CUTTING OF STRUCTURAL AND/OR ARCHITECTURAL MEMBERS TO BE DONE ONLY WITH THE WRITTEN APPROVAL OF THE ARCHITECT AND STRUCTURAL ENGINEER.
 - PROVIDE MINIMUM 10 PSI SAFETY FACTOR.
 - WORKING DRAWINGS INDICATING SPRINKLER HEAD LOCATIONS AND EXPOSED AND CONCEALED PIPING ROUTING SHALL BE PROVIDED TO THE ARCHITECT/ENGINEER PRIOR TO INSTALLATION FOR APPROVAL.
 - FIRE PROTECTION CONTRACTOR IS RESPONSIBLE FOR ORGANIZING A COORDINATION MEETING WITH OTHER TRADES AND OWNER PRIOR TO INSTALLATION.
 - SYSTEM PIPING LOCATION: WET SYSTEM PIPING SHALL BE INSTALLED AT HIGHEST ELEVATION POSSIBLE. PIPING SHALL BE INSTALLED ABOVE ALL MECHANICAL EQUIPMENT, DUCTWORK, AND ALL PLUMBING SYSTEM PIPING. PROVIDE ADEQUATE CLEARANCE TO MECHANICAL UNITS. FIRE PROTECTION CONTRACTOR SHALL COORDINATE FIRE PROTECTION PIPING PRIOR TO INSTALLATION.
 - PROPERLY TORQUE MECHANICAL TEES TO MANUFACTURER'S RECOMMENDATIONS.
 - FIRE PROTECTION PLANS ARE FOR REFERENCE ONLY. OCCUPANCIES AND AREAS OF PROTECTION NOTED ON THE PLANS SHALL BE CONFIRMED WITH NFPA 13 AND AUTHORITIES HAVING JURISDICTION. THIS CONTRACTOR SHALL COMPLY WITH ANY CODE REQUIREMENTS AS REQUIRED.
 - REFER TO ARCHITECTURAL FIRE CODE PLAN FOR ADDITIONAL INFORMATION.
 - FIRESEAL ALL PENETRATIONS THRU RATED STRUCTURES TO MAINTAIN FIRE RATINGS.
 - SEMI-RECESSED PENDANT SPRINKLER HEADS SHALL HAVE WHITE FINISH.
 - UPRIGHT SPRINKLER HEADS SHALL BE BRASS. PROVIDE PROTECTIVE GUARD FOR HEAD.

FIRE PROTECTION SHEET INDEX	
F000	FIRE PROTECTION NOTES & SYMBOLS
F001	FIRE PROTECTION PLAN - OVERALL
F101	FIRE PROTECTION PLAN - AREA A
F102	FIRE PROTECTION PLAN - AREA B
F103	FIRE PROTECTION PLAN - AREA C
F104	FIRE PROTECTION PLAN - AREA D

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK

CIVIL

KFC ENGINEERING

STRUCTURAL

SALAS O'BRIEN

MECHANICAL / ELECTRICAL



KC

drawn by

KP

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

F000

OWNERSHIP USE OF DOCUMENTS:

Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2023-02792-00

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.