

| | |
|------------|--|
| CJC | |
| drawn by | |
| BWB | |
| checked by | |
| JULY 2023 | |
| date | |
| revisions | |



1. GENERAL INFORMATION

- A. GOVERNING BUILDING CODE: 2015 INTERNATIONAL BUILDING CODE (IBC-2015).
- B. BUILDING RISK CATEGORY: THE BUILDING RISK CATEGORY ACCORDING TO IBC-2015 TABLE 1604.5 AND ASCE 7-10 TABLE 1.5-1 IS CATEGORY III.
- C. ELEVATIONS: REFERENCE FINISHED FLOOR ELEVATIONS OF 100'-0" EQUALS ACTUAL EXISTING FINISH FLOOR ELEVATION OF 1249.21' FOR CLASSROOM ADDITION AND 1249.38' FOR THE OFFICE ADDITION.
- D. CONTRACT DOCUMENTS:
 - 1) THE CONTRACT DOCUMENTS CONSIST OF THE AGREEMENT BETWEEN THE OWNER AND CONTRACTOR, CONDITIONS OF THE CONTRACT, DRAWINGS, SPECIFICATIONS, ADDENDA ISSUED PRIOR TO EXECUTION OF THE CONTRACT, OTHER DOCUMENTS LISTED IN THE AGREEMENT AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT.
 - 2) THE GENERAL CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND DISSEMINATING ALL CONTRACT DOCUMENTS AND LATEST ADDENDA TO ALL SUB-CONTRACTORS PRIOR TO DETAILING, FABRICATION OR INSTALLATION OF WORK.
 - 3) CORRELATION OF THE CONTRACT DOCUMENTS: THE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IF CONFLICTING REQUIREMENTS ARE FOUND BETWEEN THE DRAWINGS, SPECIFICATIONS AND/OR THESE GENERAL NOTES, THE MORE STRINGENT AND HIGHEST COST REQUIREMENT SHALL CONTROL UNLESS DIRECTED OTHERWISE IN WRITING BY THE OWNER'S REPRESENTATIVE.
 - 4) THE GENERAL CONTRACTOR SHALL COMPARE THE ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR DISCREPANCIES BETWEEN EACH SET, AND WITHIN EACH SET OF DRAWINGS, AND REPORT DISCREPANCIES, IF ANY, TO THE OWNER'S REPRESENTATIVE PRIOR TO THE DETAILING, FABRICATION AND INSTALLATION OF AFFECTED WORK.
 - 5) GENERAL CONTRACTOR SHALL COORDINATE SIZES AND LOCATIONS OF OPENINGS THROUGH FLOORS, ROOF AND WALLS SHOWN ON ELECTRICAL, PLUMBING, AND FIRE SUPPRESSION SYSTEM DESIGN DOCUMENTS WITH ASSOCIATED SUBCONTRACTORS.
 - 6) CONTRACTOR SHALL COORDINATE ALL ELEVATOR REQUIREMENTS FOR FINAL ELEVATOR EQUIPMENT PURCHASED, INCLUDING PIT DIMENSIONS, PIT DEPTH, FLOOR OPENING DIMENSIONS, ELEVATOR OVER-RUN CLEARANCE AT TOP OF SHAFT. CONTRACTOR SHALL REPORT ASSOCIATED DISCREPANCIES TO THE ARCHITECT IN WRITING PRIOR TO CONSTRUCTION OF ASSOCIATED BUILDING ELEMENTS.
 - 7) ALTHOUGH NOT NECESSARILY SPECIFICALLY REFERENCED IN THE CONTRACT DOCUMENTS, TYPICAL DETAILS AND GENERAL NOTES APPLY TO THE ENTIRE PROJECT WHEREVER CONDITIONS SIMILAR TO THOSE DETAILED OR NOTED EXIST.
 - 8) THE USE OF ELECTRONIC FILES OR REPRODUCTION OF CONTRACT DOCUMENTS BY ANY TRADE OR MATERIAL SUPPLIER IN LIEU OF COMPLETELY INDEPENDENT PREPARATION OF SHOP DRAWINGS SIGNIFIED THE SUPPLIER'S CERTIFICATION THAT ALL INFORMATION SHOWN IN THE SHOP DRAWINGS IS CORRECT, AND ASSIGNS THEMSELVES TO RESPONSIBILITY FOR ANY JOB EXPENSE ARISING DUE TO ANY ERRORS OCCURRING THEREIN.
- E. FIELD MODIFICATIONS: CONTRACTOR OR SUBCONTRACTOR FIELD MODIFICATIONS TO THE STRUCTURE WITHOUT THE PRIOR WRITTEN CONSENT OF THE STRUCTURAL ENGINEER ARE EXPRESSLY PROHIBITED AND MAY REQUIRE SUBSEQUENT REMEDIATION DIRECTED BY THE STRUCTURAL ENGINEER AT CONTRACTOR'S EXPENSE.

2. DESIGN LOADS

- A. DEAD LOAD: SELF WEIGHT OF MATERIALS, UNLESS NOTED OTHERWISE
- B. ROOF DEAD LOAD:
 - 1) BUILT-UP ROOFING SYSTEM6 PSF
 - 2) RIGID INSULATION2 PSF
 - 3) METAL ROOF DECK3 PSF
 - 4) JOIST SELF-WEIGHT2 PSF
 - 5) CEILING SYSTEM2 PSF
 - 6) ROOF COLLATERAL (MEP, BRIDGING & MISC. FRAMING)5 PSF
 - 7) TOTAL20 PSF
- C. UNIFORM LIVE LOADS:
 - 1) ROOF LIVE LOAD (REDUCIBLE)20 PSF
- D. CONCENTRATED LIVE LOADS:
 - 1) ROOFS (ON AN AREA 2.5 FT. X 2.5 FT.)300 LBS
- E. WIND LOADS:
 - 1) GOVERNING CODE: ASCE 7-10
 - 2) RISK CATEGORY: III
 - 3) EXPOSURE CATEGORY: B
 - 4) INTERNAL PRESSURE COEFFICIENT, GCPI: +/- 0.18
 - 5) TOPOGRAPHIC FACTOR, KZT: 1.0
 - 6) DIRECTIONALITY FACTOR, KD: 0.85
 - 7) ULTIMATE DESIGN WIND SPEED, Vult: 120 MPH
- F. SNOW LOADS:
 - 1) GOVERNING CODE: ASCE 7-10
 - 2) SNOW IMPORTANCE FACTOR, Is: 1.1
 - 3) GROUND SNOW LOAD, Pg: 10 PSF
 - 4) EXPOSURE OF ROOF: PARTIALLY EXPOSED
 - 5) EXPOSURE FACTOR, Ce: 1.0
 - 6) THERMAL FACTOR, Ct: 1.0
 - 7) ROOF SLOPE FACTOR, Cs: 1.0
 - 8) MINIMUM FLAT ROOF SNOW LOAD, I'Pg: 7.7 PSF
 - 9) RAIN ON SNOW SURCHARGE LOAD: 5 PSF
- G. RAIN LOADS:
 - 1) GOVERNING CODE: ASCE 7-10
 - 2) DEPTH OF WATER ON THE UNDEFLECTED ROOF UP TO THE INLET OF THE SECONDARY DRAINAGE SYSTEM WHEN THE PRIMARY DRAINAGE SYSTEM IS BLOCKED (I.E., THE STATIC HEAD), ds: 4.0 INCHES
 - 3) ADDITIONAL DEPTH OF WATER ON THE UNDEFLECTED ROOF ABOVE THE INLET OF THE SECONDARY DRAINAGE SYSTEM AT ITS DESIGN FLOW (I.E., THE HYDRAULIC HEAD), dh: 2.0 INCHES
- H. SEISMIC DESIGN CRITERIA:
 - 1) GOVERNING CODE: ASCE 7-10
 - 2) RISK CATEGORY: III
 - 3) SEISMIC IMPORTANCE FACTOR, Ie: 1.25
 - 4) SOIL SITE CLASSIFICATION: C
 - 5) 0.2 SEC. MAPPED SPECTRAL ACCELERATION, Ss: 0.273
 - 6) 1.0 SEC. MAPPED SPECTRAL ACCELERATION, S1: 0.079
 - 7) SITE COEFFICIENT, 0.2 SEC. PERIOD, Fv: 1.2
 - 8) SITE COEFFICIENT, 1.0 SEC. PERIOD, Fv: 1.7
 - 9) 0.2 SEC. DESIGN SPECTRAL ACCELERATION, Sds: 0.218
 - 10) 1.0 SEC. DESIGN SPECTRAL ACCELERATION, Sd1: 0.089
 - 11) SEISMIC DESIGN CATEGORY: B
 - 12) SEISMIC PARAMETERS FOR BUILDING:
 - A) SEISMIC FORCE RESISTING SYSTEM: ORDINARY REINFORCED MASONRY SHEAR WALLS
 - B) RESPONSE MODIFICATION COEFFICIENT, R: 2.0
 - C) SYSTEM OVERSTRENGTH FACTOR, O1: 2.5
 - D) DEFLECTION AMPLIFICATION FACTOR, Cd: 1.75
 - E) ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE METHOD.
 - F) SEISMIC RESPONSE COEFFICIENT, Cs: 0.163
 - G) TOTAL LATERAL BASE SHEAR, CLASSROOM V: 220 KIPS
 - H) TOTAL LATERAL BASE SHEAR, OFFICE V: 55 KIPS

3. MATERIAL DESIGN VALUES

- A. CONCRETE (MINIMUM ULTIMATE COMPRESSIVE STRENGTH AT 28 DAYS, NORMAL WEIGHT U.N.O.):
 - 1) FOUNDATIONS: 3,500 PSI
 - 2) SLAB-ON-GRADE: 4,000 PSI
 - 3) ALL OTHER STRUCTURAL CONCRETE, U.N.O.: 4,000 PSI
- B. REINFORCED CONCRETE MASONRY
 - 1) DETERMINATION OF COMPRESSIVE STRENGTH: UNIT STRENGTH METHOD
 - 2) DESIGN COMPRESSIVE STRENGTH OF CONCRETE MASONRY, fm: 2,000 PSI
 - 3) NET AREA COMPRESSIVE STRENGTH OF CONCRETE MASONRY UNITS (ASTM C90) 2,000 PSI
 - 4) MORTAR (ASTM C270, PROPORTION SPECIFICATION, TYPE S) 1,800 PSI
 - 5) GROUT (ASTM C476, PROPORTION SPECIFICATION) 2,000 PSI
- C. CONCRETE AND MASONRY REINFORCEMENT (MINIMUM YIELD STRENGTH)
 - 1) ALL PLAIN AND DEFORMED BARS (ASTM A615, GRADE 60) FY = 60 KSI
 - 2) WELDABLE REINFORCING BARS (ASTM A706) FY = 60 KSI
- D. STRUCTURAL STEEL (MINIMUM YIELD STRENGTH)
 - 1) ALL WIDE FLANGE SHAPES (ASTM A992) FY = 50 KSI
 - 2) SQUARE AND RECTANGULAR HSS (ASTM A500, GRADE C) FY = 50 KSI
 - 3) ANCHOR RODS (ASTM F1554, GRADE 55, SUPPLEMENTARY REQUIREMENT S1, WELDABLE) FY = 55 KSI
 - 4) DEFORMED BAR ANCHORS (AWS D1.1 TYPE C, ASTM A1064) FY = 70 KSI
 - 5) HEADED STUD ANCHORS (AWS D1.1 TYPE B, ASTM A29, GRADES 1010 THROUGH 1020) FY = 51 KSI
 - 6) ALL OTHER SHAPES AND PLATES UNLESS NOTED (ASTM A36) FY = 36 KSI
- E. COLD FORMED STEEL (MINIMUM YIELD STRENGTH)
 - 1) ROOF DECK (ASTM A653, SS GRADE 33, G-60 GALVANIZED) FY = 33 KSI
 - 2) COLD FORMED METAL STUDS, 43 MIL AND LIGHTER (ASTM A1003/A, GRADE ST3H, G-60 GALVANIZED) FY = 33 KSI
 - 3) COLD FORMED METAL STUDS, 54 MIL AND HEAVIER (ASTM A1003/A, GRADE ST50H, G-60 GALVANIZED) FY = 50 KSI
 - 4) COLD FORMED METAL PIPS (ASTM A653, SS GRADE 50, G-90 GALVANIZED) FY = 50 KSI

4. CONSTRUCTION LOADS AND STABILITY

- A. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL TEMPORARY CONSTRUCTION LOADS CAN BE SAFELY SUPPORTED BY THE STRUCTURE DURING CONSTRUCTION.
- B. THE STRUCTURAL FRAMING SYSTEM AND FOUNDATIONS HAVE BEEN DESIGNED AS A COMPLETE STRUCTURAL SYSTEM FOR SUPPORT OF THE LOADS INDICATED IN THE CONSTRUCTION DOCUMENTS. THE STRUCTURE HAS NOT BEEN DESIGNED OR CHECKED FOR TEMPORARY CONSTRUCTION LOADS NOR HAS IT BEEN DESIGNED OR CHECKED FOR ADEQUACY OR STABILITY AS A PARTIALLY ERRECTED STRUCTURE.
- C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE ABILITY OF THE PARTIALLY COMPLETED OR FULLY COMPLETED STRUCTURE TO RESIST ALL CONSTRUCTION LOADS INCLUDING BUT ARE NOT NECESSARILY LIMITED TO MATERIAL STAGING, PERSONNEL, AND EQUIPMENT.
- D. THE CONTRACTOR SHALL PROVIDE TEMPORARY SHORES, GUYS, BRACES, AND OTHER SUPPORTS DURING CONSTRUCTION TO KEEP STRUCTURAL FRAMING COMPONENTS SECURE, PLUMB, AND IN ALIGNMENT AGAINST TEMPORARY CONSTRUCTION LOADS AND LOADS EQUAL IN INTENSITY TO DESIGN LOADS. THE TEMPORARY SUPPORTS SHALL BE SUFFICIENT TO SECURE THE PARTIALLY ERRECTED STRUCTURE OR ANY PORTION THEREOF AGAINST LOADS THAT ARE LIKELY TO BE ENCOUNTERED DURING CONSTRUCTION, INCLUDING THOSE DUE TO WIND AND THOSE THAT RESULT FROM CONSTRUCTION OPERATIONS.
- E. THE CONTRACTOR SHALL NOT REMOVE TEMPORARY SUPPORTS UNTIL THE INSTALLATION OF ALL STRUCTURAL ELEMENTS IS COMPLETE AND HAS BEEN ACCEPTED AS COMPLETE BY THE ENGINEER. FOR THE PURPOSES OF THIS PARAGRAPH, "ALL STRUCTURAL ELEMENTS" INCLUDES, BUT IS NOT NECESSARILY LIMITED TO, THE FOLLOWING STRUCTURAL ELEMENTS:
 - 1) FOUNDATIONS
 - 2) LOAD-BEARING MASONRY WALLS
 - 3) MASONRY SHEAR WALLS
 - 4) STRUCTURAL STEEL FRAMING WITH COMPLETED STEEL CONNECTIONS, INCLUDING PERMANENT VERTICAL AND/OR HORIZONTAL BRACING
 - 5) STEEL JOISTS INCLUDING JOIST BRIDGING
 - 6) ROOF DECK

5. EXISTING CONSTRUCTION

- A. ALL VERTICAL AND HORIZONTAL DIMENSIONS, FINISHED FLOOR AND ROOF ELEVATIONS, PLUMBNESS, AND DETAILS FOR THE EXISTING STRUCTURE SHALL BE VERIFIED IN THE FIELD PRIOR TO PROCEEDING WITH ANY DEMOLITION OR INSTALLATION OF NEW WORK.
- B. PRIOR TO DEMOLITION OR INSTALLATION OF NEW WORK, THE CONTRACTOR SHALL MAKE WRITTEN DOCUMENTATION IF UNFORESEEN CONDITIONS OCCUR IN THE EXISTING CONSTRUCTION. THESE UNFORESEEN CONDITIONS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR REVIEW AND A WRITTEN RESPONSE BEFORE PROCEEDING WITH THE WORK.
- C. THE CONTRACTOR SHALL PROVIDE AND INSTALL ALL SHORING, PROPS, AND GUYS REQUIRED FOR THE TEMPORARY SUPPORT OF THE EXISTING STRUCTURE, UTILITIES, ETC. AS MAY BE NECESSARY TO SAFELY COMPLETE DEMOLITION OR NEW WORK.
- D. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING EXISTING UTILITIES, BOTH CHARTED AND UNCHARTED BEFORE COMMENCING WITH ANY EXCAVATION OR DEMOLITION WORK. DEPTH OF CONCRETE SAW SHALL BE SET SO AS NOT TO CUT ANY LOCAL EMBEDDED OR UNDER-FLOOR PIPING OR WIRING WHICH IS TO REMAIN.
- E. ALL DRILLING, CUTTING, DEMOLITION OR OTHER MODIFICATIONS TO EXISTING CONSTRUCTION SHALL BE PERFORMED IN A MANNER THAT WILL NOT REDUCE THE STABILITY OR STRUCTURAL INTEGRITY OF THE EXISTING CONSTRUCTION. WHEN SAW CUTTING, SPECIAL CARE SHALL BE TAKEN TO NOT OVER CUT INTO AN EXISTING AREA OF STRUCTURE THAT WILL REMAIN.
- F. CORING FOR PIPING OR CONDUIT THROUGH EXISTING STRUCTURAL MEMBERS IS NOT ALLOWED UNLESS SPECIFICALLY SHOWN IN THE CONTRACT DOCUMENTS OR SPECIFICALLY ALLOWED BY THE STRUCTURAL ENGINEER IN WRITING.
- G. DAMAGE TO PORTIONS OF THE EXISTING STRUCTURE OR OTHER EXISTING BUILDING COMPONENTS CAUSED BY DEMOLITION OPERATIONS SHALL BE REPAIRED BY THE CONTRACTOR AT THE CONTRACTOR'S EXPENSE AND TO A LEVEL ACCEPTABLE TO THE OWNER'S REPRESENTATIVE.
- H. THE PROJECT AREA SHALL BE MAINTAINED AS CLEAN AS POSSIBLE WITH DUST BEING LIMITED AS MUCH AS PRACTICAL.

6. DEFERRED SUBMITTALS

- A. DEFERRED DESIGN SUBMITTALS ARE TO BE SUBMITTED TO THE OWNER'S REPRESENTATIVE AND SHALL INCLUDE BOTH SHOP DRAWINGS AND SIGNED AND SEALED CALCULATIONS PERFORMED BY AN ENGINEER LICENSED IN THE STATE WHERE THE PROJECT IS LOCATED AND EXPERIENCED IN THE DESIGN OF THE SPECIFIC BUILDING ELEMENT BEING SUBMITTED. THE FOLLOWING ITEMS ARE CONSIDERED DEFERRED SUBMITTALS:
 - 1) STEEL JOISTS
 - 2) ROOF MOUNTED EQUIPMENT AND ASSOCIATED ANCHORAGES
 - 3) ANALYSIS OF CONCRETE SLABS FOR SUPPORT OF PROPOSED LIFT EQUIPMENT (FOR KFC FILE ONLY, WILL NOT BE REVIEWED AND RETURNED)

- B. DOCUMENTS FOR DEFERRED SUBMITTAL ITEMS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE WHO SHALL REVIEW THEM AND FORWARD THEM TO THE BUILDING OFFICIAL WITH A NOTATION INDICATING THAT THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN REVIEWED AND FOUND TO BE IN GENERAL CONFORMANCE TO THE DESIGN OF THE BUILDING.
- C. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY BOTH THE OWNER'S REPRESENTATIVE AND THE BUILDING OFFICIAL.
- D. ADDITIONAL ITEMS IMPACTING STRUCTURAL DESIGN, INCLUDING BUT NOT LIMITED TO, ELEVATORS AND MECHANICAL EQUIPMENT WEIGHTS, SHALL BE SUBMITTED TO OWNER'S REPRESENTATIVE FOR EVALUATION

7. FOUNDATION NOTES

- A. GEOTECHNICAL REPORT: A GEOTECHNICAL ENGINEERING SERVICES REPORT FOR THE HIGHLAND WEST JUNIOR HIGH ADDITIONS LOCATED IN MOORE, OKLAHOMA WAS PERFORMED BY PROFESSIONAL SERVICE INDUSTRIES, INC. (PSI), DATED JULY 22, 2020 (PSI REPORT NO. 05462142-4)
- B. SITE SUB-GRADE PREPARATION:
 - 1) STRIPPING: SITE PREPARATION FOR THE BUILDING PAD SHALL INCLUDE REMOVING ANY SOFT OR UNSUITABLE MATERIALS ENCOUNTERED DURING CONSTRUCTION. VEGETATION ROOTS, PAVEMENTS, UTILITIES, GRAVEL, EXISTING FOOTINGS, EXISTING SLABS AND ANY TOPSOIL WILL REQUIRE REMOVAL DURING INITIAL SITE STRIPPING. REMOVED MATERIAL CAN EITHER BE WASTED OR STOCKPILED IN A NON-LOAD BEARING AREA FOR LATER USE. REMOVAL DEPTHS SHALL BE DETERMINED BY A GEOTECHNICAL ENGINEER.
 - 2) PROOF-ROLLING: AFTER MAKING ANY REQUIRED CUTS, THE CONSTRUCTION AREA SHALL BE PROOF-ROLLED (UNDER OBSERVATION OF A GEOTECHNICAL ENGINEER) WITH A TANDEM AXLE DUMP TRUCK WEIGHING AT LEAST 9 TONS/AXLE TO LOCATE ANY SOFT OR UNSTABLE AREAS. THE PROOF-ROLLING SHALL BE PERFORMED WITH OVERLAPPING PASSES IN MUTUALLY PERPENDICULAR DIRECTIONS. SOILS IN AREAS WHERE RUTTING (DEFLECTIONS GREATER THAN 1 INCH) OR PUMPING OCCURS DURING PROOF-ROLLING SHALL BE UNDERCUT AND RECOMPACTED IN PLACE OR REPLACED WITH PROPERLY COMPACTED ENGINEERED FILL. THE RECOMPACTED SOIL OR STRUCTURAL FILL SHALL BE MOISTURE CONDITIONED DURING PLACEMENT. THE PROOF-ROLLING AND UNDERCUTTING ACTIVITIES SHALL BE WITNESSED BY A REPRESENTATIVE OF THE GEOTECH ENGINEER AND SHALL BE PERFORMED DURING A PERIOD OF DRY WEATHER.
 - 3) SCARIFICATION: AFTER STRIPPING, EXCAVATING AND PROOF-ROLLING, THE EXPOSED SOILS SHALL BE SCARIFIED TO A DEPTH OF 8 INCHES AND THEN PROCESSED AT A MOISTURE CONTENT AT OR ABOVE ITS OPTIMUM VALUE AS DETERMINED BY THE STANDARD PROCTOR TEST. THE SUBGRADE SOIL SHALL BE RECOMPACTED TO AT LEAST 95 PERCENT OF ITS MAXIMUM DRY DENSITY AS DETERMINED BY THE STANDARD PROCTOR TEST METHOD (ASTM D-698).
 - 4) ACCEPTABLE FILL: STRUCTURAL FILL MATERIALS SHALL BE FREE OF ORGANIC OR OTHER DELETERIOUS MATTER, HAVE A MAXIMUM PARTICLE SIZE OF 3 INCHES, HAVE A LIQUID LIMIT NOT MORE THAN 35, A PLASTICITY INDEX IN THE RANGE OF 5 TO 18 AND FINE MATERIAL PASSING THE NO. 200 U.S. STANDARD SEIVE NOT LESS THAN 60%.
 - 5) FILL PLACEMENT: FILL SHALL BE PLACED IN MAXIMUM LIFTS OF 8 INCHES OF LOOSE MATERIAL AND SHALL BE COMPACTED WITHIN THE RANGE OF 2 PERCENT POINTS BELOW AND 3 PERCENTAGE POINTS ABOVE THE OPTIMUM MOISTURE CONTENT. EACH LIFT OF COMPACTED ENGINEERED FILL SHALL BE TESTED BY A REPRESENTATIVE OF THE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF SUBSEQUENT LIFTS. THE EDGES OF COMPACTED FILL SHALL EXTEND 5 FEET LATERALLY BEYOND THE BUILDING FOOTPRINT PRIOR TO SLOPING ON AS FLAT A GRADIENT AS PRACTICAL. STRUCTURAL FILL SHALL BE COMPACTED TO AT LEAST 95 PERCENT OF STANDARD PROCTOR MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-698.
 - 6) DEPTH OF FILL: FOOTINGS SHALL BE SUPPORTED ON NATIVE SOILS OR STRUCTURAL FILL. GROUND FLOOR SLABS SHALL BE GRADE SUPPORTED ON 2'-0" OF COMPACTED STRUCTURAL FILL PLACED AS DESCRIBED ABOVE.
 - 7) FILL PLACEMENT TESTING: EACH LIFT OF COMPACTED FILL SHALL BE TESTED BY A GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF SUBSEQUENT LIFTS. FIELD DENSITY TESTS SHALL BE TAKEN AT A MINIMUM OF ONE PER EVERY 2500 SF, BUT AT LEAST TWO SETS OF DENSITY TESTS SHALL BE TAKEN FOR EACH LIFT.
 - 8) SITE DRAINAGE: GRADING OF THE SITE AROUND THE STRUCTURE'S PADS SHALL BE ACCOMPLISHED TO ENABLE POSITIVE DRAINAGE AWAY FROM THE PADS BY PROVIDING AN ADEQUATE GRADIENT. THE SURFACE GRADIENT PROVIDED WILL BE DEPENDENT ON THE LANDSCAPING TYPE OF VEGETATION. WATER INFILTRATION AND SEEPAGE INTO THE FOUNDATION SHALL BE REDUCED AS MUCH AS POSSIBLE. IF IT IS POSSIBLE FOR WATER TO COLLECT BENEATH THE FOUNDATION AND FOUNDATION AREAS, IT WILL BE NECESSARY TO USE INTERCEPTOR DRAINS TO REMOVE THE COLLECTED WATER.
 - 9) MAINTENANCE OF SOIL MOISTURE: SOIL MOISTURE SHALL BE MAINTAINED UP UNTIL CONCRETE PLACEMENT TO PREVENT SHRINKAGE AND SUBSEQUENT POST-CONSTRUCTION SMELL OF SUBGRADE SOILS.
- C. SHALLOW FOUNDATIONS:
 - 1) FOOTING DESIGN PARAMETERS: THE PROPOSED BUILDING SHALL BE SUPPORTED ON CONVENTIONAL SHALLOW SPREAD FOOTINGS BASED ON THE FOLLOWING DESIGN PARAMETERS:
 - A) BEARING MATERIAL: NATIVE SOIL OR PROPERLY COMPACTED ENGINEERED FILL AS OUTLINED ABOVE
 - B) ALLOWABLE BEARING PRESSURE FOR SPOT FOOTINGS: 3,500 PSF
 - C) ALLOWABLE BEARING PRESSURE FOR CONTINUOUS FOOTINGS: 2,500 PSF
 - 2) OBSERVATION OF BEARING CONDITIONS: A REPRESENTATIVE OF THE GEOTECHNICAL ENGINEER SHALL OBSERVE THE FOUNDATION EXCAVATIONS PRIOR TO STEEL OR CONCRETE PLACEMENT TO DETERMINE IF THE FOUNDATION MATERIALS ARE CAPABLE OF SUPPORTING THE DESIGN LOADS AND ARE CONSISTENT WITH THE MATERIALS DISCUSSED ABOVE.
 - 3) IMPROVEMENT OF BEARING CONDITIONS: SOFT OR LOOSE SOIL ZONES ENCOUNTERED AT THE BOTTOM OF THE FOOTING EXCAVATIONS SHALL BE REMOVED TO THE LEVEL OF STIFF OR DENSE SOIL AS DIRECTED BY THE GEOTECHNICAL ENGINEER. CAVITIES FORMED AS A RESULT OF EXCAVATION OF SOFT OR LOOSE SOIL ZONES SHALL BE BACKFILLED WITH ENGINEERED FILL. LEAN CONCRETE OR FLOWABLE FILL, AS DETERMINED BY THE GEOTECHNICAL ENGINEER, CARE SHALL BE TAKEN TO PREVENT WETTING OR DRYING OF THE BEARING MATERIALS DURING CONSTRUCTION. ANY EXTREMELY WET OR DRY MATERIAL, OR ANY LOOSE OR DISTURBED MATERIAL IN THE BOTTOM OF THE FOOTING EXCAVATIONS SHALL BE REMOVED PRIOR TO PLACING CONCRETE.
 - 4) ANTICIPATED SETTLEMENT: IT IS ESTIMATED THAT FOUNDATIONS CONSTRUCTED IN ACCORDANCE WITH THE ABOVE RECOMMENDATIONS WILL EXPERIENCE TOTAL SETTLEMENTS GENERALLY LESS THAN 1-INCH WITH DIFFERENTIAL SETTLEMENTS GENERALLY LESS THAN 3/8 INCHES WITHIN THE BUILDING AREA.
 - 5) TRENCHED FOOTINGS: EARTH-FORMED TRENCHED FOOTINGS ARE PERMITTED, EXCEPT WHERE BRICK LEDGES OR EXPOSED SURFACES REQUIRE FORMING AND/OR WHERE SOIL SIDE WALLS SLOUGH INTO THE TRENCH. IN ORDER TO ACHIEVE 3" MINIMUM CONCRETE COVER OVER STEEL REINFORCING ON SIDEWALLS, EARTH FORMED TRENCHES SHALL BE A MINIMUM OF 2" WIDER THAN THE FORMED DIMENSIONS SHOWN IN ALL SECTIONS AND DETAILS.

- 6) PIPE PENETRATIONS: ALL HORIZONTAL PIPE OR SIMILAR PENETRATIONS OR SLEEVES THROUGH FOOTINGS SHALL PREFERABLY OCCUR WITHIN THE MIDDLE 1/3 OF THE FOOTING DEPTH AND SHALL HAVE A MAXIMUM OPENING DIAMETER OF ONE-FOURTH THE FOOTING DEPTH. AT PENETRATIONS, PROVIDE (4) #5 DIAGONAL BARS AT EACH FOOTING FACE (3" CLEAR BETWEEN BAR AND PENETRATION AND 3" CLEAR FROM FOOTING BEARING). IF PENETRATION MUST OCCUR NEAR THE BOTTOM OF FOOTING, REFER TYPICAL DETAILS FOR STANDARD DETAIL TO TRANSITION & THICKEN FOOTING TO ACCOMMODATE PENETRATION.

D. SLAB-ON-GRADE CONSTRUCTION

- 1) SLAB THICKNESS AND REINFORCING: SLABS-ON-GRADE SHALL BE 4" THICK CONCRETE REINFORCED WITH #3 BARS AT 15" ON CENTER EACH WAY. REINFORCING BARS SHALL BE PLACED 1 1/2" CLEAR FROM TOP OF SLAB USING CHAIRS OR SLAB BOLSTERS COMPLYING WITH CRSI'S "MANUAL OF STANDARD PRACTICE".
- 2) SLAB SUBGRADE: THE FLOOR SLAB SHALL BE GRADE-SUPPORTED AS OUTLINED IN THE SITE SUB-GRADE PREPARATION NOTES SHOWN ABOVE.
- 3) CONSTRUCTION MONITORING: CONSTRUCTION ACTIVITY MAY CAUSE DAMAGE AND DETEIORATION TO THE PREPARED SUBGRADE. A FIELD REPRESENTATIVE OF THE GEOTECHNICAL ENGINEER SHALL OBSERVE THE FINAL SUBGRADE PRIOR TO PLACEMENT OF THE SLAB ON GRADE, PERFORM FURTHER TESTING AS NECESSARY, AND DETERMINE IF ANY REMEDIAL MEASURES ARE NECESSARY PRIOR TO SLAB PLACEMENT.
- 4) AGGREGATE BASE COURSE: A 4-INCH THICK, FREE-DRAINING AGGREGATE BASE COURSE SHALL BE PLACED BENEATH THE FLOOR SLAB TO ENHANCE DRAINAGE AND PROVIDE INCREASED SUBGRADE STRENGTH. AT THE TIME OF THE SLAB PLACEMENT, THE GRANULAR BASE SHALL BE MOIST, BUT FREE OF ANY STANDING OR SELF-DRAINING WATER. THE AGGREGATE BASE COURSE MATERIAL SHALL MEET THE OKLAHOMA DEPARTMENT OF TRANSPORTATIONS STANDARD SPECIFICATION 701.3 TYPE "A" CRITERIA.
- 5) VAPOR RETARDER: A 15 MIL VAPOR RETARDER SHALL BE PLACED IMMEDIATELY BELOW THE CONCRETE SLAB. VAPOR RETARDER SHALL BE SEALED AT ALL LAPS AND SEALED TO PREVIOUSLY PLACED CONCRETE AS RECOMMENDED BY VAPOR RETARDER MANUFACTURER. BEFORE PLACING CONCRETE, PATCH AND SEAL ANY RIPS, TEARS OR HOLES IN VAPOR RETARDER INCURRED DURING CONSTRUCTION.
- 6) MOIST CURING OF SLAB: SLABS-ON-GRADE SHALL BE WATER CURED FOR A MINIMUM OF 7 DAYS BY FLOODING, SPRAYING, SPRINKLING OR BY USE OF SATURATED COVERINGS. CURING COMPOUNDS ARE EXPRESSLY PROHIBITED.
- 7) ISOLATION JOINTS: PROVIDE SLAB ISOLATION AROUND COLUMNS PENETRATING THE SLAB-ON-GRADE. PROVIDE 1/2 INCH PREMOLED EXPANSION JOINT MATERIAL AROUND PERIMETER OF ISOLATION JOINTS. REFER TO TYPICAL DETAILS AND ADDITIONAL INFORMATION.
- 8) SLAB JOINTS: SLAB JOINTS SHALL BE PROVIDED AS SHOWN ON THE PLANS AND TYPICAL DETAILS AND AS DESCRIBED FURTHER IN THE SLAB-ON-GRADE SCHEDULE. THE FOLLOWING JOINT TYPES ARE SHOWN ON THE DRAWINGS:
 - A) CJ = CONSTRUCTION JOINT
 - B) SJ = SAVED CONTRACTION JOINT
 - C) EJ = EXPANSION JOINT

E. FOUNDATION MISCELLANEOUS

- 1) GROUNDWATER CONDITIONS: GROUNDWATER WAS ENCOUNTERED IN SOME OF THE BORINGS AT THE TIME OF DRILLING. HOWEVER, IT IS POSSIBLE THAT TRANSIENT OVER-SATURATED GROUND CONDITIONS COULD DEVELOP AT SHALLOWER DEPTHS AT A LATER TIME DUE TO PERIODS OF HEAVY PRECIPITATION, LANDSCAPE WATERING, LEAKING WATER LINES, OR OTHER UNFORESEEN CAUSES. THE CONTRACTOR SHALL DETERMINE THE ACTUAL GROUNDWATER LEVELS AT TIME OF CONSTRUCTION. IF GROUNDWATER ISSUES ARE ENCOUNTERED DURING CONSTRUCTION, THE GEOTECHNICAL ENGINEER SHALL BE CONTACTED AND REQUESTED TO ASSESS THE POSSIBLE NEED FOR REMEDIAL MEASURES.
- 2) DRAINAGE CONSIDERATIONS DURING CONSTRUCTION: DUE TO ADVERSE EFFECT ON STRUCTURES, WATER SHALL NOT BE ALLOWED TO COLLECT IN THE FOUNDATION EXCAVATION OR ON PREPARED SUBGRADE OF THE CONSTRUCTION AREA EITHER DURING OR AFTER CONSTRUCTION. UNDERCUT OR EXCAVATED AREAS SHALL BE SLOPED TOWARD ONE CORNER TO FACILITATE REMOVAL OF ANY COLLECTED RAINWATER, OR POSITIVE RUNOFF SHALL BE PROVIDED. THE CONTRACTOR SHALL EXERCISE CARE IN CREATING DRAINAGE PATHS FOR WATER DURING THE CONSTRUCTION PHASE OF THE PROJECT. TO REDUCE INFILTRATION OF SURFACE WATER AROUND THE PERIMETER OF THE BUILDING AND BENEATH THE FLOOR SLABS, POSITIVE DRAINAGE SHALL BE PROVIDED DURING ALL PHASES OF CONSTRUCTION.
- 3) FINAL SITE GRADING: PER SECTION 1804.4 OF IBC-2015, THE GROUND IMMEDIATELY ADJACENT TO THE FOUNDATION SHALL BE SLOPED AWAY FROM THE BUILDING AT A SLOPE OF NOT LESS THAN ONE UNIT VERTICAL IN 20 UNITS HORIZONTAL (5-PERCENT SLOPE) FOR A MINIMUM DISTANCE OF 10 FEET PERPENDICULAR TO THE FACE OF THE WALL. IF PHYSICAL OBSTRUCTIONS OR LOT LINES PROHIBIT 10 FEET OF HORIZONTAL DISTANCE, A 5-PERCENT SLOPE SHALL BE PROVIDED TO AN APPROVED ALTERNATIVE METHOD OF DIVERTING WATER AWAY FROM THE FOUNDATION. SWALES USED FOR THIS PURPOSE SHALL BE SLOPED A MINIMUM OF 2-PERCENT WHERE LOCATED WITHIN 10 FEET OF THE BUILDING FOUNDATION. IMPERVIOUS SURFACES WITHIN 10 FEET OF THE BUILDING SHALL BE SLOPED A MINIMUM OF 2-PERCENT AWAY FROM THE BUILDING.
- 4) EXCAVATION AND TEMPORARY SLOPES: THE CONTRACTOR, DESIGNATED AS "RESPONSIBLE PERSON" IN OSHA CONSTRUCTION STANDARDS FOR EXCAVATIONS, 29 CFR PART 1926, IS SOLELY RESPONSIBLE FOR PLANNING AND IMPLEMENTING ALL SAFETY PROCEDURES DURING CONSTRUCTION. ALL EXCAVATION HEIGHT, SLOPE, AND DEPTH MUST ADHERE TO ALL SPECIFICATIONS OUTLINED IN LOCAL, STATE, AND FEDERAL SAFETY REGULATIONS. THE STRUCTURAL ENGINEER DOES NOT ASSUME ANY RESPONSIBILITY FOR CONSTRUCTION SITE SAFETY OR ANY PARTY'S, INCLUDING THE CONTRACTOR'S, COMPLIANCE WITH THE APPLICABLE LOCAL, STATE, AND FEDERAL SAFETY REGULATIONS OR ANY OTHER APPLICABLE REGULATIONS.
- 5) TRENCH BACKFILL: ALL REQUIRED TRENCH BACKFILL SHALL BE ACCEPTABLE FILL MATERIAL AS DEFINED ABOVE AND SHALL BE MECHANICALLY COMPACTED IN LAYERS TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 698. SOME SETTLEMENT OF THE BACKFILL MAY BE EXPECTED AND ANY UTILITIES WITHIN THE TRENCHES SHALL BE CONSTRUCTED TO ALLOW THESE DIFFERENTIAL MOVEMENTS. REFER TO PROJECT SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- 6) CONSTRUCTION MONITORING: A GEOTECHNICAL ENGINEER SHALL BE RETAINED TO PROVIDE OBSERVATIONS AND TESTING OF SOILS EXPOSED DURING PROJECT CONSTRUCTION IN ORDER TO VERIFY THAT SOIL CONDITIONS ARE AS ANTICIPATED. CONSTRUCTION ACTIVITIES PERTAINING TO EARTHWORK AND OTHER RELATED ACTIVITIES SHALL ALSO BE OBSERVED BY THE GEOTECHNICAL ENGINEER AS OUTLINED ABOVE.

8. CONCRETE CONSTRUCTION NOTES

- A. DESIGN CRITERIA: THE DESIGN OF CONCRETE IS GOVERNED BY "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE (ACI 318-14) AND COMMENTARY (ACI 318R-14)."
- B. CONCRETE CONSTRUCTION CRITERIA: ALL CONCRETE CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF "SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301-16)."
- C. TOLERANCES: TOLERANCES FOR CONCRETE CONSTRUCTION SHALL BE IN ACCORDANCE WITH "SPECIFICATION FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS (ACI 117-10) AND COMMENTARY (ACI 117R-10)."

D. CONCRETE MIXTURES:

- 1) CEMENTITIOUS MATERIALS
A) PORTLAND CEMENT: ASTM C150 TYPE I OR II UNLESS SPECIFICALLY NOTED OTHERWISE.
B) FLY ASH: ASTM C618 CLASS C OR F. THE MAXIMUM PERCENTAGE OF FLY ASH SHALL NOT EXCEED 25 PERCENT OF THE TOTAL CEMENTITIOUS MATERIAL.
2) ALL CONCRETE MIXES SHALL BE COMPRISED OF NORMAL WEIGHT AGGREGATES CONFORMING TO ASTM C33, EXCEPT WHERE SPECIFICALLY INDICATED AS LIGHTWEIGHT, IN WHICH CASE AGGREGATES SHALL CONFORM TO ASTM C330.
3) MIXING WATER SHALL CONFORM TO ASTM C1062. MIXING WATER, INCLUDING THAT PORTION OF MIXING WATER CONTRIBUTED IN THE FORM OF FREE MOISTURE ON AGGREGATES, SHALL NOT CONTAIN DELETERIOUS AMOUNTS OF CHLORIDE IONS.
4) ADMIXTURES, IF USED, SHALL CONFORM TO THE FOLLOWING:
A) WATER REDUCTION AND SETTING TIME MODIFICATION: ASTM C494.
B) PRODUCING FLOWING CONCRETE: ASTM C1017.
C) AIR ENTRAINMENT: ASTM C260.
D) INHIBITING CHLORIDE INDUCED CORROSION: ASTM C1582.
E) MOISTURE VAPOR REDUCING ADMIXTURE, MVRA: ASTM C494 & ASTM D5084.
5) MIX DESIGNS SHALL BE PROPORTIONED BASED ON THE FOLLOWING MIX CHARACTERISTICS:
A) FOUNDATIONS
1) FREEZING AND THAWING EXPOSURE CATEGORY (F): CLASS F1
2) SULFATE EXPOSURE CATEGORY (S): CLASS S0
3) WATER EXPOSURE CATEGORY (W): CLASS W0
4) CORROSION PROTECTION CATEGORY (C): CLASS C1
5) 28-DAY COMPRESSIVE STRENGTH: 3,500 PSI
6) MAXIMUM WATER/CEMENT RATIO: 0.55
7) MAXIMUM AGGREGATE SIZE: 1 1/2 INCHES
8) TARGET AIR CONTENT: 4.5 PERCENT PLUS OR MINUS 1.5 PERCENT
9) MAXIMUM WATER-SOLUBLE CHLORIDE ION CONTENT IN CONCRETE, PERCENT BY WEIGHT OF CEMENT: 0.30
B) SLABS-ON-GRADE
1) FREEZING AND THAWING EXPOSURE CATEGORY (F): CLASS F0
2) SULFATE EXPOSURE CATEGORY (S): CLASS S0
3) WATER EXPOSURE CATEGORY (W): CLASS W0
4) CORROSION PROTECTION CATEGORY (C): CLASS C0
5) 28-DAY COMPRESSIVE STRENGTH: 4,000 PSI
6) MAXIMUM WATER/CEMENT RATIO: 0.45
7) MAXIMUM AGGREGATE SIZE: 1 1/2-INCHES
8) TARGET AIR CONTENT: DO NOT ALLOW AIR CONTENT OF TROWEL-FINISHED FLOORS TO EXCEED 3 PERCENT
9) MAXIMUM WATER-SOLUBLE CHLORIDE ION CONTENT IN CONCRETE, PERCENT BY WEIGHT OF CEMENT: 1.00
10) MVRA ADMIXTURES SHALL BE APPLIED TO ALL SLABS-ON-GRADE CONCRETE MIXES.
6) CONCRETE MIX PROPORTIONS SHALL BE ESTABLISHED IN ACCORDANCE WITH ARTICLE 4.2.3 OF "SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301)." SO THAT THE CONCRETE SATISFIES THE FOLLOWING THREE REQUIREMENTS:
A) THE CONCRETE CAN BE PLACED READILY WITHOUT SEGREGATION INTO FORMS AND AROUND REINFORCEMENT UNDER ANTICIPATED PLACEMENT CONDITIONS. THE CONCRETE PRODUCER SHALL DETERMINE WHETHER ADMIXTURES ARE NECESSARY FOR WATER REDUCTION, SET TIME, OR SLUMP REQUIREMENTS.
B) THE CONCRETE SHALL MEET REQUIREMENTS FOR THE ASSIGNED EXPOSURE CLASSES OUTLINED HEREIN.
C) THE CONCRETE SHALL CONFORM TO STRENGTH TEST REQUIREMENTS FOR STANDARD-CURED SPECIMENS.
7) DOCUMENTATION OF CONCRETE MIXTURE CHARACTERISTICS SHALL BE SUBMITTED FOR REVIEW BEFORE THE MIXTURE IS USED. EVIDENCE OF THE ABILITY OF THE PROPOSED MIXTURE TO COMPLY WITH THE CONCRETE MIXTURE REQUIREMENTS IN THE CONSTRUCTION DOCUMENTS SHALL BE INCLUDED IN THE SUBMITTAL. THE EVIDENCE SHALL BE BASED ON FIELD TEST RECORDS OR LABORATORY TRIAL BATCHES.

E. CONCRETE REINFORCING:

- 1) ALL DETAILING, FABRICATION, AND PLACING OF REINFORCING STEEL, UNLESS OTHERWISE NOTED, SHALL FOLLOW ALL SECTIONS OF THE ACI "DETAILING MANUAL-2004" (SP-66 04), THE ACI "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE (ACI 318-14), AND ALL SECTIONS OF THE CONCRETE REINFORCING STEEL INSTITUTE (CRSI) "MANUAL OF STANDARD PRACTICE."
2) UNLESS OTHERWISE NOTED, LAP SPLICES OF DEFORMED REINFORCING BARS SHALL CONFORM TO ACI REQUIREMENTS FOR CLASS B TENSION SPLICES. REFER TO LAP LENGTH SCHEDULES FOR TYPICAL LAP REQUIREMENTS.
3) PLACEMENT OF WELDED WIRE REINFORCEMENT SHALL BE CONTINUOUS, SHALL NOT BE INTERRUPTED BY BEAMS AND GIRDERS, AND SHALL BE LAPPED A MINIMUM OF 6-INCHES UNLESS SHOWN OTHERWISE IN DETAILS.
4) PROVIDE CORNER BARS IN BOTH FACES OF ALL CONTINUOUS GRADE BEAMS, FOOTINGS AND WALLS. NUMBER, SIZE, AND SPACING OF CORNER BARS SHALL BE EQUAL TO NUMBER, SIZE AND SPACING OF HORIZONTAL REINFORCING WITH WHICH THEY LAP AND SHALL HAVE CLASS B TENSION LAP SPLICES IN EACH DIRECTION. REFER TO TYPICAL DETAILS FOR ADDITIONAL INFORMATION.
5) AT INTERSECTING FOUNDATIONS, EXTEND ALL HORIZONTAL REINFORCING OF THE INTERSECTING MEMBERS BEYOND THE POINT OF INTERSECTION TO THE OPPOSITE FACE. BEND TO A STANDARD 90 DEGREE HOOK OR PROVIDE BENT DOWELS OF EQUAL SIZE AND SPACING AND LAP AS REQUIRED FOR A CLASS B TENSION SPLICE (BUT NOT LESS THAN 12") IN EACH DIRECTION. REFER TO TYPICAL DETAILS FOR ADDITIONAL INFORMATION.
6) PROVIDE TIES COMPLYING WITH ACI 318-14 IN ALL CONCRETE COLUMNS AND PILLASTERS. EVERY CORNER AND ALTERNATING LONGITUDINAL BAR SHALL HAVE A LATERAL SUPPORT PROVIDED BY THE CORNER OF A TIE WITH AN INCLUDED ANGLE ON NOT MORE THAN 135-DEGREES. NO UNSUPPORTED LONGITUDINAL BAR SHALL BE FARTHER THAN 6-IN. CLEAR ON EACH SIDE ALONG THE TIE FROM A LATERALLY SUPPORTED BAR.

F. OPENINGS IN CONCRETE STRUCTURES:

- 1) ALL OPENINGS IN CONCRETE WALLS LARGER THAN 1'-0" IN SIZE SHALL HAVE A MINIMUM OF (2)#5 BARS PLACED AT ALL SIDES OF OPENING AND EXTENDED 2'-6" BEYOND EDGE OF OPENING. IN ADDITION, DIAGONAL CORNER BARS SHALL EXTEND 2'-6" EACH WAY BEYOND CORNER OF OPENING. REFER TYPICAL DETAILS FOR MORE INFORMATION.
2) THE SIZE AND LOCATION OF ALL FLOOR PITS, TRENCH DRAINS, AND OPENINGS FOR ALL DUCTS AND PIPES THROUGH WALLS, FLOORS, AND FOUNDATION WORK SHALL BE VERIFIED WITH THE MECHANICAL, PLUMBING, FIRE PROTECTION AND ELECTRICAL CONTRACTOR'S REQUIREMENTS PRIOR TO THE START OF ANY CONCRETE WORK.

G. JOINTS IN CONCRETE CONSTRUCTION:

- 1) CONCRETE SLABS-ON-GRADE: REFER TO SLAB-ON-GRADE CONSTRUCTION NOTES ABOVE FOR INFORMATION REGARDING JOINTS.
2) CURING AT CONSTRUCTION JOINTS: CONCRETE POURS EITHER SIDE OF CONSTRUCTION JOINTS SHALL NOT BE CONCURRENT. CONCRETE SHALL BE ALLOWED TO CURE A MINIMUM OF 7 DAYS PRIOR TO PLACEMENT OF ADJACENT CONCRETE.

H. CONCRETE MISCELLANEOUS:

- 1) WATERSTOPS AND WATERPROOFING: ALL CONSTRUCTION JOINTS (VERTICAL AND HORIZONTAL) IN BELOW-GRADE CONCRETE WALLS, TRENCHES AND PITS SHALL BE KEVED AND HAVE BENTONITE WATERSTOPS INSTALLED UNLESS NOTED OTHERWISE. ALL BELOW-GRADE CONCRETE WALLS, PITS AND TRENCHES SHALL BE WATERPROOFED AS SHOWN IN ARCHITECTURAL DRAWINGS, UNLESS NOTED OTHERWISE.
2) EQUIPMENT PADS: PROVIDE CONCRETE EQUIPMENT PADS OF SIZE REQUIRED FOR EQUIPMENT FURNISHED. SEE MECHANICAL, PLUMBING, FIRE PROTECTION AND ELECTRICAL DRAWINGS FOR NUMBER, SIZE, AND LOCATION OF SUCH PADS. UNLESS OTHERWISE SHOWN, MINIMUM PAD THICKNESS SHALL BE 4" AND SHALL EXTEND A MINIMUM OF 6" BEYOND THE FACE OF THE EQUIPMENT. MINIMUM REINFORCING SHALL BE #4 BARS AT 12" O.C. EACH WAY. TOOLED OR CHAMFERED EDGES SHALL BE PROVIDED AT ALL EQUIPMENT PADS. ANCHORAGE TO SUPPORTING SLAB SHALL BE MADE. REFER TO TYPICAL DETAILS.
3) CHAMFERED EDGES: UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS, PROVIDE 3/4" CHAMFER ON ALL EXPOSED CONCRETE EDGES.
4) SURFACE FINISH: ALL HORIZONTAL CONCRETE SURFACES SHALL HAVE A TROWELED FINISH UNLESS NOTED OTHERWISE IN ARCHITECTURAL DRAWINGS OR FLOORING SPECIFICATIONS.
5) MOIST CURING OF SLABS: SLABS-ON-GRADE AND SLABS-ON-DECK SHALL BE WATER CURED FOR A MINIMUM OF 7 DAYS BY PONDING, SPRAYING, SPRINKLING OR BY USE OF SATURATED COVERINGS. CURING COMPOUNDS ARE EXPRESSLY PROHIBITED.

9. REINFORCED HOLLOW CONCRETE MASONRY NOTES

- A. MASONRY DIMENSIONS: REFER TO ARCHITECTURAL DRAWINGS FOR ALL DIMENSIONS RELEVANT TO ALL CONCRETE MASONRY CONSTRUCTION.
B. CONCRETE MASONRY UNITS:
1) ALL CONCRETE MASONRY UNITS SHALL BE 1 OR 2-CELL LIGHTWEIGHT CONCRETE BLOCK WITH AN OVEN DRY WEIGHT OF LESS THAN 105 LBS PER CUBIC FOOT.
2) ALL CONCRETE MASONRY UNITS SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI ON THE NET AREA (INDIVIDUAL STRENGTH PER ASTM C 90).

C. MORTAR:

- 1) MORTAR MATERIALS: CONCRETE MASONRY SHALL BE CONSTRUCTED WITH PORTLAND CEMENT/LIME, TYPE S MORTAR CONFORMING TO THE PROPORTION SPECIFICATION OF ASTM C270.
2) MORTAR SUBMITTAL REQUIREMENTS: BECAUSE THE PROPORTION SPECIFICATION FOR MORTAR IS PRESCRIPTIVE, THERE ARE NO MORTAR TESTS REQUIRED. SUBMITTAL INFORMATION SHALL INCLUDE THE PROPORTIONS OF MORTAR MATERIALS AND CERTIFICATES OF COMPLIANCE FOR EACH RAW MATERIAL USED.
3) MORTAR MIX PROPORTIONS: MORTAR MATERIAL PROPORTIONS BY VOLUME SHALL BE AS FOLLOWS:
A) PORTLAND CEMENT: 1
B) HYDRATED LIME OR LIME PUTTY: OVER 0.25 TO 0.50
C) AGGREGATE RATIO (MEASURED IN DAMP LOOSE CONDITIONS): NOT LESS THAN 2.25 AND NOT MORE THAN 3.0 TIMES THE SUM OF THE VOLUMES OF CEMENT AND LIME MATERIALS.
4) MORTAR MIXING: MIX CEMENTITIOUS MATERIALS AND AGGREGATES BETWEEN 3 AND 5 MINUTES IN A MECHANICAL BATCH MIXER WITH A SUFFICIENT AMOUNT OF WATER TO PRODUCE A WORKABLE CONSISTENCY. UNLESS SPECIFICALLY ALLOWED BY THE OWNER'S REPRESENTATIVE, DO NOT HAND MIX MORTAR. MAINTAIN WORKABILITY OF MORTAR BY REMIXING OR RETEMPERING. DISCARD MORTAR WHICH HAS BEGUN TO STIFFEN OR IS NOT USED WITHIN 2.5 HOURS AFTER INITIAL MIXING.
5) MORTAR PROTRUSIONS: REMOVE MORTAR PROTRUSIONS EXTENDING 1/2-INCH OR MORE INTO CELLS OR CAVITIES TO BE GROUDED.
6) ADMIXTURES: DO NOT USE ADMIXTURES CONTAINING MORE THAN 0.2 PERCENT CHLORIDE IONS.
7) MORTAR QUALITY ASSURANCE: TESTING AGENCY SHALL PERIODICALLY OBSERVE AND CONFIRM THAT THE PROPORTIONS OF SITE-PREPARED MORTAR COMPLY WITH THE PROPORTIONS OUTLINED ABOVE.

D. GROUT:

- 1) GROUT MATERIALS: GROUT USED IN THE CONSTRUCTION OF MASONRY SHALL CONFORM TO THE PROPORTION SPECIFICATION OF ASTM C476. GROUT AGGREGATES SHALL COMPLY WITH ASTM C404.
2) GROUT SUBMITTAL REQUIREMENTS: BECAUSE THE PROPORTION SPECIFICATION FOR GROUT IS PRESCRIPTIVE, THERE ARE NO GROUT TESTS REQUIRED. SUBMITTAL INFORMATION SHALL INCLUDE THE PROPORTIONS OF GROUT MATERIALS AND CERTIFICATES OF COMPLIANCE FOR EACH RAW MATERIAL USED.
3) GROUT MIX PROPORTIONS: GROUT MATERIAL PROPORTIONS BY VOLUME SHALL BE AS FOLLOWS:

Table with 4 columns: GROUT TYPE, CEMENT, LIME, AGGREGATE (DAMP, LOOSE) * (FINE, COARSE). Rows for FINE and COARSE grout types.

*TIMES THE SUM OF THE VOLUMES OF THE CEMENT & LIME MATERIALS

- 4) GROUT SLUMP: SITE-MIX GROUT TO A CONSISTENCY THAT HAS A SLUMP BETWEEN 8 AND 11 INCHES. DISCARD GROUT THAT DOES NOT MEET THE SPECIFIED SLUMP WITHOUT ADDING WATER AFTER INITIAL MIXING.
5) GROUT QUALITY ASSURANCE: TESTING AGENCY SHALL PERIODICALLY OBSERVE AND CONFIRM THAT THE PROPORTIONS AND SLUMP OF SITE-PREPARED GROUT COMPLY WITH THE REQUIREMENTS OUTLINED ABOVE.
E. INSPECTION: PRIOR TO THE START OF MASONRY CONSTRUCTION, THE CONTRACTOR SHALL VERIFY THE FOLLOWING:
1) VERIFY FOUNDATIONS ARE CONSTRUCTED WITHIN A LEVEL ALIGNMENT TOLERANCE OF PLUS OR MINUS 1/2 IN.
2) VERIFY REINFORCING DOWELS ARE POSITIONED IN ACCORDANCE WITH THE PROJECT DRAWINGS.
3) IF STATED CONDITIONS ARE NOT MET, NOTIFY THE OWNER'S REPRESENTATIVE PRIOR TO PROCEEDING.

F. PREPARATION:

- 1) CLEANING:
A) CLEAN REINFORCEMENT AND SHANKS OF ANCHOR BOLTS BY REMOVING MUD, OIL, OR OTHER MATERIALS THAT WILL ADVERSELY AFFECT OR REDUCE BOND AT THE TIME MORTAR OUR GROUT IS PLACED.
B) PRIOR TO PLACING MASONRY, REMOVE LAITANCE, LOOSE AGGREGATE, AND ANYTHING ELSE THAT WOULD PREVENT MORTAR FROM BONDING TO THE FOUNDATION.
2) THE MINIMUM LENGTH OF LAP SPLICES OF REINFORCING STEEL IN MASONRY SHALL BE AS SHOWN IN THE CMU REINFORCING LAP SCHEDULE.

2) WETTING: DO NOT WET CONCRETE MASONRY UNITS BEFORE LAYING. WET CUTTING IS PERMITTED.

- 3) DEBRIS: CONSTRUCT GROUT SPACES FREE OF MORTAR DROPPING, DEBRIS, LOOSE AGGREGATES, AND ANY MATERIAL DELETERIOUS TO MASONRY GROUT.
4) REINFORCEMENT: PLACE REINFORCEMENT AND TIES IN GROUT SPACES PRIOR TO GROUTING.
5) CLEANOUTS: PROVIDE CLEANOUTS IN THE BOTTOM COURSE OF MASONRY FOR EACH GROUT POUR WHEN THE GROUT POUR HEIGHT EXCEEDS 5 FT 4 IN.
A) CONSTRUCT CLEANOUTS SO THAT THE SPACE TO BE GROUDED CAN BE CLEANED AND INSPECTED, IN SOLID GROUDED MASONRY, SPACE CLEANOUTS HORIZONTALLY A MAXIMUM OF 32 IN. ON CENTER.
B) CONSTRUCT CLEANOUTS WITH AN OPENING OF SUFFICIENT SIZE TO PERMIT REMOVAL OF DEBRIS. THE MINIMUM OPENING DIMENSION SHALL BE 3 IN.
C) AFTER CLEANING, CLOSE CLEANOUTS WITH CLOSURES BRACED TO RESIST GROUT PRESSURE.

G. MASONRY ERECTION:

- 1) BOND PATTERN: UNLESS OTHERWISE INDICATED, LAY MASONRY IN RUNNING BOND.
2) PLACING MORTAR UNITS: COMPLY WITH ARTICLE 3.3 B OF ACI 530.1-13 "SPECIFICATION FOR MASONRY STRUCTURES AND COMMENTARY" INCLUDING BUT NOT LIMITED TO THE FOLLOWING:
A) BED JOINTS AT FOUNDATIONS: IN THE STARTING COURSE ON FOUNDATIONS AND OTHER SUPPORTING MEMBERS, CONSTRUCT BED JOINTS SO THAT THE BED JOINT THICKNESS IS AT LEAST 1/4 IN. AND NOT MORE THAN:
(i) 3/4 IN. WHEN THE MASONRY IS UNGROUTED OR PARTIALLY GROUDED
(ii) 1-1/4 IN. WHEN THE FIRST COURSE OF MASONRY IS SOLID GROUDED AND SUPPORTED BY A CONCRETE FOUNDATION.
B) OPENINGS IN TROUGH BLOCKS: AT ALL VERTICAL REINFORCING LOCATIONS, THE BOTTOM OF TROUGH BLOCKS SHALL BE CUT TO PROVIDE A MINIMUM 2-INCH DIAMETER HOLE TO ALLOW PLACEMENT OF VERTICAL REINFORCING AND PLACEMENT OF GROUT THROUGH THE HOLE.
3) EMBEDDED ITEMS AND ACCESSORIES: COMPLY WITH ARTICLE 3.3 D OF ACI 530.1-13 "SPECIFICATION FOR MASONRY STRUCTURES AND COMMENTARY."
4) TEMPORARY BRACING OF MASONRY: DESIGN, PROVIDE, AND INSTALL TEMPORARY BRACING THAT WILL ASSURE STABILITY OF MASONRY DURING CONSTRUCTION.

5) SITE TOLERANCES: ERECT MASONRY WITHIN THE TOLERANCES DEFINED IN ARTICLE 3.3 F OF ACI 530.1-13 "SPECIFICATION FOR MASONRY STRUCTURES AND COMMENTARY."

- 6) PLACING REINFORCING: COMPLY WITH ALL PROVISIONS OF ARTICLE 3.4 OF ACI 530.1-13 "SPECIFICATION FOR MASONRY STRUCTURES AND COMMENTARY." MAINTAIN CLEAR DISTANCE BETWEEN REINFORCING BARS AND ANY FACE OF MASONRY UNIT OR FORMED SURFACE, BUT NOT LESS THAN 1/4-IN FOR FINE GROUT OR 1/2-IN. FOR COARSE GROUT.
7) CONTROL JOINTS: LOCATION AND DETAILS OF CONTROL JOINTS SHALL BE AS DEFINED ON ARCHITECTURAL DRAWINGS. IF NOT SHOWN ON THE ARCHITECTURAL DRAWINGS, THE LOCATION OF CONTROL JOINTS SHALL BE DETAILED BY THE MASONRY CONTRACTOR AND SUBMITTED FOR REVIEW AND APPROVAL BY THE ARCHITECT AND ENGINEER. THE DISTANCE BETWEEN CONTROL JOINTS SHOULD NOT EXCEED THE LESSER OF 1.5 TIMES THE WALL HEIGHT OR 25 FT. IN ADDITION, CONTROL JOINTS SHOULD TYPICALLY BE PROVIDED AT THE FOLLOWING LOCATIONS:
A) AT CHANGES IN WALL HEIGHT.
B) AT PILLASTERS AND CHANGES IN WALL THICKNESS.
C) DIRECTLY OVER EXPANSION JOINTS IN SUPPORTING FOUNDATIONS.
D) AT EXPANSION JOINTS IN ROOFS AND FLOORS THAT BEAR ON THE WALL.
E) NEAR ONE SIDE OF OPENINGS LESS THAN 6 FT. WIDE. REFER TYPICAL MASONRY OPENING DETAILS.
F) NEAR BOTH SIDES OF OPENINGS GREATER THAN 6 FT. WIDE. REFER TYPICAL MASONRY OPENING DETAILS.
G) AT INTERSECTING WALLS.
H) AT MAXIMUM OF ONE-HALF THE TYPICAL CONTROL JOINTS SPACING FROM CORNERS.

- 8) PENETRATIONS: OPENINGS FOR ALL DUCTS AND PIPES PENETRATING MASONRY WALLS SHALL BE VERIFIED AND COORDINATED WITH MECHANICAL AND ELECTRICAL CONTRACTORS REQUIREMENTS. PENETRATIONS THROUGH WALLS SHALL HAVE ADDITIONAL REINFORCING AS SHOWN ON IN THE TYPICAL DETAILS.
9) LINTELS: LINTELS SHALL BE PROVIDED WHERE REQUIRED ACCORDING TO TYPICAL LINTEL DETAILS AND SCHEDULE OR AS INDICATED ON PLAN SHEETS. SOLID BOTTOM TROUGH BLOCKS SHALL BE USED AT THE HEADS OF ALL OPENINGS.
10) PERMANENT BRACING: UNLESS BRACED BY ATTACHMENT TO A STRUCTURAL SLAB OR METAL DECK, THE TOP OF MASONRY WALLS SHALL BE BRACED IN ACCORDANCE WITH THE TYPICAL DETAILS SHOWN IN THE DRAWINGS.

H. CONCRETE MASONRY REINFORCING:

- 1) MINIMUM HORIZONTAL AND VERTICAL REINFORCING IN CMU WALLS SHALL BE PROVIDED AS FOLLOWS:

Table with 4 columns: WALL TYPE, CMU TYPE, MINIMUM REINFORCING IN CMU WALLS (GROUTED VERTICAL CELL REINFORCING, HORIZONTAL BOND BEAM REINFORCING), SPACING OF BOND BEAMS. Rows for EXTERIOR, INTERIOR LOAD-BEARING, INTERIOR PARTITION.

- 2) THE MINIMUM LENGTH OF LAP SPLICES OF REINFORCING STEEL IN MASONRY SHALL BE AS SHOWN IN THE CMU REINFORCING LAP SCHEDULE.

3) FOUNDATION DOWELS:

- A) THERE SHALL BE A FOUNDATION DOWEL FOR EACH VERTICAL WALL REINFORCING BAR.
B) THE MINIMUM REQUIRED EMBEDMENT OF DOWELS IN CONCRETE FOUNDATIONS SHALL BE AS REQUIRED FOR A CLASS B SPLICE FOR THE SPECIFIED COMPRESSIVE STRENGTH FOR THE FOUNDATION. REFER TO CONCRETE LAP LENGTH SCHEDULES FOR TYPICAL LAP REQUIREMENTS. ALTERNATIVELY, THE FOUNDATION DOWELS MAY BE DEVELOPED WITH A STANDARD ACI 90 DEGREE HOOK INTO THE FOUNDATION.
C) MASONRY DOWELS SHOWN CAST-IN-PLACE IN DOCUMENTS SHALL BE TIED IN PLACE TO FOUNDATION REINFORCING. WET STICKING OF MASONRY DOWELS IS NOT PERMITTED. MASONRY CONTRACTOR SHALL VERIFY PLACEMENT AND LOCATION OF DOWELS PRIOR TO CONCRETE PLACEMENT. EPOXY EMBEDDING DOWELS SHALL NOT BE PERMITTED WITHOUT APPROVAL BY THE OWNER'S REPRESENTATIVE.
D) AT CONTRACTOR'S OPTION, FOUNDATION DOWELS MAY BE DRILLED AND GROUDED WITH EPOXY MATERIAL TO DEVELOP THE TENSILE CAPACITY OF THE BAR IN ACCORDANCE WITH POST-INSTALLED ANCHORS AND DOWEL NOTES BELOW. EPOXY MANUFACTURER INFORMATION AND EMBEDMENT DEPTH SHALL BE SUBMITTED FOR REVIEW AND APPROVAL BY THE OWNER'S REPRESENTATIVE PRIOR TO PLACEMENT OF WALL FOUNDATIONS.
E) FOUNDATION DOWELS SHALL EXTEND UP INTO THE GROUDED CELLS TO PROVIDE THE MINIMUM LAP SPLICE LENGTH SHOWN IN THE CMU REINFORCING LAP SCHEDULE.
F) FOUNDATION DOWELS THAT INTERFERE WITH UNIT WEBS ARE PERMITTED TO BE BENT A MAXIMUM OF 1 IN. HORIZONTALLY FOR EVERY 6 IN. OF VERTICAL HEIGHT. REFER TYPICAL DETAIL FOR PERMITTED BENDING OF FOUNDATION DOWELS.

- 4) NORMAL VERTICAL WALL REINFORCING SHALL EXTEND CONTINUOUSLY FROM THE TOP OF FOUNDATION TO EMBED WITH A STANDARD HOOK INTO THE FLOOR OR ROOF DIAPHRAGM BOND BEAM. THE DIAPHRAGM BOND BEAM SHALL BE DEFINED AS THE BOND BEAM AT THE FLOOR OR ROOF LEVEL OR WHERE KICKER ANGLES OR CLIP ANGLES ARE PROVIDE LATERAL SUPPORT.

- 5) BOND BEAM REINFORCING STEEL FOR INTERIOR AND EXTERIOR WALLS SHALL BE CONTINUOUS THROUGHOUT, EXCEPT AT CONTROL JOINTS. AT CONTROL JOINTS, INTERMEDIATE BOND BEAM REINFORCEMENT SHALL BE CUT, BUT SHALL BE CONTINUOUS AT DIAPHRAGM BOND BEAMS. EXTEND REINFORCING BARS NOT LESS THAN THAT SPECIFIED ON LAP SCHEDULE. REFER TO TYPICAL DETAILS AND LAP SCHEDULE FOR ADDITIONAL INFORMATION.

I. GROUT PLACEMENT:

- 1) GROUT PLACING TIME: PLACE GROUT WITHIN 1-1/2 HOURS FROM INTRODUCING WATER IN THE MIXTURE AND PRIOR TO INITIAL SET.
2) GROUT POUR HEIGHT: DO NOT EXCEED THE MAXIMUM GROUT POUR HEIGHT GIVEN IN THE TABLE BELOW. THE GROUT POUR HEIGHT IS DEFINED AS THE TOTAL HEIGHT OF MASONRY TO BE GROUDED PRIOR TO ERECTION OF ADDITIONAL MASONRY. A GROUT POUR CONSISTS OF ONE OR MORE GROUT LIFTS.

Table: GROUT SPACE REQUIREMENTS PER ACI 530-13 BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES, TABLE 3.2.1. Columns: GROUT TYPE, MAXIMUM GROUT POUR HEIGHT, FT., MINIMUM CLEAR WIDTH OF GROUT SPACE, MINIMUM CLEAR GROUT SPACE DIMENSIONS FOR GROUTING CELLS OF HOLLOW UNITS, 3,4 IN. X IN. Rows: FINE, COARSE.

- 3) GROUT LIFT HEIGHT: PLACE GROUT IN LIFTS NOT EXCEEDING 5 FT. 4 IN. A GROUT LIFT IS DEFINED AS AN INCREMENT OF GROUT HEIGHT WITHIN A TOTAL GROUT POUR.
4) GROUT CONSOLIDATION: CONSOLIDATE GROUT POURS BY MECHANICAL VIBRATION, AND RECONSOLIDATE BY MECHANICAL VIBRATION AFTER INITIAL WATER LOSS AND SETTLEMENT HAS OCCURRED.

- 5) GROUT KEY: WHEN GROUDED, FORM GROUT KEYS BETWEEN GROUT POURS. FORM GROUT KEYS BETWEEN GROUT LIFTS WHEN THE FIRST LIFT IS PERMITTED TO SET PRIOR TO PLACEMENT OF THE SUBSEQUENT LIFT.
A) FORM A GROUT KEY BY TERMINATING THE GROUT A MINIMUM OF 1-1/2 IN. BELOW A MORTAR JOINT.
B) DO NOT FORM GROUT KEYS WITHIN BOND BEAMS.
C) AT BOND BEAMS OR LINTELS LAID WITH CLOSED BOTTOM UNITS, TERMINATE THE GROUT POUR AT THE BOTTOM OF THE BEAM OR LINTEL WITHOUT FORMING A GROUT KEY.

10. POST-INSTALLED ANCHORS AND DOWELS

A. QUALIFICATION REQUIREMENTS FOR INSTALLERS

- 1) CONTRACTOR SHALL REQUEST, SCHEDULE AND FACILITATE THE ANCHOR AND/OR ADHESIVE MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL THE MANUFACTURER'S SPECIFIED ANCHORING PRODUCTS. THE ENGINEER MUST RECEIVE DOCUMENTED CONFIRMATION THAT ALL OF THE CONTRACTOR'S ANCHOR INSTALLATION PERSONNEL ARE TRAINED PRIOR TO COMMENCEMENT OF ANCHOR INSTALLATION OPERATIONS.
2) PER ACI 318-14 SECTION 17.8.2.2, INSTALLATION OF ADHESIVE ANCHORS HORIZONTALLY OR UPWARDLY INCLINED SHALL BE PERFORMED BY PERSONNEL CERTIFIED BY AN APPLICABLE CERTIFICATION PROGRAM. CERTIFICATION SHALL INCLUDE WRITTEN AND PERFORMANCE TESTS IN ACCORDANCE WITH THE ACI/CRSI ADHESIVE ANCHOR INSTALLER (AAI) CERTIFICATION PROGRAM, OR EQUIVALENT, WHEN APPLICABLE. SOME DOWN-HOLE INSTALLATIONS SHOWN ON DRAWINGS SUPPORTING SUSTAINED TENSION LOADS ARE DESIGNATED WITH A (CERT) AFTER THE ANCHOR CALLOUT AND SHALL ALSO REQUIRE INSTALLER CERTIFICATION AS OUTLINED ABOVE.

B. QUALIFICATION REQUIREMENTS FOR PRODUCTS

- 1) POST-INSTALLED EXPANSION AND UNDERCUT ANCHORS SHALL MEET THE ASSESSMENT CRITERIA OF ACI 355.2 "QUALIFICATION OF POST-INSTALLED MECHANICAL ANCHORS IN CONCRETE."
2) POST-INSTALLED ADHESIVE ANCHORS SHALL MEET THE ASSESSMENT CRITERIA OF ACI 355.4 "QUALIFICATION OF POST-INSTALLED ADHESIVE ANCHORS IN CONCRETE."



201 N. BROADWAY SUITE 210 MOORE, OK. 73160 405.735.3477 AGP@theAGP.net www.theAGP.net

CEDAR CREEK


CIVIL

KFC ENGINEERING

STRUCTURAL

SALAS O'BRIEN

MECHANICAL/ELECTRICAL

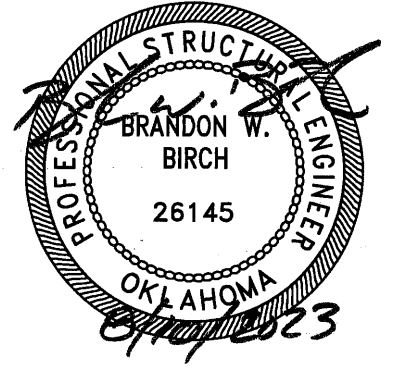

CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS BOARD OF EDUCATION MOORE, OKLAHOMA



MOORE Public Schools LEARNING FOR LIFE

CLASSROOM ADDITION HIGHLAND WEST JUNIOR HIGH SCHOOL

Sheet no:

S101

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.



C. APPROVED ANCHORING PRODUCTS: THE ANCHORING SYSTEMS SHOWN BELOW HAVE BEEN USED IN THE ANCHOR DESIGNS SHOWN IN THE CONSTRUCTION DOCUMENTS. SUBSTITUTION REQUESTS FOR ALTERNATE PRODUCTS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD PRIOR TO USE. CONTRACTOR SHALL PROVIDE CALCULATIONS DEMONSTRATING THAT THE SUBSTITUTED PRODUCT IS CAPABLE OF ACHIEVING THE PERFORMANCE VALUES OF THE SPECIFIED PRODUCT. SUBSTITUTIONS WILL BE EVALUATED BY THEIR HAVING AN ICC ESR SHOWING COMPLIANCE WITH THE RELEVANT BUILDING CODE FOR SEISMIC USES, LOAD RESISTANCE, INSTALLATION CATEGORY, AND AVAILABILITY OF COMPREHENSIVE INSTALLATION INSTRUCTIONS. ADHESIVE ANCHOR EVALUATION WILL ALSO CONSIDER CREEP, IN-SERVICE TEMPERATURE AND INSTALLATION TEMPERATURE.

1) ANCHORAGE TO CONCRETE

A) ADHESIVE ANCHORS:
(1) HILTI HIT-HY 200 SYSTEM WITH HILTI HIT-Z ROD OR HAS-E THREADED ROD [ICC ESR-3187].

B) MEDIUM DUTY MECHANICAL ANCHORS:
(1) HILTI KWIK BOLT 3 EXPANSION ANCHORS (UNCRACKED CONCRETE ONLY) [ICC ESR-2302]

2) REBAR DOWELING INTO CONCRETE

A) ADHESIVE ANCHORS:
(1) HILTI HIT-HY 200 SYSTEM WITH CONTINUOUSLY DEFORMED REBAR [ICC ESR-3187].

3) ANCHORAGE TO SOLID GROUTED MASONRY

A) ADHESIVE ANCHORS:
(1) HILTI HIT-HY 270 MASONRY ADHESIVE ANCHORING SYSTEM WITH HILTI HAS-E CONTINUOUSLY THREADED ROD OR CONTINUOUSLY DEFORMED STEEL REBAR [ICC ESR-4143].

B) MECHANICAL ANCHORS:
(1) HILTI KWIK BOLT-3 EXPANSION ANCHORS [ICC ESR-1385].

D. PREPARATION PRIOR TO INSTALLATION

- CURING OF BASE MATERIAL: DO NOT DRILL OR CORE HOLES INTO SUPPORTING CONCRETE OR MASONRY MATERIALS UNTIL THE CONCRETE, MORTAR AND/OR GROUT HAVE BEEN ADEQUATELY CURED TO ACHIEVE FULL DESIGN STRENGTH. IN NO CASE SHALL ANCHORS BE INSTALLED PRIOR TO THE CONCRETE HAVING AN AGE OF LESS THAN 21 DAYS.
- AVOIDANCE OF EMBEDDED ITEMS: PRIOR TO DRILLING OR CORING OPERATIONS, THE CONTRACTOR SHALL LOCATE AND MARK ALL POTENTIALLY CONFLICTING REINFORCING BARS, UTILITIES AND OTHER EMBEDDED ITEMS BY INDUCTION SCANNING, GROUND PENETRATING RADAR, X-RAY, OR OTHER APPROVED NON-DESTRUCTIVE METHOD. CONTRACTOR SHALL AVOID DRILLING OR CORING HOLES THAT MAY DAMAGE THESE EMBEDDED ITEMS. NOTIFY THE ENGINEER IF CONFLICTING EMBEDDED ITEMS DO NOT ALLOW INSTALLATION OF POST-INSTALLED ANCHORS IN ACCORDANCE WITH THE CONSTRUCTION DOCUMENTS AND/OR APPROVED SHOP DRAWINGS.
- INSTALLATION EQUIPMENT: THE CONTRACTOR SHALL PROVIDE ALL EQUIPMENT REQUIRED TO INSTALL THE EXPANSION AND/OR ADHESIVE ANCHOR INCLUDING, BUT NOT LIMITED TO, DRILLS, SETTING TOOLS, CLEAN-OUT BRUSHES, BLOWOUT BULBS, OIL-FREE COMPRESSED AIR, VACUUMS, WRENCHES, ETC.

E. INSTALLATION

- ALL DRILLING AND CORING EQUIPMENT AND ALL METHODS FOR INSTALLATION OF POST-INSTALLED ANCHORS AND DOWELS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS (MPII).
 - UNLESS OTHERWISE SPECIFIED, ANCHORS SHALL BE INSTALLED IN HOLES DRILLED WITH A ROTARY IMPACT HAMMER DRILL OR, WHERE NOT OTHERWISE PROSCRIBED, A ROCK DRILL. IN ALL CASES, THE BIT DIAMETER SHALL BE IN ACCORDANCE WITH THE MPII.
 - EMBEDMENT DEPTH AND MINIMUM ANCHOR PROJECTION OF THE ANCHOR ELEMENT FROM THE CONCRETE SURFACE SHALL BE AS SHOWN ON THE DRAWING OR DETAIL FOR THE PARTICULAR ANCHOR OR GROUP OF ANCHORS BEING INSTALLED.
 - ANCHOR CAPACITY IS DEPENDENT UPON SPACING BETWEEN ADJACENT ANCHORS AND PROXIMITY OF ANCHORS TO EDGES OF CONCRETE. INSTALL ANCHORS IN ACCORDANCE WITH SPACING AND EDGE CLEARANCES INDICATED ON THE DRAWINGS. ANCHOR SPACING AND EDGE DISTANCE VALUES SHALL NOT BE LESS THAN RECOMMENDED BY THE ANCHOR MANUFACTURER.
- F. SPECIAL INSPECTION REQUIREMENTS
- CONTINUOUS INSPECTIONS: PER ACI 318-14 SECTION 17.8.2.4, ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS SHALL BE CONTINUOUSLY INSPECTED DURING INSTALLATION BY AN INSPECTOR SPECIFICALLY APPROVED FOR THAT PURPOSE BY THE BUILDING OFFICIAL.
 - PERIODIC INSPECTIONS: PERIODIC SPECIAL INSPECTIONS SHALL BE PROVIDED FOR ALL OTHER POST-INSTALLED ANCHORS NOT INCLUDED IN THE CONTINUOUS INSPECTIONS REQUIRED ABOVE.
 - REPORTING REQUIREMENTS: THE SPECIAL INSPECTOR SHALL FURNISH A REPORT TO THE ENGINEER AND BUILDING OFFICIAL THAT THE WORK COVERED BY THE REPORT HAS BEEN PERFORMED AND THAT THE MATERIALS AND INSTALLATION PROCEDURES USED CONFORM WITH THE APPROVED CONSTRUCTION DOCUMENTS AND THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS (MPII).

- ALL BOLTS SHALL BE TIGHTENED TO THE SNUG-TIGHTENED JOINT REQUIREMENTS OF RCSC-10 EXCEPT AT SLIP-CRITICAL JOINTS OR WHERE NOTED OTHERWISE IN CONSTRUCTION DOCUMENTS OR IN FABRICATOR'S CONNECTION DESIGN.
- UNLESS OTHERWISE INDICATED IN THE DRAWINGS, ALL ANCHOR RODS SHALL CONFORM TO THE SPECIFIED MATERIAL GRADE SHALL BE A MINIMUM 3/4 INCH DIAMETER WITH A MINIMUM FOUNDATION EMBEDMENT AS INDICATED IN STRUCTURAL DETAILS. THE EMBEDDED END SHALL HAVE EITHER A STANDARD BOLT HEAD, A HEAVY HEX NUT WITH THE THREADS SPOILED ABOVE AND BELOW THE NUT, OR JAMMED DOUBLE NUTS.
- PRIOR TO PLACING CONCRETE, STEEL PLATE TEMPLATES SHALL BE PROVIDED TO FACILITATE PLACEMENT OF ANCHOR RODS IN DETAILED PLAN POSITIONS AND ELEVATIONS.
- BASE PLATES SHALL BE LEVELED WITH LEVELING NUTS AND OVERSIZED WASHER PLATES OR WITH SHIM PACKS AT THE ERECTOR'S OPTION.
- AFTER FINAL BASE PLATE POSITIONING, ANCHOR ROD NUTS SHALL BE INSTALLED TO A SNUG-TIGHT CONDITION AND WASHER PLATES SHALL BE FIELD WELDED AS INDICATED IN THE CONSTRUCTION DOCUMENTS.

D. STEEL FABRICATION & FINISH:

- SHOP DRAWINGS SHALL BE SUBMITTED TO AND REVIEWED BY THE OWNER'S REPRESENTATIVE PRIOR TO COMMENCING FABRICATION. ANY FABRICATION INITIATED PRIOR TO APPROVAL OF SHOP DRAWINGS WILL BE AT THE SOLE RISK OF THE FABRICATOR.
- ALL SHOP AND FIELD WELDS SHALL BE MADE IN ACCORDANCE WITH THE ANSI/AWS "D1.1-STRUCTURAL WELDING CODE - STEEL", 2011 EDITION. ALL WELDING SHALL USE LOW HYDROGEN PROCESSES.
- ALL BEAMS THAT ARE REQUIRED TO HAVE CAMBER SHALL BE FABRICATED WITH CAMBER UPWARD. BEAMS WITHOUT SPECIFIED CAMBER SHALL BE FABRICATED SUCH THAT AFTER ERECTION, ANY NATURAL CAMBER DUE TO ROLLING OR SHOP FABRICATION IS UPWARD.
- CUTS, HOLES, COPING, ETC. REQUIRED FOR WORK OF OTHER TRADES SHALL BE SHOWN ON THE SHOP DRAWINGS AND MADE IN THE SHOP. CUTS OR BURNING OF HOLES IN STRUCTURAL STEEL MEMBERS IN THE FIELD WILL NOT BE PERMITTED.
- THE FABRICATOR SHALL BE RESPONSIBLE FOR ALL ERECTION AIDS. ANY SUCH ERECTION AIDS SHALL BE REMOVED FROM THE COMPLETED STRUCTURE IF DIRECTED BY THE OWNER'S REPRESENTATIVE.
- ALL EXTENSION BARS, RUN-OFF PLATES, AND BACKING BARS USED IN WELDED CONNECTIONS SHALL BE REMOVED AND THE JOINTS SHALL BE GROUND SMOOTH WHERE SUCH CONNECTION IS PERMANENTLY EXPOSED TO VIEW OR IS DESIGNATED AS ARCHITECTURALLY EXPOSED STRUCTURAL STEEL.
- HEADED STUDS AND DEFORMED BAR ANCHORS
 - ALL HEADED STUDS AND DEFORMED BAR ANCHORS SHALL BE INSTALLED USING AUTOMATIC END-WELDING EQUIPMENT RECOMMENDED BY THE STUD OR ANCHOR MANUFACTURER. MANUAL WELDING OF HEADED STUDS OR DEFORMED BAR ANCHORS WILL NOT BE ALLOWED.
 - IF A VISUAL INSPECTION REVEALS ANY STUD THAT DOES NOT SHOW A FULL 360-DEGREE FLASH OR ANY STUD THAT HAS BEEN REPAIRED BY MANUAL WELDING, SUCH STUD SHALL BE BENT TO AN ANGLE APPROXIMATELY 15-DEGREES FROM ITS ORIGINAL AXIS. THE DIRECTION OF BENDING FOR STUDS WITH LESS THAN A 360-DEGREE FLASH SHALL BE OPPOSITE TO THE MISSING PORTION OF THE FLASH.
 - HEADED STUDS AND DEFORMED BAR ANCHORS THAT HAVE SUCCESSFULLY PASSED THE BEND TEST WITHOUT SIGN OF FAILURE SHALL BE ACCEPTABLE FOR USE AND LEFT IN THE BENT POSITION UNLESS DIRECTED OTHERWISE BY THE ENGINEER.
 - WELDED STUDS NOT CONFORMING TO THE REQUIREMENTS OF THE AWS D1.1 "STRUCTURAL WELDING CODE - STEEL" SHALL BE REPAIRED OR REPLACED BY THE CONTRACTOR. THE CONTRACTOR SHALL REVISE THE WELDING PROCEDURE AS NECESSARY TO ENSURE THAT SUBSEQUENT STUD WELDING WILL MEET AWS D1.1 REQUIREMENTS.

8) STEEL EMBEDMENTS IN CONCRETE:

A) ALL STEEL COMPONENTS TO BE EMBEDDED IN CONCRETE SHALL HAVE COATINGS AS DEFINED IN THE TABLE BELOW.

| COATINGS FOR STEEL EMBEDMENTS IN CONCRETE | | |
|---|---------------|------------|
| EXPOSURE | FIELD WELDING | FINISH |
| EXTERIOR | EITHER | GALVANIZED |
| | YES | UNPAINTED |
| INTERIOR | NO | GALVANIZED |

FOOTNOTES:

- ALL WELDING TO PREVIOUSLY GALVANIZED COMPONENTS WILL REQUIRE REMOVAL OF THE GALVANIZING WITH GRINDING FOR AT LEAST 3-INCHES FROM EITHER SIDE OF THE INTENDED WELD AND ON BOTH SIDES OF THE WORKPIECE.
- FIELD WELDED AREAS AND OTHER AREAS WITH REMOVAL OF, OR DAMAGE TO, THE GALVANIZED COATING SHALL HAVE THEIR COATING RESTORED IN ACCORDANCE TO ASTM A780, USING PAINT CONTAINING ZINC DUST OR SIMILAR PERMITTED PRODUCTS CAPABLE OF PROVIDING A MINIMUM ZINC-RICH COATING THICKNESS OF 2.0 MILS IN A SINGLE APPLICATION.

B) IN ORDER TO REDUCE THE RISK OF HEAT-INDUCED CONCRETE SPALLING AT FIELD-WELDED EMBED PLATES:

- ALLOW SUPPORTING CONCRETE TO CURE FOR A MINIMUM OF 14-DAYS PRIOR TO FIELD WELDING.
- PROVIDE THE WELD SIZE SHOWN IN DETAILS AND DO NOT OVER-WELD.

- SHOP PRIMER
 - ALL STEEL EXPOSED TO EXTERIOR WEATHER OR AN UNCONTROLLED ENVIRONMENT SHALL BE BLAST CLEANED AND PRIMED WITH A SUBMITTED AND APPROVED ZINC-RICH PRIMER.
 - INTERIOR STEEL SHALL BE SHOP PRIMED WITH THE FABRICATORS STANDARD SHOP PRIMER.
 - SHOP PRIMER SHALL NOT BE APPLIED TO THE FOLLOWING AREAS:
 - SURFACES EMBEDDED IN CONCRETE OR MORTAR. EXTEND PRIMING OF PARTIALLY EMBEDDED MEMBERS TO A DEPTH OF 2 INCHES.
 - SURFACES TO BE FIELD WELDED.
 - SURFACES TO BE HIGH-STRENGTH BOLTED WITH SLIP-CRITICAL CONNECTIONS.
 - SURFACES TO RECEIVE SPRAYED FIRE-RESISTIVE MATERIALS.
 - GALVANIZED SURFACES.

E. STEEL MISCELLANEOUS:

- ALL EDGE ANGLES SUPPORTING ROOF OR FLOOR DECK SHALL BE CONTINUOUS BUTT-SPlice WELDED OVER SUPPORTS.
- ALL ELEVATED MECHANICAL EQUIPMENT SHALL BE SUPPORTED BY STEEL FRAMING. IF SPECIFIC FRAMING SIZES ARE NOT PROVIDED ON THE FRAMING PLAN, REFER TYPICAL DETAILS FOR ROOF AND FLOOR OPENING FRAME DETAILS.
- SUBSTITUTION OF POST-INSTALLED ANCHORS FOR EMBEDDED ANCHORS SHOWN ON THE DRAWINGS WILL NOT BE PERMITTED UNLESS SPECIFICALLY APPROVED IN WRITING BY THE OWNER'S REPRESENTATIVE.

- WHERE POST-INSTALLED ANCHORS ARE USED IN CONTINUOUS ANGLES, FABRICATE ANGLE WITH OPTIONAL HOLE LOCATIONS TO ALLOW REMEDIATION OF CASES WHERE ANCHORS FOUL WITH REBAR. AS AN EXAMPLE, FOR A CONTINUOUS ANGLE WITH ANCHORS AT 24" ON CENTER, PROVIDE HOLES AT 6" ON CENTER.
- GALVANIZED LOOSE LEDGE ANGLES SHALL BE PROVIDED OVER ALL MASONRY VENEER OPENINGS OR RECESSES DEEPER THAN 1". LINTELS SHALL HAVE 1" OF BEARING AT EACH END FOR EVERY FOOT OF SPAN, WITH A MINIMUM OF 4" AND SIZED AS FOLLOWS UNLESS SHOWN OTHERWISE IN THE DRAWINGS.
 - UP TO 4'-0"L3-1/2 x 3-1/2 x 3/8
 - 4'-1" to 5'-0"L4 x 3-1/2 x 3/8 (LLV)
 - 5'-1" to 6'-6"L5 x 3-1/2 x 3/8 (LLV)
 - 6'-7" to 8'-0"L6 x 3-1/2 x 3/8 (LLV)

12. STEEL JOIST AND BRIDGING NOTES

A. COORDINATION BY GENERAL CONTRACTOR:

1) THE GENERAL CONTRACTOR SHALL CONFIRM OR REVISE MECHANICAL EQUIPMENT SIZE AND WEIGHT AND PROVIDE THE JOIST MANUFACTURER THE POINT LOADS FOR WHICH SPECIAL JOISTS ARE TO BE DESIGNED. PRELIMINARY ROOF TOP UNIT (RTU) WEIGHTS ARE SHOWN ON THE ROOF PLANS. SHOULD WEIGHTS EXCEED THOSE SHOWN, CONTRACTOR SHALL CONTACT THE OWNER'S REPRESENTATIVE FOR REVIEW.

B. JOIST DESIGN BY MANUFACTURER

- AS A MINIMUM REQUIREMENT, THE JOIST MANUFACTURER SHALL DESIGN ALL JOISTS FOR THE DESIGN LOADS SPECIFIED IN THE STEEL JOIST INSTITUTE'S LOAD TABLES. IN ADDITION, JOISTS SHALL BE DESIGNED TO CARRY ANY OTHER LOADS INDICATED ON THE DRAWINGS, INCLUDING BUT NOT LIMITED TO, EQUIPMENT AND/OR PIPING SUPPORTED ON OR SUSPENDED FROM THE ROOF STRUCTURE.
- UNLESS SHOWN OTHERWISE IN THE DRAWINGS, JOISTS SHALL BE DESIGNED BY THE JOIST MANUFACTURER FOR A NET UPLIFT OF 10 PSF IN THE FIELD OF THE ROOF AND 15 PSF WITHIN 10 FEET OF ROOF EDGES.
- BETWEEN PANEL POINTS OF STEEL JOISTS THE CHORD MEMBERS SHALL BE DESIGNED TO SUPPORT 100 LBS VERTICAL LOAD WITHOUT REINFORCEMENT OF THE JOIST. TYPICALLY, UNDERLING LOADS SHALL BE SUPPORTED AT JOIST PANEL POINTS. OFF-PANEL POINT LOADING IN EXCESS OF 100 POUNDS WILL REQUIRE JOIST REINFORCING. REFER TYPICAL DETAILS FOR JOIST REINFORCING DETAIL.
- UNLESS MORE STRINGENT PROVISIONS ARE SHOWN IN THE CONTRACT DOCUMENTS, THE JOIST MANUFACTURER SHALL DESIGN ALL JOISTS FOR A MAXIMUM LIVE LOAD DEFLECTION OF L/360.
- JOISTS SEATS SHALL HAVE STANDARD JOIST SEAT DEPTHS UNLESS NOTED OTHERWISE. HOWEVER, FLAT BEARING SEATS SHALL BE PROVIDED FOR ALL JOISTS BY INCREASING THE DEPTH OF THE SEAT AT THE HIGH END OF SLOPED JOISTS. CONTRACTOR SHALL VERIFY FINAL SEAT DEPTHS PRIOR TO DETAILING SUPPORTING STRUCTURE. STANDARD JOIST SEAT DEPTHS ARE AS FOLLOWS:
 - K-SERIES: 2-1/2"
- BOTTOM CHORDS ON ALL JOISTS SHALL BE EXTENDED TO RECEIVE CEILING OR POTENTIAL FUTURE CEILING.
- IN STEEL FRAMES, WHERE COLUMNS ARE NOT FRAMED IN AT LEAST TWO DIRECTIONS WITH SOLID WEB STRUCTURAL STEEL MEMBERS, STEEL JOISTS SHALL BE FIELD-BOLTED TO THE COLUMNS TO PROVIDE LATERAL STABILITY TO THE COLUMNS DURING ERECTION AND BOTTOM CHORD STABILITY PLATES SHALL BE PROVIDED AS REQUIRED BY OSHA SAFETY STANDARDS.

C. JOIST BRIDGING

- JOIST BRIDGING SHOWN ON FRAMING PLANS IS PRELIMINARY AND SHALL NOT BE USED AS THE BASIS FOR BID OR FOR ERECTION. ALL JOIST BRIDGING SHALL BE DESIGNED BY THE JOIST MANUFACTURER TO MEET OR EXCEED THE MINIMUM REQUIREMENTS OF THE SJI "STANDARD SPECIFICATION FOR K-SERIES, LH-SERIES, AND DLH SERIES OPEN WEB STEEL JOISTS AND FOR JOIST GIRDERS", AND ALL OSHA PROVISIONS REGARDING JOIST ERECTION.
- ADDITIONAL BRIDGING LINES AT THE BOTTOM CHORD OUTSIDE PANEL POINT HAVE NOT BEEN SHOWN FOR CLARITY BUT ARE REQUIRED FOR THE SUPPORT OF UPLIFT LOADS. PROVIDE AS DESIGNED BY THE JOIST MANUFACTURER.
- NO VERTICAL LOAD SHALL BE IMPOSED ON BRIDGING.
- HORIZONTAL BRIDGING ANGLES FOR TOP AND BOTTOM CHORDS OF JOISTS ARE SHOWN ON FRAMING PLANS THUS: - - - - -
- DIAGONAL BRIDGING IS SHOWN AS AN "X" ALONG A LINE OF HORIZONTAL BRIDGING. DIAGONAL BRIDGING SHALL BE PROVIDED WHERE SHOWN AND AT ANY DISCONTINUITIES IN THE ROW OF BRIDGING.
- ALL BRIDGING LINES SHALL BE TERMINATED WITH AN "X" OR ANCHORED TO A STRUCTURAL WALL. REFER TYPICAL DETAILS FOR JOIST BRIDGING DETAILS.

D. JOIST ERECTION

- ERECTION OF JOISTS SHALL FOLLOW THE STEEL JOIST INSTITUTE'S CODE OF STANDARD PRACTICE, SJI TECHNICAL DIGEST NO. 9 AND ALL APPLICABLE PROVISIONS OF OSHA SAFETY STANDARDS. JOISTS SHALL NOT BE FULLY LOADED UNTIL ALL BRIDGING LINES ARE SECURED AND METAL DECKING IS IN PLACE. THE JOIST MANUFACTURER AND ERECTOR SHALL PROVIDE ADDITIONAL BRIDGING DURING CONSTRUCTION SEQUENCING AS REQUIRED BY THE CURRENT SJI SPECIFICATIONS AND OSHA REQUIREMENTS.
- NO LOAD APPLIED TO JOIST SHALL BE DONE IN A MANNER THAT EXCEEDS THE MOMENT OR SHEAR CAPACITY OF THE JOIST.
- ANY HANGERS SUPPORTED FROM JOISTS SHALL BE CONNECTED WITHOUT FIELD WELDING OR DRILLING TO THE JOIST.

13. METAL DECK NOTES:

A. ROOF DECK:

- BASIS OF DESIGN: VULCRAFT TYPE 1.5B WIDE RIB DECK WITH THE CHARACTERISTICS AND STRUCTURAL PROPERTIES OUTLINED BELOW. WIDE RIB DECKS OF OTHER MANUFACTURERS ARE ACCEPTABLE IF THEY PROVIDE SIMILAR LOAD-CARRYING CAPACITY FOR THE DECK SPANS APPLICABLE TO THIS PROJECT.
 - SDI DECK TYPE: WIDE RIB (WR)
 - DEPTH: 1-1/2 IN.
 - THICKNESS: 20 GAGE
 - FINISH: GALVANIZED
 - E = 0.201 IN4/FT
 - Sp = 0.234 IN3/FT
 - Sn = 0.247 IN3/FT
 - Fy = 33 KSI
 - SIDE LAPS: OVERLAPPED
- SUPPORT FASTENERS: ROOF DECK SHALL BE CONNECTED TO SUPPORTS WITH #12 MECHANICAL FASTENERS AT 12" O.C. (36/4 PATTERN).
 - FASTENERS SHALL PENETRATE ALL PLIES OF DECKING INTO SUPPORTING SUBSTRATE OR 2 LINES OF FASTENERS SHALL BE PROVIDED.
 - #12 MECHANICAL FASTENERS ARE CAPABLE OF SELF-TAPPING INTO A 1/2-INCH MAXIMUM SUPPORTING STEEL THICKNESS. IF SUPPORTING STEEL THICKNESS EXCEEDS 1/2-INCH OR IF SUPPORT IS AN EMBED PLATE, PROVIDE (1) 5/8-INCH DIAMETER PUDDLE WELD IN LIEU OF EACH #12 FASTENER.

3) SIDE LAP FASTENERS: ROOF DECK SIDE LAPS SHALL BE FASTENED WITH #10 SIDE LAP FASTENERS AT 12" ON CENTER.

4) MINIMUM BEARING LENGTH AND LAP LENGTH: MINIMUM BEARING LENGTH ON SUPPORTS AT DISCONTINUOUS ENDS OF ROOF DECK IS 2-INCHES. MINIMUM BEARING LENGTH AND LAP LENGTH OF CONTINUOUS ROOF DECK OVER INTERIOR SUPPORTS IS 3-INCHES.

B. SUBSTITUTION OF WELDING OR PINS FOR MECHANICAL SCREW ANCHORS WILL NOT BE PERMITTED.

C. SUPPORTS FOR DECKING ARE DEFINED AS MEMBERS PROVIDING DIRECT TRANSVERSE SUPPORT AS WELL AS CONTINUOUS PARALLEL EDGE SUPPORT.

D. ALL DECKING SHALL BE PLACED WITH RIBS PERPENDICULAR TO SUPPORTING ROOF OR FLOOR MEMBERS AND SHALL SPAN A MINIMUM OF 3 SPANS UNLESS SHOWN OTHERWISE IN STRUCTURAL DRAWINGS.

E. METAL DECKING SHALL NOT BE USED TO SUPPORT ANY HANGING LOADS INCLUDING, BUT NOT LIMITED TO, SUSPENDED MECHANICAL, ELECTRICAL, OR PLUMBING EQUIPMENT, CABLE TRAYS OR RACEWAYS, CEILING FINISHES OR CEILING FRAMING.

F. ALL DECK OPENINGS UP TO 8-IN. SHALL BE REINFORCED WITH A MINIMUM 16-GAGE PLATE AS SHOWN IN TYPICAL ROOF DECK REINFORCING DETAIL.

G. ALL DECK OPENINGS GREATER THAN 8-IN. SHALL BE SUPPORTED BY AN ANGLE FRAME. IF SPECIFIC FRAMING SIZES ARE NOT PROVIDED ON THE FRAMING PLAN, REFER TYPICAL DETAILS FOR ROOF OPENING FRAME DETAIL.

H. PROVIDE SHEET STEEL COLUMN CLOSURES, Z-CLOSURES, CELL CLOSURES, POUR STOPS AND GIRDER FILLERS OF SAME MATERIAL AND FINISH AS DECK WITH THICKNESS AND PROFILE RECOMMENDED IN SDI FLOOR DECK DESIGN MANUAL, SECOND EDITION (JUNE 2020). WELD TO SUPPORTING STRUCTURE ACCORDING TO SDI RECOMMENDATIONS AND AS CONCEPTUALLY SHOWN IN TYPICAL FLOOR DECK CLOSURE DETAILS.

I. ALL FLOOR DECK EDGES SHALL BE SUPPORTED WITH POUR STOPS OR BENT PLATES. IF BENT PLATES ARE NOT SHOWN IN THE STRUCTURAL DRAWINGS, PROVIDE GAGE METAL POUR STOPS COMPLYING WITH SDI FLOOR DECK DESIGN MANUAL, SECOND EDITION (JUNE 2020), SECTION 5, TABLE 11 AND AS SHOWN IN TYPICAL DETAILS.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK

CIVIL

KFC ENGINEERING

STRUCTURAL

SALAS O'BRIEN

MECHANICAL/ELECTRICAL



CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE

CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S102

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.





CJC
drawn by
BWB
checked by
JULY 2023
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL


sheet no.

S103


OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.



4 PLAN SECTION AT TYPICAL VERTICAL PENETRATION
SCALE: NONE

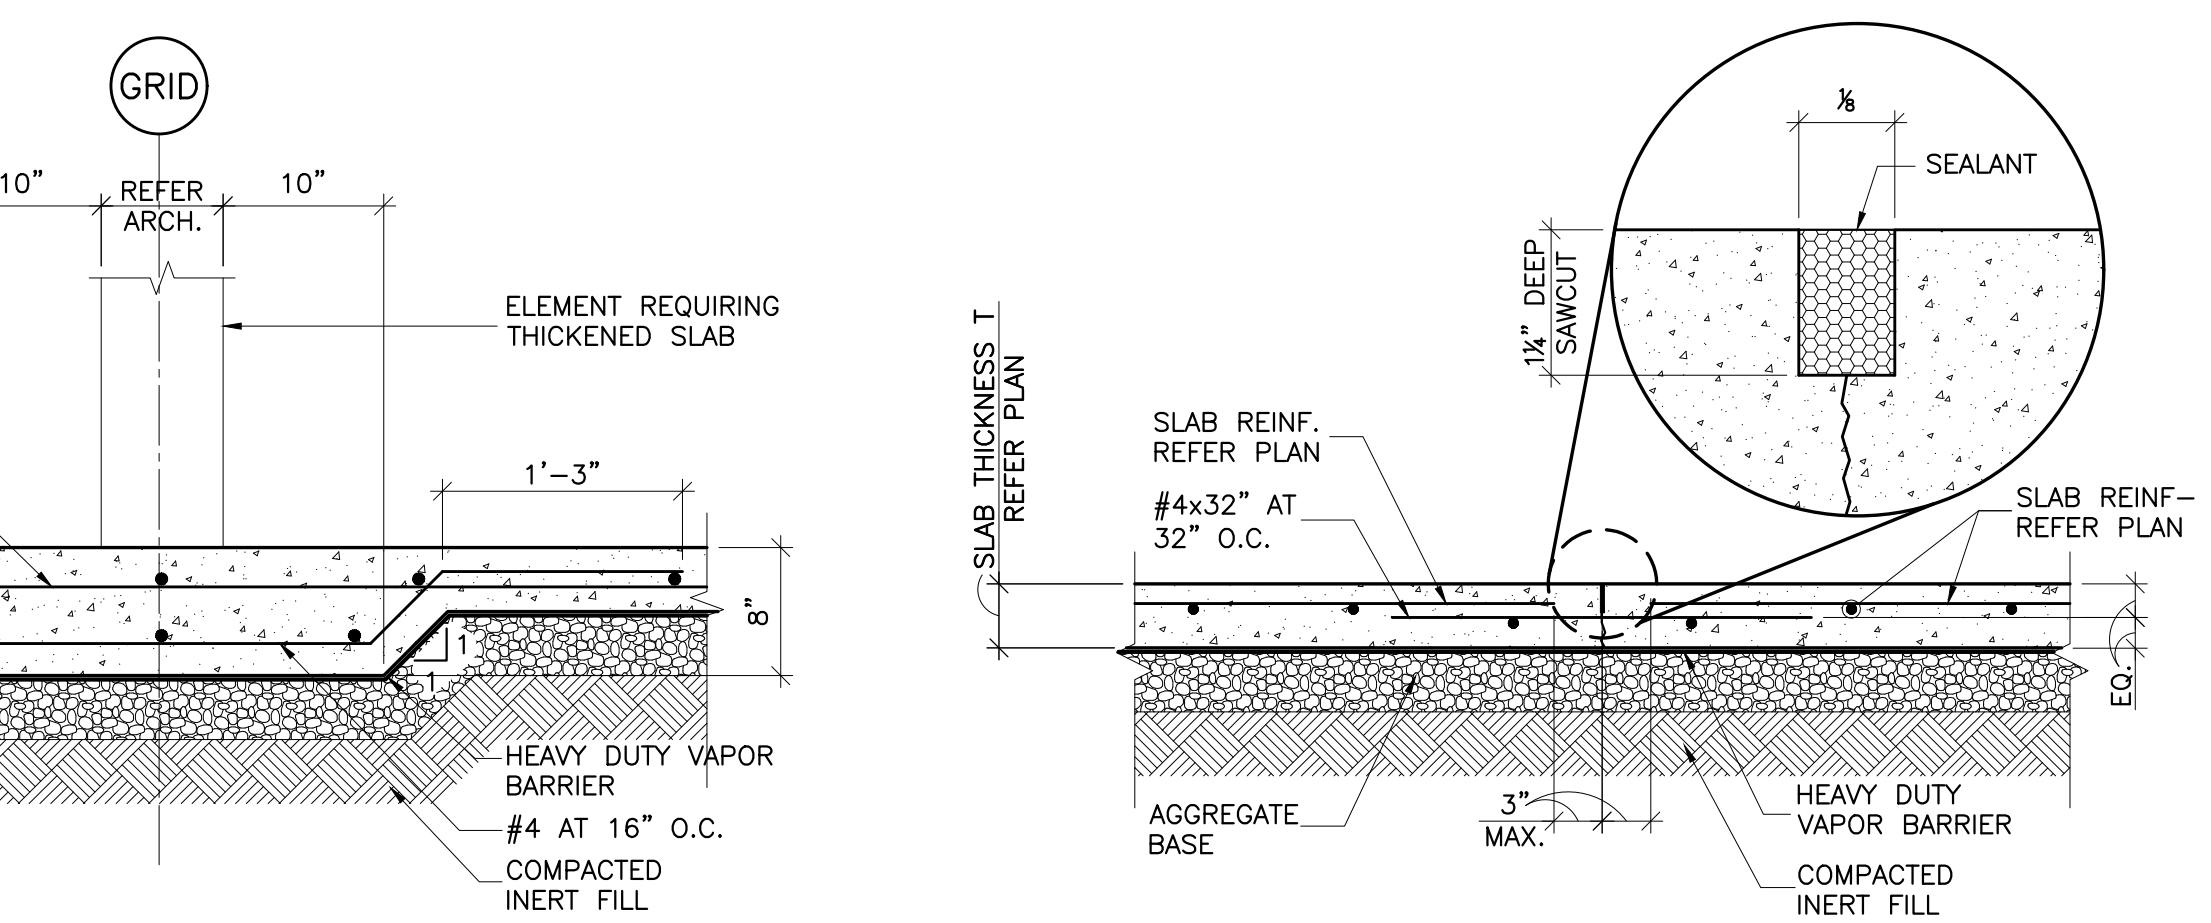


8 TYP. SAWED JOINT (SJ)
SCALE: NONE

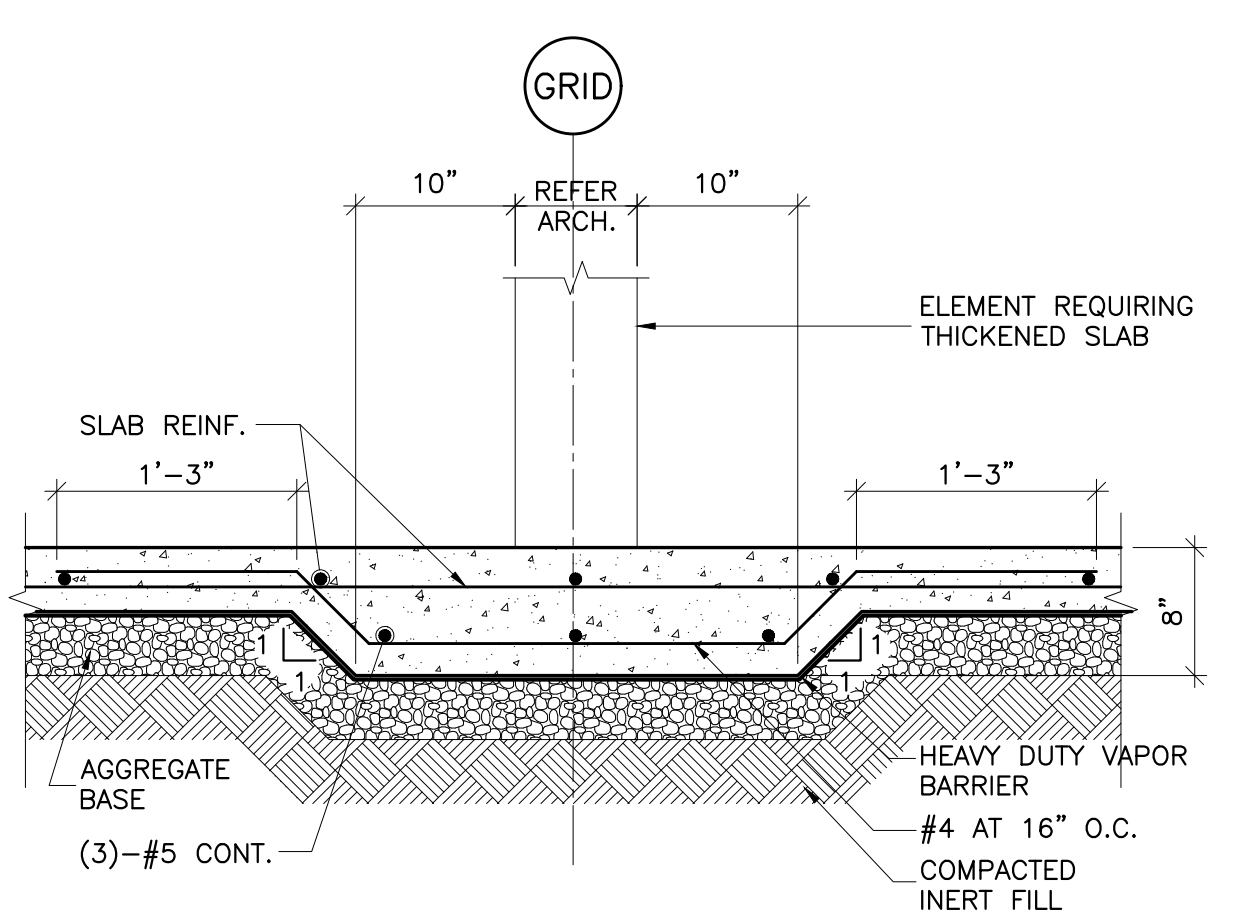


7 TYP. THICKENED SLAB
SCALE: NONE


3 TYP. FOOTING PENETRATION
SCALE: NONE

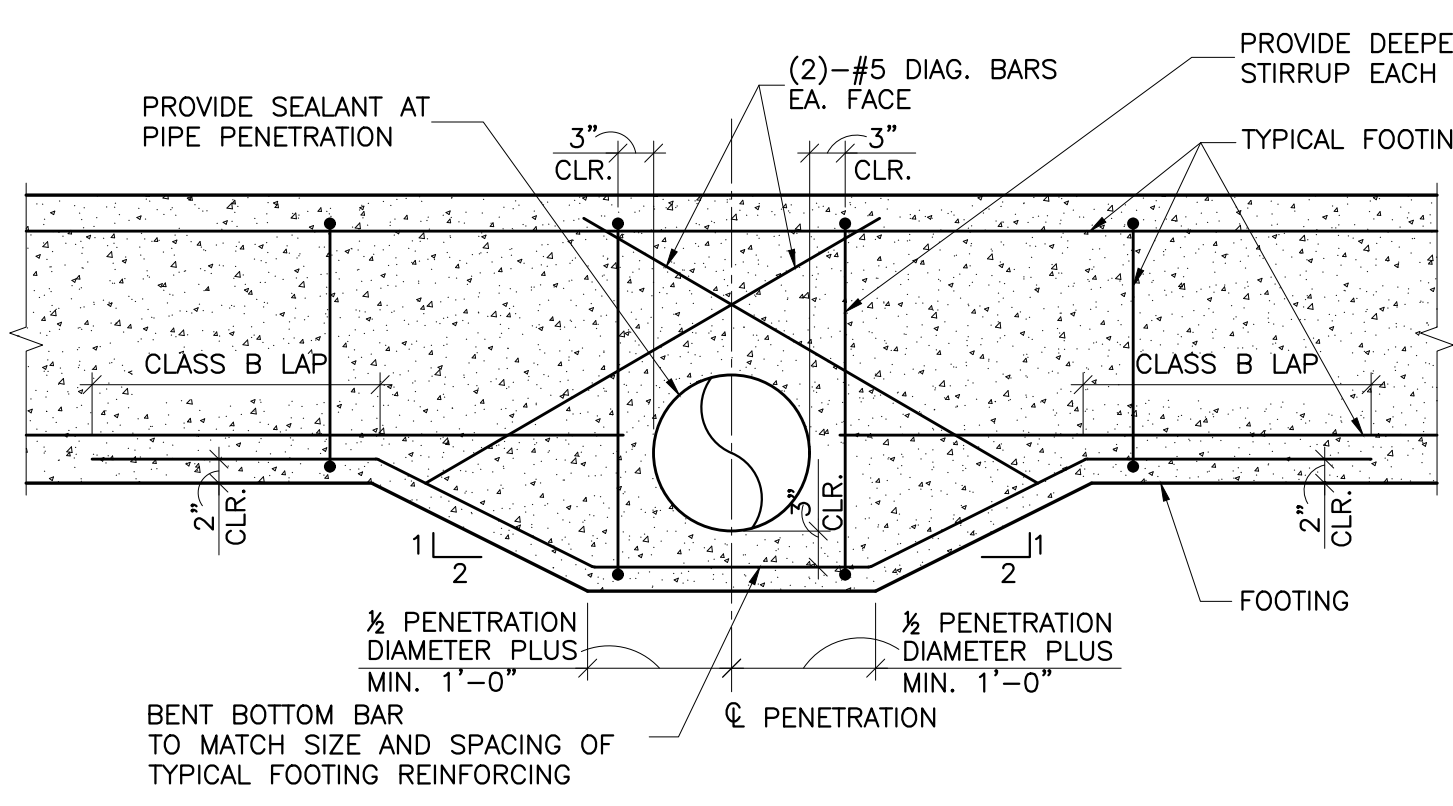


6 CJ THROUGH FOOTING
SCALE: NONE

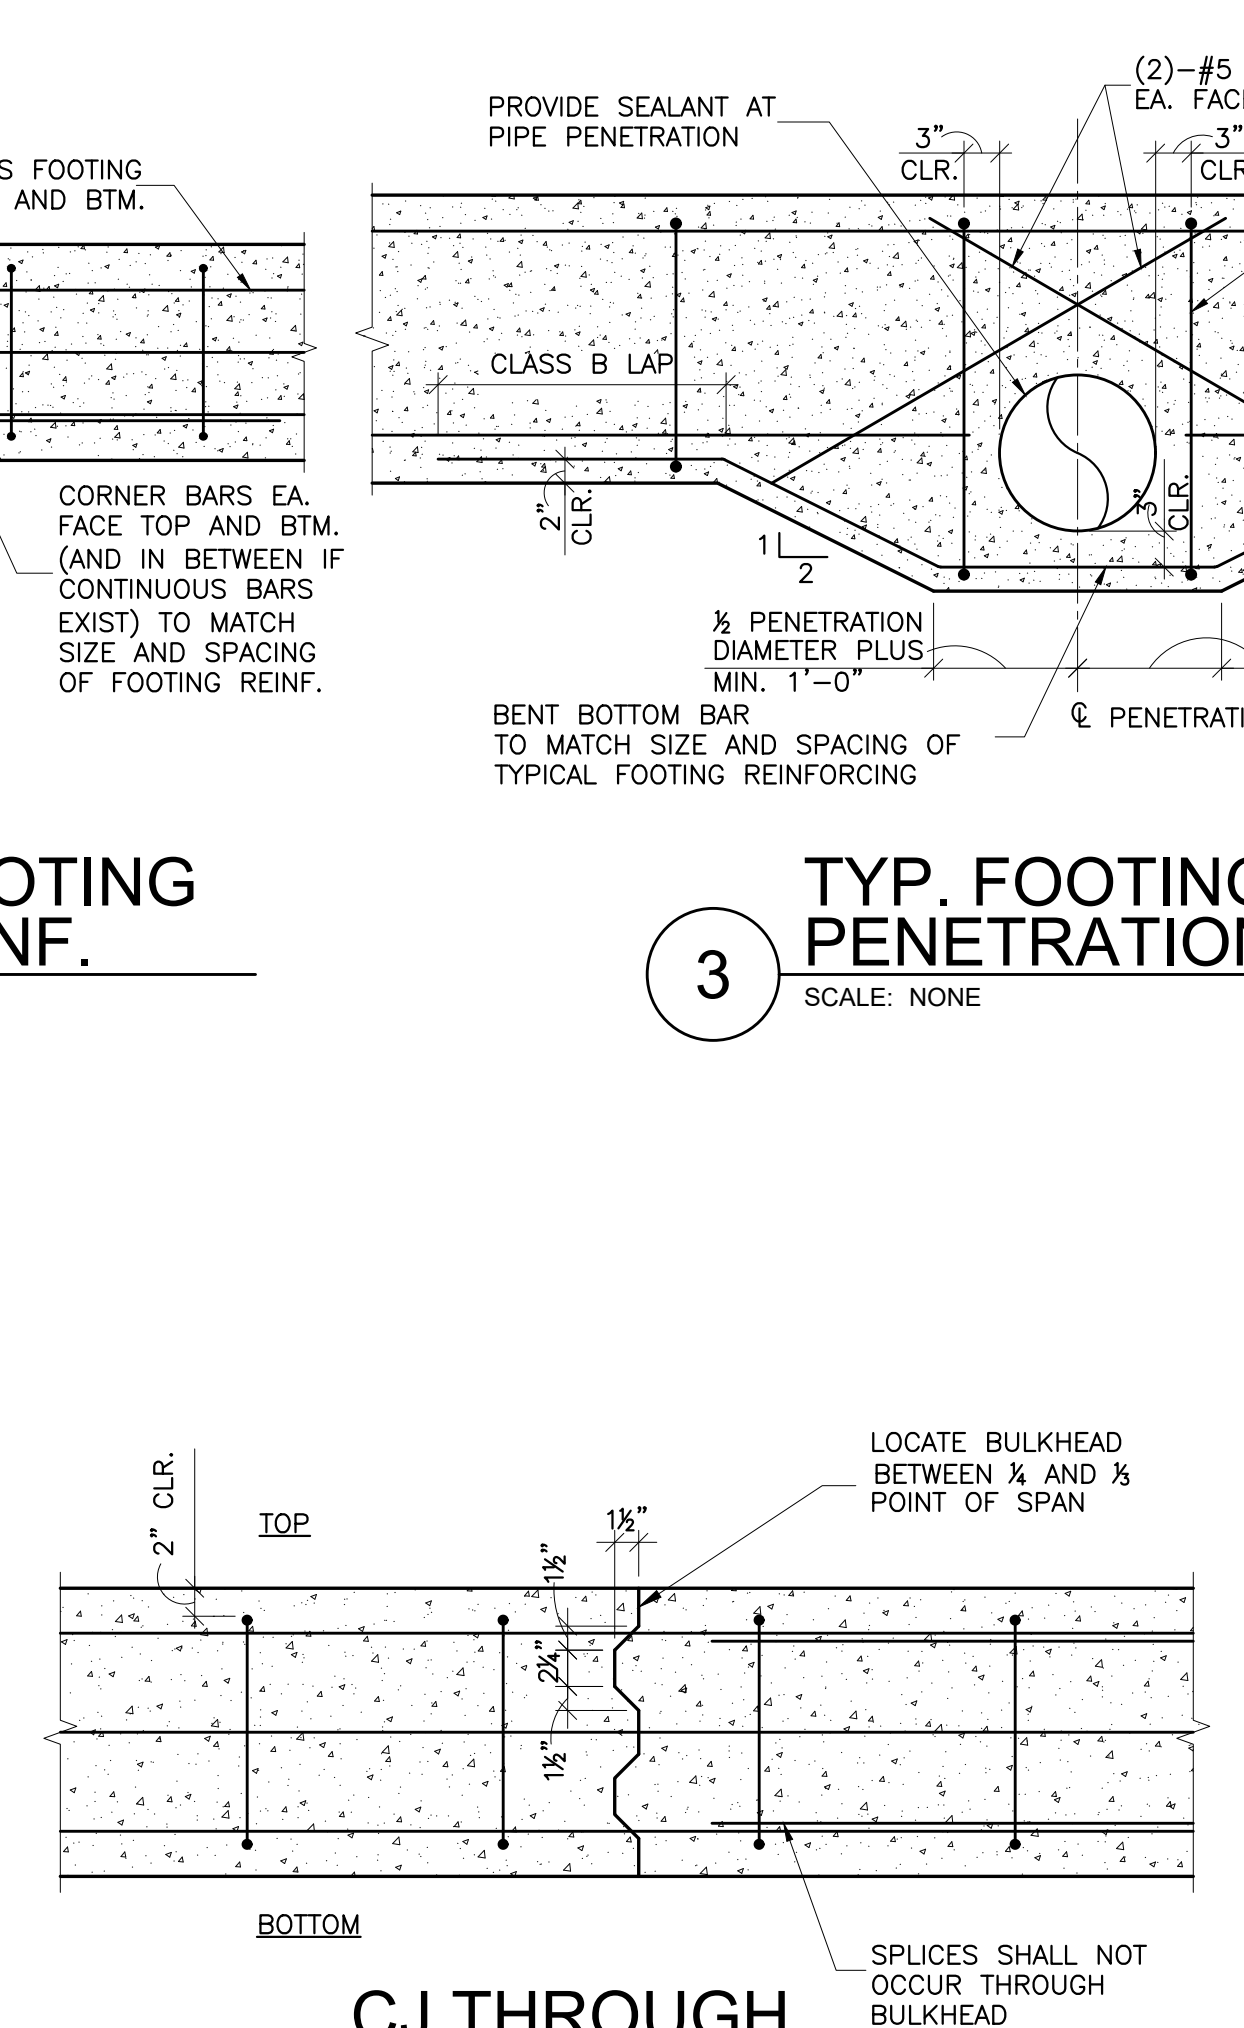

2 TYP. FOOTING TEE REINF.
SCALE: NONE

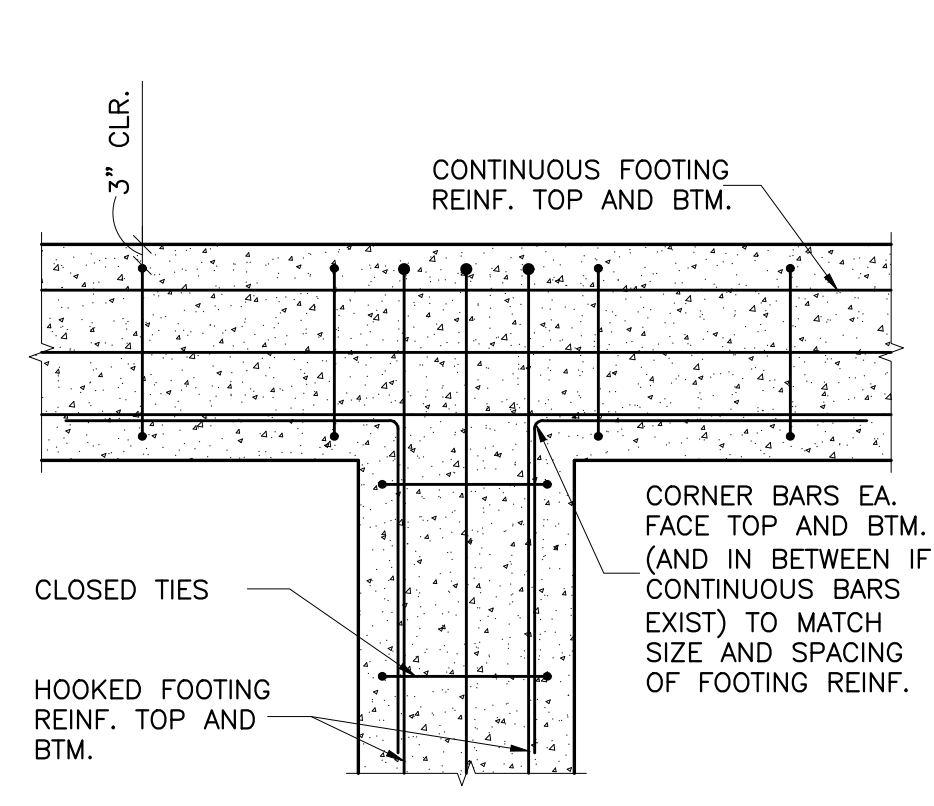

1 TYP. FOOTING CORNER REINF.
SCALE: NONE

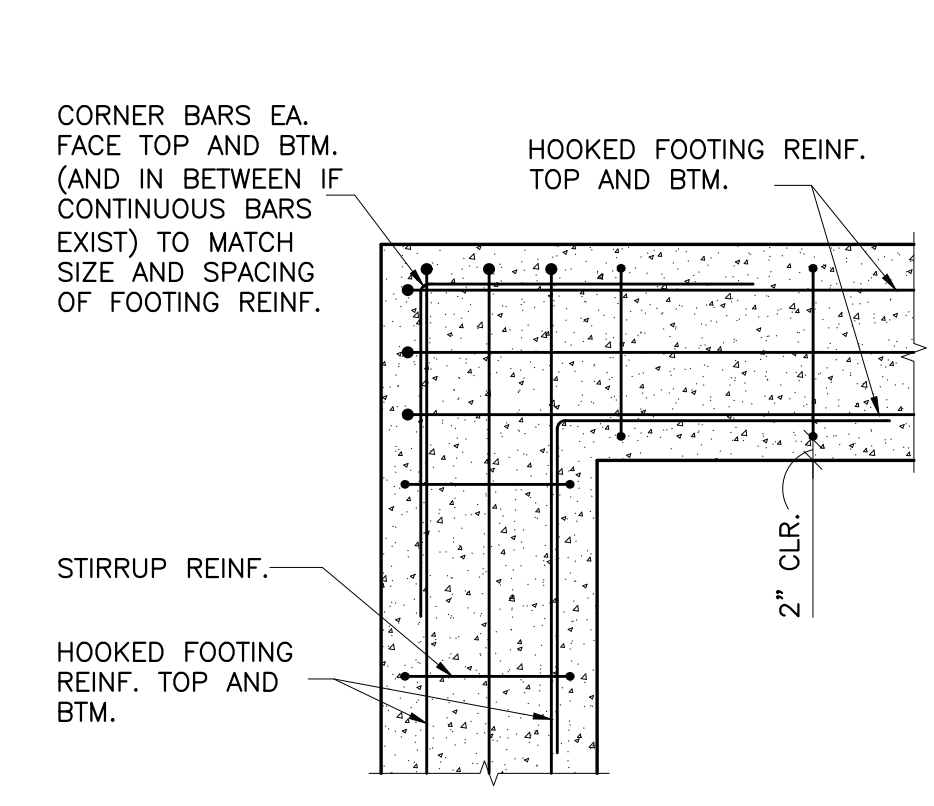


TENSION DEVELOPMENT AND LAP-SPLICE LENGTHS FOR UNCOATED REINFORCING BARS

| BAR SIZE | LAP CLASS | LENGTHS (IN.) PER CONCRETE STRENGTH | | | |
|----------|-----------|-------------------------------------|-----|------------|-----|
| | | f'c=3500 psi (NORMAL WEIGHT) | | | |
| | | TOP BARS | | OTHER BARS | |
| #3 | A | 20 | 30 | 16 | 23 |
| | B | 26 | 39 | 20 | 30 |
| #4 | A | 27 | 40 | 21 | 31 |
| | B | 35 | 52 | 27 | 40 |
| #5 | A | 33 | 50 | 26 | 39 |
| | B | 43 | 65 | 33 | 50 |
| #6 | A | 40 | 60 | 31 | 46 |
| | B | 52 | 78 | 40 | 60 |
| #7 | A | 58 | 87 | 45 | 67 |
| | B | 75 | 113 | 58 | 87 |
| #8 | A | 66 | 99 | 51 | 77 |
| | B | 86 | 129 | 66 | 99 |
| #9 | A | 75 | 112 | 58 | 86 |
| | B | 97 | 145 | 75 | 112 |
| #10 | A | 84 | 126 | 65 | 97 |
| | B | 109 | 164 | 84 | 126 |
| #11 | A | 93 | 140 | 72 | 108 |
| | B | 121 | 182 | 93 | 140 |
| #14 | N/A | 112 | 168 | 86 | 129 |
| #18 | N/A | 149 | 224 | 115 | 172 |

TENSION DEVELOPMENT AND LAP-SPLICE LENGTHS FOR UNCOATED REINFORCING BARS

| BAR SIZE | LAP CLASS | LENGTHS (IN.) PER CONCRETE STRENGTH | | | |
|----------|-----------|-------------------------------------|-----|------------|-----|
| | | f'c=4000 psi (NORMAL WEIGHT) | | | |
| | | TOP BARS | | OTHER BARS | |
| #3 | A | 19 | 28 | 15 | 22 |
| | B | 24 | 36 | 19 | 28 |
| #4 | A | 25 | 37 | 19 | 29 |
| | B | 32 | 48 | 25 | 37 |
| #5 | A | 31 | 47 | 24 | 36 |
| | B | 40 | 60 | 31 | 47 |
| #6 | A | 37 | 56 | 29 | 43 |
| | B | 48 | 72 | 37 | 56 |
| #7 | A | 54 | 81 | 42 | 63 |
| | B | 70 | 106 | 54 | 81 |
| #8 | A | 62 | 93 | 48 | 71 |
| | B | 80 | 121 | 62 | 93 |
| #9 | A | 70 | 105 | 54 | 81 |
| | B | 91 | 136 | 70 | 105 |
| #10 | A | 79 | 118 | 61 | 91 |
| | B | 102 | 153 | 79 | 118 |
| #11 | A | 87 | 131 | 67 | 101 |
| | B | 113 | 170 | 87 | 131 |
| #14 | N/A | 105 | 157 | 81 | 121 |
| #18 | N/A | 139 | 209 | 107 | 161 |

NOTES: 1 in.=25.4 mm.
1. TABULATED VALUES ARE BASED ON GRADE 60 REINFORCING BARS AND NORMAL WEIGHT CONCRETE. LENGTHS ARE IN INCHES.
2. TENSION DEVELOPMENT LENGTHS AND TENSION LAP-SPLICE LENGTHS ARE CALCULATED PER ACI 318, SECTIONS 25.4.2.2 AND 25.5.2.1, RESPECTIVELY. TABULATED VALUES FOR BEAMS OR COLUMNS ARE BASED ON TRANSVERSE REINFORCEMENT AND CONCRETE COVER MEETING MINIMUM CODE REQUIREMENTS.
3. CASES 1 AND 2, WHICH DEPEND ON THE TYPE OF STRUCTURAL ELEMENT, CONCRETE COVER, AND CENTER-TO-CENTER SPACING OF THE BARS, ARE DEFINED AS: BEAMS OR COLUMNS: CASE 1-COVER AT LEAST 1.0d_c AND CENTER-TO-CENTER SPACING AT LEAST 2.0d_c; AND CASE 2-COVER LESS THAN 1.0d_c OR CENTER-TO-CENTER SPACING LESS THAN 2.0d_c; ALL OTHERS: CASE 1-COVER AT LEAST 1.0d_c AND CENTER-TO-CENTER SPACING AT LEAST 3.0d_c; CASE 2-COVER LESS THAN 1.0d_c OR CENTER-TO-CENTER SPACING LESS THAN 3.0d_c.
4. LAP SPLICE LENGTHS ARE MULTIPLES OF TENSION DEVELOPMENT LENGTHS; CLASS A=1.0d_c AND CLASS B=1.3d_c (ACI 318, SECTION 25.5.2.1).
5. ACI 318 DOES NOT ALLOW TENSION LAP SPLICES OF #14 OR #18 BARS. THE TABULATED VALUES FOR THOSE BAR SIZES ARE THE TENSION DEVELOPMENT LENGTHS.
6. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 IN. OF CONCRETE CAST BELOW THE BARS.
7. FOR LIGHTWEIGHT-AGGREGATE CONCRETE, MULTIPLY THE TABULATED VALUES BY 1.3.

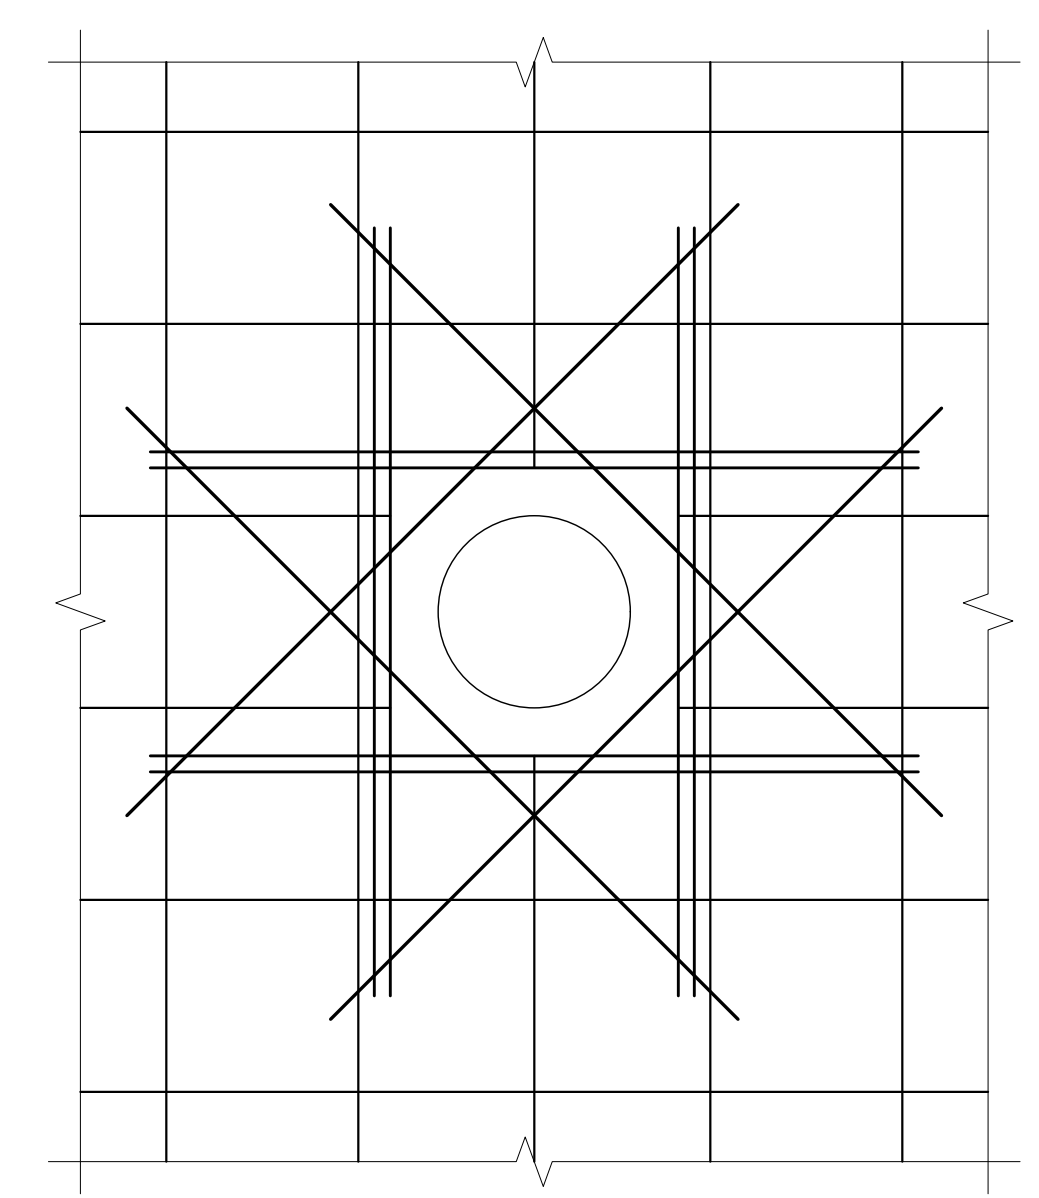


REINFORCING LAP LENGTHS
SCALE: NONE


13 REINFORCING LAP LENGTHS
SCALE: NONE

| CONCRETE EXPOSURE | MEMBER | REINFORCEMENTS | SPECIFIED COVER, IN. |
|---|-------------------------|---|----------------------|
| CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND | ALL | ALL | 3 |
| EXPOSED TO WEATHER OR IN CONTACT WITH GROUND | ALL | NO. 6 THROUGH NO. 18 BAR | 2 |
| | | NO. 5 BAR, W31 OR D31 WIRE, AND SMALLER | 1-1/2 |
| NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND | SLAB, JOISTS, AND WALLS | NO. 14 AND NO. 18 AND SMALLER | 1-1/2 |
| | | BEAMS, COLUMNS, PEDESTALS, AND TENSION TIES | 3/4 |
| | | PRIMARY REINFORCEMENT, STIRRUPS, TIES, SPIRALS, AND HOOPS | 1-1/2 |

11 TYP. MIN. CONCRETE COVER
SCALE: NONE

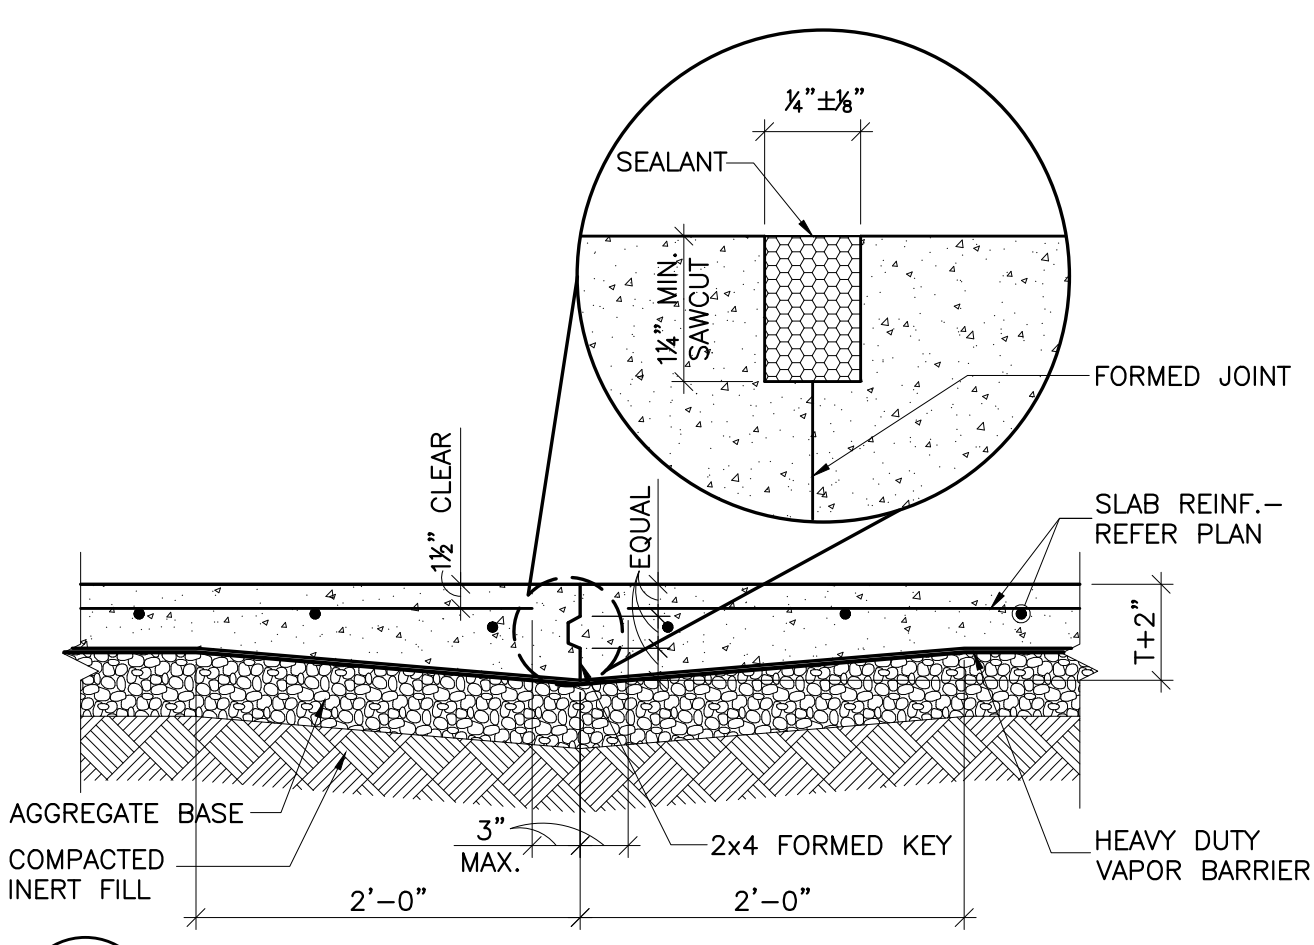


9 TYP. CONSTRUCTION JOINT (CJ)
SCALE: NONE

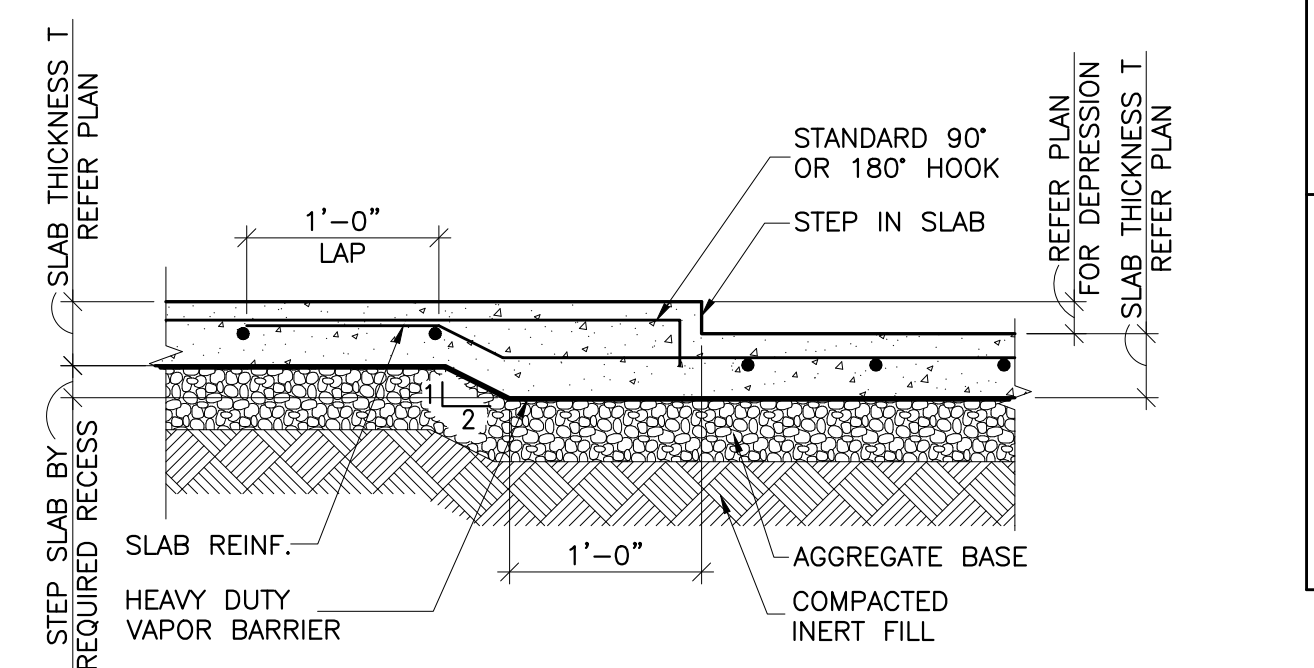


10 TYP. SLAB STEP
SCALE: NONE




| |
|------------|
| CJC |
| drawn by |
| BWB |
| checked by |
| JULY 2023 |
| date |
| revisions |

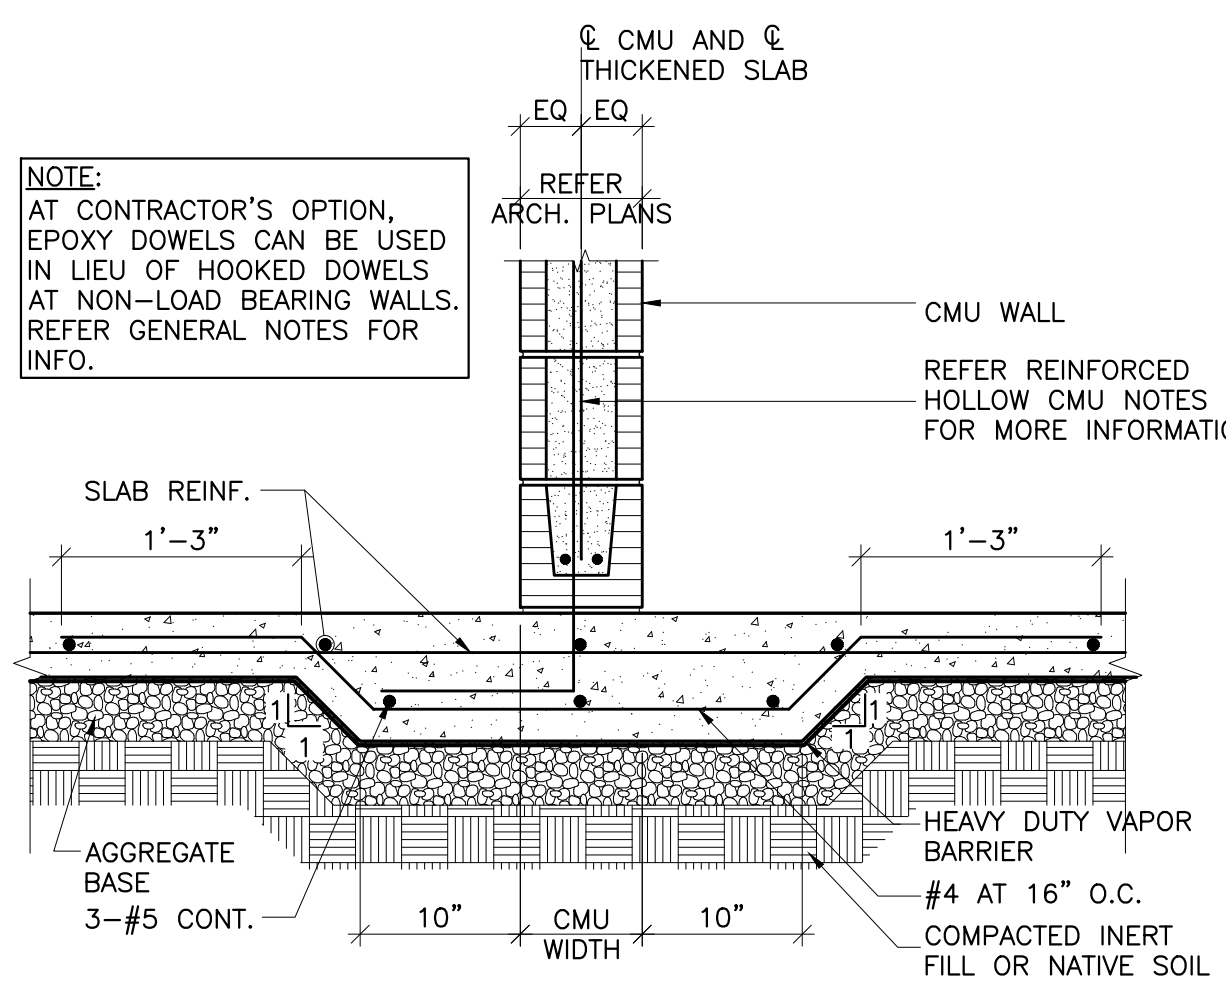


1 THICKENED SLAB AT CMU
SCALE: NONE

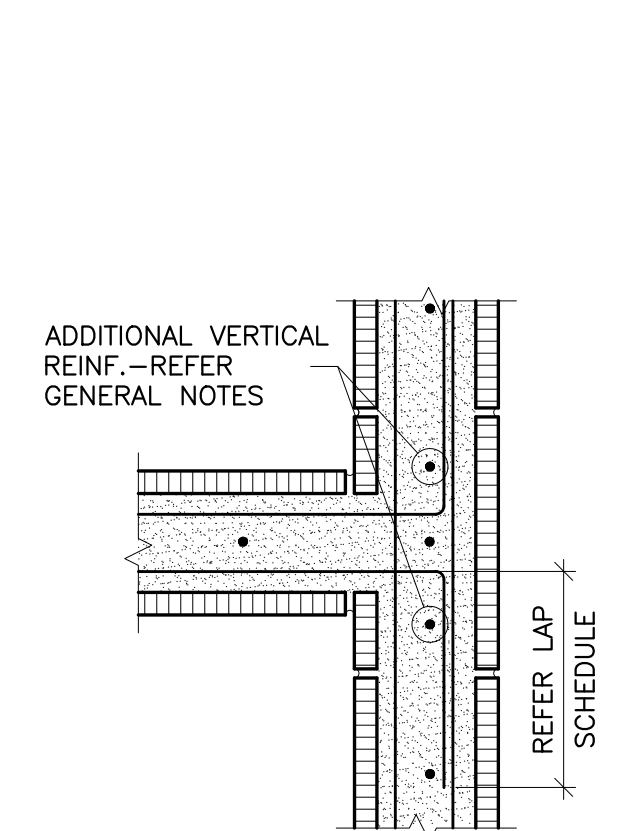


2 DETAIL AT BOND BEAM CORNER W/ NO CONTROL JT
SCALE: NONE

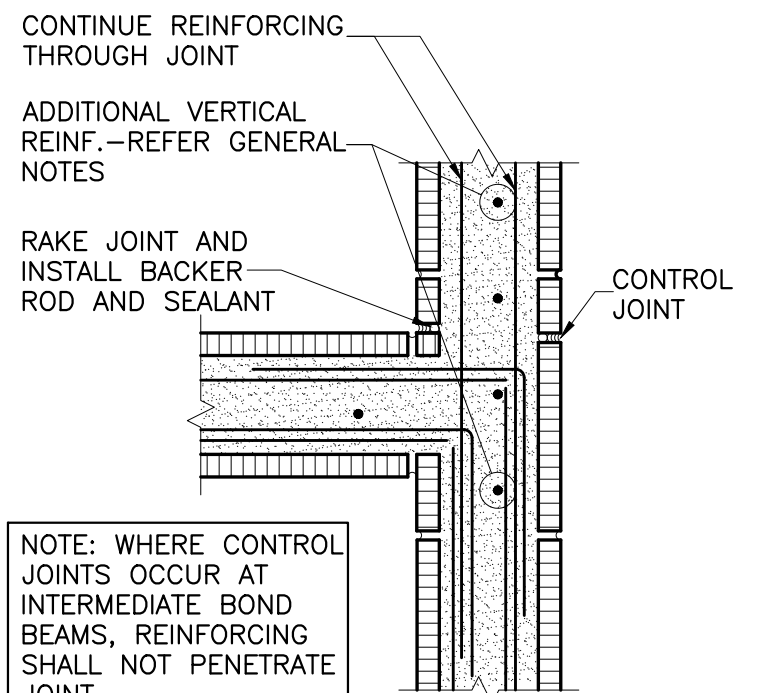


3 DETAIL AT FLOOR/ROOF BOND BEAM CORNER W/ CONTROL JT
SCALE: NONE

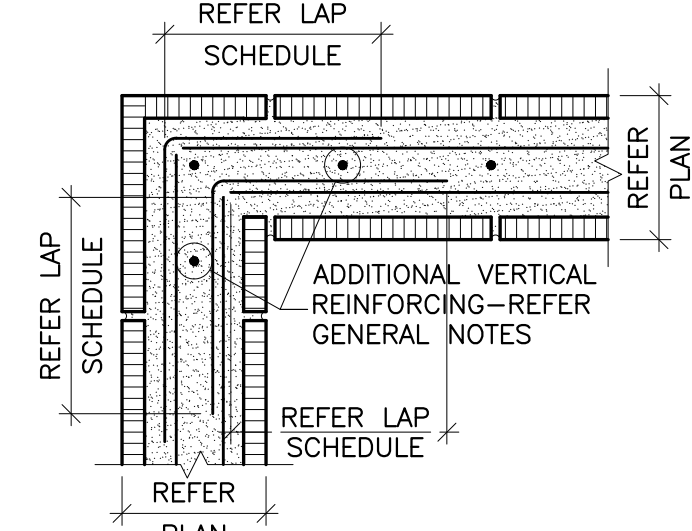


4 CORNER BOND BEAM WITH NO CONTROL JT
SCALE: NONE

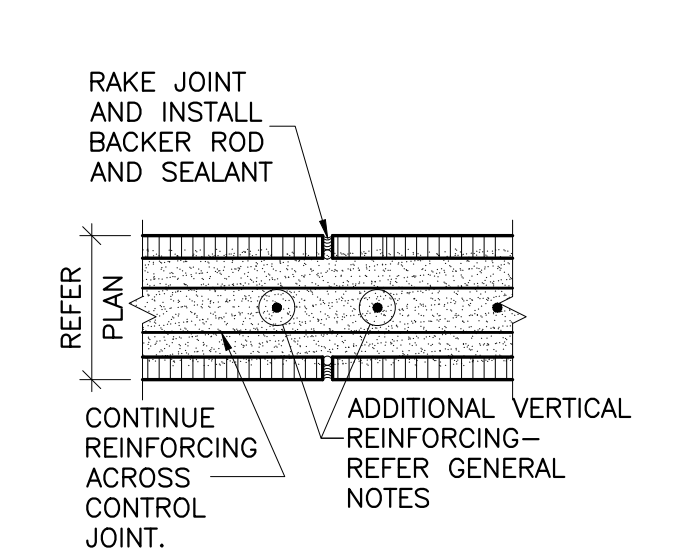

5 CONTROL JT AT FLOOR/ROOF BOND BEAM
SCALE: NONE

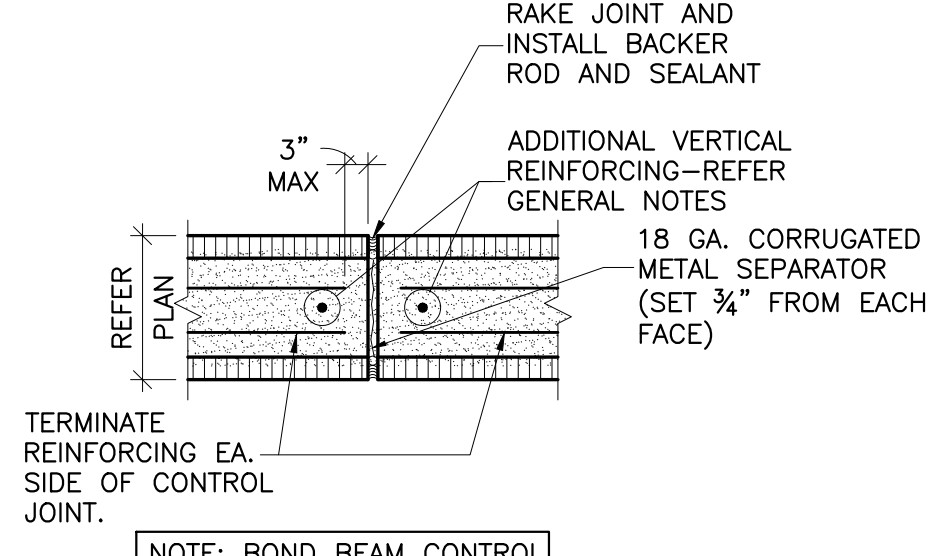

6 CONTROL JT AT INTERMEDIATE BOND BEAM
SCALE: NONE

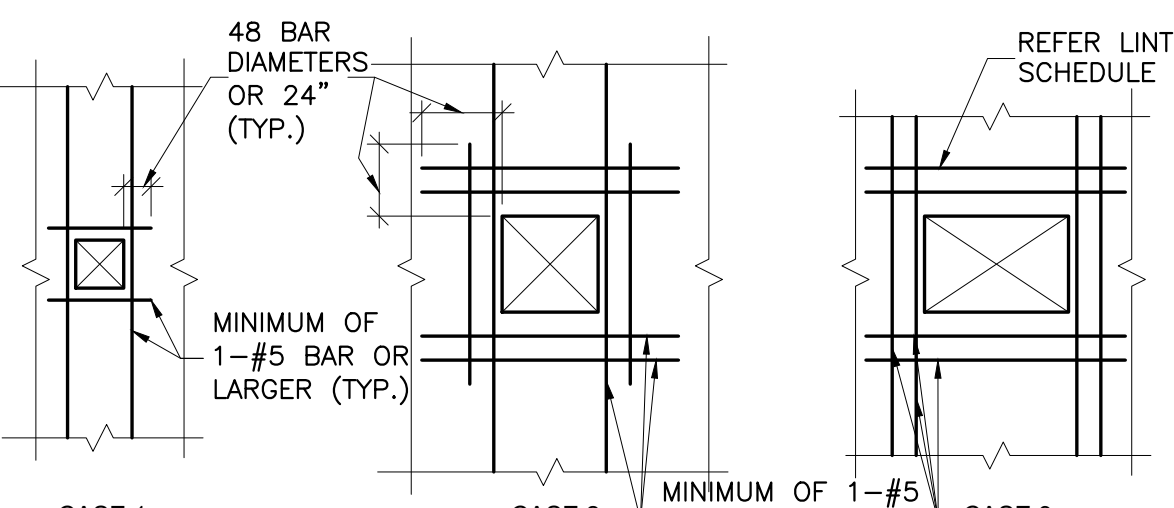





| BAR SIZE | LENGTH (in.) | | | EDGE (2 IN CLEAR COVER) |
|----------|--------------|--------|---------|-------------------------|
| | 6" CMU | 8" CMU | 12" CMU | |
| 3 | 1'-0" | 1'-0" | 1'-0" | 1'-6" |
| 4 | 1'-6" | 1'-6" | 1'-0" | 2'-0" |
| 5 | 2'-6" | 2'-0" | 1'-6" | 3'-0" |
| 6 | ** | 3'-6" | 2'-0" | ** |
| 7 | ** | ** | 3'-0" | ** |
| 8 | ** | ** | ** | ** |

7 CMU REINFORCING LAP SCHEDULE
SCALE: NONE

NOTES:
1. $f_m = 2000$ psi
2. $f_y = 60,000$ psi
*SCHEDULE ALSO APPLIES TO EMBEDMENT LENGTHS
**MECHANICAL SPLICES SHALL BE USED

CASE 1 APPLIES TO: ALL OPENINGS 2 FEET OR LESS BOTH WAYS.
CASE 2 APPLIES TO: ALL OPENINGS EXCEEDING 2 FEET BUT NOT MORE THAN 4 FEET BOTH WAYS, WHERE NO LINTEL IS INDICATED
CASE 3 APPLIES TO: ALL OPENINGS EXCEEDING 4 FEET AND WIDER
NOTE: 1.) WHERE VERTICAL REINFORCING CONSISTS OF 2 BARS OR MORE EACH BAR SHALL BE PLACED IN A SEPARATE CELL
2.) WHERE OPENING IS SUPPORTED BY A PERPENDICULAR WALL AND ONLY 8" OF WALL EXTENDS BEYOND THE OPENING, HOOK LINTEL AND SILL REINFORCING 90°


8 REINFORCING AROUND CMU WALL OPENING
SCALE: NONE

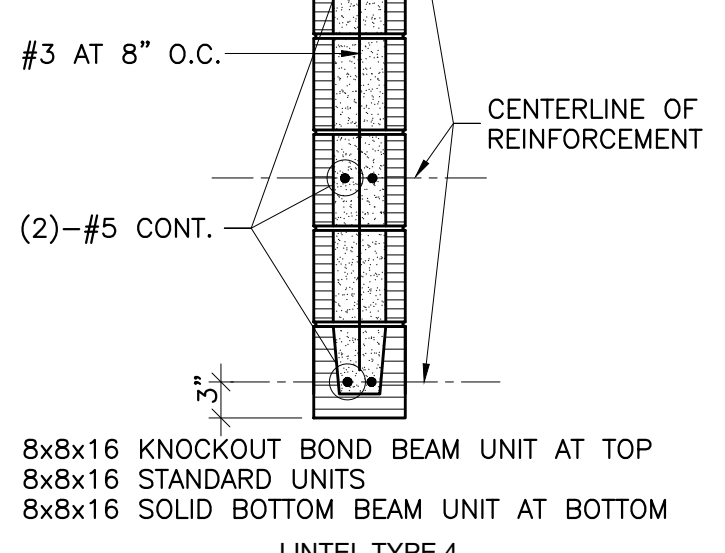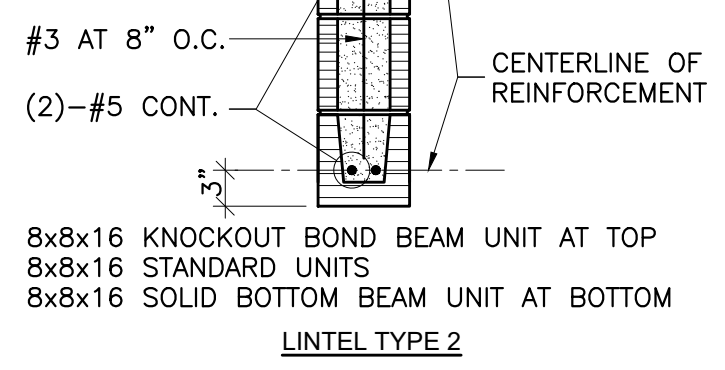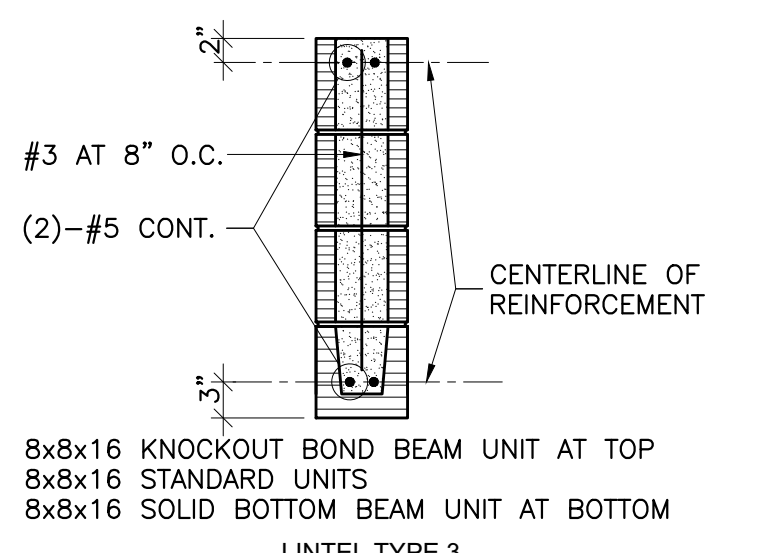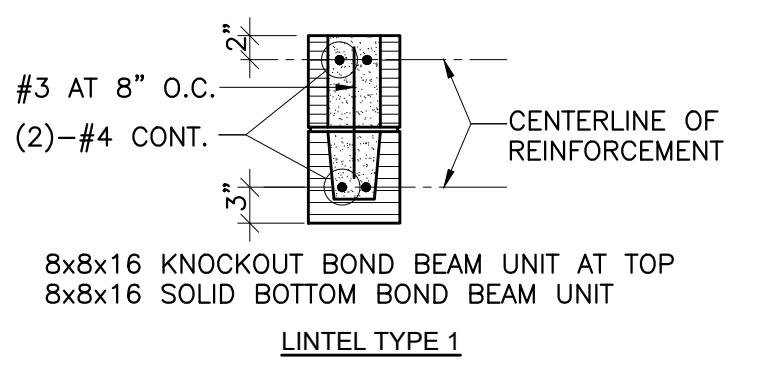


9 TYP. LINTEL TYPES
SCALE: NONE

| NON-LOAD BEARING CMU LINTEL SCHEDULE | |
|--------------------------------------|-----------------|
| TYPE | SPAN IN FEET |
| 1 | UP TO 4'-0" |
| 2 | 4'-1" TO 6'-8" |
| 3 | 6'-9" TO 9'-4" |
| 4 | 9'-5" TO 12'-0" |



NOTE: REFER # ON PLANS FOR REFER LINTEL TYPES.

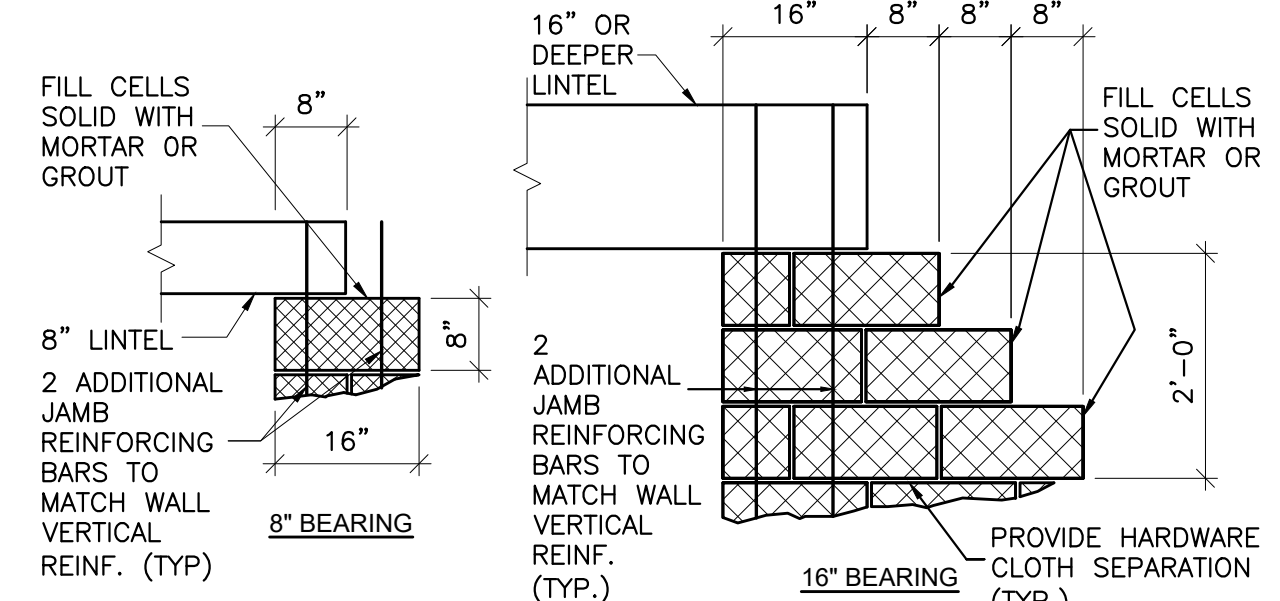

10 BEARING DETAILS TYP. LINTEL TYPES
SCALE: NONE

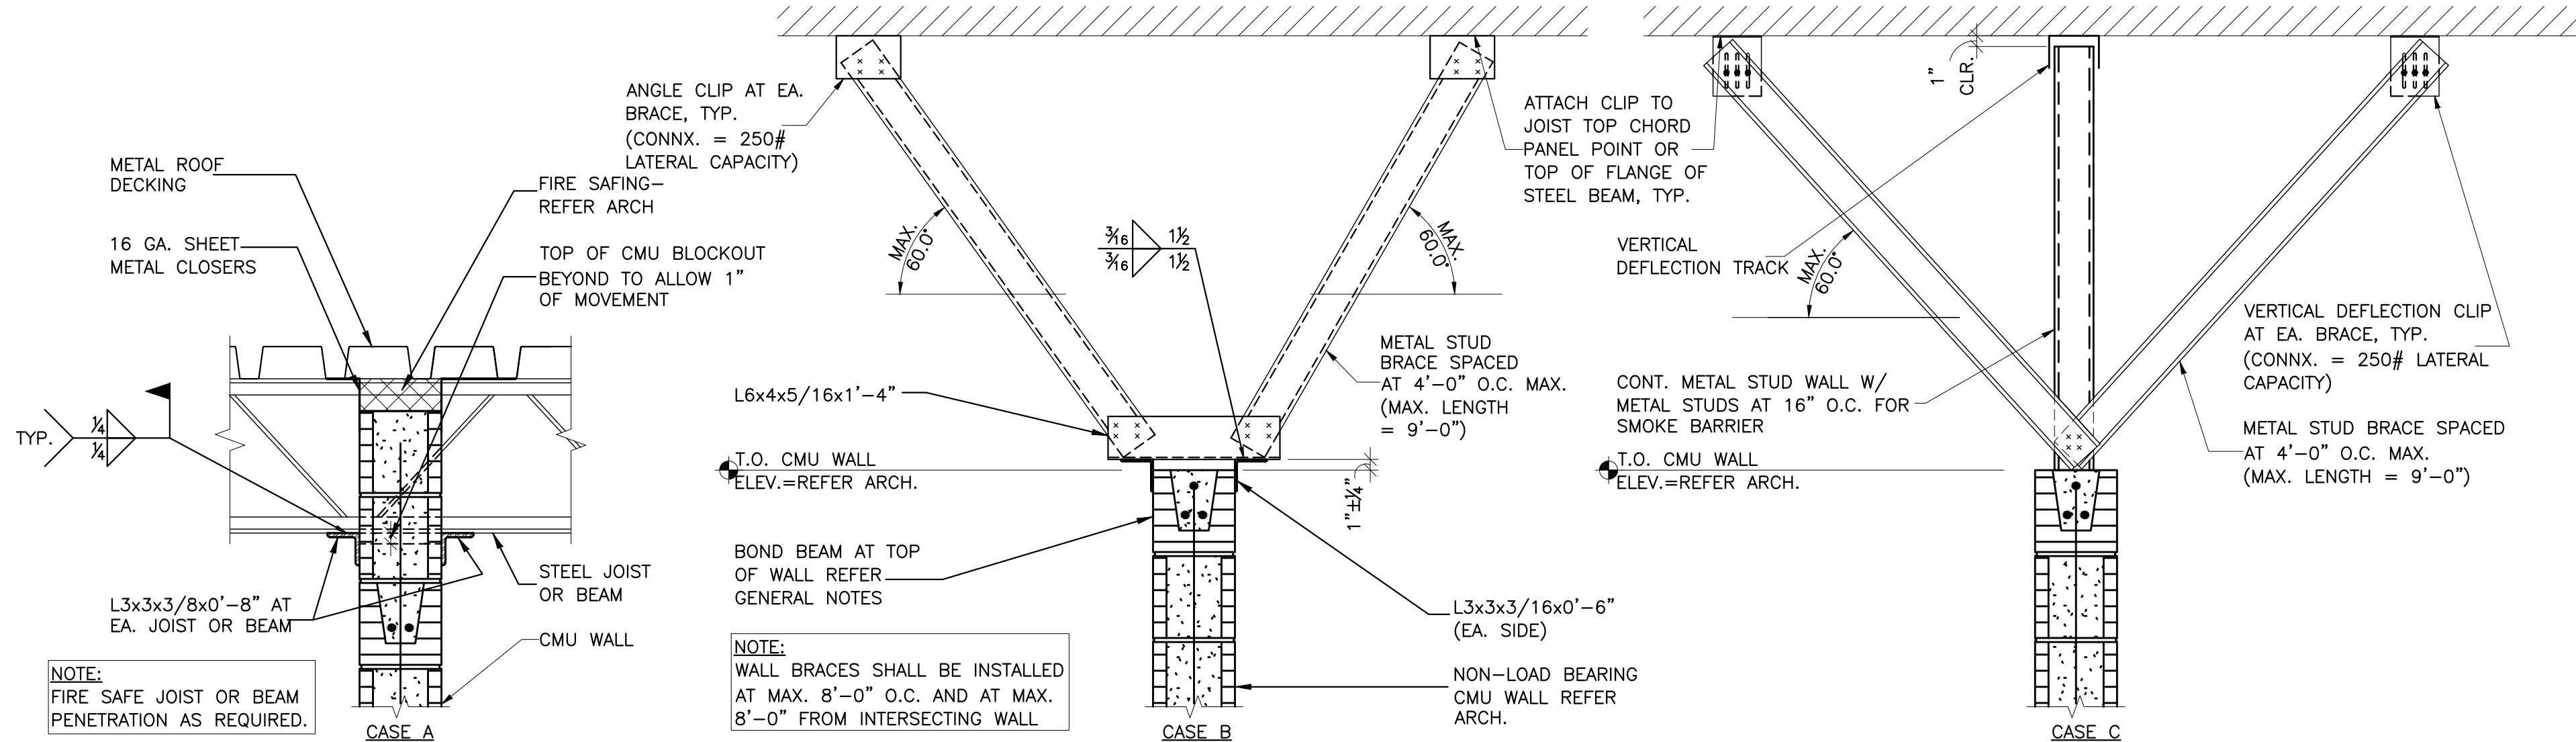

11 TYP. BRACING AT TOP OF NON-LOAD BEARING CMU
SCALE: NONE

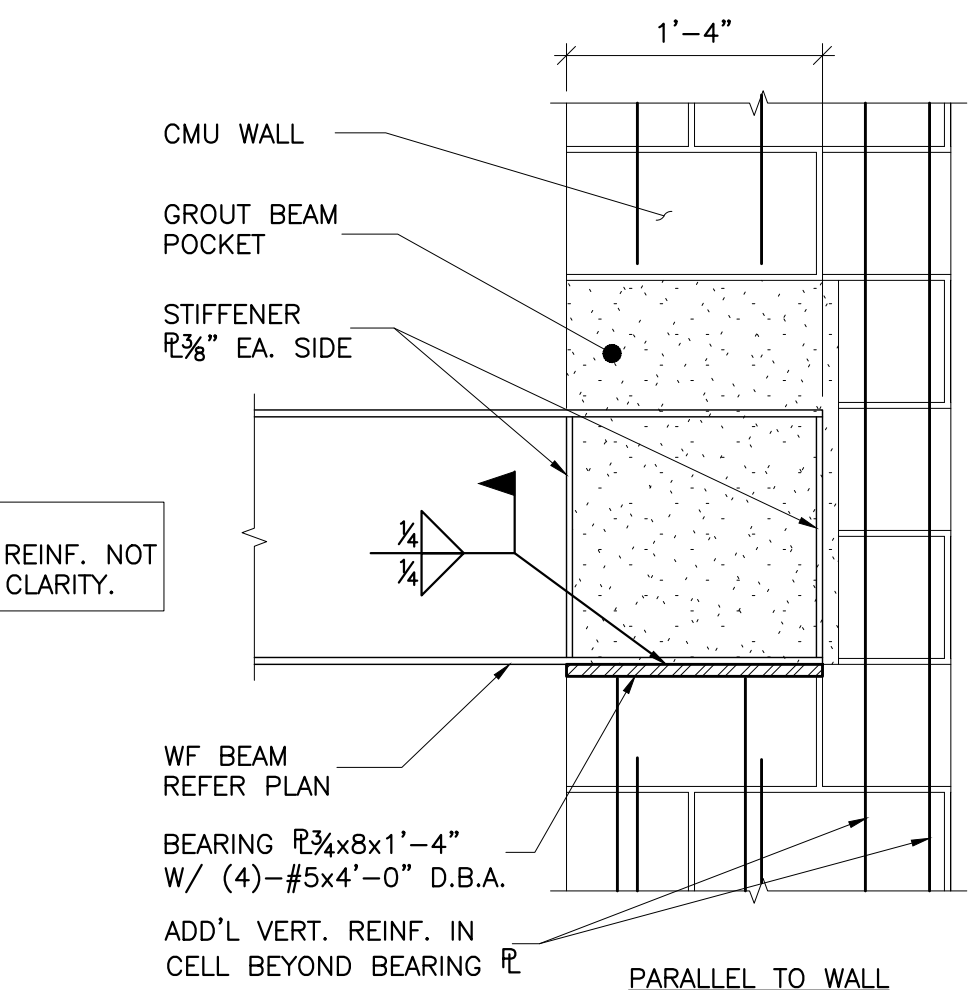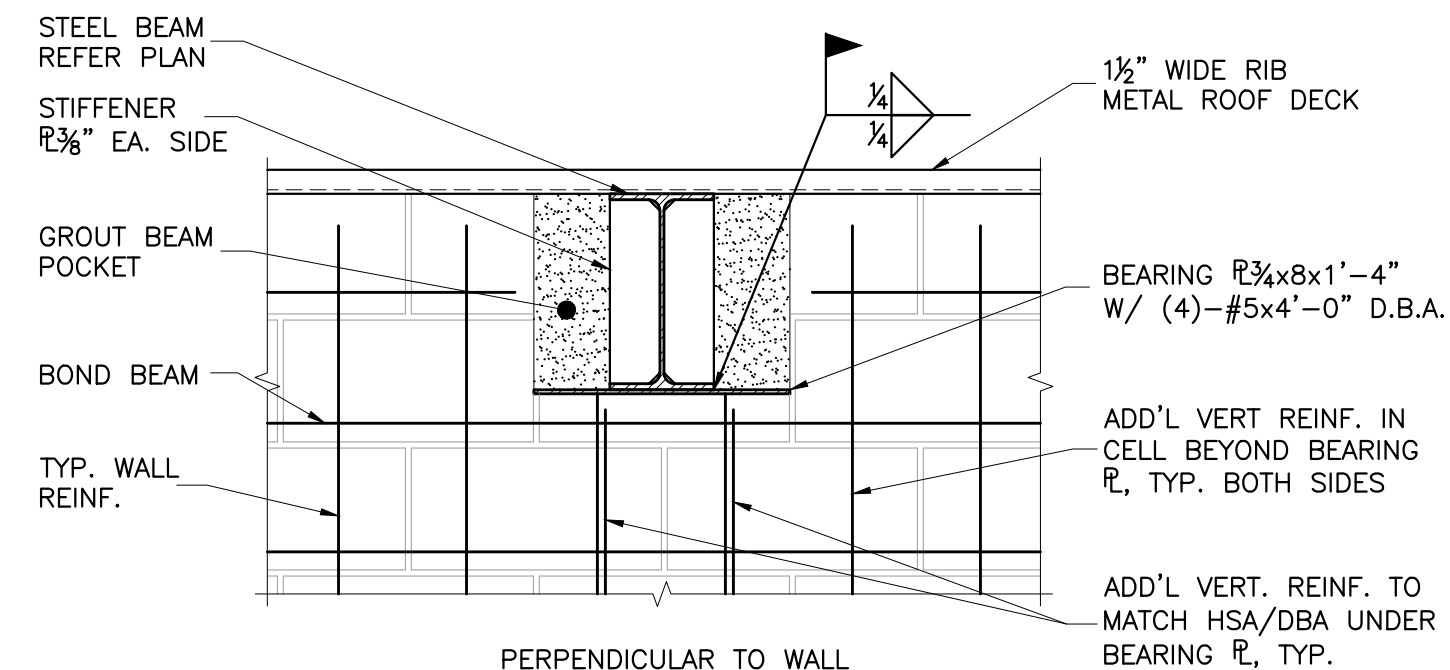

12 TYPICAL BEAM BEARING PLATE DETAILS
SCALE: NONE

KFC engineering
Kirkpatrick Forest Curtis PC
Structural Engineering
OK CA #3888, EXP. 06/30/25
525 Central Park Drive, Suite 202
Oklahoma City, OK 73105
405.528.4596 | kfcengr.com

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL


sheet no:

S104

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

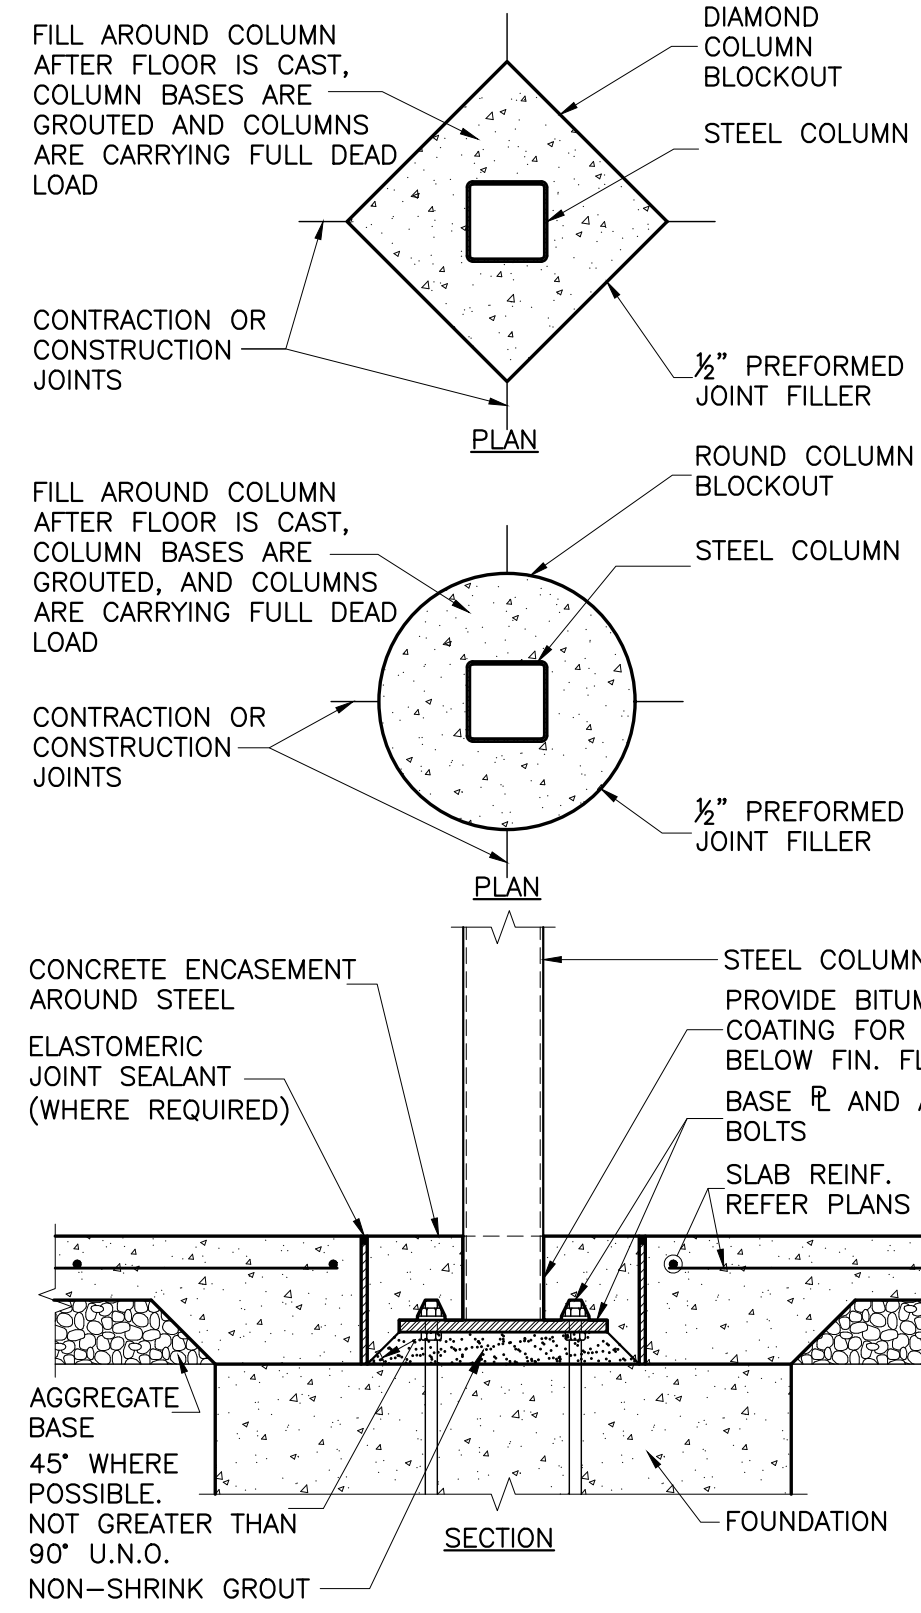

1 TYP. ISOLATION JOINT DETAILS
SCALE: NONE

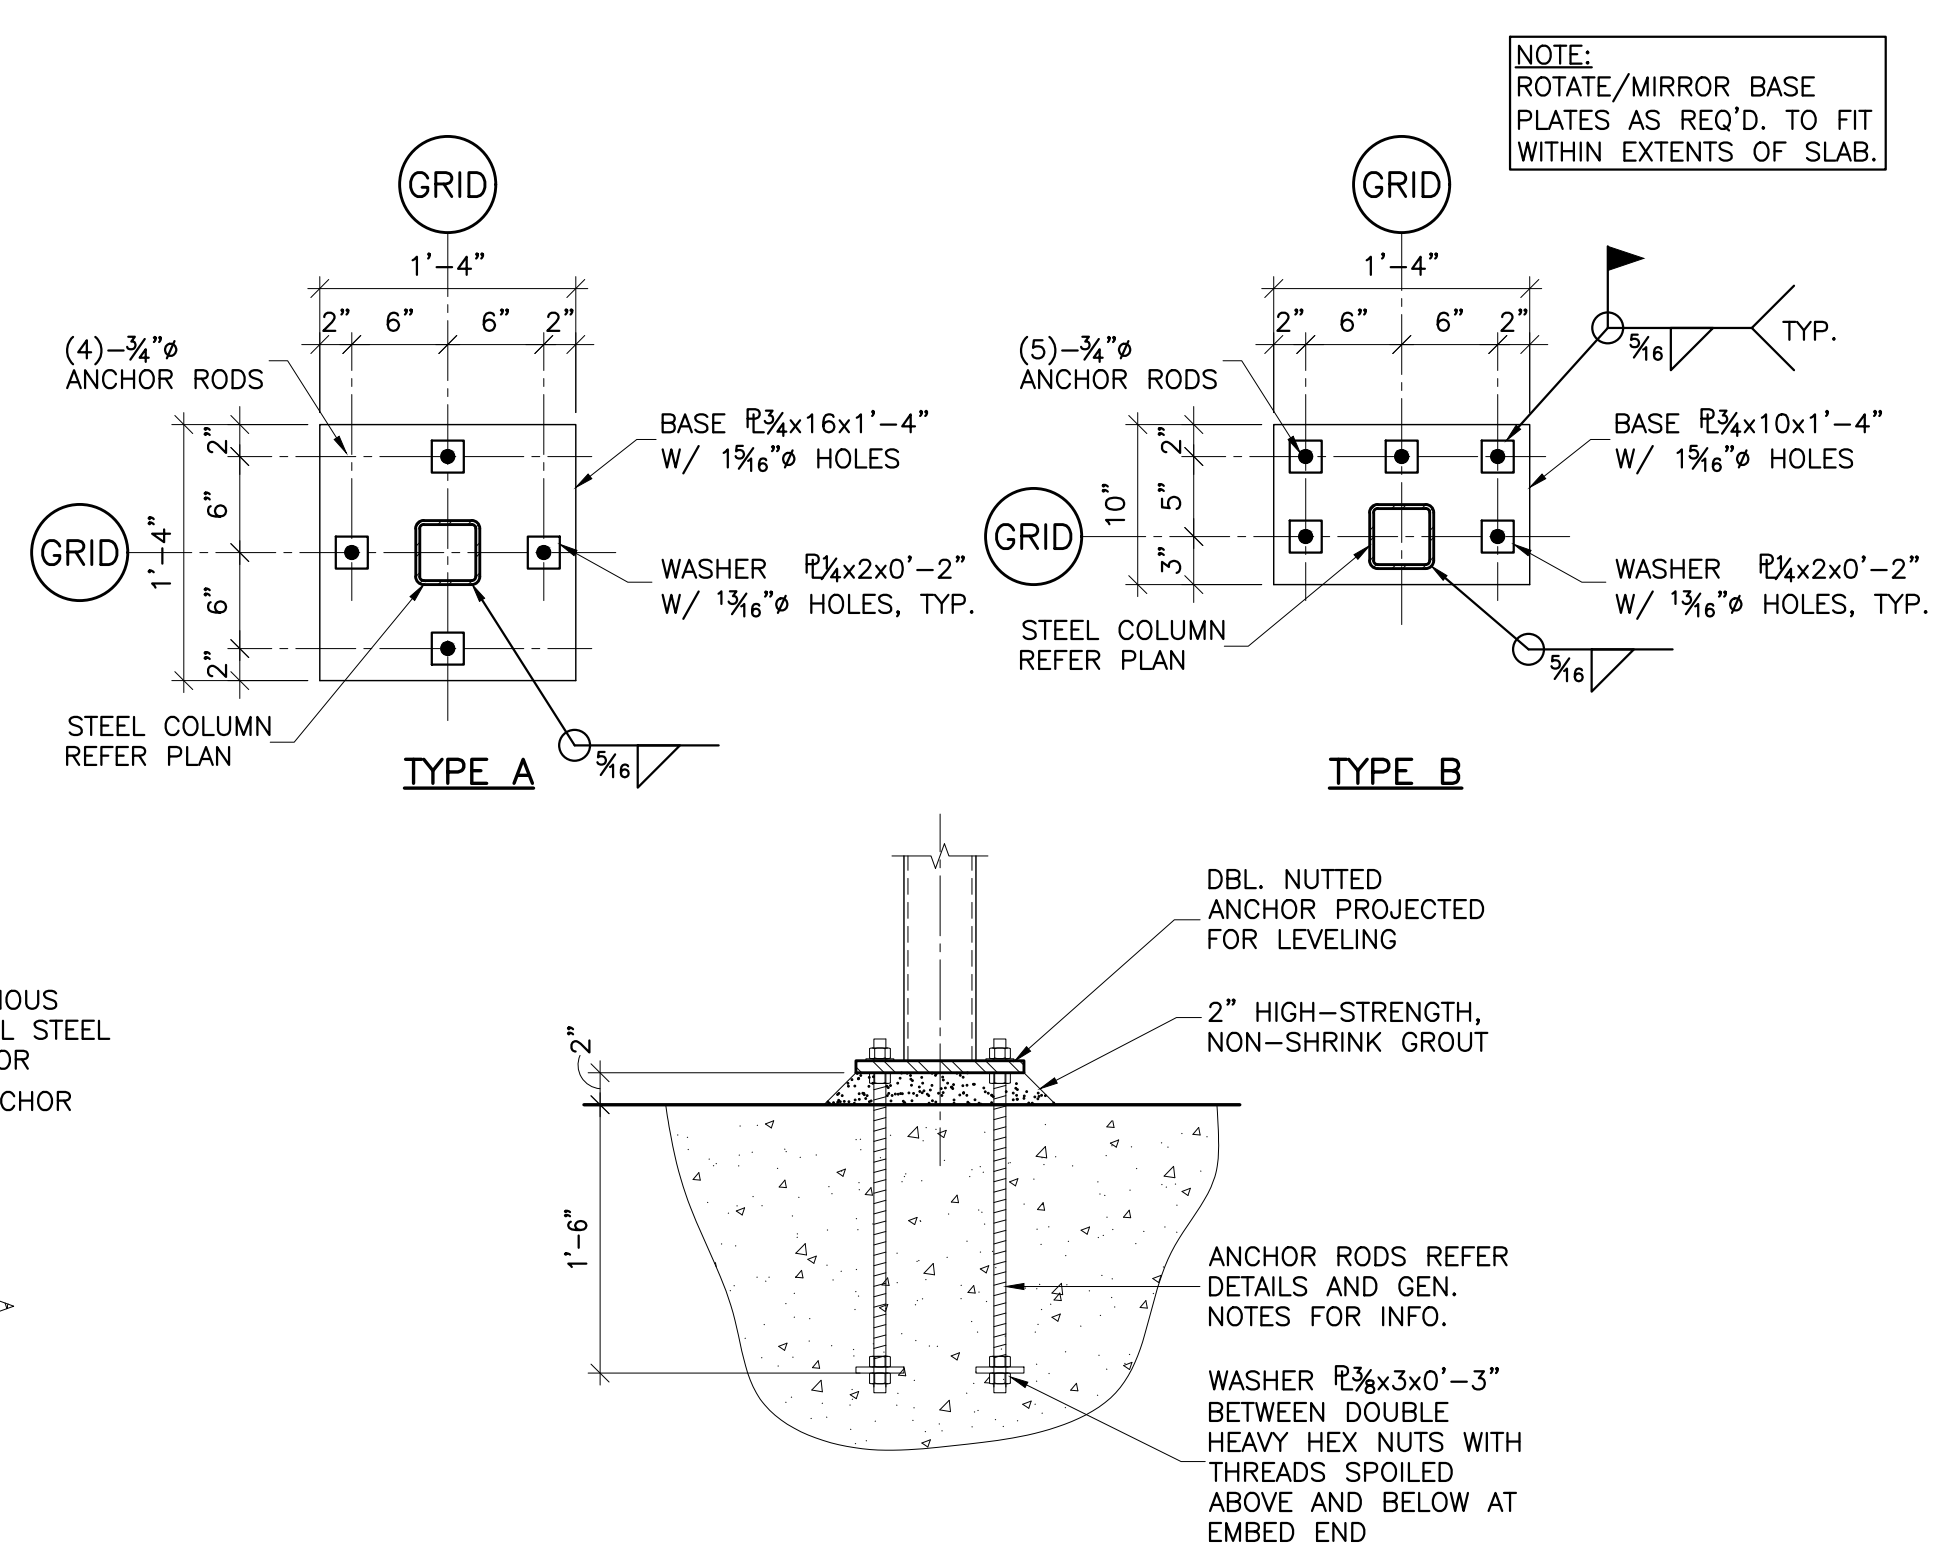


2 BASE PLATE DETAILS
SCALE: NONE

3/4" A325-N BOLT SCHEDULE FOR SINGLE PLATE SHEAR TAB CONNECTIONS (FACTORED LOADS)



| END REACTION | NO. OF BOLTS |
|-------------------|--------------|
| 0 THRU 31 KIPS | 2-3/8" |
| 31 THRU 47 KIPS | 3-3/8" |
| 47 THRU 63 KIPS | 4-3/8" |
| 63 THRU 79 KIPS | 5-3/8" |
| 79 THRU 95 KIPS | 6-3/8" |
| 95 THRU 111 KIPS | 7-3/8" |
| 111 THRU 127 KIPS | 8-3/8" |

NOTES:
1. VALUES SHOWN ARE APPLICABLE FOR SINGLE PLATE SHEAR TAB CONNECTIONS
2. SEE PLAN FOR END REACTIONS
3. L = PLATE LENGTH ≥ 1/2 OF CONNECTED BEAM.
4. AT HSS OR PIPE COLUMNS, A THROUGH-PLATE WITH EQUAL WELD ON THE BACK SIDE OF THE COLUMN IS REQUIRED UNDER EITHER OF THE FOLLOWING CIRCUMSTANCES:
A. FOR SQUARE OR RECTANGULAR HSS:
WHEN $\frac{R-2.78t}{0.93t} > 35.1$
B. FOR ROUND HSS OR PIPE:
WHEN $\frac{R}{t} > \frac{3.190}{F_y}$
WHERE:
B = NOMINAL COLUMN WIDTH ACROSS THE COLUMN FACE WITH THE SINGLE PLATE CONNECTION, IN.
D = OUTSIDE DIAMETER OF ROUND HSS OR PIPE, IN.
t = NOMINAL THICKNESS OF COLUMN, IN.
F_y = YIELD STRENGTH OF COLUMN, KSI

3 SINGLE PLATE SHEAR TAB CONNECTIONS (LRFD)
SCALE: NONE

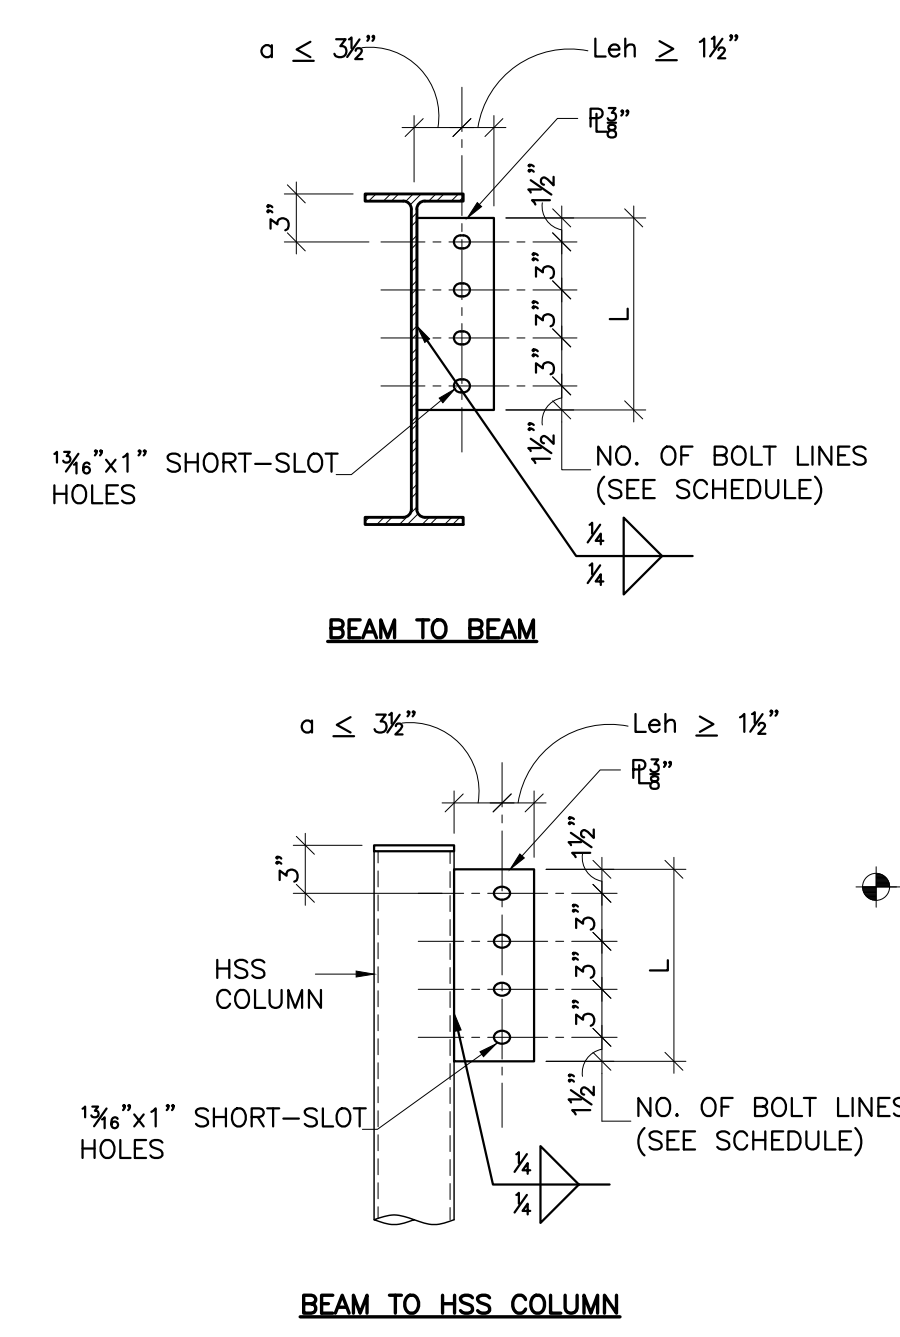


4 TYP. PARAPET GIRT TO COLUMN
SCALE: NONE

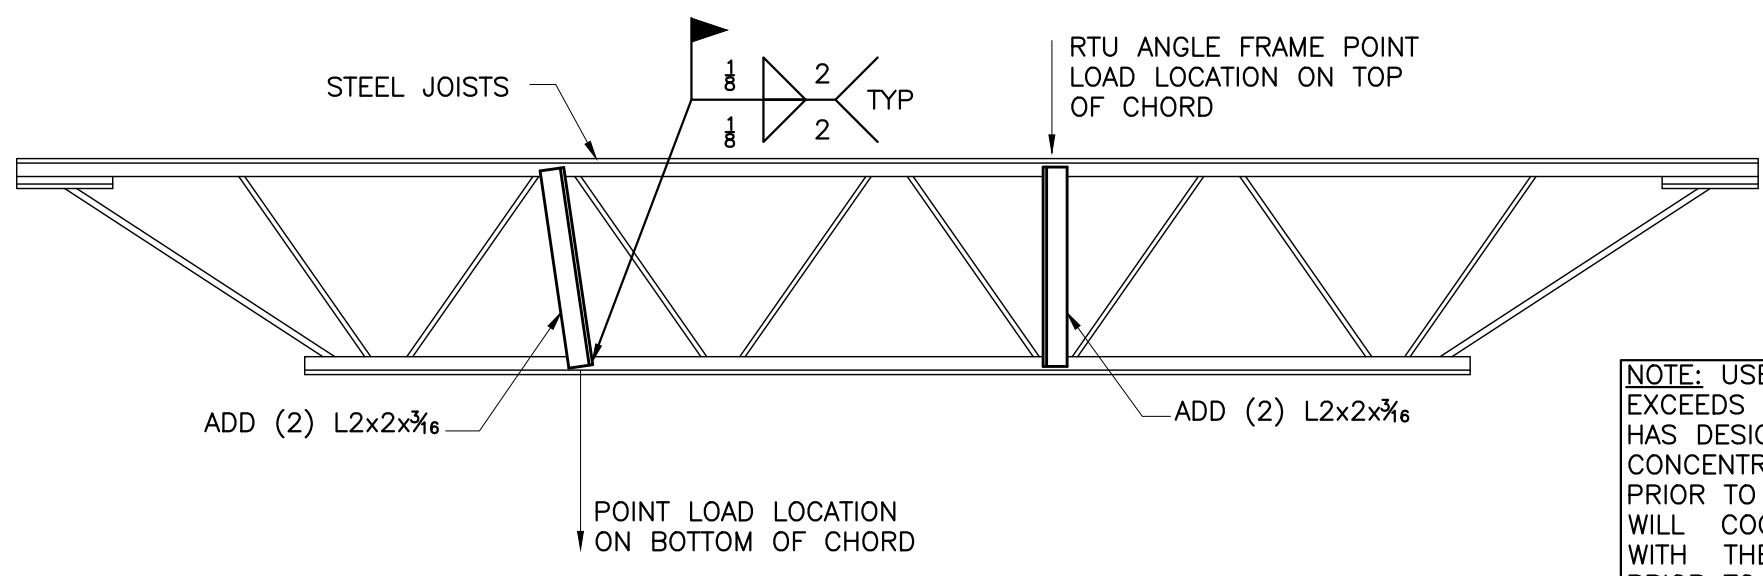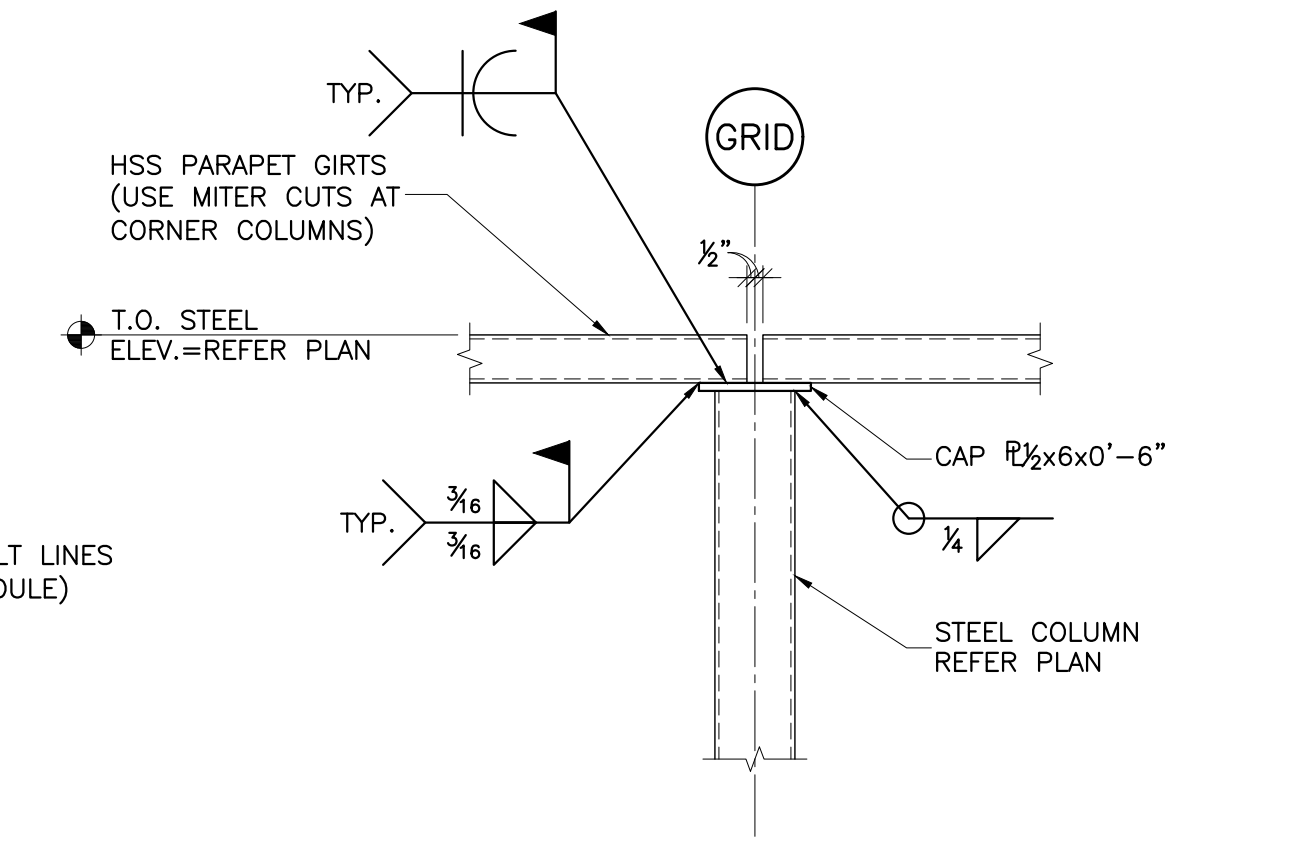


5 BRACING DETAIL FOR STEEL JOISTS W/ POINT LOADS
SCALE: NONE


NOTE: USE THIS DETAIL WHEN POINT LOAD EXCEEDS 50 LBS. AND THE JOIST MANUFACTURER HAS DESIGNED THE JOIST FOR THE FULL CONCENTRATED LOAD. ANGLES TO BE IN PLACE PRIOR TO APPLICATION OF LOAD. CONTRACTOR WILL COORDINATE ALL SUPERIMPOSED LOADS WITH THE JOIST MANUFACTURER & ENGINEER PRIOR TO APPLICATION OF LOAD.

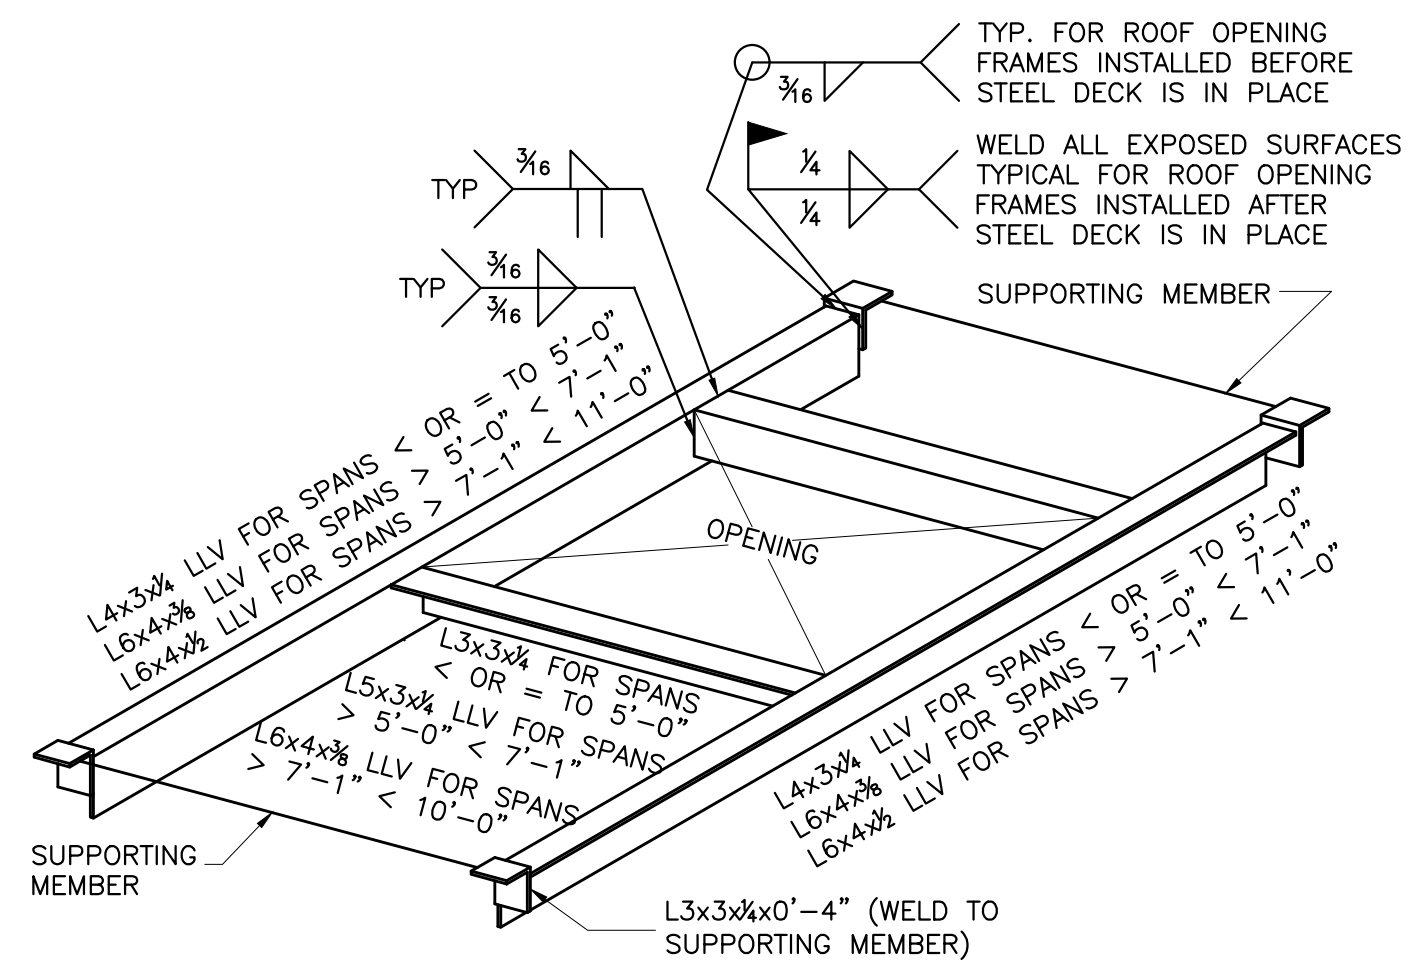

6 TYP. ROOF OPENING FRAME AND MECHANICAL UNIT SUPPORT
SCALE: NONE

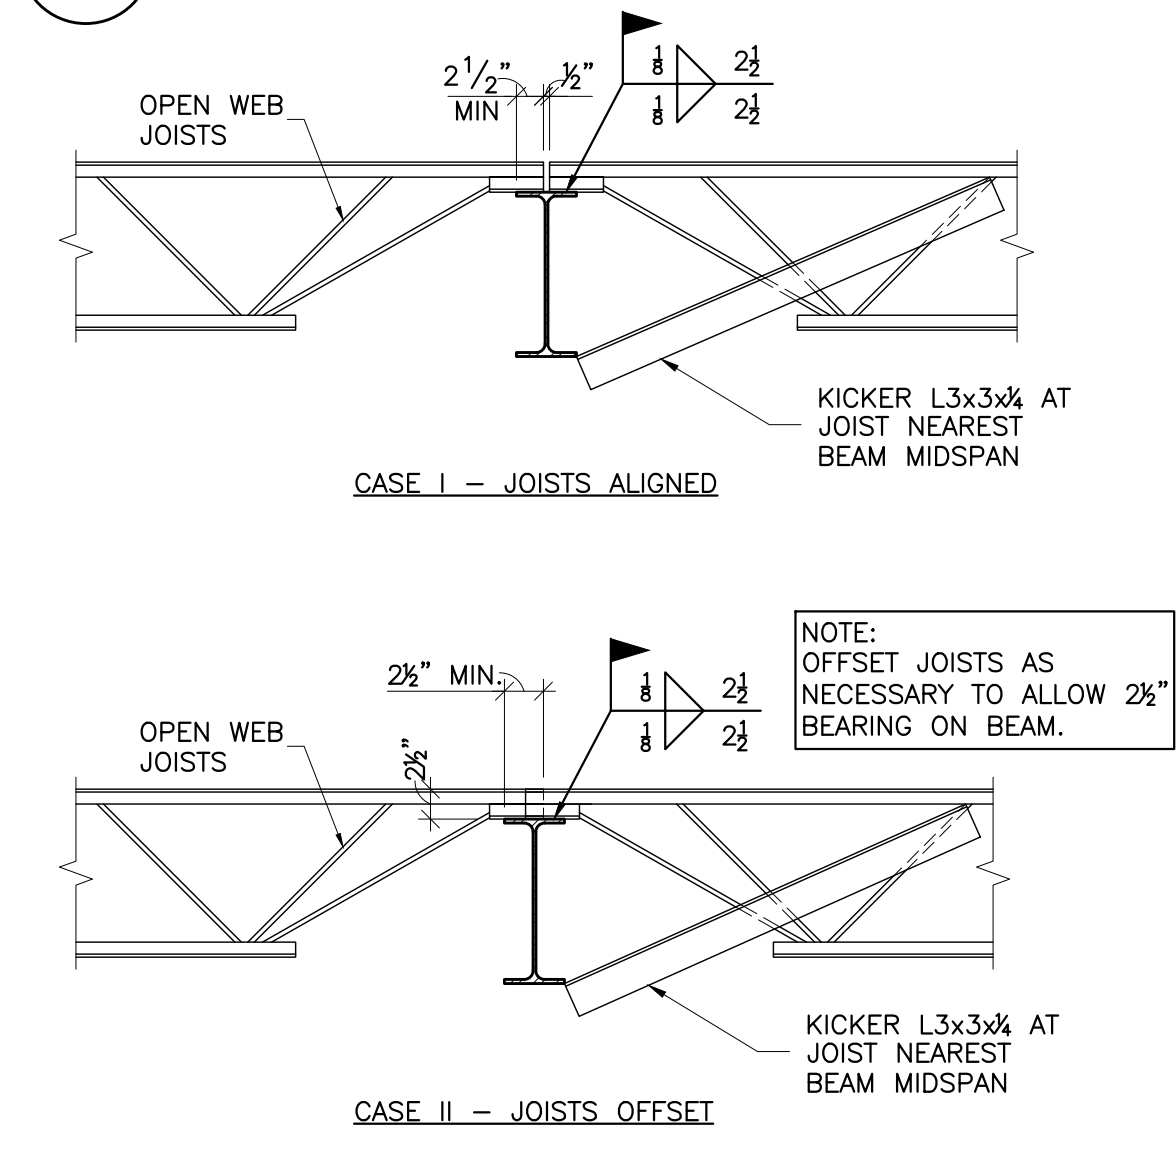


7 KICKER ANGLE AT BOTTOM FLANGE
SCALE: NONE

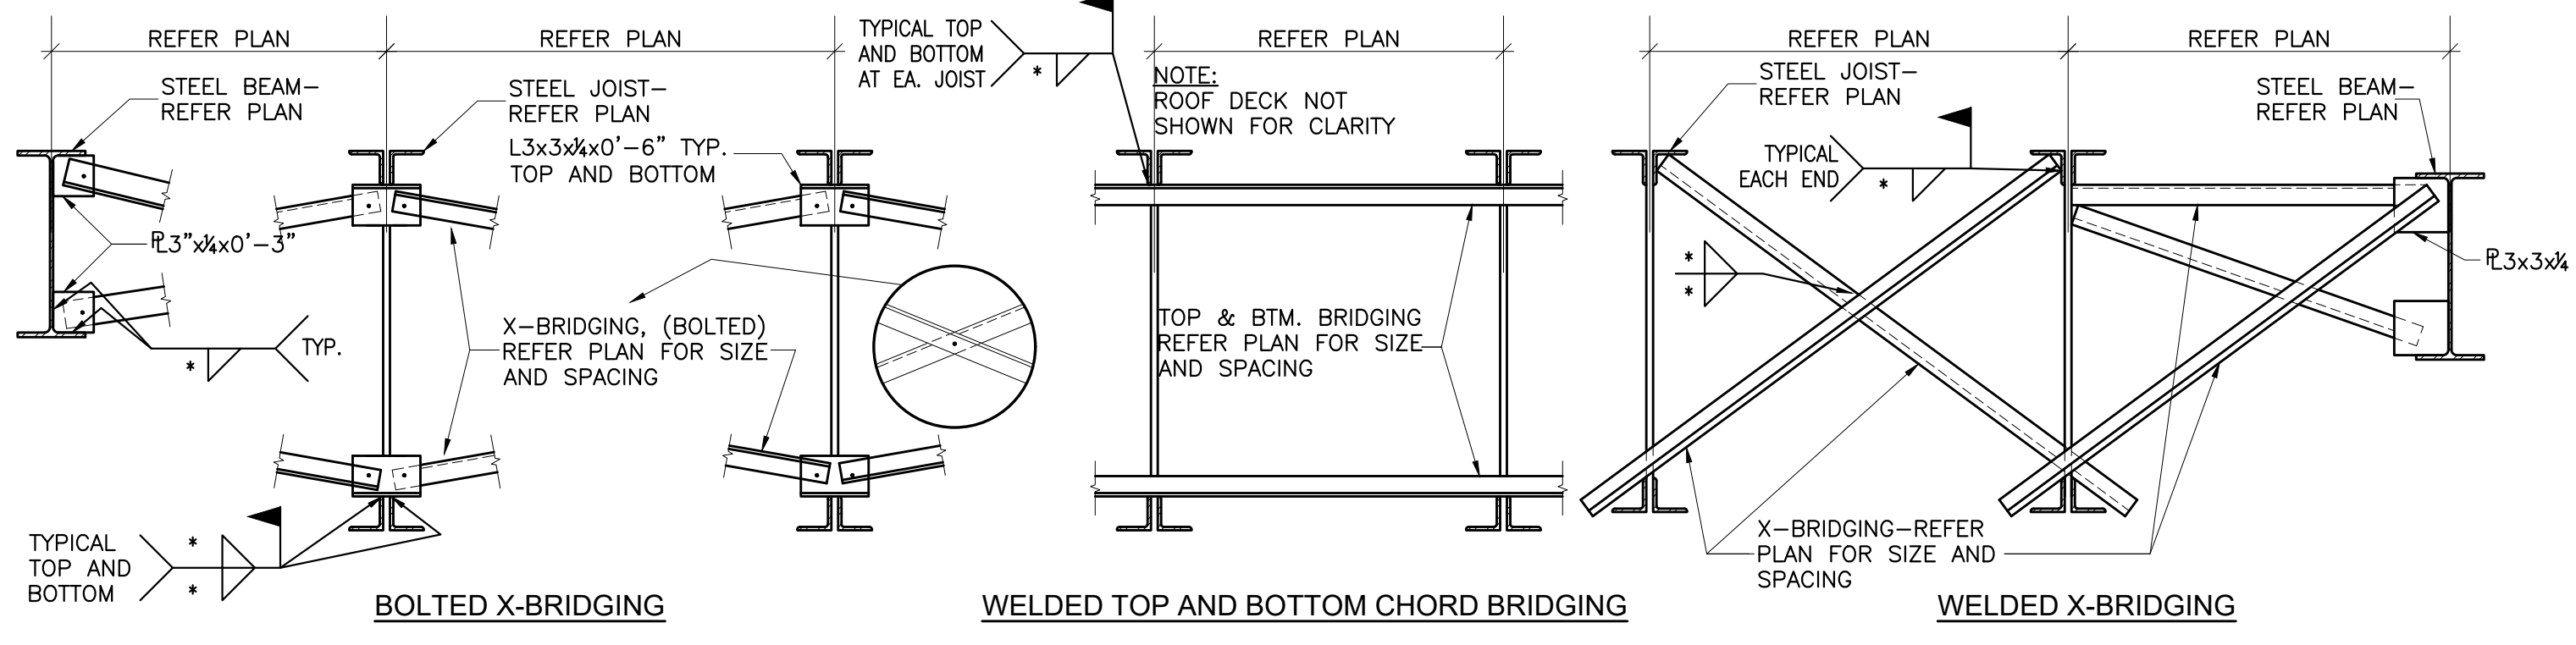

8 TYP. BRIDGING DETAILS AT JOISTS
SCALE: NONE

| JOIST DESIGNATION | SPAN, FT. | UNIFORMLY DISTRIBUTED LOADS, PLF | | | | | TRAPEZOIDAL LOADS, PLF | | | CONCENTRATED LIVE LOADS, LBS | | | | | | | | REMARKS | |
|-------------------|-----------|----------------------------------|-------|-----------|-----------|---------|------------------------|-------|------|------------------------------|-------|-----|--------|-----|--------|-----|---------|---------|---------|
| | | DL | LL | SL (N.D.) | SL (W.D.) | WL (IN) | WL (OUT) | SL1 | "A" | SL2 | "B" | P1 | "C" | P2 | "D" | P3 | "E" | | P4 |
| 16K4-SP1 | 28'-0" | 100.0 | 100.0 | 55.0 | 38.5 | 50.0 | 140.0 | 127.5 | 6.65 | | | 100 | 24'-0" | | | | | | |
| 16K4-SP2 | 28'-0" | 100.0 | 100.0 | 55.0 | 38.5 | 50.0 | 140.0 | | | 127.5 | 6.65 | 100 | 3'-5" | | | | | | |
| 18K4-SP3 | 28'-0" | 100.0 | 100.0 | 55.0 | 38.5 | 50.0 | 140.0 | | | 215.1 | 11.25 | 100 | 0'-8" | 100 | 4'-5" | | | | |
| 10K1-SP4 | 15'-0" | 100.0 | 100.0 | 55.0 | 38.5 | 50.0 | 140.0 | | | | | 100 | 5'-11" | 100 | 9'-7" | | | | |
| 18K4-SP5 | 30'-0" | 100.0 | 100.0 | 55.0 | 38.5 | 50.0 | 140.0 | | | 95.8 | 5.01 | 100 | 1'-5" | 100 | 5'-1" | 100 | 11'-3" | 100 | 14'-11" |
| 24K4-SP6 | 34'-0" | 83.4 | 83.4 | 45.9 | 32.1 | 108.4 | 181.0 | | | | | 100 | 11'-9" | 100 | 15'-1" | 100 | 18'-10" | 100 | 22'-2" |


NOTES:
1. SPANS SHOWN ARE APPROXIMATE. MANUFACTURER SHALL DETERMINE EXACT DESIGN SPANS.
2. REFER TO THE SPECIAL JOIST DIAGRAM FOR CLARIFICATION OF ALL NOMENCLATURE.
3. SL (N.D.) IS THE UNIFORM BALANCED SNOW LOAD TO BE CONSIDERED WITHOUT DRIFT LOADS.
4. SL (W.D.) IS THE UNIFORM SNOW LOAD WITH DRIFT INCLUDED.
5. JOISTS SHALL BE DESIGNED FOR ALL LOAD COMBINATIONS SPECIFIED IN THE GOVERNING BUILDING CODE. REFER GENERAL NOTES FOR THE APPLICABLE CODE.

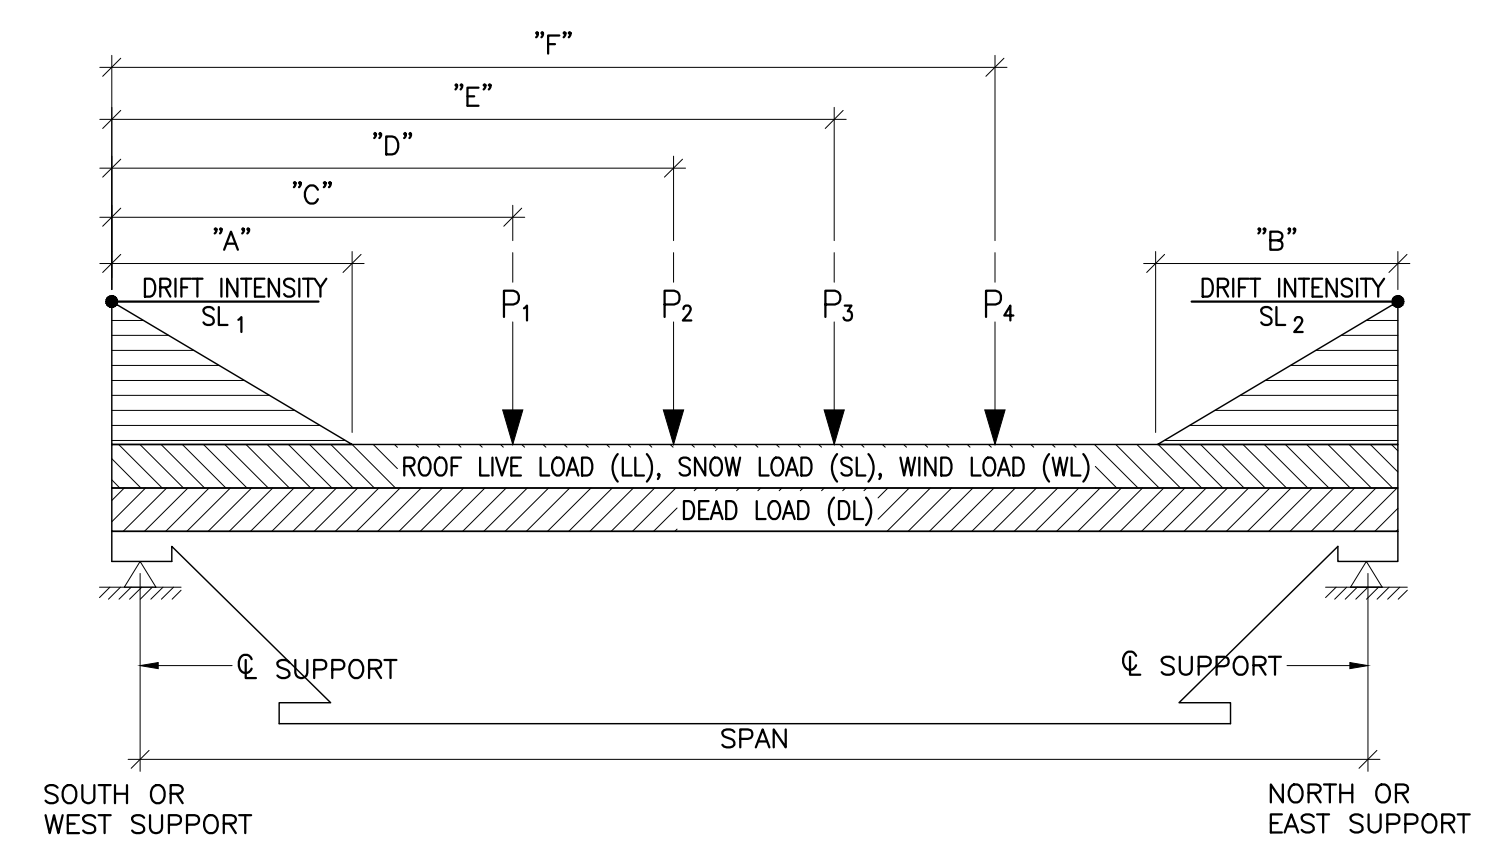

9 SPECIAL JOIST ELEVATION
SCALE: NONE

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK
CIVIL
KFC ENGINEERING
STRUCTURAL
SALAS O'BRIEN
MECHANICAL / ELECTRICAL

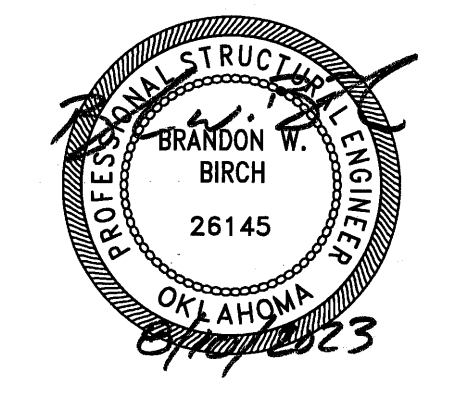

CJC
drawn by
BWB
checked by
JULY 2023
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S105

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.



1. STATEMENT OF SPECIAL INSPECTIONS NOTES:

- A. THIS STATEMENT OF SPECIAL INSPECTIONS IS INCLUDED AS REQUIRED BY CHAPTER 17 OF 2015 INTERNATIONAL BUILDING CODE AND AISC 360.
- B. SPECIAL INSPECTIONS SHALL CONFORM TO CHAPTER 17 OF THIS SHEET, SPECIFICATIONS, AISC 360, AND 2015 INTERNATIONAL BUILDING CODE. GENERAL REQUIREMENTS ARE LISTED BELOW AND IN THE ATTACHED INSPECTION TABLES.
- C. REFER TO PROJECT SPECIFICATIONS FOR ADDITIONAL SPECIAL INSPECTION REQUIREMENTS. IF CONFLICTING REQUIREMENTS ARE FOUND BETWEEN STATEMENTS OF SPECIAL INSPECTIONS AND THE PROJECT SPECIFICATIONS, THE MORE STRINGENT PROVISION SHALL CONTROL, UNLESS DIRECTED OTHERWISE IN WRITING BY THE STRUCTURAL ENGINEER OF RECORD.
- D. THE OWNER SHALL EMPLOY ONE OR MORE SPECIAL INSPECTORS FOR THIS PROJECT. THE SPECIAL INSPECTOR SHALL BE A QUALIFIED PERSON WHO SHALL DEMONSTRATE COMPETENCE, TO THE SATISFACTION OF THE BUILDING OFFICIAL, FOR THE INSPECTION OF THE PARTICULAR TYPE OF CONSTRUCTION OR OPERATION REQUIRING SPECIAL INSPECTION.
- E. THE SPECIAL INSPECTOR SHALL PROVIDE WRITTEN DOCUMENTATION TO THE BUILDING OFFICIAL DEMONSTRATING HIS OR HER COMPETENCE AND RELEVANT EXPERIENCE OR TRAINING. EXPERIENCE OR TRAINING SHALL BE CONSIDERED RELEVANT WHEN THE DOCUMENTED EXPERIENCE OR TRAINING IS RELATED IN COMPLEXITY TO THE SAME TYPE OF SPECIAL INSPECTION ACTIVITIES FOR PROJECTS OF SIMILAR COMPLEXITY AND MATERIAL QUALITIES.
- F. THE SPECIAL INSPECTOR SHALL PROVIDE CONTINUOUS OR PERIODIC INSPECTIONS AS SHOWN IN THE ATTACHED INSPECTION TABLES

- 1) CONTINUOUS INSPECTION: THE SPECIAL INSPECTOR SHALL BE PRESENT AT ALL PROCEDURAL EVENTS.
- 2) PERIODIC INSPECTION: THE SPECIAL INSPECTOR SHALL BE PRESENT AT THE START OF THE WORK AND PERIODIC INSPECTION IS MADE TO VERIFY PROGRESS OF WORK IS IN COMPLIANCE.
- G. INSPECTION OF FABRICATORS: WHERE FABRICATION OF STRUCTURAL LOADBearing MEMBERS AND ASSEMBLIES IS BEING PERFORMED ON THE PREMISES OF A FABRICATOR'S SHOP, SPECIAL INSPECTION OF THE FABRICATED ITEMS SHALL BE REQUIRED BY SECTION 1704.2 OF THE 2009 INTERNATIONAL BUILDING CODE AND SECTION 1704.2.5 OF THE 2015 INTERNATIONAL BUILDING CODE AND AS REQUIRED ELSEWHERE IN THE CODE.

- H. FABRICATOR APPROVAL: SPECIAL INSPECTIONS REQUIRED BY SECTION 1704 ARE NOT REQUIRED WHERE THE WORK IS DONE ON THE PREMISES OF A FABRICATOR REGISTERED AND APPROVED TO PERFORM SUCH WORK WITHOUT SPECIAL INSPECTION. APPROVAL SHALL BE BASED UPON REVIEW OF THE FABRICATOR'S WRITTEN PROCEDURAL AND QUALITY CONTROL MANUALS AND PERIODIC AUDITING OF FABRICATION PRACTICES BY AN APPROVED SPECIAL INSPECTION AGENCY. AT COMPLETION OF FABRICATION, THE APPROVED FABRICATOR SHALL SUBMIT A CERTIFICATE OF COMPLIANCE TO THE BUILDING OFFICIAL STATING THAT THE WORK WAS PERFORMED IN ACCORDANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS.

- I. REPORT REQUIREMENTS: SPECIAL INSPECTORS SHALL KEEP RECORDS OF INSPECTIONS. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL, AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE. REPORTS SHALL INDICATE THAT WORK INSPECTED WAS OR WAS NOT COMPLETED IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION. IF THEY ARE NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO THE COMPLETION OF THAT PHASE OF THE WORK. A FINAL REPORT DOCUMENTING REQUIRED SPECIAL INSPECTIONS AND CORRECTION OF ANY DISCREPANCIES NOTED IN THE INSPECTIONS SHALL BE SUBMITTED AT A POINT IN TIME AGREED UPON PRIOR TO THE START OF WORK BY THE APPLICANT AND THE BUILDING OFFICIAL.

- J. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING REASONABLE NOTICE TO THE SPECIAL INSPECTOR(S) REGARDING WHEN ELEMENTS OF THE PROJECT WILL BE READY FOR EFFICIENT IMPLEMENTATION OF SPECIAL INSPECTIONS.

- K. THE CONTRACTOR SHALL PROVIDE ACCESS TO THE LATEST VERSION OF ALL APPROVED PLANS AND SHOP DRAWINGS FOR THE SPECIAL INSPECTOR'S USE IN PERFORMING SPECIAL INSPECTIONS.

- L. CONTRACTOR SHALL GRANT ACCESS TO OWNER'S SPECIAL INSPECTOR AS IS REASONABLY NECESSARY FOR THE PROPER PERFORMANCE OF SPECIAL INSPECTIONS.

- M. SPECIAL INSPECTIONS DO NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY TO COMPLY WITH ALL REQUIREMENTS OF THE CONTRACT DOCUMENTS. CONSTRUCTION MEANS AND METHODS AND JOBSITE SAFETY ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.

N. STEEL QUALITY INSPECTOR QUALIFICATIONS.

- 1) QUALITY CONTROL INSPECTOR OF ERECTOR/FABRICATOR SHALL BE QUALIFIED TO THE SATISFACTION OF THE ERECTOR/ FABRICATOR'S QC PROGRAM AND AISC 360 SECTION N.4.1 REQUIREMENTS.
- 2) QUALITY ASSURANCE INSPECTOR SHALL BE QUALIFIED BY A QA AGENCY AND AISC 360 SECTION N.4.2 REQUIREMENTS.
- 3) NON-DESTRUCTIVE TESTING PERSONNEL, OR OTHER THAN VISUAL, SHALL BE QUALIFIED IN ACCORDANCE W/ EMPLOYER'S WRITTEN PRACTICE MEETING OR EXCEEDING REQUIREMENTS OF AWS D1.1/D1.1M AND EITHER ANST NTC-1A OR ANST CP-189 REQUIREMENTS.

| TABLE 1705.3 REQUIRED SPECIAL INSPECTIONS AND TESTS OF CONCRETE CONSTRUCTION | | | | |
|--|-------------------------------|-----------------------------|---|--------------------------------|
| TYPE | CONTINUOUS SPECIAL INSPECTION | PERIODIC SPECIAL INSPECTION | REFERENCED STANDARD | IBC REFERENCE |
| | | | | |
| 2) Reinforcing bar welding: | | X | | |
| a) Verify weldability of reinforcing bars other than ASTM A706; | - | X | AWS D1.4 ACI 318: 26.5.4 | - |
| b) Inspect single-pass fillet welds, maximum 5/16"; and | - | X | | |
| c) Inspect all other welds. | X | - | | |
| 3) Inspect anchors cast in concrete. | - | X | ACI 318:17.8.2 | - |
| 4) Inspect size, embedment, and installation of post-installed anchors. | X | - | Manuf. Requirements | |
| 5) Verify use of required design mix. | - | X | ACI 318: Ch. 19, 26.4.3, 26.4.4 | 1904.1, 1904.2, 1908.2, 1908.3 |
| 6) Prior to concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete. | X | - | ASTM C 172 ASTM C 31 ACI 318: 26.4, 26.12 | 1908.10 |
| 7) Inspect concrete and shotcrete placement for proper application techniques. | X | - | ACI 318: 26.5 | 1908.6, 1908.7, 1908.8 |
| 8) Verify maintenance of specified curing temperature and techniques. | - | X | ACI 318: 26.5.3-26.5.5 | 1908.9 |
| 9) Inspect prestressed concrete for: | | | | |
| a) Application of prestressing forces; and | X | - | ACI 318: 26.10 | - |
| b) Grouting of bonded prestressing tendons. | X | - | | |
| 10) Inspect erection of precast concrete members. | - | X | ACI 318: Ch. 26.8 | - |
| 11) Verify in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms from beams and structural slabs. | - | X | ACI 318: 26.11.2 | - |
| 12) Inspect formwork for shape, location and dimensions of the concrete member being formed. | - | X | ACI 318: 26.11.1.2(b) | - |

| TABLE 3.1.2 – QUALITY ASSURANCE REQUIRED INSPECTIONS AND TESTS OF MASONRY CONSTRUCTION | | | | | | |
|---|-------------------------|------------------|---------------------|------------------|---|--|
| MINIMUM TESTS | | | | | | |
| Verification of Slump flow and Visual Stability Index (VSI) as delivered to the project site in accordance with Specification Article 1.5B-1.b.3 for self-consolidation grout | | | | | | |
| Verification of F_m and F_{AAC} in accordance with Specification Article 1.4 B prior to construction, except where specifically exempted. At shelter walls, prisms created in the field shall be tested to verify F_m . | | | | | | |
| MINIMUM SPECIAL INSPECTIONS | | | | | | |
| INSPECTION TASK | FREQUENCY (NON-SHELTER) | | FREQUENCY (SHELTER) | | REFERENCE FOR CRITERIA | |
| | CONTINUOUS | PERIODIC | CONTINUOUS | PERIODIC | TMS 402/ACI 530/ASCE 5 | TMS 602/ACI 530.1/ASCE 6 |
| 1. Verify compliance with the approved submittals. | - | X | X | - | - | Art. 1.5 |
| 2. As masonry construction begins, verify that the following are in compliance: | | | | | | |
| a. Proportions of site-prepare mortar | - | X | - | X | - | - |
| b. Construction of mortar joints | - | X | - | X | - | Art. 2.1, 2.6 A |
| c. Grade and size of prestressing tendons and anchorages | - | X | X | - | - | Art. 2.4 B, 2.4 H |
| d. Location of reinforcement, connectors, and prestressing tendons and anchorages | - | X | X | - | - | Art. 3.4, 3.6 A |
| e. Prestressing technique | - | X | X | - | - | Art. 3.6 B |
| f. Properties of thin-bed mortar for AAC masonry | X ^(a) | X ^(b) | X ^(a) | X ^(b) | - | Art. 2.1 C |
| 3. Prior to grouting, verify that the following are in compliance: | | | | | | |
| a. Grout space | - | X | X | - | - | Art. 3.2 D, 3.2 F |
| b. Grade, type, and size of reinforcement and anchor bolts, and prestressing tendons and anchorages | - | X | X | - | Sec. 6.1 | Art. 2.4, 3.4 |
| c. Placement of reinforcement, connectors, and prestressing tendons and anchorages | - | X | X | - | Sec. 6.1, 6.2.1, 6.2.6, 6.2.7 | Art. 3.2 E, 3.4, 3.6A |
| d. Proportions of site-prepared grout and prestressing grout for bonded tendons | - | X | X | - | - | Art. 2.6 B, 2.4 G.1.b |
| e. Construction of mortar joints | - | X | X | - | - | Art. 3.3. B |
| 4. Verify during construction: | | | | | | |
| a. Size and location of structural elements. | - | X | X | X | - | Art. 3.3 F |
| b. Type, size and location of anchors, including other details of anchorage of masonry to structural members, frames or other construction. | - | X | X | X | Sec. 1.2.1 (e), 6.1.4.3, 6.2.1 | - |
| c. Welding of reinforcing bars. | X | - | X | - | Sec. 8.1.6.7.2, 9.3.3.4(c), 11.3.3.4(b) | - |
| d. Preparation, construction and protection of masonry during cold weather (temperature below 40°F) or hot weather (temperature above 90°F). | - | X | X | - | - | Art. 1.8 C, 1.8 D |
| e. Application and measurement of prestressing force | X | - | X | - | - | Art. 3.6 B |
| f. Placement of grout and prestressing grout for bonded tendons in compliance | X | - | X | - | - | Art. 3.5, 3.6 C |
| g. Placement of AAC masonry units and construction of thin-bed mortar joints | X ^(a) | X ^(b) | X | X | - | Art. 3.3 B.9, 3.3 F.1.b |
| 5. Observe preparation of grout specimens, mortar specimens, and/or prisms | - | X | X | - | - | Art. 1.4 B.2.a.3, 1.4 B.2.b.3, 1.4 B.2.c.3, 1.4 B.3, 1.4 B.4 |

a. Required for the first 5000 square feet of AAC masonry.
b. Required after the first 5000 square feet of AAC masonry.

| REQUIRED VERIFICATION AND INSPECTION OF STEEL CONSTRUCTION | | | |
|--|--|---|---|
| VERIFICATION AND INSPECTION | FREQUENCY OF INSPECTION | | REFERENCED STANDARD |
| | CONTINUOUS (inspect each joint/member) | PERIODIC (inspect random joint/members) | |
| 1. Material verification of high-strength bolts, nuts and washers: | | | |
| a. Identification markings to conform to ASTM standards specified in the approved construction documents. | - | QC and QA | AISC 360, Section A3.3 and applicable ASTM material standards |
| b. Manufacturer's certifications available for fastener materials. | QA | QC | |
| c. Fasteners marked in accordance with ASTM requirements. | - | QC and QA | |
| d. Proper fasteners selected for the joint detail (grade, type, bolt length if threads are to be excluded from shear plane). | - | QC and QA | |
| e. Proper bolting procedure selected for joint detail. | - | QC and QA | AISC 360, Table N5.6-1 |
| f. Connecting elements, including the appropriate faying surface condition and hole preparation, if specified, meet applicable requirements. | - | QC and QA | |
| g. Pre-installation verification testing by installation personnel observed and documented for fastener assemblies and methods used. | QC | QA | |
| h. Proper storage provided for bolts, nuts, washers and other fastener components. | - | QC and QA | |
| 2. Inspection of high-strength bolting: | | | |
| <ul style="list-style-type: none"> For bolts requiring pretensioning, the special inspector shall observe the preinstallation testing and calibration procedures; determine that all piles of connected materials have been drawn together and properly snugged prior to pretensioning and monitor the installation of bolts to verify that fasteners are pretensioned in accordance with the RCSC Specification, progressing systematically from the most rigid point to the free edges. For joints required to be tightened only to the snug-tight condition, the special inspector need only verify that the connected materials have been drawn together and properly snugged. | | | |
| a. Snug-tight joints. | - | QC and QA | |
| b. Pretensioned and slip-critical joints using turn-of-nut with matchmarking, twist-off bolt or direct tension indicator methods of installation. | - | QC and QA | AISC 360, Section M2.5 |
| c. Pretensioned and slip-critical joints using turn-of-nut without matchmarking of calibrated wrench methods of installation. | QC and QA | - | |
| d. Fastener assemblies, of suitable condition, placed in all holes and washers (if required) are positioned as required. | - | QC and QA | AISC 360, Table N5.6-2 |
| e. Fastener component not turned by the wrench prevented from rotating. | - | QC and QA | |
| f. Document acceptance or rejection of bolted connections. | QC and QA | - | AISC 360, Table N5.6-3 |
| 3. Material verification of structural steel and cold-formed steel deck U.N.O.: | | | |
| a. For structural steel, identification markings to conform to AISC 360. | - | QC and QA | AISC 360, Section M1 |
| b. For other steel, identification markings to conform to ASTM standards specified in the approved construction documents. | - | QC and QA | Applicable ASTM material standards |
| 4. Inspection prior to welding: | | | |
| a. Verify identification markings of weld filler materials conform to AWS specification in the approved construction documents. | - | QC and QA | AISC 360, Section A3.5 and applicable AWS AS documents |
| b. Welding procedure specifications are available. | QC and QA | - | |
| c. Manufacturer certifications for welding consumables available. | QC and QA | - | |
| d. Material identification (type/grade) and welded identification system. | - | QC and QA | AISC 360, Table N5.4-1 |
| e. Fit-up of welds including but not limited to joint preparation, dimensions, cleanliness, tacking, and backing type/fit as applicable. | - | QC and QA | |
| f. Configuration and finish of access holes | - | QC and QA | |
| g. Check welding equipment. | - | QC | |

| TABLE 1705.6 REQUIRED SPECIAL INSPECTIONS AND TESTS OF SOILS | | |
|--|-------------------------------|-----------------------------|
| TYPE | CONTINUOUS SPECIAL INSPECTION | PERIODIC SPECIAL INSPECTION |
| 1. Verify materials below shallow foundations are adequate to achieve the design bearing capacity. | - | X |
| 2. Verify excavations are extended to proper depth and have reached proper material. | - | X |
| 3. Perform classification and testing of compacted fill materials. | - | X |
| 4. Verify use of proper materials, densities and lift thicknesses during placement and compaction of compacted fill. | X | - |
| 5. Prior to placement of compacted fill, inspect subgrade and verify that site has been prepared properly. | - | X |

| REQUIRED VERIFICATION AND INSPECTION OF STEEL CONSTRUCTION | | | |
|--|--|---|---------------------------------------|
| VERIFICATION AND INSPECTION | FREQUENCY OF INSPECTION | | REFERENCED STANDARD |
| | CONTINUOUS (inspect each joint/member) | PERIODIC (inspect random joint/members) | |
| 5. Inspection of welding: | | | |
| a. AISC 360 requirements for welding structural steel | | | |
| 1) Use of qualified welders | - | QC and QA | AISC 360, Table N5.4-2 During Welding |
| 2) Packaging and exposure control and handling of welding consumables. | - | QC and QA | |
| 3) Welding over cracked tack welds | - | QC and QA | |
| 4) Environmental conditions including but not limited to precipitation, temperature and wind. | - | QC and QA | |
| 5) Verify settings on equipment, travel speeds, electrode materials, shielding gas type/flow rate, preheating interpass temperatures and proper position meets WPS standards. | - | QC and QA | |
| 6) Verify welding techniques for interpass, final cleaning, profile limitations, and quality requirements. | - | QC and QA | |
| 7) Welds are cleaned and painted where required. | - | QC and QA | |
| 8) Verify size, length and locations of welds. | QC and QA | - | |
| 9) Visually verify welds for crack prohibition, weld/base-metal fusion, crater cross section, weld profiles, weld size, undercutting, and porosity. | QC and QA | - | AISC 360, Table N5.4-2 After Welding |
| 10) Arc strikes, k-area cracks within 3" of weld, removal of backing, and repair activities as applicable. | QC and QA | - | |
| 11) Documentation of acceptance or rejection of welded joint or member. | QC and QA | - | |
| b. American Welding Society requirements for structural steel and cold-formed steel deck: | | | |
| 1) Complete and partial joint penetration groove welds. | X | - | AWS D1.1 |
| 2) Multipass fillet welds. | X | - | |
| 3) Single-pass fillet welds > 5/16" | X | - | |
| 4) Plug and slot welds. | X | - | |
| 5) Single-pass fillet welds ≤ 5/16" | - | X | |
| 6) Floor and roof deck welds. | - | X | AWS D1.3 |
| 7) Welded studs & deformed bar anchors (DBA's). | - | X | AWS D1.1 |
| 8) Welded sheet steel for cold-formed steel members | - | X | AWS D1.3 |
| 9) Welding of stairs & railing systems | - | X | AWS D1.1 |
| c. Reinforcing steel: | | | |
| 1) Verification of weldability of reinforcing steel other than ASTM A 706. | - | X | |
| 2) Reinforcing steel resisting flexural and axial forces in intermediate and special moment frames, and boundary elements of special structural walls of concrete and shear reinforcement. | X | - | AWS D1.4, ACI 318: Section 3.5.2 |
| 3) Shear reinforcement. | X | - | |
| 4) Other reinforcing steel. | - | X | |
| 6. Inspection of steel elements of composite construction prior to concrete placement: | | | |
| a. Placement and installation of steel deck. | QC and QA | - | AISC 360, Table N6.1 |
| b. Placement and installation of steel HSA. | QC and QA | - | AISC 360, Table N6.1 |
| c. Documentation of acceptance or rejection of steel elements. | QC and QA | - | AISC 360, Table N6.1 |

| TABLE 1705.2.3 REQUIRED SPECIAL INSPECTIONS OF OPEN-WEB STEEL JOISTS AND JOIST GIRDERS | | | |
|---|-------------------------------|-----------------------------|--|
| TYPE | CONTINUOUS SPECIAL INSPECTION | PERIODIC SPECIAL INSPECTION | REFERENCED STANDARD |
| 1. Installation of open-web steel joists and joist girders. | | | |
| a. End connections – welding or bolted. | - | X | SJI specification listed in Section 2207.1 |
| b. Bridging – horizontal or diagonal. | | | |
| 1. Standard bridging. | - | X | SJI specification listed in Section 2207.1 |
| 2. Bridging that differs from SJI specifications listed in Section 2207.1 | - | X | |



201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK


CIVIL

KFC ENGINEERING

STRUCTURAL

SALAS O'BRIEN

MECHANICAL / ELECTRICAL

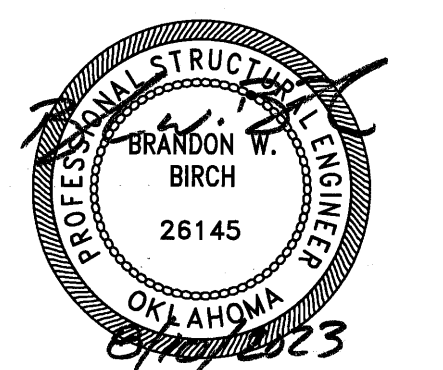

CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE

CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S106

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.



Kirkpatrick Forest Curtis PC
Structural Engineering
OK CA #3888, EXP. 06/30/25
323 Central Park Drive, Suite 202
Oklahoma City, OK 73105
405.528.4596 | kfceng.com



CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE


CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S200

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

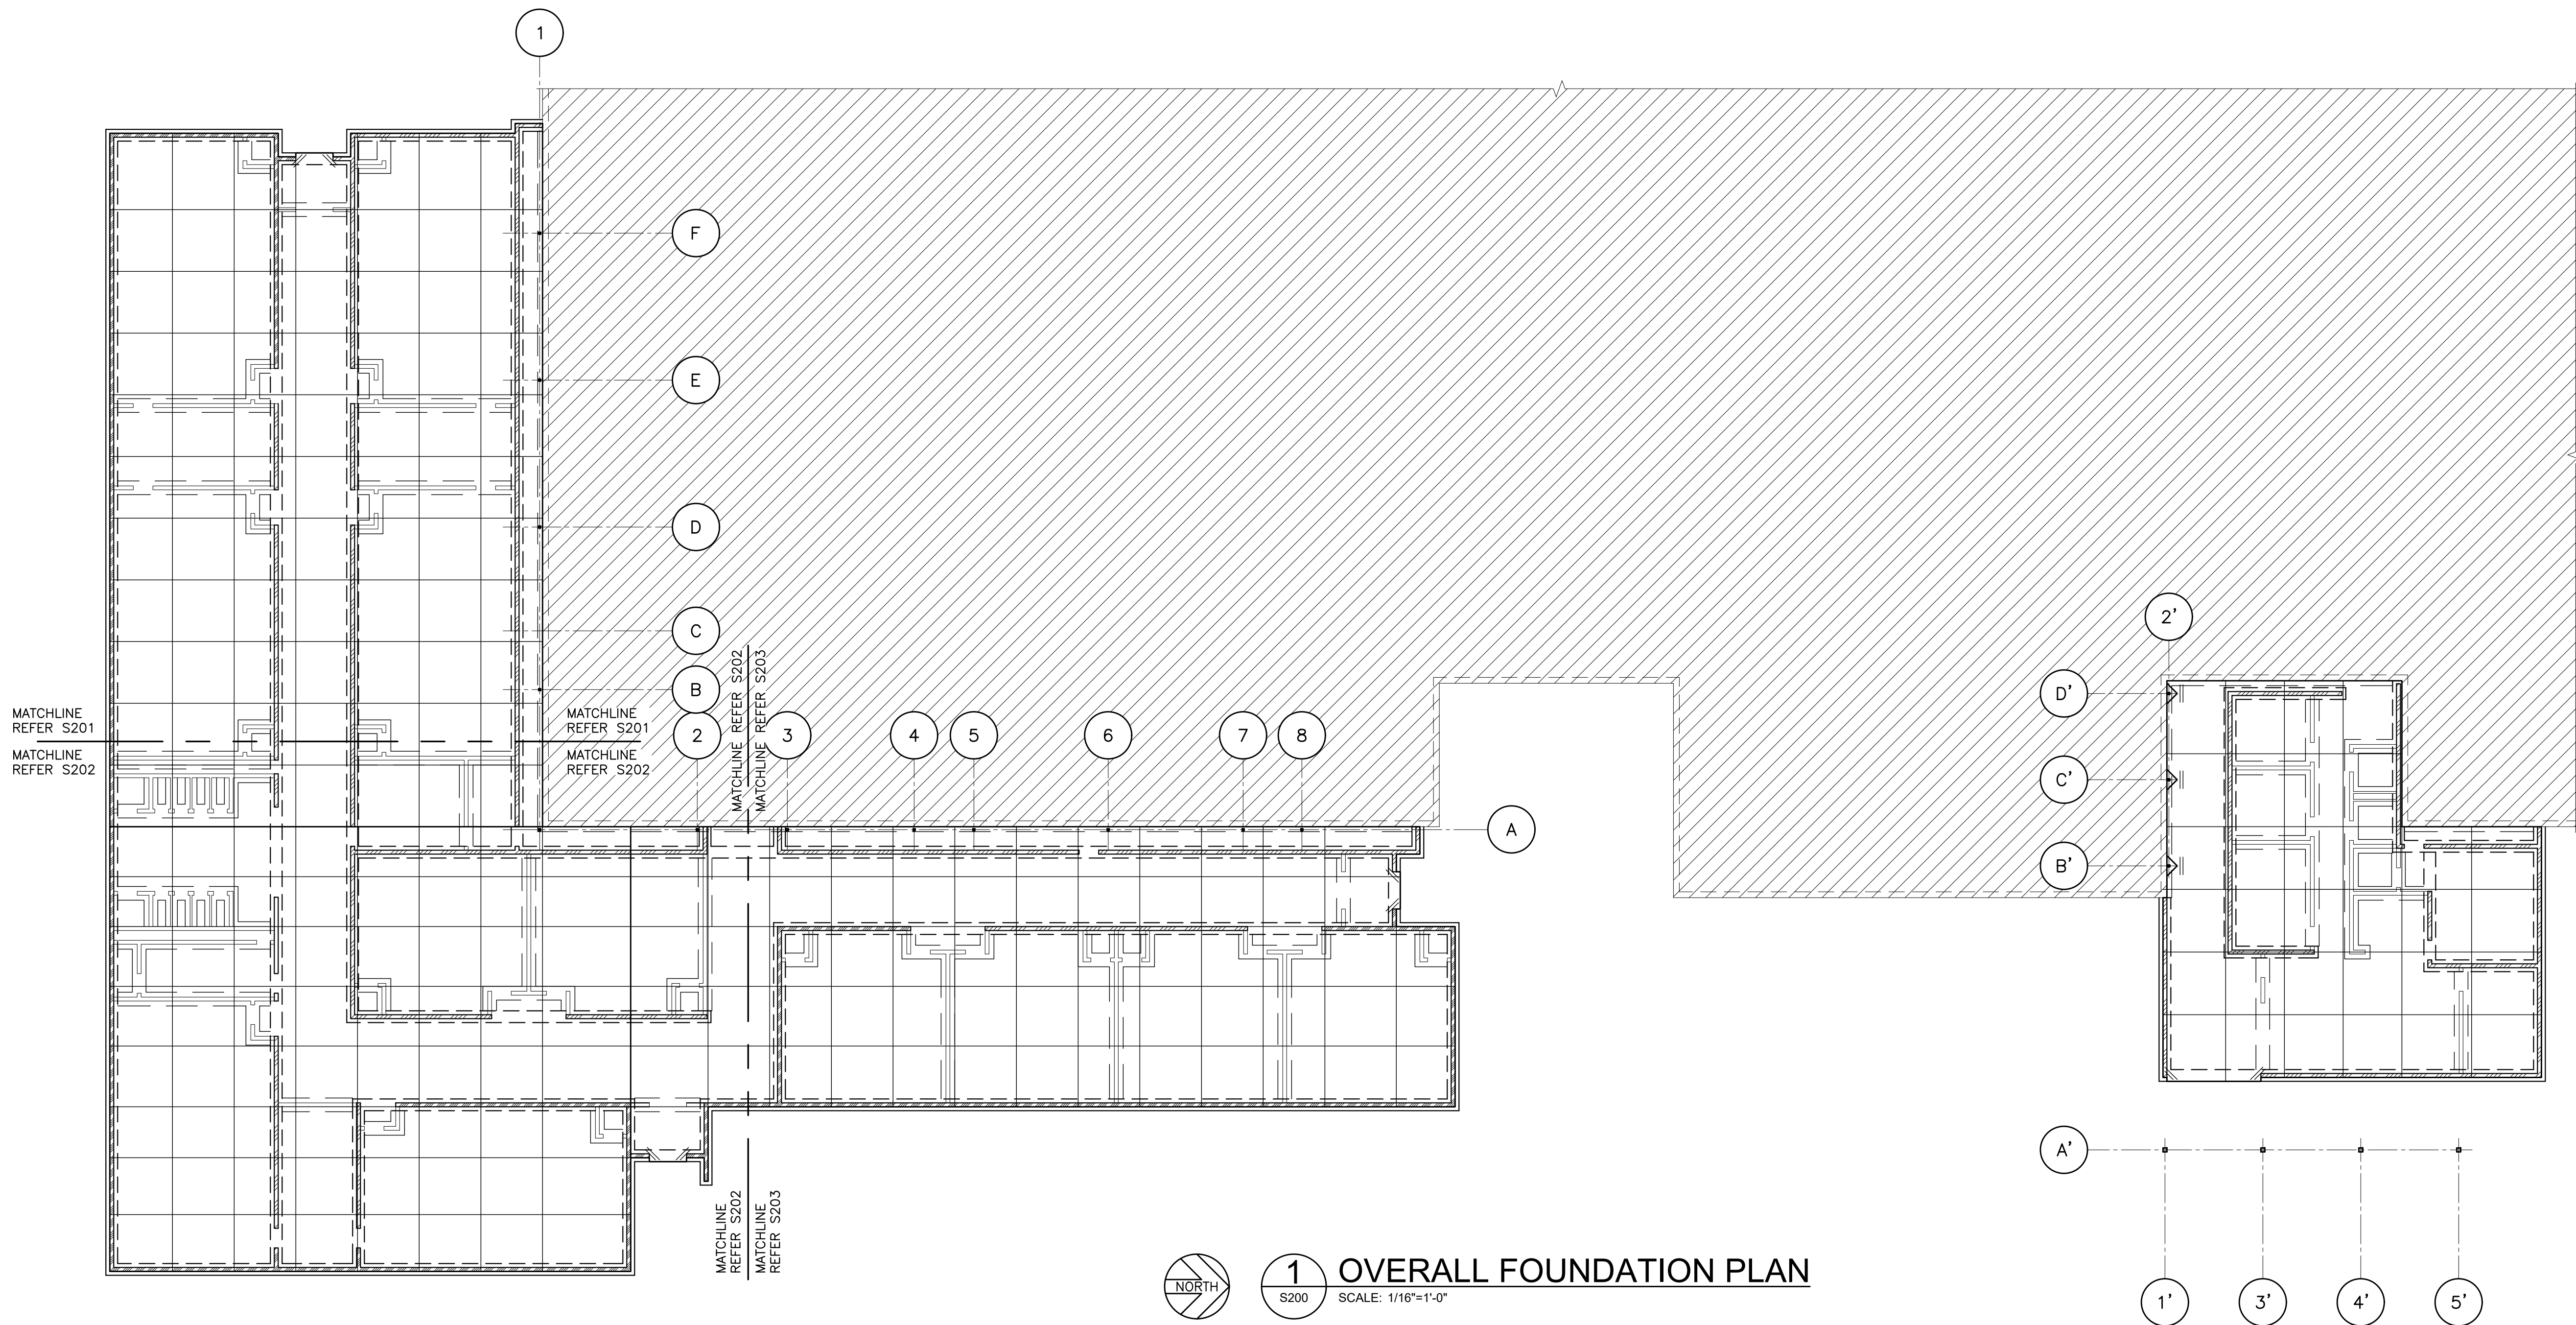

1
S200


OVERALL FOUNDATION PLAN

SCALE: 1/16"=1'-0"

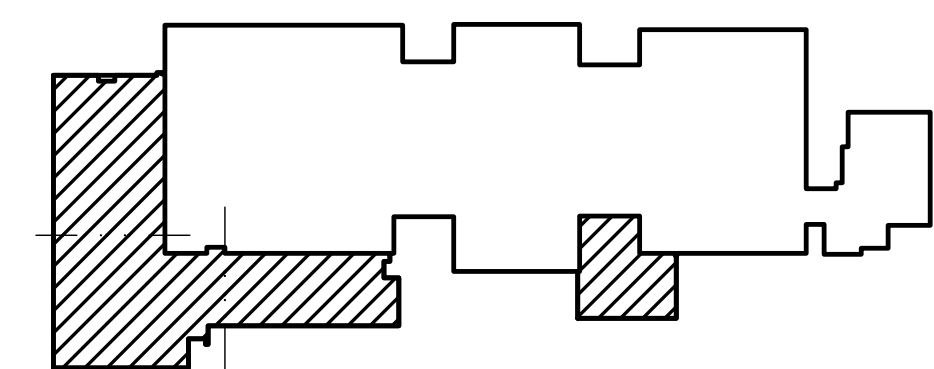

KEY PLAN



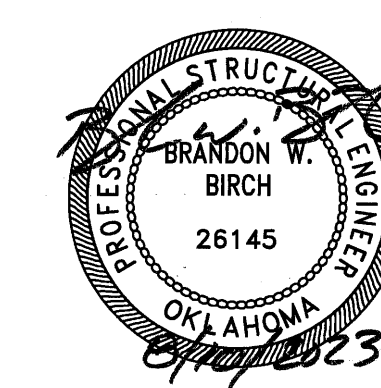

CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S201

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

FOUNDATION PLAN LEGEND:

- = LOAD BEARING MASONRY WALLS
- = NON-LOAD BEARING MASONRY WALLS

FOUNDATION PLAN NOTES:


1. FOUNDATION AND SLAB SUBGRADE SHALL BE PREPARED AS OUTLINED IN THE STRUCTURAL GENERAL NOTES.
2. REFERENCE ELEVATION OF 100'-0" EQUALS DATUM FINISHED FLOOR ELEVATION OF 1249.21 FEET FOR THE NEW BUILDING.
3. EXCEPT WHERE SHOWN OTHERWISE, SLABS-ON-GRADE SHALL BE 4" THICK CONCRETE REINFORCED WITH #3 BARS AT 15" ON CENTER EACH WAY OVER A 15 MIL VAPOR RETARDER OVER A 4" AGGREGATE BASE COURSE. REINFORCING BARS SHALL BE PLACED 12" CLEAR FROM TOP OF SLAB USING CHAIRS OR SLAB BOLSTERS COMPLYING WITH CRSI'S "MANUAL OF STANDARD PRACTICE".
4. SLABS-ON-GRADE SHALL BE WATER CURED FOR A MINIMUM OF 7 DAYS BY PONDING, SPRAYING, SPRINKLING OR BY USE OF SATURATED COVERINGS. THE USE OF CURING COMPOUNDS FOR SLABS-ON-GRADE IS PROHIBITED.
5. SAWED JOINTS (SJ) AND REQUIRED CONSTRUCTION JOINTS (CJ) ARE SHOWN ON THE DRAWINGS. AT THE CONTRACTOR'S OPTION, ADDITIONAL CONSTRUCTION JOINTS MAY BE PLACED AT LOCATIONS INDICATED TO BE SAWED JOINTS.
6. // INDICATES (2)#4 BARSx4'-0" TO BE PLACED IN SLAB-ON-GRADE AT ALL RE-ENTRANT CORNERS. RE-ENTRANT CORNERS ARE DEFINED AS INTERIOR CORNERS WHERE JOINTS DO NOT OCCUR IN BOTH DIRECTIONS. SIMILAR BARS SHALL BE PLACED AT ANY DISCONTINUOUS ENDS OF SAWED JOINTS OR CONSTRUCTION JOINTS.
7. REFER MECHANICAL FOR FLOOR DRAIN (F.D.) INFORMATION.

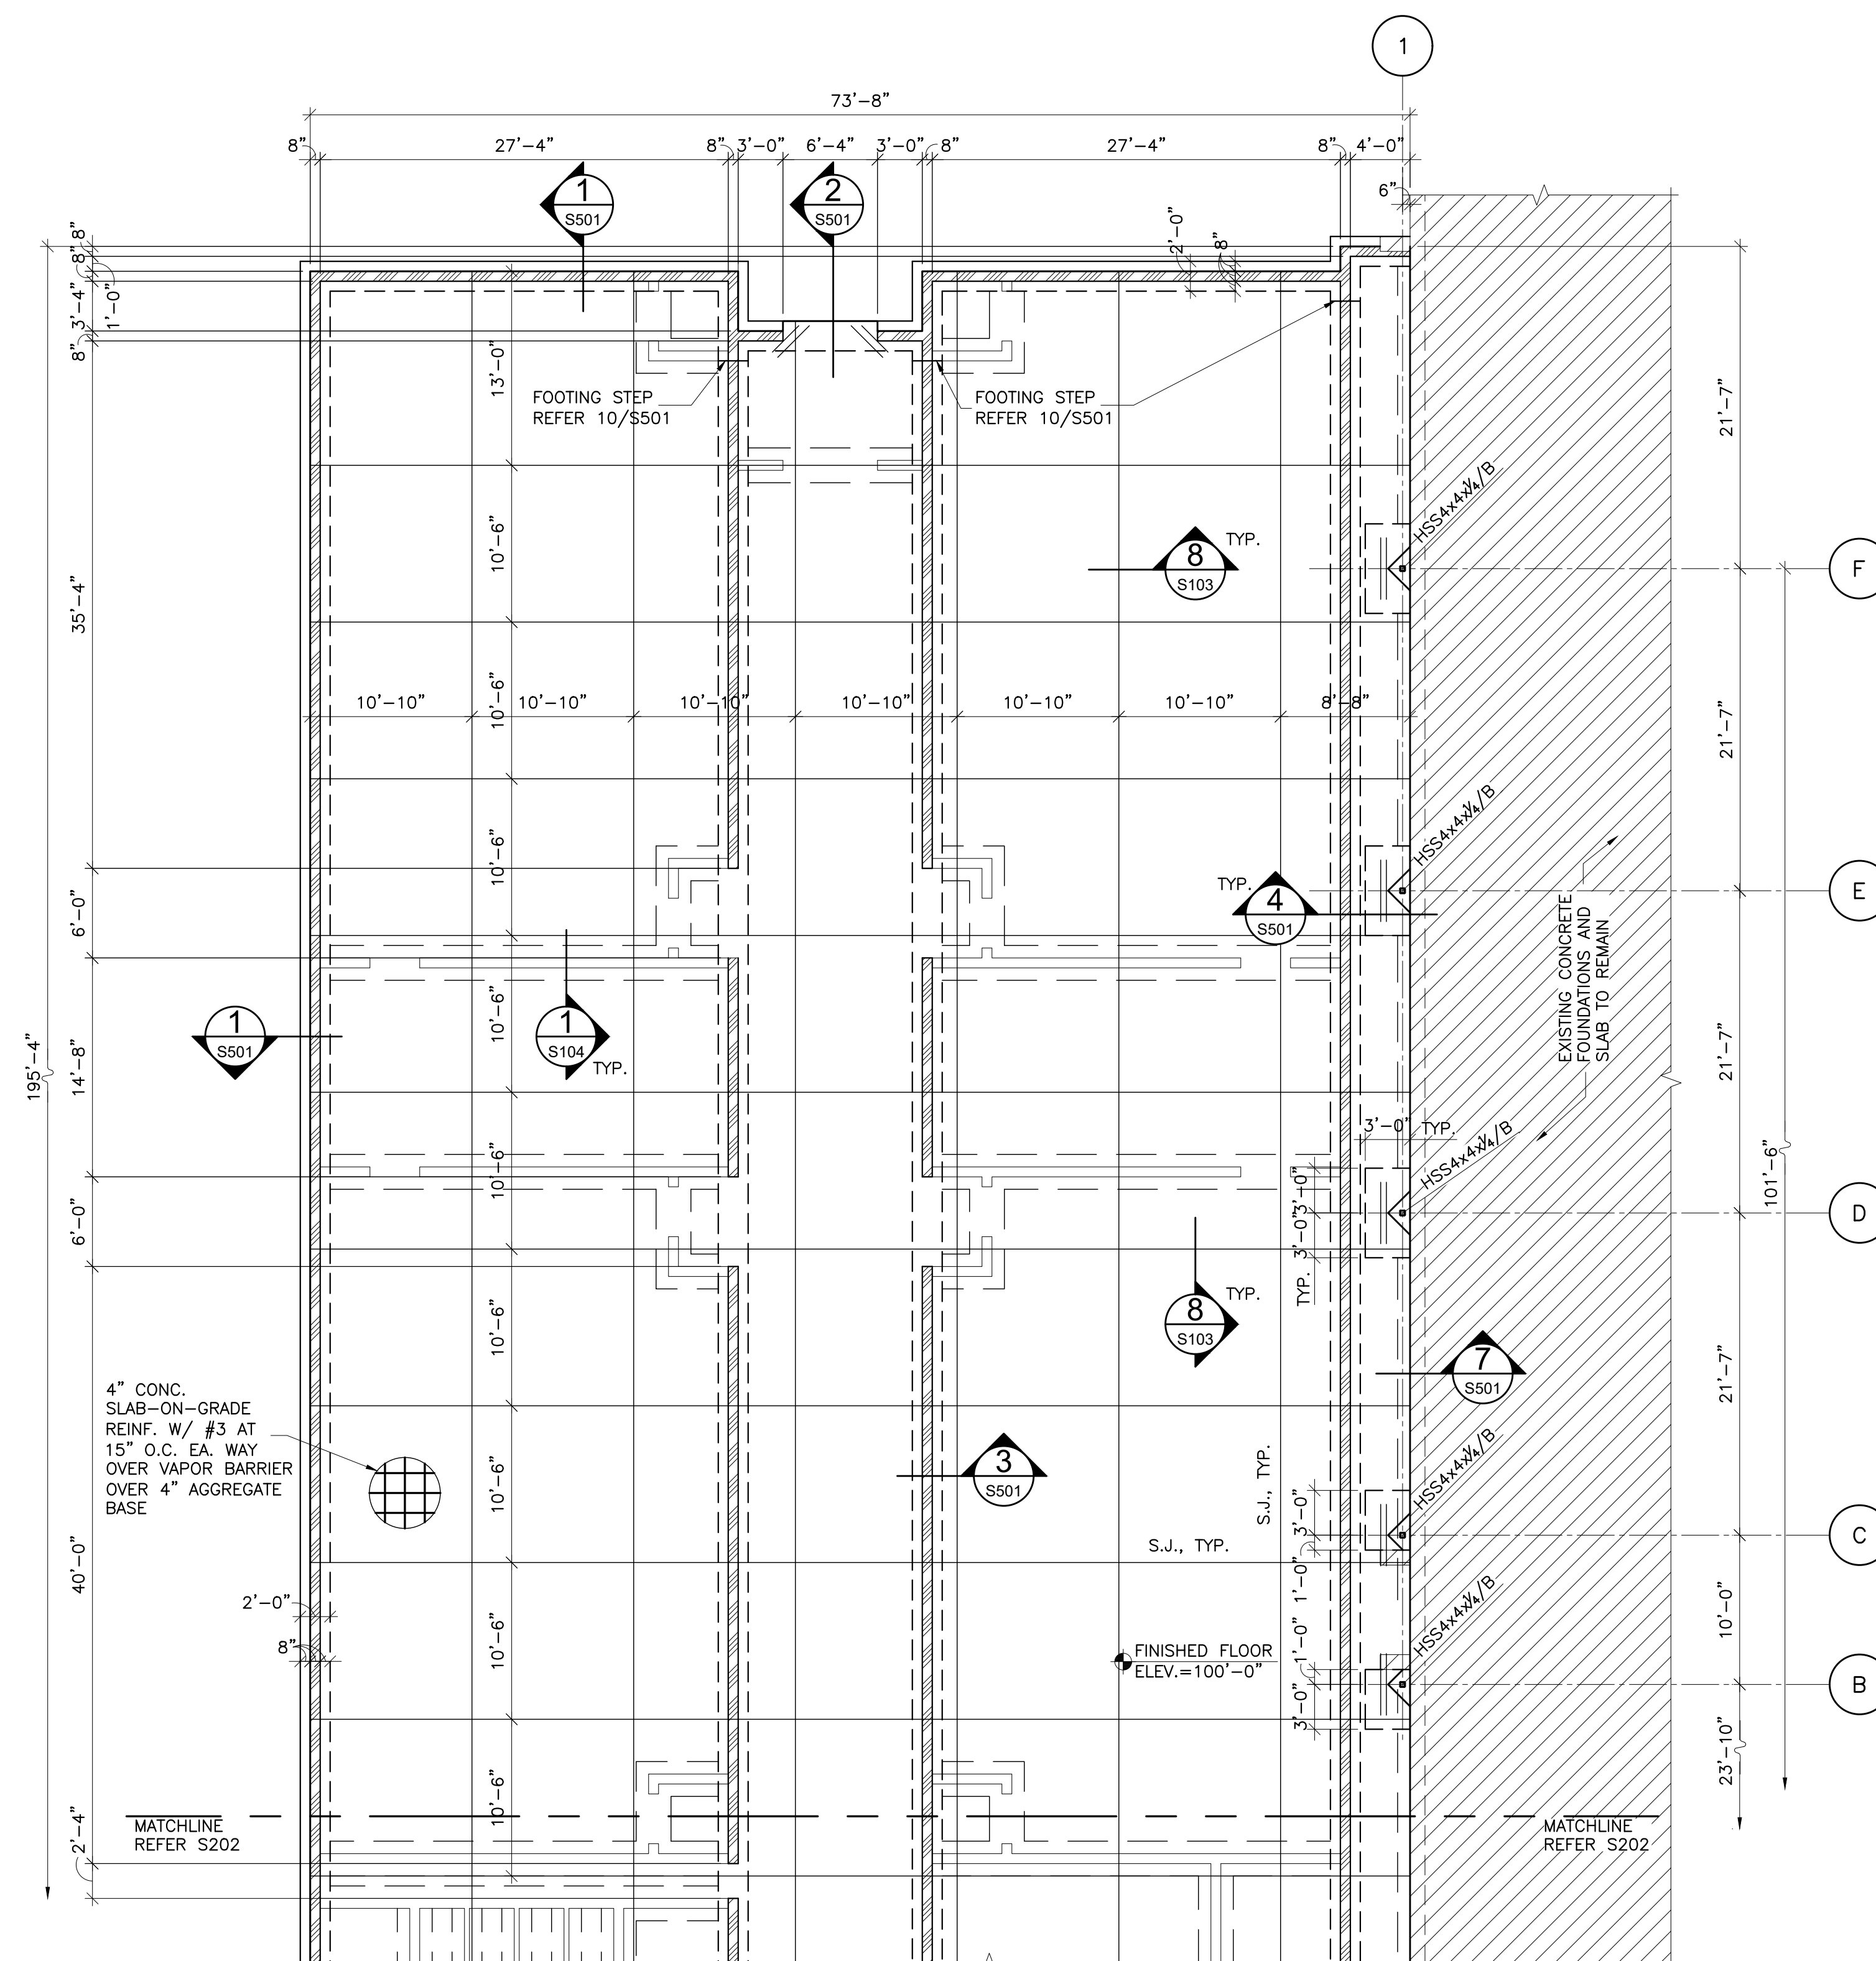

1
S201

FOUNDATION PLAN AREA A

SCALE: 1/8"=1'-0"

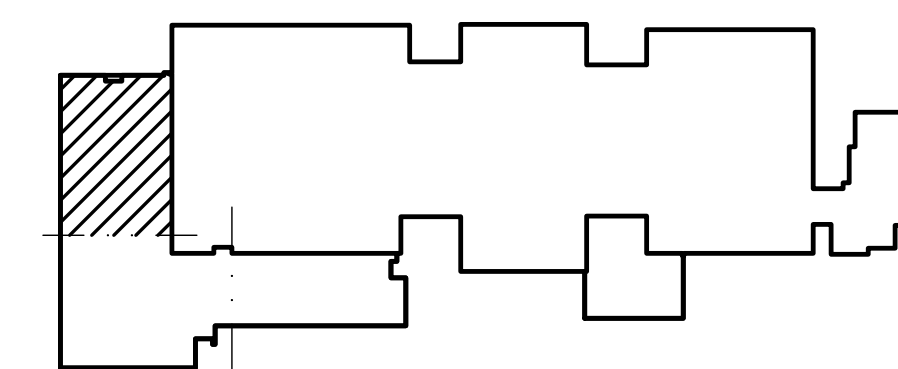

KEY PLAN





CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE

CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S202

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

FOUNDATION PLAN LEGEND:

- = LOAD BEARING MASONRY WALLS
- = NON-LOAD BEARING MASONRY WALLS


FOUNDATION PLAN NOTES:

1. FOUNDATION AND SLAB SUBGRADE SHALL BE PREPARED AS OUTLINED IN THE STRUCTURAL GENERAL NOTES.
2. REFERENCE ELEVATION OF 100'-0" EQUALS DATUM FINISHED FLOOR ELEVATION OF 1249.21 FEET FOR THE NEW BUILDING.
3. EXCEPT WHERE SHOWN OTHERWISE, SLABS-ON-GRADE SHALL BE 4" THICK CONCRETE REINFORCED WITH #3 BARS AT 15" ON CENTER EACH WAY OVER A 15 MIL VAPOR RETARDER OVER A 4" AGGREGATE BASE COURSE. REINFORCING BARS SHALL BE PLACED 15" CLEAR FROM TOP OF SLAB USING CHAIRS OR SLAB BOLSTERS COMPLYING WITH CRSI'S "MANUAL OF STANDARD PRACTICE".
4. SLABS-ON-GRADE SHALL BE WATER CURED FOR A MINIMUM OF 7 DAYS BY PONDING, SPRAYING, SPRINKLING OR BY USE OF SATURATED COVERINGS. THE USE OF CURING COMPOUNDS FOR SLABS-ON-GRADE IS PROHIBITED.
5. SAWED JOINTS (SJ) AND REQUIRED CONSTRUCTION JOINTS (CJ) ARE SHOWN ON THE DRAWINGS. AT THE CONTRACTOR'S OPTION, ADDITIONAL CONSTRUCTION JOINTS MAY BE PLACED AT LOCATIONS INDICATED TO BE SAWED JOINTS.
6. // INDICATES (2)#4 BARS@4'-0" TO BE PLACED IN SLAB-ON-GRADE AT ALL RE-ENTRANT CORNERS. RE-ENTRANT CORNERS ARE DEFINED AS INTERIOR CORNERS WHERE JOINTS DO NOT OCCUR IN BOTH DIRECTIONS. SIMILAR BARS SHALL BE PLACED AT ANY DISCONTINUOUS ENDS OF SAWED JOINTS OR CONSTRUCTION JOINTS.
7. REFER MECHANICAL FOR FLOOR DRAIN (F.D.) INFORMATION.

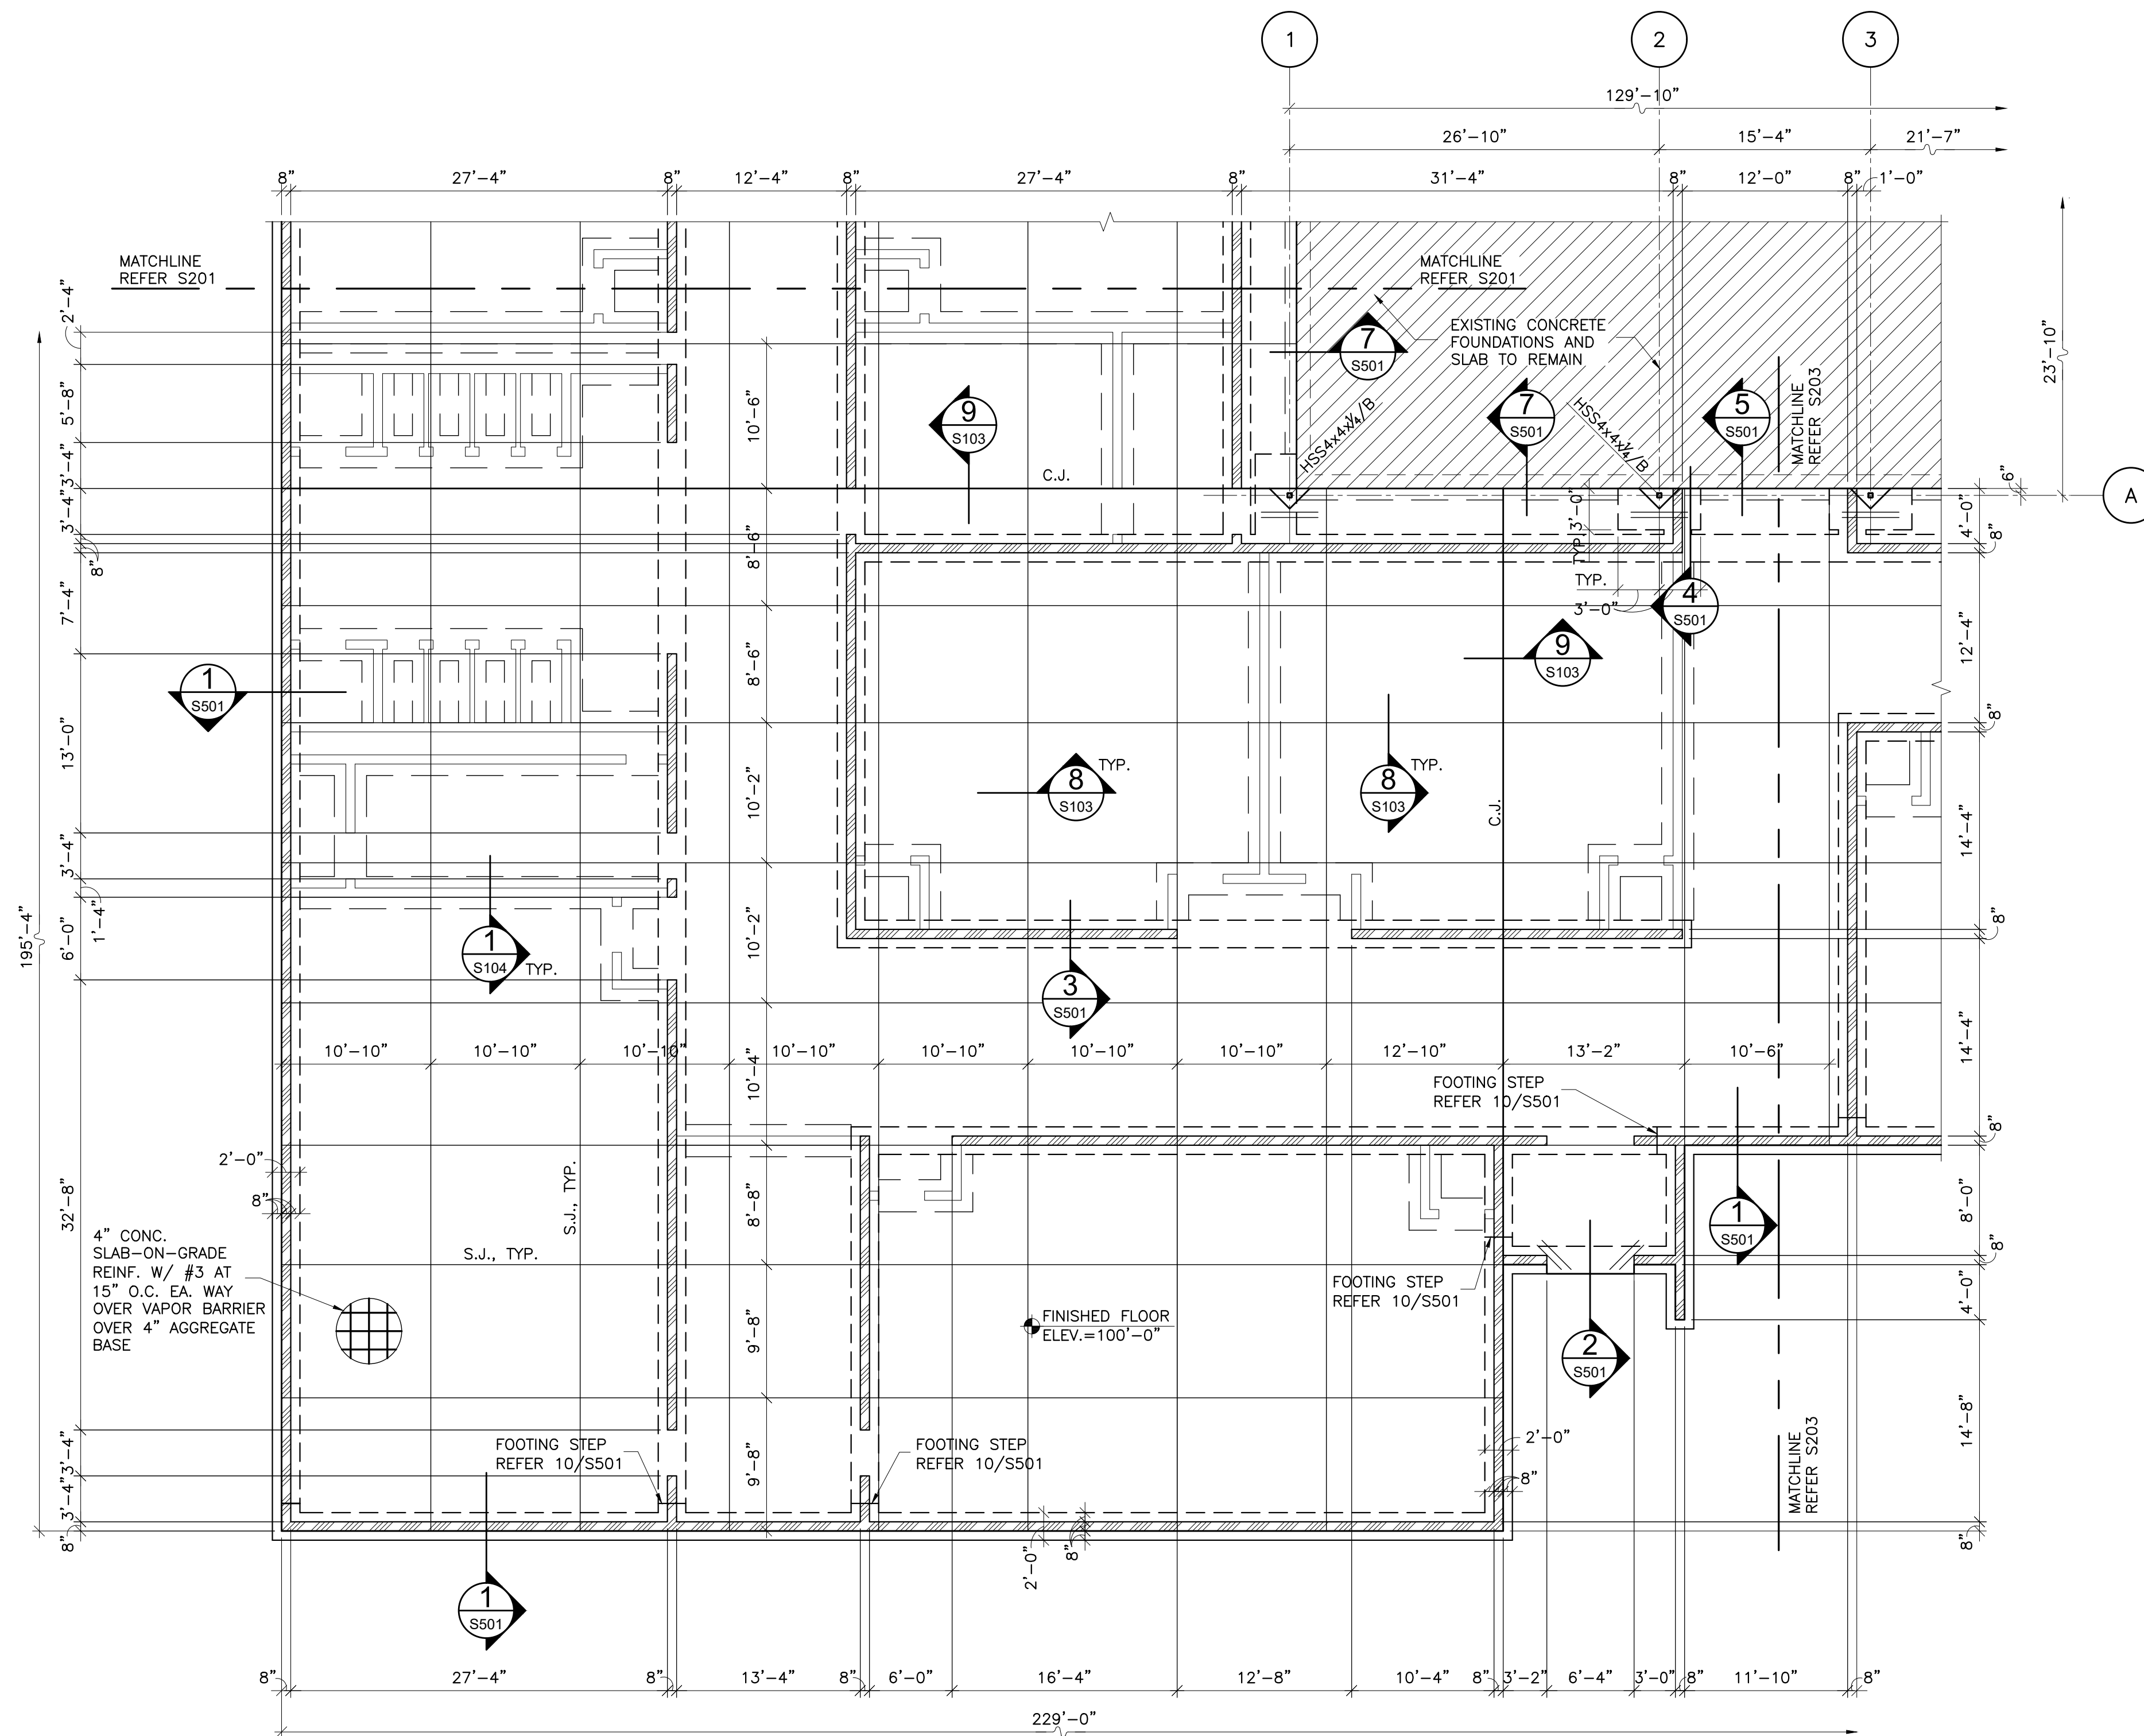

1 FOUNDATION PLAN AREA B


S202 SCALE: 1/8"=1'-0"

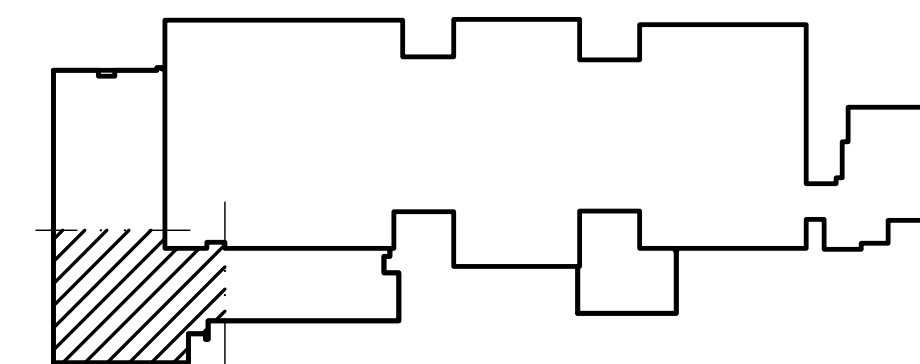

KEY PLAN



Kirkpatrick Forest Curtis PC
Structural Engineering
OK CA #3888, EXP. 06/30/25
525 Central Park Drive, Suite 202
Oklahoma City, OK 73105
405.528.4596 | kfcenr.com

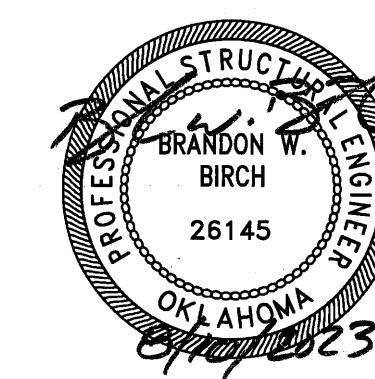

CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL


sheet no:

S204

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.


FOUNDATION PLAN LEGEND:

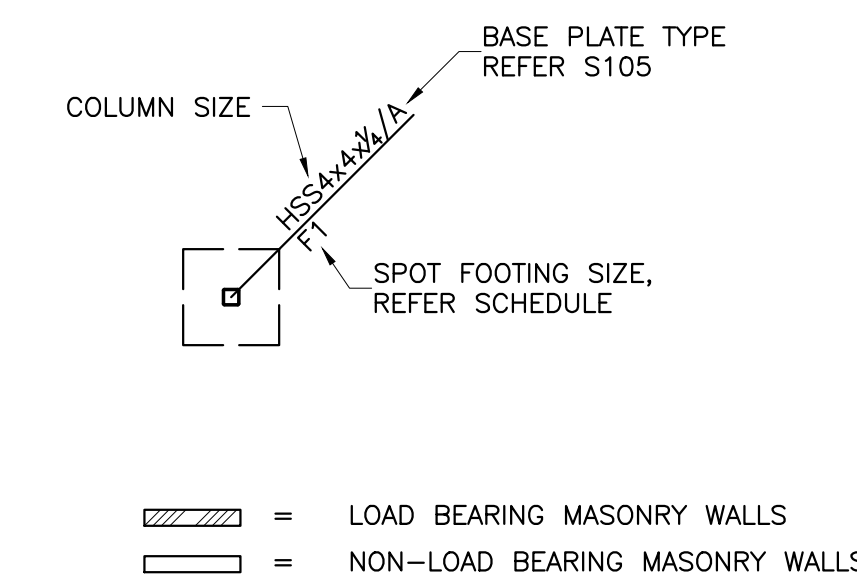


FOUNDATION PLAN NOTES:

- FOUNDATION AND SLAB SUBGRADE SHALL BE PREPARED AS OUTLINED IN THE STRUCTURAL GENERAL NOTES.
- REFERENCE ELEVATION OF 100'-0" EQUALS DATUM FINISHED FLOOR ELEVATION OF 1249.38 FEET FOR THE NEW BUILDING.
- EXCEPT WHERE SHOWN OTHERWISE, SLABS-ON-GRADE SHALL BE 4" THICK CONCRETE REINFORCED WITH #3 BARS AT 15" ON CENTER EACH WAY OVER A 15 MIL VAPOR RETARDER OVER A 4" AGGREGATE BASE COURSE. REINFORCING BARS SHALL BE PLACED 1 1/2" CLEAR FROM TOP OF SLAB USING CHAIRS OR SLAB BOLSTERS COMPLYING WITH CRSI'S "MANUAL OF STANDARD PRACTICE".
- SLABS-ON-GRADE SHALL BE WATER CURED FOR A MINIMUM OF 7 DAYS BY PONDING, SPRAYING, SPRINKLING OR BY USE OF SATURATED COVERINGS. THE USE OF CURING COMPOUNDS FOR SLABS-ON-GRADE IS PROHIBITED.
- SAWED JOINTS (SJ) AND REQUIRED CONSTRUCTION JOINTS (CJ) ARE SHOWN ON THE DRAWINGS. AT THE CONTRACTOR'S OPTION, ADDITIONAL CONSTRUCTION JOINTS MAY BE PLACED AT LOCATIONS INDICATED TO BE SAWED JOINTS.
- // INDICATES (2)#4 BARSx4'-0" TO BE PLACED IN SLAB-ON-GRADE AT ALL RE-ENTRANT CORNERS. RE-ENTRANT CORNERS ARE DEFINED AS INTERIOR CORNERS WHERE JOINTS DO NOT OCCUR IN BOTH DIRECTIONS. SIMILAR BARS SHALL BE PLACED AT ANY DISCONTINUOUS ENDS OF SAWED JOINTS OR CONSTRUCTION JOINTS.
- REFER MECHANICAL FOR FLOOR DRAIN (F.D.) INFORMATION.

| MARK | SIZE | | | REINFORCEMENT |
|------|-------|--------|-------|-----------------------------|
| | WIDTH | LENGTH | DEPTH | |
| F1 | 5'-0" | 5'-0" | 2'-0" | (6) #5 TOP AND BOT. EA. WAY |

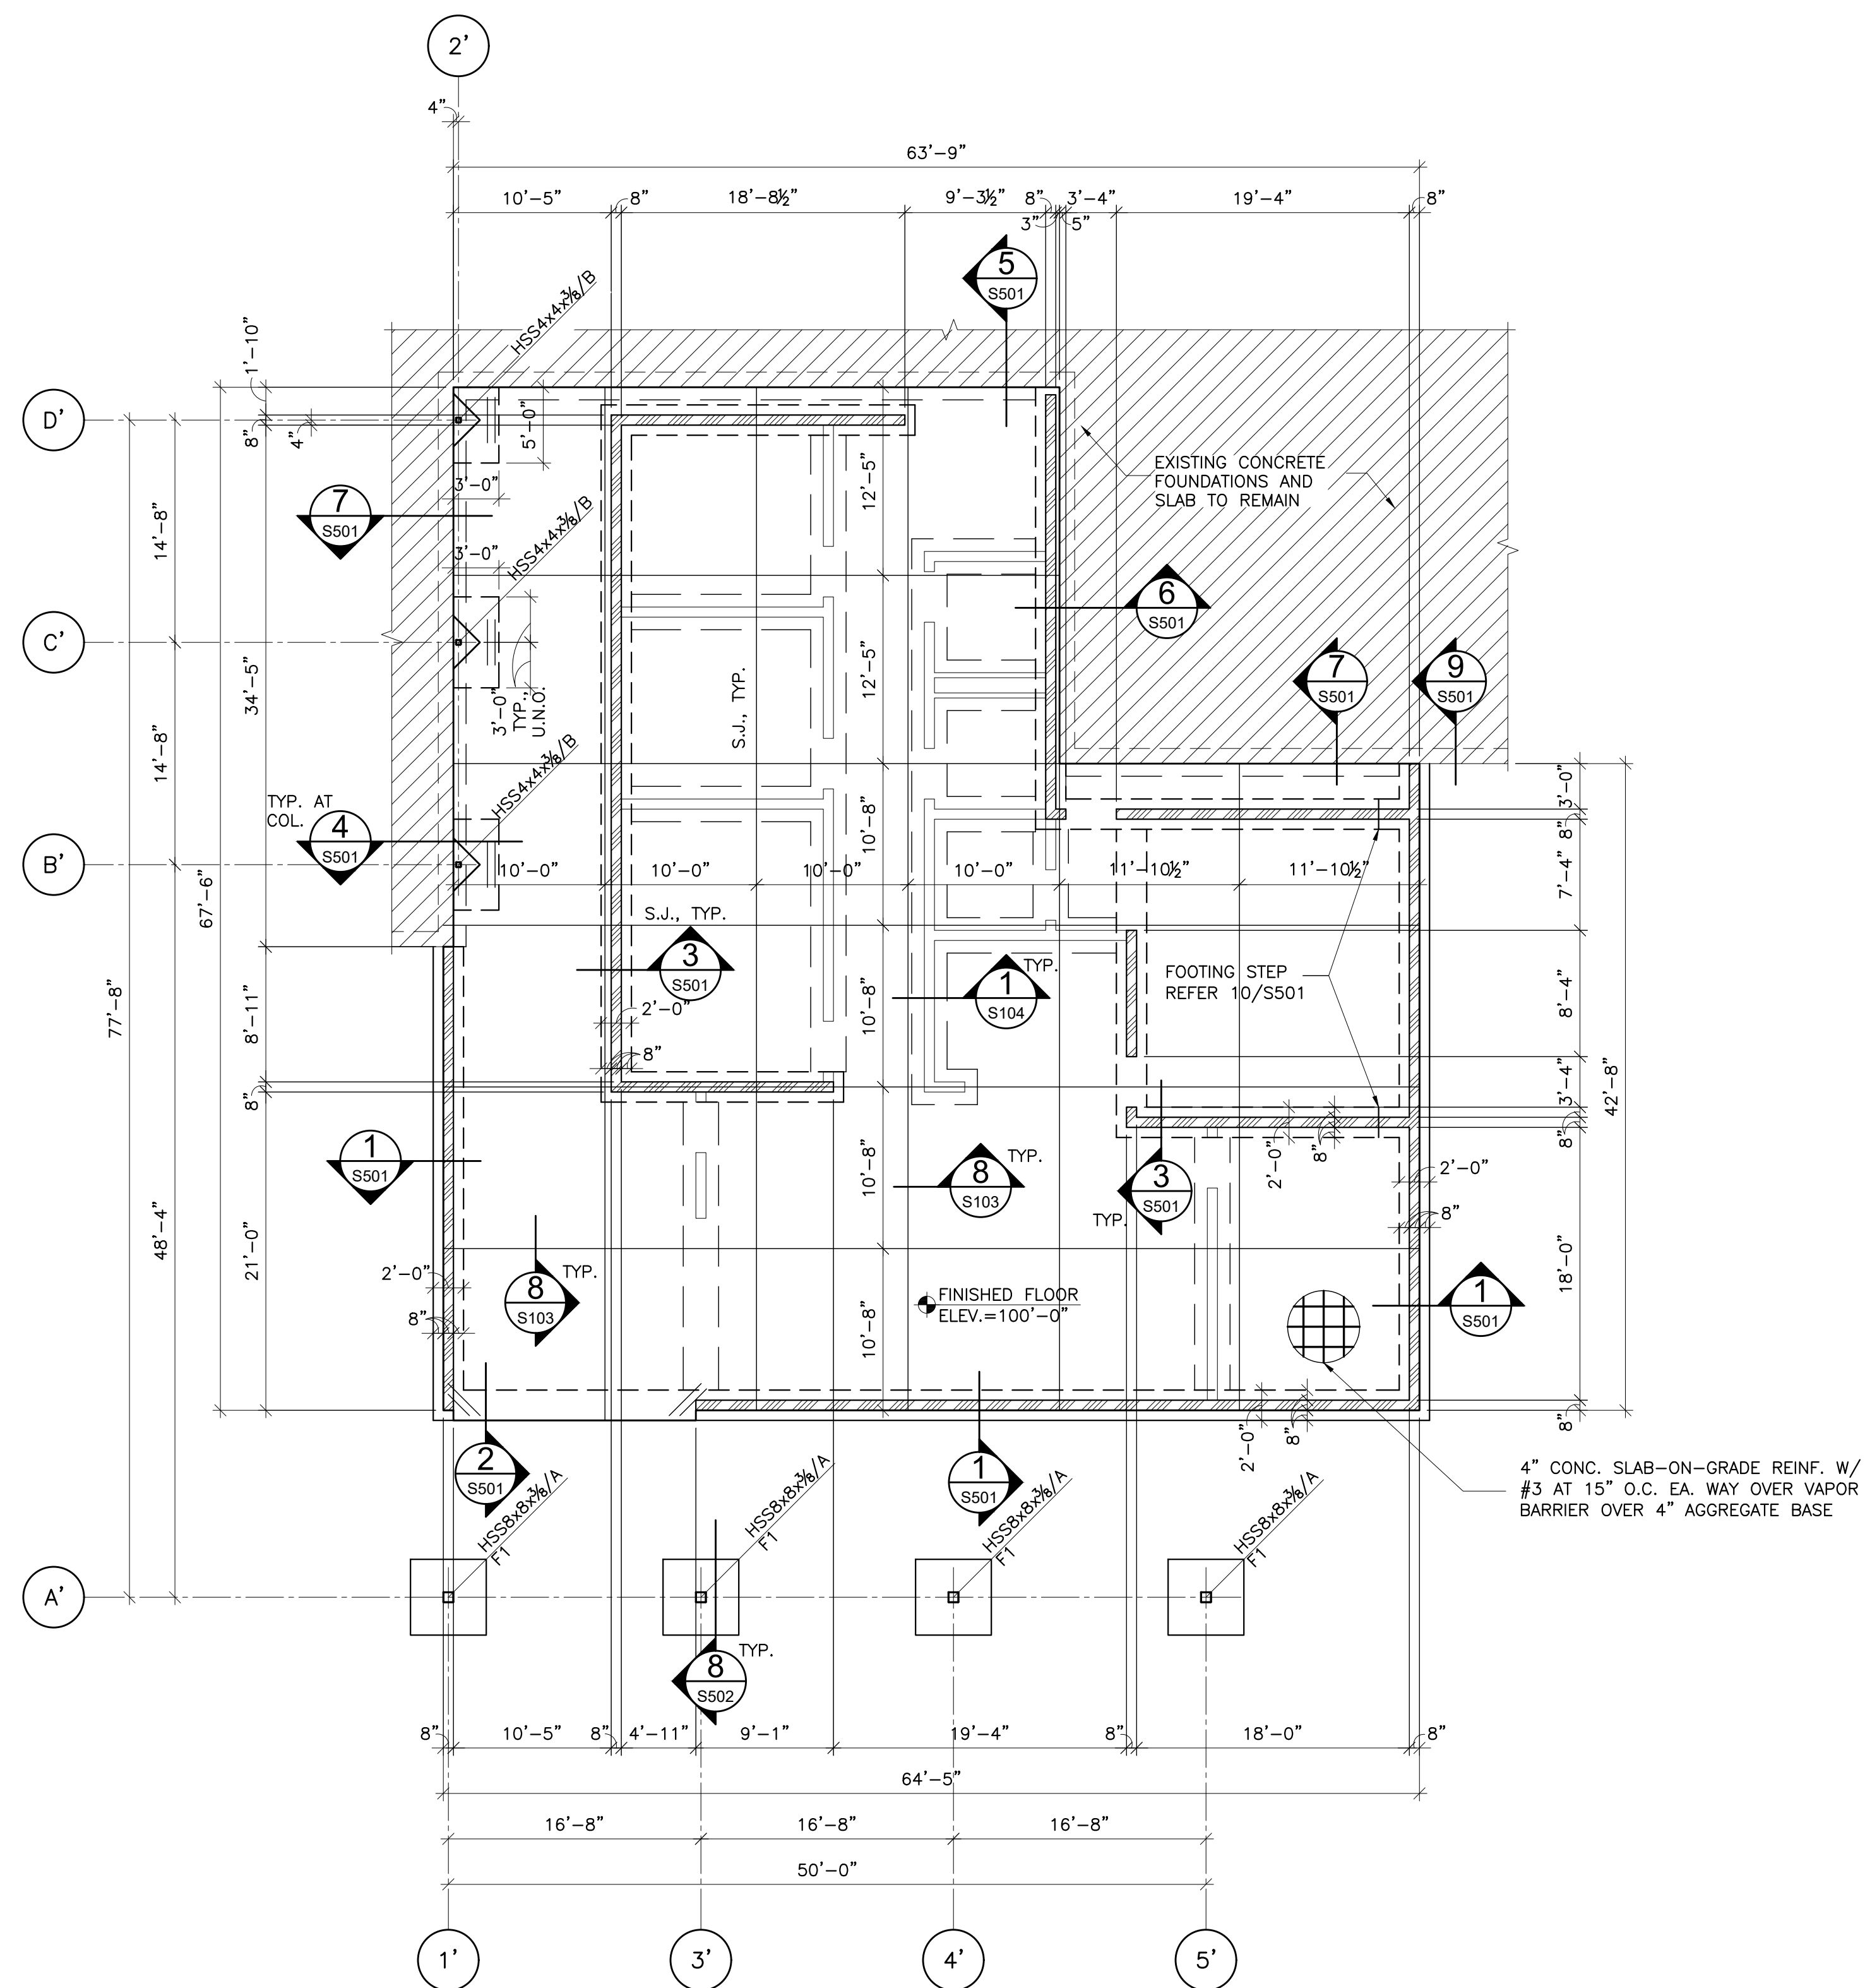

1 FOUNDATION PLAN AREA D
S204 SCALE: 1/8"=1'-0"

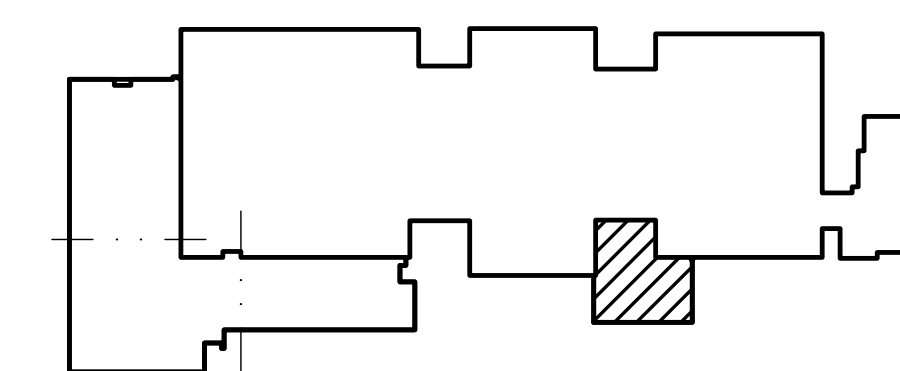

KEY PLAN



CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S300


OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

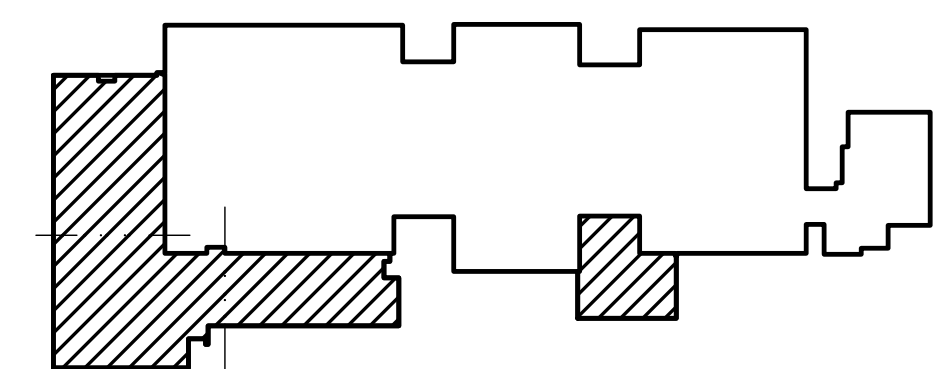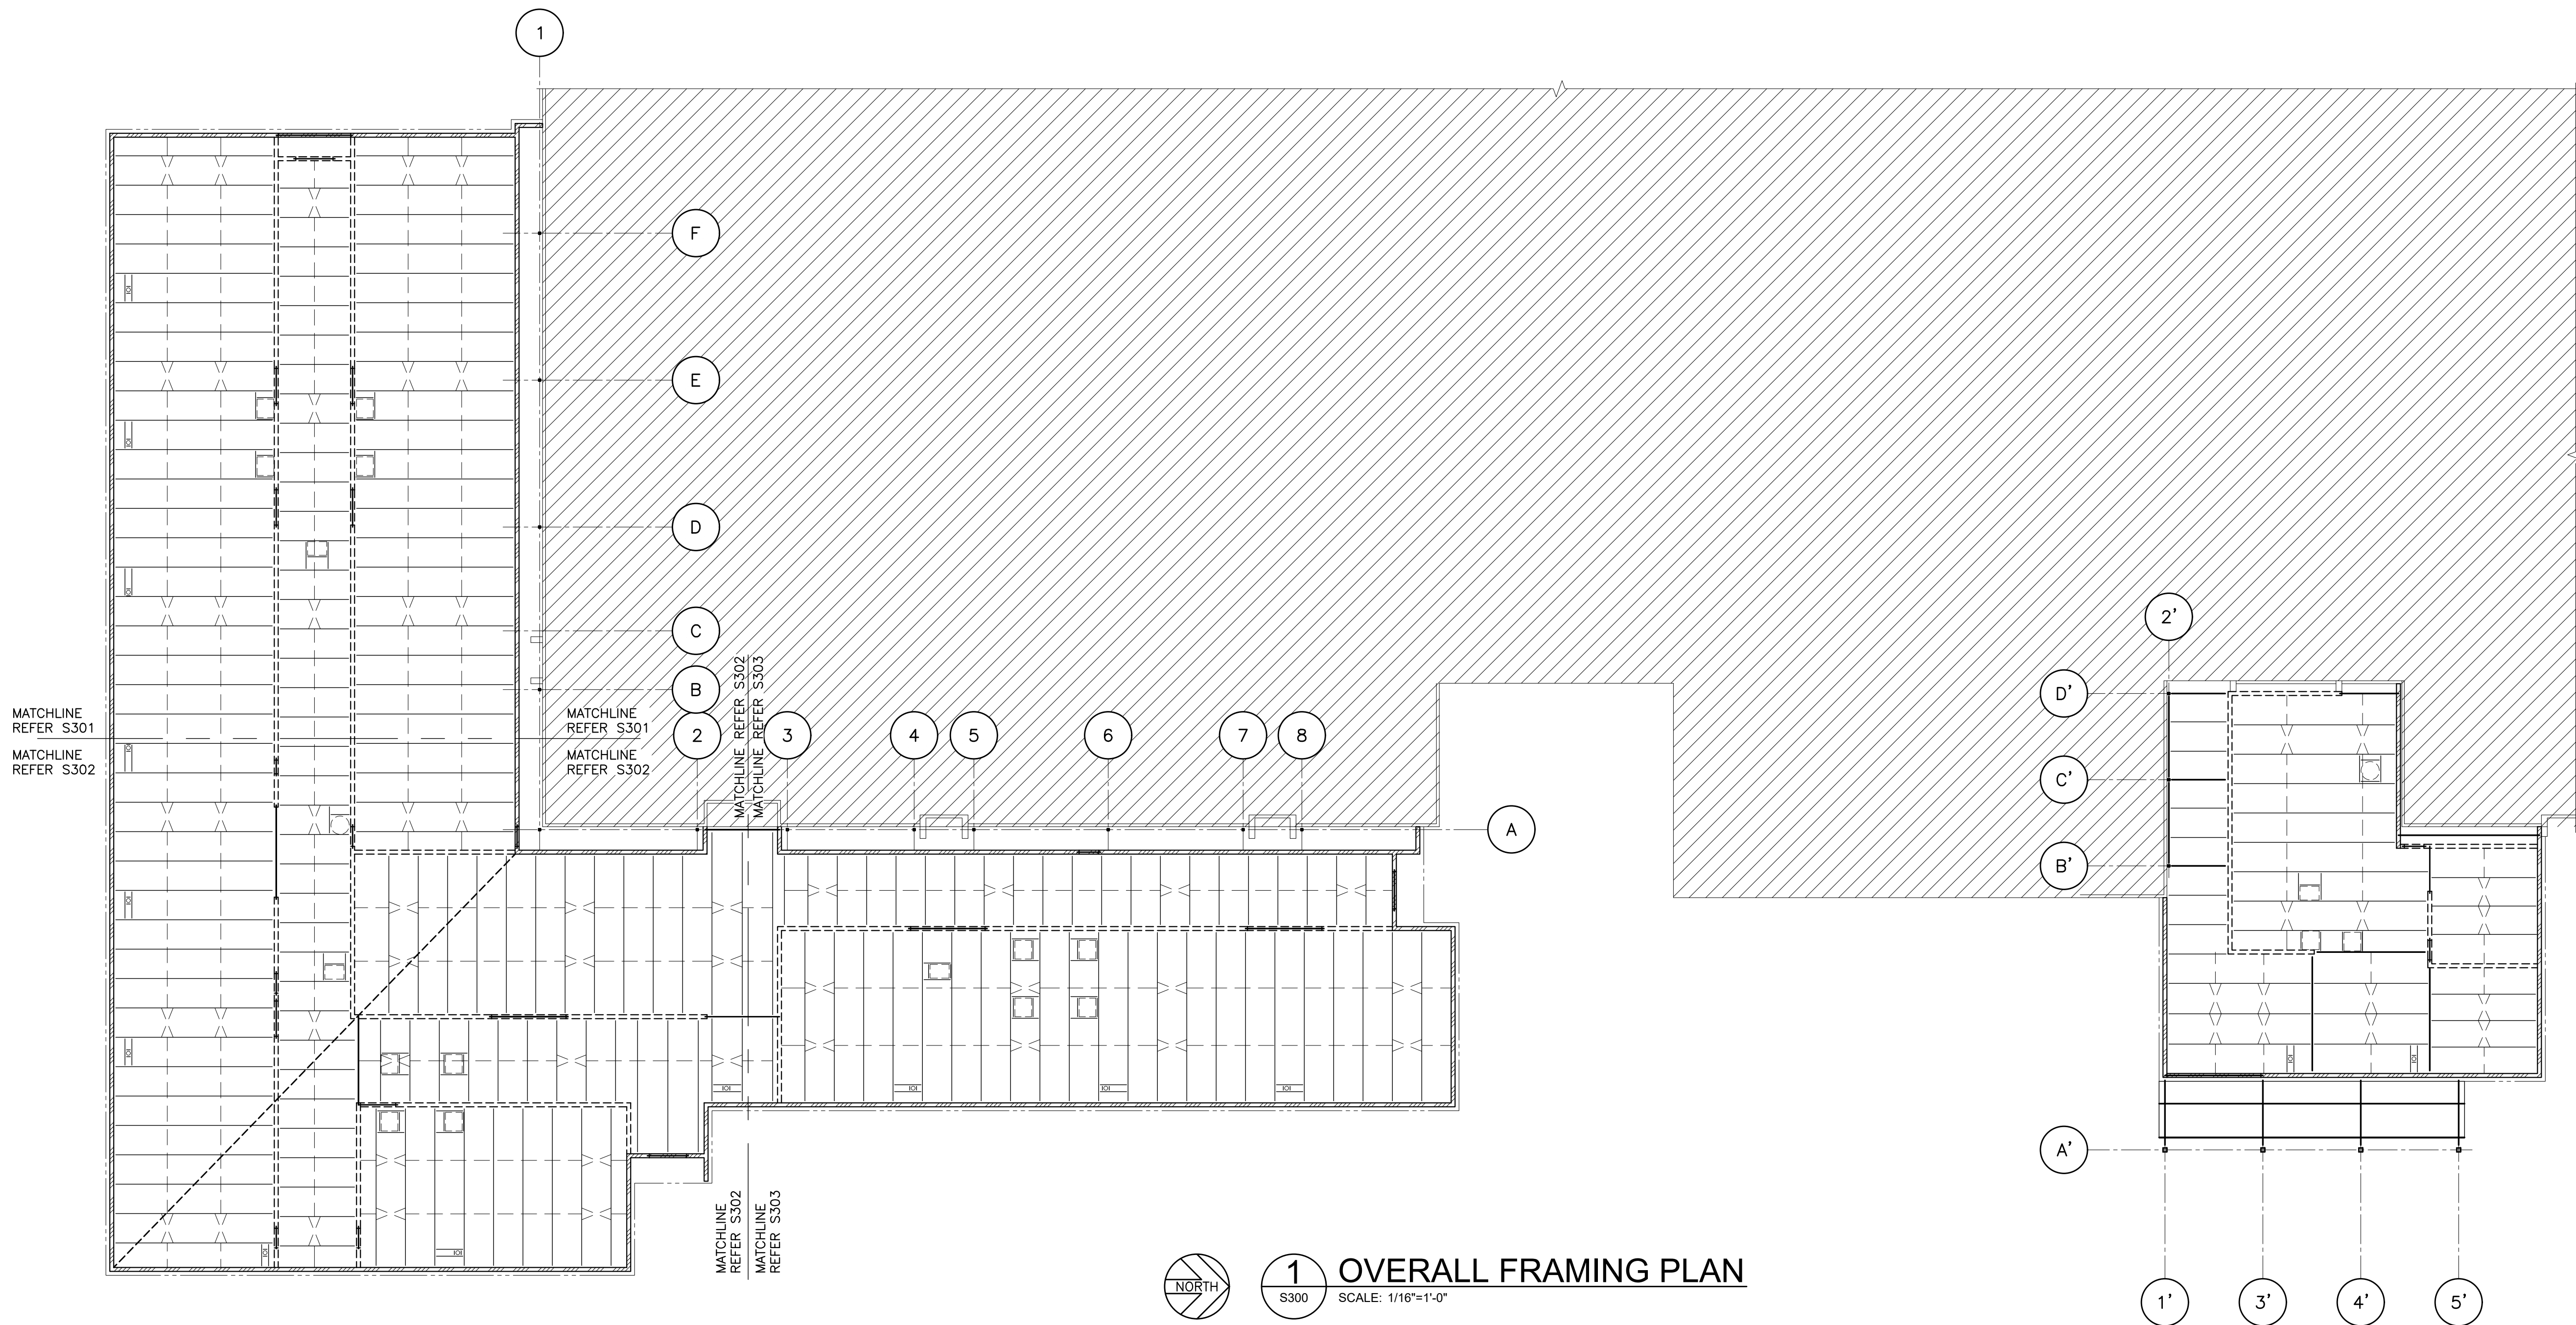

KEY PLAN




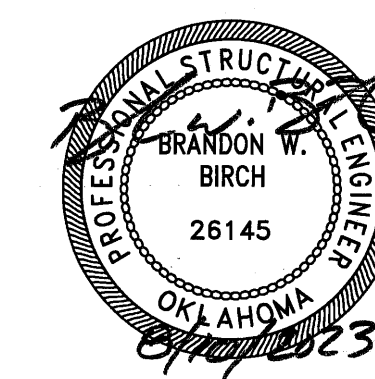

- ROOF FRAMING PLAN NOTES:**
- ALL ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR DATUM OF 100'-0". REFER TO FOUNDATION PLAN NOTES FOR ACTUAL ELEVATION.
 - REFER TO FOUNDATION PLAN FOR COLUMN SIZES.
 - ALL ROOF OPENINGS FOR MECHANICAL ROOF TOP UNITS ARE APPROXIMATELY LOCATED. EXACT SIZE AND LOCATIONS SHALL BE COORDINATED WITH THE SUCCESSFUL MECHANICAL CONTRACTOR. ALL ROOF/WALL OPENINGS SHALL BE SUPPORTED WITH TYPICAL ANGLE FRAME UNLESS NOTED OTHERWISE.
 - (27K) INDICATES MAXIMUM FACTORED BEAM END REACTION IN ACCORDANCE WITH THE AISC LRFD SPECIFICATION. IF NOT SHOWN, PROVIDE 10K MINIMUM CAPACITY. REFER TO TYPICAL CONNECTION DETAILS.
 - T.O. PARAPET REFERS TO THE TOP OF METAL STUD/MASONRY WALL ELEVATION WITH REFERENCE TO FINISH FLOOR ELEVATION SPECIFIED ON THE FOUNDATION PLAN U.N.O.
 - ① DENOTES MASONRY LINTEL TYPE. REFER S104 FOR ADDITIONAL INFORMATION.

FRAMING PLAN LEGEND:

- - - = L1½x1¼x¾ MIN. HORIZONTAL JOIST BRIDGING BY JOIST MANUFACTURER
- X - X = L1½x1¼x¾ MIN. JOIST X-BRIDGING BY JOIST MANUFACTURER

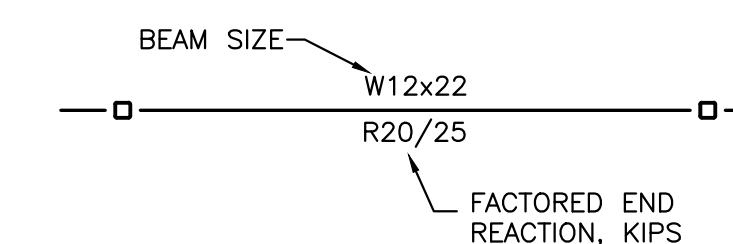

NOTE:
IF ONLY ONE NUMBER IS PROVIDED FOR END REACTIONS, REACTION APPLIES TO BOTH ENDS. WHERE NO REACTION IS GIVEN, USE 10K.

- [Hatched Area] = LOAD BEARING MASONRY WALLS
- [Dashed Area] = INTERIOR LOAD BEARING MASONRY WALLS

CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA





CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S301

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

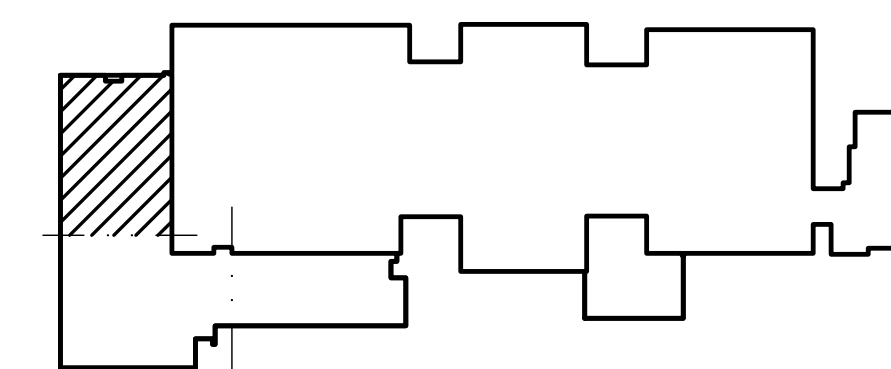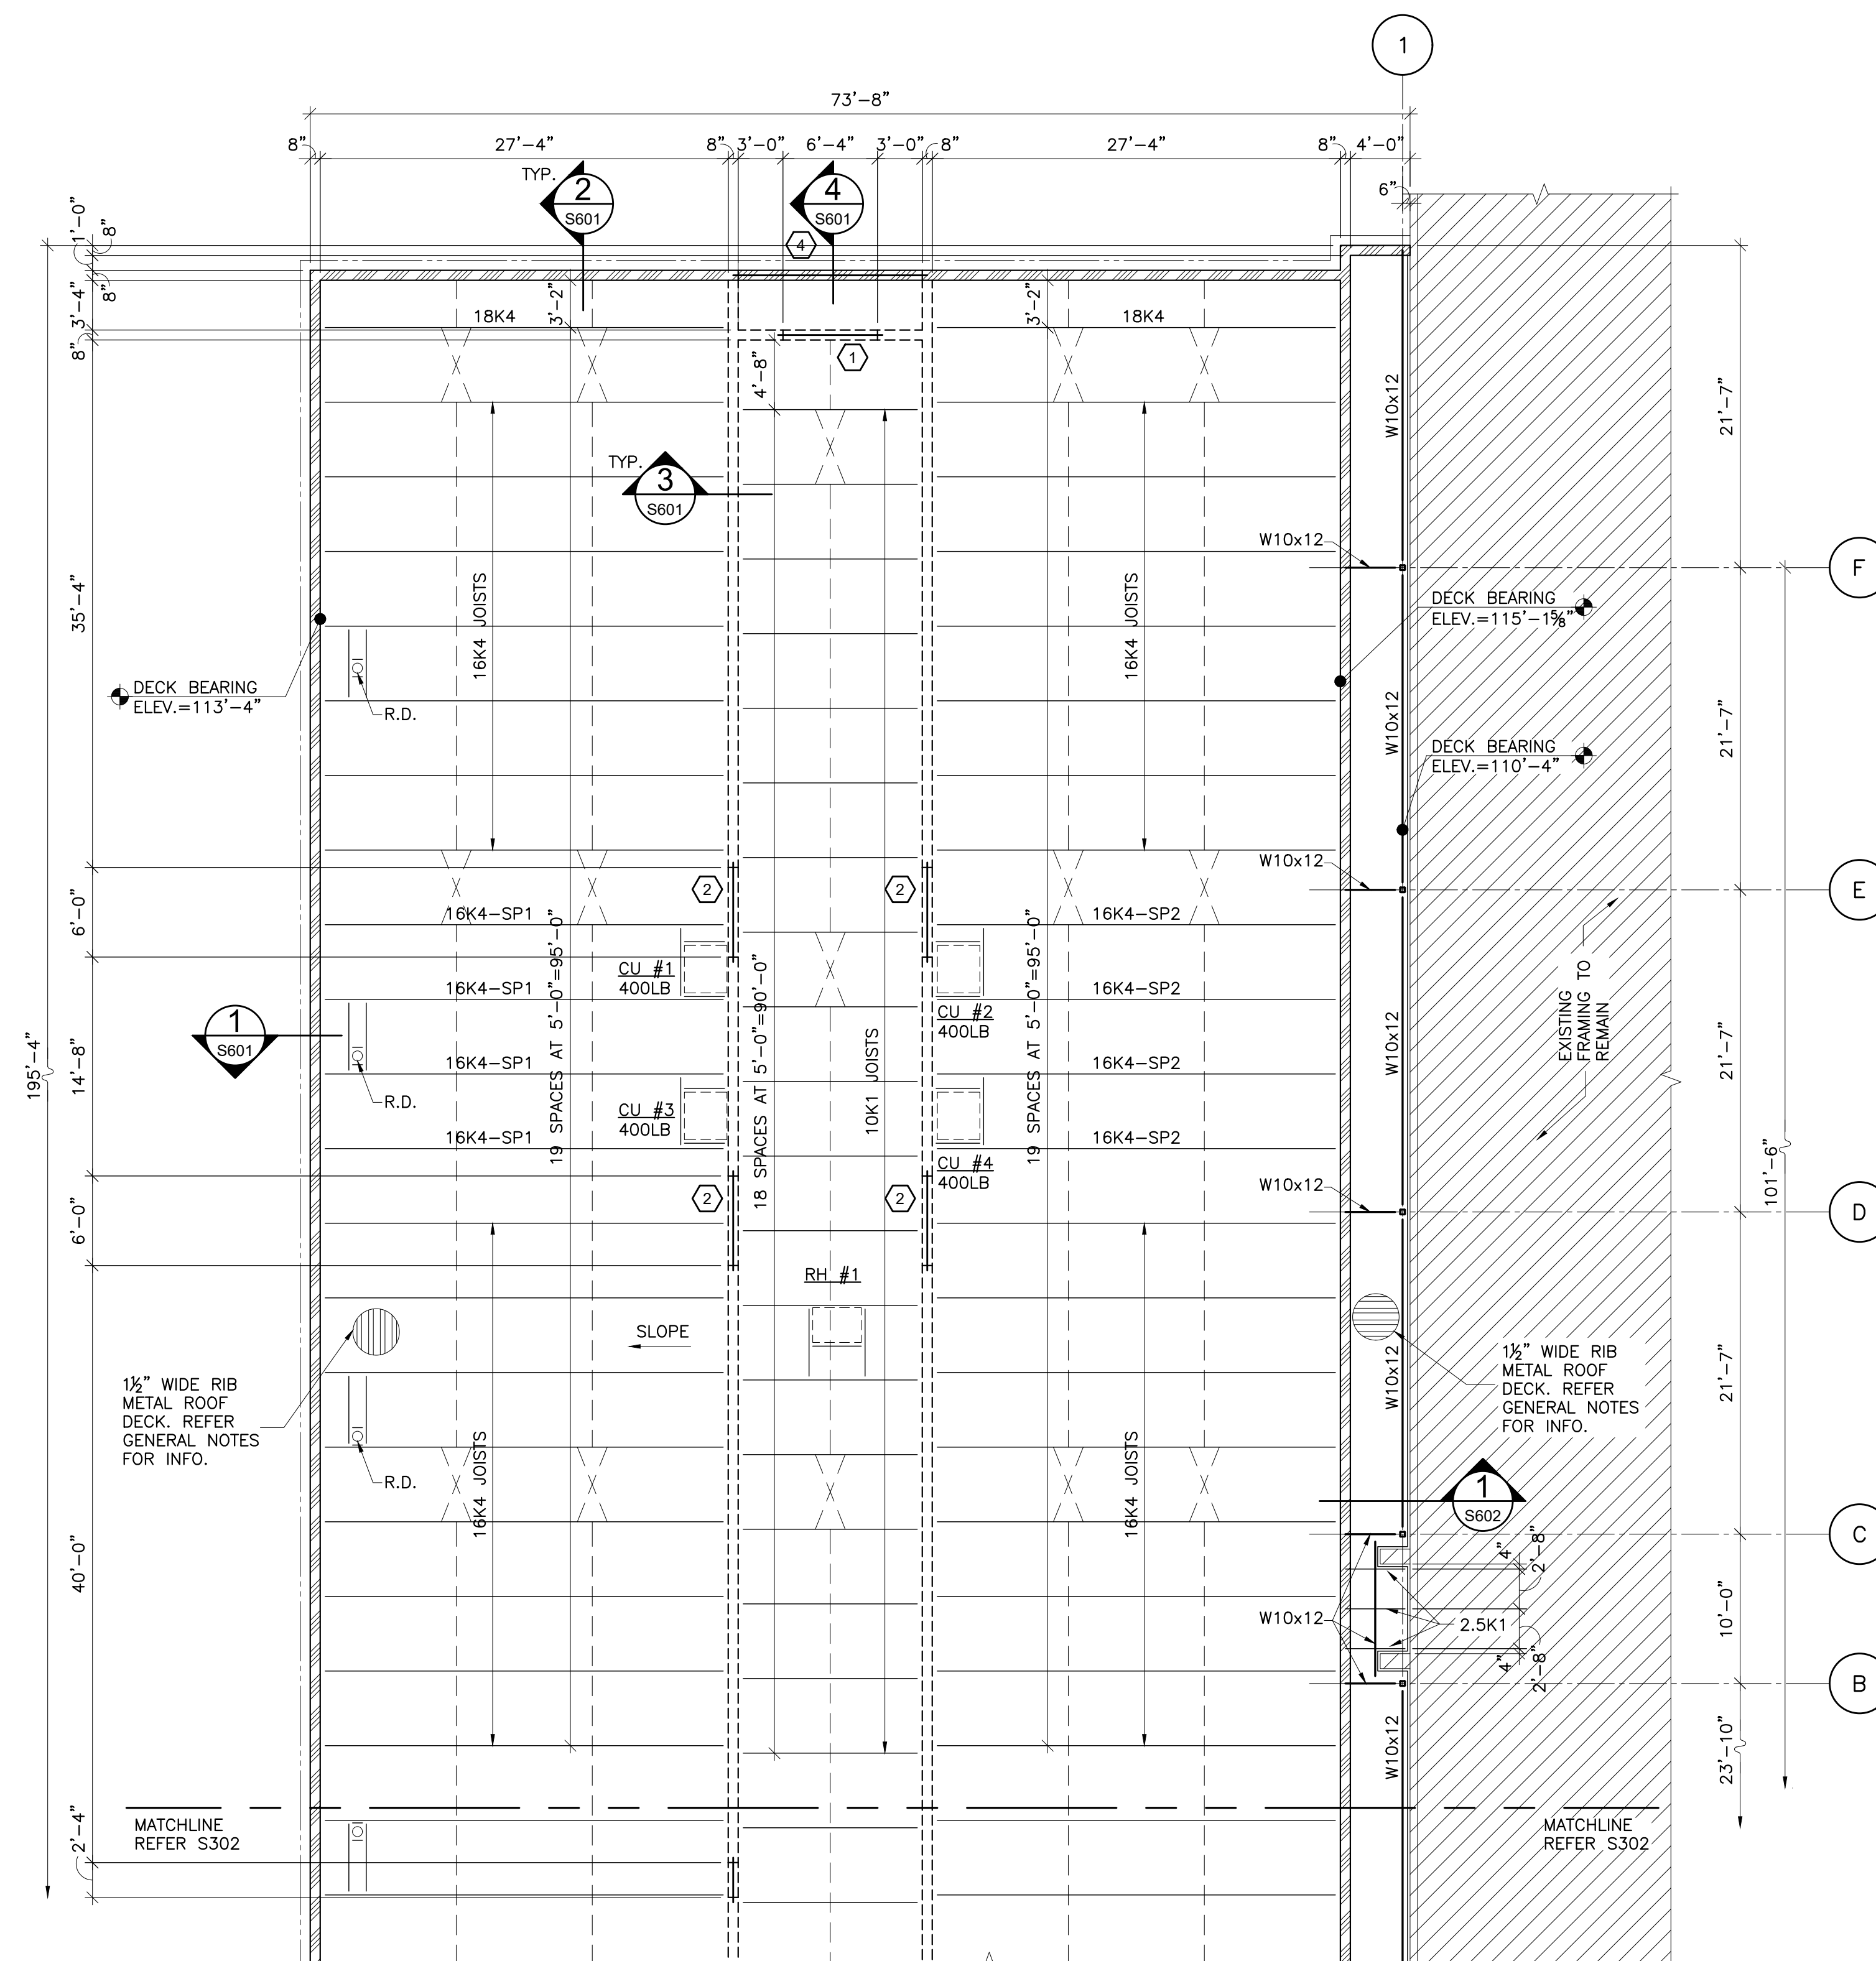

KEY PLAN





CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S302


OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

- ROOF FRAMING PLAN NOTES:**
- ALL ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR DATUM OF 100'-0". REFER FOUNDATION PLAN NOTES FOR ACTUAL ELEVATION.
 - REFER TO FOUNDATION PLAN FOR COLUMN SIZES.
 - ALL ROOF OPENINGS FOR MECHANICAL ROOF TOP UNITS ARE APPROXIMATELY LOCATED. EXACT SIZE AND LOCATIONS SHALL BE COORDINATED WITH THE SUCCESSFUL MECHANICAL CONTRACTOR. ALL ROOF/WALL OPENINGS SHALL BE SUPPORTED WITH TYPICAL ANGLE FRAME UNLESS NOTED OTHERWISE.
 - (27K) INDICATES MAXIMUM FACTORED BEAM END REACTION IN ACCORDANCE WITH THE AISC LRFD SPECIFICATION. IF NOT SHOWN, PROVIDE 10K MINIMUM CAPACITY. REFER TO TYPICAL CONNECTION DETAILS.
 - T.O. PARAPET REFERS TO THE TOP OF METAL STUD/MASONRY WALL ELEVATION WITH REFERENCE TO FINISH FLOOR ELEVATION SPECIFIED ON THE FOUNDATION PLAN U.N.O.
 - ① DENOTES MASONRY LINTEL TYPE. REFER S104 FOR ADDITIONAL INFORMATION.


FRAMING PLAN LEGEND:

- - - = L1x1/4x3/4 MIN. HORIZONTAL JOIST BRIDGING BY JOIST MANUFACTURER
- X X X = L1x1/4x3/4 MIN. JOIST X-BRIDGING BY JOIST MANUFACTURER

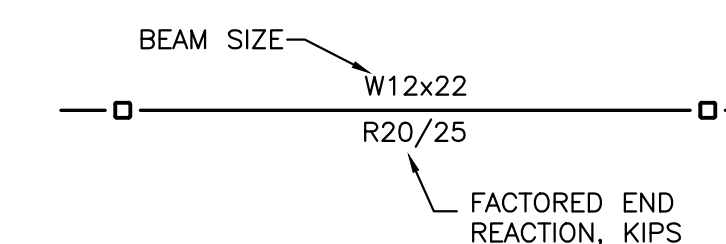


NOTE:
IF ONLY ONE NUMBER IS PROVIDED FOR END REACTIONS, REACTION APPLIES TO BOTH ENDS. WHERE NO REACTION IS GIVEN, USE 10K.

- [Hatched Area] = LOAD BEARING MASONRY WALLS
- [Dashed Area] = INTERIOR LOAD BEARING MASONRY WALLS

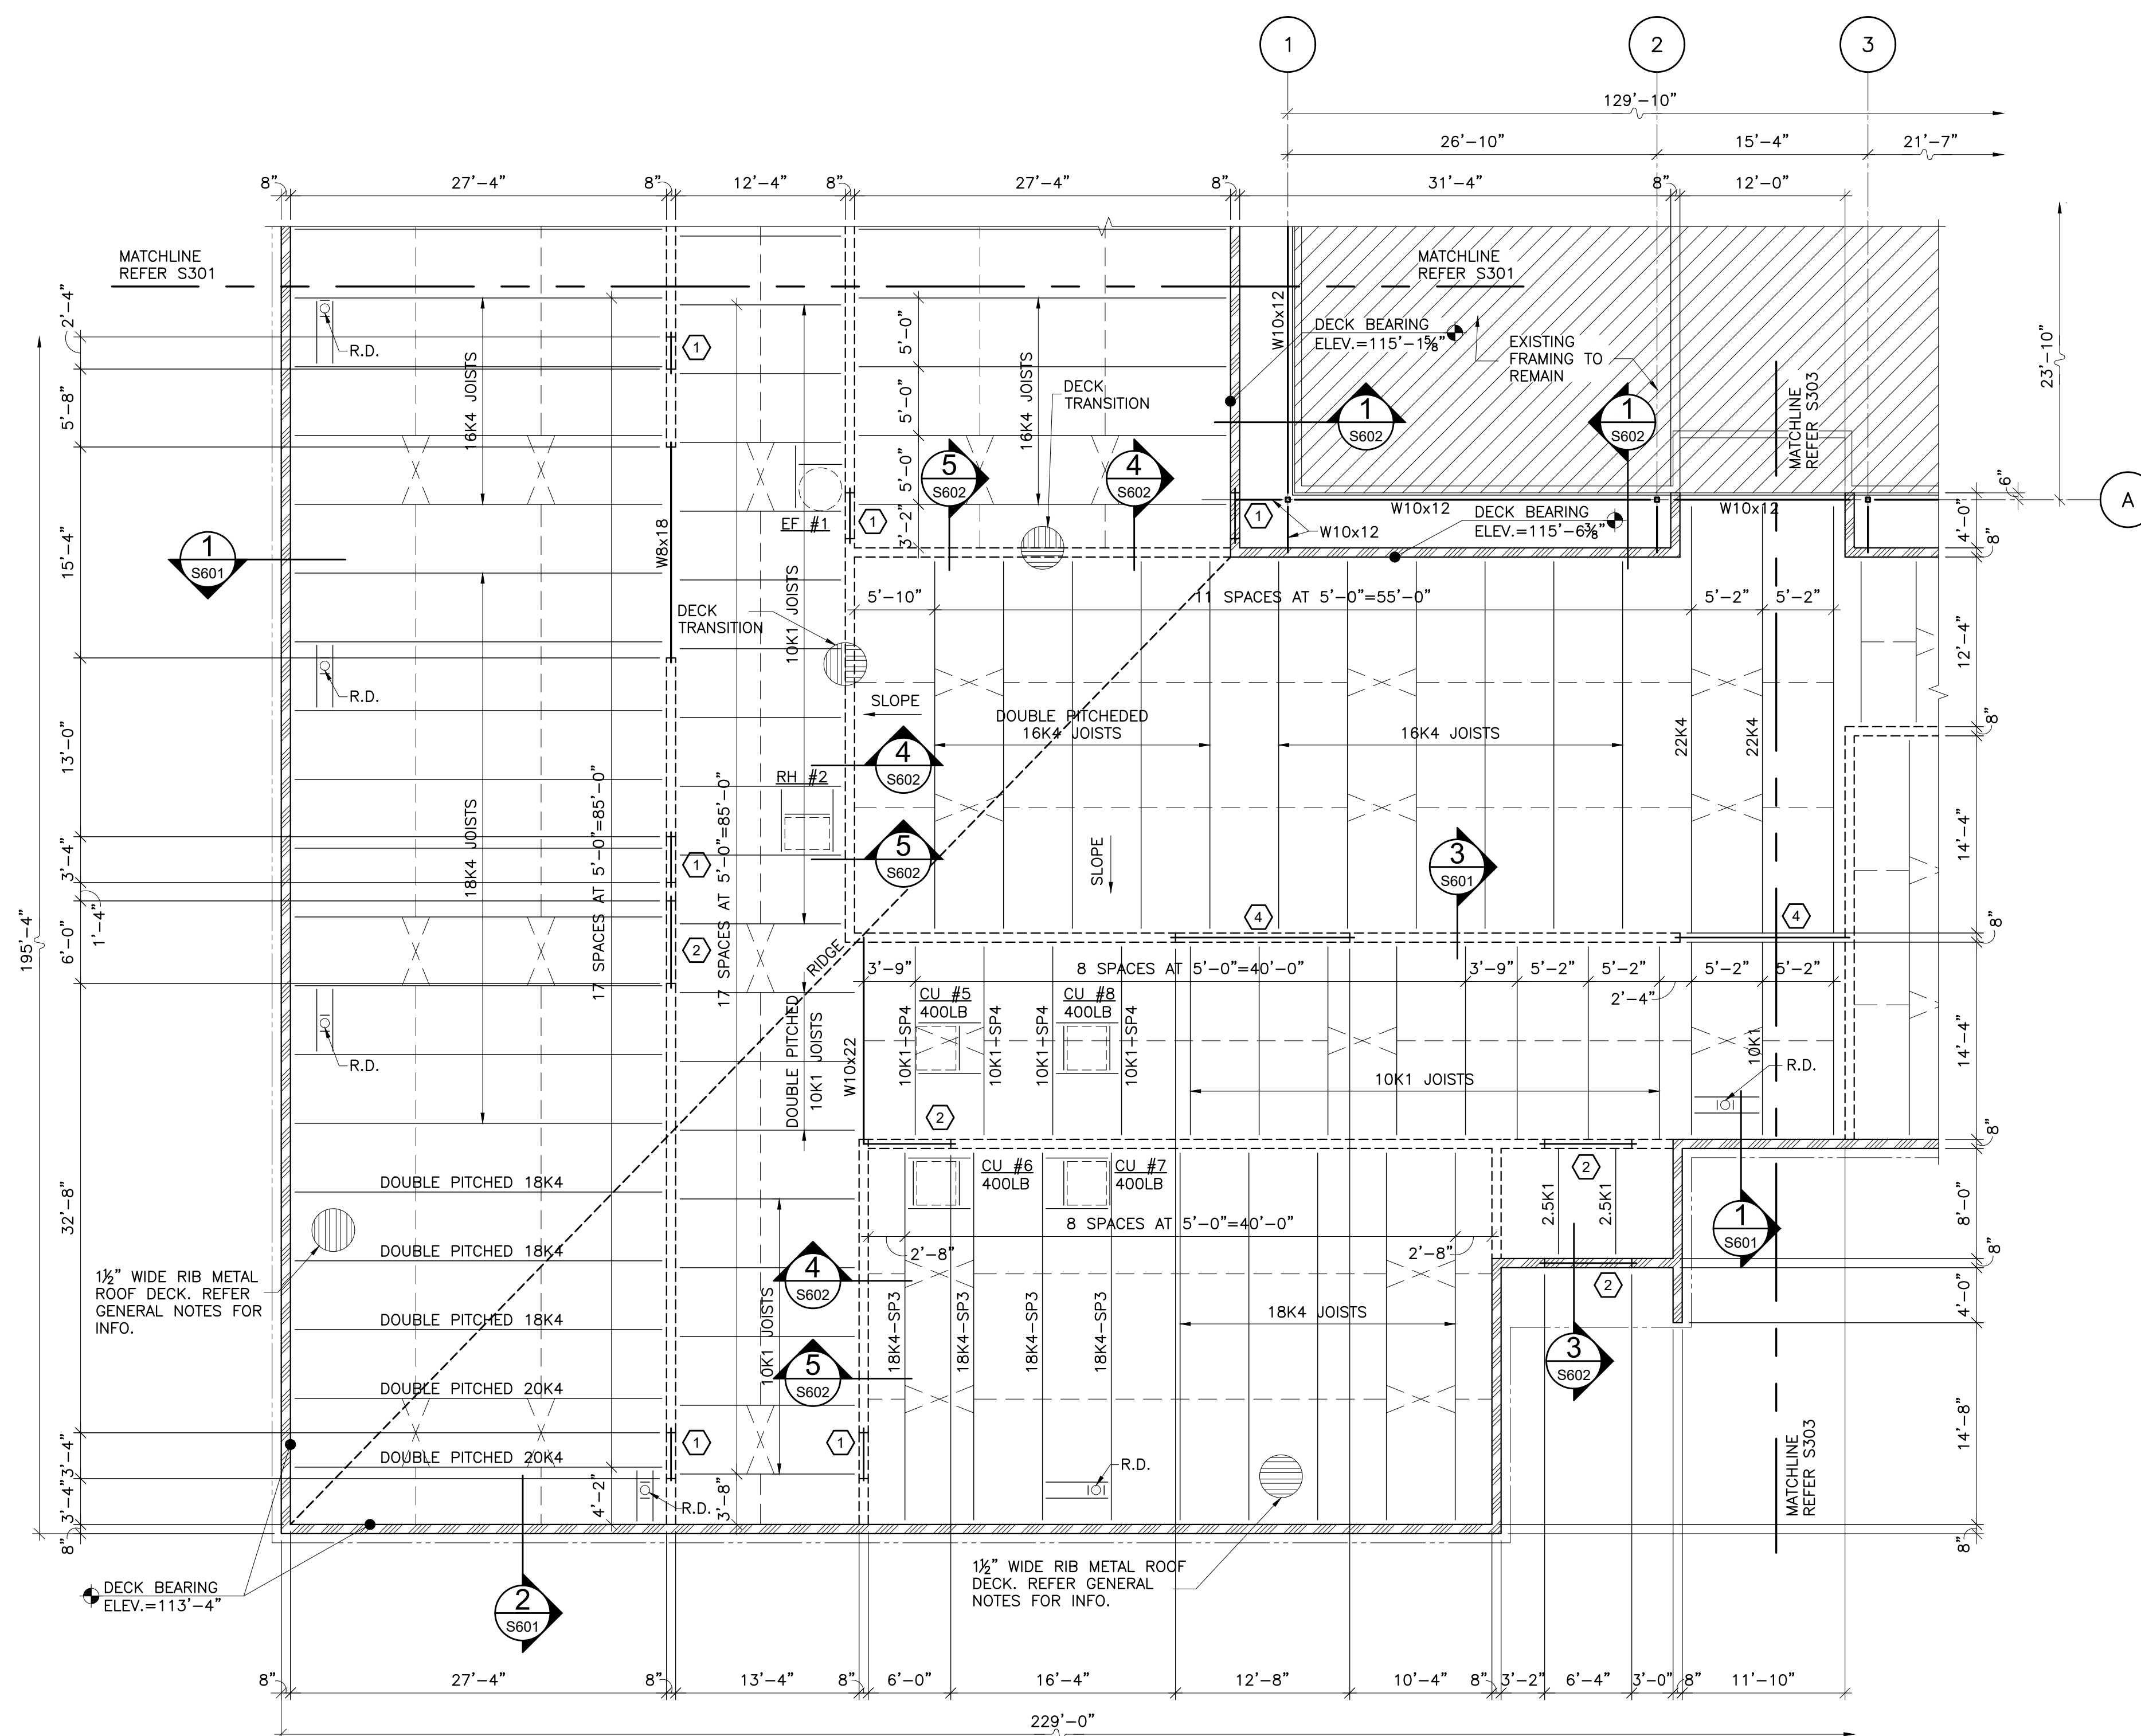

1 FRAMING PLAN AREA B
S302 SCALE: 1/8"=1'-0"

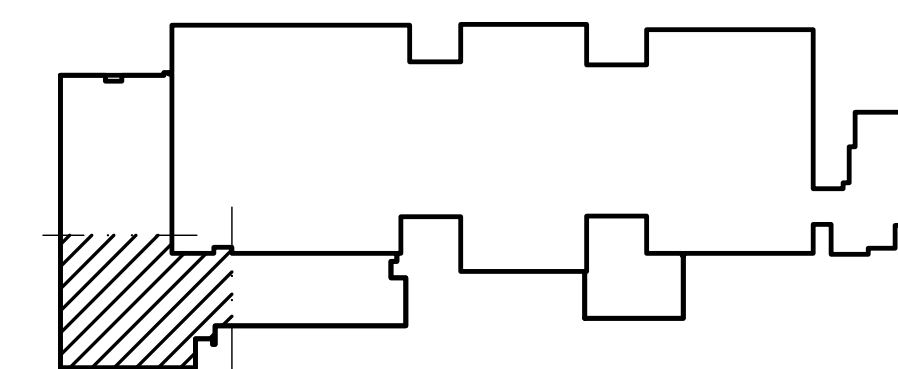


KEY PLAN



- ROOF FRAMING PLAN NOTES:**
1. ALL ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR DATUM OF 100'-0". REFER TO FOUNDATION PLAN NOTES FOR ACTUAL ELEVATION.
 2. REFER TO FOUNDATION PLAN FOR COLUMN SIZES.
 3. ALL ROOF OPENINGS FOR MECHANICAL ROOF TOP UNITS ARE APPROXIMATELY LOCATED. EXACT SIZE AND LOCATIONS SHALL BE COORDINATED WITH THE SUCCESSFUL MECHANICAL CONTRACTOR. ALL ROOF/WALL OPENINGS SHALL BE SUPPORTED WITH TYPICAL ANGLE FRAME UNLESS NOTED OTHERWISE.
 4. (27K) INDICATES MAXIMUM FACTORED BEAM END REACTION IN ACCORDANCE WITH THE AISC LRFD SPECIFICATION. IF NOT SHOWN, PROVIDE 10K MINIMUM CAPACITY. REFER TO TYPICAL CONNECTION DETAILS.
 5. T.O. PARAPET REFERS TO THE TOP OF METAL STUD/MASONRY WALL ELEVATION WITH REFERENCE TO FINISH FLOOR ELEVATION SPECIFIED ON THE FOUNDATION PLAN U.N.O.
 6. (1) DENOTES MASONRY LINTEL TYPE. REFER S104 FOR ADDITIONAL INFORMATION.

FRAMING PLAN LEGEND:

- - - = L1½x1¼x¾ MIN. HORIZONTAL JOIST BRIDGING BY JOIST MANUFACTURER
- X - X = L1½x1¼x¾ MIN. JOIST X-BRIDGING BY JOIST MANUFACTURER

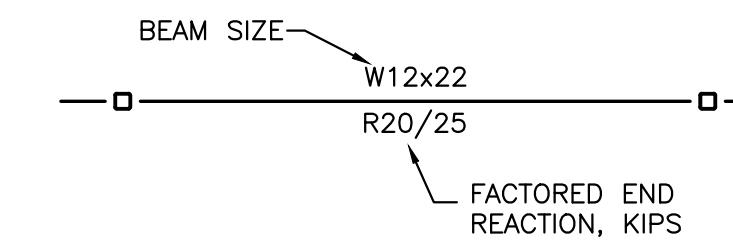

NOTE:
IF ONLY ONE NUMBER IS PROVIDED FOR END REACTIONS, REACTION APPLIES TO BOTH ENDS. WHERE NO REACTION IS GIVEN, USE 10K.

- [Hatched Area] = LOAD BEARING MASONRY WALLS
- [Dashed Area] = INTERIOR LOAD BEARING MASONRY WALLS



CJC

drawn by

BWB

checked by

JULY 2023

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:


S303

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

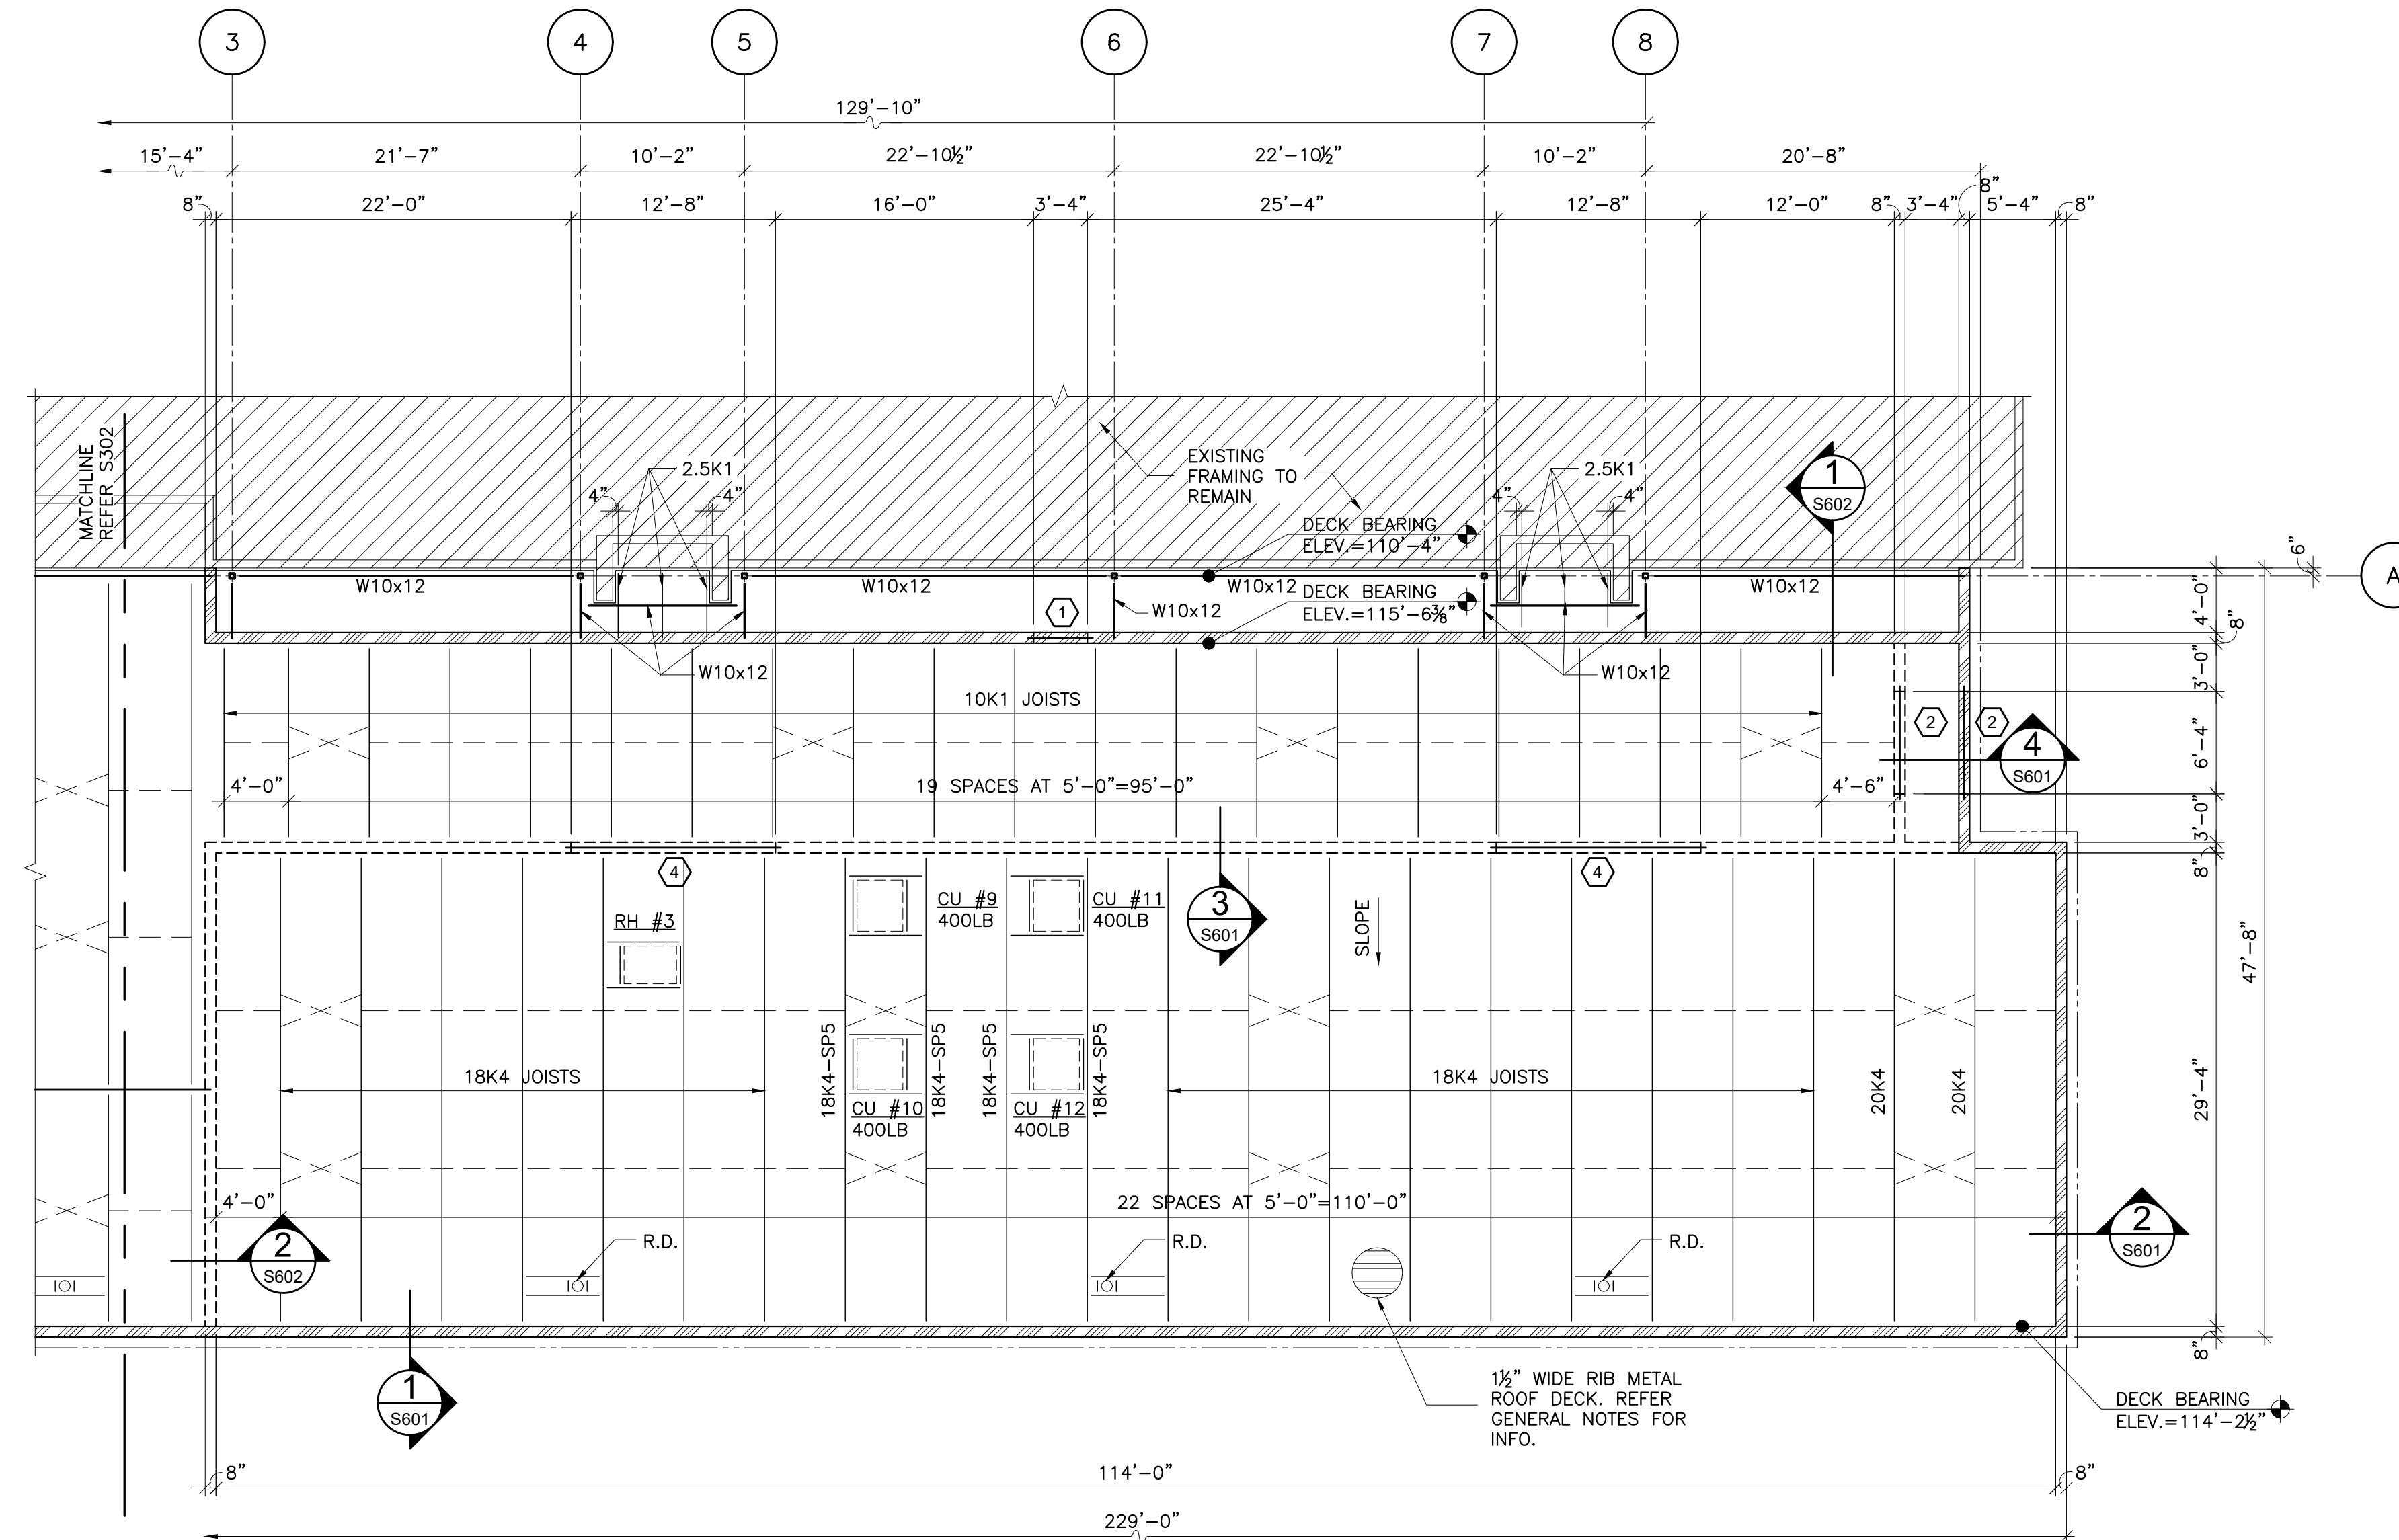

1 FRAMING PLAN AREA C
S303 SCALE: 1/8"=1'-0"

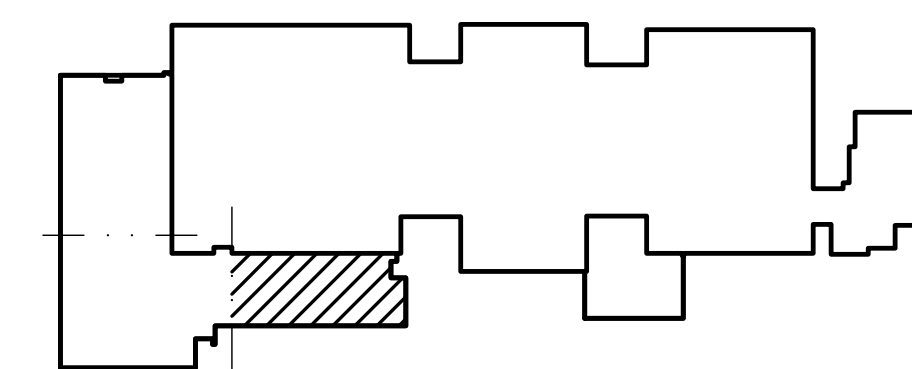


KEY PLAN



- NONSHELTER ROOF FRAMING PLAN NOTES:
- ALL ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR DATUM OF 100'-0". REFER FOUNDATION PLAN NOTES FOR ACTUAL ELEVATION.
 - REFER TO FOUNDATION PLAN FOR COLUMN SIZES.
 - ALL ROOF OPENINGS FOR MECHANICAL ROOF TOP UNITS ARE APPROXIMATELY LOCATED. EXACT SIZE AND LOCATIONS SHALL BE COORDINATED WITH THE SUCCESSFUL MECHANICAL CONTRACTOR. ALL ROOF/WALL OPENINGS SHALL BE SUPPORTED WITH TYPICAL ANGLE FRAME UNLESS NOTED OTHERWISE.
 - (27K) INDICATES MAXIMUM FACTORED BEAM END REACTION IN ACCORDANCE WITH THE AISC LRFD SPECIFICATION. IF NOT SHOWN, PROVIDE 10K MINIMUM CAPACITY. REFER TO TYPICAL CONNECTION DETAILS.
 - T.O. PARAPET REFERS TO THE TOP OF METAL STUD/MASONRY WALL ELEVATION WITH REFERENCE TO FINISH FLOOR ELEVATION SPECIFIED ON THE FOUNDATION PLAN U.N.O.
 - ① DENOTES MASONRY LINTEL TYPE. REFER S104 FOR ADDITIONAL INFORMATION.


FRAMING PLAN LEGEND:

- - - = L1x1 1/4x3/4 MIN. HORIZONTAL JOIST BRIDGING BY JOIST MANUFACTURER
- X X X = L1x1 1/4x3/4 MIN. JOIST X-BRIDGING BY JOIST MANUFACTURER

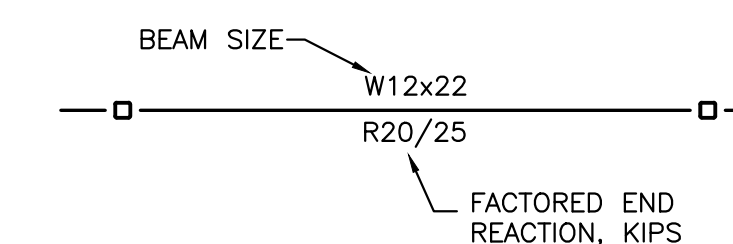

NOTE:
IF ONLY ONE NUMBER IS PROVIDED FOR END REACTIONS, REACTION APPLIES TO BOTH ENDS. WHERE NO REACTION IS GIVEN, USE 10K.

- [Hatched Area] = LOAD BEARING MASONRY WALLS
- [Dashed Area] = INTERIOR LOAD BEARING MASONRY WALLS

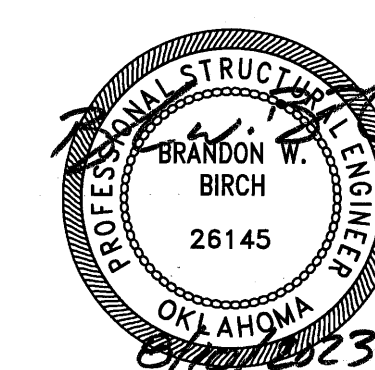

| | |
|-----------|------------|
| CJC | drawn by |
| BWB | checked by |
| JULY 2023 | date |
| | revisions |

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:


S304

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

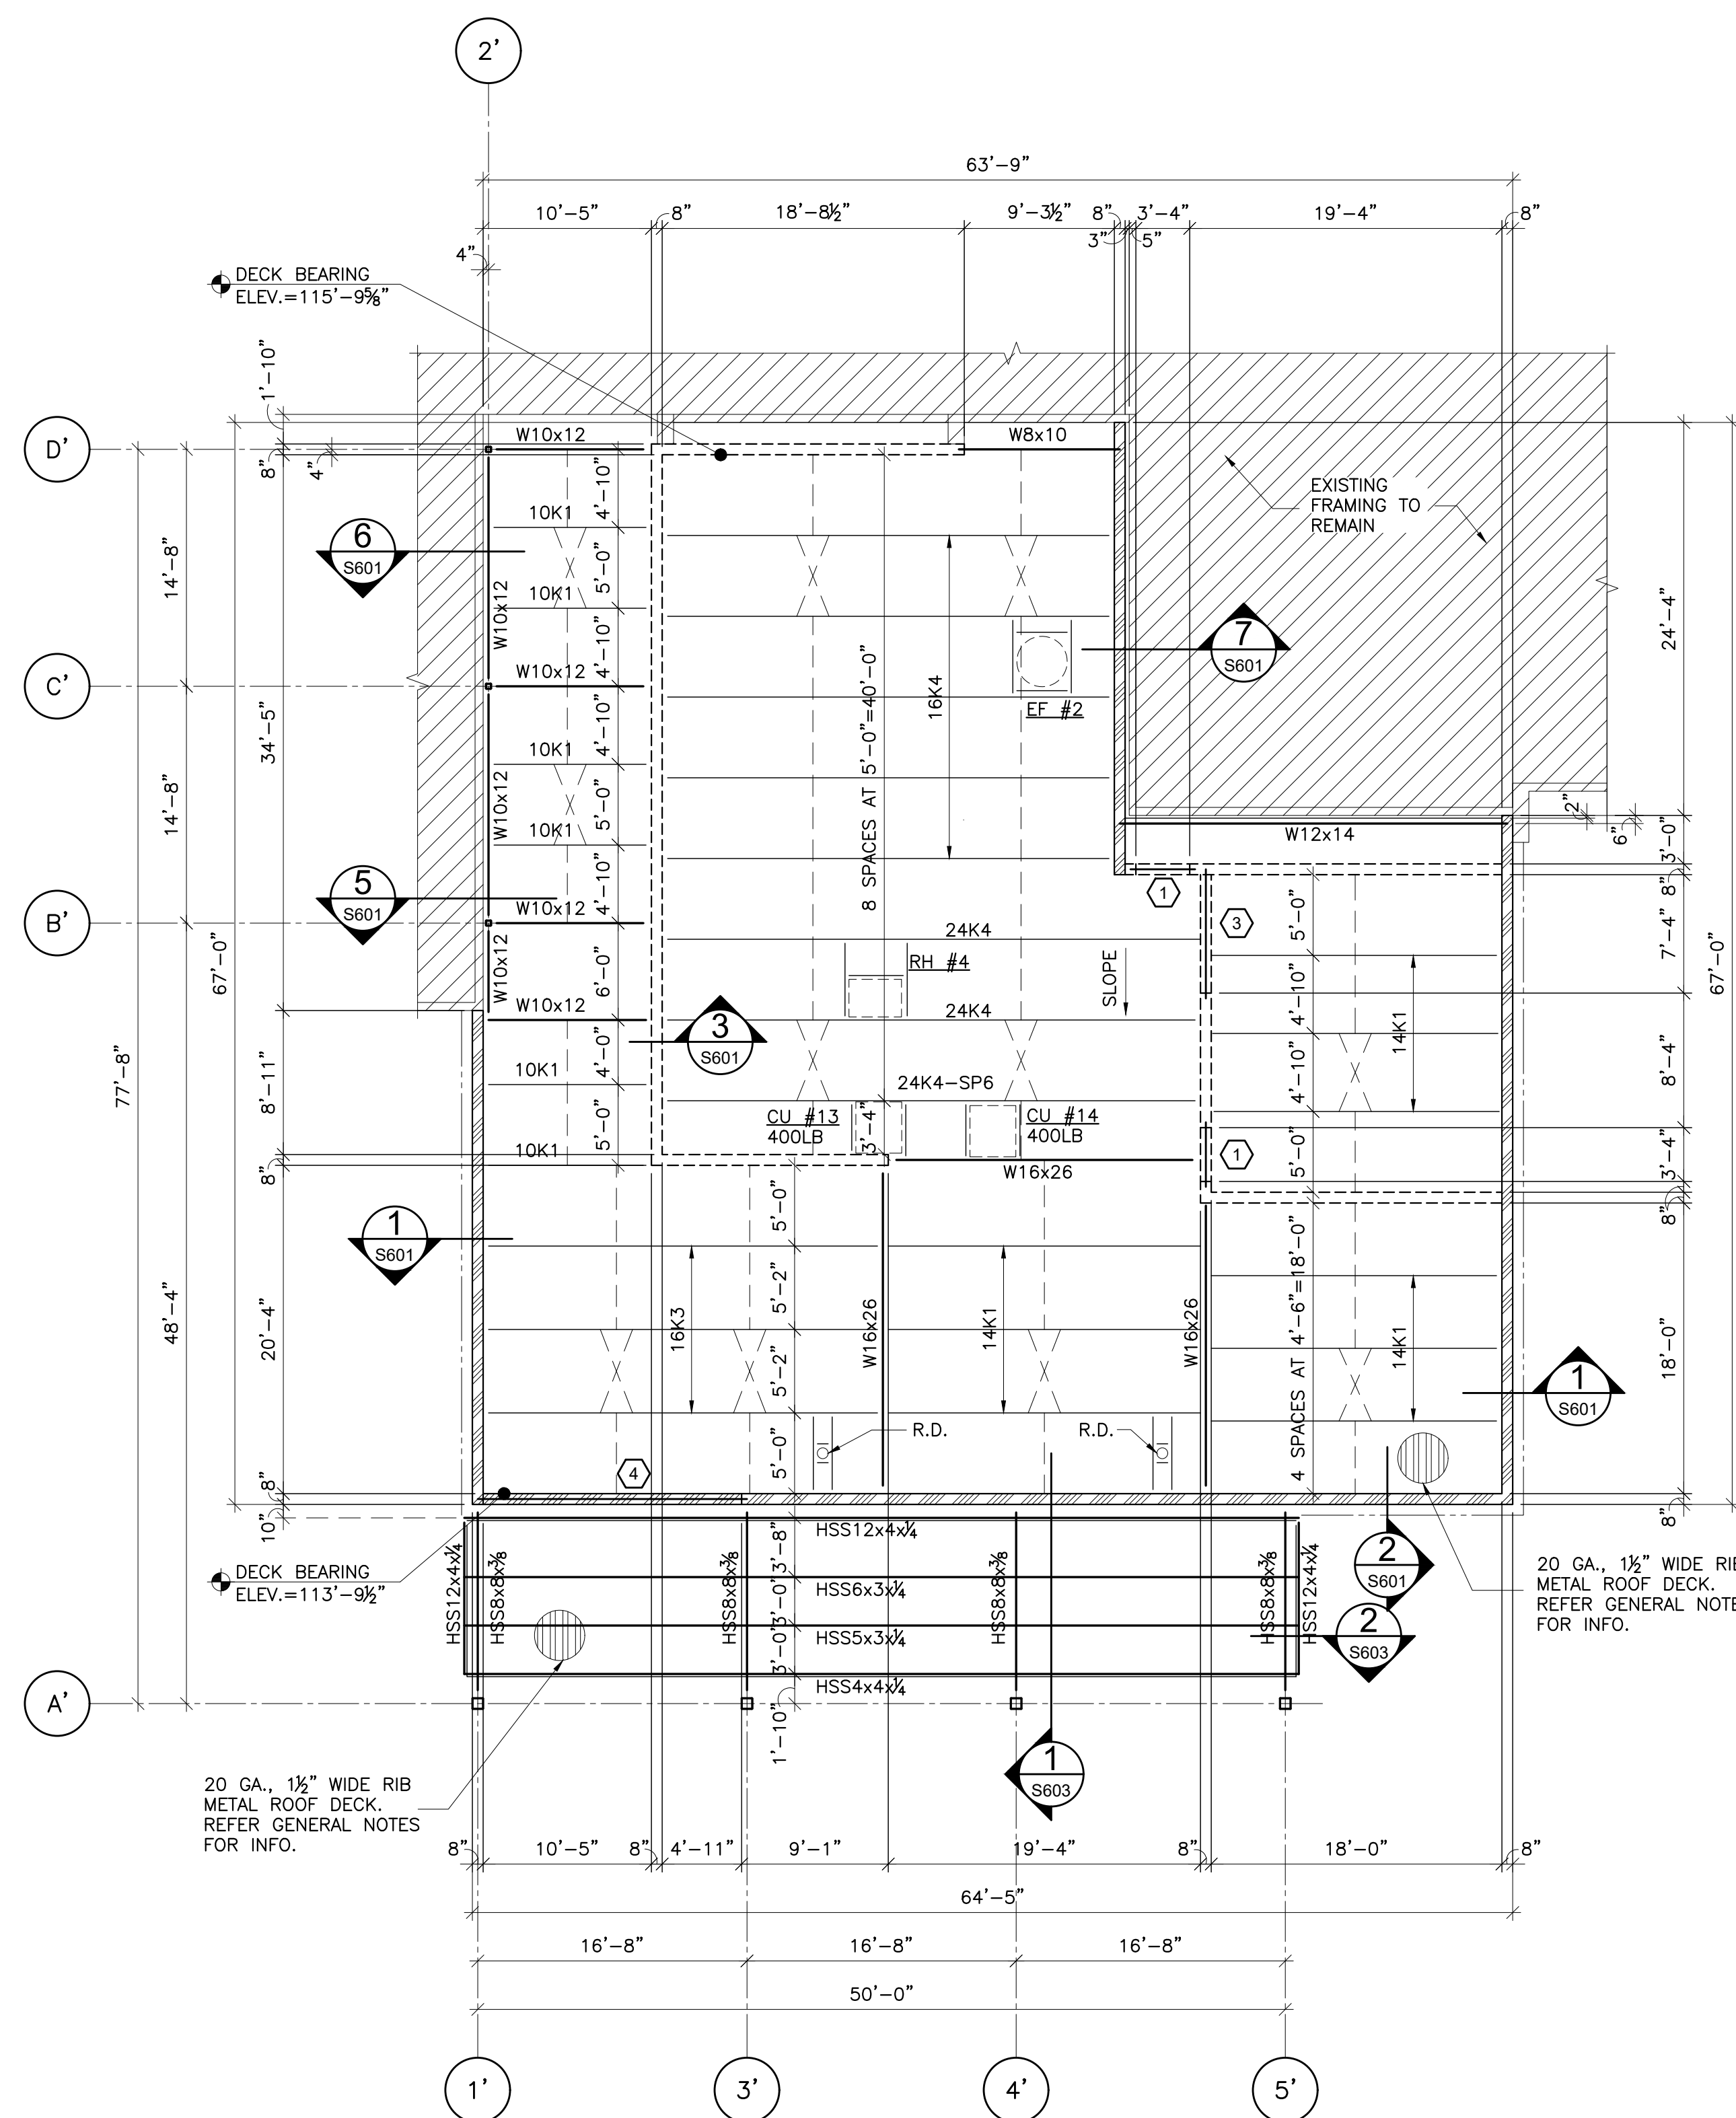

1 FRAMING PLAN AREA D
S304 SCALE: 1/8"=1'-0"

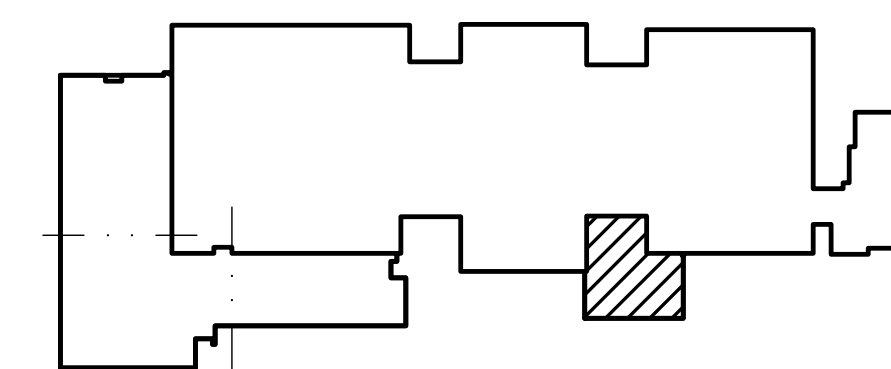

KEY PLAN





| | |
|-----------|------------|
| CJC | drawn by |
| BWB | checked by |
| JULY 2023 | date |
| | revisions |




sheet no:


S501

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

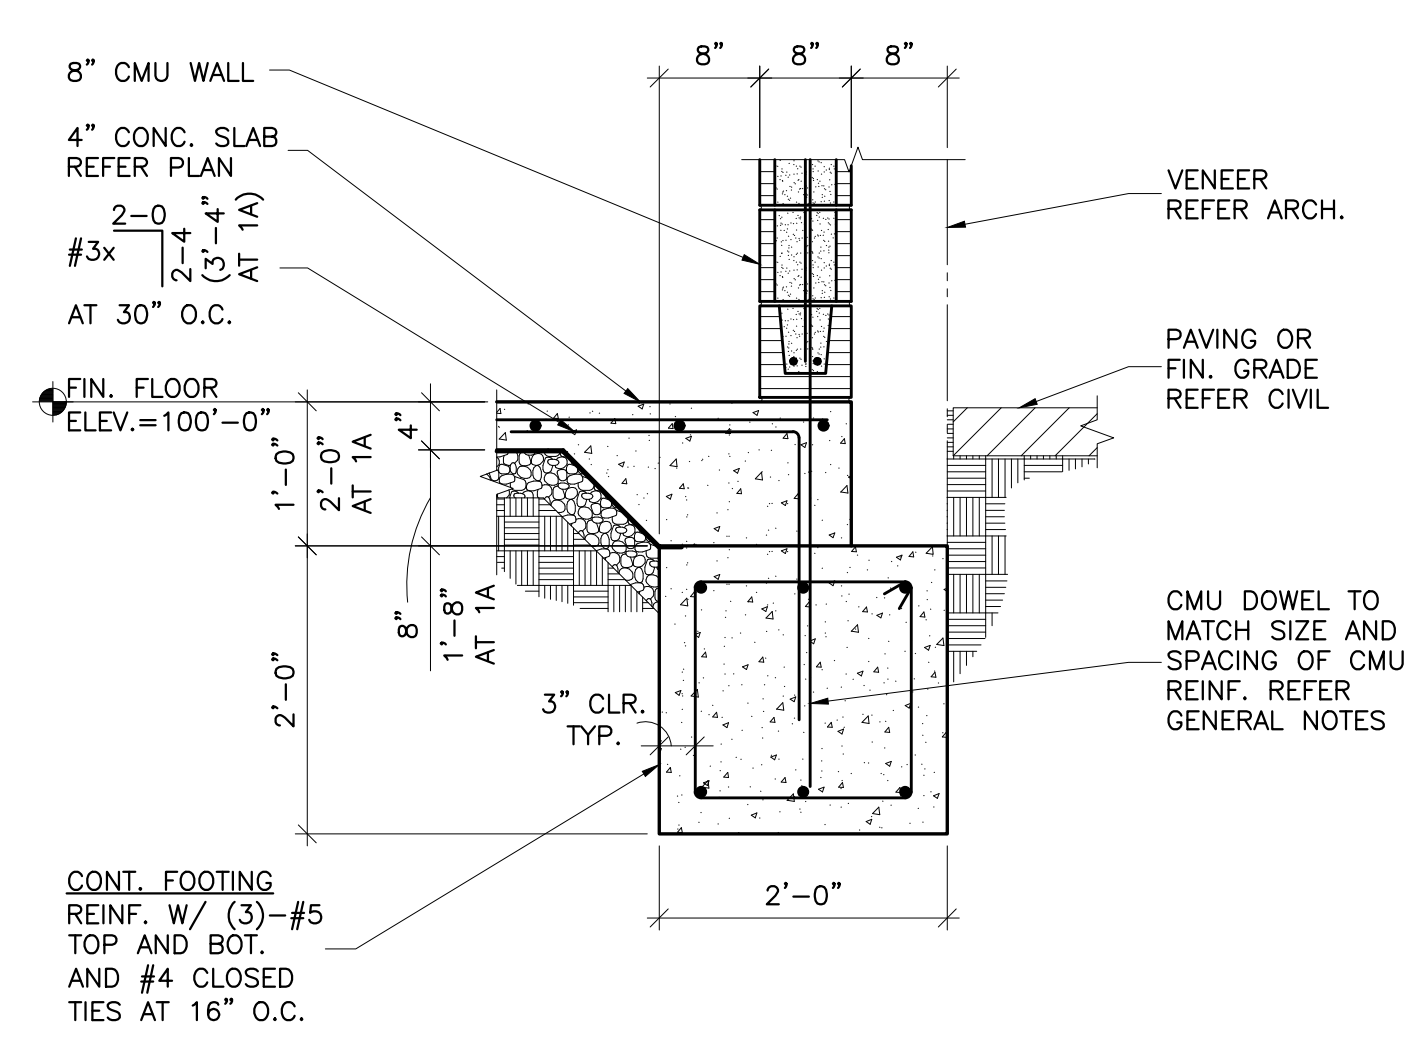


1 SECTION
S501 SCALE: 3/4"=1'-0"

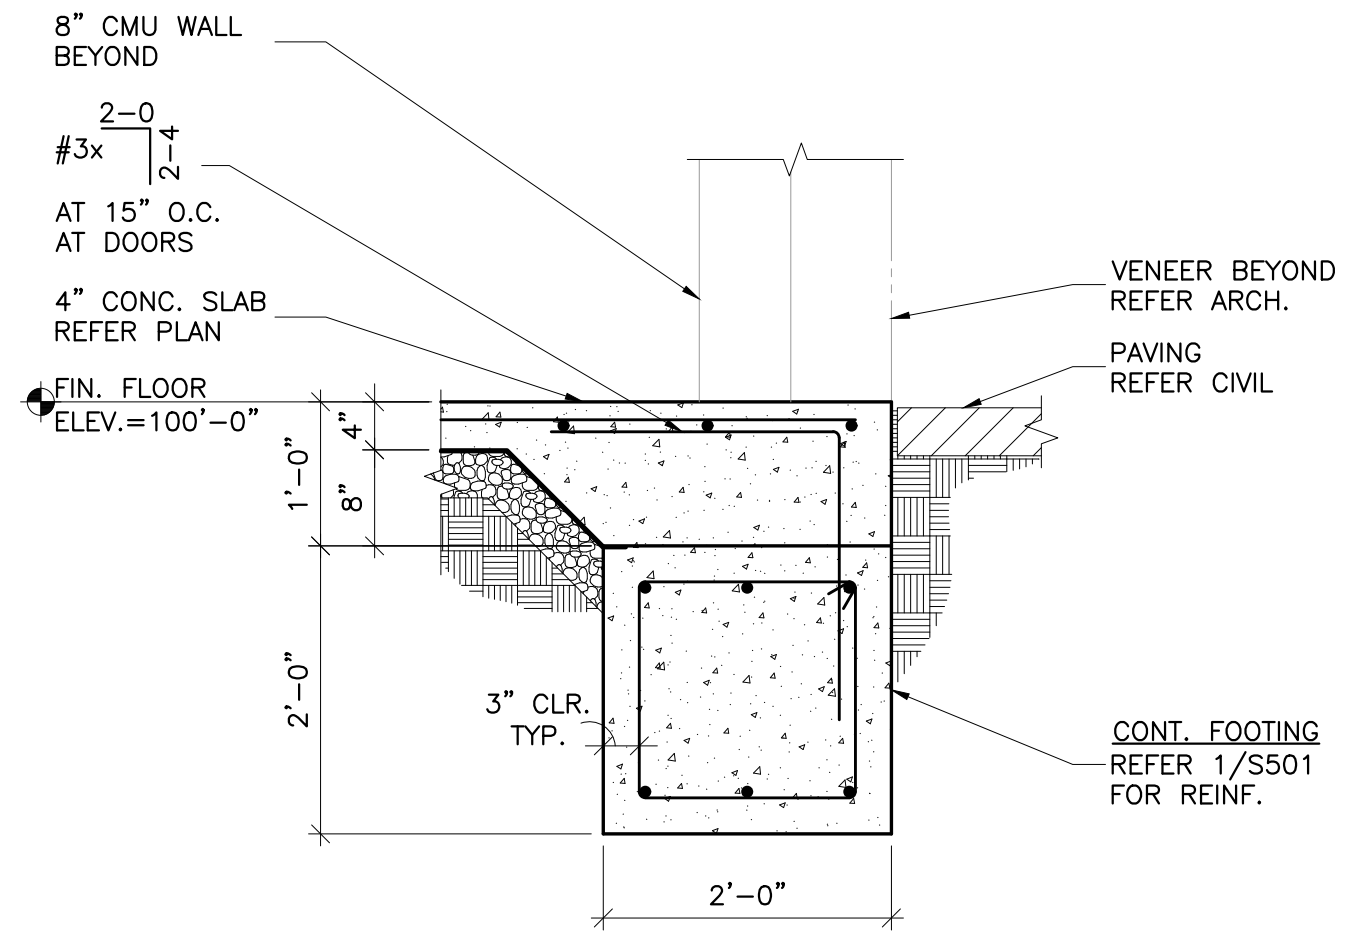


2 SECTION
S501 SCALE: 3/4"=1'-0"

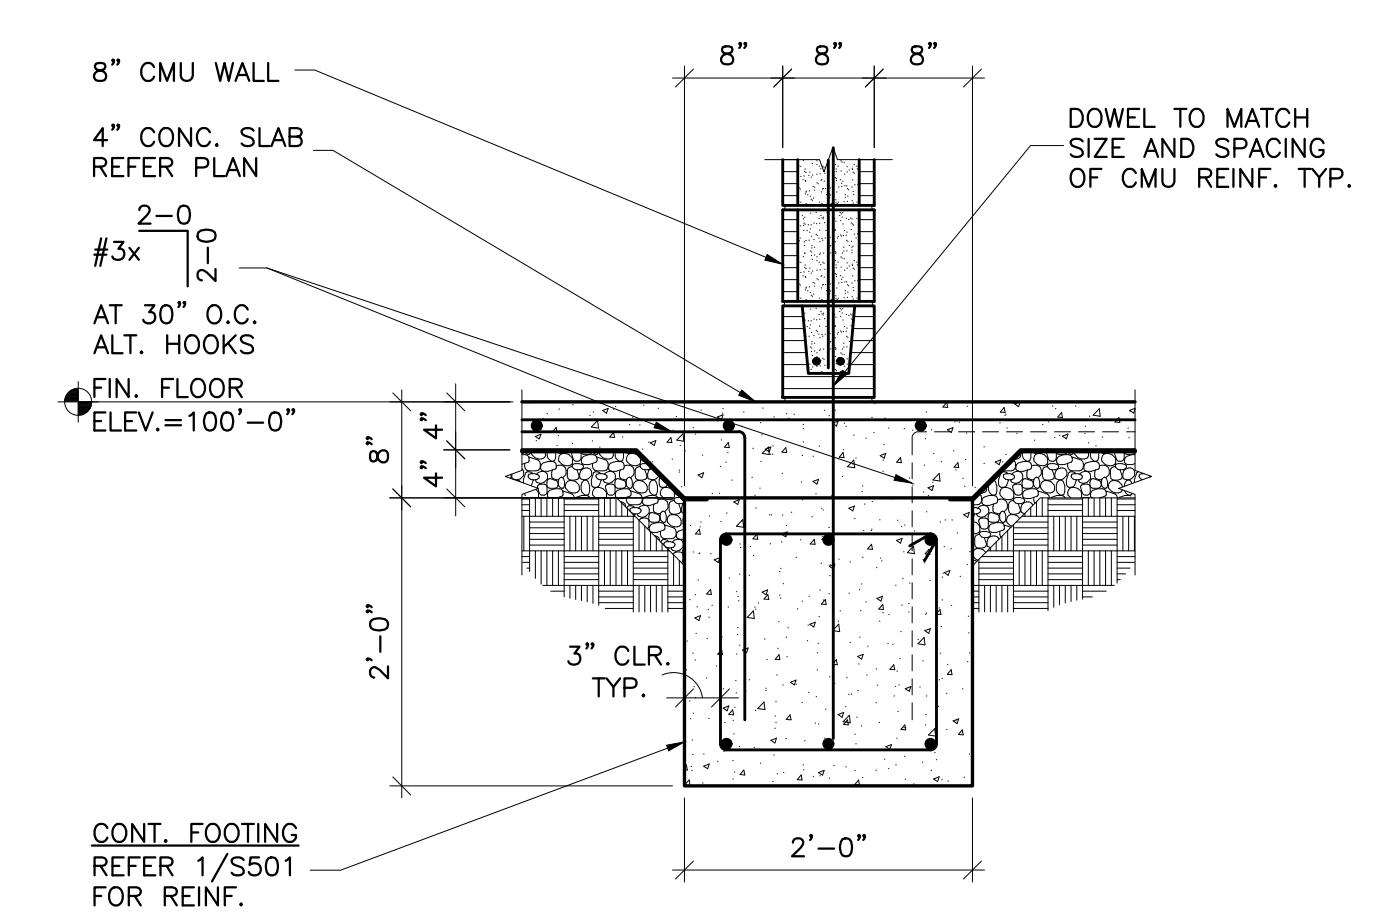


3 SECTION
S501 SCALE: 3/4"=1'-0"

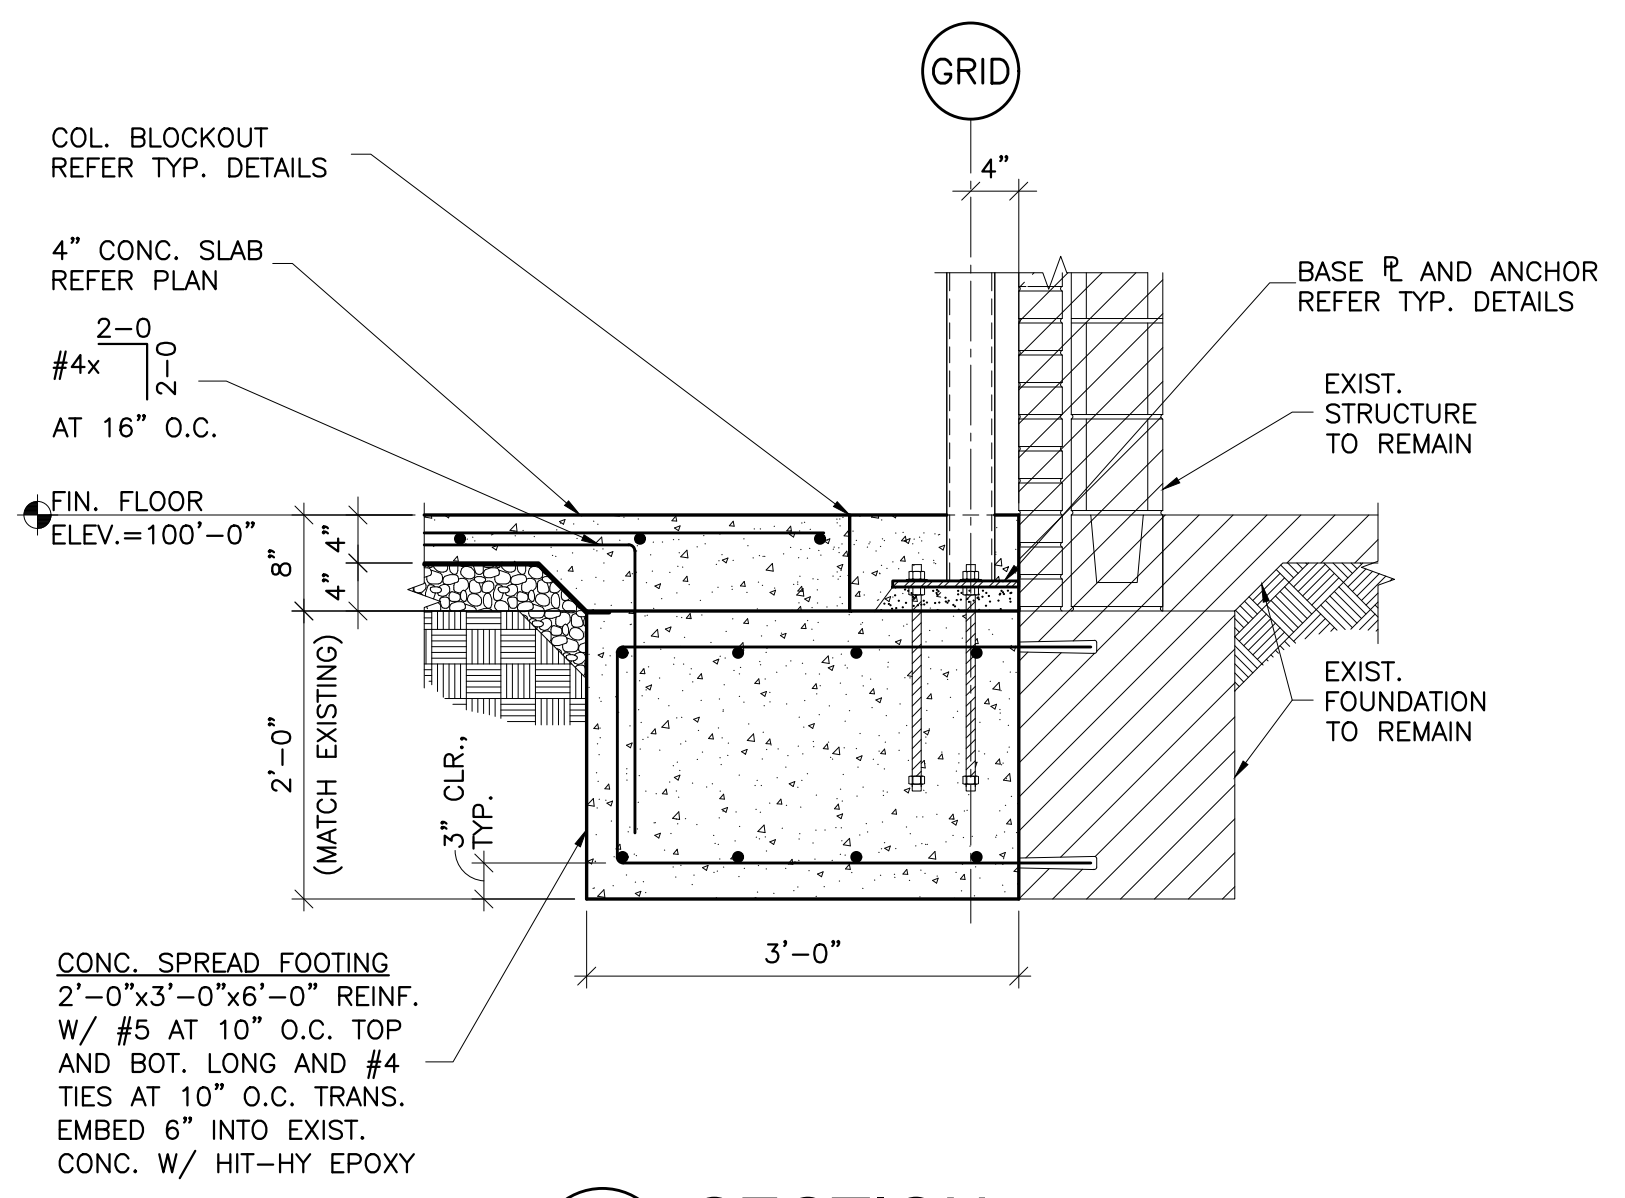


4 SECTION
S501 SCALE: 3/4"=1'-0"

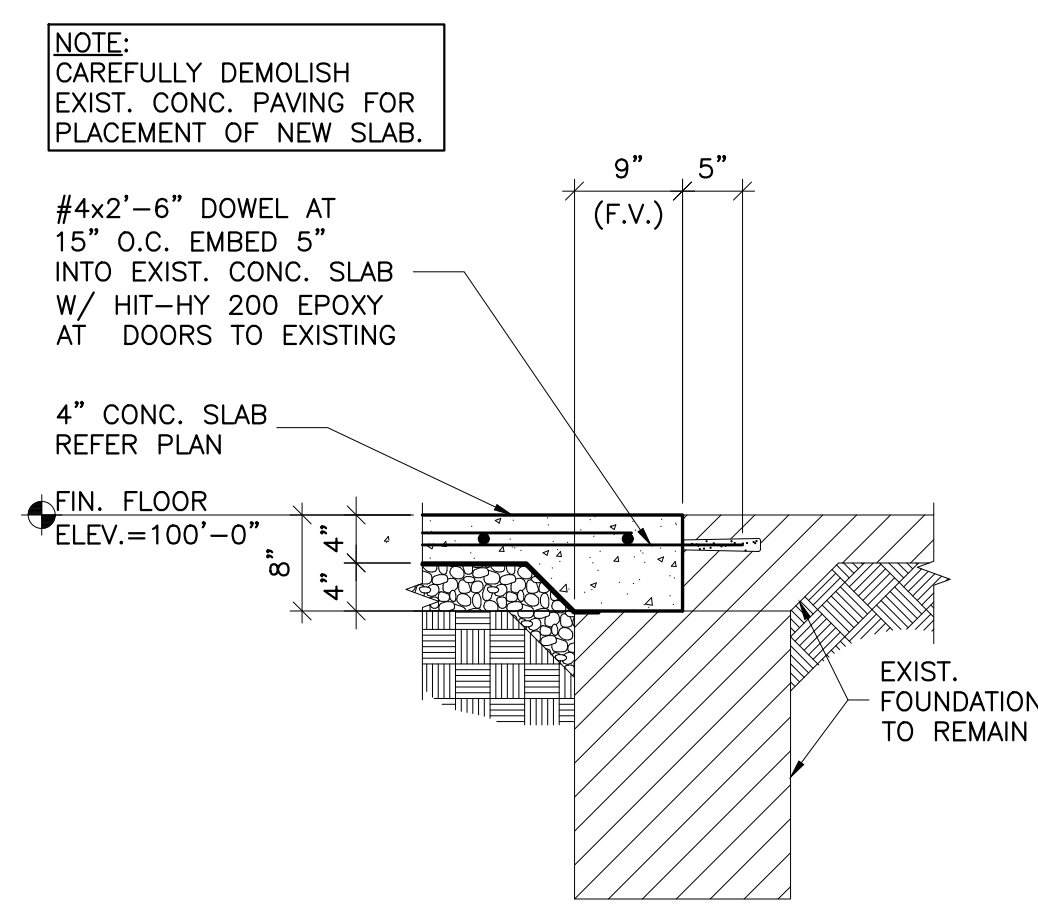


5 SECTION
S501 SCALE: 3/4"=1'-0"

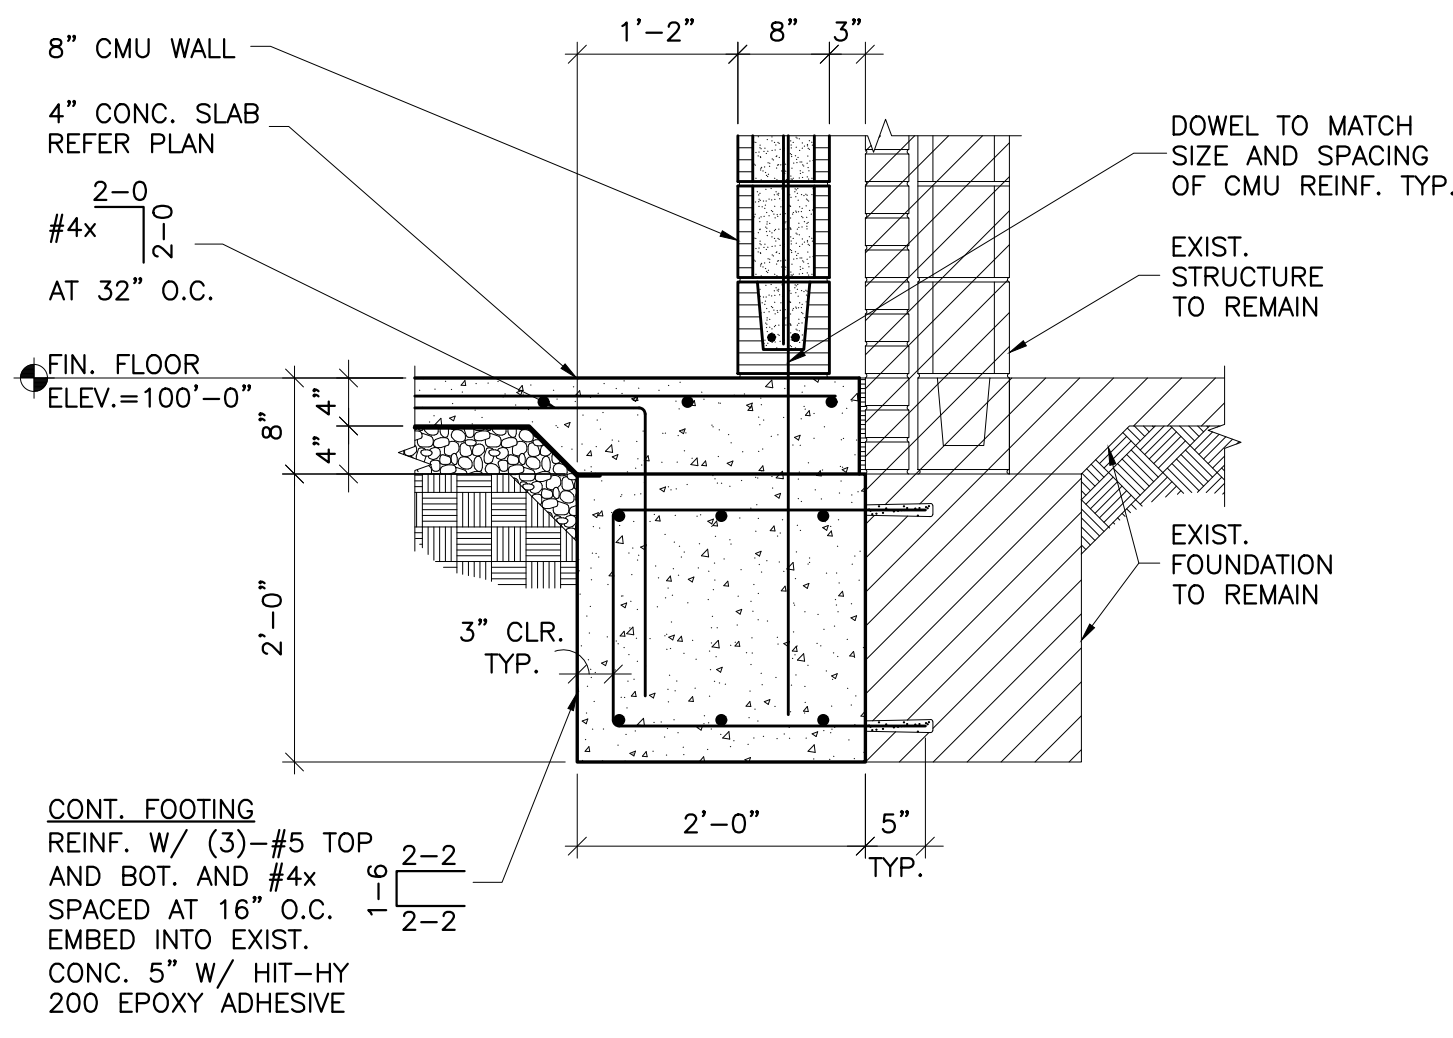


6 SECTION
S501 SCALE: 3/4"=1'-0"

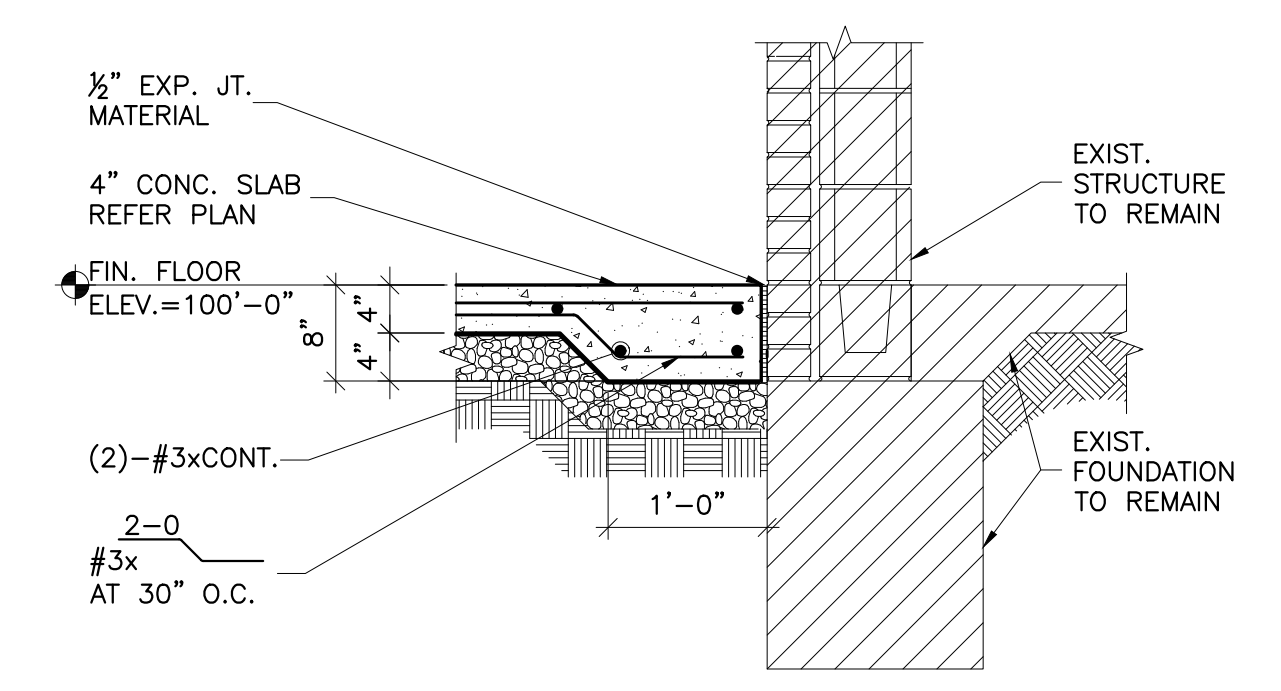


7 SECTION
S501 SCALE: 3/4"=1'-0"

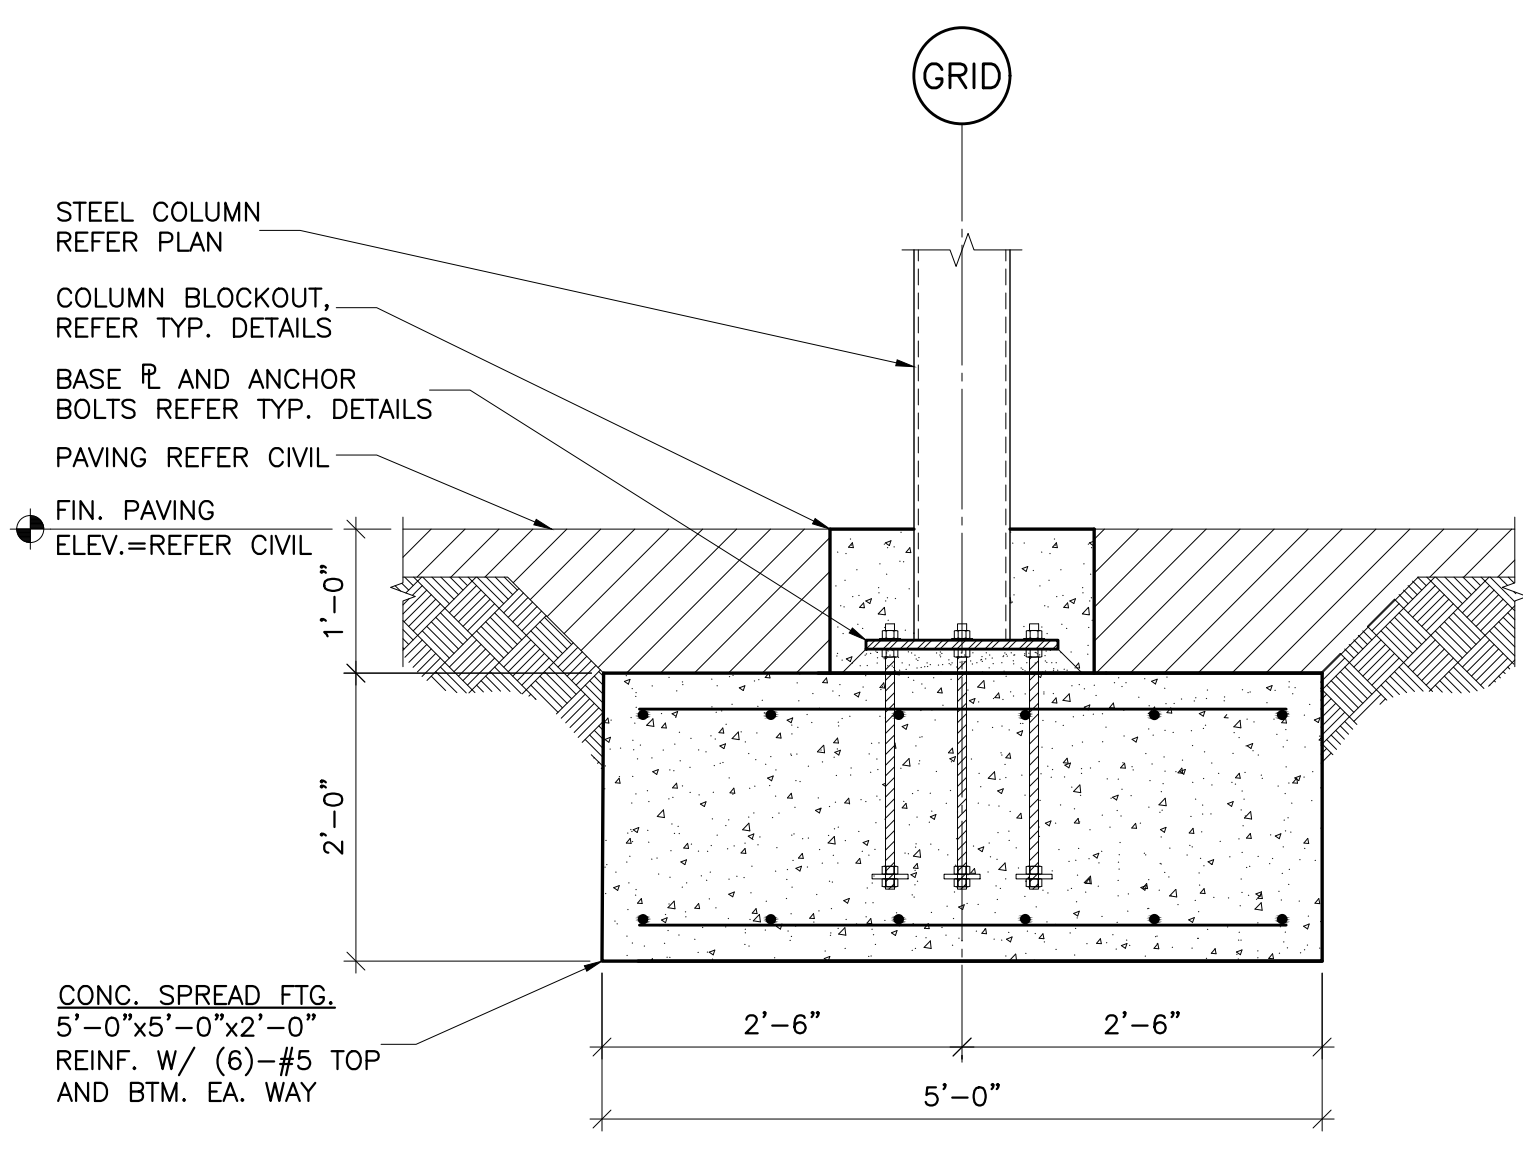


8 SECTION
S501 SCALE: 3/4"=1'-0"

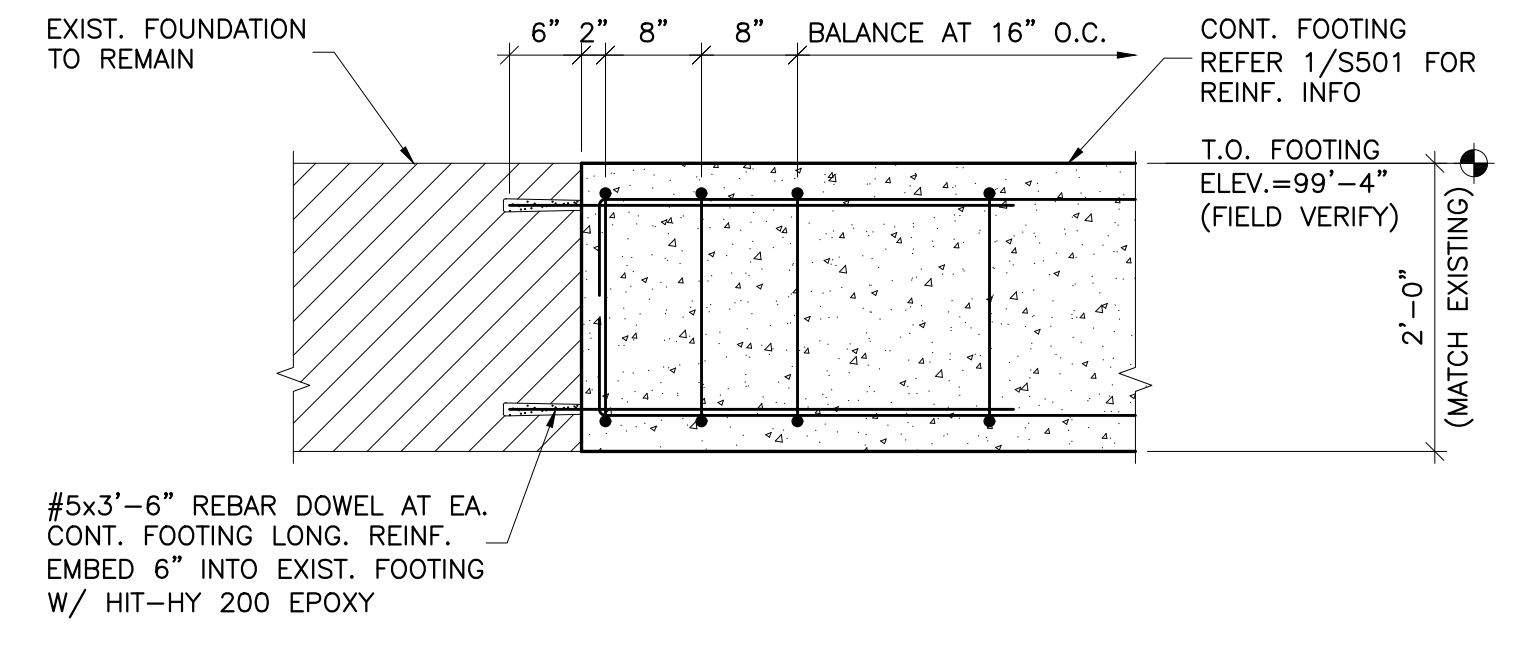


9 SECTION
S501 SCALE: 3/4"=1'-0"

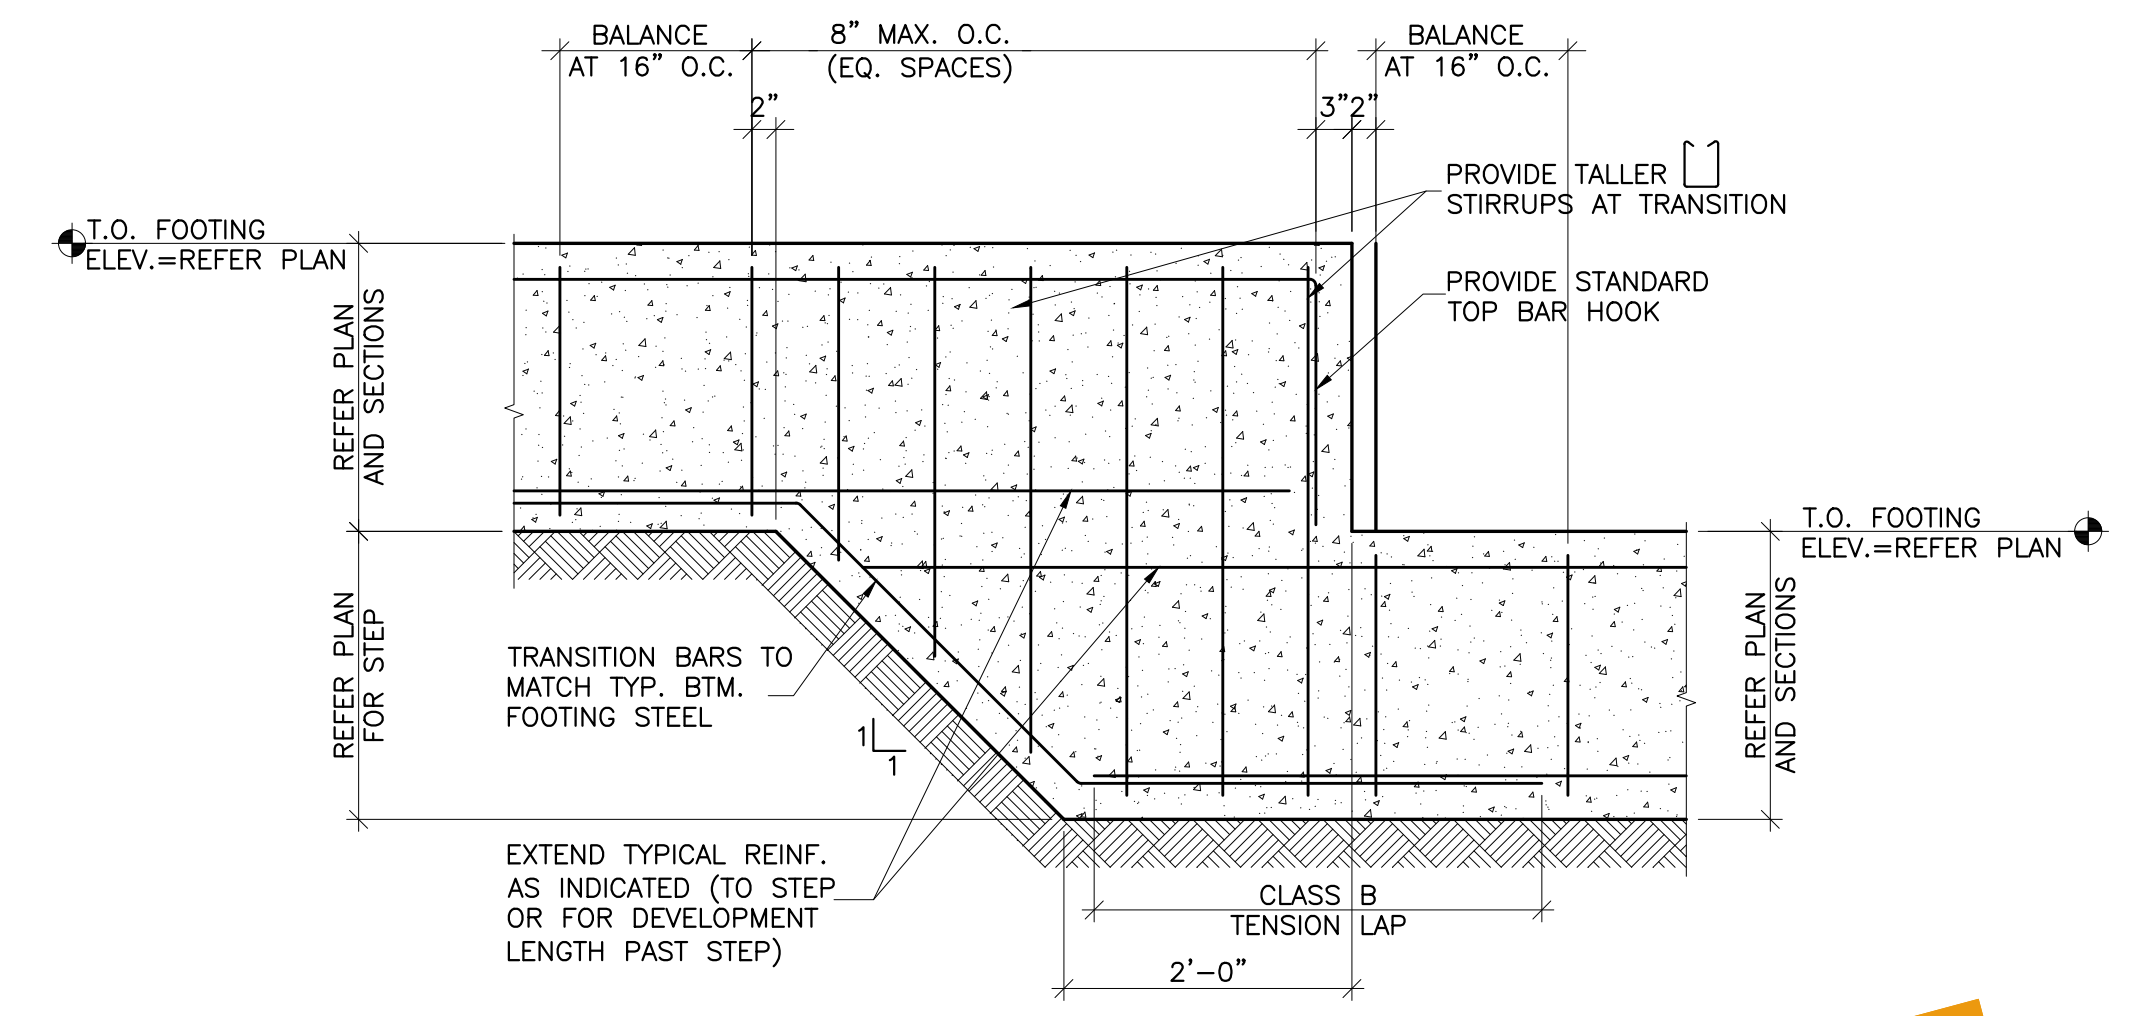


10 TYPICAL FOOTING STEP
S501 SCALE: 3/4"=1'-0"

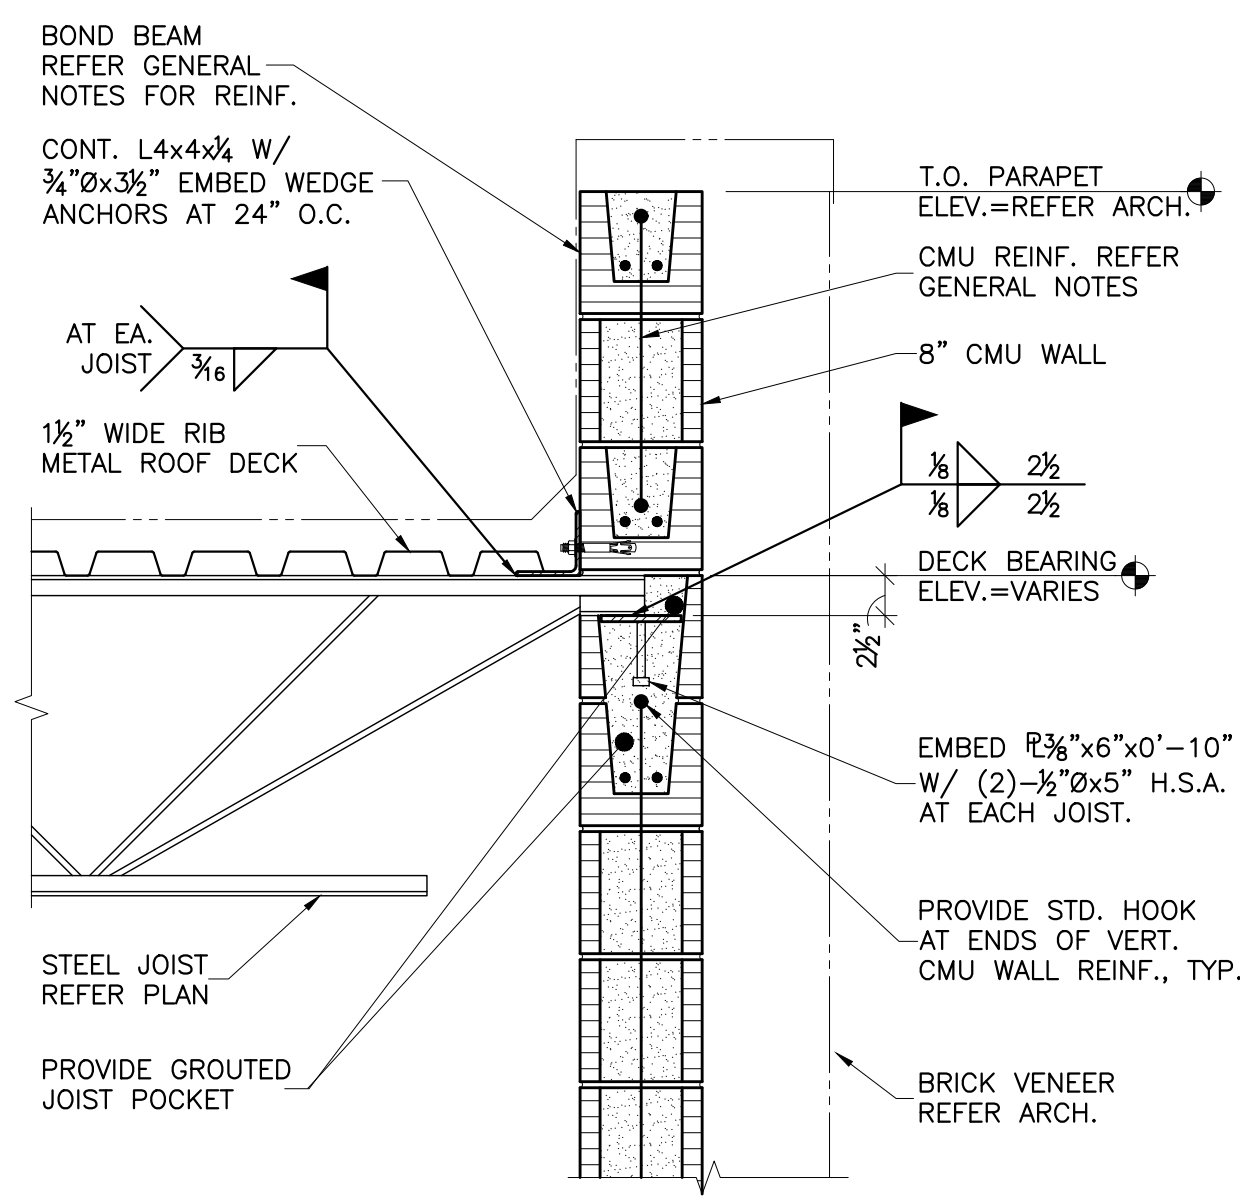


1 SECTION
S601 SCALE: 1"=1'-0"

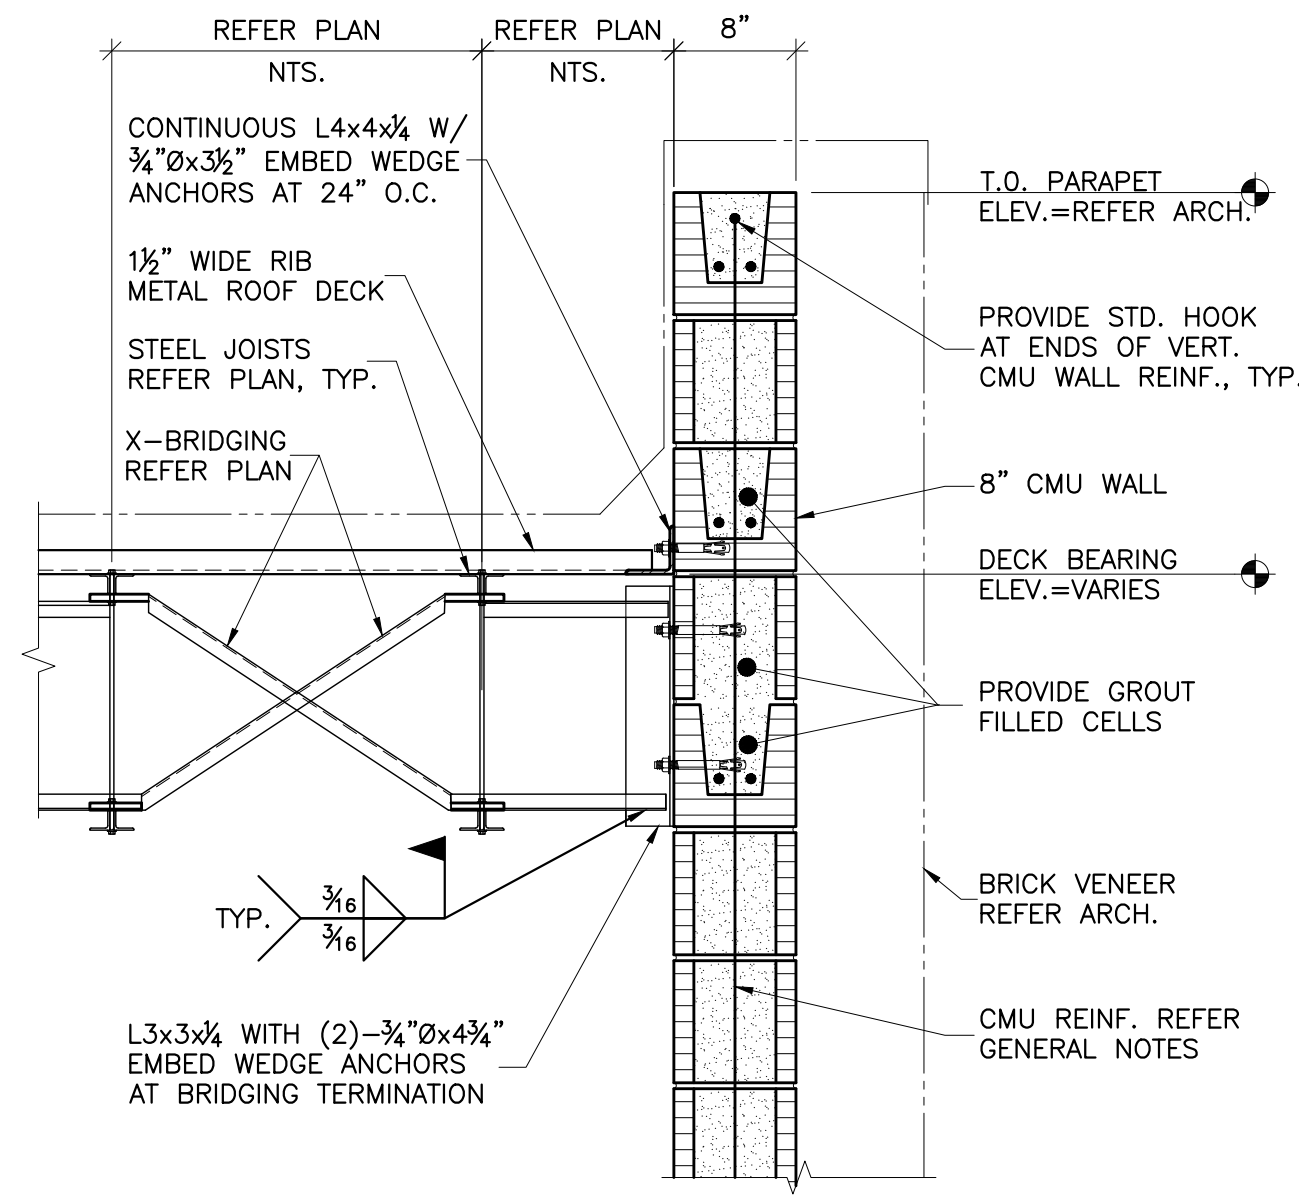


2 SECTION
S601 SCALE: 1"=1'-0"

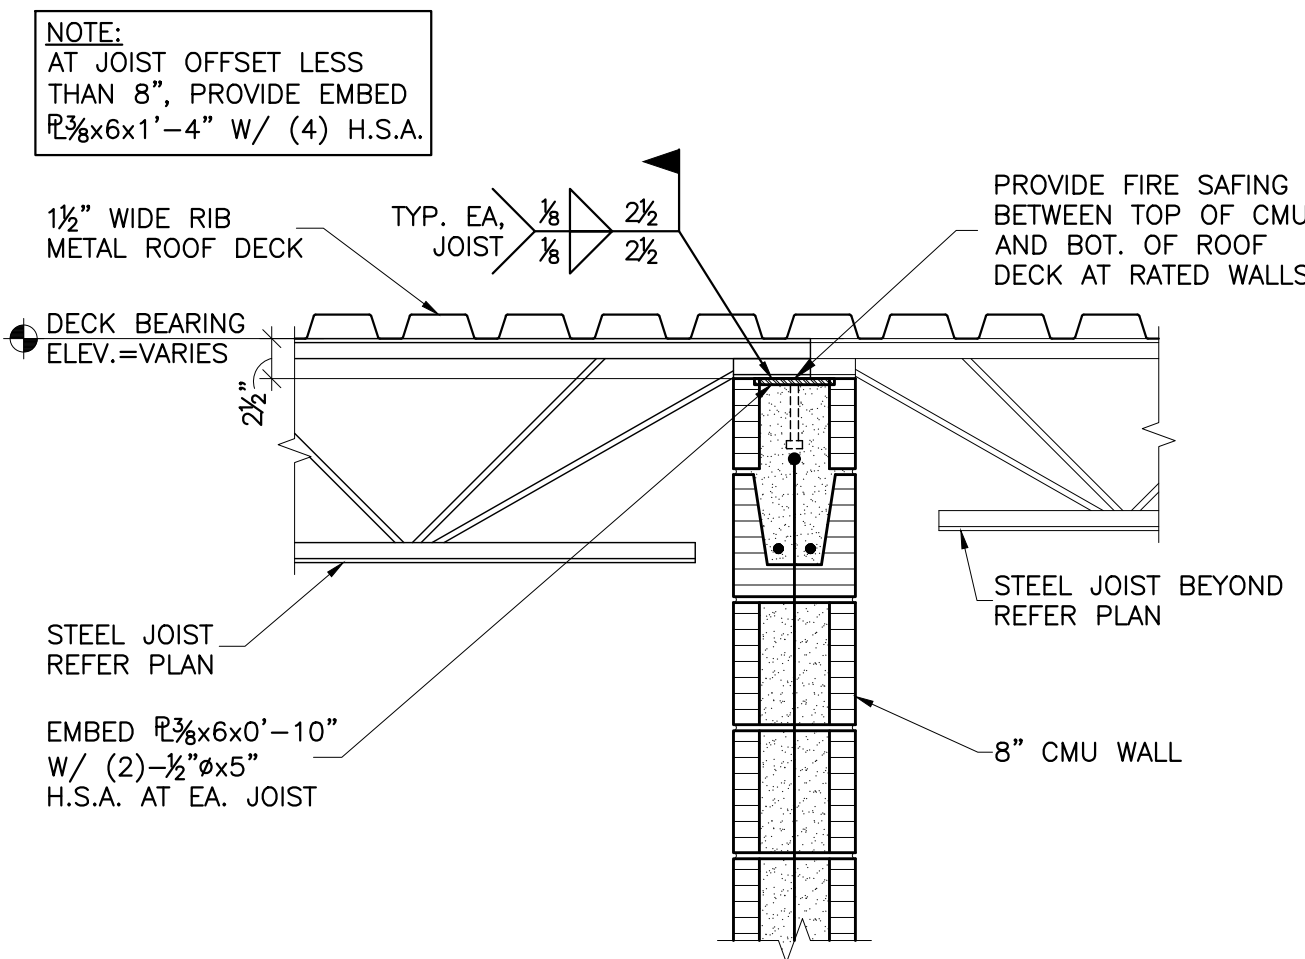


3 SECTION
S601 SCALE: 1"=1'-0"

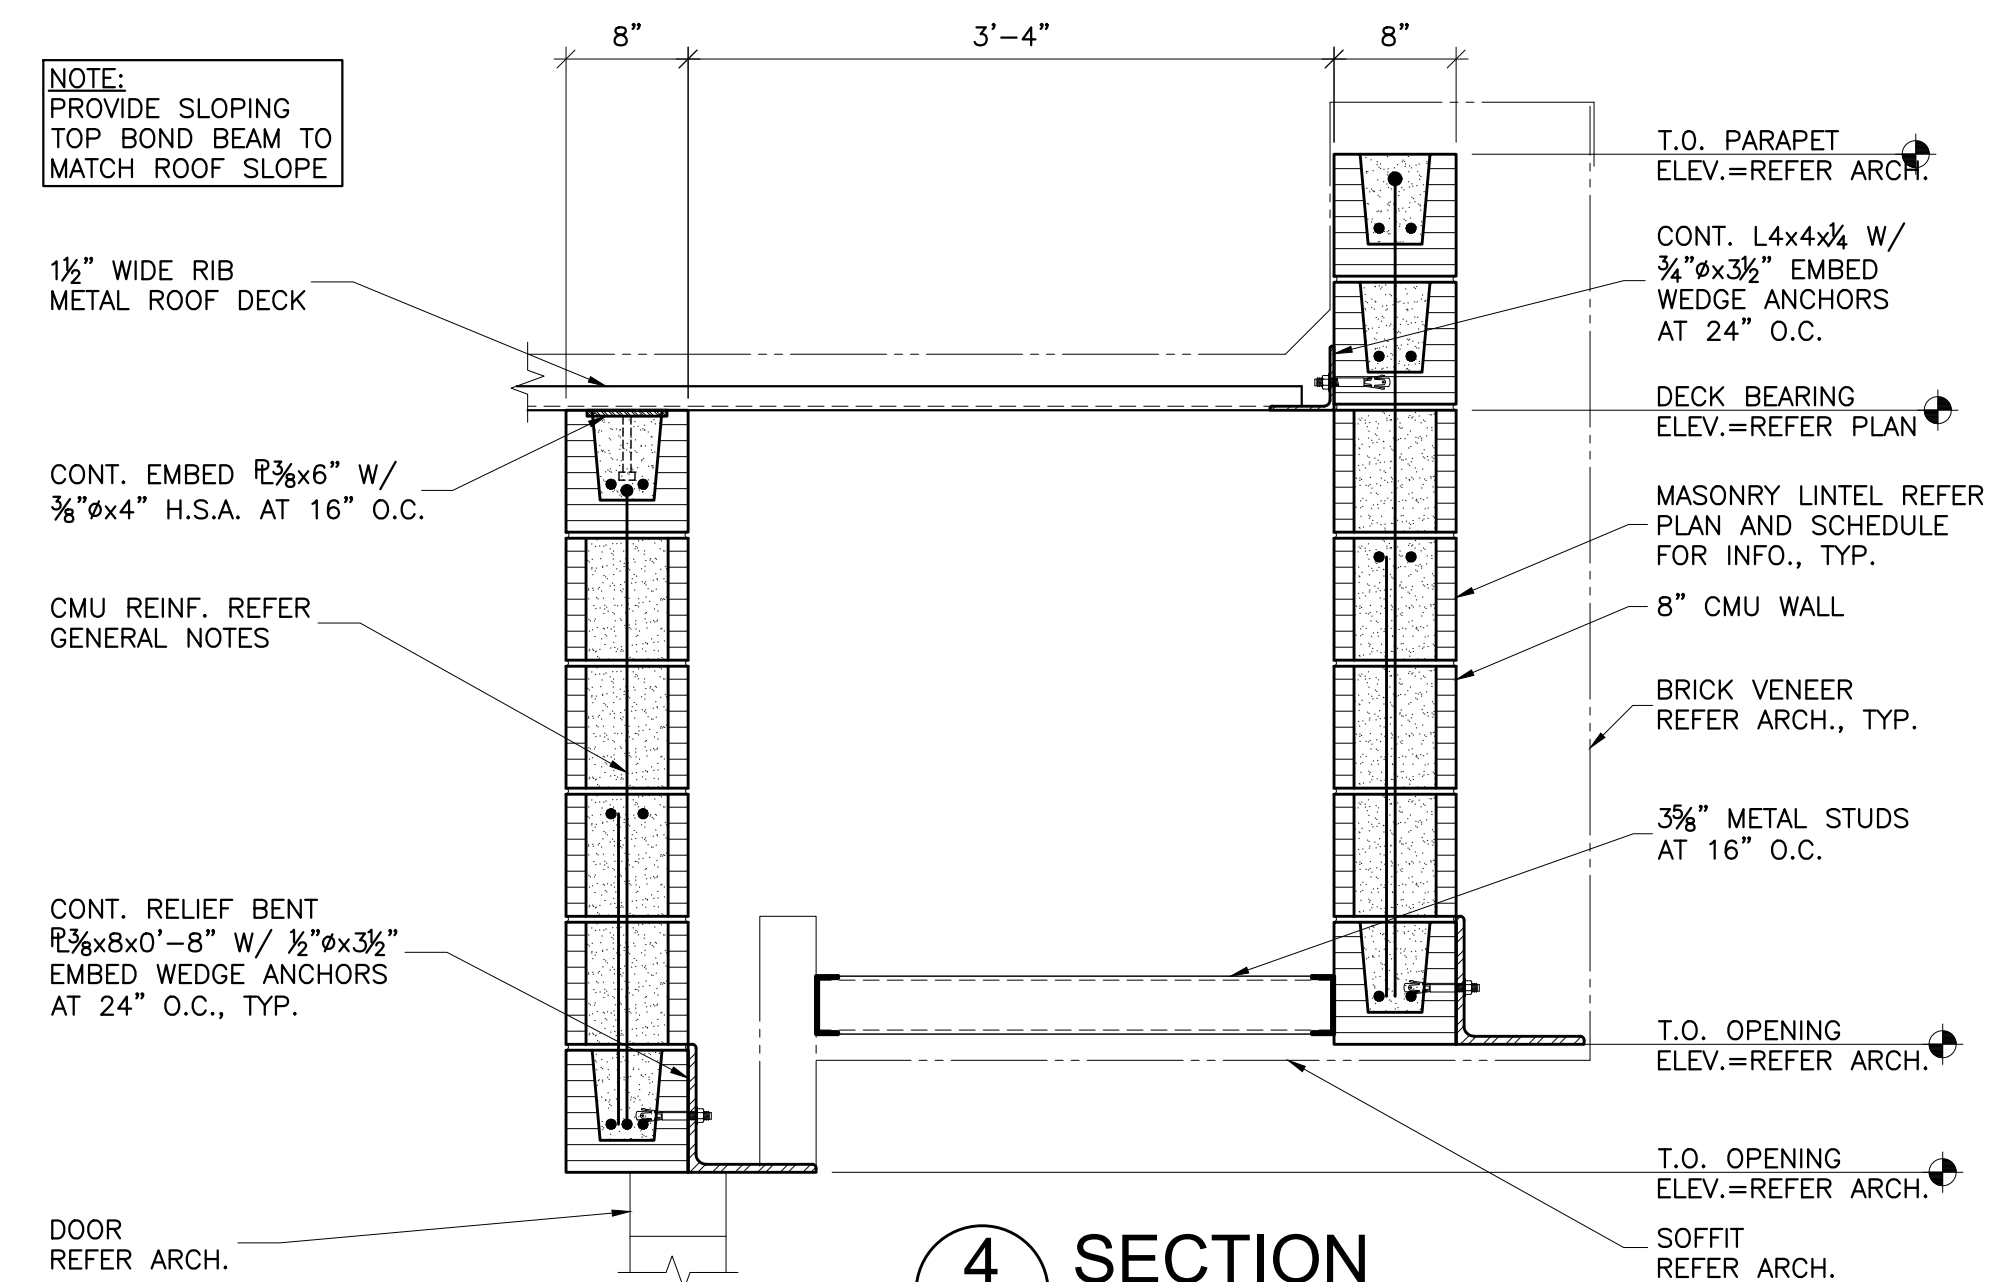


4 SECTION
S601 SCALE: 1"=1'-0"

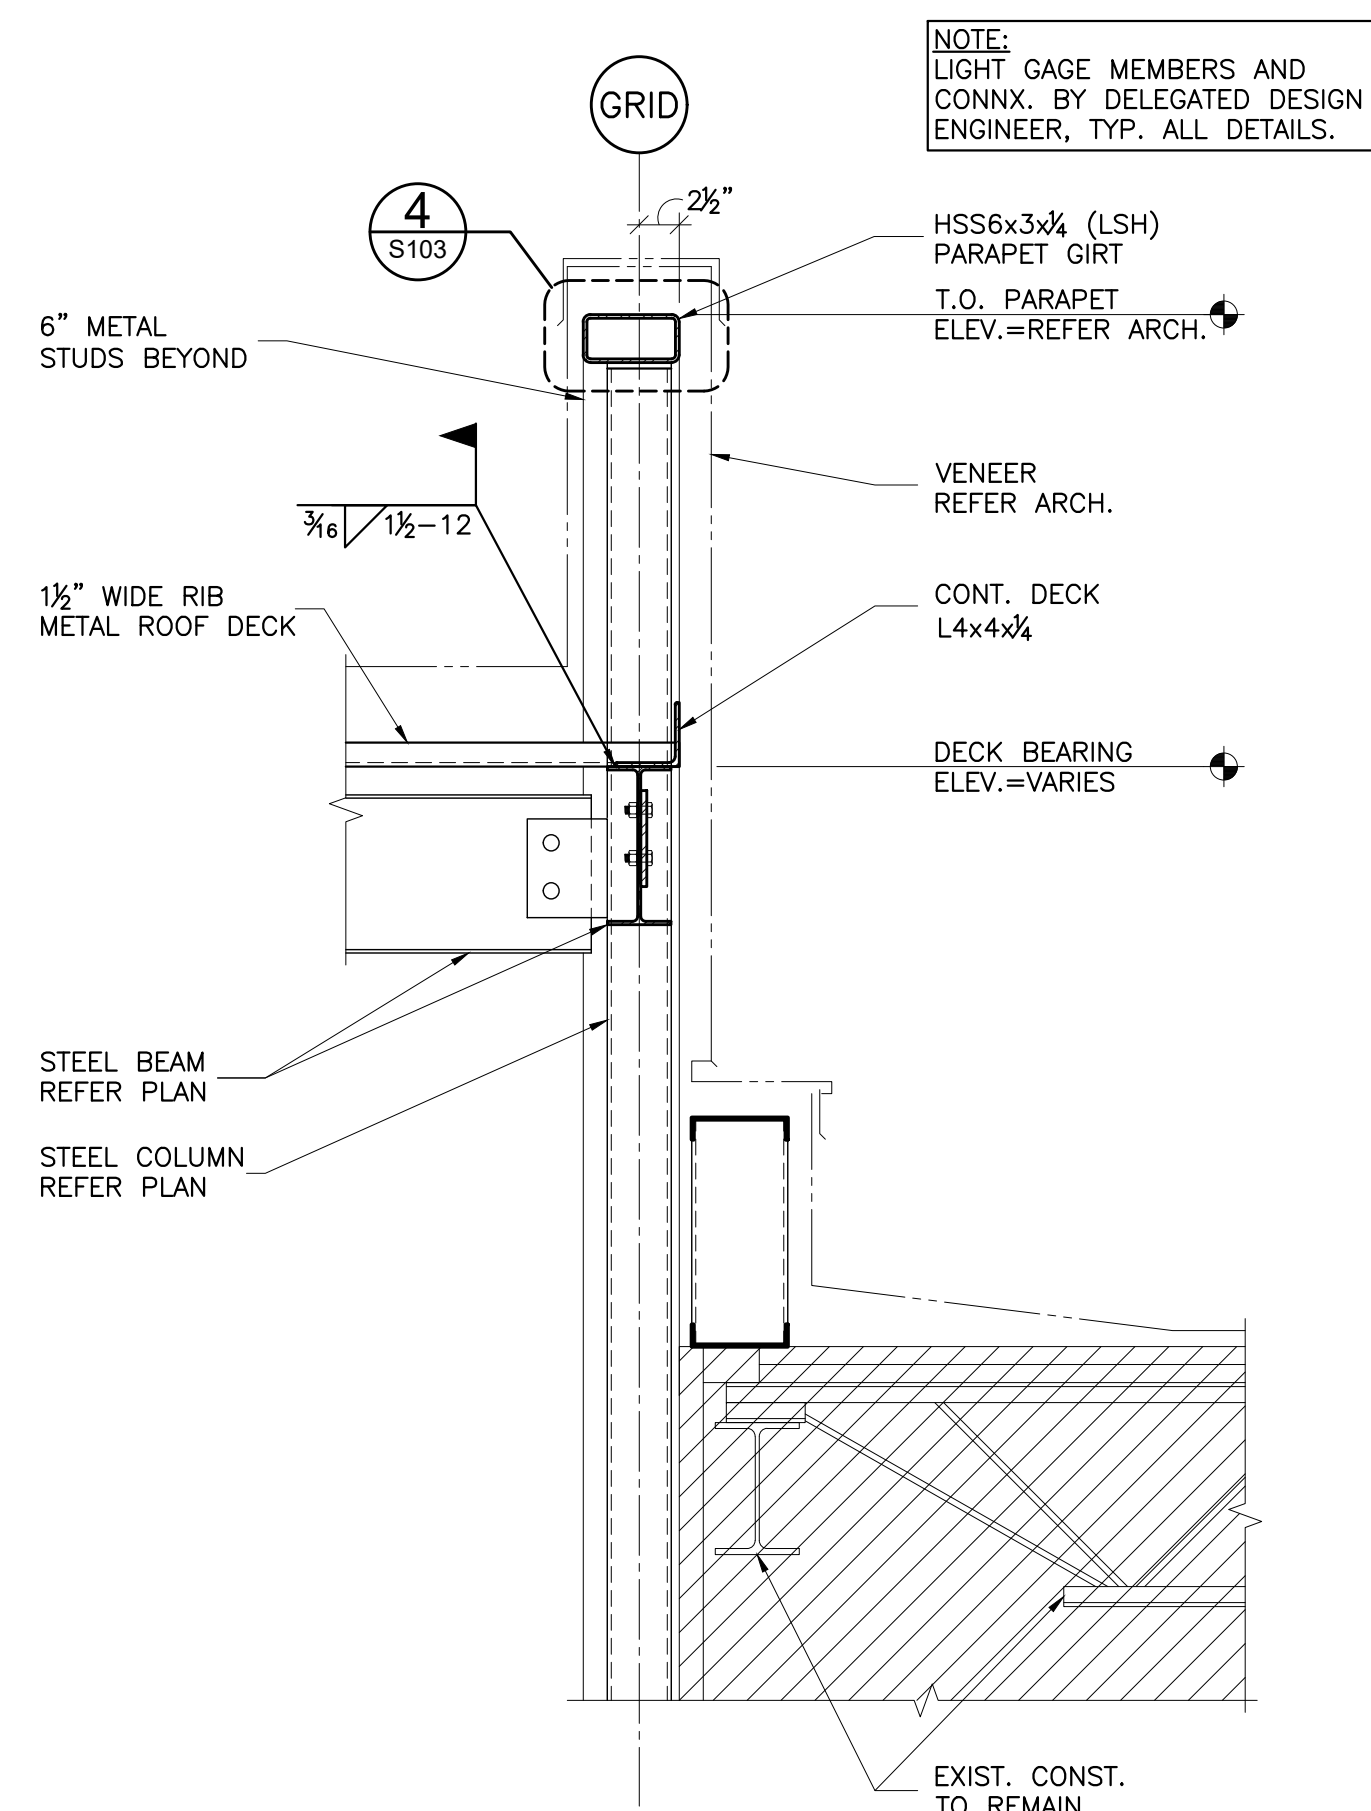

5 SECTION
S601 SCALE: 1"=1'-0"

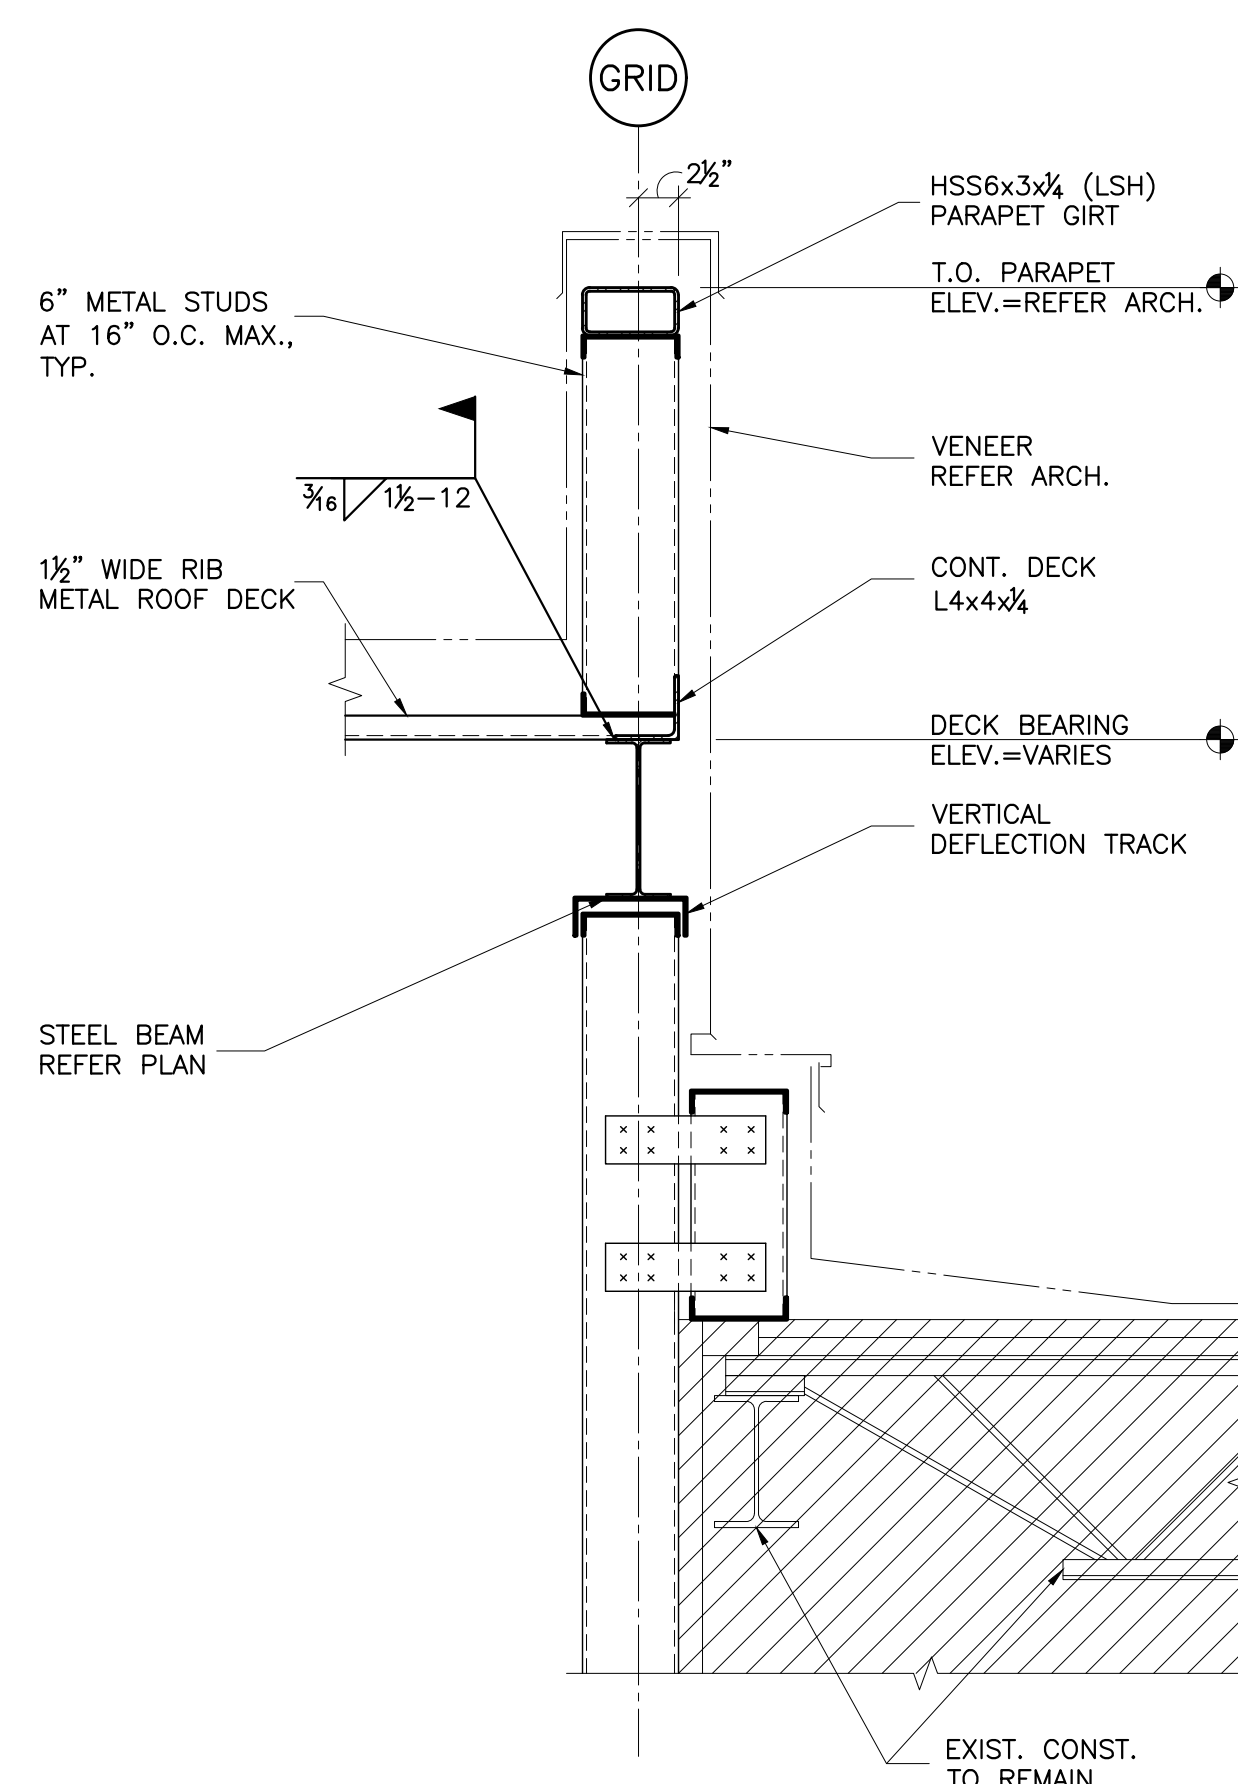

6 SECTION
S601 SCALE: 1"=1'-0"

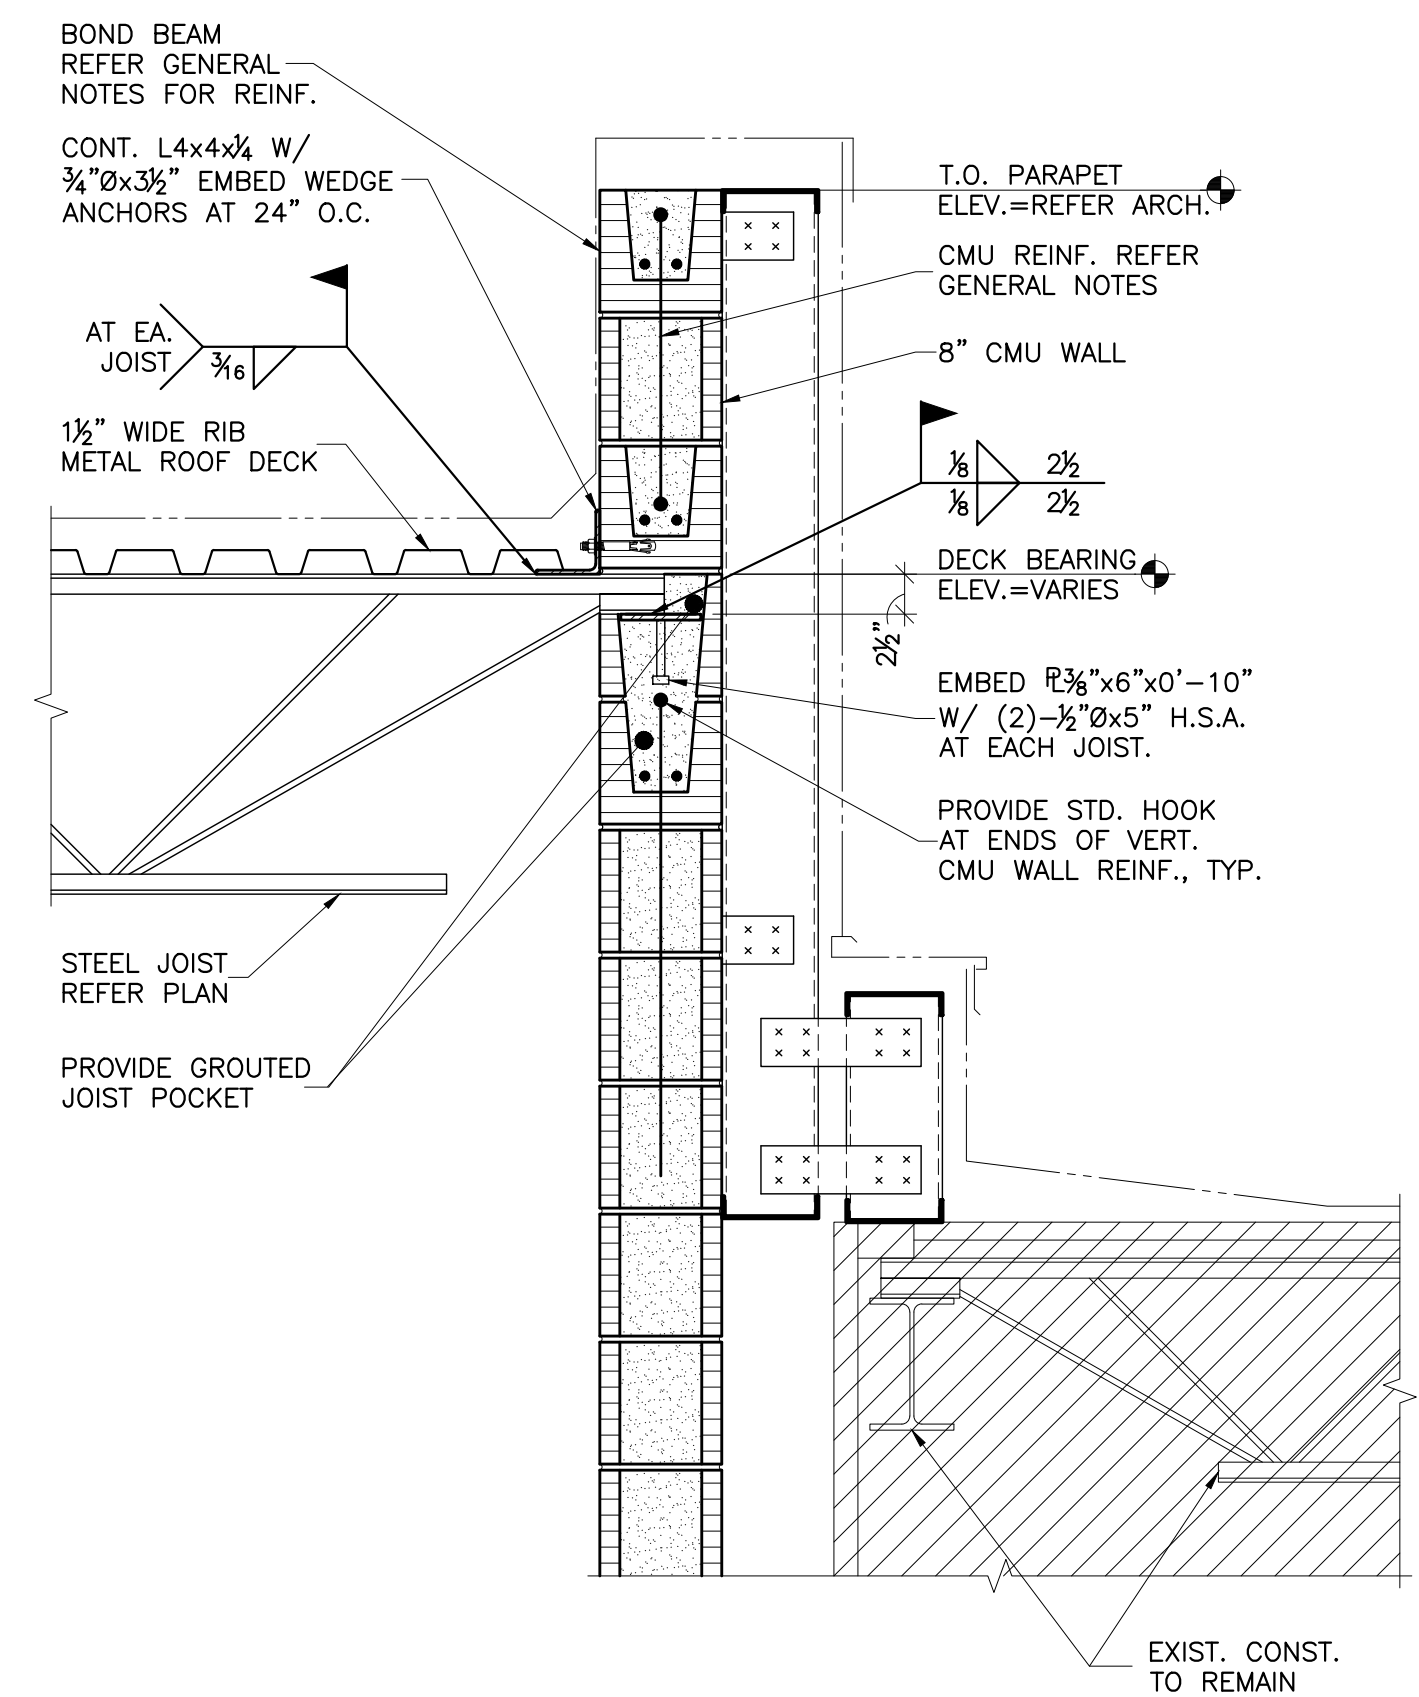

7 SECTION
S601 SCALE: 1"=1'-0"

CJC
drawn by

BWB
checked by

JULY 2023
date

revisions



sheet no:

S601



CJC

drawn by

BWB

checked by

JULY 2023

date


revisions




sheet no:

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

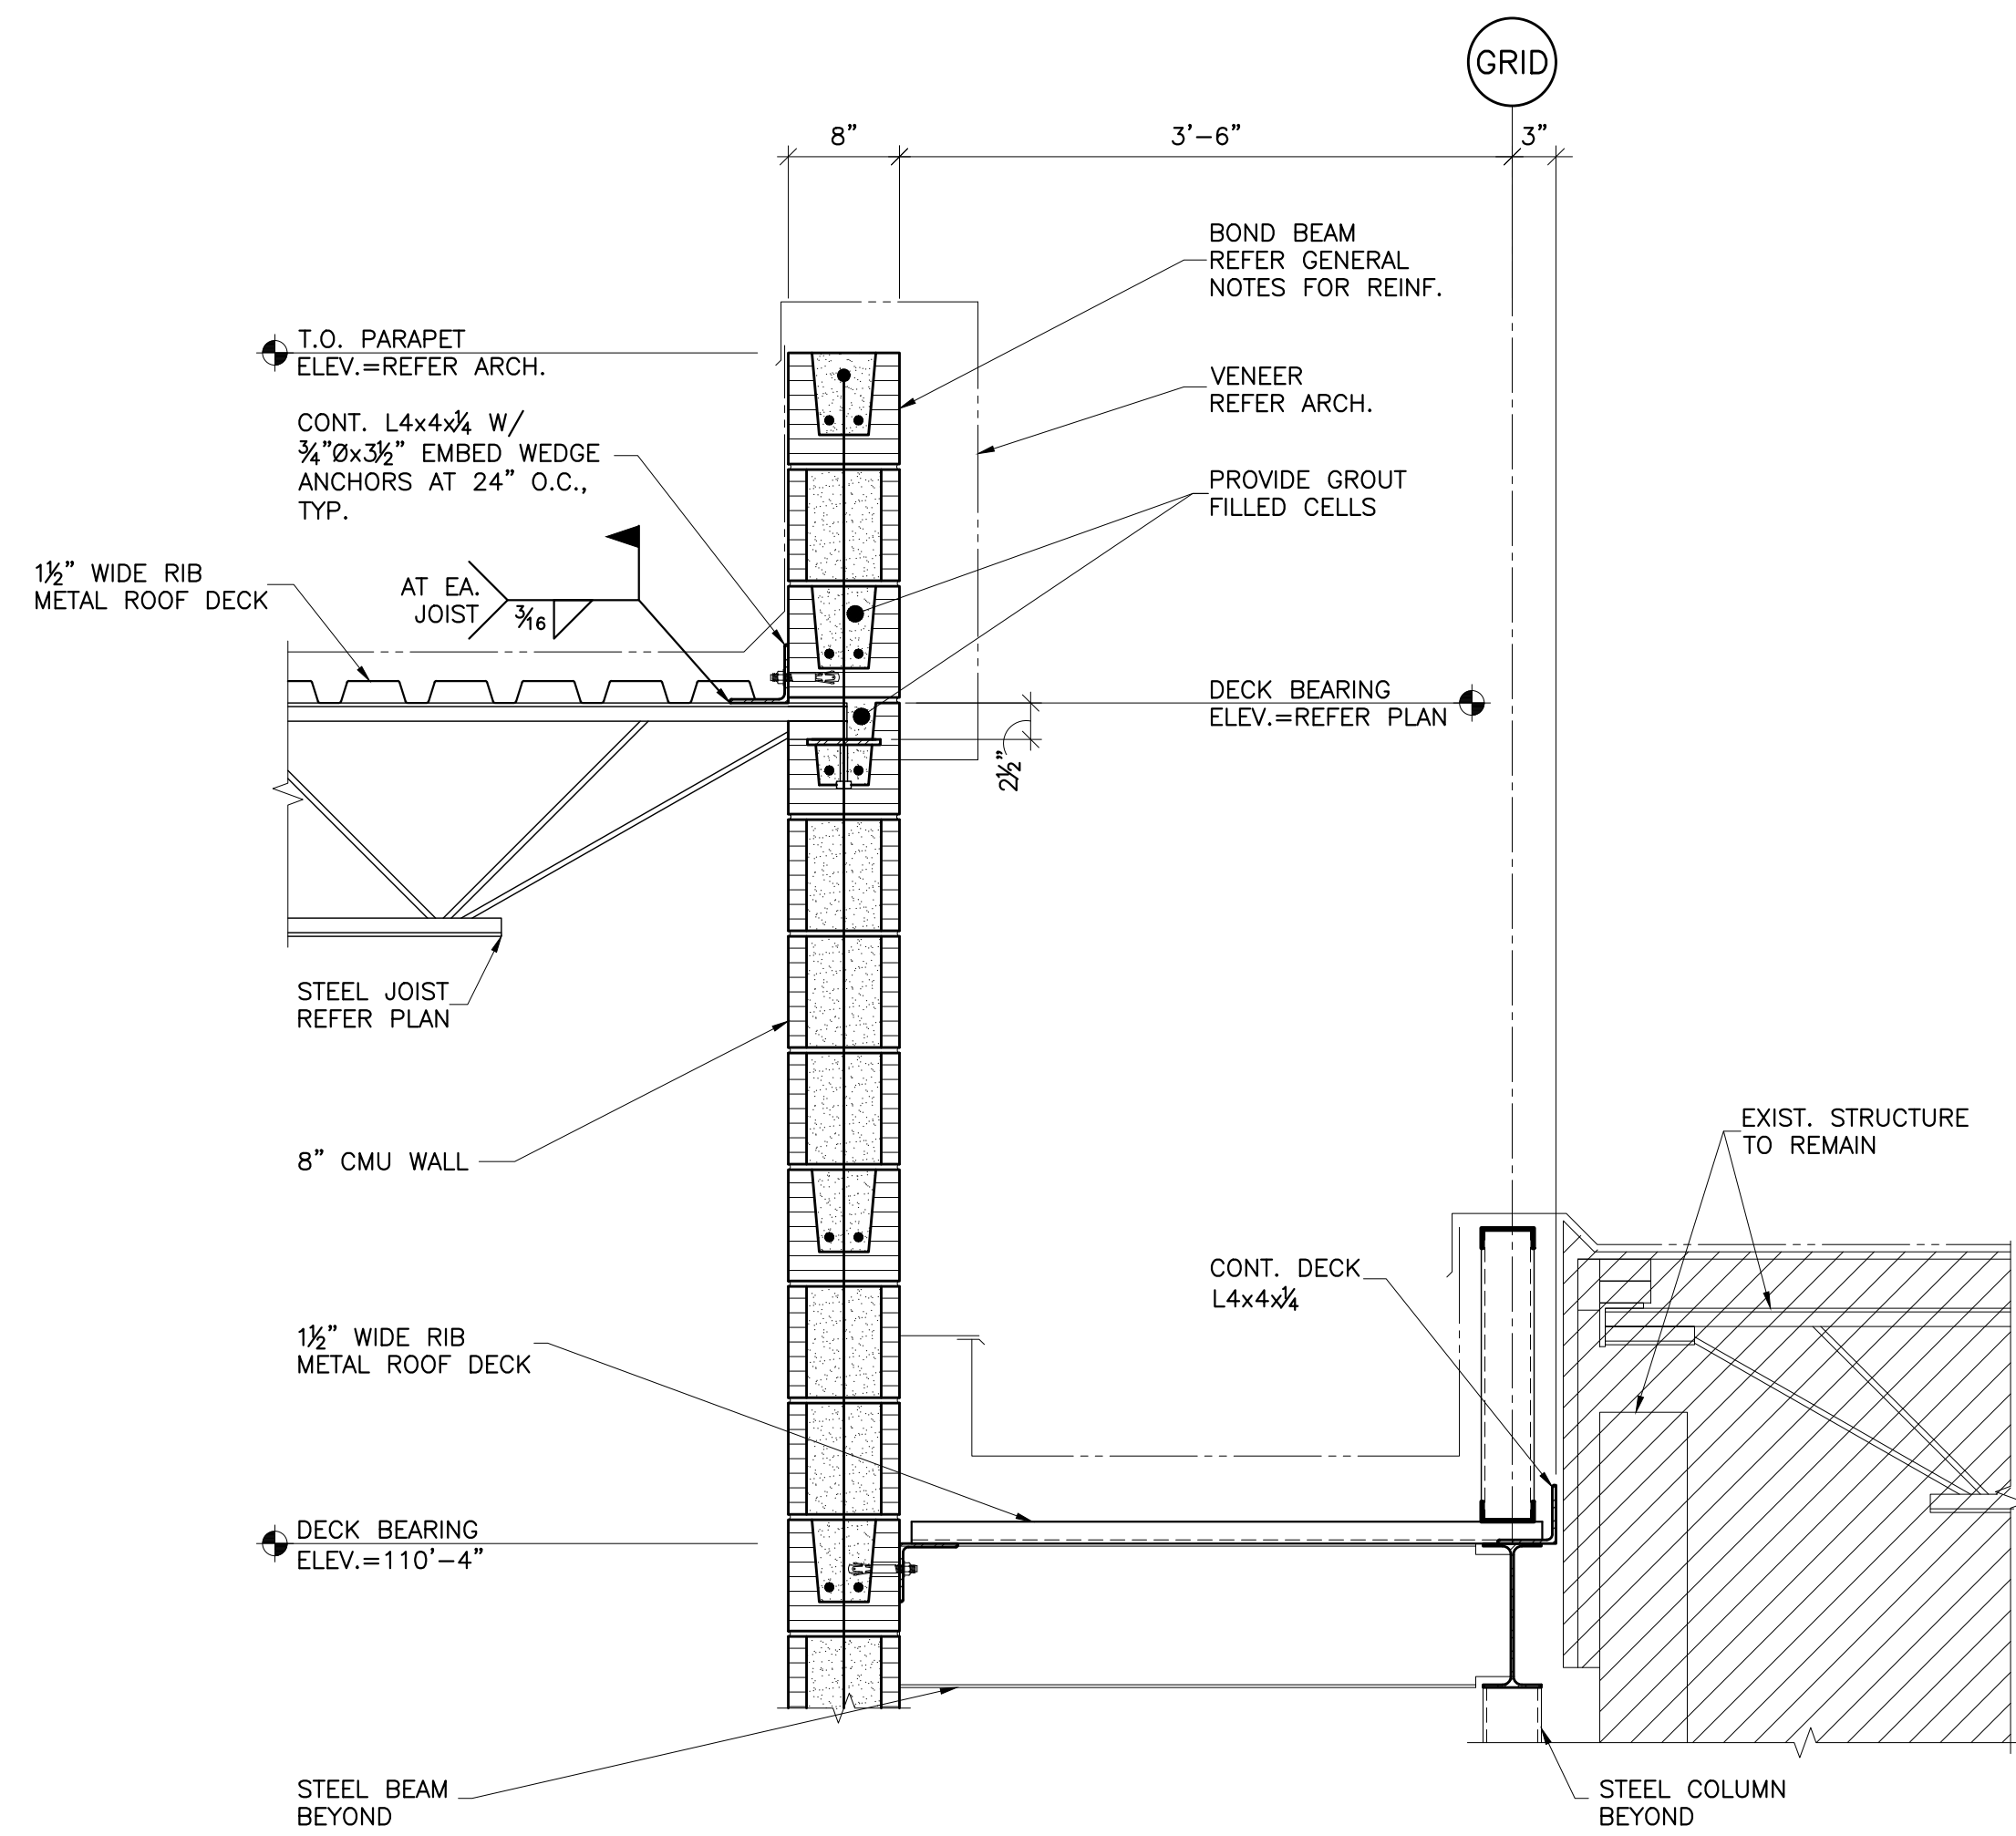


1 SECTION
S602 SCALE: 1"=1'-0"

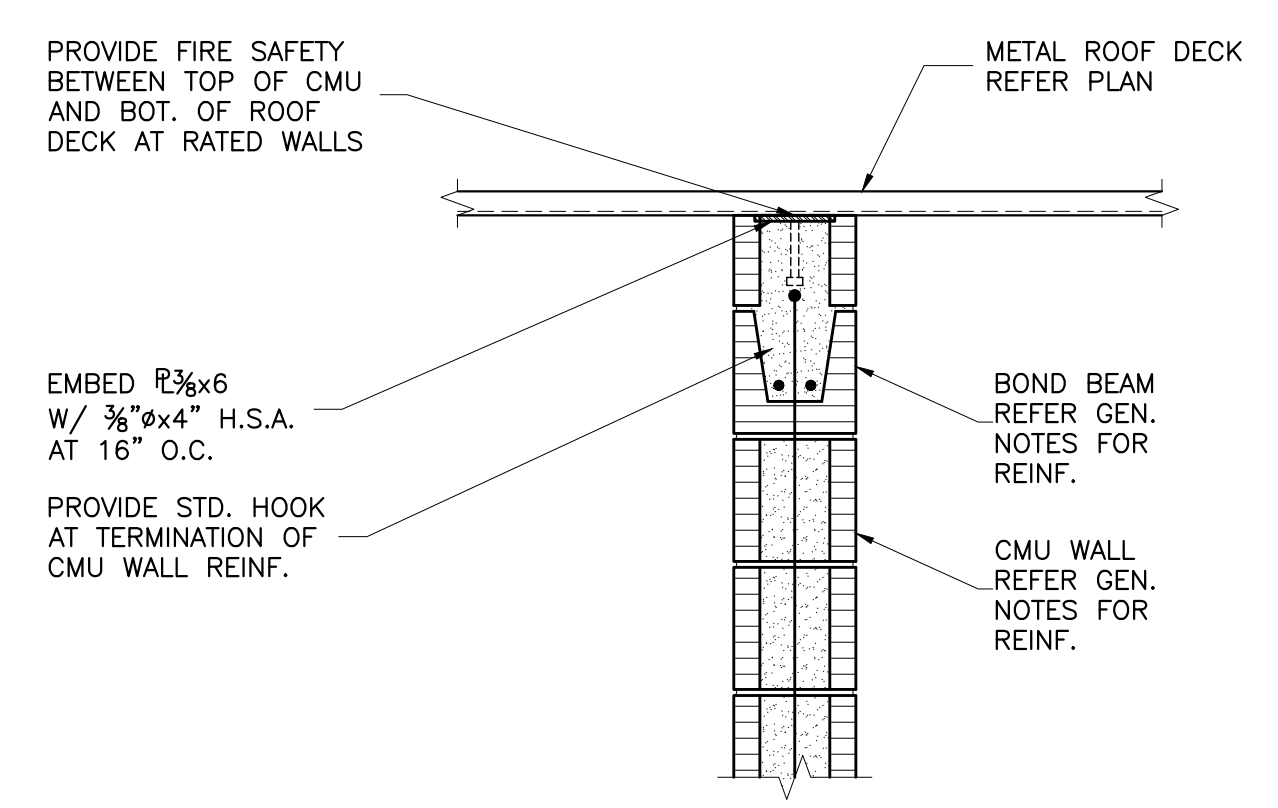


2 SECTION
S602 SCALE: 1"=1'-0"

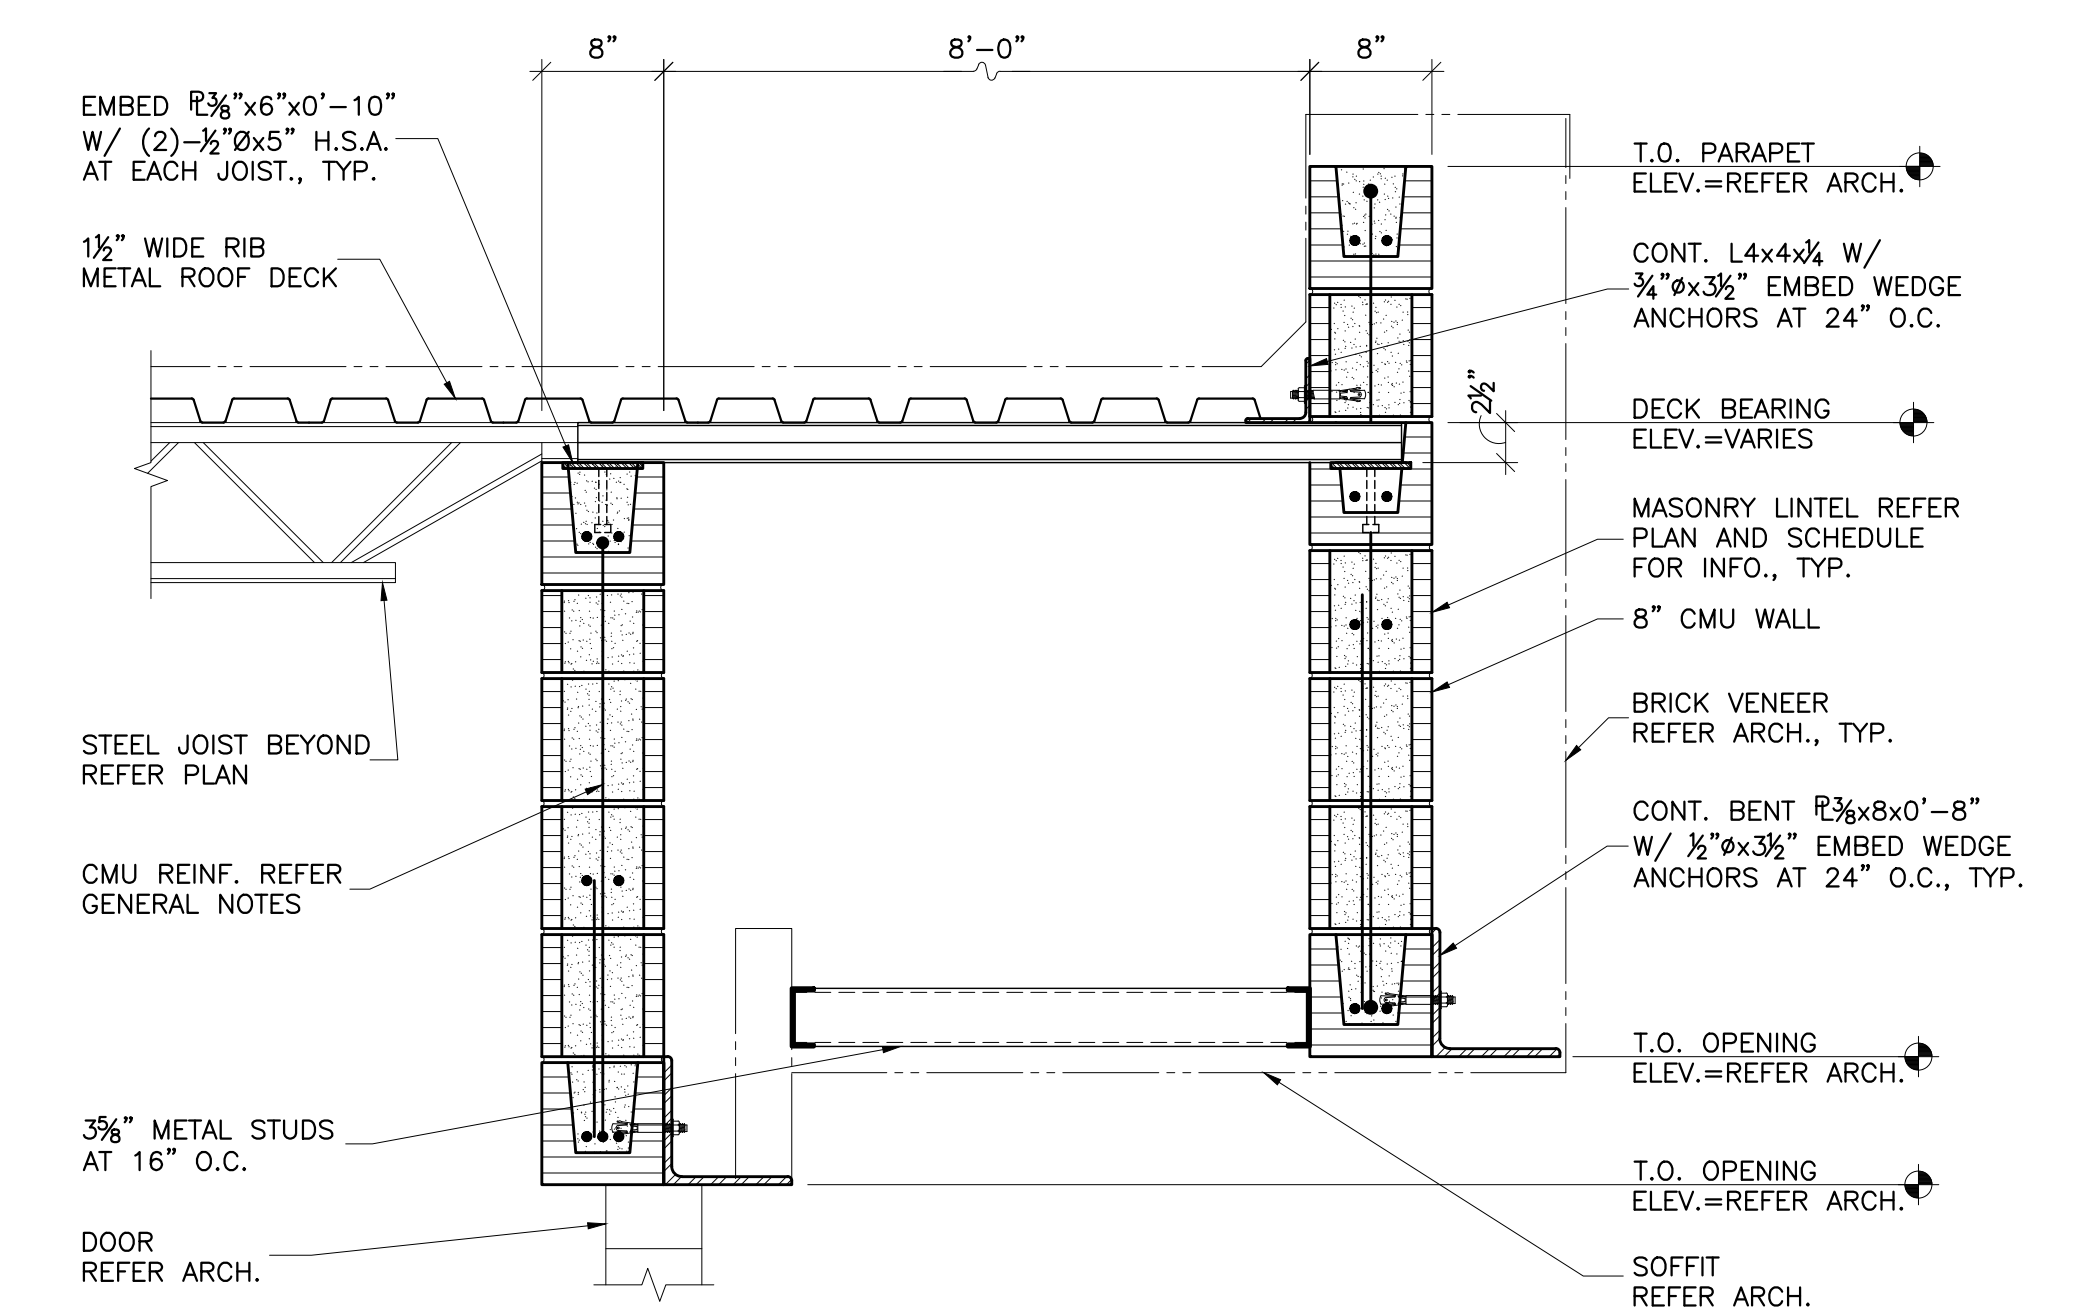


3 SECTION
S602 SCALE: 1"=1'-0"

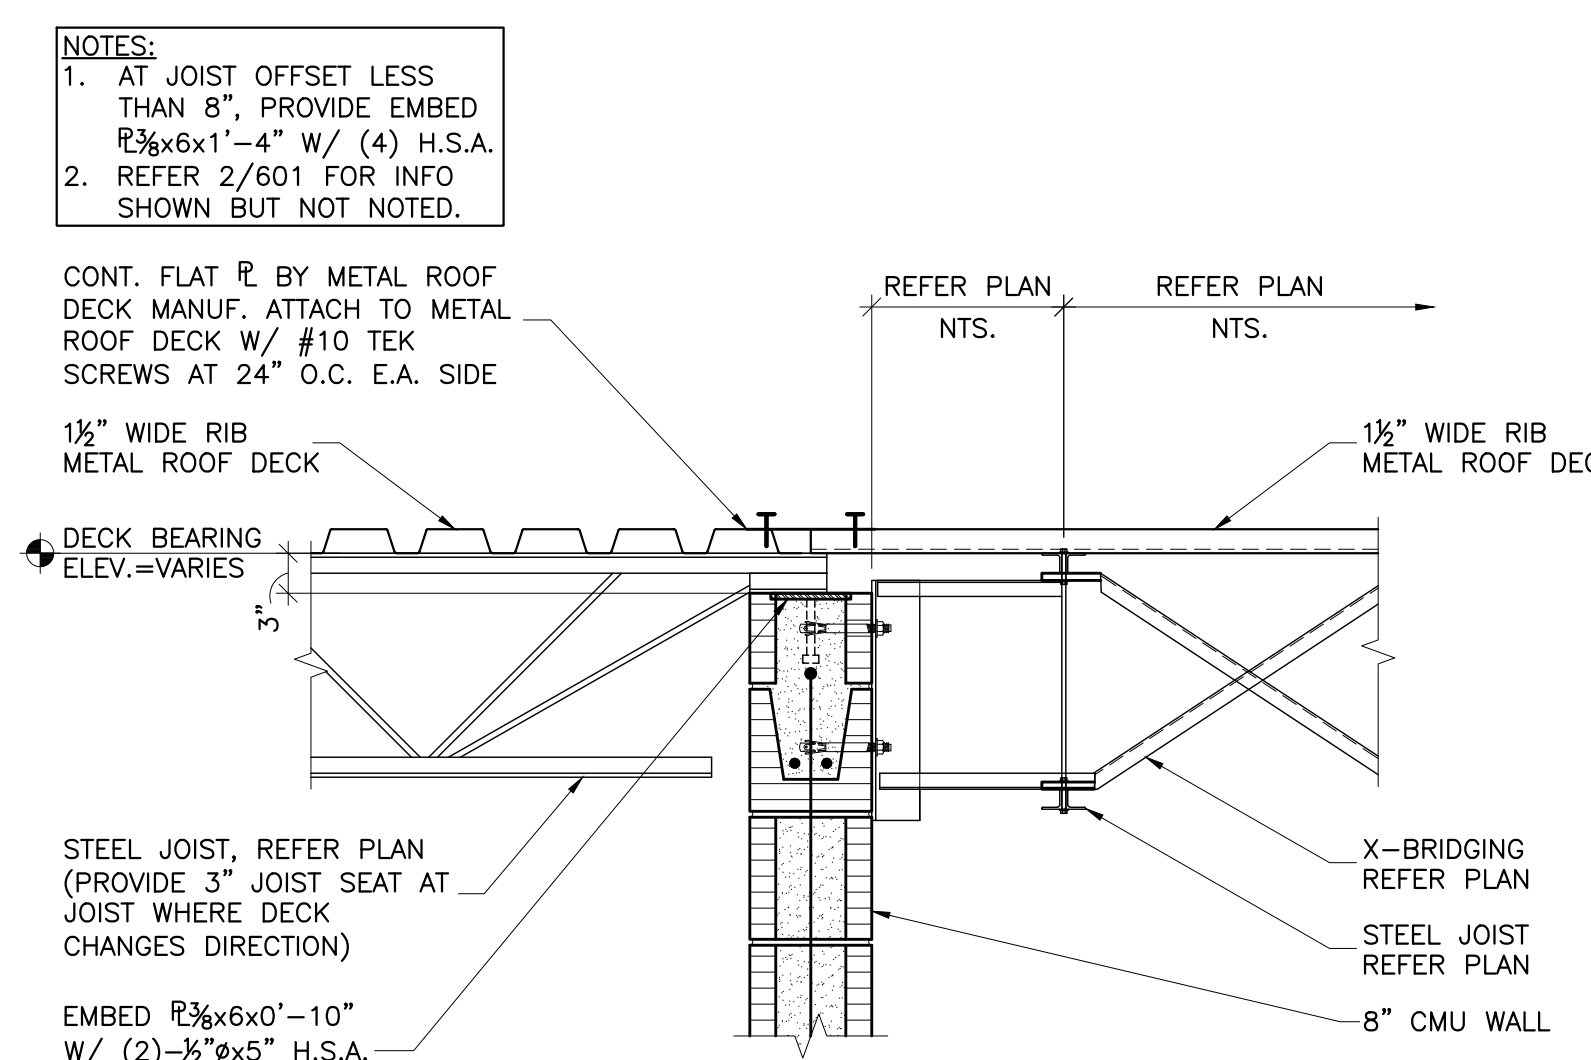

4 SECTION
S602 SCALE: 1"=1'-0"

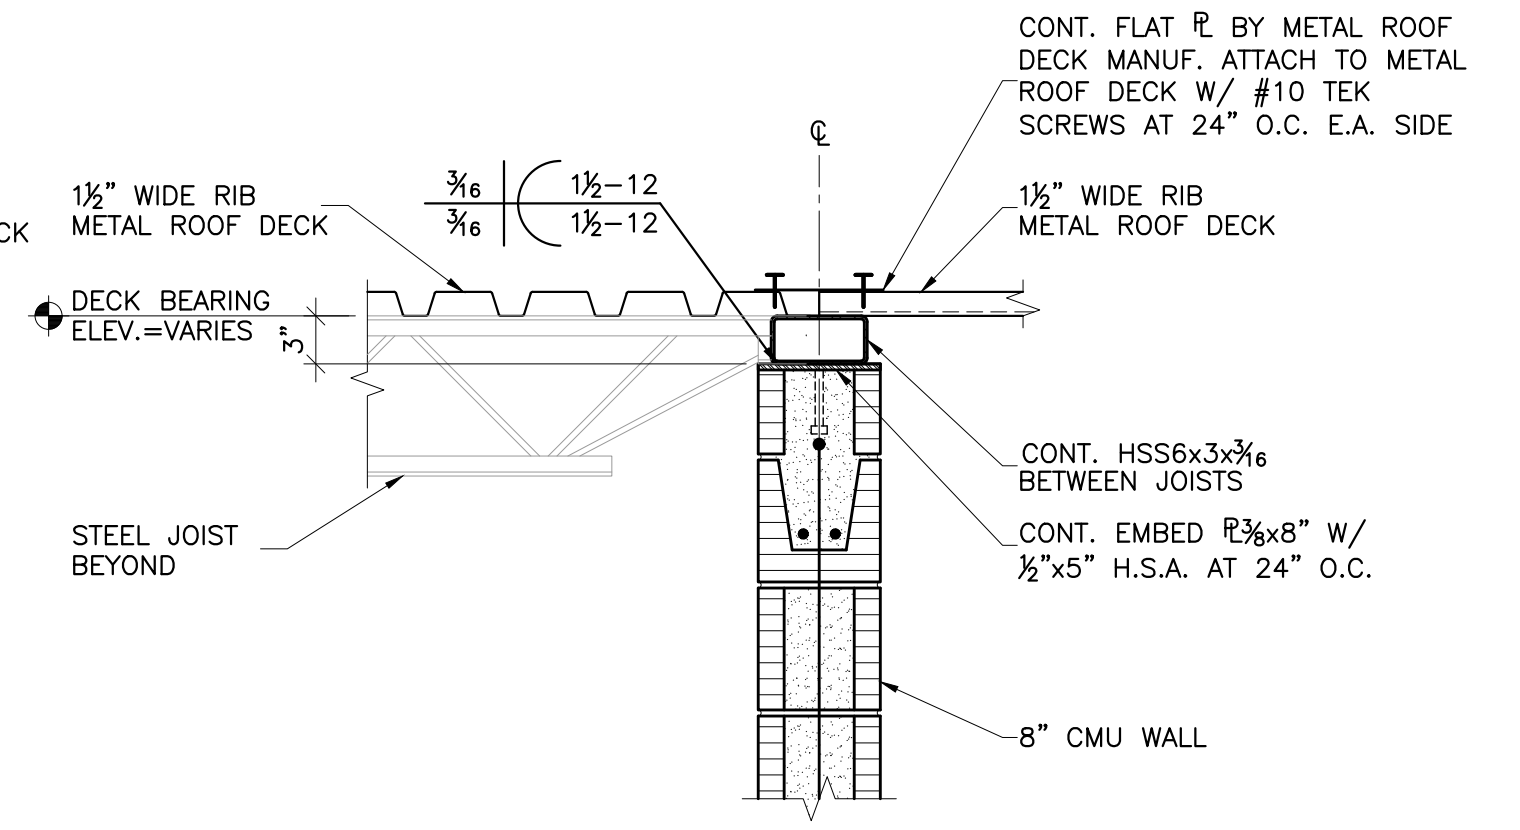


5 SECTION
S602 SCALE: 1"=1'-0"

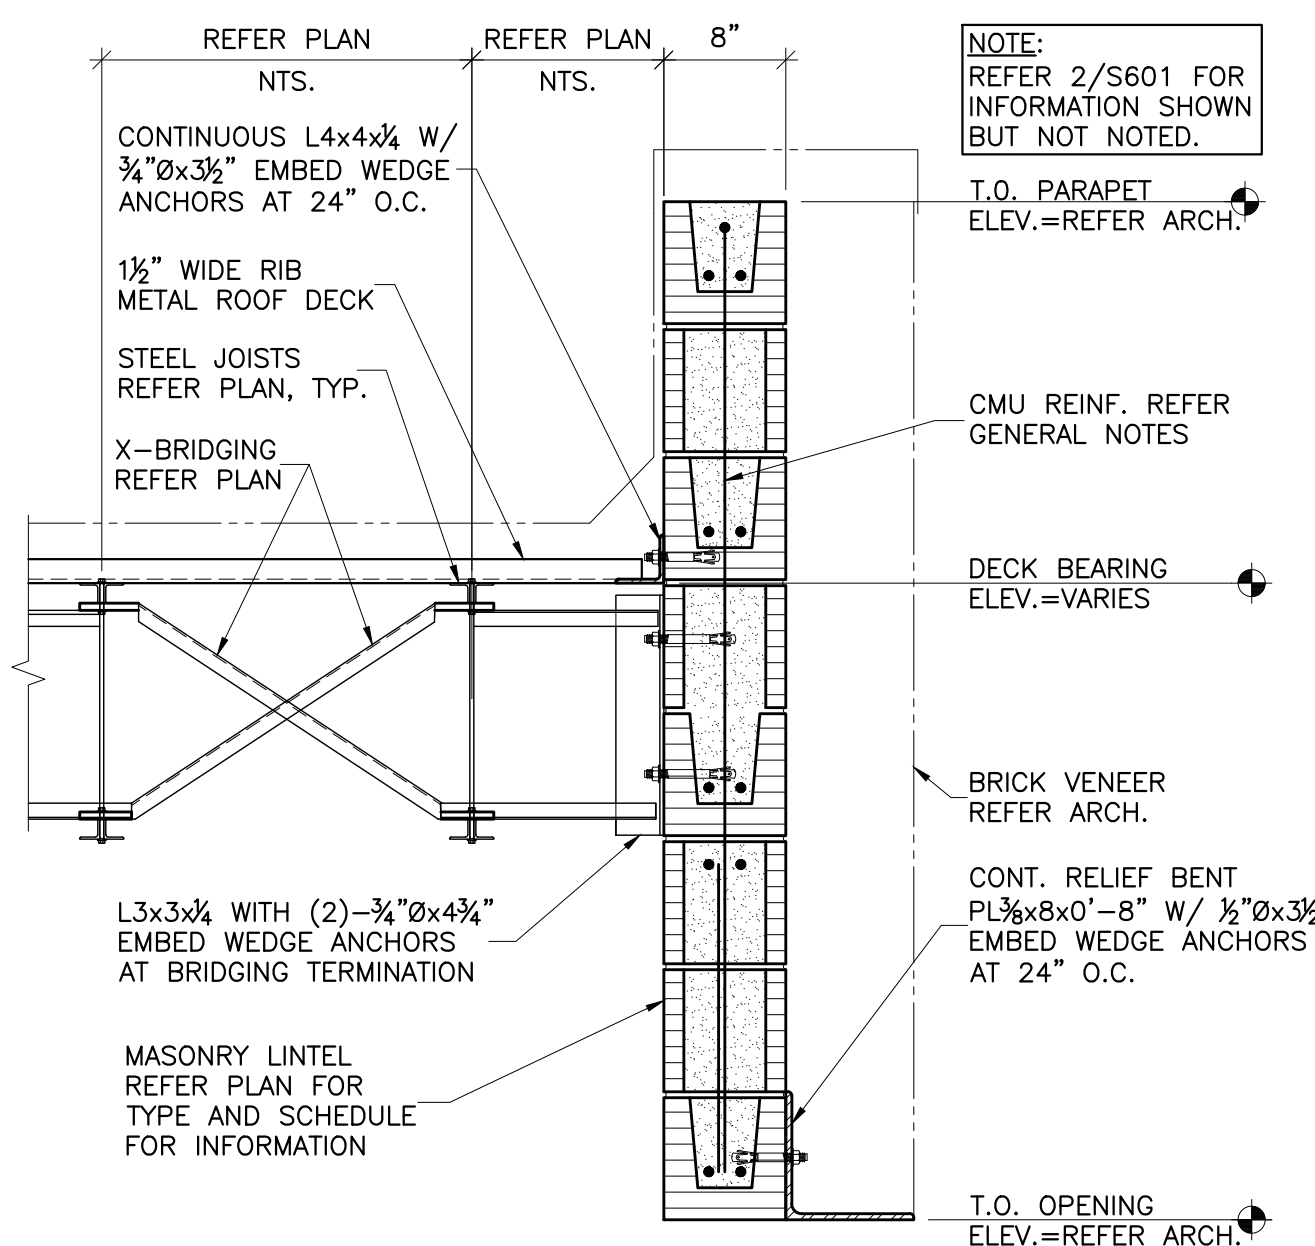


6 SECTION
S602 SCALE: 1"=1'-0"

NOTES:
1. AT JOIST OFFSET LESS THAN 8", PROVIDE EMBED $\#3/8 \times 6 \times 1'-4"$ W/ (4) H.S.A.
2. REFER 2/601 FOR INFO SHOWN BUT NOT NOTED.

NOTE:
REFER 2/S601 FOR INFORMATION SHOWN BUT NOT NOTED.

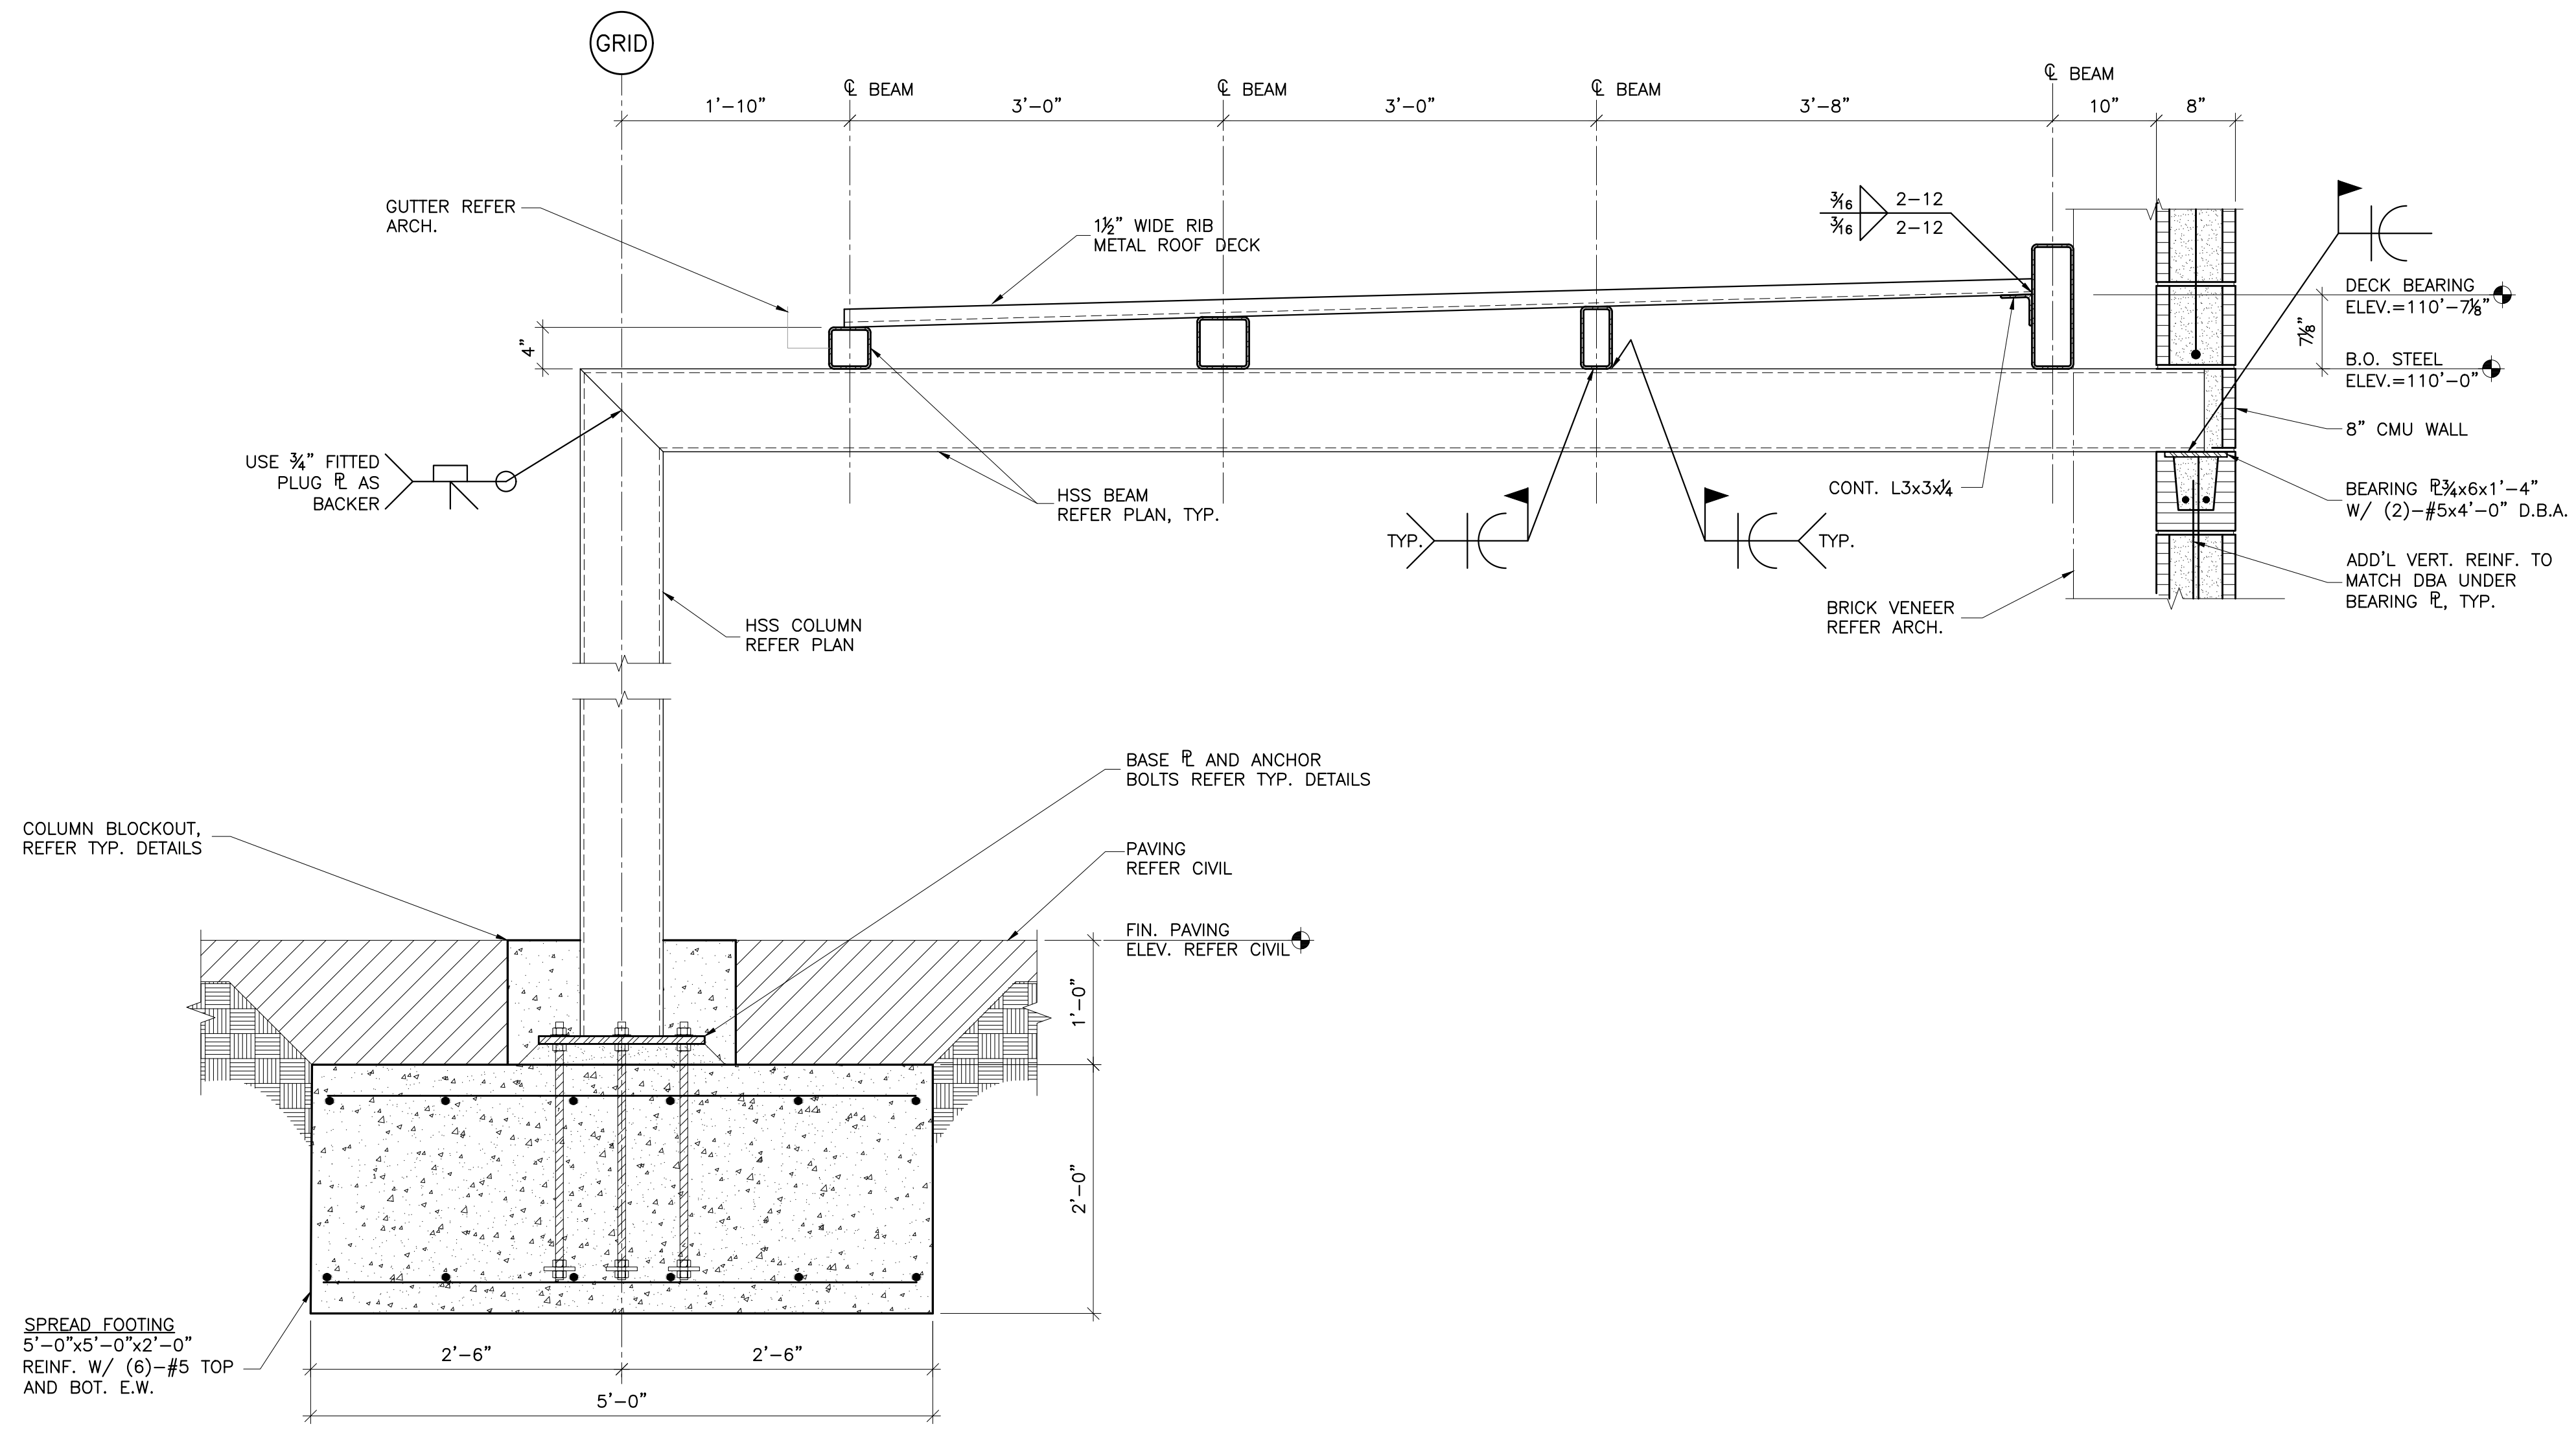

1 SECTION
S603 SCALE: 1"=1'-0"

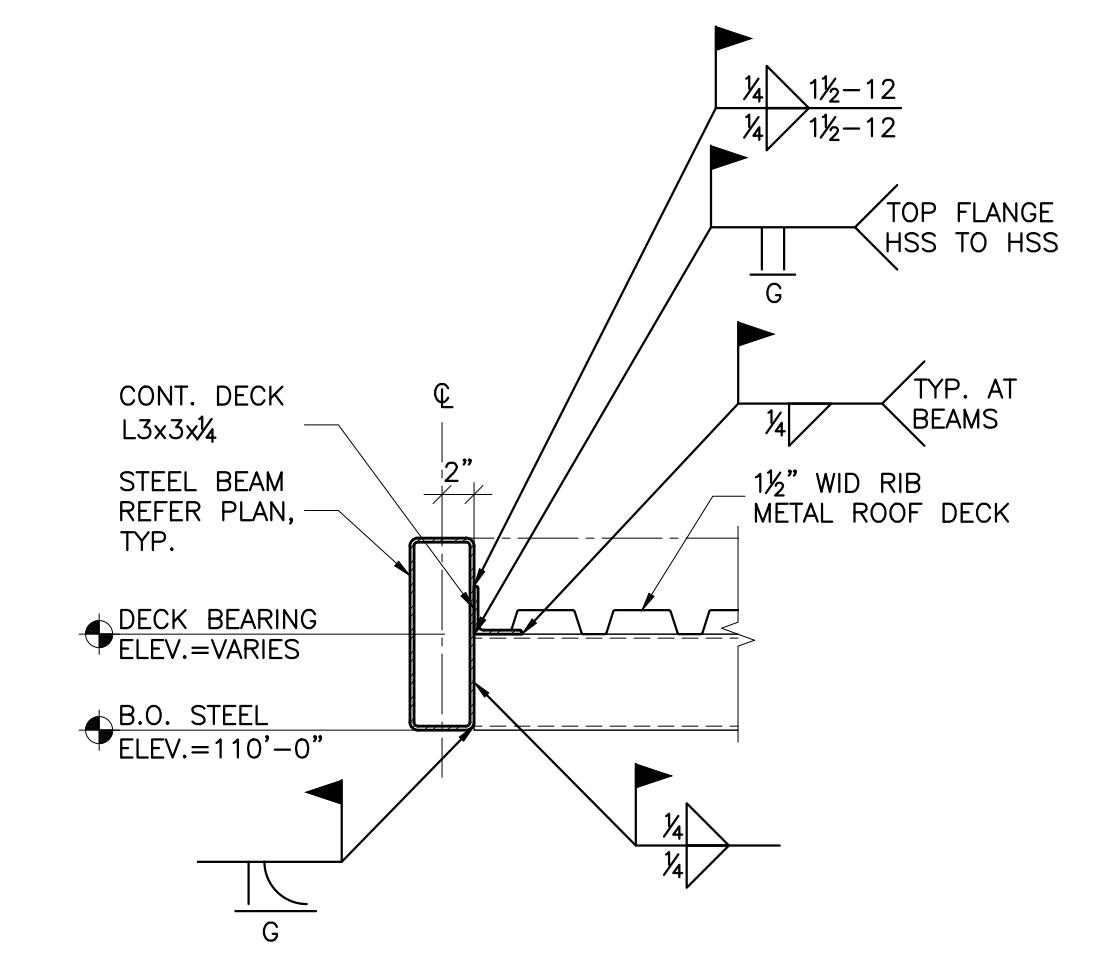

2 SECTION
S603 SCALE: 1"=1'-0"

| | |
|-----------|------------|
| CJC | drawn by |
| BWB | checked by |
| JULY 2023 | date |
| | revisions |

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



CLASSROOM ADDITION
HIGHLAND WEST
JUNIOR HIGH SCHOOL

sheet no:

S603

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

