
BIDDING INSTRUCTIONS & FORMS

Kingsgate Elementary HVAC Replacement
1400 Kingsgate Road
Oklahoma City, OK 73159

OMNI CONSTRUCTION
1909 S Eastern Ave Moore, OK 73160

TABLE OF CONTENTS

Kingsgate Elementary HVAC Replacement

Division 0	Bidding Instructions and Forms	Page 2
Document 100	Solicitation for Bids (State of Oklahoma Form)	Page 3
Document 200	Instructions to Bidders	Page 4
	1) Solicitation	Page 5
	2) Bid Documents and Contracts Documents	Page 6
	3) Site Assessment	Page 7
	4) Qualifications	Page 8
	5) Bid Submissions	Page 8
	6) Bid Enclosure/Requirements	Page 9
	7) Offer Acceptance/Rejection	Page 10
Document 300	Bid Forms	Page 11
	1) General Bid Form	Page 11
	2) Non-Collusion Affidavit	Page 13
	3) Non-Kickback Affidavit	Page 14
	4) Non-Asbestos Affidavit	Page 15
	5) Non-Sex Offender Affidavit	Page 16
	6) Business Relationship Affidavit	Page 17
Document 400	General Bid Package Items	Page 18
	1) General	Page 18
	2) Project Schedule	Page 19
	3) Safety	Page 20
Document 500	Bid Package 1 thru 15	Page 21
	1) Demo/Sitework (Not Used)	Page 21
	2) Concrete (Not Used)	Page 22
	3) Masonry (Not Used)	Page 24
	4) Metals (Not Used)	Page 25
	5) Wood & Plastic (Not Used)	Page 26
	6) Thermal & Moisture Protection (Not Used)	Page 27
	7) Doors & Hardware (Not Used)	Page 28
	8) Finishes (Ceiling Systems)	Page 29
	9) Specialties (Accessories) (Not Used)	Page 30
	10) Flooring (Not Used)	Page 31
	11) Painting (Not Used)	Page 32
	12) Fire Suppression (Not Used)	Page 33
	13) Mechanical	Page 34
	14) Plumbing	Page 35
	15) Electrical/Cabling/IT	Page 37

Kingsgate Elementary HVAC Replacement
1400 Kingsgate Road
Oklahoma City, OK 73159

Division 0

Bidding Instructions

&

Forms

ARCHITECT OF RECORD:

AGP – the Abla Griffin Partnership, LLC
201 N. Broadway, Suite 210
Moore, OK 73160 405-735-
3477

CONSTRUCTION MANAGER:

OMNI Construction, LLC
1909 S. Eastern Ave.
Moore, OK 73160 405-
735-3992

DOCUMENT 100
SOLICITATION FOR BIDS
(BID NOTICE)

Sealed proposals will be received by the Board of Education, Independent School District No. I-002, Moore, Cleveland County, Oklahoma, at the Moore Public Schools Administration Service Center, 1500 SE 4th Street, Moore, Oklahoma, until 2:00 P.M., Central Standard Time, on Thursday, the 2nd day of May 2024, at which time said bids will be opened for furnishing all labor and materials for the construction of the Kingsgate Elementary HVAC Replacement including the following Bid Packages:

- Bid Package 1 – Demo/Sitework (Not Used)
- Bid Package 2 – Concrete (Not Used)
- Bid Package 3 – Masonry (Not Used)
- Bid Package 4 – Metal (Not Used)
- Bid Package 5 – Wood & Plastic (Not Used)
- Bid Package 6 – Thermal & Moisture Protection (Not Used)
- Bid Package 7 – Doors & Hardware (Not Used)
- Bid Package 8 – Finishes (Ceiling Systems)
- Bid Package 9 – Specialties (Accessories) (Not Used)
- Bid Package 10 – Flooring (Not Used)
- Bid Package 11 – Painting (Not Used)
- Bid Package 12 – Fire Suppression (Not Used)
- Bid Package 13 – Mechanical
- Bid Package 14 – Plumbing
- Bid Package 15 – Electrical/Cablng/IT

Bids received more than ninety-six (96) hours, excluding Saturdays, Sundays, and holidays, before the time set for opening bids, as well as bids received after the time set for opening bids, will not be considered, and will be returned unopened.

Bids will be publicly opened and read aloud at the above-mentioned office immediately following the closing time stated above.

Complete sets of General Conditions, Plans, and Specifications, and other bidding documents may be obtained through OMNI Construction, LLC, and the RPG Plan Room.

OMNI Construction
1909 S. Eastern Ave.
Moore, OK 73160
405-735-3992
www.omnioklahoma.com

RPG Plan Room
www.rpgplanroom.com

A cashier's check, a certified check, or a surety bond in the amount of five percent (5%) of the bid shall accompany the sealed proposal of each bidder if the proposal is \$50,000.00 or larger. Bid Guarantees will be returned to the unsuccessful bidders.

The Board of Education reserves the right to accept or reject any and all bids.

The time period within which a contract will be executed following award to the successful bidder will not exceed thirty (30) days.

DOCUMENT 200

INSTRUCTIONS TO BIDDERS

To be considered, bids must be made in accordance with these instructions to bidders.

- Section 1 Solicitation**
- 1) Bid Submission
 - 2) Intent
 - 3) Work Identified in the Contract Documents
 - 4) Contract Time
- Section 2 Bid Documents and Contract Documents**
- 1) Definitions
 - 2) Contract Documents Identification
 - 3) Availability
 - 4) Examination
 - 5) Queries/Addenda
 - 6) Product Substitution
- Section 3 Site Assessment**
- 1) Site Examination
- Section 4 Qualifications**
- 1) Evidence of Qualifications
 - 2) Subcontractors/Suppliers/Others
- Section 5 Bid Submission**
- 1) Submission Procedure
 - 2) Bid Ineligibility
- Section 6 Bid Enclosure/Requirements**
- 1) Security Deposit
 - 2) Performance Assurance
 - 3) Bid Form Requirements
 - 4) Bid Form Signature
- Section 7 Offer Acceptance/Rejection**
- 1) Duration of Offer
 - 2) Acceptance of Offer

Section 1-
SOLICITATION

1.1) BID SUBMISSION

- A. Sealed proposals will be received by the Board of Education, Independent School District No. I-002, Moore, Cleveland County, Oklahoma, at the Moore Public Schools Administration Service Center, 1500 SE 4th Street, Moore, Oklahoma, until 2:00 P.M., Central Standard Time, on Thursday, the 2nd day of May 2024, at which time said bids will be opened for furnishing all labor and materials for the complete construction of the Kingsgate Elementary HVAC Replacement project.

Bid Packages: **Bid Package 1** – Demo/Sitework (Not Used)
Bid Package 2 – Concrete (Not Used)
Bid Package 3 – Masonry (Not Used)
Bid Package 4 – Metal (Not used)
Bid Package 5 – Wood & Plastic (Not Used)
Bid Package 6 – Thermal & Moisture Protection (Not Used)
Bid Package 7 – Doors & Hardware (Not Used)
Bid Package 8 – Finishes (Ceiling Systems)
Bid Package 9 – Specialties (Accessories) (Not Used)
Bid Package 10 – Flooring (Not Used)
Bid Package 11 – Painting (Not Used)
Bid Package 12 – Fire Suppression (Not Used)
Bid Package 13 – Mechanical
Bid Package 14 – Plumbing
Bid Package 15 – Electrical/Cabling/IT

- B. Bids received more than ninety-six (96) hours, excluding Saturdays, Sundays, and holidays, before the time set for opening bids, as well as bids received after the above time set for opening bids, will not be considered, and will be returned unopened.
- C. All forms identified in Section 300 shall be properly filled out and notarized.
- D. Bids will be publicly opened and read aloud at the above-mentioned office immediately following the closing time stated above.
- E. Amendments to submitted Bids will be permitted when received in writing prior to bid deadline and when endorsed by the same party or parties who signed and sealed the Bid.
- F. Bidders may withdraw their Bid by written request at any time before bid deadline.

1.2) INTENT

- A. The intent of this bid request is to obtain an offer to perform work to complete the construction of the Santa Fe Elementary Security Upgrades, 12801 S. Santa Fe, Oklahoma City, OK 73170, for a Stipulated Price contract, in accordance with the Contract Documents.
- B. The Owner has contracted with OMNI Construction to act as Construction Manager for the total Project. Selected parts of the work of the Project may be completed by the Construction Manager and other parts may be contracted by acceptance of public bids.

1.3) WORK IDENTIFIED IN THE CONTRACT DOCUMENTS

- A. Work of this proposed Contract comprises of bid package 1 thru 15 as noted in the Bid Manual
- B. The Scope of the work consists of furnishing all labor and materials for the complete construction, in accordance with the Contract Documents,
- C. The Base Proposal shall include all work as described in the Drawings, Project Manual and bid day instructions and forms. Each trade shall be responsible to review all sheets identified in the plan set and work that may pertain to their respected bid package.

1.4) CONTRACT TIME

- A. Construction Start Date = 5/15/2024
- B. Construction Completion Date = 1/10/2025

Section 2

BID DOCUMENTS AND CONTRACT DOCUMENTS

2.1) DEFINITIONS

- A. Bid Documents: Project Plans, Project Manual, Bidding Instructions and Forms.
- B. Bid: Executed Bid Form and required attachments submitted in accordance with these Instructions to Bidders.
- C. Bid Price: Monetary lump sum identified by the Bidder in the Bid Form.

2.2) CONTRACT DOCUMENTS IDENTIFICATION

- A. The Contract Documents (Drawings and Project Manual) are identified as prepared by the Architect, AGP – the Abla Griffin Partnership, LLC, and identified in their respective Table of Contents.

2.3) AVAILABILITY

- A. Refer to section 2.4- for availability of drawings.

2.4) EXAMINATION

- A. Bid Documents are on display at the offices of the following construction association plan room facilities:
 - [1] OMNI Construction, LLC
1909 S. Eastern Ave.
Moore, OK 73160 405-735-3992
www.omnioklahoma.com
 - [2] RPG Plan Room
www.rpgplanroom.com
- B. Upon receipt of Bid Documents verify that documents are complete. Notify the Architect or Construction Manager, OMNI Construction, LLC, should the documents be incomplete.

- C. Immediately notify the Architect or Construction Manager upon finding discrepancies or omissions in the Bid Documents.

2.5) QUERIES/ADDENDA

- A. Direct questions to AGP – the Abla Griffin Partnership L.L.C., 201 N Broadway, Suite 210, Moore, Oklahoma 73160, 405-735-3477 or AGP@theAGP.net. OMNI Construction, LLC, PO Box 892245 Oklahoma City, OK 73189, 405-735-3992 or omniconstructionllc@coxinet.net.
- B. Verbal answers are not binding on any party.
- C. Submit questions not less than 3 days before date set for receipt of Bids. Replies will be made by Addenda.
- D. Addenda may be issued during the Bidding period. Addenda become part of the Contract Documents. Include resultant costs in the Bid Price.
- E. List any addenda received on the Bid Form. Failure to receive any addenda shall not release the bidder from any obligations under his bid.

2.6) PRODUCT SUBSTITUTION

- A. Where the Bid Documents stipulate a particular Product, substitutions will be considered by the Architect up to seven (7) days before receipt of Bids.
- B. With each substitution request, provide sufficient information for Architect to determine acceptability of proposed products.
- C. When a request to substitute a Product is made, Architect may approve the substitution. Approved substitutions will be identified by Addenda.
- D. In submission of substitutions to products specified, Bidders shall include in their Bid, any changes required in the Work to accommodate such substitutions. Later claims by the Bidder for an addition to the Contract Time or Contract Sum/Price because of changes in Work necessitated by use of substitutions shall not be considered.

Section 3

SITE ASSESSMENT

3.1) SITE EXAMINATION

- A. Examine the project site before submitting a Bid.
- B. Each bidder shall carefully examine the project site, compared it to the Drawings and Project Manual, including all Addenda, and satisfied themselves as to the existing conditions under which their trade will be required to work, or that will affect the work under this contract.
- C. No allowances will be made on behalf of the Contractor for any error or negligence in determining these existing conditions. By submission of a bid on this project, the bidders agree to accept the existing project site in its present condition.
- D. Any and all site visits shall be scheduled through the Project Manager of record, OMNI Construction, LLC 405-735-3992.

Section 4

QUALIFICATIONS

4.1) EVIDENCE OF QUALIFICATIONS

- A. To demonstrate qualifications for performing the Work of this Contract, Bidders may be required to submit in writing, evidence of financial position, previous experience, and current commitments. The financial statement shall reflect the true financial condition of the bidder within three months prior to the date of the bid opening. To be eligible for the Contract a bidder, must be able to show his financial ability to carry on work until such time as he receives the first payment on the Contract agreement, and to finance the work between payments until the project is complete and accepted by the Owner.

4.2) SUBCONTRACTORS/SUPPLIERS/OTHERS

- A. The Owner reserves the right to reject a proposed Subcontractor for reasonable cause.
- B. Refer to OMNI Construction's Master Service Agreement when OMNI is Construction Manager.

Section 5

BID SUBMISSION

5.1) SUBMISSION PROCEDURE

- A. Bidders shall be solely responsible for the delivery of their Bids in the manner and time prescribed.
- B. **Submit one copy of the executed offer on the Bid Forms provided, signed, and sealed with the required security in a closed opaque envelope, clearly identified with Bidder's name, project name, Owner's name, Bid Manual 1, Bid Package Number and Description, and Bid Date on the outside of the envelope.**
- C. Contents of the Proposal Packet:
 - 1. Complete Bid Forms (Document 300).
 - 2. Non-collusion Affidavit signed and notarized.
 - 3. Non-Kickback Affidavit signed and notarized.
 - 4. Affidavit of Asbestos Free Materials and Construction signed and notarized.
 - 5. Non-Sex Offender Affidavit signed and notarized.
 - 6. Business Relationship Affidavit signed and notarized.
 - 7. A cashier's check, a certified check, or surety bond.
- D. An abstract summary of submitted Bids will be made available to all Bidders following Bid opening.

5.2) BID INELIGIBILITY

- A. Bids that are unsigned, improperly signed or sealed, conditional, illegible, obscure, contain arithmetical errors, erasures, alterations, or irregularities of any kind, may be declared unacceptable at Owner's discretion.
- B. Bid Forms, Appendices, and enclosures which are improperly prepared, may at the discretion of the Owner, be declared unacceptable.
- C. Failure to provide security deposit, bonding or insurance requirements will at the discretion of the Owner, invalidate the Bid.

Section 6

BID ENCLOSURES/REQUIREMENTS

6.1) SECURITY DEPOSIT

- A. Bids shall be accompanied by a security deposit if more than \$50,000.00 for a sum not less than five percent (5%) of the Bid Price/Sum submitted, as a guarantee that the successful bidder will properly execute a Contract and file performance assurance bonds within seven (7) days of the date of notification of award, as follows:
 - 1. Bid Bond or
 - 2. Certified or cashier's check.
- B. Should the successful bidder fail to enter into a Contract Agreement or to comply with the specified requirements, the bidder's check or bond will become the property of the Owner as liquidated damages, but not as penalty.
- C. Endorse the Bid Bond in the name of the Owner as obliged, signed, and sealed by the Contractor as principal and the Surety. Surety Bonds shall be issued by a surety licensed to conduct business in the State of Oklahoma and shall be accompanied by the bond agent's power-of-attorney.
- D. Endorse the certified or cashier's check in the name of the Owner.
- E. The security deposit will be returned after delivery to the Owner of the required Performance and Statutory Payment Bonds by the accepted Bidder.
- F. The security deposit will be returned after delivery to the Owner of the required Performance and Labor and Material Payment Bond(s) by the accepted Bidder.
- G. Include the cost of Bid Security in the Bid Price.
- H. After a bid has been accepted, all securities will be returned to the respective Bidders and other requested enclosures.
- I. If no contract is awarded, all security deposits will be returned.

6.2) PERFORMANCE ASSURANCE

- A. Accepted Bidder: Provide Performance and Statutory Bonds in one hundred percent (100%) of the contract amount covering faithful performance of the contract, and payment of all obligations arising there-under, will be required by the Owner.
- B. Provide a Defect Bond in the amount of one hundred percent (100%) of the contract amount covering defective workmanship and materials for a period of one year after the acceptance of the project.
- C. Include the cost of performance assurance bonds in the Bid Price.
- D. Oklahoma law allows substitution of an Irrevocable Letter of Credit is included herewith. One such letter shall be required for each of the bonds noted above.
- E. Construction Manager reserves the right to enforce or waive the surety bond requirements.

6.3) BID FORM REQUIREMENTS

- A. Complete all requested information in Section 300 of the Bidding Instructions and Forms.

6.4) BID FORM SIGNATURE

- A. The Bid Form shall be signed by the Bidder, as follows:
 - 1. Sole Proprietorship: Signature of sole proprietor in the presence of a witness who will also sign. Insert the words "Sole Proprietor" under the signature.
 - 2. Partnership: Signature of all partners in the presence of a witness who will also sign. Insert the word "Partner" under each signature.

3. Corporation: Signature of a duly authorized signing officer(s) in their normal signatures. Insert the officer's capacity in which the signing officer acts, under each signature. Affix the corporate seal. If the Bid is signed by officials other than the President and Secretary of the company, or the President/Secretary/Treasurer of the company, a copy of the by-law resolution of the Board of Directors authorizing them to do so, must also be submitted with the Bid Form in the Bid Envelope.
4. Joint Venture: Each party of the joint venture shall execute the Bid Form under their respective seals in a manner appropriate to such party as described above, similar to the requirements of a Partnership.

Section 7

OFFER ACCEPTANCE/REJECTION

7.1) DURATION OF OFFER

- A. Bids shall remain open to acceptance and shall be irrevocable for a period of thirty (30) days after the Bid closing date.

7.2) ACCEPTANCE OF OFFER

- A. The Owner reserves the right to accept or reject any or all bids, or to accept any bid he considers advantageous and to waive formalities and irregularities.
- B. The Owner reserves the right to disqualify bids, before and after opening, upon evidence of collusion with intent to defraud or other illegal practices upon the part of the bidder.
- C. The Contract will be awarded based on the lowest responsible bid.
- D. In case of a difference in written words and figures on the Bid Form, the amount stated in written words shall govern.
- E. After acceptance by the Owner, the Architect, on behalf of the Owner, will issue to the successful Bidder, a written Notice to Proceed.
- F. The time Period within which a contract will be executed following award to the successful bidder will not exceed thirty (30) days.
- G. In the event of a tie bid the coin toss method will be administered by the Construction Manager to determine the successful bidder.

DOCUMENT 300

BID FORMS

PROJECT NAME: Kingsgate Elementary HVAC Replacement

DATE OF BID OPENING: _____

COMPANY NAME: _____

COMPANY ADDRESS: _____

CONTACT NAME: _____

TELEPHONE NUMBER: _____

FAX NUMBER: _____

EMAIL ADDRESS: _____

PACKAGE NO. / DESCRIPTION	COMPLETE DESCRIPTION AS TO SCOPE OF WORK	AMOUNT

****Any proposal containing clarifications or exclusions shall not be considered.**

Base Bid: _____ (Written Words)

\$ _____ (Numeric Form)

IT IS UNDERSTOOD THE BASE BID DOES NOT INCLUDE THE COST OF THE PERFORMANCE BOND COVERING 100% OF THE CONTRACT AMOUNT. PRIOR TO AWARD, THE OWNER AND CONTRACTOR RESERVE THE RIGHT TO ADD A PERFORMANCE BOND FROM THE TRADE CONTRACT AGREEMENT. PLEASE INDICATE THE FOLLOWING INFORMATION WITH REGARDS TO YOUR PERFORMANCE BOND:

PERFORMANCE BOND RATE (%): _____

COST OF PERFORMANCE BOND (\$): _____ (Dollars)

Alternates:

Description of Alternate: _____

Add or Deduct: _____

**Please note that any and all items of the given package which are not specifically excluded in the bid document will be considered to be a part of the bid package.

SIGNATURE OF BIDDING PARTY

DATE

By initialing the line next to each item below you are acknowledging that you have included the following items:

_____ A cashier's check, a certified check, or a surety bond if bid is \$50,000 or greater.

_____ Non-Collusion Affidavit (Signed and Notarized)

_____ Non-Kickback Affidavit (Signed and Notarized)

_____ Affidavit of Asbestos Free Materials and Construction (Signed and Notarized)

_____ Non-Sex Offender Affidavit (Signed and Notarized)

_____ Business Relations Affidavit (Signed and Notarized)

_____ Acknowledge receipt of Addenda Numbers _ through _ issued for bidding.

SUBMITTED BY:

COMPANY NAME: _____

FULL PRINTED NAME: _____

SIGNATURE: _____

DATE: _____

NON-COLLUSION AFFIDAVIT

STATE OF _____)

)ss.

COUNTY OF _____)

_____, of lawful age, being first duly sworn on oath says that (s)he is the agent authorized by the bidder to submit the attached bid. Affiant further states that the bidder has not been a party to any collusion among bidders in restraint of freedom of competition by agreement to bid at a fixed price or to refrain from bidding; or with any state official or employee as to quantity, quality or price in the prospective contract, or any other terms of said prospective contract; or in any discussions between bidders and any state official concerning exchange of money or other things of value for special consideration in the letting of contract.

Subscribed and sworn to me before this _____ day of _____, 20____

Notary Public

My Commission Expires:

NON-KICKBACK AFFIDAVIT

COMPANY NAME: _____

As required by Oklahoma State Statutes, Title 62, § 310.9, any contract for \$25,000.00 or more for the purchase of materials, goods, or services, must be accompanied by the signed statement described below. Please sign this statement as indicated below and return to Moore Public Schools at the address shown below.

MOORE PUBLIC SCHOOLS
Attn: Purchasing Department
1500 S.E. 4th Street
Moore, OK 73160-8232

The undersigned (architect, contractor, supplier, or engineer), of lawful age, being first duly sworn on oath says that this contract is true and correct. Affiant further states that the (work, services, or materials) will be (completed or supplied) in accordance with the plans, specifications, orders, or requests furnished the affiant. Affiant further states that (s)he has made no payment directly or indirectly to any elected official, officer, or employee of the State of Oklahoma, any county or local subdivision of the state, of money or any other thing of value to obtain or procure the contract or purchase order.

(Signature of contractor, supplier, engineer, or architect)

Subscribed and sworn to me before this _____ day of _____, 20____

Notary Public

My Commission Expires: _____

NON-ASBESTOS AFFIDAVIT

STATE OF OKLAHOMA _____)

SS)

COUNTY OF _____)

_____, of lawful age, being first duly sworn, on oath says that (s)he is the agent authorized by bidder to submit the attached bid. Affiant further states that the bidder has not included as a part of the bid and will not include in the finished construction, nor will said bidder allow any subcontractor or workman to include in the finished construction, any material which contains asbestos in any form in the amount equal to or in excess of the one percent (1%) by weight or volume.

Subscribed and sworn to me before this _____ day of _____, 20_____

Notary Public

My commission Expires:

NON-SEX OFFENDER AFFIDAVIT

The undersigned, _____ represents that he/she is the owner or an officer of _____, who has the authority to make this declaration to Moore Public Schools, as required by Section 6-101.48 of Title 70 of the Oklahoma Statutes.

I declare that no employee on school premises during normal working hours under the authority of the above-named company or business has been convicted in the State, the United States, or another state of any se offense subject to the sex Offenders Registration Act or is subject to other states or the federal sex offender registration provisions.

I further declare that no employee working on school premises during normal working hours under the authority f the above-named company or business has been convicted of a felony offense within the past ten (10) years in this State the United States, or another state.

I further understand that Title 57, Oklahoma Statutes, Section 589 provides as follows, to wit:
It is unlawful for any person registered pursuant to the Sex Offenders Registration Act to work with or provide services to children or to work on school premises, or for any person or business who offers or provides services to children or contracts for work to be performed on school premises to knowingly and willfully allow any employee to work with children or to work on school premises who is registered pursuant to the Sex Offenders Registration Act. Upon conviction for any violation of the provisions of the subsection, the violator shall be guilty of a misdemeanor punishable by a fine not to exceed One Thousand Dollars (\$1,000.00). In addition, the violator may be liable for civil damages.

Dated this _____ day of _____, 20_____

Vendor / Contractor’s Name and Address

Authorized Signer

Subscribed and sworn to me before this _____ day of _____, 20_____

Notary Public

My Commission Expires:

Business Relations Affidavit

State of _____

)ss.

County of _____

_____, of lawful age, being first duly sworn on oath that (s)he is the agent authorized by the bidder to submit the attached bid. Affiant further states that the nature of any partnership, joint venture, or other business relationship presently in effect of which existed within one (1) year prior to the date of this statement which the architect, engineer, or other part of the project is as follows:

Affiant further states that any such business relationship presently in effect or which existed within one (1) year prior to the date of this statement between any official or director of the architectural or engineering firm or any other party to the project is as follows:

Affiant further states that the names of all persons who have any such business relationship and the positions they hold with their respective companies or firms are as follows:

(If none of the business relationships hereinabove mentioned exists, affiant should so state)

Name: _____

Title: _____

Subscribed and sworn before me this _____ day of _____, 20____

Notary Public

My Commission Expires: _____

DOCUMENT 400
GENERAL BID PACKAGE ITEMS

Each Bid Package shall include, but is not necessarily limited to the following General Bid Package Items:

Section 1-
General

- A. Subcontractor acknowledges that they have performed an onsite investigation, if desired, of the site conditions and acknowledges that all activities must be performed in close coordination with other Subcontractors. The Subcontractor shall be responsible for all means and methods for performing the work according to the contract documents, site conditions, and all applicable codes.
- B. Subcontractor shall comply with all provisions of the OMNI Construction contract, insurance, safety, and EEOC requirements.
- C. In addition to the Conditions of Specification, drawings, submittals, and Closeout Submittals the Subcontractor shall provide the following:
 - o Each Submittal shall be submitted under separate coversheet indicating the specific Specification Section to which it pertains.
 - o Subcontractor shall submit three (3) hard copies and one (1) digital copy of each submittal.
 - o Subcontractor shall submit two (2) hard copies and one (1) digital copy of Close-out Documents.
 - a. Subcontractor shall be responsible for timely submission of all submittals, including but not limited to: shop drawings, samples, product data sheets MSDS information, and all other submittals required by the contract documents.
 - b. Miscellaneous – This contract will be provided by OMNI Construction. All warranties and guarantees are to be transferred to Owner at the completion of this project.
 - c. Subcontractor shall sequence work as directed by OMNI without exception.
 - d. All correspondence for this project shall be directed to the designated Project Manager – OMNI Construction.
 - e. Coordination – Subcontractor shall have a designated Project Superintendent who will regularly attend construction meetings as required involving this project. The Superintendent/representative attending the meeting shall have the authority and ability to make binding commitments regarding the timing of the performance of Subcontractor’s work. Subcontractor, Field Project Manager or Superintendent may not be changed without mutual agreement with OMNI Construction. Subcontractor shall attend all schedule related meetings to coordinate access to work areas with the other Subcontractors, OMNI Construction and Owner work forces that are on site.
 - f. Subcontractor shall engage a qualified surveyor to establish exact points to act as working points as needed. Subcontractor shall include the cost to resurvey as needed to establish final dimensions and protect and maintain working points and survey control points from disturbance caused during construction. Construction Manager will provide two (2) Benchmarks to establish the layout.

- g. Subcontractor shall include all layout and field dimensions associated with this work.
- h. Subcontractor shall coordinate delivery of materials. Subcontractor shall provide equipment and personnel necessary to unload, stack, and store onsite. Subcontractor shall inventory all delivered items and inspect for damage or missing items. Any damaged or missing items shall be noted on the Bill of Lading. Subcontractor shall notify suppliers and arrange for replacement items to be shipped. Subcontractor shall file all damage claims with insurance carriers. Placement of staged items shall be coordinated with OMNI Construction.
- i. Subcontractor shall be responsible for any damage caused by the Subcontractor to any adjoining areas that remain.
- j. Subcontractor shall pay for all repairs to other Subcontractor's work damaged by contractor's personnel, suppliers, or subcontractors during construction.
- k. Subcontractor shall be responsible for daily clean-up to include but not limited to: Removal and/or proper storage of tools, equipment, and materials as required by the Construction Manager, disposal of scrap and waste material, and the sweeping of any dust and dirt generated by construction activities, including general foot traffic of the subcontractor. All debris will be removed from the working area and deposited in the dumpster or proper location by the subcontractor, as directed by the Construction Manager.
- l. Subcontractor is responsible for the proper back fill and testing of work put in place by the subcontractor in accordance with specification section 02200 Earthwork.
- m. Subcontractor is responsible for fire caulking and sealing of all penetrations, with an equal fire rating to that of the wall being penetrated by the subcontractor's work.

Section 2-
Project Schedule

Project Sequence: Bidders will be required to adhere to the project schedule, which will be provided by OMNI Construction. Work will be performed as required to meet the overall completion date.

- A. The Subcontractor agrees that it will provide adequate manpower to complete the Subcontractor's Work in accordance with the time established by the Schedule during regular working hours. The Schedule is based on a 40-hour work week. The Work Week is Monday – Friday, from 7:00 a.m. – 4:00 p.m. It shall be the Subcontractor's responsibility to meet the Schedule. Any cost associated with additional manpower and or overtime hours required to meet the schedule are the responsibility of the Subcontractor. In addition, the Subcontractor will be liable to the Construction Manager in connection with any overtime required to meet the schedule due to Subcontractor's inability to meet the schedule during regular hours, including but not limited to, additional supervision and a reasonable markup for overhead and profit.
- B. Off hour and or Overtime may be required to complete select activities as may be directed by the Construction Manager and or Owner to meet the need of the school. These activities will be scheduled in advance.

- C. It shall be the responsibility of Subcontractor to provide in writing the following information on a weekly basis, in order to update the Master Project Schedule:
- Detailed Schedule including activities, anticipate durations and man loading
 - Subcontractor's daily report shall be submitted to OMNI Project Superintendent
 - Planned crew size and man-hours by week
 - Actual crew size and man-hours expended by week
 - Planned units by week
 - Actual units installed by week
- D. Subcontractor shall provide an estimated man-loading curve for the duration of the project. This curve will be used as a guide for man loading throughout project. Subcontractor shall coordinate with OMNI Construction to refine the schedule for manpower loading and timely completion of the project. This responsibility will be ongoing as updates are required.

Section 3-
Safety

- 3.1 Subcontractor shall implement a safety program meeting or exceed the requirements set forth by OSHA.
- 3.2 High visibility clothing and proper PPE will be required 100% of the time for the duration of this project.

DOCUMENT 500
BID PACKAGE 1-15

BID PACKAGE 1: DEMO/SITWORK (Not Used)

Project: Kingsgate Elementary HVAC Replacement
Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification		
Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 02050	Demolition	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the DEMO/SITWORK BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials, and equipment necessary to complete demo/sitework.
2. Testing to be paid for by others, but to be coordinated by contractor.
3. Include all dewatering required to perform this scope of work.
4. Provide construction entrance as set forth in specifications.
5. All miscellaneous equipment and material required for the proper completion of this scope of work.
6. Subcontractor is to ensure that all elevated work areas are made ready to protect all areas below and have OSHA approved fall protection for work to proceed.

BID PACKAGE 2: CONCRETE (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 02500	Paving and Surfacing	Complete
Section 03300	Cast-In-Place Concrete	Complete
Section 06100	Rough Carpentry	As applicable to concrete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the CONCRETE BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish and install all concrete complete.
2. Furnish and install all rebar, dowels, and accessories associated with concrete. Furnish and maintain all rebar caps on dowels until next trade begins tie in. **(Rebar associated with Masonry will be provided and installed in Masonry Bid package.)**
3. Furnish and install all required formwork.
4. Excavate and fill as required for all concrete work.
5. Furnish all sand & gravel base required for concrete work.
6. Include all necessary layout and surveying from a provided benchmark for concrete work.
7. Include all termite treatments.
8. Testing to be paid for by others but coordinated by contractor.
9. Include all concrete related weather and temperature protection.
10. Include all dewatering required to perform this scope of work.
11. Include concrete repairs including but not limited to patching, rubbing, grinding, fill, sandblast, and caulk as indicated on the drawings and specifications.
12. Furnish and install board insulation under slab and at foundation perimeter per plans and specifications.

13. All miscellaneous equipment and material required for the proper completion of this scope of work.
14. Subcontractor is to ensure that all elevated pours are made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
15. Furnish and install sidewalks/paving as detailed.
16. Clean your work area daily.

BID PACKAGE 3: MASONRY (Not Used)

Project: Kingsgate Elementary HVAC Replacement
Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 04810	Unit Masonry Assemblies	Complete
Section 05500	Metal Fabrications	As Applicable to Masonry

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the MASONRY BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the follow items:

1. Furnish and install all necessary materials to complete masonry work, inclusive of rebar related to masonry scope of work.
2. Provide all necessary equipment and materials required for completion of this scope of work.
3. Subcontractor to ensure that all elevated work areas are made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
4. Install all loose steel lintels over openings.
5. Clean your work area daily.

BID PACKAGE 4: METALS (MATERIAL ONLY) (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 05120	Structural Steel	Material Complete
Section 05310	Steel Decking	Material Complete
Section 05500	Metal Fabrications	As per plans and applicable

This bid package shall include all material, equipment, services, insurances, and incidentals for the METAL (MATERIAL ONLY) BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Supply all structural steel framing, joist, and steel decking.
2. Supply all anchors for embedding into concrete.
3. Supply all anchors for embedding into masonry.
4. Supply all bridging and seats.
5. Supply all bearings and angles.
6. Supply all lintels.
7. Supply all required fasteners to include but not limited to bolts, nuts, lag bolts, machine screws, plain washers, drilled-in expansion bolts, toggle bolts, epoxy, anchors, screens, and concrete inserts as indicated in the documents.
8. Include delivery of all material associated with this bid package. Delivery must be coordinated with the Construction Manager and steel erector.
9. Supply all seismic bracing steel.

BID PACKAGE 5: WOOD & PLASTIC (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 06200	Finish Carpentry	As applicable to custom casework/millwork
Section 06300	Wood Treatment	As applicable to custom casework/millwork

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the WOODS & PLASTICS BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish and install all necessary materials to complete carpentry work.
2. Provide all necessary equipment and materials required for the proper completion of this scope of work.
3. Subcontractor to ensure that all elevated work areas are made ready to protect all areas below and have OSHA approved fall protection for work to proceed.

BID PACKAGE 6: THERMAL & MOISTURE PROTECTION (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 07150	Damp proofing	Complete
Section 07600	Flashing & Sheet Metal	Complete except as to concrete, roofing and interior finish
Section 07900	Sealants	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the THERMAL & MOISTURE PROTECTION BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish and install all necessary materials to complete the waterproofing/insulation/firestopping work.
2. Provide all necessary equipment and materials required for completion of this scope of work.
3. Subcontractor to ensure that all elevated work areas are made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
4. Clean your work area daily.

BID PACKAGE 7: DOORS/HARDWARE (MATERIAL ONLY) (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 06100	Rough Carpentry	As applicable to this bid package
Section 06200	Finish Carpentry	As applicable to this bid package
Section 06300	Wood Treatment	As applicable to this bid package
Section 08100	Metal Doors and Frames	As applicable to this bid package
Section 08700	Finish Hardware	As applicable to this bid package

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the DOORS/HARDWARE BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish all wood and metal doors, frames and hardware per plans and specifications installation by others.

BID PACKAGE 8: FINISHES (CEILING SYSTEM)

Project: Kingsgate Elementary HVAC Replacement
Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification		
Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 05400	Cold Formed Metal Framing	Complete
Section 06100	Rough Carpentry	As applicable to this bid package
Section 06200	Finish Carpentry	As applicable to this bid package
Section 06300	Wood Treatment	As applicable to this bid package
Section 07200	Insulation	As applicable to this bid package
Section 09120	Ceiling Suspension Systems	Complete
Section 09250	Gypsum Wallboard	Complete
Section 09500	Acoustical Treatment	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the FINISHES (CEILING SYSTEM) BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials, and equipment necessary to complete the ceiling system/finish framing/sheetrock.
2. All miscellaneous equipment and material required for the proper completion of this scope of work.
3. Subcontractor is to ensure that all elevated work is made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
4. All demo/removal of existing material to be replaced as applicable to this scope of work.
5. Clean your work area daily.

BID PACKAGE 9: SPECIALTIES (ACCESSORIES) (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 10100	Chalkboards and Tackboards	Complete
Section 10520	Fire Protection Specialties	Complete
Section 10800	Toilet and Bath Accessories	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the SPECIALTIES (ACCESSORIES) BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish all materials necessary for installation of accessories per the plans and specifications, installation to be provided by others.

BID PACKAGE 10: FLOORING (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 09300	Tile	Complete
Section 09650	Resilient Tile Flooring	Complete
Section 09681	Carpet Tile	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the FLOORING BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials, and equipment necessary to complete flooring.
2. All miscellaneous equipment and material required for the proper completion of this scope of work.
3. Clean your work area daily.

BID PACKAGE 11: PAINTING (Not Used)

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 09900	Painting	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the PAINTING BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials, and equipment necessary to complete painting.
2. Provide all miscellaneous equipment and material required for the proper completion of this scope of work.
3. Subcontractor is to ensure that all elevated work is made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
4. Clean your work area daily.

BID PACKAGE 12: FIRE SUPPRESSION (Not Used)

Project: Kingsgate Elementary HVAC Replacement
Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification		
Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 210500	Common Work Results for Fire Suppression	Complete
Section 210553	Identification for Fire Suppression Piping and Equipment	Complete
Section 211300	Fire Suppression Sprinklers	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the FIRE SUPPRESSION BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials and equipment necessary to complete fire suppression.
2. All miscellaneous equipment and material required for the proper completion of this scope of work.
3. Subcontractor is to ensure that all elevated work is made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
4. Clean your work area daily.

BID PACKAGE 13: MECHANICAL

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification		
Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 230500	Mechanical General Provisions	Complete
Section 230512	HVAC Shop Drawings, Coordination Drawings & Product Data	Complete
Section 230513	Electrical Provisions of HVAC Work	Complete
Section 230514	HVAC Condensate Drain Piping System	Complete
Section 230548	Vibration Isolation	Complete
Section 230593	Testing, Balancing & Adjusting (TAB) of Environmental Systems	Complete
Section 230713	External Duct Insulation	Complete
Section 232300	Refrigerant Piping and Appurtenances	Complete
Section 233113	Ductwork	Complete
Section 233713	Air Devices	Complete
Section 234100	Air Filtration	Complete
Section 236300	Air-Cooled Condensing Units	Complete
Section 238121	Variable Refrigerant Flow System	Complete
Section 238223	Gas Fired Furnace with DX Evaporator	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the MECHANICAL BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the following items:

1. Furnish labor, materials and equipment necessary to complete mechanical.
2. Testing to be coordinated by mechanical contractor.
3. All miscellaneous equipment and material required for the proper completion of this scope of work.
4. Coring, patching and caulking of penetrations required for this scope of work.
5. Subcontractor is to ensure that all elevated work is made ready to protect all areas below and have OSHA approved fall protection for work to proceed.
6. All demo/removal of existing material/equipment to be replaced as applicable to this scope of work.
7. Clean your work area daily

BID PACKAGE 14: PLUMBING

Project: Kingsgate Elementary HVAC Replacement
Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 220100	Plumbing Operating & Maintenance Manuals	Complete
Section 220500	Plumbing General Provisions	Complete
Section 220510	Plumbing Contract Quality Control	Complete
Section 220512	Plumbing Shop Drawings, Coordination Drawings & Product Data	Complete
Section 220514	Plumbing Alterations Project Procedures	Complete
Section 220523	Valves	Complete
Section 220719	Plumbing Piping Insulation	Complete
Section 221316	Soil, Waste, & Sanitary Drain Piping, Vent Piping and Appurtenances	Complete
Section 222000	Plumbing Pipe and Pipe Fittings-General	Complete
Section 226311	Gas Piping and Appurtenances	Complete

This bid package shall include all labor, materials, equipment, services, insurances, and incidentals for the PLUMBING BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the bid manual and shall also include, but not be limited to the follow items:

1. Provide all material labor, and equipment required for proper installation of complete plumbing system.
2. All piping, fittings, valves, cleanouts, fixtures, and accessories as required for complete and proper installation of plumbing.
3. Any sleeves and penetrations required in walls, floors, roof, etc. for this work including fire/smoke sealing inside and outside of sleeves and patching/fire caulking of the penetrations.
4. All supports, hangers and in-wall blocking required for this work.
5. All identification as called for and/or required per code.
6. Coring, patching and caulking of penetrations required for this scope of work.
7. Caulking of all fixtures.
8. Furnishing and installing all plumbing equipment.
9. Provide all necessary sleeving and or block-outs at CMU required for the proper installation of all plumbing systems included in this contract agreement. Contractor will provide adequate layout and coordination with the Masonry Contractor to ensure proper installation of the work.

10. All permits, fees and inspections as required,
11. All cutting and patching as required for the work of this proposal.
12. Subcontractor is responsible for backfilling and compactions per section 00202.
13. All testing to be paid for by others and coordinated by subcontractor associated with backfilling and compaction.
14. Subcontractor is responsible for removal of excess spoils from site.
15. Subcontractor to coordinate with utilities subcontractor to tie into utilities.
16. Subcontractor shall furnish and install steel, lockable, and primed access panels in any location required to allow for proper access to the plumbing system. Access panels shall be large enough to accommodate easy access for repairs, maintenance, and inspection.
17. All penetrations through CMU walls must have block-outs. Core drilling will not be allowed.
18. All demo/removal of existing material/equipment to be replaced as applicable to this scope of work.
19. Clean your work area daily.

BID PACKAGE 15: ELECTRICAL/CABLING/IT

Project: Kingsgate Elementary HVAC Replacement

Location: 1400 Kingsgate Road, Oklahoma City, OK 73159

Specification

Section	Description	
Division 0	Bidding & Contract Documents	Complete
Division 1	General Requirements	Complete
Section 260126	Field Testing	Complete
Section 260500	Electrical General Provisions	Complete
Section 260512	Electrical Shop Drawings, Coordination Drawings & Product Data	Complete
Section 260519	Conductors & Connectors – 600 Volt	Complete
Section 260526	Electrical Grounding	Complete
Section 260533	Conduit Systems	Complete
Section 260535	Electrical Connections for Equipment	Complete
Section 260536	Surface Non-Metallic Raceway	Complete
Section 260537	Electrical Boxes & Fittings	Complete
Section 260540	Electrical Gutters & Wireways	Complete
Section 260545	Cable Trays	Complete
Section 260925	Electrical Contactors	Complete
Section 260926	Lighting Occupancy Sensors-Ceiling Mount	Complete
Section 262416	Panelboards & Enclosures	Complete
Section 262425	Enclosed Switches	Complete
Section 262430	Fuses	Complete
Section 262773	Line Voltage Wiring Devices	Complete
Section 265113	Lighting Fixtures	Complete

This bid package shall include all labor, material, equipment, services, insurances, and incidentals for the ELECTRICAL/CABLING/IT BID PACKAGE, including work from referenced specifications and other work normally associated with this trade.

The scope of work shall include all General Bid Package Items as listed in section 400 of Division 0 of the Bid Manual and shall also include, but not be limited to the following items:

1. Furnish and install the complete building and site electrical systems as specified.
2. Furnish, install, and coordinate all permanent fire alarm and communication systems.
3. Provide, coordinate, and maintain all temporary building/jobsite trailer and site electrical power and lighting services, including temporary construction facilities.
4. Subcontractor is responsible for coordinating all systems with the Fire Sprinkler, Mechanical, and Plumbing Contractors.
5. All associated inspections, permits, and required fees.
6. Subcontractor is responsible for all layout associated with this bid package.
7. Furnish and install all sleeves for associated electrical work.

8. Subcontractor is responsible for any and all wiring to others equipment.
9. Subcontractor is responsible for all fire-stopping where this scope of work creates penetrations.
10. Furnish and install all conduit and boxes for specification divisions 26000 through 28000.
11. Furnish and install all conduit and boxes for all mechanical controls systems.
12. Subcontractor shall furnish and install steel, lockable, and primed access panels in any location required to allow for proper access to the electrical system. Access panels shall be large enough to accommodate easy access for repairs, maintenance, and inspection.
13. All penetrations through CMU walls must have block-outs. Core drilling will not be allowed.
14. Subcontractor is responsible for coordinating all systems with the Fire Sprinkler, Mechanical, and Plumbing Contractors.
15. All associated inspections, permits, and required fees.
16. Subcontractor is responsible for all layout associated with this bid package.
17. Furnish and install all sleeves for associated electrical work.
18. Subcontractor is responsible for any and all wiring to others equipment.
19. Subcontractor is responsible for all fire-stopping where this scope of work creates penetrations.
20. Furnish and install all conduit and boxes for specification divisions 26000 through 28000.
21. Furnish and install all conduit and boxes for all mechanical controls systems.
22. Subcontractor shall furnish and install steel, lockable, and primed access panels in any location required to allow for proper access to the electrical system. Access panels shall be large enough to accommodate easy access for repairs, maintenance, and inspection.
23. All penetrations through CMU walls must have block-outs. Core drilling will not be allowed.
24. All demo/removal of existing material/equipment to be replaced as applicable to this scope of work.
25. Clean your work area daily.

**MOORE PUBLIC SCHOOLS
KINGSGATE ELEMENTARY SCHOOL
HVAC REPLACEMENT**

**INDEPENDENT DISTRICT NO. 2
CLEVELAND COUNTY, MOORE, OKLAHOMA**

**1400 KINGSGATE ROAD
OKLAHOMA CITY, OKLAHOMA 73159**

PROJECT MANUAL
MARCH 2024

AGP | the Abla Griffin
Partnership



PROJECT MANUAL
MARCH 2024

**MOORE PUBLIC SCHOOLS
KINGSGATE ELEMENTARY SCHOOL
HVAC REPLACEMENT**

**INDEPENDENT DISTRICT NO. 2
CLEVELAND COUNTY, MOORE, OKLAHOMA**

**1400 KINGSGATE ROAD
OKLAHOMA CITY, OKLAHOMA 73159**

ARCHITECT:

AGP | the Abla Griffin
Partnership

the Abla Griffin Partnership LLC
201 North Broadway, Suite 210
Moore, Oklahoma 73160
t: 405.735.3477
AGP@theAGP.net

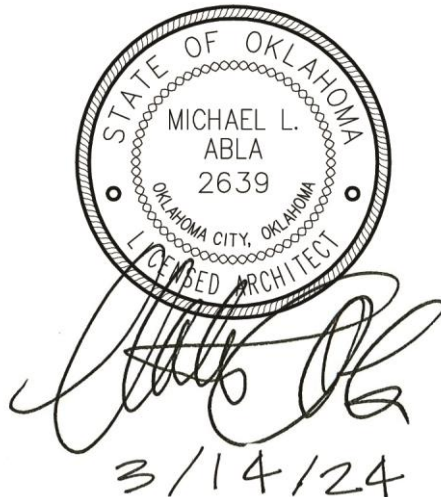


TABLE OF CONTENTS

Title Page	1 page
Table of Contents	2 pages
Mechanical, Electrical, Plumbing, & Technology Table of Contents	2 pages
BIDDING REQUIREMENTS	
Special Conditions	7 pages
DIVISION 1 - GENERAL REQUIREMENTS	
01010 Summary of the Work	01010-1 - 4
DIVISION 2 - SITE WORK	
02050 Demolition	02050-1 - 3
02110 Temporary Construction Fencing	02110-1 - 2
DIVISION 3 - CONCRETE	
03300 Cast-In-Place Concrete	03300-1 - 13
DIVISION 4 - MASONRY	
04810 Unit Masonry Assemblies	04810-1 - 11
DIVISION 5 - METALS	
05400 Cold Formed Metal Framing	05400-1 - 10
05500 Metal Fabrications	05500-1 - 4
DIVISION 6 - WOOD & PLASTIC	
06100 Rough Carpentry	06100-1 - 4
06300 Wood Treatment	06300-1
DIVISION 7 - THERMAL & MOISTURE PROTECTION	
07200 Insulation	07200-1 - 2
07550 Modified Bitumen Membrane Roofing System	07550-1 - 14
07600 Flashing and Sheet Metal	07600-1 - 2
07840 Firestopping	07840-1 - 8
07900 Sealants	07900-1 - 6
DIVISION 8 - DOORS & WINDOWS	
08100 Metal Doors and Frames	08100-1 - 9
08700 Finish Hardware	08700-1 - 4

TABLE OF CONTENTS

DIVISION 9 - FINISHES

09120	Ceiling Suspension Systems	09120-1 - 3
09250	Gypsum Wallboard	09250-1 - 3
09500	Acoustical Treatment	09500-1 - 2
09900	Painting	09900-1 - 4

DIVISION 10 - SPECIALTIES

Not Used

DIVISION 11 - EQUIPMENT

Not Used

DIVISION 12 - FURNISHINGS

Not Used

DIVISION 13 - SPECIAL CONSTRUCTION

Not Used

DIVISION 14 - CONVEYING SYSTEMS

Not Used

DIVISIONS 22 THRU 26 - MECHANICAL, ELECTRICAL, & PLUMBING

REFER TO MECHANICAL AND ELECTRICAL TABLE OF CONTENTS

DIVISIONS 01, 02, AND 31 THRU 33 - CIVIL

Not Used

SECTION 00 01 10

TABLE OF CONTENTS



Engineer of Record
Divisions 22, 23
Dwayne McDonald Gordon
Mechanical Engineer
Salas O'Brien, LLC
OK 30822 / EXP 02.28.2026
CA 7058 / EXP 06.30.2025

DIVISION 22 - PLUMBING

- 22 01 00 Plumbing Operating and Maintenance Manuals
- 22 05 00 Plumbing General Provisions
- 22 05 10 Plumbing Contract Quality Control
- 22 05 12 Plumbing Shop Drawings, Coordination Drawings & Product Data
- 22 05 14 Plumbing Alterations Project Procedures
- 22 05 23 Valves
- 22 07 19 Plumbing Piping Insulation
- 22 13 16 Soil, Waste and Sanitary Drain Piping, Vent Piping and Appurtenances
- 22 20 00 Plumbing Pipe and Pipe Fittings - General
- 22 63 11 Gas Piping and Appurtenances

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

- 23 05 00 Mechanical General Provisions
- 23 05 12 HVAC Shop Drawings, Coordination Drawings & Product Data
- 23 05 13 Electrical Provisions of HVAC Work
- 23 05 14 HVAC Condensate Drain Piping System
- 23 05 48 Vibration Isolation
- 23 05 93 Testing, Balancing and Adjusting (TAB) Of Environmental Systems
- 23 07 13 External Duct Insulation
- 23 23 00 Refrigerant Piping and Appurtenances
- 23 31 13 Ductwork
- 23 37 13 Air Devices
- 23 41 00 Air Filtration
- 23 63 00 Air-Cooled Condensing Units
- 23 81 21 Variable Refrigerant Flow System
- 23 82 23 Gas Fired Furnace with DX Evaporator

Engineer of Record
Divisions 26
Timothy Van Ostran
Electrical Engineer
Salas O'Brien, LLC
OK 32650 / EXP 03.31.2025
CA 7058 / EXP 06.30.2025



DIVISION 26 - ELECTRICAL

- 26 01 26 Field Testing
- 26 05 00 Electrical General Provisions
- 26 05 12 Electrical Shop Drawings, Coordination Drawings & Product Data
- 26 05 19 Conductors and Connectors – 600 Volt
- 26 05 26 Electrical Grounding
- 26 05 33 Conduit Systems
- 26 05 35 Electrical Connections for Equipment
- 26 05 36 Surface Non-Metallic Raceway
- 26 05 37 Electrical Boxes and Fittings
- 26 05 40 Electrical Gutters and Wireways
- 26 05 45 Cable Trays
- 26 09 25 Electrical Contactors
- 26 09 26 Lighting Occupancy Sensors – Ceiling Mount
- 26 24 16 Panelboards and Enclosures
- 26 24 25 Enclosed Switches
- 26 24 30 Fuses
- 26 27 73 Line Voltage Wiring Devices
- 26 51 13 Lighting Fixtures

END OF SECTION

SPECIAL CONDITIONS

TIME FOR COMPLETION AND LIQUIDATED DAMAGES:

- A. Upon execution of the contract agreement between the Owner and the Contractor, it shall become an obligation of the contractor to complete all work to be performed under this agreement for the Construction of the Kingsgate Elementary School HVAC Replacment to be located at 1400 Kingsgate Road, Oklahoma City, OK - **within 180 Calendar Days.**
- B. Penalty for noncompliance by the above date shall be cessation of all further periodical payments until the work is completed, and can be fully used for the purpose intended.

PAYMENTS:

- A. The Owner's payment schedule indicating the payment dates established by Moore Public Schools shall be provided to the contractor to establish a monthly payment schedule.
- B. **Certificates of payment shall be submitted to the Architect on or before 7 days prior to Owner's cut-off date.**
- C. Until the Work is 50 percent complete, the Owner will pay 95 percent of the amount due the Contractor on account of progress payments. At the time the Work is 50 percent complete and thereafter, if the manner of completion of the Work and its progress are and remain satisfactory to the Architect, and in absence of other good and sufficient reasons, he shall on presentation by the Contractor of Consent of Surety for each application, authorize any **remaining** partial payments to be paid at 100% of amount due. The retainage held to that point shall be retained until the project is completed.

The full contract retainage may be reinstated if the manner of the completion of the Work and its progress do not remain satisfactory to the Architect, (or if the Surety withholds his consent), or for other good and sufficient reasons.

INSURANCE AND BONDS:

- A. Insurance provided shall be with a company or companies licensed to do business in the state of Oklahoma.
- B. Policies shall be provided in the following types and amounts:
 - 1. a. Workmen's Compensation-Statutory

- b. Employer's Liability-\$500,000 each accident.
- 2. Comprehensive General Liability:
 - a. Bodily Injury - \$1,000,000 each occurrence.
 - b. Personal Injury - \$1,000,000
 - c. Property Damage - \$1,000,000 each occurrence
- 3. Automobile Liability:
 - a. Bodily Injury - \$500,000 each person/\$1,000,000 each occurrence
 - b. Such Comprehensive Automobile Liability Insurance shall include all owned and non-owned hired motor vehicles.
- 4. Owners Protective Liability - Same limits as above.
- 5. Products and Completed Operations - Same limits as above.
- 6. Contractual Liability - Same limits as above.
- C. Furnish one copy of Certificates herein required for each copy of the Agreement; specifically set forth evidence of all coverage required by Subparagraphs 11.1 and 11.2. Furnish to the Owner copies of any endorsements that are subsequently issued amending coverage or limits.
- D. **The Contractor shall provide property insurance in the amount of the initial contract sum as well as subsequent modifications thereto for the entire Work at the site on a replacement cost basis without voluntary deductibles. This insurance coverage shall be the "all-risk" form for completed value.**

TEMPORARY SERVICES:

- A. Sanitary Facilities: The Contractor shall provide and maintain necessary sanitary conveniences for the use of those employed on/or about the work. The sanitary facilities shall be properly secluded from public observation and shall be such locations as shall be approved by the Owner, and their use shall be strictly enforced.

SHOP DRAWINGS and SUBMITTALS:

- A. Unless otherwise specified, the shop drawings and product data shall be submitted **electronically**. Physical samples of materials shall

be submitted to the Architect as required.

- B. Contractor is responsible for obtaining and distributing required prints of shop drawings to his subcontractors and material suppliers after as well as before final approval.
- C. Shop drawings and samples shall be dated and marked to show the names of the Project, Architect, Contractor, originating Sub-Contractor, manufacturer or supplier, and separate detailer if pertinent. Shop drawings shall completely identify Specifications section and locations at which materials or equipment are to be installed. Reproduction of Contract Drawings are acceptable as Shop Drawings only when specifically authorized in writing by the Architect.
- D. If materials or specified items other than those specified in these Contract Documents are supplied - and approved by the Architect - it shall be the Contractor's responsibility to provide ALL additional materials, accessories, substrates, utility connection, etc. for a complete and operational installation at NO additional cost to the Owner.

CHANGES IN THE WORK:

- A. Cost shall be limited to the following: cost of materials, including sales tax and cost of delivery; cost of labor, including social security, old age and unemployment insurance, and fringe benefits under collective bargaining agreements; workmen's compensation insurance; bond premiums; and rental value of power tools and equipment. Overhead shall include the following; supervision, superintendence, wages of time keepers, watchmen and clerks, hand tools, incidentals, general office expense, and all other expenses not included in "cost".
- B. Change Order markups shall be limited to 10% overhead and 10% profit. No other markups shall be allowed.

AS BUILT DRAWINGS:

- A. Provide and maintain in proper order and in good, clean condition in the field office at the project site, one complete full-size set of all working drawings. On this set of drawing prints, in red ink, neatly and accurately inscribe any and all changes in the work.
- B. Upon completion of work, the Contractor shall furnish one set of "as built" drawings. These drawings shall be contract drawings

corrected in **red ink** to show any differences between contract drawings and actual construction. All changes made during construction shall be noted. Each drawing showing changes in dimensions, details, or containing supplemental information shall be plainly marked "**As Built**" and shall contain the signature of both the Architect and the Contractor.

CLOSEOUT SUBMITTALS:

Prepare project data in the form of an instructional manual supplied electronically on media as requested by Owner (CD, DVD, flash drive, memory stick, etc.). The following information shall be included and arranged under a Table of Contents:

1. Directory listing names, addresses, and telephone numbers of the Architect/Engineer(s), General Contractor, Subcontractors, and major material/equipment suppliers.
2. Operation and maintenance instructions, arranged by system and subdivided by specification section. For each category, identify names, addresses, and telephone numbers of Subcontractors and Suppliers. Include equipment, parts list for each, operating instructions, maintenance instructions for equipment, special finishes, etc.
3. Project documents and certificates, including shop drawings and product data, air and water balance reports, photocopies of warranties.
4. Record As-Built Drawings as described above.
5. Completed Non-Asbestos Affidavit.

DEBRIS DISPOSAL:

Waste disposal shall be the responsibility of the Contractor. The Contractor shall make arrangements with the local authorities having jurisdiction for accommodation of all waste disposal. If local facilities are not available the contractor shall be responsible for all other arrangements for waste disposal.

SUPPLEMENTARY CONDITIONS AND SPECIAL CONDITIONS:

In the following sections where the term "General Conditions" is used, it shall include the "Supplementary Conditions" and/or "Special Conditions" bound in this project manual.

MISCELLANEOUS PROVISIONS:

A. TESTS AND INSPECTIONS

Add the following clarification: **Regardless of how it is described elsewhere in the drawings and specifications, the contractor shall engage all testing laboratories / subcontractors as approved by the Architect; and, pay for ALL testing as required by the drawings and**

specifications. The Contractor shall pay for any additional testing due to defective work. The Owner shall pay for any additional testing requested and found to be non-defective.

B. EQUAL OPPORTUNITY

The Contractor shall maintain policies of employment as follows:

The Contractor and all Subcontractors shall not discriminate against any employee or applicant for employment because of race, religion, color, sex, or national origin. The Contractor shall take affirmative action to insure that applicants are employed, and that employees are treated fairly during employment without regard to their race, religion, color, sex, or national origin. Such action shall include, but not be limited to the following: employment, upgrading, demotion, or transfer; recruitment advertising; layoff or termination; rates of pay or any other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices setting forth the policies of non-discrimination.

C. COOPERATION WITH BUILDING OFFICIALS

Cooperate with applicable Federal, State, City or other governmental officials and inspectors at all times. If such officials or inspectors deems special inspection necessary, provide assistance and facilities that will expedite his inspection.

D. MEASUREMENTS

Before doing any work or ordering any materials, the Contractor shall verify all measurements of existing and new work, and shall be responsible for their correctness.

Any differences which may be found shall be submitted to the Architect for consideration before proceeding with the work. No extra compensation will be allowed because of differences between actual dimensions and measurements indicated on the working drawings.

E. MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS

Install all manufactured items of materials or equipment in strict accordance with manufacturer's recommended specifications, except that the specifications herein, where more stringent, shall be complied with.

At the completion of the project and prior to final acceptance by the Owner, provide the Owner with three complete sets of operating and maintenance instructions, and demonstrate to him the procedures for proper operation and maintenance of all equipment.

F. JOB MAINTENANCE

During the course of their work, all crafts and trades shall protect all work which preceded theirs from damage, and they shall make repairs or replacements to any damage caused either directly or indirectly by them.

G. COMPLIANCE WITH STATE AND FEDERAL LAWS

Contractor assumes full responsibility for the payment of all contributions and payroll taxes (state and federal) as to all subcontractors and employees engaged in the performance of work pursuant hereto and further agrees to check and meet all requirements that might be specified under regulations of the administrative officials or board charged with the enforcement of any state or federal act on the subject referred to. Contractor agrees to furnish Owner, upon request, a certificate or other evidence of compliance therewith.

H. OCCUPATIONAL SAFETY AND HEALTH ACT OF 1970 (OSHA)

The Contractor shall comply with the latest edition and revision of The Federal Occupational Safety and Health Act of 1970 for construction.

I. GUARANTY BONDS

1. Prior to the Owner signing the contract agreement, he will require the Contractor to furnish performance and payment bonds covering the faithful performance of the entire construction contract agreement. The performance bond and the payment bond shall each be made out in one hundred percent (100%) of the contract sum and shall be in a company or companies against which the Owner has no reasonable objection.
2. Bonds shall be signed by an official of the bonding company, and shall be accompanied by the bonding agent's written power-of-attorney in order that one copy may be attached to each copy of the contract agreement.
3. The Contractor shall include in his proposal amount the total premiums for all required bonds.
4. The Contractor does hereby warrant and/or guarantee against defects in all workmanship and materials performed or furnished by him directly or by his subcontractors for a period of one (1) year from the date of completion, as evidenced by the date of the Final Certificate or final acceptance of the project. Said warranty and/or

guarantee shall be in the form of a good and sufficient bond in a sum equal to one hundred percent (100%) of the contract price.

End of Special Conditions

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01010-SUMMARY OF THE WORK

Part 1 - General

1.01 Work Included:

- A. The General Conditions, Bidding Requirements, and Division I are hereby made a part of each of the technical sections that follow, and shall be understood to apply and shall apply in full to all individuals or corporations who contract or subcontract to perform any part or all of the project work.
- B. Indications on the working drawings or in any section of the specifications of an article or material, operation, or method, requires that the Contractor shall provide each item or service or quality or is subject to qualifications noted; and, the Contractor shall perform each operation prescribed according to the conditions stated providing, therefore, all necessary labor, equipment, and incidentals to complete the project work.
- C. The project:
 1. Name: Kingsgate Elementary School HVAC Replacement
- Moore Public Schools.
 2. Location: 1400 Kingsgate Road - Oklahoma City, Oklahoma
73159.

1.02 Summary of Work:

- A. **Base Bid:** Provide and pay for all materials, labor, services, equipment, licenses, taxes, permits, and other items necessary for the complete construction of an (approximately) 31,936 s.f. new addition including new sidewalks, driveway realignment, and site utilities. And, limited demolition of portions of the existing building to accommodate connection to the new addition. Contractor shall maintain all barriers, guards and other environmental items required at the site during construction.
- B. Owner: Moore Public Schools
 1. Owner's Representative:
Jeff Horn, Assistant Superintendent, Operations
Moore Public Schools
1500 SE 4th Street
Moore, OK 73160
405-735-4221
- C. Design Team:
 1. Architect:
Mike Abla, Principal Architect
AGP
201 N. Broadway, Suite 210
Moore, OK 73160
405-735-3477
 2. Structural Engineer:
Brandon Birch, Structural Engineer
KFC Engineering, Inc.
525 Central Park Drive, Suite 202
Oklahoma City, OK 73105
405-528-4596

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01010-SUMMARY OF THE WORK

3. Mechanical, Electrical and Plumbing Engineers:
Dwayne Gordon, Mechanical Engineer
Salas O'Brien
2600 Van Buren St., Suite 2604
Norman, OK 73072
 4. Construction Management Team:
Joe Sherga, Project Manager
Omni Construction LLC
1909 S. Eastern Ave.
Moore, OK 73160
405-735-3992
- 1.04 Work to be Provided and Installed By Others:
Not applicable.
- 1.05 Use of the Site:
- A. Confine operations at the site to the areas permitted under the contract. Portions of the site beyond areas on which work is indicated are not to be disturbed.
 - B. Keep facility free from accumulation of waste material, rubbish or construction debris.
- 1.06 Safety of Persons and property:
- A. Contractor shall at all times protect the building from damage from rainwater.
 - B. Contractor shall provide barricades and clearly mark work zone areas.
 - C. Refer to Special Conditions "Temporary Services" for additional information.
 - D. During the period of construction, the OSHA Standards shall be followed as applicable by law.
 - E. The Contractor shall post emergency telephone numbers.
- 1.07 Preconstruction Conference:
- A. A preconstruction meeting will be held at a time and place designated by the Architect or Owner's Representative, for the purpose of identifying responsibilities of the Owner's and the Architect's personnel and explanation of administrative procedures.
 - B. The Contractor shall use this meeting for the following minimum agenda:
 1. Construction Schedule/Project Phasing.
 2. Use of areas of the site.
 3. Delivery and storage.
 4. Safety.
 5. Security.
 6. Cleaning up.
 7. Subcontractor procedures relating to:
 - a. Submittals.
 - b. Change orders.
 - c. Applications for payment.
 - d. Record documents.
 - C. The attendees shall include:
 1. The Owner's Representatives.
 2. The Architect.

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01010-SUMMARY OF THE WORK

3. The Contractor and its superintendent.
- 1.08 Project Scheduling:
 - A. The Contractor is responsible for the scheduling of construction and must prepare a schedule and charting system described below. This schedule is to ensure adequate planning and execution of the work by the contractor and to assist the Architect in appraising the schedule and evaluating the progress of the work.
 - B. The project schedule shall be presented within ten (10) days after receipt of the Notice to Proceed. Three (3) copies of the schedule shall be submitted to the Architect for review and approval.
 - C. The schedule logic must be in the form of a "fenced" bar chart or Critical Path Method network indicating the planned start and completion dates of the activity, logical constraints between activities, and total float of each activity.
 - D. An updated project schedule shall be provided when requested by the Architect.
 - 1.09 Environmental Controls:
 - A. Water Resources:
 1. Oily substances: prevent oily or other hazardous substances from entering the ground, drainage areas, or local bodies of water.
 2. Mosquito abatement: prevent ponding of stagnant water conducive to mosquito breeding habitat.
 - B. Land Resources:
 1. Erodible soils: plan and conduct earthwork to minimize the duration of exposure of unprotected soils. Clear areas in reasonably sized increments only as needed to use the areas developed. Immediately protect side slopes and back slopes upon completion of rough grading.
 - C. Air resources:
 1. Prevent creation of dust, air pollution, and odors.
 2. Use water sprinkling, temporary enclosures, and other appropriate methods to limit dust and dirt rising and scattering in air to locate practical level.
 3. Store volatile liquids, including fuels and solvents, in closed containers.
 4. Properly maintain equipment to reduce gaseous pollutant emissions.
 - D. Comply with all applicable environmental control guidelines as required by the City of Moore.
 - 1.10 Temporary Utilities:
 - A. The Contractor shall provide and pay for all temporary utilities required for the complete construction of the project including, but not limited to, electricity, lighting, heating, cooling, ventilating, telephone, water, sanitary facilities, exterior and interior enclosures, access roads and parking areas, cleaning and waste removal, project identification and signs, etc.
 - 1.11 Cleaning:
 - A. Use cleaning materials and agents recommended by manufacturer

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01010-SUMMARY OF THE WORK

or fabricator of surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property, or that might damage finished surfaces.

- B. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of work to condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's published instructions.
- C. Complete cleaning operations prior to requesting a Final / Substantial Completion Inspection.

End of Section

DIVISION 2 - SITE WORK

SECTION 02050 - DEMOLITION

Part 1 - General

1.01 Work Included:

- A. The General Conditions and applicable sections of Division 1 shall apply to this entire section.
- B. All materials, labor, services and incidentals necessary for the completion of this section of the work.
- C. Complete demolition of the existing paving and curbs; complete demolition of the existing curbs as necessary to construct new entry driveways; removal of existing trees; and all site materials as shown on the Drawings.
- D. Removal of all materials, debris and rubbish from site. Refer to Part 3 for ownership of materials.

1.02 Submittals:

- A. Scheduling of Alteration and Demolition Work:
 1. Before commencing any alteration removal or demolition work the contractor shall prepare and submit for approval by the Architect, a schedule showing the commencement, the order, and the completion dates of the various parts of this work.
 2. Before starting any work relating to existing utilities (electrical, heat, gas, etc.) that will temporarily discontinue or disrupt services to any existing building, the Contractor shall be required to give notice to the Architect and obtain his approval in writing before proceeding with this phase of work.

Part 2 - Materials (not applicable)

Part 3 - Execution

3.01 General Requirements:

- A. Permits, Licenses, Ordinances and Regulations:

All work shall comply with local and other governing ordinance, codes and regulations, but this requirement does not relieve the Contractor of responsibility of complying with these specifications. Complying with requirements of state, county or local laws, ordinances and regulations regarding demolition work is the responsibility of the Contractor, who shall pay any and all fees, and give any notices necessary in connection therewith.

3.02 Demolition of Work To Be Modified:

- A. Alterations and demolition shall be as indicated on the Drawings and in accordance with applicable technical sections of the specifications. The Contractor shall do all necessary demolition or removal of existing work as required in connection with this project, including shoring, bracing, etc. and removal of unwanted material and debris from the site. Demolish existing items only as necessary to tie on new construction as detailed. This work shall be done in a most careful manner, as the Contractor will be held responsible for any damage which

DIVISION 2 - SITE WORK

SECTION 02050 - DEMOLITION

- may be caused thereby to any part or parts of existing streets, neighboring buildings, and grounds.
- B. When alterations occur, or new and old work join, the immediate adjacent surfaces or so much thereof as required by the involved conditions, shall be cut, removed, patched, repaired or refinished and left in as good a condition as existed prior to the commencing of the work, and matching the remainder of the existing paving, etc.
 - C. Conduit and piping found underground on the site, or other areas involved in demolition or alteration shall be removed, re-rerouted or protected as required by the Drawings. Where these items are found; but not covered in the drawings, the Contractor shall notify the Architect for disposition instructions.
 - D. Maintain existing utility services to remain and protect from damage during demolition operations.
 - E. The Contractor shall furnish and install adequate guards, barricades and other temporary protection to prevent injury to persons.
 - F. The Contractor shall make every effort to control the amount of dust and the noise level generated by demolition operations.
- 3.03 Ownership and Disposition of Materials:
- A. Classification of removed materials (re: Drawings for applicable items):
 - 1. **Reinstalled:** Items are those items which, after removal, are to be used, reinserted, remounted or otherwise built back into the work under this contract.
 - 2. **Salvaged:** Items are those items which, after removal, are to be retained by the Owner and delivered for storage on the Owner=s premises.
 - 3. **Scrapped:** Items are all other removed materials or equipment. This includes all items which are not noted or specified for reinstallation or salvage.
 - B. Disposition by Classification:
 - 1. **Reinstalled:** Items of material or equipment shown on the work shall be jointly inspected by the Contractor and the Architect prior to dismantling or removal. An agreement shall be reached briefly setting forth the apparent condition of the material or equipment, and approved by the Architect. Simple operating test of operative equipment will be included with this joint inspection if feasible. Such items shall be reinstalled as specified in the applicable sections of the specifications covering new items of similar categories.
 - 2. **Salvaged:** Materials and equipment noted on the Drawings or listed to be salvaged shall be carefully handled and protected and shall be delivered to storage areas, as designated by the Architect, on the Owner=s premises.
 - 3. **Scrapped:** All removed materials and equipment not noted on the drawings specified to be reinstalled, shall be considered as scrap and shall be disposed of by the

DIVISION 2 - SITE WORK

SECTION 02050 - DEMOLITION

Contractor off the Owner=s premises and credit for the value thereof, if any, shall have been reflected in the Contractor's bid price.

3.04 Clean-Up:

- A. Disposition of all material, debris and rubbish shall be the responsibility of the Contractor. Leave site clean. Completely remove all materials, debris, and rubbish from site. Absolutely no burning of debris on the site will be allowed.
- B. **The Contractor shall submit proposed refuse dumping sites to the Architect and shall receive written approval from the Architect concerning acceptable dumping sites prior to the disposition of any material, debris or rubbish generated by this project.**

End of Section

DIVISION 2 - SITE WORK

SECTION 02110 - TEMPORARY CONSTRUCTION FENCING

Part 1 - General

1.01 Summary

- A. Section includes: Erection, maintenance and dismantling of temporary fencing around construction site and materials storage areas. This section does not apply where security fencing is required.
- B. Refer to Drawings for temporary fencing layout and location of gates.

1.02 Submittals

- A. Submit the following:
 - 1. Shop drawing indicating layout of temporary fencing, location and size of gates, existing pavement and roads, access to fire hydrants and hose connections, and other site specific conditions. Prepare drawing after site observation and verification of existing conditions.

Part 2 - Products

2.01 Temporary Chain Link fencing:

- A. Unless otherwise indicated, type of temporary chain link fencing shall be Contractor's option. Following types are acceptable:
 - 1. New materials or previously used salvaged chain link fencing in good condition.
 - 2. Posts: Galvanized steel pipe of diameter to provide rigidity. Post shall be suitable for setting in concrete footings, driving into ground, anchoring with base plates, or inserting in precast concrete blocks.
 - 3. Fabric: Woven galvanized steel wire mesh. Provide in continuous lengths to be wire tied to fence posts or prefabricated into modular pipe-framed fence panels.
 - 4. Height: Minimum Height shall be 8'-0".
- B. Gates: Provide personnel and vehicle gates of the quantity and size indicated on the Drawings or required for functional access to site.
 - 1. Fabricate of same material as used for fencing.
 - 2. Vehicle gates:
 - a. Minimum width: 20 feet to allow access for emergency vehicles.
 - b. Capable of manual operation by one person.

Part 3 - Execution:

3.01 Layout:

- A. Installation of temporary fencing shall not deter or hinder

DIVISION 2 - SITE WORK

SECTION 02110 - TEMPORARY CONSTRUCTION FENCING

access to existing and new hose connections and fire hydrants.

1. Maintain 3 feet diameter clear space around fire hydrants.
 2. Where fire hydrant or hose connection is blocked by fencing, provide access gate.
- B. Access: Provide gates for personnel, delivery of materials, and access by emergency vehicles.

3.02 Installation:

A. Chain link posts:

1. Space at 10'-0" maximum.
2. Drive posts, set in holes and backfill, or anchor in precast concrete blocks.
3. For soft and unstable ground conditions, cast concrete plug around post.
4. Posts over pavement: Use steel post plates or precast concrete blocks.
5. Gate posts: Use bracing or concrete footings to provide rigidity for accommodating size of gate.

B. Fabric: Securely attach to posts.

C. Gates: Install with required hardware.

D. Plastic mesh fencing: Space steel support posts to ensure mesh remains vertical and at proper height. Securely tie mesh to posts.

3.03 Maintenance and Removal:

- A. Maintain fencing in good condition. If damaged, immediately repair.
- B. Remove temporary fencing upon completion of Work or when no longer required for security or control. Backfill holes and compact. Holes in pavement shall be surfaced to match existing paving. Repair damage caused by installation of temporary fencing.

End of Section

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

PART 1 - GENERAL

1.01 Related Documents

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions Sections, apply to this Section.

1.02 Summary

- A. This Section includes the following:
 - 1. Exterior and interior non-load-bearing wall framing.
- B. Related Sections include the following:
 - 1. Division 9 Section "Gypsum Board Assemblies" for interior non-load-bearing, metal-stud framing and ceiling-suspension assemblies.

1.03 Performance Requirements

- A. Structural Performance: Provide cold-formed metal framing capable of withstanding design loads within limits and under conditions indicated.
 - 1. Design Loads: Design loads shall be calculated components and cladding load per ASCE/SEI 7 edition indicated on the drawings.
 - 2. Deflection Limits: Design framing systems to withstand design loads without deflections greater than the following:
 - a. Exterior Non-Load-Bearing Framing: Horizontal deflection of 1/600 of wall height at areas backing up brick veneer, and 1/240 of wall height at areas backing up other materials.
 - 3. Design framing system to maintain clearances at openings, to allow for construction tolerances, and to accommodate live load deflection of primary building structure as follows:
 - a. Upward and downward movement of 1 inch.
- B. Cold-Formed Steel Framing, General: Design according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions."
 - 1. Headers: Design according to AISI's "Standard for Cold-Formed Steel Framing - Header Design."
 - 2. Design exterior non-load-bearing wall framing to accommodate horizontal deflection without regard for contribution of sheathing materials.

1.04 Submittals

- A. Product Data: For each type of cold-formed metal framing product and accessory indicated.
- B. Shop Drawings: Show layout, spacings, sizes, thicknesses, and types of cold-formed metal framing; fabrication; and fastening and anchorage details, including mechanical fasteners. Show reinforcing channels, opening framing,

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

supplemental framing, strapping, bracing, bridging, splices, accessories, connection details, and attachment to adjoining work.

1. For cold-formed metal framing indicated to comply with design loads, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

C. Welding certificates.

D. Research/Evaluation Reports: For cold-formed metal framing.

1.05 Quality Assurance

A. Engineering Responsibility: Preparation of Shop Drawings, design calculations, and other structural data by a qualified professional engineer.

B. Professional Engineer Qualifications: A professional engineer who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing engineering services of the kind indicated. Engineering services are defined as those performed for installations of cold-formed metal framing that are similar to those indicated for this Project in material, design, and extent.

C. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code--Steel," and AWS D1.3, "Structural Welding Code--Sheet Steel."

D. AISI Specifications and Standards: Comply with AISI's "North American Specification for the Design of Cold-Formed Steel Structural Members" and its "Standard for Cold-Formed Steel Framing - General Provisions."

1. Comply with AISI's "Standard for Cold-Formed Steel Framing - Truss Design."

2. Comply with AISI's "Standard for Cold-Formed Steel Framing - Header Design."

1.06 Delivery, Storage, And Handling

A. Protect cold-formed metal framing from corrosion, deformation, and other damage during delivery, storage, and handling.

B. Store cold-formed metal framing, protect with a waterproof covering, and ventilate to avoid condensation.

PART 2 - PRODUCTS

2.01 Manufacturers

A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering cold-formed metal framing that may be incorporated into the Work include, but are not limited to, the following:

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

1. Allied Studco.
2. AllSteel Products, Inc.
3. California Expanded Metal Products Company.
4. Clark Steel Framing.
5. Consolidated Fabricators Corp.; Building Products Division.
6. Craco Metals Manufacturing, LLC.
7. Custom Stud, Inc.
8. Dale/Incor.
9. Design Shapes in Steel.
10. Dietrich Metal Framing; a Worthington Industries Company.
11. Formetal Co. Inc. (The).
12. Innovative Steel Systems.
13. MarinoWare; a division of Ware Industries.
14. Quail Run Building Materials, Inc.
15. SCAFCO Corporation.
16. Southeastern Stud & Components, Inc.
17. Steel Construction Systems.
18. Steeler, Inc.
19. Super Stud Building Products, Inc.
20. United Metal Products, Inc.

2.02 Materials

- A. Steel Sheet: ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of grade and coating weight as follows:
 1. Grade: ST33H (ST230H).
 2. Coating: G60 (Z180).
- B. Steel Sheet for Vertical Deflection Clips: ASTM A 653/A 653M, structural steel, zinc coated, of grade and coating as follows:
 1. Grade: 50 (340), Class 1 or 2.
 2. Coating: G90 (Z275).

2.03 Exterior Non-Load-Bearing Wall Framing

- A. Steel Studs: Manufacturer's standard C-shaped steel studs, of web depths indicated, punched, with stiffened flanges, and as follows:
 1. Minimum Base-Metal Thickness: 0.0428 inches (1.09 mm).
 2. Flange Width: 1-5/8 inches (41 mm).
- B. Steel Track: Manufacturer's standard U-shaped steel track, of web depths indicated, unpunched, with unstiffened flanges, and as follows:
 1. Minimum Base-Metal Thickness: 0.0538 inches (1.37 mm)
 2. Flange Width: 1-1/2 inches.
- C. Vertical Deflection Clip Option: Manufacturer's standard head clips, capable of accommodating upward and downward

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

vertical displacement of primary structure through positive mechanical attachment to stud web.

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Dietrich Metal Framing; a Worthington Industries Company.
 - b. MarinoWare, a division of Ware Industries.
 - c. SCAFCO Corporation
 - d. The Steel Network, Inc.
 - D. Single Deflection Track Option: Manufacturer's single, deep-leg, U-shaped steel track; unpunched, with unstiffened flanges, of web depth to contain studs while allowing free vertical movement, with flanges designed to support horizontal and lateral loads and transfer them to the primary structure, and as follows:
 1. Minimum Base-Metal Thickness: 0.0538 inch (1.37 mm).
 2. Flange Width: 1 inch (25 mm) plus the design gap for 1-story structures and 1 inch (25 mm) plus twice the design gap for other applications.
 - E. Double Deflection Track Option: Manufacturer's double, deep-leg, U-shaped steel tracks, consisting of nested inner and outer tracks; unpunched, with unstiffened flanges.
 1. Outer Track: Of web depth to allow free vertical movement of inner track, with flanges designed to support horizontal and lateral loads and transfer them to the primary structure, and as follows:
 - a. Minimum Base-Metal Thickness: 0.0538 inch (1.37 mm).
 - b. Flange Width: 1 inch (25 mm) plus the design gap for 1-story structures and 1 inch (25 mm) plus twice the design gap for other applications.
 2. Inner Track: Of web depth indicated, and as follows:
 - a. Minimum Base-Metal Thickness: 0.0428 inch (1.09 mm).
 - b. Flange Width: Equal to sum of outer deflection track flange width plus 1 inch.
- 2.04 Ceiling Joist Framing
- A. Steel Ceiling Joists: Manufacturer's standard C-shaped steel sections, of web depth indicated, unpunched, with stiffened flanges, and as follows:
 1. Minimum Base-Metal Thickness: As indicated on drawings.
 2. Flange Width: 1-5/8 inches (41 mm) minimum.

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

2.05 Framing Accessories

- A. Fabricate steel-framing accessories from steel sheet, ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of same grade and coating weight used for framing members.
- B. Provide accessories of manufacturer's standard thickness and configuration, unless otherwise indicated, as follows:
 - 1. Supplementary framing.
 - 2. Bracing, bridging, and solid blocking.
 - 3. Web stiffeners.
 - 4. Anchor clips.
 - 5. End clips.
 - 6. Foundation clips.
 - 7. Gusset plates.
 - 8. Stud kickers, knee braces, and girts.
 - 9. Joist hangers and end closures.
 - 10. Hole reinforcing plates.
 - 11. Backer plates.

2.06 Anchors, Clips, And Fasteners

- A. Anchor Bolts: ASTM F 1554, Grade 55, threaded carbon-steel headless bolts, with encased end threaded, and carbon-steel nuts; and flat, hardened-steel washers; zinc coated by hot-dip process according to ASTM A 153/A 153M, Class C or mechanically deposition according to ASTM B 695, Class 50.
- B. Expansion Anchors: Fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 488 conducted by a qualified independent testing agency.
- C. Power-Actuated Anchors: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 1190 conducted by a qualified independent testing agency.
- D. Mechanical Fasteners: ASTM C 1513, corrosion-resistant-coated, self-drilling, self-tapping steel drill screws.
 - 1. Head Type: Low-profile head beneath sheathing, manufacturer's standard elsewhere.
- E. Welding Electrodes: Comply with AWS standards.

2.07 Miscellaneous Materials

- A. Galvanizing Repair Paint: ASTM A 780.
- B. Nonmetallic, Nonshrink Grout: Premixed, nonmetallic, noncorrosive, nonstaining grout containing selected silica sands, portland cement, shrinkage-compensating agents, and plasticizing and water-reducing agents, complying with

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

ASTM C 1107, with fluid consistency and 30-minute working time.

- C. Shims: Load bearing, high-density multimonomer plastic, nonleaching.
- D. Sealer Gaskets: Closed-cell neoprene foam, 1/4 inch (6.4 mm) thick, selected from manufacturer's standard widths to match width of bottom track or rim track members.

2.08 Fabrication

- A. Fabricate cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened, according to referenced AISI's specifications and standards, manufacturer's written instructions, and requirements in this Section.
 - 1. Fabricate framing assemblies using jigs or templates.
 - 2. Cut framing members by sawing or shearing; do not torch cut.
 - 3. Fasten cold-formed metal framing members by welding, screw fastening, clinch fastening, or riveting as standard with fabricator. Wire tying of framing members is not permitted.
 - a. Comply with AWS D1.3 requirements and procedures for welding, appearance and quality of welds, and methods used in correcting welding work.
 - b. Locate mechanical fasteners and install according to Shop Drawings, with screw penetrating joined members by not less than three exposed screw threads.
 - 4. Fasten other materials to cold-formed metal framing by welding, bolting, or screw fastening, according to Shop Drawings.
- B. Reinforce, stiffen, and brace framing assemblies to withstand handling, delivery, and erection stresses. Lift fabricated assemblies to prevent damage or permanent distortion.
- C. Fabrication Tolerances: Fabricate assemblies level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet (1:960) and as follows:
 - 1. Spacing: Space individual framing members no more than plus or minus 1/8 inch (3 mm) from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.
 - 2. Squareness: Fabricate each cold-formed metal framing assembly to a maximum out-of-square tolerance of 1/8 inch (3 mm).

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

PART 3 - EXECUTION

3.01 Examination

- A. Examine supporting substrates and abutting structural framing for compliance with requirements for installation tolerances and other conditions affecting performance.
 - 1. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 Installation, General

- A. Cold-formed metal framing may be shop or field fabricated for installation, or it may be field assembled.
- B. Install cold-formed metal framing according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions" and to manufacturer's written instructions unless more stringent requirements are indicated.
- C. Install shop- or field-fabricated, cold-formed framing and securely anchor to supporting structure.
 - 1. Screw, bolt, or weld wall panels at horizontal and vertical junctures to produce flush, even, true-to-line joints with maximum variation in plane and true position between fabricated panels not exceeding 1/16 inch (1.6 mm).
- D. Install cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened.
 - 1. Cut framing members by sawing or shearing; do not torch cut.
 - 2. Fasten cold-formed metal framing members by welding, screw fastening, clinch fastening, or riveting. Wire tying of framing members is not permitted.
 - a. Comply with AWS D1.3 requirements and procedures for welding, appearance and quality of welds, and methods used in correcting welding work.
 - b. Locate mechanical fasteners and install according to Shop Drawings, and complying with requirements for spacing, edge distances, and screw penetration.
- E. Install framing members in one-piece lengths unless splice connections are indicated for track or tension members.
- F. Install temporary bracing and supports to secure framing and support loads comparable in intensity to those for which structure was designed. Maintain braces and supports in place, undisturbed, until entire integrated supporting structure has been completed and permanent connections to framing are secured.

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

- G. Do not bridge building expansion and control joints with cold-formed metal framing. Independently frame both sides of joints.
 - H. Install insulation, specified in Division 7 Section "Building Insulation," in built-up exterior framing members, such as headers, sills, boxed joists, and multiple studs at openings, that are inaccessible on completion of framing work.
 - I. Fasten hole reinforcing plate over web penetrations that exceed size of manufacturer's standard punched openings.
 - J. Erection Tolerances: Install cold-formed metal framing level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet (1:960) and as follows:
 - 1. Space individual framing members no more than plus or minus 1/8 inch (3 mm) from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.
- 3.03 Exterior Non-Load-Bearing Wall Installation
- A. Install continuous tracks sized to match studs. Align tracks accurately and securely anchor to supporting structure as indicated.
 - B. Fasten both flanges of studs to bottom track, unless otherwise indicated. Fast both flanges to top track if required by deflection option selected. Space studs as follows:
 - 1. Stud Spacing: 16 inches.
 - C. Set studs plumb, except as needed for diagonal bracing or required for nonplumb walls or warped surfaces and similar requirements.
 - D. Isolate non-load-bearing steel framing from building structure to prevent transfer of vertical loads while providing lateral support.
 - 1. Single Deflection Track Option: Install single-leg deflection tracks and anchor to building structure.
 - 2. Double Deflection Track Option: Install double deep-leg deflection tracks and anchor outer track to building structure.
 - 3. Deflection Clip Option: Connect vertical deflection clips to infill studs and anchor to building structure.
 - E. Install horizontal bridging in wall studs, spaced in rows indicated on Shop Drawings but not more than 48 inches apart. Fasten at each stud intersection.
 - 1. Top Bridging for Single Deflection Track Option: Install row of horizontal bridging within 12 inches of single deflection track. Install a combination of

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

flat, taut, steel sheet straps of width and thickness indicated and stud or stud-track solid blocking of width and thickness matching studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.

a. Install solid blocking at maximum 96-inch centers and as shown on approved Shop Drawings.

2. Bridging Options:

a. Cold-rolled steel channel, welded or mechanically fastened to webs of punched studs.

b. Combination of flat, taut, steel sheet straps of width and thickness indicated and stud-track solid blocking of width and thickness to match studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.

c. Proprietary bridging bars installed according to manufacturer's written instructions.

F. Install miscellaneous framing and connections, including stud kickers, web stiffeners, clip angles, continuous angles, anchors, fasteners, and stud girts, to provide a complete and stable wall-framing system.

3.04 Joist Installation

A. Install perimeter joist track sized to match joists. Align and securely anchor or fasten track to supporting structure at corners, ends, and spacings indicated on Shop Drawings.

B. Install joists bearing on supporting frame, level, straight, and plumb; adjust to final position, brace, and reinforce. Fasten joists to both flanges of joist track.

1. Unless shown otherwise in drawings, install joists over supporting frame with a minimum end bearing of 1-1/2 inches (38 mm).

2. Reinforce ends and bearing points of joists with web stiffeners, end clips, joist hangers, steel clip angles, or steel-stud sections as indicated on drawings.

C. Space joists not more than 2 inches (51 mm) from abutting walls, and as follows:

1. Joist Spacing: As indicated.

D. Frame openings with built-up joist headers consisting of joist and joist track, nesting joists, or another combination of connected joists if indicated.

E. Install bridging at intervals indicated. Fasten bridging at each joist intersection as follows:

1. Bridging: Joist-track solid blocking of width and thickness indicated, secured to joist webs.

F. Install miscellaneous joist framing and connections, including web stiffeners, closure pieces, clip angles,

DIVISION 5 - METALS

SECTION 05400 - COLD-FORMED METAL FRAMING

continuous angles, hold-down angles, anchors, and fasteners, to provide a complete and stable joist-framing assembly.

3.05 Field Quality Control

- A. Testing: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Field and shop welds will be subject to testing and inspecting.
- C. Testing agency will report test results promptly and in writing to Contractor and Architect.
- D. Remove and replace work where test results indicate that it does not comply with specified requirements.
- E. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

3.06 Repairs And Protection

- A. Galvanizing Repairs: Prepare and repair damaged galvanized coatings on fabricated and installed cold-formed metal framing with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Provide final protection and maintain conditions, in a manner acceptable to manufacturer and installer that ensures the cold-formed metal framing is without damage or deterioration at time of Substantial Completion.

END OF SECTION

DIVISION 5 - STRUCTURAL STEEL

SECTION 05500 - METAL FABRICATIONS

PART 1 - GENERAL

1.01 Section Includes

- A. Shop fabricated steel items.

1.02 Related Requirements - where applicable.

- A. Section 03 3000 - Cast-in-Place Concrete: Placement of metal fabrications in concrete.
- B. Section 04 2000 - Unit Masonry: Placement of metal fabrications in masonry.
- C. Section 05 1200 - Structural Steel Framing: Structural steel column anchor bolts.
- D. Section 05 2100 - Steel Joist Framing: Structural joist bearing plates, including anchorage.
- E. Section 05 3100 - Steel Decking: Bearing plates for metal deck bearing, including anchorage.
- F. Section 05 5100 - Metal Stairs.

1.03 Reference Standards

- A. For all reference standards listed below, comply with the version year in the governing building code adopted by the Authority Having Jurisdiction. For those reference standards that are not directly referenced by the building code, use the latest edition unless noted otherwise.
- B. ASTM A36/A36M - Standard Specification for Carbon Structural Steel.
- C. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless.
- D. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products.
- E. ASTM A283/A283M - Standard Specification for Low and Intermediate Tensile Strength Carbon Steel Plates.
- F. ASTM A307 - Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength.
- G. ASTM A501/A501M - Standard Specification for Hot-Formed Welded and Seamless Carbon Steel Structural Tubing.
- H. ASTM F3125/F3125M - Standard Specification for High Strength Structural Bolts and Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions 120 ksi and 150 ksi Minimum Tensile Strength, and Metric Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength.
- I. AWS A2.4 - Standard Symbols for Welding, Brazing, and Nondestructive Examination.
- J. AWS D1.1/D1.1M - Structural Welding Code - Steel.
- K. MPI #79 - Primer, Alkyd, Anti-Corrosive for Metal.
- L. SSPC-Paint 20 - Zinc-Rich Primers (Type I, "Inorganic," and Type II, "Organic").

DIVISION 5 - STRUCTURAL STEEL

SECTION 05500 - METAL FABRICATIONS

1.04 Submittals

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate profiles, sizes, connection attachments, reinforcing, anchorage, size and type of fasteners, and accessories. Include erection drawings, elevations, and details where applicable.
 - 1. Indicate welded connections using standard AWS A2.4 welding symbols. Indicate net weld lengths.
 - 2. Design data: Submit drawings and supporting calculations, signed and sealed by a qualified professional structural engineer.
 - a. Include the following, as applicable:
 - 1) Design criteria.
 - 2) Engineering analysis depicting stresses and deflections.
 - 3) Member sizes and gauges.
 - 4) Details of connections.
 - 5) Support reactions.
 - 6) Bracing requirements.

PART 2 - PRODUCTS

2.01 Materials - Steel

- A. Steel Sections: ASTM A36/A36M.
- B. Steel Tubing: ASTM A501/A501M hot-formed structural tubing.
- C. Plates: ASTM A283/A283M.
- D. Pipe: ASTM A53/A53M, Grade B Schedule 40, black finish.
- E. Mechanical Fasteners: Same material as or compatible with materials being fastened; type consistent with design and specified quality level.
- F. Bolts, Nuts, and Washers: ASTM A307, Grade A, plain.
- G. Bolts, Nuts, and Washers: ASTM F3125/F3125M, Type 1, plain.
- H. Welding Materials: AWS D1.1/D1.1M; type required for materials being welded.
- I. Shop and Touch-Up Primer: As required below, complying with VOC limitations of authorities having jurisdiction.
 - 1. Steel Exposed to Exterior Weather or an Uncontrolled Environment: Two-component, high performance, zinc-rich, aromatic urethane, compatible with topcoat and complying with SSPC-Paint 20.
 - 2. Interior Steel: Fabricator's standard lead- and chromate-free, non-asphaltic, rust-inhibiting primer complying with MPI #79 and compatible with topcoat.

DIVISION 5 - STRUCTURAL STEEL

SECTION 05500 - METAL FABRICATIONS

- J. Touch-Up Primer for Galvanized Surfaces: SSPC-Paint 20, complying with VOC limitations of authorities having jurisdiction.
- 2.02 Fabrication
- A. Fit and shop assemble items in largest practical sections, for delivery to site.
 - B. Fabricate items with joints tightly fitted and secured.
 - C. Grind exposed joints flush and smooth with adjacent finish surface. Make exposed joints butt tight, flush, and hairline. Ease exposed edges to small uniform radius.
 - D. Supply components required for anchorage of fabrications. Fabricate anchors and related components of same material and finish as fabrication, except where specifically noted otherwise.
- 2.03 Fabricated Items
- A. Ledge Angles, Shelf Angles, Channels, and Plates Not Attached to Structural Framing: For support of metal decking and joists; prime paint finish.
 - B. Lintels: As detailed; prime paint finish.
 - C. Door Frames for Overhead Door Openings and Wall Openings: Channel sections; prime paint finish.
 - D. Elevator Hoistway Divider Beams: Beam sections; prime paint finish.
 - E. Toilet Partition Suspension Members: Steel channel sections; prime paint finish.
- 2.04 Finishes - Steel
- A. Prime paint steel items.
 - 1. Exceptions: Galvanize items to be embedded in concrete and items to be embedded in masonry.
 - 2. Exceptions: Do not prime surfaces in direct contact with concrete, where field welding is required, and items to be covered with sprayed fireproofing.
 - B. Prepare surfaces to be primed in accordance with SSPC-SP3 for interior steel or SSPC-SP6 for all steel exposed to exterior weather or an uncontrolled environment.
 - C. Clean surfaces of rust, scale, grease, and foreign matter prior to finishing.
 - D. Prime Painting: One coat.
 - E. Galvanizing of Structural Steel Members: Galvanize after fabrication to ASTM A123/A123M requirements. Provide minimum 1.7 oz/sq ft galvanized coating.
 - F. Galvanizing of Non-structural Items: Galvanize after fabrication to ASTM A123/A123M requirements.
- 2.05 Fabrication Tolerances
- A. Squareness: 1/8 inch maximum difference in diagonal measurements.
 - B. Maximum Offset Between Faces: 1/16 inch.

DIVISION 5 - STRUCTURAL STEEL

SECTION 05500 - METAL FABRICATIONS

- C. Maximum Misalignment of Adjacent Members: 1/16 inch.
- D. Maximum Bow: 1/8 inch in 48 inches.
- E. Maximum Deviation From Plane: 1/16 inch in 48 inches.

PART 3 - EXECUTION

3.01 Examination

- A. Verify that field conditions are acceptable and are ready to receive work.

3.02 Preparation

- A. Clean and strip primed steel items to bare metal where site welding is required.
- B. Supply setting templates to the appropriate entities for steel items required to be cast into concrete or embedded in masonry.

3.03 Installation

- A. Install items plumb and level, accurately fitted, free from distortion or defects.
- B. Provide for erection loads, and for sufficient temporary bracing to maintain true alignment until completion of erection and installation of permanent attachments.
- C. Field weld components as indicated on drawings.
- D. Perform field welding in accordance with AWS D1.1/D1.1M.
- E. Obtain approval prior to site cutting or making adjustments not scheduled.
- F. After erection, prime welds, abrasions, and surfaces not shop primed, except surfaces to be in contact with concrete.

3.04 Tolerances

- A. Maximum Variation From Plumb: 1/4 inch per story, non-cumulative.
- B. Maximum Offset From True Alignment: 1/4 inch.
- C. Maximum Out-of-Position: 1/4 inch.

END OF SECTION

DIVISION 6 - WOOD & PLASTIC

SECTION 06100 - ROUGH CARPENTRY

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Wood Treatment - Section 06300

1.03 Quality Assurance:

- A. Grades specified shall conform to the most recent grading rules as established by the following bureaus and associations.
 - 1. PS 20 - American Softwood Lumber Standard.
 - 2. Western Wood Products Association
 - 3. Southern Pine Inspection Bureau
- B. Grade and trade mark each piece of lumber or bundle on bundled stock. Use only the recognized official marks of association under whose rules it is graded. Grade and trade marks will not be required if each shipment is accompanied by certificate of inspection issued by grading association.

1.04 Submittals:

- A. Product Data: for each type of process and factory-fabricated product. Indicate component materials and dimensions and include construction and application details.
 - 1. Include data for wood preservative treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements. Indicate type of preservative used, net amount of preservative retained, and chemical treatment manufacturer's written instructions for handling, storing, installing and finishing treated material.
 - 2. As requested by authorities having jurisdiction include data for fire-retardant treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements. Include physical properties of treated materials both before and after exposure to elevated temperatures when tested according to ASTM D5516 and ASTM D 5664.
 - 3. Include copies of warranties from chemical treatment manufacturers for each type of treatment.

DIVISION 6 - WOOD & PLASTIC

SECTION 06100 - ROUGH CARPENTRY

4. Research / evaluation reports - for the following, showing compliance with building code in effect for Project:
 - a. Fire-retardant treated wood.
 - b. Power-driven fasteners.
 - c. Power-actuated fasteners.
 - d. Expansion anchors.
 - e. Metal framing anchors.

1.05 Delivery, Storage and Handling:

- A. Stack lumber, plywood, sheathing, and other materials: provide spacers between each bundle to provide air circulation around bundled material. Provide proper air circulation between stacks and under coverings.

Part 2 - Products

2.01 General:

- A. Provide best quality of respective grades and kinds. Lumber and plywood shall be produced from wood obtained from forests certified by an FSC-accredited certification body to comply with FSC STD-01-001, "FSC Principles and Criteria for Forest Stewardship". Factory mark each piece of lumber with grade stamp of grading agency.
- B. Maximum moisture content of lumber 19%.
- C. Provide dressed lumber (S4S) unless otherwise indicated.
- D. Where nominal sizes are indicated, provide actual sized required by DOC PS 20 for moisture content specified. Where actual sizes are indicated, they are minimum dressed sizes for dry lumber.

2.02 Grades and Applications of Lumber:

- A. Framing lumber for the following shall be "Standard" grade Douglas Fir (WCLIB or WWPA).
 1. Concealed blocking/nailers, cants, grounds, and miscellaneous wood items used in conjunction with the roofing work and as indicated on the Drawings.
 2. Provide dimension lumber of grades indicated according to the American Lumber Standards Committee National Grading Rule provisions of the Grading Agency indicated.

2.03 Fire-retardant Treated Materials:

- A. General - where fire-retardant treated materials are required by authorities having jurisdiction, provide materials that comply with performance requirements in AWPA C20 (lumber) and AWPA C27 (plywood). Identify fire-retardant treated wood with appropriate classification

DIVISION 6 - WOOD & PLASTIC

SECTION 06100 - ROUGH CARPENTRY

marking of UL, U.S. Testing, Timber Products Inspection, or another testing and inspecting agency acceptable to authorities having jurisdiction.

2.04 Panel Products:

- A. Miscellaneous Concealed Plywood: shear wall sheathing, span rating to suit framing in each location, and thickness indicated. Refer to Structural Drawings.
- B. Telephone and Electrical Equipment Backing Panels: DOC PS 1, C-D Plugged, fire-retardant treated, in thickness indicated, or if not indicated, not less than ½ inch thick.

2.05 Fasteners:

- A. All nails, spikes, bolts, connectors and other fasteners used in connections with this work shall be galvanized.
 - 1. Nails, wire, brads and staples - FS-FF-N-105.
 - 2. Power-driven Fasteners - CABO NER-272.
 - 3. Wood screws - ASME B18.6.1.
 - 4. Screws for fastening to cold formed metal framing: ASTM C954 length as recommended by screw manufacturer for material to be fastened.
 - 5. Lag bolts - ASME B18.2.1.
 - 6. Bolts - steel bolts complying with ASTM A 307, Grade A with ASTM C563 hex nuts and, where indicated, flat washers.
 - 7. Expansion anchors - anchor bolt and sleeve assembly of material indicated below with capability to sustain, without failure, a load equal to 4 times the load imposed when installed in concrete as determined by testing per ASTM E 488 conducted by a qualified independent testing and inspecting agency.
 - a. Material for interior applications: carbon steel components, zinc plated to comply with ASTM B 633, Class Fe/Zn 5.
 - b. Material for exterior applications: stainless steel with bolts and nuts complying with ASTM F 593 and ASTM F 594, alloy group 1 or 2.

2.06 Metal Framing Anchors:

- A. General: provide galvanized steel framing anchors of structural capacity, type, and size indicated and acceptable to authorities having jurisdiction.
- B. Galvanized Steel Sheet: hot-dip, zinc-coated steel sheet complying with ASTM A 653/A 653M, G60 coating designation.

DIVISION 6 - WOOD & PLASTIC

SECTION 06100 - ROUGH CARPENTRY

Part 3 - Execution

3.01 Sizes and Applications (General Framing):

- A. Members shall be accurately cut and fitted, true to line and level, avoiding shims and wedges as much as possible. Discard material with defects that impair quality of carpentry and that are too small to use with minimum number of joints or optimum joint arrangement.
- B. Where applicable, apply field treatment complying with AWPA M4 to cut surfaces of preservative-treated lumber and plywood.
- C. At wood ground, blocking and nailer installation: install where indicated and required for attaching other work. Form to shapes indicated and cut as required for true line and level of attached work. Coordinate locations with other work involved.
- D. Attach items to substrates to support applied loading. Recess bolts and nuts flush with surfaces, unless noted otherwise.

3.02 Rough Hardware:

- A. Provide all sufficient nails, screws, etc. to insure rigidity and structural soundness. Provide hot-dipped galvanized fasteners at all weather exposed locations.
- B. Spiking and nailing shall be done using largest size spikes and nails practicable and as indicated on the drawings. Securely attach carpentry according to applicable codes and recognized standards.
- C. Bolt nailers and blocking to steel or concrete members with bolts of proportionate strength of members attached, length required, spaced 4'-0" o.c. maximum and 4" from each end, except as otherwise indicated. Countersink fastener heads on exposed carpentry work and fill holes with wood fiber.
- D. Pre-drill members when necessary to avoid splitting of wood.

3.03 Panel Product Installation:

- A. Wood structural panels: comply with applicable recommendations contained in APA Form No. E30K, "APA Design/Construction Guide: Residential and Commercial", for types of structural-use panels and applications indicated. Comply with "Code Plus" provisions in above referenced guide.

End of Section

DIVISION 6 - WOOD & PLASTIC

SECTION 06300 - WOOD TREATMENT

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Quality Assurance:

- A. Standards:
 - 1. American Wood Preservers Association:
 - a. AWPA Standard P-5 (Preservative)
 - b. AWPA Standard Commodity Standards (Treating Process).
 - 2. Federal Specifications:
 - a. TT-W-550 (Preservative).
 - b. TT-W-571 (Treating Process).
- B. All lumber and plywood receiving wood treatment shall bear the trademark of the process used.
- C. Submit certificate and guarantee of the lumber treated.

Part 2 - Products

2.01 Materials:

- A. Description: Waterborne chemical salts intended for pressure impregnation as a wood preservative. Preservatives with a petroleum vehicle are not permitted.

Part 3 - Execution

3.01 Installation:

- A. Location of treated lumber:
 - 1. All blocking, plates, nailers and curbs used in conjunction with gravel guards, roof edges and all other wood components used in the roofing project.
- B. Materials shall be pressure treated in accordance with the standards of the American Wood Preservers Institute and the chemical manufacturer's specifications.
- C. Treated material shall conform to AWPB LD-2 and treated to a maximum retention of 0.23 pound of oxide per cubic foot.
- D. Moisture content of finish products shall not exceed 19%.

End of Section

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07200 - INSULATION

Part 1 - General

1.01 Work Included:

- A. All materials, labor and services and incidentals necessary for the completion of this section of work.

1.02 Quality Assurance:

A. Standards:

1. Federal Specifications:

- a. HH-I-524C, Type IV, Class C, Rigid Insulation.
- b. ASTM C 665-84, Type 1, Insulation Blankets.
- c. ASTM D1621, Compressive Strength.
- d. ASTM E84, Flame Spread and Smoke Developed.

B. Submittals:

- 1. Provide submittals in the form of samples, and documentation, to the Architect for review.

1.03 Product Delivery, Storage and Handling:

- A. Rigid insulation board is combustible. During storage and insulation, observe good fire safety practice, including job site housekeeping.

- 1.04 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.**

Part 2 - Products

2.01 Materials:

- A. Rigid Insulation: FS-HH-I-1972/1, Class 2 Rigid Insulation.
 - 1. Type: Glass fiber reinforced polyisocyanurate core with foil facing each side (glass fiber facing at roof insulation), and a compressive strength of 25 p.s.i. and a maximum water vapor transmission rate of >.03 perm-inch.
 - a. Application: 1 layer of rigid insulation. First layer shall be 1" thick to match existing thickness, field verify, for installation above metal decking. Refer to Drawings.
 - 3. Adhesive: as recommended by manufacturer of rigid insulation board.
- B. Fibrous Insulation: ASTM C 665-84, Type 1
 - 1. Type:
 - a. 6" thick (approx.) mineral wool or fiberglass fire resistant insulating blanket or batt, with kraft paper facing. Thermal resistance R-19. Provide as necessary.

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07200 - INSULATION

- C. Vapor Retarder:
 - 1. Roof Deck Installation:
 - a. Two layers of high strength kraft paper laminated with an adhesive, and reinforced at edges with fiberglass yarns.
 - b. Type Example: Permstop - Owens Corning.

Part 3 - Execution

3.01 Installation - Rigid Insulation:

- A. Install rigid insulation horizontally to roof deck, as shown on the Drawings.
- B. **Rigid insulation and other components applied to metal decking at membrane roofing shall be fastened with approved fasteners at the rate of 1 per 2 square feet to meet FM I-90 requirements.**
- C. Install number of layers required of rigid insulation to metal roof deck to match existing thickness. Stagger joints of insulation to provide continuous insulation coverage.
- D. Cut insulation by means of a saw, knife, or other sharp tool to fit around obstructions across the wall, such as vents, louvers, pipes and conduit.
- E. If mastic adhesive is used to supplement holding the insulation in place, observe label directions.

End of Section

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

Part 1 - General

1.01 Section Includes:

- A. Preparation of Substrate to Receive Roofing Materials
- B. Roof Insulation Application to Prepared Substrate
- C. Roof Membrane Application
- D. Roof Flashing Application
- E. Incorporation of Sheet Metal Flashing Components and Roofing Accessories into the New / Existing Roof Systems

1.02 Products Installed But Not Furnished Under This Section:

- A. Sheet Metal Flashing and Trim

1.03 Related Sections:

- A. Rough Carpentry - Section 06100
- B. Insulation - Section 07200
- C. Flashing & Sheet Metal Section 07600

1.04 Reference Standards:

References in these specifications to standards, test methods and codes, are implied to mean the latest edition of each such standard adopted. The following is an abbreviated list of associations, institutions, and societies which may be used as references throughout these specifications.

ASTM	American Society for Testing and Materials Philadelphia, PA
FM	Factory Mutual Engineering and Research Norwood, MA
NRCA	National Roofing Contractors Association Rosemont, IL
OSHA	Occupational Safety and Health Administration Washington, DC
SMACNA	Sheet Metal and Air Conditioning Contractors National Association, Chantilly, VA
UL	Underwriters Laboratories, Northbrook, IL

1.05 Description Of Work:

- A. **Project Type:** Patch/repair of existing system after HVAC unit and structural supports installation.
Deck: Metal Slope: **1/8 inch ±** per foot .
- B. **Rigid Insulation:**
 - 1. Top and Bottom Layers: Polyisocyanurate, having an approximate thickness of **1.0"** - field verify. Refer to Section 07200, Insulation.
 - 2. Crickets: Polyisocyanurate (tapered to match existing).
- C. **Gypsum sheathing panel:** having a thickness of 1/2 inch, mechanically attached, as per FM I-90 requirements.
- D. **Roof System:** Modified Bitumen Base, applied in cold adhesive; stripping and Flashing, applied in cold adhesive. Modified Bitumen Finish Ply, applied in cold adhesive.

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

- E. **Flashing System:** SBS with continuous metal-foil surfacing, torch applied.

1.06 Submittals:

- A. Submittals Prior to Contract Award:
 - 1. Letter from the proposed primary roofing manufacturer confirming that the bidder is an acceptable Contractor authorized to install the proposed system.
 - 2. Letter from the primary roofing manufacturer stating that the proposed application will comply with the manufacturer's requirements in order to qualify the project for the specified guarantee.
- B. Submittals Prior to Project Close-out:
 - 1. Manufacturer's printed recommendations for proper maintenance of the specified roof system including inspection frequencies, penetration addition policies, temporary repairs, and leak call procedures.

1.07 Quality Assurance:

- A. **Acceptable Products:** Primary roofing products, including each type of sheet, all manufactured in the United States, shall be supplied by a single manufacturer which has been successfully producing the specified types of primary products for not less than 10 years. The primary roofing products shall have maintained a consistent composition for a minimum of five years.
- B. **Agency Approvals:** The proposed roof system shall conform to the following requirements. No other testing agency approvals will be accepted.
 - 1. Underwriters Laboratories Class A acceptance of the proposed roofing system without additional requirements for coatings.
- C. **Acceptable Contractor:** Contractor shall have a minimum of 10 years of experience in successfully installing the same or similar roofing materials and be certified in writing by the roofing materials manufacturer to install the primary roofing products for a minimum of 5 years prior to the date of bid opening.
 - 1. **Torch Applicators:** Contractor shall employ torch applicators who have successfully passed the CERTA (Certified Roofing Torch Applicator) program requirements as provided by the National Roofing Contractors Association (NRCA).
 - 2. The Contractor shall have an office, warehouse with supplies, and permanent roofing crews within a 50 mile radius of Moore, Oklahoma. Contractor shall have had "NDL" (No Dollar Limit) approval for 5 years AT THIS AREA OFFICE from manufacturer and shall perform a minimum of ten (10) NDL manufacturer guarantees per

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

year.

3. **Owner's Roofing Contractor (Universal Roofing and Sheet Metal located in Moore, Oklahoma) shall be utilized on this project. The bid shall be based on the provided drawings and specifications, and agreed-to pricing.**
 - D. **Scope of Work:** The work to be performed under this specification shall include but is not limited to the following: Attend necessary job meetings and furnish competent and full-time supervision, experienced roof mechanics, all materials, tools, and equipment necessary to complete, in an acceptable manner, the roof installation in accordance with this specification. Comply with the latest written application instructions of the manufacturer of the primary roofing products. In addition, application practice shall comply with requirements and recommendations contained in the latest edition of the Handbook of Accepted Roofing Knowledge (HARK) as published by the National Roofing Contractors Association, amended to include the acceptance of a phased roof system installation.
 - E. **Local Regulations:** Conform to regulations of public agencies, including any specific requirements of the city and/or state of jurisdiction.
 - F. **Manufacturer Requirements:** Ensure that the primary roofing materials manufacturer provides direct trained company personnel to attend necessary job meetings, perform periodic inspections as necessary, and conducts a final inspection upon successful completion of the project.
 - G. **Contractor shall have one of the following approved Contractor Certification levels prior to bid opening:**
 - Johns Manville - Peak Advantage Contractor
 - Soprema - Soprema Certified Applicator
 - Siplast - Siplast Select Applicator
 - GAF - Master Select Contractor
- 1.08 **Product Delivery Storage And Handling:**
- A. **Delivery:** Deliver materials in the manufacturer's original sealed and labeled containers and in quantities required to allow continuity of application.
 - B. **Storage:** Store materials out of direct exposure to the elements. Store roll goods on a clean, flat and dry surface. All material stored on the roof overnight shall be stored on pallets. Rolls of roofing must be stored on ends. Store materials on the roof in a manner so as to preclude overloading of deck and building structure. Store materials such as solvents, adhesives, and asphalt cutback products away from open flames, sparks, or excessive heat. Cover all material using a breathable cover such as a

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

canvas. Polyethylene or other non-breathable plastic coverings are not acceptable.

- C. Handling: Handle all materials in such a manner as to preclude damage and contamination with moisture or foreign matter. Handle rolled goods to prevent damage to edges or ends.
- D. Damaged Material: Any materials that are found to be damaged or stored in any manner other than stated above will be automatically rejected, removed, and replaced at the Contractor's expense.

1.09 Project/Site Conditions:

- A. Requirements Prior to Job Start
 - 1. Notification: Give a minimum of 5 days notice to the Owner and manufacturer prior to commencing any work and notify both parties on a daily basis of any change in work schedule.
 - 2. Permits: Obtain all permits required by local agencies and pay all fees which may be required for the performance of the work.
 - 3. Safety: Familiarize every member of the application crew with all fire and safety regulations recommended by OSHA, NRCA and other industry or local governmental groups.
- B. Environmental Requirements:
 - 1. Precipitation: Do not apply roofing materials during precipitation or in the event there is a probability of precipitation during application. Take adequate precautions to ensure that materials, applied roofing, and building interiors are protected from possible moisture damage or contamination.
 - 2. Temperature Restrictions: At ambient temperatures between 40F and 50F, prepare / warm adhesive as directed by manufacturer.
- C. Protection Requirements:
 - 1. Membrane Protection: Provide protection against staining and mechanical damage for newly applied roofing and adjacent surfaces throughout this project.
 - 2. Torch Safety: Designate one person on each crew to perform a daily fire watch. The designated crew member shall watch for fires or smoldering materials on all areas of roof construction. Continue the fire watch after roofing material application has been suspended for the day.
 - 3. Limited Access: Prevent access by the public to materials, tools, and equipment during the course of the project.
 - 4. Debris Removal: Remove all debris daily from the

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

project site and take to a legal dumping area authorized to receive such materials.

5. Site Condition: Complete, to the owner's satisfaction, all job site clean-up including building interior, exterior and landscaping where affected by the construction.

1.10 Guarantee/Warranty:

- A. Roof Membrane Guarantee: Upon successful completion of the project, and after all post installation procedures have been completed, furnish the Owner with **the manufacturer's ten year labor and materials membrane guarantee**. The guarantee shall be a term type, without deductibles or limitations on coverage amount, and shall be issued at no additional cost to the Owner. This guarantee shall not exclude random areas of ponding from coverage.

- 1.11 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Only the four systems listed in 2.02 Description of Systems below will be accepted for installation on this project.**

Part 2 - Products:

2.01 Roofing System Assembly/Products:

- A. Rigid Roof Insulation: Roof insulation shall be UL and FM approved. Insulation shall be approved in writing by the insulation manufacturer for intended use and for use with the specified roof assembly. Refer to Section 07200.
- B. Recover Board Sheathing Panel for Roof Membrane Substrate: A panel composed of high density fiberboard, non-structural water resistant core material integrally bonded having a nominal thickness of 1/2 inch.
 1. Acceptable Manufacturer: Fiberboard Coated High Density Roof Insulation, by Huebert.
- C. Gypsum Sheathing Panel for Wood/Plywood Surfaces to Receive Flashing Coverage: A panel composed of a gypsum based, non-structural water resistant core material integrally bonded with fiberglass mats on both sides having a nominal thickness of 1/2 inch. The panel surface shall be factory primed with a non-asphaltic primer.
 1. Acceptable Manufacturer: DensDeck Prime Gypsum Roof Board, by Georgia Pacific Corporation; Atlanta, GA

2.02 Description Of Systems:

- A. Roofing Membrane Assembly: A roof membrane assembly consisting of two plies of a prefabricated, reinforced, homogeneous Styrene-Butadiene-Styrene (SBS) block copolymer modified asphalt membrane, applied over a prepared substrate. Both reinforcement mats shall be

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

impregnated/saturated and coated each side with an SBS modified bitumen blend. The roof system shall pass 500 cycles of ASTM D 5849 Resistance to Cyclic Joint Displacement (fatigue) at 14F - or show evidence of other independent testing indicating resistance fatigue, membrane cracking and delamination. Passing results shall show no signs of membrane cracking or interply delamination after 500 cycles. The roof system shall pass 200 cycles of ASTM D 5849 after heat conditioning performed in accordance with ASTM D 5147. The assembly shall possess waterproofing capability, such that a phased roof application, with only the modified bitumen base ply in place, can be achieved for prolonged periods of time without detriment to the watertight integrity of the entire roof system.

1. Acceptable Manufacturer: Johns Manville roof system:
 - a. Modified Bitumen Base, Stripping, and Flashing Reinforcing Ply.
JM DynaBase
 - b. Modified Bitumen Finish Ply
JM DynaGlas FR
 - c. Stripping Ply and Flashing Reinforcing Sheet
JM DynaPly
- B. Flashing Membrane Assembly: A flashing membrane assembly consisting of a prefabricated, reinforced, Styrene-Butadiene-Styrene (SBS) block copolymer modified asphalt membrane with a continuous, channel-embossed metal-foil surfacing. The finish ply shall conform to ASTM D 6298 and the following physical and mechanical property requirements.
 1. Acceptable Manufacturer: Johns Manville flashing system, aluminum finish
 - a. Cant Backing Sheet for Wood/Plywood Surfaces to Receive Flashing Coverage: applicable JM product.
 - b. Metal-Clad Modified Bitumen Flashing Sheet: JM DynaClad Flashing
 - c. Cant Strip: JM FesCant Plus Cant Strips
- C. Catalyzed Acrylic Resin Flashing System: A specialty flashing system consisting of a liquid-applied, fully reinforced, multi-component acrylic membrane installed over a prepared or primed substrate. The flashing system consists of a catalyzed acrylic resin primer, basecoat and topcoat, combined with a non-woven polyester fleece. The resin and catalyst are pre-mixed immediately prior to installation. The use of the specialty flashing system shall be specifically approved in advance by the membrane manufacturer for each application.
 1. Acceptable Manufacturer: Flashing System by Johns

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

Manville; Denver, CO

- D. Additional Roof Systems: The following additional roof systems are acceptable for use in lieu of the specified roof system.
 - 1. GAF Materials Corp., Wayne, NJ
 - Base Ply B Ruberoid Mop Smooth
 - Finish Ply B Ruberoid Mop FR - cap ply Plus
 - Flashing Sheet B Ruberoid Ultraclad SBS
 - Stripping Ply and Flashing Reinforcing Sheet - Ruberoid Mop Smooth
 - 2. Soprema, Inc., Wadsworth, OH
 - Base Ply - Elastophene Sanded 2.2
 - Finish Ply - Elastophene LS FR GR
 - Flashing Sheet - Sopralast 50 TV ALU
 - Stripping Ply and Flashing Reinforcing Sheet - Elastophene Sanded 2.2
- 2.03 Roofing Accessories:
- A. Roofing Adhesives:
 - 1. Membrane Cold Adhesive: An asphalt, solvent blend conforming to ASTM D 3019, Type III requirements.
 - a. Acceptable Manufacturer: MBR Cold Application Adhesive by Johns Manville; Denver, CO
 - B. Bituminous Cutback Materials:
 - 1. Primer: An asphalt, solvent blend conforming to ASTM D 41 requirements.
 - 2. Mastics: An asphalt cutback mastic, reinforced with non-asbestos fibers, used as a base for setting metal flanges conforming to ASTM D 4586 Type II requirements.
 - C. Sealant: A moisture-curing, non-slump elastomeric sealant designed for roofing applications. The sealant shall be approved by the roof membrane manufacturer for use in conjunction with the roof membrane materials.
 - D. Ceramic Granules: No. 11 grade specification ceramic granules of color scheme matching the granule surfacing of the finish ply.
 - E. Metallic Powder: A finely graded metal dust as supplied or approved by the membrane manufacturer, used for covering of bitumen overruns over the foil surfaced membrane.
 - F. Perlite Cant Strips: A cant strip composed of expanded volcanic minerals combined with waterproofing binders. The top surface shall be pre-treated with an asphalt based coating. The face of the cant shall have a nominal 4 inch dimension.
 - G. Fasteners:
 - 1. Gypsum Sheathing Panel Fasteners for Roofing

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

Substrates and Wood/Plywood Flashing Surfaces: Gypsum sheathing panel fasteners and plates shall be FM Approved, and/or approved by the manufacturer of the primary roofing products. The fastening pattern for each panel to be used shall be as recommended by the panel manufacturer and approved by the manufacturer of the primary roofing products. Acceptable panel fastener manufacturers for specific substrate types are listed below.

- a. Wood/Plywood Flashing Surfaces: Gypsum sheathing panel mechanical fasteners shall be factory coated for corrosion resistance. The fastener shall conform meet or exceed Factory Mutual Standard 4470 and when subjected to 30 Kesternich cycles, show less than 15% red rust. Acceptable fastener types for wood/plywood substrates are listed below.
 - 1) A fluorocarbon coated screw type roofing fastener having a minimum 0.220 inch thread diameter. Plates used in conjunction with the fastener shall be a metal type having a minimum 3 inch diameter, as supplied by the fastener manufacturer.
- b. Acceptable Manufacturer=s:
 - 1) Ultrafast Fastener with UltraFast Round Metal Plates by Johns Manville; Denver, CO
 - 2) Dekfast #12 with Dekfast Steel Hexagonal Plates by Construction Fasteners, Inc.; Wyomissing, PA
 - 3) Standard Roofing Fastener by Olympic Manufacturing Group, Agawam; MA
2. Flashing Reinforcing Sheet Fasteners: Fasteners shall be approved by the manufacturer of the primary roofing products. Acceptable fasteners for specific substrate types are listed below.
 - a. Wood/Plywood Substrates
 - 1) A 12 gauge, spiral or annular threaded shank, zinc coated steel roofing fastener having a minimum 1 inch head.
 - 2) Square Cap by W.H. Maze Co.; Peru, IL
12 Gauge Simplex Nail by the Simplex Nail and Manufacturing Co., Americus, GA
 - 3) Fasteners shall be applied to meet FM-I90 requirements. At crickets, if insulation thickness prohibits satisfactory application of fasteners, use adhesive similar to Para-

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

STIK insulation adhesive.

- H. Walktread: A prefabricated, puncture resistant polyester core reinforced, polymer modified bitumen sheet material topped with a ceramic-coated granule wearing surface.
 - 1. Thickness: 0.25 in
 - 2. Width: 32 in
 - 3. Acceptable Manufacturer: DynaTred Roof Walkway Pads by Johns Manville; Denver, CO
- I. Pipe Supports Typical:
 - 1. Roller System: A Aroller-bearing@ pipe support for roof-mounted gas pipes, RTU condensate lines, and electrical conduit up to 4" I.D. or 5"O.D. Pipes rest on a self-lubricating roller system which is made of a stainless steel or glass-filled nylon rod and a sturdy polycarbonate resin roller. Pipe support base shall be manufactured of polycarbonate resin with a roller rod of glass-filled nylon, and stainless steel metal parts.
 - 2. Load Weight: Maximum load weight may not exceed 125 lbs. per pipestand.
 - 3. Spacing: Not to exceed 10 foot centers. Do not exceed 125 lbs. load weight and adjust pipe stand in height to even load.
 - 4. Acceptable Manufacturer: Pillow Block Pipestand Model 4-R, Miro Industries, Inc., 1780 West 2300 South, Salt Lake City, Utah 84119.
- J. Pipe Supports at Turns In Large Piping:
 - 1. Pipe Support Hangers: A Aclevis hanger@ pipe support hanger for roof mounted gas pipes at all large (over 4" I.D.) piping corners, bends, and Atees@/pipe intersections. Pipes rest on a clevis hanger with a support base of stainless steel polycarbonate. All other metal parts are hot-dip galvanized steel.
 - 2. Load Weight: Maximum load weight not to exceed 310 lbs. per pipestand or 155 lbs. on each base.
 - 3. Spacing: Locate Aclevis@ type pipe hangers at all corners, bends, and Atees@/pipe intersections not to exceed 10'-0" o.c. maximum. Do not exceed 310 lbs. load weight (155 lbs. on each base) and make certain each pipestand is adjusted in height to even load at all pipestands.
 - 4. Acceptable Manufacturer: Pillow Block Pipestand Model 6-H, Miro Industries, Inc., 1780 West 2300 South, Salt Lake City, Utah 84119.
- K. Penetration Dam/Sealer Pockets shall be similar to:
ChemCurb System: gray polyester resin exterior forms,

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

structural sealant and One (1) part self-leveling moisture cure pourable sealer (gray).

Part 3- Execution

3.01 Preparation:

- A. General: Sweep or vacuum all surfaces, removing all loose aggregate and foreign substances prior to commencement of roofing.

3.02 Substrate Preparation - Metal Deck / Insulation:

- A. Preparation of Wood/Plywood Substrates to Receive Flashing Materials: Mechanically attach the gypsum sheathing panels to all wood/plywood substrates that will be covered with the specified flashing membrane, using the specified screws/plates, at 12 inches o.c. staggered. Cut the cant backing sheet into 12 inch widths and peel the release film from the back of the sheet. Set the sheet into place extending 6 inches onto the field of the roof area and 6 inches up the gypsum sheathing panel surface utilizing minimum 3 inch side laps. Set the cant into place prior to installation of the roof membrane base ply.
- B. Insulation Panel - two layers: Mechanically attach the insulation panels, using the specified fasteners, at a rate of 1 fastener for every 2.7 square feet of panel area (12 per 4' x 8' panel). Increase the fastening frequency by 50% at the perimeter of the roof area and by 75% at the corners. Meet FM I-90 requirements.
- C. Gypsum Sheathing Panels: Install sheathing panels, and any tapered insulation in hot asphalt, with end joints offset; edges of the panels shall be in moderate contact without forcing applied in strict accordance with the insulation manufacturer's requirements and the following instructions.

3.04 Roof Membrane Installation:

- A. Membrane Application: Apply roofing in accordance with roofing system manufacturer's instructions and the following requirements. Application of roofing membrane components shall immediately follow application of base sheet and/or insulation as a continuous operation.
- B. Aesthetic Considerations: An aesthetically pleasing overall appearance of the finished roof application is a standard requirement for this project. Make necessary preparations, utilize recommended application techniques, apply the specified materials including granules and metallic powder, and exercise care in ensuring that the finished application is acceptable to the Owner.
- C. Priming: Prime metal and concrete and masonry surfaces with a uniform coating of the specified primer.

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

- D. Membrane Adhesive Application: Membrane adhesive can be applied by roller, squeegee or spray unit. Apply cold adhesive in a smooth, even, continuous layer without breaks or voids. Utilize an application rate of 2 to 2 1/2 gal/sq over irregular or porous substrates. Utilize an application rate of 1 1/2 to 2 gal/sq for interply applications. Double the adhesive application rate at the end laps of granule surfaced sheets. In the areas surrounding details that are to receive the catalyzed acrylic resin primer and flashing system, apply membrane plies in a full coating of the specified elastomeric sealant in lieu of the solvent based adhesive a minimum 8 inches from the base of the penetration or curb.
- E. Bitumen Consistency: Cutting or alterations of bitumen, primer, and sealants will not be permitted.
- F. Roofing Application: Apply all layers of roofing free of wrinkles, creases, or fishmouths. Exert sufficient pressure on the roll during application to ensure prevention of air pockets.
1. Apply all layers of roofing perpendicular to the slope of the deck.
 2. Fully bond the base ply to the prepared substrate, utilizing minimum 3 inch side and end laps. Apply each sheet directly behind the asphalt applicator. Cut a dog ear angle at the end laps on overlapping selvage edges. Using a clean trowel, apply top pressure to top seal T-laps immediately following sheet application. Stagger end laps a minimum of 3 feet.
 3. Fully bond the finish ply to the base ply, utilizing minimum 3 inch side and end laps. Apply each sheet directly behind the cold adhesive applicator. Stagger end laps of the finish ply a minimum 3 feet. Cut a dog ear angle at the end laps on overlapping selvage edges. Using a clean trowel, apply top pressure to top seal T-laps immediately following sheet application. Stagger side laps of the finish ply a minimum 12 inches from side laps in the underlying base ply. Stagger end laps of the finish ply a minimum 3 feet from end laps in the underlying base ply.
 4. Maximum sheet lengths and special fastening of the specified roof membrane system may be required at various slope increments where the roof deck slope exceeds 1/2 inch per foot. The manufacturer shall provide acceptable sheet lengths and the required fastening schedule for all roofing sheet applications

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

- to applicable roof slopes.
- G. Granule Embedment: Broadcast mineral granules over all bitumen overruns on the finish ply surface, while the bitumen is still hot or the adhesive is soft, to ensure a monolithic surface color.
 - H. Flashing Application - masonry surfaces: Flash masonry parapet walls and curbs using the reinforcing sheet and the metal foil flashing membrane. After the base ply has been applied to the top of the cant, fully adhere the reinforcing sheet, utilizing minimum 3 inch side laps and extend a minimum of 3 inches onto the base ply surface and 3 inches up the parapet wall above the cant. After the final roofing ply has been applied to the top of the cant, prepare the surface area that is to receive flashing coverage by torch heating granular surfaces or by application of asphalt primer; allowing primer to dry thoroughly. Torch apply the metal foil-faced flashing into place using three foot widths (cut off the end of roll) always lapping the factory selvage edge. Stagger the laps of the metal foil flashing layer from lap seams in the reinforcing layer. Extend the flashing sheet a minimum of 4 inches beyond the toe of the cant onto the prepared surface of the finished roof and up the wall to the desired flashing height. Exert pressure on the flashing sheet during application to ensure complete contact with the wall/roof surfaces, preventing air pockets; this can be accomplished by using a damp sponge or shop rag. Check and seal all loose laps and edges. Nail the top edge of the flashing on 9 inch centers. (See manufacturer's schematic for visual interpretation).
 - I. Flashing Application B surfaces sheathed with gypsum sheathing panels: After the gypsum sheathing panel and cant backing sheet have been installed, flash parapet walls and curbs with the specified reinforcing sheet and the metal foil flashing membrane. The reinforcing sheet shall have minimum 3 inch side laps and extend a minimum of 3 inches onto the base ply surface and to the top of the parapet wall or curb. Using the specified fasteners, mechanically attach the reinforcing sheet through the field of the sheet to the vertical flashing surface on 12 inch centers from the top of the cant to the top of the wall or curb. Fully adhere the remainder of the flashing reinforcing sheet that extends over the cant and roof level. Using a Leister Hand Welding Tool, seal the laps between flashing reinforcing sheets. After the final roofing ply has been applied to the top of the cant,

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

prepare the surface area that is to receive flashing coverage by torch heating granular surfaces or by application of asphalt primer; allowing primer to dry thoroughly. Torch apply the metal foil-faced flashing into place using three foot widths (cut off the end of roll) always lapping the factory selvage edge. Stagger the laps of the metal foil flashing layer from lap seams in the reinforcing layer. Extend the flashing sheet a minimum of 4 inches beyond the toe of the cant onto the prepared surface of the finished roof and up the wall to the desired flashing height. Exert pressure on the flashing sheet during application to ensure complete contact with the wall/roof surfaces, preventing air pockets; this can be accomplished by using a damp sponge or shop rag. Check and seal all loose laps and edges. Nail the top edge of the flashing on 9 inch centers. (See manufacturer's schematic for visual interpretation).

- J. Catalyzed Acrylic Resin Flashing System: Install the liquid-applied primer and flashing system in accordance with the membrane system manufacturer's printed installer's guidelines and other applicable written recommendations as provided by the manufacturer.
 - K. Use of Metallic Powder: Broadcast metallic powder over all bitumen overruns on the metal foil membrane surface while the bitumen is still hot to ensure a monolithic surface color.
 - L. Water Cut-Off: At end of day's work, or when precipitation is imminent, construct a water cut-off at all open edges. Cut-offs can be built using asphalt or plastic cement and roofing felts, constructed to withstand protracted periods of service. Cut-offs must be completely removed prior to the resumption of roofing.
- 3.05 Roof System Interface With Related Components:
- A. Walktread: Cut the walktread into maximum 5 foot lengths and allow to relax until flat. Adhere the sheet using the specified plastic cement. Apply the specified cement in a 3/8 inch thickness to the back of the product in 5 inch by 5 inch spots in accordance with the pattern as supplied by the walktread manufacturer. Walk-in each sheet after application to ensure proper adhesion. Use a minimum spacing of 2 inches between sheets to allow for proper drainage.
 - B. Sealant: Apply a smooth continuous bead of the specified sealant at the exposed finish ply edge transition to metal flashings incorporated into the roof system.
- 3.06 Field Quality Control And Inspections:

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07550 - MODIFIED BITUMEN MEMBRANE ROOFING SYSTEM

- A. Site Condition: Leave all areas around job site free of debris, roofing materials, equipment, and related items after completion of job.
- B. Notification Of Completion: Notify the manufacturer by means of manufacturer's printed Notification of Completion form of job completion in order to schedule a final inspection date.
- C. Final Inspection:
 - 1. Post-Installation Meeting: Hold a meeting at the completion of the project, attended by all parties that were present at the pre-job conference. A punch list of items required for completion shall be compiled by the Contractor and the manufacturer's representative. Complete, sign, and mail the punch list form to the manufacturer's headquarters.
- D. Issuance Of The Guarantee: Complete all post installation procedures and meet the manufacturer's final endorsement for issuance of the specified guarantee.

End of Section

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07600 - FLASHING AND SHEET METAL

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Modified Bitumen Membrane Roofing System - Section 07550
- B. Sealants - Section 07900

1.03 Quality Assurance:

- A. Standards:
 - 1. American Society of Testing and Materials
 - a. ASTM A-526, Steel Sheet, Zinc-Coated (Galvanized), Commercial Quality.
 - b. ASTM B-32, Solder Metal
 - 2. Federal Specifications:
 - a. SS-C-153B, Cement, Bituminous, Plastics
 - 3. Sheet Metal and Air Conditioning Contractors National Association:
 - a. Architectural Sheet Metal Manual

- 1.04 Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.**

Part 2 - Products

2.01 Materials:

- A. Sheet Metal:
 - 1. Galvanized Sheet Steel: ASTM A-526, Commercial Quality.
 - 2. Gauge: 22 Gauge minimum or as required by Drawings or Specifications.
- C. Fasteners: Nails, screws, and other fasteners used in conjunction with this work shall be galvanized or cadmium plated.
- D. Solder: ASTM B-32, alloy grade 58, 50% tin, 50% lead.
- E. Flux: Muriatic acid with zinc.
- F. Sealants: Rubber based compound - refer to Section 07900.
- G. Bituminous Plastic Cement: FS SS-C-153B.
- H. Accessories: Provide accessories as recommended by manufacturer or as indicated on Drawings.

Part 3 - Execution

3.01 Fabrication:

- A. Shape and install sheet metal as indicated on Drawings. Comply

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07600 - FLASHING AND SHEET METAL

with recommendations of SMACNA "Architectural Sheet Metal Manual."

- B. Form exposed faces flat and free of buckles, excessive wave and tool marks. Provide uniform, neat seams with minimum exposure of solder, welds, and sealant.
- C. Hem all exposed edges.
- D. Make waterproof corner joints by soldering solidly. Joints shall be full-lapped.
- E. Soldering: Shall be done slowly with well heated coppers to thoroughly heat the sheet and completely sweat the solder through the full width of the seam. Ample solder shall be used and the seam shall show a least one full inch of evenly flowed solder. Soldering coppers: Shall be heavy and blunt design, properly tinned before using. Neutralize all excess flux.
- F. Provide for thermal expansion of running trim, flashing and other items exposed for more than 15'-0" continuous length. Locate expansion seams at 10'-0" intervals and 2'-0" each side of corners and intersections.
- G. Angle bottom edges of exposed vertical surfaces to form drips.

3.02 Installation and Application:

- A. General:
 - 1. Furnish those items to be installed by other trades to proper grade for installation.
 - 2. Cooperate with and coordinate installation of sheet metal with roofing work as specified under Membrane Roofing - Section 07500.
 - 3. Install work watertight, without waves, warps, buckles, fastening stresses or distortion, allowing for expansion and contraction.
 - 4. Embed all flashing in plastic cement. Coat dissimilar metals from contact with bituminous coating.

End of Section

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

Part 1 - General

1.01 Related Documents:

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-1 Specification Section, apply to work specified in this section.

1.02 Definitions:

- A. Firestopping: Material or combination of materials used to retain integrity of fire-rated construction by maintaining an effective barrier against the spread of flame, smoke, and hot gases through penetrations in, or construction joints between, fire rated wall and floor assemblies.

1.03 General Description of the Work:

- A. Only tested firestop systems shall be used in specific locations as follows:
 1. Penetrations for the passage of duct, cable, cable tray, conduit, piping, electrical busways and raceways through fire-rated vertical barriers (walls and partitions), horizontal barriers (floor/ceiling assemblies), and vertical service shaft walls and partitions.
 2. Safing slot gaps between edge of floor slabs and curtain walls.
 3. Openings between structurally separate sections of wall or floors.
 4. Gaps between the top of walls and ceilings or roof assemblies.
 5. Expansion joints in walls and floors.
 6. Openings and penetrations in fire-rated partitions or walls containing fire doors.
 7. Openings around structural members which penetrate floors or walls.

1.04 Related Work Specified Elsewhere:

- A. Coordinate work of this section with work of other sections as required to properly execute the work and as necessary to maintain satisfactory progress of the work of other sections, including:
 1. Section 03300 - Cast-In-Place Concrete
 2. Section 04810 - Masonry
 3. Section 07900 - Sealants
 4. Section 09250 - Gypsum Wallboard
 5. Section ***** - Fire Suppression Piping
 6. Section ***** - Common Work Results for Plumbing
 7. Section ***** - Common Work Results for HVAC
 8. Section ***** - HVAC Insulation
 9. Section ***** - Basic Electrical Materials and Methods

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

1.05 References:

- A. Test Requirements: ASTM E 814, "Standard Method of Fire Tests of Through Penetration Fire Stops".
- B. Test Requirements: UL 1479, "Fire Tests of Through-Penetration Firestops".
- C. Test Requirements: UL 2079, "Tests for Fire Resistance of Building Joint Systems".
- D. Underwriters Laboratories (UL) of Northbrook, IL publishes tested systems in their "FIRE RESISTANCE DIRECTORY" that is updated annually.
 - 1. UL Fire Resistance Directory:
 - a. Firestop Devices (XHJI)
 - b. Fire Resistance Ratings (BXRH)
 - c. Through-Penetration Firestop Systems (XHEZ)
 - d. Fill, Voids, or Cavity Material (XHHW)
 - e. Forming Materials (XHKU)
 - f. Joint Systems (XHBN)
 - g. Perimeter Fire Containment Systems (XHDG)
 - 2. Alternate Systems: "Omega Point Laboratories Directory" (updated annually).
- E. Test Requirements: ASTM E 1966, "Standard Test Method for Fire Resistive Joint Systems".
- F. Inspection Requirements: ASTM E 2174, "Standard Practice for On-site Inspection of Installed Fire Stops".
- H. ASTM E 84, "Standard Test Method for Surface Burning Characteristics of Building Materials".
- I. International Firestop Council Guidelines for Evaluating Firestop Systems Engineering Judgments.
- J. All major building codes: ICBO, SBCCI, BOCA, IBC
- K. NFPA 101 - Life Safety Code
- L. NFPA 70 - National Electric Code

THROUGH-PENETRATION UL CLASSIFICATION SYSTEM

Fire Stopping Systems

UL Classification System

		Construction Penetrated	Type Of Construction	System Identification
1	No Penetrating Items:	F, W, C	A, B, J, K, L	0001-0999
2	Metallic Pipes, Conduit or Tubing:	F, W, C	A, B, J, K, L	1001-1999
3	Nonmetallic Pipe, Conduit or Tubing:	F, W, C	A, B, J, K, L	2001-2999
4	Electric Cables:	F, W, C	A, B, J, K, L	3001-3999
5	Cable, Trays with Electric Cables:	F, W, C	A, B, J, K, L	4001-4999
6	Insulated Pipes:	F, W, C	A, B, J, K, L	5001-5999

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

7	Electrical Bussduct Penetrations:	F, W, C	A, B, J, K, L	6001-6999
8	Mechanical Ductwork Penetrations: Multiple Penetrations Through Common	F, W, C	A, B, J, K, L	7001-7999
9	Openings:	F, W, C	A, B, J, K, L	8000-8999

Construction Penetration

	Floor
F	penetration
	Wall
W	penetration
	Either floor or wall
C	penetration

Type of Construction

	Concrete floors equal to or less than
A-	5-inches thick
	Concrete floors greater
B-	than 5-inches thick
	Concrete or masonry walls equal to or less than 8-
J-	inches thick
	Concrete or masonry walls greater
K-	than 8-inches thick
L-	Framed walls

JOINT UL CLASSIFICATION SYSTEM

Fire-Resistant Joint Systems		UL Classification System		Joint Width
	Joint System	Movement Capability		
1	Floor-to-Floor	FF	D	0000-0999
2	Wall-to-Wall	WW	D	0000-0999
3	Floor-to-Wall:	FW	D	0000-0999
4	Head of Wall:	HW	D	0000-0999

Movement Capability

D-	Has movement capability
----	-------------------------

Joint Width

0000-0999 Less than or equal to 2-inches

1.06 Quality Assurance

A. Installer Responsibilities: A firm experienced installing through-penetration firestop systems similar in material, design and extent to that indicated for this Project, whose

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

work has resulted in construction with a record of successful performance. Qualifications include having the necessary experience, staff, and training to install manufacturer's products per specified requirements.

- B. Firestop System installation must meet requirements of ASTM E 814, UL 1479 or UL 2079 tested assemblies that provide a fire rating equal to that of construction being penetrated.
- C. Proposed firestop materials and methods shall conform to applicable governing codes having local jurisdiction.
- D. Installation Responsibility: Assign installation of through-penetration firestop systems and fire-resistive joint systems in Project to a single qualified installer.
- E. Source Limitations: Obtain through-penetration firestop systems, for each kind of penetration and construction condition indicated, through one source from a single manufacturer.

1.07 Submittals:

- A. Submit Product Data: Manufacturer's specifications and technical data for each material including the composition and limitations, documentation of qualified tested firestop systems to be used and manufacturer's installation instructions.
- B. Submit Manufacturer's engineering judgment identification number and drawing details when no qualified tested system is available for an application. Engineering judgment must include both project name and contractor's name who will install firestop system as described in document.
- C. Submit material safety data sheets provided with product delivered to job-site.

1.08 Installer Qualifications:

- A. Engage an experienced Installer who is certified, licensed, or otherwise qualified by the firestopping manufacturer as having been provided the necessary training to install manufacturer's products per specified requirements.
- B. The work is to be installed by a contractor with at least one of the following qualifications:
 - 1. FM 4991 Approved Contractor
 - 2. UL Approved Contractor
 - 3. Hilti Accredited Fire Stop Specialty Contractor
- C. Installer shall have not less than 3 years of experience with fire stop installation.

1.09 Delivery, Storage and Handling:

- A. Deliver materials undamaged in manufacturer's clearly labeled, unopened containers, identified with brand, type, and UL label where applicable.
- B. Coordinate delivery of materials with scheduled installation date to allow minimum storage time at job-site.
- C. Store materials under cover and protect from weather and

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

damage in compliance with manufacturer's requirements, including temperature restrictions.

- D. Comply with recommended procedures, precautions or remedies described in material safety data sheets as applicable.
- E. Do not use damaged or expired materials.

1.10 Project Conditions:

- A. Do not use materials that contain flammable solvents.
- B. Schedule installation of firestopping after completion of penetrating item installation but prior to covering or concealing of openings.
- C. Verify existing conditions and substrates before starting work. Correct unsatisfactory conditions before proceeding.
- D. Weather conditions: Do not proceed with installation of firestop materials when temperatures exceed the manufacturer's recommended limitations for installation printed on product label and product data sheet.
- E. During installation, provide masking and drop cloths to prevent firestopping materials from contaminating any adjacent surfaces.

1.11 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers, providing they meet or exceed that specified.**

Part 2 - Products

2.01 Firestopping, General:

- A. Provide firestopping composed of components that are compatible with each other, the substrates forming openings, and the items, if any, penetrating the firestopping under conditions of service and application, as demonstrated by the firestopping manufacturer based on testing and field experience.
- B. Provide components for each firestopping system that are needed to install fill material. Use only components specified by the firestopping manufacturer and approved by the qualified testing agency for the designated fire-resistance-rated systems.
- C. Firestopping Materials are either "cast-in-place" (integral with concrete placement) or "post installed." Provide cast-in-place firestop devices prior to concrete placement.

2.02 Acceptable Manufacturers:

- A. Subject to compliance with through penetration firestop systems (XHEZ), joint systems (XHBN), and perimeter firestop systems (XHDG) listed in Volume 2 of the UL Fire Resistance Directory; provide products of the following manufacturers

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

as identified below:

1. Hilti, Inc., Tulsa, Oklahoma
800-879-8000 / www.us.hilti.com

2.03 Materials:

- A. Use only firestop products that have been UL 1479, ASTM E 814 or UL 2079 tested for specific fire-rated construction conditions conforming to construction assembly type, penetrating item type, annular space requirements, and fire-rating involved for each separate instance.
- B. Pre-installed firestop devices for use with noncombustible and combustible pipes (closed and open systems), conduit, and/or cable bundles penetrating concrete floors and/or gypsum walls, the following products are acceptable:
 1. Hilti CP 680-P Cast-In Place Firestop Device
 - a. Add Aerator adaptor when used in conjunction with aerator ("sovent") system.
 2. Hilti CP 681 Tub Box Kit for use with tub installations.
 3. Hilti CP 680-M Cast-In Place Firestop Device for use with noncombustible penetrants.
 4. Hilti CP 653 Speed Sleeve for use with cable penetrations.
- C. Sealants, caulking materials, or foams for use with non-combustible items including steel pipe, copper pipe, rigid steel conduit and electrical metallic tubing (EMT), the following products are acceptable:
 1. Hilti FS-ONE Intumescent Firestop Sealant
 2. Hilti CP 604 Self-leveling Firestop Sealant
 3. Hilti CP 620 Fire Foam
 4. Hilti CP 606 Flexible Firestop Sealant
 5. Hilti CP 601s Elastomeric Firestop Sealant
- D. Sealants or caulking materials for use with sheet metal ducts, the following products are acceptable:
 1. Hilti CP 601s Elastomeric Firestop Sealant
 2. Hilti CP 606 Flexible Firestop Sealant
 3. Hilti FS-ONE Intumescent Firestop Sealant
- E. Sealants, caulking or spray materials for use with fire-rated construction joints and other gaps, the following products are acceptable:
 1. Hilti CP 672 Speed Spray
 2. Hilti CP 601s Elastomeric Firestop Sealant
 3. Hilti CP 606 Flexible Firestop Sealant
 4. Hilti CP 604 Self-leveling Firestop Sealant
- F. Pre-formed mineral wool designed to fit flutes of metal profile deck and gap between top of wall and metal profile deck; as a backer for spray material.
 1. Hilti CP 777 Speed Plugs
 2. Hilti CP 767 Speed Strips

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

- G. Intumescent sealants, caulking materials for use with combustible items (penetrants consumed by high heat and flame) including insulated metal pipe, PVC jacketed, flexible cable or cable bundles and plastic pipe, the following products are acceptable:
 - 1. Hilti FS-ONE Intumescent Firestop Sealant
- H. Foams, intumescent sealants, or caulking materials for use with flexible cable or cable bundles, the following products are acceptable:
 - 1. Hilti FS-ONE Intumescent Firestop Sealant
 - 2. Hilti CP 620 Fire Foam
 - 3. Hilti CP 601s Elastomeric Firestop Sealant
 - 4. Hilti CP 606 Flexible Firestop Sealant
- I. Non-curing, re-penetrable intumescent putty or foam materials for use with flexible cable or cable bundles, the following products are acceptable:
 - 1. Hilti CP 618 Firestop Putty Stick
 - 2. Hilti CP 658T Firestop Plug
- J. Wall opening protective materials for use with U.L. listed metallic and specified nonmetallic outlet boxes, the following products are acceptable:
 - 1. Hilti CP 617 Firestop Putty Pad
 - 2. Hilti Firestop Box Insert
- K. Firestop collar or wrap devices attached to assembly around combustible plastic pipe (closed and open piping systems), the following products are acceptable:
 - 1. Hilti CP 643N Firestop Collar
 - 2. Hilti CP 644 Firestop Collar
 - 3. Hilti CP 648E/CP648S Wrap Strips
- L. Materials used for large openings and complex penetrations made to accommodate cable trays and bundles, multiple steel and copper pipes, electrical busways in raceways, the following products are acceptable:
 - 1. Hilti CP 637 Firestop Mortar
 - 3. Hilti FS 657 FIRE BLOCK
 - 4. Hilti CP 620 Fire Foam
 - 5. Hilti CP 675T Firestop Board
- M. Non curing, re-penetrable materials used for large size/complex penetrations made to accommodate cable trays and bundles, multiple steel and copper pipes, electrical busways in raceways, the following products are acceptable:
 - 1. Hilti FS 657 FIRE BLOCK
 - 2. Hilti CP 675T Firestop Board
- N. Sealants or caulking materials used for openings between structurally separate sections of wall and floors, the following products are acceptable:
 - 1. Hilti CP 672 Speed Spray
 - 2. Hilti CP 601s Elastomeric Firestop Sealant

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

3. Hilti CP 606 Flexible Firestop Sealant
4. Hilti CP 604 Self-Leveling Firestop Sealant
- O. For blank openings made in fire-rated wall or floor assemblies, where future penetration of pipes, conduits, or cables is expected, the following products are acceptable:
 1. Hilti FS 657 FIRE BLOCK
 2. Hilti CP 658T Firestop Plug
- P. Provide a firestop system with a "F" Rating as determined by UL 1479 or ASTM E814 which is equal to the time rating of construction being penetrated.
- Q. Provide a firestop system with an Assembly Rating as determined by UL 2079 which is equal to the time rating of construction joint assembly.

Part 3 - Execution

3.01 Preparation:

- A. Verification of Conditions: Examine areas and conditions under which work is to be performed and identify conditions detrimental to proper or timely completion.
 1. Verify penetrations are properly sized and in suitable condition for application of materials.
 2. Surfaces to which firestop materials will be applied shall be free of dirt, grease, oil, rust, laitance, release agents, water repellents, and any other substances that may affect proper adhesion.
 3. Provide masking and temporary covering to prevent soiling of adjacent surfaces by firestopping materials.
 4. Comply with manufacturer's recommendations for temperature and humidity conditions before, during and after installation of firestopping.
 5. Do not proceed until unsatisfactory conditions have been corrected.

3.02 Coordination:

- A. Coordinate location and proper selection of cast-in-place Firestop Devices with trade responsible for the work. Ensure device is installed before placement of concrete.
- B. Responsible trades to provide adequate spacing of field run pipes to allow for installation of cast-in-place firestop devices without interferences.

3.03 Installation:

- A. Regulatory Requirements: Install firestop materials in accordance with UL Fire Resistance Directory or Omega Point Laboratories Directory.
- B. Manufacturer's Instructions: Comply with manufacturer's instructions for installation of through-penetration and construction joint materials.
 1. Seal all holes or voids made by penetrations to ensure

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07840 - FIRESTOPPING

an air and water resistant seal.

2. Consult with mechanical engineer, project manager, and damper manufacturer prior to installation of UL firestop systems that might hamper the performance of fire dampers as it pertains to duct work.
3. Protect materials from damage on surfaces subjected to traffic.

3.04 Field Quality Control:

- A. Examine sealed penetration areas to ensure proper installation before concealing or enclosing areas.
- B. Keep areas of work accessible until inspection by applicable code authorities.
- C. Inspection of through-penetration firestopping shall be performed in accordance with ASTM E 2174, "Standard Practice for On-Site Inspection of Installed Fire Stops" or other recognized standard.
- D. Perform under this section patching and repairing of firestopping caused by cutting or penetrating of existing firestop systems already installed by other trades.

3.05 Identification:

- A. Identify through-penetration firestop systems with pressure-sensitive, self-adhesive, preprinted vinyl labels. Attach labels permanently to surfaces of penetrated construction on both sides of each firestop system installation where labels will be visible to anyone seeking to remove penetrating items or firestop systems. Include the following information on labels:
 1. The words: "Warning -Through Penetration Firestop System-Do Not Disturb. Notify Building Management of Any Damage."
 2. Contractor's Name, address, and phone number.
 3. Through-Penetration firestop system designation of applicable testing and inspecting agency.
 4. Date of Installation.
 5. Through-Penetration firestop system manufacturer's name.
 6. Installer's Name.

3.06 Adjusting and Cleaning:

- A. Remove equipment, materials and debris, leaving area in undamaged, clean condition.
- B. Clean all surfaces adjacent to sealed holes and joints to be free of excess firestop materials and soiling as work progresses.

End of Section

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

Part 1 - General

1.01 Work Included:

- A. All materials, labor services, and incidentals necessary for the completion of this section of the work.

1.02 Quality Assurance:

- A. Standards:
 - 1. TT-S-00230C, Sealing Compound, One Component.
 - 2. Testing Agency Qualifications: Qualified according to ASTM C 1021 to conduct the testing indicated.

1.03 Submittals:

- A. Submit manufacturer's specifications and color chart for each type of sealant.
- B. Samples: For each kind and color of joint sealant required.
- C. Joint-Sealant Schedule: Include the following information:
 - 1. Joint-sealant application, joint location, and designation.
 - 2. Joint-sealant manufacturer and product name.
 - 3. Joint-sealant formulation.
 - 4. Joint-sealant color.
- D. Product test reports.
- E. Preconstruction compatibility and adhesion test reports.
- F. Preconstruction field-adhesion test reports.
- G. Field-adhesion test reports.

1.04 Warranty:

- A. All work done under this section of the work shall be guaranteed for a period of two years from date of final acceptance of the building. Guarantee shall include materials and workmanship required to repair any leaks or the repairs thereof.
- B. Special Warranty: Manufacturer's standard form in which joint sealant manufacturer agrees to furnish joint sealants to repair or replace those that do not comply with performance and other requirements specified in this Section for a period of 10 years from date of final acceptance.

1.05 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.**

Part 2 - Products

2.01 Materials:

- A. Building Sealant: One part high performance polyurethane waterproofing sealant, FS-TT-S-00230C.
 - 1. Acceptable Manufacturer: Sonneborn NP1 Building Sealant.
 - 2. VOC Content of Interior Sealants: Sealants and sealant primers used inside the weatherproofing system shall

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

comply with the following limits for VOC content when calculated according to 40 CFR 59, Subpart D (EPA Method 24):

- a. Architectural Sealants: 250 gIL.
 - b. Sealant Primers for Nonporous Substrates: 250 gIL.
 - c. Sealant Primers for Porous Substrates: 775 gIL.
3. Liquid-Applied Joint Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied joint sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
 - a. Suitability for Immersion in Liquids. Where sealants are indicated for Use I for joints that will be continuously immersed in liquids, provide products that have undergone testing according to ASTM C 1247. Liquid used for testing sealants is deionized water, unless otherwise indicated.
 4. Stain-Test-Response Characteristics: Where sealants are specified to be nonstaining to porous substrates, provide products that have undergone testing according to ASTM C 1248 and have not stained porous joint substrates indicated for Project.
 5. Suitability for Contact with Food: Where sealants are indicated for joints that will come in repeated contact with food, provide products that comply with 21 CFR 177.2600.
- B. Silicone Joint Sealants:
1. Mildew-Resistant Neutral-Curing Silicone Joint Sealant: ASTM C 920.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 1. BASF Building Systems.
 2. Dow Corning Corporation.
 3. GE Advanced Materials - Silicones.
 4. Pecora Corporation.
 5. Sika Corporation; Construction Products Division.
 6. Tremco Incorporated.
- C. Urethane Joint Sealants: Urethane Joint Sealant: ASTM C 920.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

- include, but are not limited to, the following:
- a. BASF Building Systems.
 - b. Bostik, Inc.
 - c. Lymtal, International, Inc.
 - d. Pecora Corporation.
 - e. Sika Corporation; Construction Products Division.
 - f. Tremco Incorporated.
- D. Latex Joint Sealants: Latex Joint Sealant: Acrylic latex or siliconized acrylic latex, ASTM C 834, Type OP, Grade NF.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. BASF Building Systems.
 - b. Bostik, Inc.
 - c. Pecora Corporation.
 - d. Tremco Incorporated.
- E. Preformed Joint Sealants: Preformed Foam Joint Sealant: Manufacturer's standard preformed, precompressed, open-cell foam sealant manufactured from urethane foam with minimum density of 10 lb/cu. ft. and impregnated with a nondrying, water-repellent agent. Factory produce in precompressed sizes in roll or stick form to fit joint widths indicated; coated on one side with a pressure-sensitive adhesive and covered with protective wrapping.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Dayton Superior Specialty Chemicals.
 - b. EM SEAL Joint Systems, Ltd.
 - c. Sandell Manufacturing Co.
 - d. Schul International, Inc.
 - e. Willseal USA, LLC.
- F. Acoustical Joint Sealants: Acoustical Joint Sealant: Manufacturer's standard nonsag, paintable, nonstaining latex sealant complying with ASTM C 834. Product effectively reduces airborne sound transmission through perimeter joints and openings in building construction as demonstrated by testing representative assemblies according to ASTM E 90.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Pecora Corporation.

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

- b. USG Corporation.
- G. Joint Sealant Backing: cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin) Type 0 (open-cell material) or any of the preceding types, as approved in writing by joint sealant manufacturer for joint application indicated, and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
 - 1. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer.
- H. Miscellaneous Materials: as recommended by sealant manufacturer.
 - 1. Primer: Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
 - 2. Cleaners for Nonporous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials.
 - 3. Masking Tape: Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.
 - 4. Joint Cleaner
 - 5. Joint Primer/Sealer
 - 6. Bond Breaker Tape
 - 7. Joint Backer-Rod: Closed-cell compressible rod stock, size and shape as required by application.
- I. Caulking compound: Watertight, gun consistency, conforming to FS-TT-C-598, Type 1.
- J. Accessories: As recommended by sealant manufacturer.
- K. Color: to be selected from manufacturer's standard colors.

Part 3 - Execution

- 3.01 Preparation:
 - A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions.
 - 1. Remove laitance and form-release agents from concrete.
 - 2. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants.
 - B. Joint Priming: Prime joint substrates where recommended by joint-sealant manufacturer or as indicated by preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

manufacturer's written instructions. Confine primers to areas of joint sealant bond; do not allow spillage or migration onto adjoining surfaces.

- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

3.02 Installation: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.

- A. Do not leave gaps between ends of sealant backings.
- B. Do not stretch, twist, puncture, or tear sealant backings.
- C. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- D. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- E. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
 - 1. Place sealants so they directly contact and fully wet joint substrates.
 - 2. Completely fill recesses in each joint configuration.
 - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- F. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
 - 1. Remove excess sealant from surfaces adjacent to joints.
 - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
 - 3. Provide concave joint profile per Figure 8A in ASTM C 1193, unless otherwise indicated.
- G. Acoustical Sealant Installation: Comply with ASTM C 919 and with manufacturer's written recommendations.
- H. Clean off excess sealant or sealant smears adjacent to

DIVISION 7 - THERMAL & MOISTURE PROTECTION

SECTION 07900 - SEALANTS

joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

3.03 Joint Sealant Schedule:

- A. Joint-Sealant Application: Exterior joints in horizontal traffic surfaces.
- B. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal nontraffic surfaces.
- C. Joint-Sealant Application: Interior joints in horizontal traffic surfaces.
- D. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal non traffic surfaces.
- E. Joint-Sealant Application: Mildew-resistant interior joints in vertical surfaces and horizontal non-traffic surfaces.
- F. Joint-Sealant Application: Interior acoustical joints in vertical surfaces and horizontal non traffic surfaces.

3.04 Additional Information:

- A. Application: All sight exposed caulking, and all exterior applications.
- B. Comply with sealant manufacturer's printed instructions.
- C. Any surfaces requiring priming, shall be prepared according to manufacturer's recommendations.
- D. Install sealants to depths as shown or as recommended by sealant manufacturer. Smooth uneven surfaces.
- F. Do not disturb compound by touching, washing, or otherwise until it has cured tack free.
- G. Excess compound shall be removed from surfaces after curing.
- H. Follow manufacturer's recommendations for painting over sealant.

End of Section

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

Part 1 - General

1.01 Work Included:

- A. All material labor, services and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Hardware and Specialties - Section 08700

1.03 Quality Assurance:

A. Standards:

1. American Society for Testing and Materials
 - a. ASTM A-366, Steel Sheets, Carbon, Cold-Rolled, Commercial Quality.
 - b. ASTM A-569, Steel, Carbon, Hot-rolled Sheet and strip, commercial quality.
2. Underwriters' Laboratories, Inc.
3. Steel Door Institute (SDI): Recommended specifications for Steel Doors and Frames.

- B. Installer Qualifications: An employer of workers trained and approved by manufacturer.

- C. Source Limitations: Obtain standard steel doors and frames through one source from a single manufacturer.

- D. Fire-Rated Door Frame Assemblies: Assemblies complying with IBC 2009 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire protection ratings indicated.

1. Test Pressure: Test according to NFPA 252. After 5 minutes into the test, the neutral pressure level in furnace shall be established at 40 inches (1000 mm) or less above the sill.
2. Temperature-Rise Rating: At exit enclosures, provide doors that have a temperature-rise rating of 450 deg F (250 deg C) maximum in 30 minutes of fire exposure.
3. Smoke-Control Door Assemblies: Comply with NFPA 105.

1.04 Submittals:

- A. Shop Drawings: Product Data: Include construction details, material descriptions, core descriptions, label compliance, and finishes for each type of steel door and frame specified.

1. Submit shop Drawings showing details for each frame and door type, elevations and details of construction. Provide a schedule of doors and frames referenced to detail and openings as shown on the Drawings.
 - a. Elevations of each door design.
 - b. Details of doors, including vertical and horizontal edge details.
 - c. Frame details for each frame type, including dimensioned profiles.
 - d. Details and locations of reinforcement and

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

- preparations for hardware.
 - e. Details of each different wall opening condition.
 - f. Details of anchorages, accessories, joints, and connections.
 - g. Details of glazing frames and stops showing glazing.
 - h. Details of conduit and preparations for electrified door hardware and controls.
 - 2. It is the manufacturer's responsibility to obtain templates of finish hardware. The shop Drawings must indicate all hardware applications to the doors and frames.
 - 3. Begin fabrication only after receiving approved shop Drawings.
 - 4. Qualification Data: For Installer.
- 1.05 Product Delivery, Storage and Handling:
- A. All materials shall be protected for shipping so that they may arrive at the job site without undue damage or damage from storage at the job.
 - B. Deliver doors and frames palletized, wrapped, or crated to provide protection during transit and Project-site storage. Do not use nonvented plastic.
 - C. Deliver welded frames with two removable spreader bars across bottom of frames, tack welded to jambs and mullions.
 - D. Store doors and frames under cover at Project site. Place units in a vertical position with heads up, spaced by blocking, on minimum 4-inch- high wood blocking. Avoid using non-vented plastic or canvas shelters that could create a humidity chamber.
 - 1. If wrappers on doors become wet, remove cartons immediately. Provide minimum 14-inch space between each stacked door to permit air circulation.
- 1.06 Project Conditions:
- A. Field Measurements: Verify openings by field measurements before fabrication and indicate measurements on Shop Drawings.
 - 1. Established Dimensions: Where field measurements cannot be made without delaying the Work, establish opening dimensions and proceed with fabricating standard steel frames without field measurements. Coordinate wall construction to ensure that actual opening dimensions correspond to established dimensions.
- 1.07 Coordination:
- A. Coordinate installation of anchorages for standard steel frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves,

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in masonry. Deliver such items to Project site in time for installation.

1.08 Warranty: Provide manufacturer's standard warranty.

Part 2 - Products

2.01 Acceptable Manufacturers:

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. CURRIES Company; an ASSA ABLOY Group Company.
2. Steelkraft; and Ingersoll-Rand Company.
3. Or Approved Equal.

2.02 Materials:

- A. Cold-Rolled Steel Sheet: ASTM A 100S/A 100SM, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Hot-Rolled Steel Sheet: ASTM A 1011A 1011M, Commercial Steel (CS), Type B; free of scale, pitting, or surface defects; pickled and oiled.
- C. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum A40 zinc-iron-alloy (galvannealed) coating designation.
- D. Electrolytic Zinc-Coated Steel Sheet: ASTM A 5911A 59 1M, Commercial Steel (CS), Class B coating; mill phosphatized.
- E. Supports and Anchors: After fabricating, galvanize units to be built into exterior walls according to ASTM A 153/A 153M, Class B.
- F. Inserts, Bolts, and Fasteners: Provide items to be built into exterior walls, hot-dip galvanized according to ASTM A 153/A 153M.
- G. Mineral-Fiber Insulation: ASTM C 665, Type I (blankets without membrane facing); consisting of fibers manufactured from slag or rock wool with 6- to 12-lb/cu. ft. density; with maximum flame-spread and smoke-developed indexes of 25 and 50 respectively; passing ASTM E 136 for combustion characteristics.
- H. Glazing: Comply with requirements in Division S Section "Glazing."
- I. Bituminous Coating: Cold-applied asphalt mastic, SSPC-Paint 12, compounded for 15-mil dry film thickness per coat. Provide inert-type noncorrosive compound free of asbestos fibers, sulfur components, and other deleterious impurities.
- J. Grout: In masonry construction use grout for masonry as specified in Division 4. In stud walls use cementitious sprayed fire-resistive material manufactured by the following:

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

1. Monokote Type MK-6; W.R. Grace Construction Products.
 2. Cafco 300; Isolatek International Corp.
- 2.03 Requirements: Provide doors of design indicated, not less than thickness indicated; fabricated with smooth surfaces, without visible joints or seams on exposed faces, unless otherwise indicated. Comply with ANSI A250.8.
- A. Doors - Flush Panel: (SDI Door Type III, Style 2, Seamless):
1. Door, as indicated on the Drawings shall be constructed of 16 gauge cold-rolled, stretcher leveled sheet steel. Doors shall be insulated with foamed urethane, full length and width of doors. Construct doors with smooth, flush surfaces without visible joints or seams on exposed face or vertical edges. Doors shall be 1-3/4" thick unless noted otherwise.
 2. Close top and bottom edges with a recessed channel end closure or a flush end closure treatment.
 3. Vertical Edges for Single-Acting Doors: Square edge unless beveled edge is indicated.
 - a. Beveled Edge: 1/8 inch in 2 inches.
 4. Vertical Edges for Double-Acting Doors: Round vertical edges with 2-1/8-inch radius.
 5. Tolerances: Comply with SDI 117, "Manufacturing Tolerances for Standard Steel Doors and Frames."
 6. Provide weep-hole openings in bottom of exterior doors to permit moisture to escape. Seal joints in top edges of doors against water penetration.
- B. Frames:
1. Hollow metal frames shall be of 16 gauge cold-rolled, pickled steel, except that all frames for single doors over 3'-0" wide, frames for pairs of doors over 4'-0" wide and frames for doors over 9'-0" high shall be of 14 gauge steel. Frames shall be neatly mitered and continuously welded and ground smooth for invisible joints.
 2. Furnish anchors as shown on Drawings or as recommended by manufacturer, to secure frames to adjacent construction, formed of not less than 18 gauge galvanized steel. Install anchors at a maximum of 24" centers of jamb height.
 3. Frames against masonry or concrete are to be slush filled.
 4. Knock-down frames are not permitted.
 5. Frames against masonry or concrete are to be slush filled.
 6. Jamb Anchors:
 - a. Masonry Type: Adjustable strap-and-stirrup or T - shaped anchors to suit frame size, not less than 0.042 inch thick, with corrugated or perforated

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

- straps not less than 2 inches wide by 10 inches long; or wire anchors not less than 0.177 inch thick.
- b. Stud-Wall Type: Designed to engage stud, welded to back of frames; not less than 0.042 inch thick.
 - c. Floor Anchors: Formed from same material as frames, not less than 0.042 inch thick, and as follows:
 - 1. Monolithic Concrete Slabs: Clip-type anchors, with two holes to receive fasteners.
 - 2. Separate Topping Concrete Slabs: Adjustable-type anchors with extension clips, allowing not less than 2-inch height adjustment. Terminate bottom of frames at finish floor surface. Fabricate concealed stiffeners and hardware reinforcement from either cold- or hot-rolled steel sheet.
 - d. Ceiling Struts: Minimum 3/8-inch-thick by 2-inch-wide steel.
 - e. Plaster Guards: Formed from same material as frames, not less than 0.016-inch thick.
7. Sidelight Frames: Provide closed tubular members with no visible face seams or joints; fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
- C. Hardware Reinforcement:
- 1. Reinforcements for locks shall be 3/16" for fronts, with 14 gauge for roses and escutcheons. Hinge reinforcements shall be at least 10 gauge x 1 2" x 9". Provide steel strike and hinge reinforcement cover for frames.
- D. Jamb Anchors: Provide number and spacing of anchors as follows:
- 1. Masonry Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - a. Two anchors per jamb up to 60 inches in height.
 - b. Three anchors per jamb from 60 to 90 inches in height.
 - c. Four anchors per jamb from 90 to 120 inches in height.
 - d. Four anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof more than 120 inches in height.
 - 2. Stud-Wall Type: Locate anchors not more than 18 inches

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:

- a. Three anchors per jamb up to 60 inches in height.
 - b. Four anchors per jamb from 60 to 90 inches in height.
 - c. Five anchors per jamb from 90 to 96 inches in height.
 - d. Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof more than 96 inches in height.
 - e. Two anchors per head for frames more than 42 inches wide and mounted in metal-stud partitions.
- E. Door Silencers: Except on weather-stripped doors, drill stops to receive door silencers as follows. Provide plastic plugs to keep holes clear during construction.
1. Single-Door Frames: Drill stop in strike jamb to receive three door silencers.
 2. Double-Door Frames: Drill stop in head jamb to receive two door silencers.
- F. Stops and Moldings:
1. Moldings for Glazed Lites in Doors: Minimum 0.032 inch thick, fabricated from same material as door face sheet in which they are installed.
 2. Fixed Frame Moldings: Formed integral with standard steel frames, minimum 5/8 inch high, unless otherwise indicated.
 3. Loose Stops for Glazed Lites in Frames: Minimum 0.032 inch thick, fabricated from same material as frames in which they are installed.
- G. Labeled Doors and Frames:
1. Where doors and frames are called for on Drawings as labeled, their construction shall conform to all requirements and bear the appropriate U.L. label.
- H. Steel Finishes
1. General: Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
 - a. Finish standard steel door and frames after assembly.
 2. Metallic-Coated Steel Surface Preparation: Clean surfaces with nonpetroleum solvent so surfaces are free of oil and other contaminants. After cleaning, apply a conversion coating suited to the organic coating to be applied over it. Clean welds, mechanical connections, and abraded areas, and apply galvanizing repair paint specified below to comply with ASTM A 780.

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

- a. Galvanizing Repair Paint: High-zinc-dust-content paint for regalvanizing welds in steel, complying with SSPC-Paint 20.
3. Steel Surface Preparation: Clean surfaces to comply with SSPC-SP 1, "Solvent Cleaning"; remove dirt, oil, grease, or other contaminants that could impair paint bond. Remove mill scale and rust, if present, from uncoated steel; comply with SSPC-SP 3, "Power Tool Cleaning," or SSPC-SP 6/NACE No.3, "Commercial Blast Cleaning."
4. Factory Priming for Field-Painted Finish: Apply shop primer specified below immediately after surface preparation and pretreatment. Apply a smooth coat of even consistency to provide a uniform dry film thickness of not less than 0.7 mils.
 - a. Shop Primer: Manufacturer's standard, fast-curing, lead- and chromate-free primer complying with ANSI A250.10 acceptance criteria; recommended by primer manufacturer for substrate; compatible with substrate and field-applied finish paint system indicated; and providing a sound foundation for field-applied topcoats despite prolonged exposure.

Part 3 - Execution

3.01 Fabrication:

- A. All doors, and frames shall be cleaned of rust, grease and other impurities, and all welds ground and filled smooth, Metallic filler to conceal defects is not acceptable.
- B. Doors and frames shall be mortised, reinforced, drilled, and tapped for all mortise hardware in accordance with Hardware schedule and templates furnished by the hardware supplier, except that drilling and tapping for surface door closers, door closer brackets, surface panic devices and/or other surface applied hardware shall be done in the field. Frames shall be accurate and done in a neat, workmanlike manner.

3.02 Installation:

- A. Standard Steel Frames: Install standard steel frames for doors sidelights borrowed lights and other openings, of size and profile indicated. Comply with SDI 105.
 1. Bituminous coating and grout: Any material lost, removed or damaged during transportation or installation shall be replaced.
 2. Set frames accurately in position; plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete, remove temporary

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

braces, leaving surfaces smooth and undamaged.

- a. At fire-protection-rated openings, install frames according to NFP A 80.
 - b. Install frames with removable glazing stops located on secure side of opening.
 - c. Install door silencers in frames before grouting.
 - d. Remove temporary braces necessary for installation only after frames have been properly set and secured.
 - e. Check plumb, squareness, and twist of frames as walls are constructed. Shim as necessary to comply with installation tolerances.
3. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor and secure with post-installed expansion anchors.
 - a. Floor anchors may be set with powder-actuated fasteners instead of post installed expansion anchors if so indicated and approved on Shop Drawings.
 4. Metal-Stud Partitions: Solidly pack mineral-fiber insulation behind frames.
 5. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with mortar as specified in Division 4 Section "Unit Masonry Assemblies."
 6. Ceiling Struts: Extend struts vertically from top of frame at each jamb to supporting construction above, unless frame is anchored to masonry or to other structural support at each jamb. Bend top of struts to provide flush contact for securing to supporting construction above. Provide adjustable wedged or bolted anchorage to frame jamb members.
 7. Installation Tolerances: Adjust standard steel door frames for squareness, alignment, twist, and plumb to the following tolerances:
 - a. Squareness: Plus or minus 1/16 inch, measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
 - b. Alignment: Plus or minus 1/16 inch, measured at jambs on a horizontal line parallel to plane of wall.
 - c. Twist: Plus or minus 1/16 inch, measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
 - d. Plumbness: Plus or minus 1/16 inch, measured at jambs at floor.

DIVISION 8 - DOORS & WINDOWS

SECTION 08100 - METAL DOORS AND FRAMES

- B. Standard Steel Doors: Fit hollow-metal doors accurately in frames, within clearances specified below. Shim as necessary.
 - 1. Non-Fire-Rated Standard Steel Doors:
 - a. Jambs and Head: 1/8 inch plus or minus 1/16 inch.
 - b. Between Edges of Pairs of Doors: 1/8 inch plus or minus 1/16 inch.
 - c. Between Bottom of Door and Top of Threshold: Maximum 3/8 inch.
 - d. Between Bottom of Door and Top of Finish Floor (No Threshold): Maximum 3/4 inch.
 - 2. Fire-Rated Doors: Install doors with clearances according to NFP A 80.
 - 3. Smoke-Control Doors: Install doors according to NFPA 105.
 - C. Glazing: Comply with installation requirements in Division 8 Section "Glazing" and with standard steel door and frame manufacturer's written instructions.
- 3.03 Adjusting and Cleaning:
- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including standard steel doors or frames that are warped, bowed, or otherwise unacceptable.
 - B. Clean grout and other bonding material off standard steel doors and frames immediately after installation.
 - C. Prime-Coat Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat and apply touchup of compatible air-drying primer.
 - D. Galvannealed Surfaces: Clean abraded areas and repair with galvanizing repair paint according to manufacturer's written instructions. Do not use abrasive, caustic or acid cleaning agents.
 - E. Protect doors and frames from damage until final acceptance by Contracting Officer. Replace/repair any damaged items as directed above.

End of Section

DIVISION 8 - DOORS & WINDOWS

SECTION 08700 - FINISH HARDWARE

Part 1 - General

1.01 Work Included:

- A. All materials, labor services and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Metal Doors and Frames - Section 08100

1.03 Quality Assurance:

- A. This material shall be procured from a source of supply approved by the Architect as having a member of their firm registered by the American Society of Contracting Architectural Hardware Consultants, and with a proven record of several years of satisfactory experience in contract builder's hardware, both in furnishing material and properly servicing jobs. The supplier also must be an established contract builder's hardware firm who meets all the above requirements, and who maintains and operates an office, display room and stock.

1.04 Submittals:

- A. Prepare a complete schedule including all items processed for each opening and other miscellaneous items and submit four copies to the Architect for approval within 30 days submitted within that time, the supplier shall furnish the hardware specified by catalog number.
- B. Indicate on schedule name of manufacturer after each item.
- C. Upon receiving the approved schedule, the hardware supplier shall immediately forward a copy to the metal frame suppliers, when applicable; and as soon as they receive approved shop drawings, they will immediately forward a complete set to the hardware supplier who can then check the applications and make any necessary minor revisions. If revisions are necessary, notify Architect immediately.
- D. Mark each item of hardware for opening on which it is to be used and deliver a complete schedule to the contractor when hardware is delivered.

1.05 Schedule:

- A. This specification describes the quality, character and function that is required of items of hardware; however, it is not intended to mention each particular item.
- B. It is the responsibility of the supplier to thoroughly detail the entire project to assure that the items specified will properly function in the indicated locations.
- C. Quantities shall be determined by the bidder. Part 2, following, indicates the type and function of material applicable to the typical opening. Should an unlisted opening require different type of function of hardware than that specified, for similar opening, notify the Architect, and provide hardware for unlisted openings within the bid.

DIVISION 8 - DOORS & WINDOWS

SECTION 08700 - FINISH HARDWARE

Part 2 - Products

2.01 Finish Hardware:

A. Standards of Quality:

1. Codes, specifications and published recommendations, latest editions of the following are hereby made part of this section of the specifications in so far as they apply to the material or work called for.
 - a. National Builders Hardware Association (NBHA)
 - b. American Society for Testing Materials (ASTM)
 - c. Underwriters Laboratories (UL)
 - d. National Fire Protection Association (NFPA)
 - e. Code of Ethics of ASAH & NBHA
 - f. Federal Emergency Management Agency (FEMA)
2. Federal Specification, (ANSI Specifications):
 - a. Hinges: FF-H-116C (ANSI A156.1)
 - b. Locks and Door Trim: FF-H-106A (ANSI A 156.2)
 - c. Auxiliary Locks: FF-H-106A (ANSI A 156.5)
 - d. Exit Devices: FF-H-106A, FF-H-111B, FF-L486 (ANSI A156.3).
 - e. Door Closers: FF-H-121C (ANSI A 156.4)
 - f. Shelf and Miscellaneous Hardware: FF-H-00116 (ANSI A156.6).
 - g. All Door hardware: Comply with ADAAG where applicable.

B. General:

1. All hardware relating to hollow metal doors and frames shall be to standard templates of each respective hardware manufacturer for items furnished.
 - a. The related suppliers such as hollow metal doors and frames and such others as may be required will furnish the hardware supplier one copy of each of their approved shop drawings for proper coordination of their work and the finish hardware.

C. Manufacturers and Requirements:

1. Hardware manufacturers and brand names are for a guide as to type and standard required and all such hardware furnished must meet these standards as far as quality, weight, finish and design.

D. Keying:

1. All locks and cylinders to be masterkeyed as directed by the Architect/Owner.
2. Keys: Furnish the following keys:
 - a. 2 change keys each lock or cylinder
 - b. 6 masterkeys
 - c. **all interior locks and cylinders shall be Classic Schlage and keyed to the Owner's Primus Master Key System.**

DIVISION 8 - DOORS & WINDOWS

SECTION 08700 - FINISH HARDWARE

2.02 Hardware Sets:

Hardware Group No. 001: Provide each PR door(s) with the following:

Quantity	Description	Model Number	Finish	Mfr
6	EA HINGE	5BB1 4.5 X 4.5	652	IVE
1	SET AUTO FLUSH BOLT	FB31P OR FB41P AS REQUIRED	630	IVE
1	EA DUST PROOF STRIKE	DP2	626	IVE
1	SET ASTRAGAL	9605A HEIGHT AS REQ	AL	NGP
1	EA STOREROOM LOCK	L9080T 03N	626	SCH
1	EA CLASSIC CORE	23-030	626	SCH
1	EA COORDINATOR	COR X FL X MTG BRKTS X HW PREPS X LENGTH AS REQ	628	IVE
1	SET ASTRAGAL	9605A HEIGHT AS REQ (OMIT @ NON-RATED DOORS)	AL	NGP
2	EA SURFACE CLOSER	4040 OR P4040XP MTG BRKTS, SPCRS & PLATES AS REQ	689	LCN
2	EA KICK PLATE	8400 10" X 1" LDW	630	IVE
2	EA STOP	WS407CCV OR FS436 AS REQUIRED	628	IVE
1	SET SEALS	5050BR H & J	CLR	NGP

The following list of products and manufactures are acceptable for this project.

<u>Product</u>	<u>Manufacture and Approved Equals</u>
1. Hinges	A. Ives B. Hager C. Bommer
2. Continuous Hinges	A. Pemko B. Roton C. Select
3. Key System	A. Schlage (No substitutions)
4. Lock/Latch	A. Schlage (No substitutions)
5. Closers	A. LCN (No substitutions)
6. Exit Devices	A. Von Duprin (No substitutions)
7. Push/Pull/Plates	A. Ives B. Rockwood C. Trimco
8. Misc. Stop, Bolts, etc.	A. Ives B. Glynn-Johnson C. Rockwood

DIVISION 8 - DOORS & WINDOWS

SECTION 08700 - FINISH HARDWARE

- 9. Door Seal/Thresholds
 - A. National Guard
 - B. Pemko
 - C. Reese

Each Product, by category, shall be the product of one manufacture. Complete lockset, including keyed lock cylinder, shall be the product of one manufacturer unless noted otherwise.

Part 3 - Execution

3.01 Installation:

- A. Install all finish hardware in strict accordance with the manufacturer's recommendations and printed instructions. Wherever cutting and fitting is required to install hardware onto or into surfaces which are later to be painted or finished in another way, install each item completely and then remove and store in the a secure place during the finish application. After completion of the finishes, reinstall each item. Do not install surface mounted items until finishes have been completed on the substrate.
- B. All hardware relating to hollow metal and aluminum doors and frames shall be to standard templates of each respective hardware manufacturer for items furnished.
- C. Mounting Heights: Mount Hardware units at heights recommended by the National Builders Hardware Association, except as specifically indicated or required to comply with governing regulations, or as may be otherwise directed by the Architect.

3.02 Prior to the Final Inspection:

- A. The supplier shall check all closers for proper operation after they have been installed and adjusted by the Contractor. He shall verify the keying to insure proper location of locksets and shall assist the Contractor in correcting faulty operation of any locks.
- B. Within 30 days after the acceptance of the entire project, the Contractor shall be responsible for this supplier meeting with the maintenance custodian at the job site for the purpose of instructing him thoroughly in the proper repair and adjustment of all finish hardware items, and items, and shall present to the custodian a full complement of tools to be used.

End of Section

DIVISION 9 - FINISHES

SECTION 09120 - CEILING SUSPENSION SYSTEMS

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Gypsum Wallboard - Section 09250
- B. Acoustical Treatment - Section 09500

1.03 Quality Assurance:

- A. Standards:
 - 1. American Society for Testing and Materials
 - a. ASTM C-635, Metal Suspension Systems for Acoustical Tile and Lay-In-Panel Ceilings.
 - b. ASTM C-636, Recommended Practice of Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In-Panels.
 - 2. All materials to comply with NFPA 101, 16-3.3.2, where applicable.
- B. Submittals:
 - 1. Provide submittals in the form of samples, and documentation, to the Architect for review.

1.04 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.**

Part 2 - Products

2.01 Materials:

- A. Suspended Acoustical Ceiling - Exposed Grid: ASTM C-635, intermediate structural classification.
 - 1. Main Beams, Cross Tees and Concealed Members: .015 cold rolled zinc coated steel.
 - 2. Wall Angle: .020 cold rolled zinc coated steel.
 - 3. Special Members: Provide special shaped members as shown on the Drawings.
 - 4. Member Finish: Exposed surfaces shall be flat white low-gloss grid.
 - 5. Hanger Wire: No. 12 gauge cold drawn, annealed, galvanized.
 - 6. Accessories: Provide wall clips, hold-down clips (shall be removable without damage to boards; two each panels opposite sides), beam clamps leveling splines, hanger clips, splice plates), (keep to a minimum), for a complete installation.

DIVISION 9 - FINISHES

SECTION 09120 - CEILING SUSPENSION SYSTEMS

7. Acceptable Manufacturer: 200 Snap-Grid System, Chicago Metallic Corporation
8. Acoustical "Cloud" Edge Trim:
 - a. Axiom Classic Trim as manufactured by Armstrong World Industries, Inc.
 - b. Commercial quality extruded aluminum alloy 6063 trim channel with factory applied baked polyester paint finish.
 - c. Color - white (to match ceiling grid).
 - d. Height - 8".
 - e. Provide all necessary accessories including, but limited to, corner posts, T-bar connection clips, galvanized steel splice plates, etc. Do not hang acoustical clouds from edge trim.
- B. Suspended Gypsum Board Ceilings:
 1. Structural Channels: Cold-rolled, 16 gauge, galvanized steel.
 2. Furring Channels: Roll-formed, hat sections, 20 gauge.

Part 3 - Execution

3.01 General:

- A. Coordinate with electrical and mechanical contractors in placement of light fixtures, grilles, etc. to conform with ceiling pattern.
- B. Construct necessary scaffolding, adequate and safe, in accordance with applicable laws and ordinances. Maintain during this work and remove after completion.
- C. Provide thorough and competent foreman and skilled mechanics.

3.02 Installation:

- A. Suspended Acoustical Ceiling:
 1. Deflection of any component shall not exceed 1/360 of the span.
 2. Main tees shall be suspended on 48" centers by 12 gauge wire spaced not more than 48" o.c. along main tee.
 3. Cross tees shall be placed at 24" o.c. or as required by the Drawings.
 4. Install wall angles at intersection of suspended ceiling and all vertical surfaces. Miter corners where wall molding intersects.
 5. Install grid system and ceiling panels with faces in a plane.
 6. Provide intersection clips at intersection of all tees.
 7. Provide additional hangar wire at four corners of light fixtures.
 8. Provide additional hangar wires to insure proper placement

DIVISION 9 - FINISHES

SECTION 09120 - CEILING SUSPENSION SYSTEMS

and alignment of grid system.

9. Prior to the final acceptance of the building, examine and adjust water level to be certain that all planes and lines are plumb, square and smooth. Replace all marked, marred or otherwise damaged materials.

B. Suspended Gypsum Board Ceilings:

1. Coordinate location of hangars with other work.
2. Install ceiling framing independent of walls, columns and above ceiling work.
3. Install ceiling framing system in accordance with manufacturer's recommendations.
4. Reinforce openings in ceilings in accordance with manufacturer's recommendations.
5. Laterally brace entire suspension system where required.

3.03 Clean-Up:

- A. Completely remove from the job site, at the completion of the work, all cartons, packaging, etc., and all other scraps and waste caused by this trade.

End of Section

DIVISION 9 - FINISHES

SECTION 09250 - GYPSUM WALLBOARD

Part 1 - General

- 1.01 Work Included:
 - A. All materials, labor, services and incidentals necessary for the completion of this section of the work.
- 1.02 Quality Assurance:
 - A. Standards:
 - 1. American Society for Testing and Materials:
 - a. ASTM C-36, Gypsum Wallboard
 - b. ASTM C-475, Joint Treatment for Gypsum Wallboard Construction.
 - B. Federal Specifications:
 - 1. FS-SS-L-30D, Type III, Grade X, Class 1, Gypsum Wallboard.
- 1.03 Submittals:
 - A. Provide submittals in the form of samples, and documentation, to the Architect for review.
- 1.04 Product Delivery, Storage and Handling:
 - A. All materials shall be delivered to the job site with manufacturer's labels intact and stored in an enclosed shelter providing protection from damage and exposure to the elements.

Part 2 - Products

- 2.01 Gypsum Wallboard:
 - A. Type: **Fire-rated**, ASTM C-36.
 - B. Size: 5/8" thick x 48" wide x 96" or as required.
 - C. Edges: Tapered.
 - D. Location: All gypsum board.
- 2.02 Gypsum Wallboard:
 - A. Type: **Impact Resistant, Fire-rated**, ASTM C-36 / C-1396, Impact Resistance ASTM E-695, Indentation Resistance ASTM D-5420, Abrasion Resistance ASTM D-4977,
 - B. Size: 5/8" thick x 48" wide x 96" or as required.
 - C. Edges: Tapered.
 - D. Location: Where indicated on drawings and / or exposed in corridors.
- 2.03 Fasteners:
 - A. Screws: Self-drilling, self-tapping, bugle head, Type S.
 - B. Nails: Annular ring: GWB-54.
- 2.04 Joint Treatment Materials:
 - A. Joint Tape: Perforated Tape, ASTM C-475.
 - B. Joint Compound: ASTM C-475.
- 2.05 Accessories:
 - A. Metal Edge: Similar to United States Gypsum Trim No. 402.
 - B. Interior Trim: ASTM C 1047.
 - 1. Material: Galvanized coated steel sheet.

DIVISION 9 - FINISHES

SECTION 09250 - GYPSUM WALLBOARD

2. Shapes:
 - a. Cornerbead.
 - b. L-Bead: L-shaped; exposed long flange receives joint compound.
 - c. Expansion (control) joint.
 - d. Curved-Edge Cornerbead: With notched or flexible flanges.
- C. Hat-Shaped, Rigid Furring Channels: ASTM C 645, 7/8 inch deep.
 1. Minimum Base Metal Thickness: 0.0312 inch.
- D. Laminating Adhesive: Adhesive or joint compound recommended for directly adhering gypsum panels to continuous substrate.

Part 3 - Execution

3.01 Installation:

- A. Apply gypsum board to horizontal surfaces first, then to vertical.
- B. Install gypsum board parallel to studs at vertical surfaces.
- C. To minimize joints, use panels of maximum practical lengths.
- D. Position all ends and edges of gypsum board over nailing or fastening members. Fit ends and edges closely; do not force together. Stagger end joints.
- E. Cut ends, edges, scribe or make cutouts within field of panel in a workmanlike manner.
- F. Install trim at all intersections of gypsum board and other surfaces. Provide corner bead at all vertical or horizontal corners.
- G. Fasteners:
 1. Drive fasteners in field of panel first, work toward ends and edges.
 2. Perimeter fasteners shall be a least 3/8" from ends and edges.
 3. Attach panels to wood framing members with specified nails spaced out 8" for ceiling, and 8" o.c. at ends and 12" o.c. at each support.
 4. Drive nail head slightly below surface of panel in a uniform dimple without breaking face paper.
 5. Screw fasteners shall be spaced 12" o.c. at each support in the field of the board and 8" o.c. at all edges and ends.
 6. Screws shall be power-driven with an electric screwdriver and screw heads shall provide a slight depression below surface of panel without breaking face paper.

3.02 Joint Treatment:

- A. Treat all exposed joints and trim with a three-coat approved system applied in strict accordance with manufacturer's

DIVISION 9 - FINISHES

SECTION 09250 - GYPSUM WALLBOARD

recommendations.

3.03 Applying Texture Finishes:

- A. Surface Preparation and Primer: Prepare and apply primer to gypsum panels and other surfaces receiving texture finishes. Apply primer to surfaces that are clean, dry, and smooth.
- B. Texture Finish Application: Mix and apply finish using powered spray equipment, to produce a uniform texture matching approved mockup and free of starved spots or other evidence of thin application or of application patterns. Provide light orange peel finish.
- C. Prevent texture finishes from coming into contact with surfaces not indicated to receive texture finish by covering them with masking agents, polyethylene film, or other means. If, despite these precautions, texture finishes contact these surfaces, immediately remove droppings and overspray to prevent damage according to texture-finish manufacturer's written recommendations.

3.04 Clean-Up:

- A. Use all necessary care during execution of the Work of this Section to prevent undue scattering of drywall scraps and dust and to prevent tracking of joint and finishing compounds onto floor surfaces. On completion of each installation segment in a room or space, promptly pick up and remove from the working area all scraps, debris and surplus material.

End of Section

DIVISION 9 - FINISHES

SECTION 09500 - ACOUSTICAL TREATMENT

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services, and incidentals necessary for the completion of this section of the work.

1.02 Related Work Specified Elsewhere:

- A. Ceiling Suspension Systems - Section 09120

1.03 Quality Assurance:

A. Standards:

1. American Society for Testing and Materials:
 - a. ASTM C-636 Recommended Practice of Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels.
 - b. ASTM E-84 Surface Burning Characteristics of Building Materials.
2. Federal Specifications:
 - a. SS-S-118B, Sound Controlling Blocks and Boards. Underwriter's Laboratories, Inc.

B. Submittals:

1. Provide submittals in the form of samples, and documentation, to the Architect for review.

1.04 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers**

Part 2 - Products

2.01 Acoustical Ceiling Panels:

A. 2x2 Tile - Square Edge:

1. Type: FS-SS-S-118B, Class 25
2. Size: 24" x 24" x 5/8". Provide special sizes as indicated on Drawings or as required by others.
3. Finish: Board finish shall be a factory-applied white latex paint, medium textured non-direction fissured surface with a minimum light reflection of 80%.
4. Noncombustibility: Board shall meet class 25-Federal Specification SS-S-118B, ASTM E-84; and, classified by Underwriter's Laboratories for Flame Spread Index 0-25.
5. Type Example and Manufacturer:
 - a. Armstrong Fine Fissured No. 1728, square (2x2)

B. 2x2 Tile - Tegular Edge:

1. Type: FS-SS-S-118B, Class 25
2. Size: 24" x 24" x 5/8". Provide special sizes as indicated on Drawings or as required by others.

DIVISION 9 - FINISHES

SECTION 09500 - ACOUSTICAL TREATMENT

3. Finish: Board finish shall be a factory-applied white latex paint, medium textured non-direction fissured surface with a minimum light reflection of 80%.
4. Noncombustibility: Board shall meet class 25-Federal Specification SS-S-118B, ASTM E-84; and, classified by Underwriter's Laboratories for Flame Spread Index 0-25.
5. Type Example and Manufacturer:
 - a. Armstrong Fine Fissured No. 1732, beveled tegular 2x2).

Part 3 - Execution

3.01 Installation:

- A. Install in specified grid system per ASTM C-636 and manufacturer's recommendations, as shown on the Drawings.
- B. Provide ten (10) pieces of ceiling panels in cartons for future use. Panels shall be in perfect condition.

End of Section

DIVISION 9 - FINISHES

SECTION 09900 - PAINTING

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this entire section of the work.
- B. Consult Drawings, finish schedules, details and specification section.

1.02 Quality Assurance:

- A. All painted surfaces shall be uniform in color, texture and finish to the satisfaction of the Architect.

1.03 Submittals:

- A. Submit manufacturer's specifications, including paint label analysis and application instructions for each material specified.
- B. Submit color samples for review of color and texture.
- C. Provide samples of all natural and stained wood finishes.
- D. Final samples: Prepare samples of finishes on the job to the satisfaction of the Architect. If required, a 4' x 8' portion of wall surface finished as final sample.

1.04 Product Deliver, Storage and Handling:

- A. Materials shall be delivered to the project site in strong, undamaged, waterproof containers with manufacturer's label intact. Materials in previously opened or unsealed containers, are not acceptable.
- B. Include on label of container: Manufacturer's name, type of paint, number and application instructions.
- C. Immediately upon delivery to the project site, all painter materials shall be stored and locked in a watertight shed with floor well off the ground. The shed shall remain locked at all times except for adding or removing materials.
- D. No materials of any manufacturer will be allowed on the project site any time during construction except those of the manufacturers specified or approved by the Architect.

1.05 Job Conditions:

- A. Comply with manufacturer's recommendations as to environmental conditions under which coating and coating systems can be applied.
- B. Do not apply finishes in areas where dust is being generated or where work in progress may affect finish quality.
- C. Protect finished work of other trades, and all surfaces not being painted concurrently, or not to be painted.

Part 2 - Products

2.01 General:

- A. The following specifications for Finishes is not intended to mention every particular item which will receive painter finish, but is intended to establish type and quality of finish which shall be required on various materials.
- B. **Products of Sherwin-Williams are specified herein to simplify descriptions of types and qualities of finishes required only.**

DIVISION 9 - FINISHES

SECTION 09900 - PAINTING

Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.

- C. Wherever the abbreviation "SW" appears in the following detailed specification, it shall be understood to mean Sherwin-Williams.
 - D. Primers shall be as specified by manufacturers of finish paint used and as approved by the Architect.
- 2.02 Acceptable Manufacturers:
- A. Sherwin-Williams.
 - B. PPG Industries.
 - C. Cook Paint and Varnish Co.
 - D. Pratt and Lambert.
 - E. Kelly-Moore.
- 2.02 Exterior Finishes:
- A. Enamel on Ferrous Metals:
 - 1. One coat SW Kem Kromik Primer, (Alkyd primer).
 - 2. Two coats SW Industrial Enamel, (Alkyd gloss enamel).
 - B. Enamel on Exterior Door Frames and Doors:
 - 1. Shop coat by others-touch up as required.
 - 2. Two coats SW Industrial Enamel, (Alkyd gloss enamel).
 - C. Enamel on Galvanized Metal:
 - 1. One Coat SW Galvite primer.
 - 2. 2 Coats SW Industrial Enamel, (Alkyd gloss enamel).
 - D. Enamel on Exterior Concrete Block:
 - 1. One coat SW Promar Latex Block Filler B25W25.
 - 2. Two coats SW A-100 Semi-Gloss Latex Enamel.
- 2.03 Interior Finishes:
- A. Enamel on Metal: All miscellaneous and ornamental metal items which are left exposed, hollow metal doors and frames.
 - 1. Shop coat by others - touch up as required.
 - 2. Two coats SW Promar 200 Semi-Gloss. Enamel, (Alkyd semi-gloss enamel).
 - B. Enamel on Concrete Block:
 - 1. One coat SW Promar 200 Block Filler (vinyl acrylic latex).
 - 2. Two coats SW Promar 200 Semi-Gloss Enamel.
 - C. Enamel on Gypsum Board Ceilings/Facias/Walls
 - 1. One coat SW Promar 200 Wall Primer with Medium Texture. (Vinyl Acrylic Latex Wall Primer.)
 - 2. Two coats SW Promar 200 Semi-Gloss Latex Enamel.
 - D. Tape and Float: Joints on Gypsum Board.
 - 1. As per manufacturer's instructions.
 - 2. All joints shall be sanded ready for primer's finish.
 - E. Interior Millwork and Cabinetry:
 - 1. One coat SW Promar 200 Alkyd Enamel Primer/Undercoat.
 - 2. Two coats SW Promar 200 Semi-Gloss Latex Enamel.
 - F. Enamel on Wood Trim:
 - 1. One coat SW Promar 200 Alkyd Enamel Primer/Undercoat.
 - 2. Two coats SW Promar 200 Semi-Gloss Latex Enamel.
 - G. Back-Painting, Interior Work:
 - 1. Two coats SW Promar 200 Alkyd Enamel Primer/Undercoat.

DIVISION 9 - FINISHES

SECTION 09900 - PAINTING

- H. Enamel on Exposed Metal Piping:
 - 1. One coat SW Galvite primer.
 - 2. Two coats SW Promar 200 Semi-Gloss Latex Enamel.

Part 3 - Execution

3.01 Inspection:

- A. Notify Contractor of any surface not in proper condition to be finished before proceeding with the work. Starting work will constitute the painter's acceptance of preceding work, and conditions under which finish will be applied and his assumption of responsibility for results to be obtained.

3.02 Preparation of Surfaces:

- A. Wood:
 - 1. Sand to a smooth even surface, then dust off.
 - 2. Touch-up knots, resinous spots, etc., on all surfaces with shellac 18 hours before applying prime coat.
 - 3. Fill nail holes, cracks and blemishes flush after priming coat has dried.
- B. Concrete Block and Concrete:
 - 1. Repair cracks and irregularities to provide uniform surface texture.
- C. Ferrous Metal Surfaces:
 - 1. Remove rust and scale, clean grease or oil surfaces with turpentine or benzine before painting.

3.03 Application:

- A. Number of coats and quality of finish shall be in accordance with these specifications, which requires the use of material which will product first quality finish if properly applied.
- B. Apply coats of material in strict accordance with manufacturer's currently published specifications, except where requirements of these specifications are in excess or manufacturer's requirements.
- C. Except as otherwise approved by the Architect, the first two coats of painter's finish shall be applied by roller or brush application. Finish coats may be applied by spray application.
- D. Comply with recommendation of product manufacturer for drying time between succeeding coats allow additional as required until finish is dry.
- E. All work where a coat of material has been applied must be inspected and approved before application of succeeding coat, otherwise, no credit for the coat well be given. Notify Architect when a particular coat has been completed for inspection and approval.
- F. Shellacs, oils, turpentine, etc., shall be of the highest quality and subject to approval of Architect. Materials shall be mixed in and applied directly from containers which they are purchased except when use of other containers is approved.
- G. First Coat of all finishes, except of varnish and stains, shall be white.

DIVISION 9 - FINISHES

SECTION 09900 - PAINTING

- H. Sand lightly between coats where shellac, varnish or enamel is used.
 - I. Remove all hardware, accessories, machined surfaces, and similar items in place and not to be finish-painted, or provide surface-applied protection prior to surface preparation and painting operations.
- 3.04 Clean-up:
- A. Clean and paint spots from work and touch-up or otherwise repair any defective or damaged work.
 - B. Remove all surplus materials and equipment after work is completed.
 - C. Leave entire job clean and acceptable to the Architect.

End of Section

SECTION 22 01 00

PLUMBING OPERATING AND MAINTENANCE MANUALS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Compilation product data and related information appropriate for Owner's operation and maintenance of products furnished under Contract. Prepare operating and maintenance data as specified.
- B. Instruct Owner's personnel in operation and maintenance of equipment and systems.
- C. Submit three copies of complete manual in final form.

1.2 SUBMITTALS

- A. Thirty (30) days after the Contractor has received the final scheduled identified submittals bearing the Architect/Engineer's stamp of acceptance (including resubmittals), submit for review one copy of the first draft of the Operating and Maintenance Manual. This copy shall contain as a minimum:
 - 1. Table of Contents for each element.
 - 2. Contractor information.
 - 3. All submittals, coordination drawings and product data, reviewed by the Architect / Engineer; bearing the Architect / Engineer's stamp of acceptance. (When submittals are returned from Engineer "Correct as Noted", corrected inserts shall be included.)
 - 4. All parts and maintenance manuals for items of equipment.
 - 5. Warranties (without starting dates)
 - 6. Certifications that have been completed. Submit forms and outlines of certifications that have not been completed.
 - 7. Operating and maintenance procedures.
 - 8. Form of Owner's Training Program Syllabus (including times and dates).
 - 9. Control operations/equipment wiring diagrams.
 - 10. Other required operating and maintenance information that are complete.
- B. Copy will be returned to the Contractor within 15 days with comments for corrections.
- C. Submit completed manuals in final electronic form to the Architect / Engineer one day after substantial completion, and prior to Owner's instructions. Include all specified data, test and balance reports, drawings, dated warranties, certificates, reports, along with other materials and information.
- D. The Architect/Engineer will review the manuals for completeness within fifteen (15) days.
- E. The Contractor shall be notified of any missing or omitted materials. The Manuals shall be reworked by the Contractor, as required, in the office of the Architect / Engineer. The manuals will not be retransmitted.
- F. Complete electronic manuals will be delivered to the Owner.

PART 2 - PRODUCTS

2.1 BINDERS

- A. Commercial quality black three-ring binders with clear overlay plastic covers.

- B. Minimum ring size: 1 inch; Maximum ring size: 3 inches.
- C. When multiple binders are used, correlate the data into related groupings.
- D. Label contents on spine and face of binder with full size insert. Label under plastic cover.

PART 3 - EXECUTION

3.1 OPERATION AND MAINTENANCE MANUAL

- A. Form for Manuals:
 - 1. Prepare data in form of an instructional manual for use by Owner's personnel.
 - 2. Format:
 - a. Size: 8-1/2 inch x 11 inch.
 - b. Text: Manufacturer's printed data or neatly typewritten.
 - 3. Drawings:
 - a. Provide reinforced punched binder tab and bind in text.
 - b. Fold larger drawings to size of text pages.
 - 4. Provide flyleaf indexed tabs for each separate product or each piece of operating equipment.
 - 5. Cover: Identify each volume with typed or printed title "Operating and Maintenance Instructions". List:
 - a. Title of Project
 - b. Identity of separate structures as applicable.
 - c. Identity of general subject matter covered in the manual.
 - 6. Binder as specified.

- B. Content of Manual:
 - 1. Neatly typewritten Table of Contents for each volume arranged in systematic order as outlined in the specifications.
 - a. Contractor, name of responsible principal, address and telephone number.
 - b. A list of each product required to be included, indexed to content of the volume.
 - c. List with each product, name, address and telephone number of:
 - 1) Subcontractor or installer.
 - 2) Maintenance contractor as appropriate.
 - 3) Identify area of responsibility of each.
 - 4) Local source of supply for parts and replacement.
 - d. Identify each product by product name and other identifying symbols as set forth in Contract Documents.
 - 2. Product Data:
 - a. Include those sheets pertinent to the specific product.
 - b. Annotate each sheet to:
 - 1) Identify specific product or part installed.
 - 2) Identify data applicable to installation.
 - 3) Delete references to inapplicable information. (All options not supplied with equipment shall be marked out indicated in some manner.
 - 3. Drawings:
 - a. Supplement product data with drawings as necessary to illustrate:
 - 1) Relations of component parts of equipment and systems.
 - 2) Control and flow diagrams.
 - b. Coordinate drawings with information in Project Record Documents to assure correct illustration of completed installation.
 - c. Do not use Project Record Documents as maintenance drawings.

4. Written text, as required to supplement product data for the particular installation:
 - a. Organize in consistent format under separate headings for different procedures.
 - b. Provide logical sequence of instructions for each procedure.
 5. Copy of each warranty, bond and service contract issued.
 - a. Provide information sheet for Owner's personnel, giving:
 - 1) Proper procedures in event of failure.
 - 2) Instances that might affect validity of warranties or bonds.
 6. Shop drawings, coordination drawings and product data as specified.
- C. Sections for Equipment and Systems.
1. Content for each unit of equipment and system as appropriate:
 - a. Description of unit and component parts.
 - 1) Function, normal operating characteristics, and limiting conditions.
 - 2) Performance curves, engineering data and tests.
 - 3) Complete nomenclature and commercial number of replaceable parts.
 - b. Operating procedures:
 - 1) Start up, break-in, routine and normal operating instructions.
 - 2) Regulation, control, stopping, shut down and emergency instructions.
 - 3) Summer and winter operating instructions.
 - 4) Special operating instructions.
 - c. Maintenance procedures:
 - 1) Routine operations
 - 2) Guide to trouble-shooting.
 - 3) Disassembly, repair and reassembly.
 - 4) Alignment, adjusting and checking.
 - 5) Routine service based on operating hours.
 - d. Servicing and lubrication schedule. List of lubricants required.
 - e. Manufacturer's printed operating and maintenance instructions.
 - f. Description of sequence of operation by control manufacturer.
 - g. Original manufacturer's parts list, illustrations, assembly drawings and diagrams required for maintenance.
 - 1) Predicted life of part subject to wear.
 - 2) Items recommended to be stocked as spare parts.
 - h. As installed control diagrams by controls manufacturer.
 - i. Complete equipment internal wiring diagrams.
 - j. Each Contractor's coordination drawings.
 - k. As installed color coded piping diagrams.
 - l. Charts of valve tag number, with location and function of each valve.
 - m. List of original manufacturer's spare parts and recommended quantities to be maintained in storage.
 - n. Other data as required under pertinent sections of the specifications.
 2. Prepare and include additional data when the need for such data becomes apparent during instruction of Owner's personnel.
 3. Additional requirements for operating and maintenance data as outlined in respective sections of specifications.
 4. Provide complete information for products specified in Division 22.
 5. Provide certificates of compliance as specified in each related section.
 6. Provide start up reports as specified in each related section.
 7. Provide signed receipts for spare parts and material.
 8. Provide training report and certificates.
 9. Provide gas piping pressure test reports.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 22 05 00

PLUMBING GENERAL PROVISIONS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Except as modified in this Section, General Conditions, Supplementary Conditions, applicable provisions of the General Requirements, and other provisions and requirements of the contract documents apply to work of Division 22 Plumbing.
- B. Applicable provisions of this section apply to all sections of Division 22, Plumbing.

1.2 CODE REQUIREMENTS AND FEES

- A. Perform work in accordance with applicable statutes, ordinances, codes and regulations of governmental authorities having jurisdiction.
- B. Plumbing work shall comply with applicable inspection services:
 - 1. Underwriters Laboratories.
 - 2. National Fire Protection Association.
 - 3. State Health Department.
 - 4. Local Municipal Building Inspection Department.
- C. Resolve any code violations discovered in contract documents with the Engineer prior to award of the contract. After Contract award, any correction or additions necessary for compliance with applicable codes shall be made at no additional cost to the Owner.
- D. This Contractor shall be responsible for being aware of and complying with asbestos NESHAP regulations, as well as all other applicable codes, laws and regulations.
- E. Obtain all permits required.

1.3 CONTRACTOR'S QUALIFICATIONS

- A. An approved contractor for the work under this division shall be:
 - 1. A licensed specialist in this field and have the personnel, experience, training, skill, and organization to provide a practical working system
 - 2. Able to furnish evidence of having contracted for and installed not less than three systems of comparable size and type that has served their Owners satisfactorily for not less than three years.

1.4 REFERENCE SPECIFICATIONS AND STANDARDS

- A. Materials which are specified by reference to Federal Specifications; ASTM, ASME, ANSI, or AWWA Specifications; Federal Standards; or other standard specifications must comply with latest editions, revisions, amendments or supplements in effect on date bids are received. Requirements in reference specifications and standards are minimum for all equipment, material, and work. In instances where specified capacities, size, or other features of equipment, devices, or materials exceed these minimums, meet specified capacities.

1.5 CONTRACT DRAWINGS

- A. Contract drawings are diagrammatic only and do not give fully dimensioned locations of various elements of work. Determine exact locations from field measurements.

1.6 PROJECT RECORD DOCUMENTS

- A. Maintain at the job site a separate set of white prints (blue line or black line) of the contract drawings for the sole purpose of recording the "as-built" changes and diagrams of those portions of work in which actual construction is at variance with the contract drawings. Mark the drawings with a colored pencil. Prepare, as the work progresses and upon completion of work, reproducible drawings clearly indicating locations of various lines, valves, ductwork, traps, equipment, and other pertinent items, as installed. Include flow-line elevation of sewer lines. Record existing and new underground and under slab piping with dimensioned locations and elevations of such piping.
- B. At the conclusion of project, obtain without cost to the Owner, erasable mylars of the original drawings and transfer as-built changes to these. Prior to transmittal of corrected drawings, obtain three sets of blue-line prints of each drawing, regardless of whether corrections were necessary and include in the transmittal (two sets are for the Owner's use and one set is for the Architect / Engineer's records). Delivery of these as-built prints and reproducible is a condition of final acceptance. Provide record drawings on one set each (reproducible Dayrex mylar film positives) and AutoCad 2012 / Revit CAD files on disk (CD Rom).
- C. As-Built drawings should indicate the following information as a minimum:
 - 1. Indicate all addendum changes to documents.
 - 2. Remove Engineer's seal, name, address and logo from drawings.
 - 3. Mark documents RECORD DRAWINGS.
 - 4. Clearly indicate: DOCUMENT PRODUCED BY
 - 5. Indicate all changes to construction during construction. Indicate actual routing of all piping, ductwork, etc. that were deviated from construction drawings.
 - 6. Correct schedules to reflect (actual) equipment furnished and manufacturer.
 - 7. During the execution of work, maintain a complete set of drawings and specifications upon which all locations of equipment, ductwork, piping, devices, and all deviations and changes from the construction documents in the work shall be recorded.
 - 8. Location and size of all ductwork and mechanical piping above ceiling including exact location of isolation of domestic and plumbing valves.
 - 9. Exact location of all roof mounted equipment, wall, roof and floor penetrations.
 - 10. Cloud all changes.

1.7 SPACE REQUIREMENTS

- A. Consider space limitations imposed by contiguous work in selection and location of equipment and material. Do not provide equipment or material that is not suitable in this respect.

1.8 RELATION WITH OTHER TRADES

- A. Carefully study all matters and conditions concerning the project. Submit notification of conflict in ample time to prevent unwarranted changes in any work. Review other Divisions of these specifications to determine their requirements.
- B. Because of the complicated relationship of this work to the total project, conscientiously study the relation and cooperate as necessary to accomplish the full intent of the documents.
- C. Provide sleeves and inserts in forms as required for the work. Stub up and protect open ends of pipe before any concrete is placed. Furnish sizes of required equipment pads. Furnish and locate bolts and fittings required to be cast in them.

- D. Locate and size openings required for installation of work specified in this Division in sufficient time to prevent delay in the work.
- E. Refer to other Divisions of the specifications for the scope of required connections to equipment furnished under that Division. Determine from the Contractor for the various trades, the Owner, and by direction from the Architect / Engineer, the exact location of all items.

1.9 CONCEALED AND EXPOSED WORK

- A. When the word "concealed" is used in connection with insulating, painting, piping, ducts and the like, the work is understood to mean hidden from sight as in chases, furred spaces or above ceilings. "Exposed" is understood to mean open to view.

1.10 GUARANTEE

- A. Guarantee work for one year from the date of substantial completion of the project. During that period make good any faults or imperfections that may arise due to defects or omissions in material, equipment or workmanship. At the Owner's option, replacement of failed parts or equipment shall be provided.

1.11 MATERIAL AND EQUIPMENT

- A. Furnish new and unused materials and equipment meeting the requirements of the paragraph specifying acceptable manufacturers. Where two or more units of the same type or class of equipment are required, provide units of a single manufacturer.

1.12 NOISE AND VIBRATION

- A. Select equipment to operate with minimum noise and vibration. If objectionable noise or vibration is produced or transmitted to or through the building structure by equipment, piping, ducts or other parts of work, rectify such conditions at no additional cost. If the item of equipment is judged to produce objectionable noise or vibration, demonstrate at no additional cost that equipment performs within designated limits on a vibration chart.

1.13 ACCEPTABLE MANUFACTURERS

- A. Manufacturers names and catalog number specified under sections of Division 22 are used to establish standards of design, performance, quality and serviceability and not to limit competition. Equipment of similar design, equal to that specified, manufactured by a named manufacturer will be acceptable on approval. A request for prior approval of equipment not listed must be submitted ten (10) days before bid due date. Submit complete design and performance data to the Engineer.

1.14 OPERATING TESTS

- A. After all plumbing systems have been completed and put into operation, subject each system to an operating test under design conditions to ensure proper sequencing and operation throughout the range of operation. Tests shall be made in the presence of the Architect / Engineer. Make adjustments as required to ensure proper functioning of all systems. Special tests on individual systems are specified under individual sections. Submit three copies of all certifications and test reports adequately in advance of completion of the work to allow for remedial action as required to correct deficiencies discovered in equipment and systems.

1.15 WARRANTIES

- A. Submit three copies of all warranties and guarantees for systems, equipment, devices and materials. These shall be included in the Operating and Maintenance Manuals.

1.16 BUILDING CONSTRUCTION

- A. It shall be the responsibility of each sub-contractor to consult the Architectural and Engineering drawings, details, and specifications and thoroughly familiarize himself with the project and all job related requirements. Each subcontractor shall cooperate with the General Contractor to verify that all piping and other items are placed in the walls, furred spaces, chases, etc., so there will be no delays in the job.

PART 2 - PRODUCTS – NOT USED

PART 3 - EXECUTION

3.1 OPENINGS

- A. Framed, cast or masonry openings for ductwork, equipment or piping are specified under other divisions. Drawings and layout work for exact size and location of all openings are included under this division.

3.2 INSTRUCTION OF OWNER'S PERSONNEL

- A. Prior to final inspection, conduct an on-site training program to instruct the Owner's operating personnel in the operation and maintenance of the plumbing systems.
 - 1. Provide the training during the Owner's regular working day.
 - 2. The Instructors shall each be experienced in their phase of operation and maintenance of building plumbing systems and with the project.
- B. Time to be allocated for instructions.
 - 1. Minimum of 1 hours dedicated instructor time.
- C. Before proceeding with the on-site training program, submit the program syllabus; proposed time and dates; and other pertinent information for review and approval.
 - 1. One copy to the Owner.
 - 2. One copy to the Architect / Engineer.
- D. The Owner will provide a list of personnel to receive instructions, and will coordinate their attendance at the agreed upon times.
- E. Use the operation and maintenance manuals as the basis of instruction. Review contents of manual with personnel in detail to explain all aspects of operation and maintenance.
- F. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shut down of each item of equipment.
- G. Demonstrate equipment functions (both individually and as part of the total integrated system).
- H. Prepare and insert additional data in the operating and maintenance manuals when the need for additional data becomes apparent during instructions.
- I. Submit a report within one week after completion of the training program that instructions have been satisfactorily completed. Give time and date of each demonstration and hours

devoted to the demonstration, with a list of people present.

- J. At the conclusion of the on-site training program, have the person designated by the Owner sign a certificate to certify that he/she has a proper understanding of the system, that the demonstrations and instructions have been satisfactorily completed, and the scope and content of the operating and maintenance manuals used for the training program are satisfactory.
- K. Provide a copy of the report and the certificate in an appropriately tabbed section of each Operating and Maintenance Manual.

3.5 EQUIPMENT IDENTIFICATION

- A. Provide a laminated engraved plastic nameplate or tag on each piece of equipment and starter.
 - 1. Designation approved by Architect / Engineer.
 - 2. Equipment includes, but is not limited to, water heaters, pumps, boilers and utility controllers.
 - 3. Submit schedule of equipment to be included and designations.

3.6 OBSTRUCTIONS

- A. The drawings indicate certain information pertaining to surface and subsurface obstructions which has been taken from available drawings. Such information is not guaranteed, however, as to accuracy of location or complete information.
 - 1. Before any cutting or trenching operations are begun, verify with Owner's representative, utility companies, municipalities, and other interested parties that all available information has been provided.
 - 2. Should obstruction be encountered, whether shown or not, alter routing of new work, reroute existing lines, remove obstruction where permitted, or otherwise perform whatever work is necessary to satisfy the purpose of the new work and leave existing services and structures in a satisfactory and serviceable condition.
- B. Assume total responsibility for and repair any damage to existing utilities or construction, whether or not such existing facilities are shown.

3.7 PROTECTION

- A. Protect work, equipment, fixtures, and materials. At work completion, work must be clean and in original manufacturer's condition.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 22 05 10

PLUMBING CONTRACT QUALITY CONTROL

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Contract quality control including workmanship, manufacturer's instructions and demonstrations.

1.2 QUALITY CONTROL PROGRAM

- A. Maintain quality control over supervision, subcontractors, suppliers, manufacturers, products, services, site conditions and workmanship to produce work in accordance with contract documents.

1.3 WORKMANSHIP

- A. Comply with industry standards except when more restrictive tolerances or specified requirements indicate more rigid standards or more precise workmanship.
- B. Perform work by persons qualified to produce workmanship of specified quality.
- C. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, and racking. Under no conditions shall material or equipment be suspended from structural bridging.
- D. Provide finishes to match approved samples. All exposed finishes shall be approved by the Architect. Submit color samples as required.

1.4 MANUFACTURER'S INSTRUCTIONS

- A. Comply with instructions in full detail, including each step in sequence.
- B. Should instruction conflict with Contract Documents, request clarification from Architect / Engineer before proceeding.

1.5 MANUFACTURER'S CERTIFICATES

- A. When required in individual Specification Sections, submit manufacturer's certificate in duplicate, certifying that products meet or exceed specified requirements.

1.6 MANUFACTURER'S FIELD SERVICES

- A. When required in individual Specification Sections, manufacturer shall provide qualified personnel to observe:
 - 1. Field conditions.
 - 2. Condition of installation.
 - 3. Quality of workmanship.
 - 4. Start-up of equipment.
 - 5. Testing, adjusting, and balancing of equipment.
- B. Representative shall make written report of observations and recommendations to Architect / Engineer.

PART 2 - PRODUCTS

2.1 REFERENCE APPLICABLE SPECIFICATION SECTIONS

PART 3 - EXECUTION

3.1 PROTECTION OF EQUIPMENT

- A. Do not deliver equipment to the project site until progress of construction has reached the stage where equipment is actually needed or until building is closed in enough to protect the equipment from weather. Equipment allowed to stand in the weather will be rejected, and the Contractor is obligated to furnish new equipment of a like kind at no additional cost to the Owner.
- B. Adequately protect equipment from damage after delivery to the project. Cover with heavy tarpaulins, drop cloths or other protective coverings as required to protect from plaster, paint, mortar and/or dirt. Do not cover with plastic materials and trap condensate and cause corrosion.

END OF SECTION

SECTION 22 05 12

PLUMBING SHOP DRAWINGS, COORDINATION DRAWINGS & PRODUCT DATA

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Prepare submittals as required by Division 1.
- B. The term submittal, as used herein, refers to all:
 - 1. Shop Drawings.
 - 2. Coordination Drawings.
 - 3. Product data.
- C. Submittals shall be prepared and produced for:
 - 1. Distribution as specified.
 - 2. Inclusion in the Operating and Maintenance Manual, as specified, in the related section.

1.2 SHOP DRAWINGS

- A. Present drawings in a clear and thorough manner. Identify details by reference to sheet and detail, schedule, or room numbers shown on Contract Drawings.
- B. Show all dimensions of each item of equipment on a single composite Shop Drawing. Do not submit a series of drawings of components.
- C. Identify field dimensions; show relationship to adjacent features, critical features, work, or products.
- D. Submit shop drawings in plan, elevation and sections, showing equipment in mechanical equipment areas.

1.3 COORDINATION DRAWINGS

- A. Present in a clear and thorough manner. Title each drawing with project name. Identify each element of drawings by reference to sheet number and detail, or room number of contract documents. Minimum drawing scale: 1/8 inch = 1 foot - 0 inch.
- B. Prepare coordination drawings to coordinate installations for efficient use of available space, for proper sequence of installation, and to resolve conflicts. Coordinate with work specified in other sections and other divisions of the specifications.
- C. For each mechanical room and for each outside equipment pad where equipment is located, submit plan and elevation drawings. Show:
 - 1. Actual mechanical equipment and components to be furnished.
 - 2. Service clearance.
 - 3. Relationship to other equipment and components.
- D. Identify field dimensions. Show relation to adjacent or critical features of work or products.
- E. Related requirements:
 - 1. Ductwork shop drawings.
 - 2. Coordination drawing specified in Division 26.

- F. Submit shop drawings in plan, elevation and sections, showing equipment in mechanical equipment areas.
- G. Gas piping sketch indicating proposed location of piping prior to proceeding with the installation.

1.4 PRODUCT DATA AND INSTALLATION INSTRUCTION

- A. Submit only pages which are pertinent to the project. All options which are indicated on the product data shall become part of the contract and shall be required whether specified are not.
- B. Mark each copy of standard printed data to identify pertinent products, referenced to specification section and article number.
- C. Show reference standards, performance characteristics and capacities; wiring and piping diagrams and controls; component parts; finishes; dimensions and required clearances.
- D. Modify manufacturer's standard schematic drawings and diagrams to supplement standard information and to provide information specifically applicable to the work. Delete information not applicable.
- E. Mark up a copy of the specifications for the product. Indicate in the margin of each paragraph the following: "Comply, "Do Not Comply", or "Not Applicable". Explain all "Do Not Comply" statements.
- F. Provide a separate transmittal for each submittal item. Transmittals shall indicate product by specification section name and number. Separate all submittals into appropriate specification section number. Do not combine specification sections.

1.5 MANUFACTURERS INSTRUCTIONS

- A. Submit Manufacturer's instructions for storage, preparation, assembly, installation, start-up, adjusting, calibrating, balancing and finishing.

1.6 CONTRACTOR RESPONSIBILITIES

- A. Review submittals prior to transmittal.
- B. Determine and verify:
 - 1. Field measurements.
 - 2. Field construction criteria.
 - 3. Manufacturer's catalog numbers.
 - 4. Conformance with requirements of Contract Documents.
- C. Coordinate submittals with requirements of the work and of the Contract Documents.
- D. Notify the Architect/Engineer in writing at time of submission of any deviations in the submittals from requirements of the Contract Documents.
- E. Do not fabricate products, or begin work for which submittals are specified, until such submittals have been produced and bear contractor's stamp. Do not fabricate products or begin work scheduled to have submittals reviewed until return of reviewed submittals with Architect/Engineer's acceptance.

- F. Contractor's responsibility for errors and omissions in submittals is not relieved whether Architect/Engineer reviews submittals or not.
- G. Contractor's responsibility for deviations in submittals from requirements of Contract Documents is not relieved whether Architect/Engineer reviews submittals or not, unless Architect/engineer gives written acceptance of the specific deviations on reviewed documents.
- H. Submittals shall show sufficient data to indicate complete compliance with Contract Documents:
 - 1. Proper sizes and capacities.
 - 2. That the item will fit in the available space in a manner that will allow proper service.
 - 3. Construction methods, materials and finishes.
- I. Schedule submissions at least 15 days before date reviewed submittals will be needed.

1.7 SUBMISSION REQUIREMENTS

- A. Make submittals promptly in accordance with approved schedule, and in such sequence as to cause no delay in the Project or in the work of any other Contractor.
- B. Number of submittals required:
 - 1. Shop Drawings and Coordination Drawings: Submit one reproducible transparency and three opaque reproductions.
 - 2. Product Data: Submit the number of copies which the contractor requires, plus those which will be retained by the Architect/Engineer.
- C. Accompany submittals with transmittal letter, in duplicate, containing:
 - 1. Date.
 - 2. Project title and number.
 - 3. Contractor's name and address.
 - 4. The number of each Shop Drawing, Project Datum and Sample submitted.
 - 5. Other pertinent data.
- D. Submittals shall include:
 - 1. The date of submission
 - 2. The project title and number
 - 3. Contract Identification
 - 4. The names of:
 - a. Contractor.
 - b. Subcontractor.
 - c. Supplier.
 - d. Manufacturer.
 - 5. Identification of the product.
 - 6. Field dimensions, clearly identified as such.
 - 7. Relation to adjacent or critical features of the work or materials.
 - 8. Applicable standards, such as ASTM or federal specifications numbers.
 - 9. Identification of deviations from contract documents.
 - 10. Suitable blank space for General Contractor and Architect/Engineer stamps.
 - 11. Contractor's signed and dated Stamp of Approval.
- E. Coordinate submittals into logical groupings to facilitate interrelation of the several items:
 - 1. Finishes which involve Architect/Engineer selection of colors, textures or patterns.
 - 2. Associated items which require correlation for efficient function or for installation.

1.8 SUBMITTAL SPECIFICATION INFORMATION

- A. Every submittal document shall bear the following information as used in the project manual:
 - 1. The related specification section number.
 - 2. The exact specification section title.
- B. Submittals delivered to the Architect/Engineer without the specified information will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been delivered.

1.9 RESUBMISSION REQUIREMENTS

- A. Make re-submittals under procedures specified for initial submittals.
 - 1. Indicate that the document or sample is a re-submittal.
 - 2. Identify changes made since previous submittals.
- B. Indicate any changes which have been made, other than those requested by the Architect / Engineer.

1.10 CONTRACTOR'S STAMP OF APPROVAL

- A. Contractor shall stamp and sign each document certifying to the review of products, field measurements and field construction criteria, and coordination of the information within the submittal with requirements of the work and of Contract Documents.
- B. Contractor's stamp of approval on any submittal shall constitute a representation to Owner and Architect/Engineer that Contractor has either determined and verified all quantities, dimensions, field construction criteria, materials, catalog numbers, and similar data or assumes full responsibility for doing so, and that Contractor has reviewed or coordinated each submittal with the requirements of the work and the Contract Documents.
- C. Do not deliver any submittals to the Architect/Engineer that do not bear the Contractor's stamp of approval and signature.
- D. Submittals delivered to the Architect/Engineer without Contractor's stamp of approval and signature will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been delivered.

1.11 ARCHITECT/ENGINEER REVIEW OF IDENTIFIED SUBMITTALS

- A. The Architect/Engineer will:
 - 1. Review identified submittals with reasonable promptness and in accordance with schedule.
 - 2. Affix stamp and initials or signature, and indicate requirements for re-submittal or approval of submittal.
 - 3. Return submittals to Contractor for distribution or for resubmission.
- B. Review and approval of submittals will not extend to design data reflected in submittals which is peculiarly within the special expertise of the Contractor or any party dealing directly with the Contractor.
- C. Architect/Engineer's review and approval is only for conformance with the design concept of the project and for compliance with the information given in the contract.
 - 1. The review shall not extend to means, methods, sequences, techniques or procedures of construction or to safety precautions or programs incident thereto.

2. The review shall not extend to review of quantities, dimensions, weights or gauges, fabrication processes or coordination with the work of other trades.
- D. The review and approval of a separate item as such will not indicate approval of the assembly in which the item functions.

1.12 SUBSTITUTIONS

- A. Do not make requests for substitution employing the procedures of this Section.
- B. The procedure for making a formal request for substitution is specified in Div. 1.

PART 2 - PRODUCTS - NOT USED.

PART 3 - EXECUTION - NOT USED

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 22 05 14

PLUMBING ALTERATIONS PROJECT PROCEDURES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Inspect and service existing equipment and materials that are to remain or to be reused.
- B. Disposal of equipment, materials, or housekeeping pads to be abandoned. Prior to disposal, the Contractor shall verify with the Owner what is to be salvaged by the Owner and what is to become the property of the Contractor.
- C. Handling of equipment and materials to be removed.

1.2 QUALITY ASSURANCE

- A. Coordination with the Owner prior to the disconnection or shutdown of existing equipment, or to the modification of existing operational systems.

1.3 CONTRACT DRAWINGS

- A. There is the possibility that existing conditions and devices are affected by the work indicated on the drawings and called for in the specifications (project manual) that do not appear on the drawings. It is the Contractor's responsibility to visit the site and determine all of the existing conditions and to consider these existing conditions when making and presenting a proposal, to have a complete proposal.

PART 2 - PRODUCTS

2.1 MATERIALS AND EQUIPMENT

- A. Material used to upgrade and repair existing equipment shall conform to that specified.
- B. Material used to upgrade and repair existing equipment shall not void existing warranties or listings of the equipment to be upgraded or repaired.
- C. Material used to upgrade and repair existing equipment shall be new and shall be of the same manufacturer of the existing equipment, shall be acquired through the existing original equipment manufacturer's approved distribution channels, shall have manufacturer's warranties for the new material being used, and shall be listed for the use intended.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Existing materials and equipment indicated on the drawings or in the specifications to be reused shall be inspected for damaged or missing parts. Contractor shall notify the Architect/Engineer, in writing, accordingly.
- B. If using materials specified or shown on the drawing voids or diminishes the warranty or operation of remaining equipment or systems, the Contractor shall notify the Architect/Engineer, in writing.

- C. Verify field measurements, above and underground piping connections and flows.
- D. Demolition Drawings are based on casual field observation, and when available, existing record documents. Report discrepancies to Architect before disturbing existing installation, and immediately after such discrepancies are discovered.
- E. Field verify existing conditions and actual utility uses prior to final connections. Existing drawings may not have been available for all required information. Use pipe inspection camera system to field verify existing sanitary / grease waste connections. Verify flow direction and depth prior to connection to existing plumbing systems.

3.2 APPLICATION

- A. Existing materials and equipment indicated on the drawings or in the specifications to be reused shall be cleaned and reconditioned, including cleaning of piping systems prior to installation and reuse.
- B. Material and equipment removed that is not to be salvaged for Owner's use or for reuse on the project shall become the property of the Contractor and be removed from the site.
- C. Material or equipment salvaged for Owner's use shall be carefully handled and stored where directed by the Owner or the Architect / Engineer. Relocate material and / or equipment as directed by Owner.
- D. Materials and equipment not indicated to be removed or abandoned shall be reconnected to the new system.
- E. Materials, equipment and housekeeping pads not to be reused or reconnected shall be removed for Owner's review and salvaged by Contractor.
- F. Prior to start of construction, Contractor shall walk areas to be renovated with Owner to identify and document items to be salvaged for Owner's use.
- G. Clean and repair existing materials and equipment that remain or are to be reused.
- H. Contractor shall utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.

3.3 SEQUENCE AND SCHEDULE

- A. Coordinate utility service outages with Utility Company, Architect and Owner.
- B. Provide additional or temporary valves, piping and connections to maintain existing systems in service during construction.
- C. Existing Plumbing Service: Refer to drawings for work in remodeled areas. Where facilities in these areas are to remain in service, any related work to keep the facilities in operation is specified in this Division. Maintain existing system in service until new system is complete and ready for service. Disable system only to make switchovers and connections. Obtain permission from Owner at least 48 hours before partially or completely disabling system. Minimize outage duration. Make temporary connections to maintain service in areas adjacent to work area. Maintain acceptable temperature and humidity control within existing building during renovation activities.
- D. Remove and replace existing Plumbing systems and appurtenances as occasioned by new or remodeled construction. Re-establish service that may be interrupted by

remodeled construction.

- E. Refer to other drawings series for work in remodeled areas. Where facilities in these areas are required to remain in service, any related work required to keep these facilities in operation is specified in this Division.
- F. Remove and replace existing piping coincident with the construction.
- G. Remove or relocate existing piping or housekeeping pads as occasioned by new or remodeled construction. Cap unused domestic piping beyond the new finish line.
- H. Relocate all domestic piping as required to accommodate new work requiring precedence.
- I. Remove concrete housekeeping pad where materials or equipment have been removed.
- J. Remove all known utilities that do not provide service to the buildings that remain.
- K. Remove existing plumbing vent penetrations through roof not to be reused.

3.4 DEMOLITION AND EXTENSION OF EXISTING PLUMBING WORK

- A. The Contractor shall modify, remove, and/or relocate all materials and items so indicated on the drawings or required by the installation of new facilities. All removals and/or dismantling shall be conducted in a manner as to produce maximum salvage. Salvage materials shall remain the property of the Owner, and shall be delivered to such destination as directed by the Owner's representative unless they are not wanted, then it will be the responsibility of this Contractor to remove such items and properly dispose of them. Materials and/or items scheduled for relocation and which are damaged during dismantling or reassembly operations shall be repaired and restored to good operative condition. The Contractor may, at his discretion, and upon approval of the Owner's representative substitute new materials and/or items of like design and quality in lieu of materials and/or items to be relocated.
- B. All items to be relocated shall be carefully removed in reverse to original assembly or placement and protected until relocated. The Contractor shall clean, repair, and provide all new materials, fittings, and appurtenances required to complete the relocations and to restore them to good operative order. All relocations shall be performed by workmen skilled in the work and in accordance with standard practice of the trades involved.
- C. When items scheduled for relocation and/or reuse are found to be in damaged condition before work has been started on dismantling, the Contractor shall call the attention of the Owner's representative to such items and receive further instructions before removal. Items damaged in repositioning operations are the contractor's responsibility and shall be repaired or replaced by the contractor as approved by the owner's representative, at no additional cost to the Owner.
- D. Plumbing, piping and appurtenances to be removed, salvaged, or relocated shall be removed to points indicated on the drawings, specified, or acceptable to the Owner's representative. Piping not scheduled for reuse shall be removed to the points at which reuse is to be continued or service is to remain. Such services shall be sealed, capped, or otherwise tied-off or disconnected in a safe manner acceptable to the Construction Inspector. All disconnections or connections into the existing facilities shall be done in such a manner as to result in minimum interruption of services to adjacent occupied areas. Services to existing areas or facilities that must remain in operation during the

construction period shall not be interrupted without prior specific approval of the Owner's representative hereinbefore specified.

- E. Repair adjacent construction and finishes damaged during demolition and extension work.
- F. Maintain access to mechanical installations that remain active. Modify installation or provide access panel as appropriate.
- G. Extend existing installations using materials and methods compatible with existing plumbing installations, or as specified.
- H. Existing plumbing piping and devices found to need additional hangers installed should be added at no additional cost to the Owner.

3.5 PROTECTION OF THE WORK

- A. Provide adequate temporary support and auxiliary structure as necessary to ensure structural value or integrity of affected portion of work.
- B. Provide devices and methods to protect other portions of work from damage.
- C. Execute fitting and adjustment of products to provide a finished installation to comply with specified products, functions, tolerances and finishes.

3.6 IDENTIFICATION OF EQUIPMENT IN RENOVATED AREAS

- A. Identification of Equipment: Provide new identification of all existing equipment to be reused and located within the renovated areas. Do not include the description "existing". Provide new nameplates for all existing plumbing equipment in renovated areas as specified in Section 22 05 00 Plumbing General Provisions.

END OF SECTION

SECTION 22 05 23

VALVES

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Plumbing Valves

PART 2 - PRODUCTS

2.1 VALVES

- A. Pressure Ratings:
 - 1. Unless otherwise indicated, use valves suitable for 125 minimum psig working steam pressure (WSP) and 450 deg. F.
 - 2. The pressure temperature rating of valves shall be not less than the design criteria applicable to components of the system.
- B. Ball Valves
 - 1. Provide ball valves with:
 - a. Blowout proof stem.
 - b. Full size port, 316 stainless steel ball and stem.
 - c. Cast bronze body.
 - d. Threaded ends.
 - 2. Seat, seals, thrust washers and packing shall be suitable for the intended service.
 - 3. Service rating:
 - a. 150 psi saturated steam.
 - b. 600 psi WOG.
 - 4. Provide with memory stop for balancing valves.
 - 5. Where Viega ProPress fittings are used, Viega ProPress ball valves may be used.
 - 6. All valves for domestic use must be lead free.
- C. Valve Connections
 - 1. Provide valves suitable to connect to adjoining piping as specified for pipe joints. Use pipe size valves. Sweated joints are not allowed.
 - 2. Thread pipe sizes 2 inches and smaller.
 - 3. Flange pipe sizes 2-1/2 inches and larger.
 - 4. Use screw to solder adapters for copper tubing.
 - 5. Use grooved body valves with mechanical grooved jointed piping.
 - 6. Use press valves when using copper press systems.
- D. Provide valves of same manufacturer throughout where possible.
- E. Provide valves with manufacturer's name and manufacturing location, duty and pressure rating clearly marked on outside of body.
- F. Where valves are installed in insulated piping, provide with extended neck so valve operator and stop plate clears the full thickness insulation.
- G. Provide valve, seat and trim materials suitable for the intended service.

2.2 VALVE SCHEDULE

- A. Domestic Service
 - 1. Gas shut-off service: UL approved for natural gas service.
 - a. Nibco Ball Valve, full port through 1 inch: T-585-70-UL.
 - b. Nibco Ball Valve conventional port 1-1/4 inch through 3 inch: T-580-70-UL.
 - c. Resun 2-1/2 inch and larger: 143 - 1-UL.
 - d. DeZurick 2-1/2 inch and larger: Series 425 or 435.
 - e. Conbraco Ball Valve, full port through 4 inch: 64-100 Series.
 - f. Milwaukee Full Port 1/4 inch-2 inch.
 - g. Milwaukee Standard Port 2-1/2 inch & 3 inch.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install valves with stems upright or horizontal, not inverted.
- B. Install valves for shut-off and isolating service at each piece of equipment, at vertical risers, and where shown on the drawings.
- C. Provide drain valves at main shut-off valves and low points of piping and apparatus so the systems can be entirely drained.
 - 1. 1 inch valve for pipes 6 inch and larger.
 - 2. 3/4 inch valve for pipes smaller than 6 inch.
 - 3. Terminate with pipe plug.
 - 4. Drain valves shall be ball valves.
- D. Where valves are installed in insulated pipe, valve operator shall have an insert so the lever or handle will not damage the insulation. Install handles so the lever or handles will not damage the insulation.
- E. Provide clearance for installation of insulation and access to valves.
- F. Provide access where valves are not exposed.

3.2 VALVE TAGS

- A. Furnish valves with 1-1/2 inch diameter brass valve tags with stamped, black or red-filled numbers. Service designations shall be 1/4 inch letters, and valve numbers shall be 2 inch letters. Engineer shall approve Service designations. Secure tags to valves by use of brass "S" hooks or brass chain. Secure chain to valve by use of copper or Monel meter seals. Valve tags are not required if the valve is located within 3 feet of the equipment being served and the service is obvious.
- B. Provide drawings listing functions of each valve and its location. Place charts and drawings as directed; in addition, on the record drawings mark the symbols and furnish a valve schedule properly identifying the valve number, service, exact location, the material being piped, and the room number of area that the valve services. Provide a copy of the valve chart in the Operating and Maintenance Manuals.

END OF SECTION

SECTION 22 07 19

PLUMBING PIPING INSULATION

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install piping insulation, jackets, accessories and covering of specified materials. The insulation shall be used for high and low temperature piping applications including domestic hot and cold water, roof and overflow drain sump bodies and rain leaders, horizontal sanitary drain piping which receives condensate, make-up water and pool heating water.

1.2 QUALITY ASSURANCE

- A. The intent of insulation specifications is to obtain superior quality workmanship resulting in an installation that is absolutely satisfactory in both function and appearance. Provide insulation in accordance with the specifications for each type of service and apply as recommended by the manufacturer and as specified.
- B. An approved contractor for this work under this Division shall be:
 - 1. A specialist in this field and have the personnel, experience, training, skill, and the organization to provide a practical working system.
 - 2. Able to furnish evidence of having contracted for and installed not less than 3 systems of comparable size and type that have served their owners satisfactorily for not less than 3 years.
- C. All piping insulation used on the project inside the building must have a flame spread rating not exceeding 25 and a smoke developed rating not exceeding 50, as determined by test procedures ASTM E 84, NFPA 255 and UL 723. These ratings must be as tested on the composite of insulation, jacket or facing, and adhesive. Components such as adhesives, mastics and cements must meet the same individual ratings as the minimum requirements and bear the UL label.
- D. Condensation on any insulated piping system is not acceptable.
- E. Replace insulation damaged by either moisture or other means. Insulation that has been wet, whether dried or not, is considered damaged. Make repairs where condensation is caused by improper installation of insulation. Also repair any damage caused by the condensation.
- F. Where existing insulated piping, or other surfaces are tapped, remove existing insulation back to undamaged sections for hot surfaces or to nearest insulation stop for cold surfaces, and replace with new insulation of the same type and thickness as existing insulation. Apply as specified for insulation of the same service.

1.3 APPROVALS

- A. Submit product data on each insulation type, adhesive, and finish to be used in the work. Make the submittal as specified in Division 1 General Requirements and obtain approval before beginning installation. Include product description, list of materials and thickness for each service and location and the manufacturer's installation instructions for each product.
- B. Make a field application of each type of insulation to display the material, quality and application method. Obtain approval of the sample application before proceeding with installation of the work.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Glass fiber pipe insulation:
 - 1. Johns-Manville Micro-Lok AP-T.
 - 2. Owens-Corning ASJ/SSL.
 - 3. Knauf ASJ/SSL.
- B. Cellular Glass Insulation (Foamglass):
 - 1. Pittsburg Corning.
 - 2. Cell-U-Foam.
- C. Fiberglass reinforcing cloth mesh:
 - 1. Perma Glass Mesh.
 - 2. Alpha Glass Mesh.
 - 3. Childers Chil-Glas.
 - 4. Vimasco.
- D. Mastics and Adhesives
 - 1. Childers.
 - 2. Foster.
 - 3. Vimasco.
 - 4. Armstrong 520 Adhesive.
- E. Elastomeric Insulation
 - 1. Armacell.

2.2 FIBERGLASS PIPE INSULATION

- A. Heavy density, dual temperature fiberglass insulation with factory applied, all service, reinforced vapor barrier jacket having integral laminated vapor barrier. Provide with a factory applied pressure sensitive tape closure system and matching butt strips. Supply in thickness as shown.
 - 1. Thermal conductivity 0.23 @ 75°F mean (ASTM 335).

2.3 ELASTOMERIC INSULATION

- A. Insulation material shall be flexible, closed-cell elastomeric insulation in tubular or sheet form. Material shall have a flame spread rating of 25 or less and a smoke developed rating of 50 or less when tested in accordance with ASTM E84, latest revision. Sheet material with a thickness greater than $\frac{3}{4}$ " shall have a flame spread rating of 25 or less and a smoke developed rating of 100 or less when tested in accordance with ASTM E84, latest revision. In addition, the product, when tested, shall not melt or drip flaming particles, and the flame shall not be progressive. In addition, all materials shall pass simulated end-use fire test. Minimum $\frac{3}{4}$ " thick.
 - 1. Thermal conductivity 0.27 at 75°F mean (ASTM C177 or C518).

2.4 CELLULAR GLASS INSULATION

- A. ASTM C552:
 - 1. "k" value of 0.35 @ 75°F ("ksi" value of 0.047 @ 24°C).
 - 2. 8.0 lb./cu.ft. (128 kg/cu.m.) density.

2.5 INSULATION/SHIELD AT HANGERS

- A. Field fabricated: Use 360° sections of rigid foamglass insulation that will support the bearing area at hangers and supports. Further support insulation at hangers and supports with a shield of galvanized metal covering at least half of the pipe circumference, and conforming to the schedule. Insulation shall extend at least 1" beyond metal shield on each end. When pipe is guided at top and bottom, metal shields shall cover the whole pipe circumference. Adhere metal shield to insulation so that metal will not slide with respect to insulation with ½" aluminum bands (2) per shield.
 - 1. Sections of foam glass insulation may be used of the same outside diameter of the adjoining pipe insulation.
 - 2. Minimum thickness of foam glass insulation shall not be less than 1" thick.
- B. Pipe saddles: Formed galvanized sheets at each support point for insulated pipe, shaped to fit pipe, and covering bottom half of pipe. Length at saddle shall be not less than twice the insulation outside diameter or more than 22". Provide 18 gauge through 4" pipe and 16-gauge 5" pipe and above.

2.6 SEALANT, ADHESIVE AND FINISH

- A. Lap Adhesive. Provide Childers CP-82 adhesive.
- B. Vapor Barrier Finish:
 - 1. Indoors: Provide as insulation coating Childers CP-35, white.
 - 2. Outdoors: Provide as insulation coating Childers Encacel X.
 - 3. Underground: Provide Childers CP-22/24 for fittings and areas. Pittwrap cannot be used.
- C. Sealant. Provide Childers CP-76 vapor barrier sealant.
- D. Lagging Adhesive. Provide Childers CP-50.
- E. Other products of equal quality will be acceptable only upon approval.

PART 3 - EXECUTION

3.1 INTERIOR PIPING

- A. Cover all piping with glass fiber, heavy density, dual temperature pipe insulation with a vapor barrier jacket. Apply insulation to clean, dry pipes. Longitudinal seams shall be joined firmly together and sealed with self-sealing lap joints. Butt insulation joints firmly together and seal with a 3" wide ASJ butt strip seal. Longitudinal seams and butt strip laps shall be coated and sealed with CP-35 vapor barrier coating for chilled water piping applications.
- B. Install hanger with protective shield, on the outside of all insulation.
- C. Where water pipes (1/2" & ¾" pipe sizes) are installed on trapeze type hangers, provide galvanized sheet metal protection shields at these locations. Place insulation jacket directly on hanger. Incompressible, load bearing insulation segments are not required.
- D. Pipe Saddles: Formed galvanized sheets at each support point for insulated pipe, shaped to fit pipe, and covering bottom half of pipe. Length at saddle shall be not less than twice the insulation outside diameter. Provide 18-gauge through 4" pipe and 16-gauge for 5" pipe and above.

- E. Piping to be insulated as specified above:
 1. Horizontal sanitary drain piping that receives condensate.

3.2 FLANGE, VALVE AND FITTING INSULATION

- A. Cover valves and flanges with fabricated segments, fittings with two-piece factory molded fittings, and both of matching pipe insulation type and thickness equal to that of the adjoining pipe. Fittings and fabricated segments shall be securely held in place.
 1. Apply a tack coat of insulating mastic to the insulated fitting to produce a smooth surface.
 2. After mastic is dry, apply a second coat of vapor barrier mastic. Neatly embed with 10 x 10 fiberglass cloth into the tack coat.
 3. Overlap mastic and fiberglass cloth by 2" on adjoining sections of pipe insulation.
 4. Apply a second coat of mastic over the fiberglass cloth to present a smooth surface.
 5. Apply mastic to a wet film thickness of 3/64".
 6. Fabric shall not be visible after completion.
 7. Vapor seal flanges, valves and fittings with Childers CP-35.

3.3 MISCELLANEOUS

- A. Install materials after piping has been tested and approved.
- B. Apply insulation on clean, dry surfaces only.

3.4 INSULATION THICKNESS

<u>INSULATED UNIT</u>	<u>THICKNESS</u> <u>(Inches)</u>
Horizontal Sanitary Drain Piping Which Receives Condensate	1

END OF SECTION

SECTION 22 13 16

SOIL, WASTE AND SANITARY DRAIN PIPING, VENT PIPING AND APPURTENANCES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install piping in buildings.

1.2 RELATED WORK

- A. Division 22 Plumbing:
 - 1. Pipe and Pipe Fittings.

1.3 REFERENCES

- A. ASTM - American Society for Testing and Materials

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Waste Pipe and Fittings:
 - 1. Charlotte Pipe and Foundry Co.
 - 2. Mueller Streamline Co.

2.2 DRAIN PIPE AND FITTINGS

- A. Above Slab Piping:
 - 1. Schedule 40 PVC plastic pipe and DWV fittings with solvent welded joints.
 - 2. Pipe and fittings shall conform to ASTM D 1784-82.
- B. Above Slab Piping:
 - 1. Copper Tube ASTM B 306, DWV with solder joints.
 - 2. Fittings, ASME B16.29, wrought copper, or ASME B16.32, solvent.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. All above slab soil, waste, sanitary drain and vent piping installation methods shall be in accordance with Cast Iron Soil Pipe Institute Standards.
- B. Above ground installation in the horizontal position shall be supported at every hub (hub & spigot or hubless type). Hangers are to be placed within 12" of hub or coupling.
- C. All above slab PVC sanitary waste and vent piping installation methods shall be in accordance with IAPMO Installation Standard 18-9 for Schedule 40 PVC-DWV, per manufacturer's recommendations and applicable standards.

3.2 GRADE

- A. Give horizontal pipe grade of ¼-inch per foot where possible, but not less than 1/8 inch per foot unless otherwise shown.

3.3 DRAIN PIPE AND FITTINGS

- A. Offsets and Fittings.
 - 1. Use reduction fittings to connect two pipes of different diameter.
 - 2. Change directions by appropriate use of 45-degree wyes, long-sweep quarter-bends, and sixth-, eights-, and sixteenth-bends. Sanitary tees can be used on vertical stacks. Use long sweeps at the base of risers.
 - 3. Provide a separate trap at each fixture, unless a trap is built into the fixture. Provide a deep seal trap at each floor drain and hub drain. Place traps so that the discharge from any fixture will pass through only one trap before reaching a building drain.
 - 4. Refer to Sanitary Drainage Code section for acceptable fittings to be used for changes in direction of drainage flow. Double combo sanitary fittings or double wye and 1/8th bend fittings are not allowed for horizontal to horizontal piping systems per Code.
- B. Cleanouts. Install cleanouts the same size as the soil waste lines in which the cleanouts are placed; however, no cleanout should be larger than 4 inches in diameter.
 - 1. Where cleanouts occur in pipe chases, bring the cleanouts through the walls and install covers. Where cleanouts occur in floor slabs, set flush. Reference drawing schedule.
 - 2. Provide cleanouts where soil lines change direction, every 50 foot on long runs, or as shown on the drawings, at the end of each horizontal waste line, and at the base of each riser (and at each increase in pipe size).

3.4 TESTING

- A. Below Slab on Grade and All Floors in Multi-Story Buildings:
 - 1. Maintain not less than 10 foot of hydrostatic head for 1 hour without a leak.
 - 3. Before acceptance of the work the contractor must ensure the piping is in working order before and after the slab is poured. To ensure this the contractor must test completed systems in the presence of the Architect, Engineer and authorities having jurisdiction after installation is complete.
 - 4. Test drainage piping systems in accordance with governing codes and the requirements specified. Provide equipment and materials and make test connections required to execute tests.
 - 6. Test drainage and waste piping hydraulically by filling system to its highest point or, whichever is greater, at a static head of 10 feet. Leaks at any joint shall be sufficient cause for rejection.
 - 7. Air tests may be substituted for hydraulic tests by forcing air into the closed system at a uniform pressure sufficient to balance a column of 10 inch hg in height.
 - 8. Under any of the previously described tests, the water height shall remain constant, after stabilization, for not less than 15 minutes without any further addition of water.
- B. System Test. After the various sections of soil, waste and vent piping are installed, but before fixtures are connected, test the system by:
 - 1. Plugging outlets.
 - 2. Test for 6 hours without any drop in the water level.

END OF SECTION

SECTION 22 20 00

PLUMBING PIPE AND PIPE FITTINGS - GENERAL

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install pipe and pipe fittings for piping systems specified in Division 22 - Plumbing.

1.2 RELATED WORK

- A. Division 22 Plumbing
 1. Valves.
 3. Insulation.
 4. Other Piping Sections.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS

- A. The particular type of pipe and fittings for each system is specified in the individual sections.

2.2 JOINTS

- A. Make screwed joints using machine cut USASI taper pipe threads. Apply a suitable joint compound to the male threads only. Ream the pipe to full inside diameter after cutting. All-thread nipples are not permitted.
- B. Dissimilar Metals. Make joints between copper and steel pipe and equipment using insulating unions or couplings such as Crane Company #1259; EPCO as manufactured by EPCO Sales, Inc.; or an approved equal.
- C. Solder joints.
 1. Prior to making joints, cut pipe square and ream to full inside diameter. Clean exterior of pipe and socket. Apply a thin coat of suitable fluxing compound to both pipe and socket, and fit parts together immediately.
 2. Heat assembled joint only as required to cause the solder to flow. Run the joint full, slightly beaded on the outside, and wipe to remove excess solder.
 3. Use silver brazing alloy or Sil-Fos on underground water entry piping. Use lead free solder on all other copper piping.
- D. Make welded joints as recommended by the standards of the American Welding Society. Ensure complete penetration of deposited metal with base metal. Provide filler metal suitable for use with base metal. Keep inside of fittings free from globules of weld metal. The use of mitered joints is not approved.
- E. Flanged.
 1. Prior to installation of bolts, center and align flanged joints to prevent mechanical pre-stressing of flanges, pipe or equipment. Align bolt holes to straddle the vertical, horizontal or north-south centerline. Do not exceed 3/64" per foot inclination of the flange face from true alignment.
 2. Use flat-face companion flanges only with flat-faced fittings, valves or equipment. Otherwise, use raised-face flanges.

3. Install gaskets suitable for the intended service and factory cut to proper dimensions. Secure with manufacturers recommended gasket cement.
 4. Use ANSI nuts and bolts, galvanized or black to match flange material. Use ANSI 316 stainless steel nuts and bolts underground. Tighten bolts progressively to prevent unbalanced stress. Draw bolts tight to ensure proper seating of gaskets.
 5. Use carbon steel flanges conforming to ANSI B16.5 with pipe materials conforming to ASTM A 105 Grade II or ASTM A 108, Grade II, ASTM A 53, Grade B. Use slip-on type flanges on pipe only. Use welding neck type flanges on all fittings. Weld slip-on flanges inside and outside.
 6. Keep flange covers on equipment while fabricating piping. Remove when ready to install in system.
- F. Press fittings for copper pipe 1/2" to 4": Copper press fittings shall conform to the material and sizing requirements of ASTM B16.18 or ASME B16.22. O-rings for copper press fittings shall be EPDM. Pro-Press System manufactured by VIEGA. The system intended for use shall be approved by submittal. Systems from various manufacturers may vary in technology. The field personnel shall carry training credentials from the approved manufacturer for the project. Mixing of fittings from different manufacturers is strictly prohibited.
- G. Press fittings for steel pipe 1/2" to 2": Where accepted by local code for specific applications, Cold Press Mechanical Joint Fittings shall conform to material requirements of ASTM A420 or ASME B16.3 and performance criteria of ANSI/CSA LC4. Sealing system shall be EPDM or HNBR as appropriate for a defined application. MegaPress system manufactured by VIEGA or approved equal and include "Smart Connect" assurance that unpressed fittings will not hold pressure. The system intended for use shall be approved by submittal. Systems from various manufacturers may vary in technology. The field personnel shall carry training credentials from the approved manufacturer for the project. Mixing of fittings from different manufacturers is strictly prohibited.

2.3 UNIONS

- A. Use 150 lb. standard (300 lb. WOG) malleable iron, ground joint unions with bronze seat. Provide flanged joints on piping 2-1/2" and larger.
1. Where pipe materials of different types join, use a dielectric union. Union shall be threaded, solder or as required for its intended use.

2.4 BRANCH CONNECTIONS

- A. Pipe 2" and Smaller. For threaded piping, use straight size reducing tee. When branch is smaller than header, a nipple and reducing coupling or swagged nipple may be used.
- B. 2-1/2" through 36": For welding piping, when branch size is the same as header size, use welding tee. Use Weld-o-let when branch is smaller than header. For threaded branch connections, use 3000 lb. full coupling or Thread-o-let welded to header.

2.5 FLOORS AND CEILING PLATES

- A. Provide chrome-plated floor and ceiling plates around pipes exposed to view when passing through walls, floors, partitions, or ceilings in finished areas; size plates to fit pipe or insulation and lock in place.

2.6 DOMESTIC MANUFACTURE

- A. All piping material, pipe and pipe fittings shall be manufactured in the United States of America unless specifically named in these specifications.

PART 3 - EXECUTION

3.1 PIPE FABRICATION AND INSTALLATION

- A. Make piping layout and installation in the most advantageous manner possible with respect to headroom, valve access, opening and equipment clearance, and clearance for other work. Give particular attention to piping in the vicinity of equipment. Preserve the required minimum access clearances to various equipment parts, as recommended by the equipment manufacturer, for maintenance.
- B. Cut all pipes to measurement determined at the site. After cutting pipe, remove burrs by reaming. Bevel plain ends of ferrous pipe.
- C. Install piping neatly, free from unnecessary traps and pockets. Work into place without springing or forcing. Use fittings to make changes in direction. Field bending and mitering is prohibited. Make connections to equipment using flanged joints, unions or couplings. Make reducing connections with reducing fittings only.
- D. Install piping without tapping out of the bottom of pipe.
- E. Press Connections: Copper and steel press fittings ½" through 4" shall be applied in accordance with the manufacturer's installation instructions. The tubing/pipe shall be fully inserted into the fitting and the tubing/pipe marked at the shoulder of the fitting. The fitting alignment shall be checked against the mark on the tubing/pipe to assure the tubing/pipe is fully engaged (inserted) in the fitting. The joints shall be pressed using the tool approved by the manufacturer. If soldering (thread adapters, etc.) near press fittings, take precautions to not damage the O-ring fittings. Maintain three pipe diameters or use a cooling agent. Viega-"Pro-Press".

3.2 WELD

- A. Weld and fabricate piping in accordance with ANSI Standard B31.1, latest edition, Code for Pressure Piping.
- B. Align piping and equipment so that no part is offset more than 1/16". Set fittings and joints square and true, and preserve alignment during welding operation. Use of alignment rods inside pipe is prohibited.
- C. Do not permit any weld to project within the pipe so as to restrict flows. Tack welds, if used, must be of the same material and made by the same procedure as the completed weld. Otherwise, remove tack welds during welding operation.
- D. Do not split, bend, flatten or otherwise damage piping before, during or after installation.
- E. Remove dirt, scale and other foreign matter from inside piping before tying into existing piping sections, fittings, valves or equipment.
- F. Bevel ends of ferrous pipe.

3.3 OFFSETS AND FITTINGS

- A. Due to the small scale of drawings, the indication of offsets and fittings is not possible. Investigate the structural and finish conditions affecting the work and take steps required to meet these conditions.
- B. Install pipe close to walls, ceilings and columns so pipe will occupy minimum space. Provide proper spacing for insulation coverings, removal of pipe, special clearances, and offsets and fittings.

3.4 SECURING AND SUPPORTING

- A. Support piping to maintain line and grade, with provision for expansion and contraction. Use approved clevis-type or trapeze-type hangers connected to structural members of the building. Single pipe runs to be supported by approved clevis type hangers. Multiple pipe runs to be supported by approved trapeze type hangers. Do not support piping from other piping or structural joist bridging.
- B. Provide supports both sides of elbows for pipe 6" and larger.
- C. Support vertical risers with steel strap pipe clamps of approved design and size, supported at each floor.
- D. Where insulation occurs, design hangers to protect insulation from damage. Pipe saddles and insulation shields, where required, are specified in the appropriate insulation section and are sized in accordance with the schedule on the drawings.
- E. Install trapeze hangers, properly sized, to support the intended load without distortion.
- F. Use electro-galvanized or zinc plated threaded rods, nuts, washers and hangers.
- G. At outdoor locations, all supports, brackets and structural members shall be hot-dipped galvanized.
- H. Support spacing: As recommended by the project structural engineer and support manufacturer, but not more than listed below. Not to exceed spacing requirements of smallest pipe.

Pipe Size	Copper & Steel Max. Support Spacing, Feet	Cast Iron Max. Support Spacing, Ft.	Plastic Piping Support Spacing Ft
1" & smaller	6		4
1-1/4" & 1-1/2"	8	5	4
2"	10	5	4
3"	10	5	4
4" & 5"	10	5	4
6" and above	10	5	4

3.5 PIPE SUPPORTS

- A. Provide P1001 or P 5000 Unistrut metal framing members and appurtenances for pipe support. Hot-dip galvanize members and appurtenances when located outside. Sagging of pipes or supports is not acceptable.
- B. Adjustable clevis hangers shall be used for single pipe supports; Anvil Fig. 260. When

oversized clevis is used, a nipple shall be placed over the clevis bolt as a spacer to assure that the lower U-strap will not move in on the bolt. Provide adjustable clevis with a nut / washer above and below the hanger on the support rod. Ring type clevis hangers are not acceptable.

- C. Provide Anvil Figure 45 galvanized or primed and painted channel assembly for trapeze hangers.

3.6 PIPE SUPPORTS ON ROOF

- A. Support gas pipe on roof with Portable Pipe Hanger Model PP-10 with roller and fully adjustable height throughout pipe run. Base material shall be high density / high impact polypropylene with UV inhibitors and anti-oxidants. Provide with hot dip galvanized rod finish and framing. Nuts and washers shall be hot dip galvanized.

3.7 ANCHORS

- A. Provide anchors as required. Use pipe anchors consisting of heavy steel collars with lugs and bolts for clamping to pipe and attaching anchor braces. Install anchor braces in the most effective manner to secure desired results. Do not install supports, anchors or similar devices where they will damage construction during installation or because of the weight or the expansion of the pipe. When possible, install sleeves in structural concrete prior to pouring of concrete.

3.8 PIPE SLEEVES

- A. Sleeves through masonry and concrete construction:
 - 1. Fabricate sleeves of Schedule 40 galvanized steel pipe.
 - 2. Size sleeve large enough to allow for movement due to expansion and to provide continuous insulation.
- B. Sleeves through gypsum wall construction.
 - 1. Fabricate sleeves of 16 gauge galvanized sheet metal.
- C. Extend each sleeve through the floor or wall. Cut the sleeve flush with each wall surface. Sleeves through floors shall extend 2" above floor lines for waterproofing purposes. Slab on grade floors shall not be sleeved except where penetrating waterproofing membrane or insect control is required.
- D. Caulk sleeves water and air tight. Seal annular space between pipes and sleeves with mastic compound to make the space water and air tight.
- E. Provide chrome plated escutcheon plates on pipes passing through walls, floors or ceilings exposed to view. At exterior walls, stainless steel sheet metal is to be used.
- F. For sleeves through fire and smoke rated walls, seal with a UL through-penetration firestop, rated to maintain the integrity of the time rated construction. Install in accordance with the manufacturer's installation instructions. Comply with UL and NFPA standards for the installation of firestops. Refer to Architectural drawings for all fire and smoke rated partitions, walls, floors, etc.

3.9 ISOLATION VALVES

- A. Provide piping systems with line size shutoff valves located at the risers, at main branch connections to mains for equipment, to isolate central plant, and at other locations.

3.10 DRAIN VALVES

- A. Install drain valves at low points of water piping systems so that these systems can be entirely drained. Install a line size drain valve for pipes smaller than 2" unless indicated otherwise. For pipes 2-1/2" and larger, provide 2" drain valves unless indicated otherwise. Drain valves shall be plugged when not in use and at completion.

3.11 CLEANING OF PIPING SYSTEMS

- A. General cleaning of piping systems. Purge pipe of construction debris and contamination before placing the systems in service. Provide and install temporary connections as required to clean, purge and circulate.
- B. Phase One: Initial flushing of system. Remove loose dirt, mill scale, weld beads, rust and other deleterious substances without damage to system components. Open valves, drains, vents and strainers at all system levels during flushing procedures. Flush until "potable water clear" and particles larger than 5 microns are removed.
- C. Connect dead-end supply and return headers, even if not shown on the drawings, and provide terminal drains in bottom of pipe end caps or blind flanges.
- D. Dispose of water in approved manner.
- E. Phase Two: Cleaning of Piping Systems. Remove, without chemical or mechanical damage to any system component, adherent dirt (organic soil), oil, grease, (hydrocarbons), soldering flux, mill varnish, piping compounds, rust (iron oxide) and other deleterious substances not removed by initial flushing. Flush system and replace with clean water.
- F. Phase Three: Final flushing and rinsing: Flush and rinse until "potable water clear" and particles larger than 5 microns are removed. Operate valves to dislodge any debris in valve body. Dispose of water in approved manner.
- G. Submit status reports upon completion of each phase of work on each system.

3.12 TESTING

- A. Test piping after installation with water hydrostatic pressure of 1-1/2 times operating pressure and carefully check for leaks. Repair leaks and retest system until proven watertight.
- B. Do not insulate or conceal piping systems until tests are satisfactorily complete.
- C. If any leaks or other defects are observed, suspend the test and correct the condition at once. Repeat testing until leaks are eliminated and the full test period is achieved.
- D. The satisfactory completion of testing does not relieve the Contractor of responsibility for ultimate proper and satisfactory operation of piping systems and their accessories.

3.13 PIPE MARKERS

- A. Identify interior exposed piping and piping in accessible chases or plenums with Opti-Code Brady Pressure Sensitive Adhesive Pipe Markers, consisting of pipe marker and direction of flow arrow tape. Clean pipe prior to installation. Background colors of markers, arrows and tape for each type of system shall be the same. Meet ANSI/OSHA standards and clearly identify each system. Provide minimum 2-1/4-inch letters through

4-inch pipe and 4-inch letters for 5-inch pipe and larger.

- B. Identify exterior and mechanical room piping with Snap Around pipe markers through 4-inch pipe and Strap Around markers 5-inch pipe and larger. Pipe markers consisting of pipe marker and direction of flow arrow tape; background colors of markers, arrows and type for each type of system shall be the same. Meet ANSI / OSHA standards and clearly identify each system. Provide minimum 2-1/4-inch letters through 4-inch pipe and 4-inch letters for 5-inch pipe and larger.
- C. Install identification in the following locations:
 - 1. Both sides of penetrations through walls, floors and ceilings.
 - 2. Close to valves or flanges.
 - 3. Intervals on straight pipe runs not to exceed 50 feet
 - 4. Apply marker where view is obstructed.
- D. Pipe markers shall meet or exceed the specifications of the ASME A13.1 "Scheme for Identification of Piping Systems".

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 22 63 11

GAS PIPING AND APPURTENANCES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install steel gas pipe inside buildings, including the supply line from existing gas line and lines to gas equipment, termination of the service line with a plug valve, drip leg, and final connection to equipment and appliances with unions.
- B. Coordinate removal of gas line to boiler.
- C. Extend steel gas piping from existing pipe on roof to new rooftop unit.

1.2 RELATED WORK

- A. Division 22 Plumbing
 - 1. Plumbing Pipe and Fittings.
 - 2. Valves and Vents.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS - ABOVE GRADE

- A. Pipe 2 inch and Smaller:
 - 1. Schedule 40 ASTM A 53 black steel pipe
 - 2. Factory fabricated socket weld fittings.
 - 3. Where approved for a specific project and where accepted by local code, cold press mechanical joint fittings shall conform to material requirements of ASTM A420 or ASME B16.3 and performance criteria of ANSI/CSA LC4. Sealing elements shall be HNBR and the fittings shall bear the CSA stamp to confirm acceptability for fuel gas systems. MegaPress system manufactured by VIEGA including "Smart Connect" to assure unpressed fittings will not hold pressure. Installers shall carry training credentials from the manufacturer to confirm they have been instructed in the correct installation procedures.
- B. Pipe Larger than 2 inch:
 - 1. Schedule 40 ASTM A 53 black steel pipe.
 - 2. Factory fabricated butt weld fittings for welded steel pipes shall conform to ASTM A-234 WPB (seamless weld fittings).
- C. Unions:
 - 1. Standard 150 lb. (300 lb. water, oil or gas) malleable iron.
 - 2. Ground joint unions, with bronze seat.
 - 3. Flange joints for pipe larger than 2 inch in diameter.
- D. Flanges:
 - 1. Steel flanges. ANSI B16.5 and ASTM A-105.

2.2 VALVES

- A. See Section 22 05 23.

2.3 GAS PRESSURE REGULATOR

- A. Size the gas pressure regulator in accordance with the manufacturer's recommendations for flow quantities and reduced pressure as required for all equipment. Coordinate final equipment gas pressure requirements prior to ordering regulators. Provide Maxitrol regulators or approved equal, suitable for outdoor installation. Regulators outside exposed to weather shall be installed with vent in vertical down position.
- B. All line pressure regulators shall be listed in accordance with ANSI (American National Standard) Z21.80 and CSA (Canadian Standards Association Standard) 6.22.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation Standards: Install gas piping in accordance with recommendations of the National Fire Protection Association.
- B. Drip Legs: Install a capped drip leg 6 inches long at the base of each vertical rise.
- C. Sleeves.
 - 1. Encase gas piping running in or through solid partitions with thin wall metal conduit. Sleeve piping and fittings shall be two pipe sizes, but not less than 1 inch larger than encased gas piping.
 - 2. Encase gas piping running below slab in Schedule 40 PVC, minimum size two pipe sizes larger than gas pipe. Vent sleeve to atmosphere with a 1-1/2 inch vent with 1-1/2 inch return bend above building roof. Seal ends of sleeve with UL fire rated caulk.
- D. Do not install gas piping exposed to view inside public area, or occupied spaces, without prior written approval.
- E. Provide test ports and isolation valves to enable proper testing of system in the future.
- F. Provide isolation valve and unions across regulators for proper removal.
- G. Gas Pressure Regulators / Vents:
 - 1. Piping shall be sized in accordance with the regulator manufacturer's instructions.
 - 2. Install vent piping from regulators to location to prevent gas smells from entering building or provide vent limiter.
 - 4. Install double elbows and insect screen at end of piping to prevent moisture and insects from entering.
 - 5. When installed inside building route vents horizontally and terminate through building sidewall. Vents terminating through roof must have prior approval from Architect before installation. Through roof penetrations shall be minimized.
 - 6. Regulators installed outside or on roof top: Install regulator vent turned downward with insect screen over vent opening. The vent shall be designed to prevent the entry of water, insects, or other foreign materials that could cause blockage.
 - 7. Adhere to all applicable codes and regulations.

3.2 TESTING GAS PIPING

- A. Preliminary gas test as required by Code, but minimum test pressure of 50 PSI held for not less than eight hours without noticeable drop.

- B. Test joints with a soap solution while lines are under pressure.
- C. Repair leaks.
- D. Final gas test shall be with a 24 inch column of mercury or a diaphragm gauge with a minimum dial size of 3-1/2 inches with a set hand and a pressure range not to exceed twenty (20) psig with 2/10-pound increments. The minimum test pressure shall not be less than ten (10) psi and the maximum test pressure shall not exceed twelve (12) psig. This test will be observed for no less than (30) thirty minutes with no drop in pressure.
- E. Provide copy of gas pressure test reports in Operations & Maintenance Manual.
- F. School renovations projects shall have all gas piping tested. Report and document gas leaks found to the Architect and Engineer. Repair leaks at no additional cost to the Owner.

3.3 PAINT EXPOSED OUTSIDE GAS PIPE

- A. Interior and Exterior Gas piping shall be protected from rust.
- B. Paint pipe with a flat alkyd coating, clean pipe prior to painting by preparing surface by hand tool cleaning per SSPC-SP2-82, applying one coat of Glidden Y-590 Rustmaster Metal Primer White and top coat of Yellow Alkyd Flat Enamel.
- C. Install pipe marker identification after gas piping has been painted.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 23 05 00

MECHANICAL GENERAL PROVISIONS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Except as modified in this Section, General Conditions, Supplementary Conditions, applicable provisions of the General Requirements, and other provisions and requirements of the contract documents apply to work of Division 23 Mechanical.
- B. Applicable provisions of this section apply to all sections of Division 23, Mechanical.

1.2 CODE REQUIREMENTS AND FEES

- A. Perform work in accordance with applicable statutes, ordinances, codes and regulations of governmental authorities having jurisdiction.
- B. Mechanical work shall comply with applicable inspection services:
 - 1. Underwriters Laboratories.
 - 2. National Fire Protection Association.
 - 3. State Health Department.
 - 4. Local Municipal Building Inspection Department.
 - 5. Texas Department of Licensing & Regulations (ADA).
- C. Resolve any code violations discovered in contract documents with the Engineer prior to award of the contract. After Contract award, any correction or additions necessary for compliance with applicable codes shall be made at no additional cost to the Owner.
- D. This Contractor shall be responsible for being aware of and complying with asbestos NESHAP regulations, as well as all other applicable codes, laws and regulations.
- E. Obtain all permits required.

1.3 CONTRACTOR'S QUALIFICATIONS

- A. An approved contractor for the work under this division shall be:
 - 1. A specialist in this field and have the personnel, experience, training, skill, and organization to provide a practical working system.
 - 2. Able to furnish evidence of having contracted for and installed not less than 3 systems of comparable size and type that has served their Owners satisfactorily for not less than 3 years.

1.4 REFERENCE SPECIFICATIONS AND STANDARDS

- A. Materials which are specified by reference to Federal Specifications; ASTM, ASME, ANSI, or AWWA Specifications; Federal Standards; or other standard specifications must comply with latest editions, revisions, amendments or supplements in effect on date bids are received. Requirements in reference specifications and standards are minimum for all equipment, material, and work. In instances where specified capacities, size, or other features of equipment, devices, or materials exceed these minimums, meet specified capacities.

1.5 CONTRACT DRAWINGS

- A. Contract drawings are diagrammatic only and do not give fully dimensioned locations of various elements of work. Determine exact locations from field measurements.

1.6 PROJECT RECORD DOCUMENTS

- A. Maintain at the job site a separate set of white prints (black line) of the contract drawings for the sole purpose of recording the "as-built" changes and diagrams of those portions of work in which actual construction is at variance with the contract drawings. Mark the drawings with a colored pencil. Prepare, as the work progresses and upon completion of work, reproducible drawings clearly indicating locations of various lines, valves, ductwork, traps, equipment, and other pertinent items, as installed. Include flow-line elevation of sewer lines. Record existing and new underground and under slab piping with dimensioned locations and elevations of such piping.
- B. At the conclusion of project, obtain without cost to the Owner, erasable mylars of the original drawings and transfer as-built changes to these. Prior to transmittal of corrected drawings, obtain 3 sets of blue-line prints of each drawing, regardless of whether corrections were necessary and include in the transmittal (2 sets are for the Owner's use and one set is for the Architect/Engineer's records). Delivery of these as-built prints and reproducible drawings is a condition of final acceptance. Provide record drawings on one set each (reproducible Dayrex mylar film positives) and AutoCad 2014 / Revit CAD files on disk (CD Rom).
- C. As-Built drawings should indicate the following information as a minimum:
 - 1. Indicate all addendum changes to documents.
 - 2. Remove Engineer's seal, name, address and logo from drawings.
 - 3. Mark documents RECORD DRAWINGS.
 - 4. Clearly indicate: DOCUMENT PRODUCED BY
 - 5. Indicate all changes to construction during construction. Indicate actual routing of all piping, ductwork, etc. that were deviated from construction drawings.
 - 6. Indicate exact location of all underground mechanical piping and elevation.
 - 7. Indicate exact location of all underground electrical raceways and elevations.
 - 8. Correct schedules to reflect (actual) equipment furnished and manufacturer.
 - 9. Location and size of all ductwork and mechanical piping above ceiling including exact location of isolation of domestic and mechanical valves.
 - 10. Exact location of all electrical equipment in and outside of the building.
 - 11. Exact location of all roof mounted equipment, wall, roof and floor penetrations.
 - 12. Cloud all changes.

1.7 SPACE REQUIREMENTS

- A. Consider space limitations imposed by contiguous work in selection and location of equipment and material. Do not provide equipment or material that is not suitable in this respect.

1.8 RELATION WITH OTHER TRADES

- A. Carefully study all matters and conditions concerning the project. Submit notification of conflict in ample time to prevent unwarranted changes in any work. Review other Divisions of these specifications to determine their requirements.
- B. Because of the complicated relationship of this work to the total project, conscientiously study the relation and cooperate as necessary to accomplish the full intent of the documents.

- C. Provide sleeves and inserts in forms as required for the work. Stub up and protect open ends of pipe before any concrete is placed. Furnish sizes of required equipment pads. Furnish and locate bolts and fittings required to be cast in them.
- D. Locate and size openings required for installation of work specified in this Division in sufficient time to prevent delay in the work.
- E. Refer to other Divisions of the specifications for the scope of required connections to equipment furnished under that Division. Determine from the Contractor for the various trades, the Owner, and by direction from the Architect/Engineer, the exact location of all items.

1.9 CONCEALED AND EXPOSED WORK

- A. When the word "concealed" is used in connection with insulating, painting, piping, ducts and the like, the work is understood to mean hidden from sight as in chases, furred spaces or above ceilings. "Exposed" is understood to mean open to view.

1.10 GUARANTEE

- A. Guarantee work for 1 year from the date of substantial completion of the project. During that period make good any faults or imperfections that may arise due to defects or omissions in material, equipment or workmanship. At the Owner's option, replacement of failed parts or equipment shall be provided.

1.11 MATERIAL AND EQUIPMENT

- A. Furnish new and unused materials and equipment meeting the requirements of the paragraph specifying acceptable manufacturers. Where two or more units of the same type or class of equipment are required, provide units of a single manufacturer.

1.12 NOISE AND VIBRATION

- A. Select equipment to operate with minimum noise and vibration. If objectionable noise or vibration is produced or transmitted to or through the building structure by equipment, piping, ducts or other parts of work, rectify such conditions at no additional cost. If the item of equipment is judged to produce objectionable noise or vibration, demonstrate at no additional cost that equipment performs within designated limits on a vibration chart.

1.13 ACCEPTABLE MANUFACTURERS

- A. Manufacturers names and catalog number specified under sections of Division 23 are used to establish standards of design, performance, quality and serviceability and not to limit competition. Equipment of similar design, equal to that specified, manufactured by a named manufacturer will be acceptable on approval. A request for prior approval of equipment not listed must be submitted ten (10) days before bid due date. Submit complete design and performance data to the Engineer.

1.14 OPERATING TESTS

- A. After all mechanical systems have been completed and put into operation, subject each system to an operating test under design conditions to ensure proper sequencing and operation throughout the range of operation. Tests shall be made in the presence of the Architect/Engineer. Make adjustments as required to ensure proper functioning of all systems. Special tests on individual systems are specified under individual sections.

Submit 3 copies of all certifications and test reports adequately in advance of completion of the work to allow for remedial action as required to correct deficiencies discovered in equipment and systems.

1.15 WARRANTIES

- A. Submit 3 copies of all warranties and guarantees for systems, equipment, devices and materials. These shall be included in the Operating and Maintenance Manuals.

1.16 BUILDING CONSTRUCTION

- A. It shall be the responsibility of each sub-contractor to consult the Architectural and Engineering drawings, details, and specifications and thoroughly familiarize himself with the project and all job related requirements. Each sub-contractor shall cooperate with the General Contractor to verify that all piping and other items are placed in the walls, furred spaces, chases, etc., so there will be no delays in the job.

PART 2 - PRODUCTS – NOT USED

PART 3 - EXECUTION

3.1 OPENINGS

- A. Framed, cast or masonry openings for ductwork, equipment or piping are specified under other divisions. Drawings and layout work for exact size and location of all openings are included under this division.

3.2 AIR FILTERS AND PIPE STRAINERS

- A. Immediately prior to substantial completion of the project, inspect, clean and service air filters and strainers. Replace air filters.

3.3 LUBRICATION, REFRIGERANT AND OIL

- A. Provide a complete charge of correct lubricant for each item of equipment requiring lubrication.
- B. Provide a complete and working charge of proper refrigerant, free of contaminants, into each refrigerant system. After each system has been in operation long enough to ensure completely balanced conditions, check the charge and modify for proper operation as required.
- C. Provide a complete charge of special oil for refrigeration use, suitable for operation with refrigerant, in each system.

3.4 HOUSEKEEPING PADS

- A. Provide equipment housekeeping pads under all floor mounted and ground mounted HVAC equipment, and as shown on the drawings.
- B. Concrete work as specified in Division 3.
- C. Concrete pads:
 - 1. 4" high, rounded edges, minimum 2500 psi unless otherwise indicated on the drawings.

2. Chamfer strips at edges and corner of forms.
3. Smooth steel trowel finish.
4. Doweled to existing slab.

D. Install concrete curbs around duct penetrations or multiple pipe penetrations.

3.5 INSTRUCTION OF OWNER'S PERSONNEL

- A. Prior to final inspection, conduct an on-site training program to instruct the Owner's operating personnel in the operation and maintenance of the mechanical systems.
 1. Provide the training during the Owner's regular working day.
 2. The Instructors shall each be experienced in their phase of operation and maintenance of building mechanical systems and with the project.
- B. Time to be allocated for instructions.
 1. Minimum of 4 hours dedicated instructor time.
- C. Before proceeding with the on-site training program, submit the program syllabus; proposed time and dates; and other pertinent information for review and approval.
 1. One copy to the Owner.
 2. One copy to the Architect/Engineer.
- D. The Owner will provide a list of personnel to receive instructions, and will coordinate their attendance at the agreed upon times.
- E. Use the operation and maintenance manuals as the basis of instruction. Review contents of manual with personnel in detail to explain all aspects of operation and maintenance.
- F. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shut down of each item of equipment.
- G. Demonstrate equipment functions (both individually and as part of the total integrated system).
- H. Prepare and insert additional data in the operating and maintenance manuals when the need for additional data becomes apparent during instructions.
- I. Submit a report within one week after completion of the training program that instructions have been satisfactorily completed. Give time and date of each demonstration and hours devoted to the demonstration, with a list of people present.
- J. At the conclusion of the on-site training program, have the person designated by the Owner sign a certificate to certify that he/she has a proper understanding of the system, that the demonstrations and instructions have been satisfactorily completed, and the scope and content of the operating and maintenance manuals used for the training program are satisfactory.
- K. Provide a copy of the report and the certificate in an appropriately tabbed section of each Operating and Maintenance Manual.

3.6 EQUIPMENT IDENTIFICATION

- A. Provide a laminated engraved plastic nameplate on each piece of equipment and starter.
 1. Designation approved by Architect/Engineer.

2. Equipment includes, but is not limited to, air handling units, fan coil units, variable volume boxes, fans, pumps, boilers and chillers.
 3. Submit schedule of equipment to be included and designations.
- B. Provide nameplates with 1/2" high letters and fastened with epoxy or screws.

3.7 OBSTRUCTIONS

- A. The drawings indicate certain information pertaining to surface and subsurface obstructions which has been taken from available drawings. Such information is not guaranteed, however, as to accuracy of location or complete information.
1. Before any cutting or trenching operations are begun, verify with Owner's representative, utility companies, municipalities, and other interested parties that all available information has been provided.
 2. Should obstruction be encountered, whether shown or not, alter routing of new work, reroute existing lines, remove obstruction where permitted, or otherwise perform whatever work is necessary to satisfy the purpose of the new work and leave existing services and structures in a satisfactory and serviceable condition.
- B. Assume total responsibility for and repair any damage to existing utilities or construction, whether or not such existing facilities are shown.

3.8 PROTECTION

- A. Protect work, equipment, fixtures, and materials. At work completion, work must be clean and in original manufacturer's condition.

3.9 INDOOR AIR QUALITY

- A. All equipment and ductwork shall be installed to allow sufficient space for testing, maintenance, and commissioning functions. Access doors or panels shall be installed in ventilation equipment, ductwork, and plenum enclosures for inspection and cleaning of outdoor air intakes, mixing plenums, up and downstream of coils, filters, drain pans and fans.
- B. Practice source control and eliminate potential contaminants in material selection, installation, and maintenance.
- C. Provide installation and disposal instructions for all materials and chemicals that are potential contaminants.
- D. Obtain and conform to the requirements of the Material Safety Data Sheets (MSDSs) in the use of materials.
- E. Utilize manufacturer's recommendations and provide installation instructions for all chemicals, compounds, and potential contaminants including pre-installation degassing if required.
- F. Ventilate completed building prior to final completion using no less than design outside air for at least 48 hours before occupancy.
- G. Make provisions for controls to prevent the entry of air contaminants into the HVAC air distribution system.
- H. Steps shall be taken to ensure that the HVAC system continues to function effectively and are not damaged or contaminated during construction activities.

END OF SECTION

SECTION 23 05 12

HVAC SHOP DRAWINGS, COORDINATION DRAWINGS & PRODUCT DATA

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Prepare submittals as required by these specifications as outlined below.
- B. The term submittal, as used herein, refers to all:
 - 1. Shop Drawings.
 - 2. Coordination Drawings.
 - 3. Product data.
- C. Submittals shall be prepared and produced for:
 - 1. Distribution as specified.
 - 2. Inclusion in the Operating and Maintenance Manual, as specified, in the related section.

1.2 SHOP DRAWINGS

- A. Present drawings in a clear and thorough manner. Identify details by reference to sheet and detail, schedule, or room numbers shown on Contract Drawings.
- B. Show all dimensions of each item of equipment on a single composite Shop Drawing. Do not submit a series of drawings of components.
- C. Identify field dimensions; show relationship to adjacent features, critical features, work, or products.
- D. Submit shop drawings in plan, elevation and sections, showing equipment in mechanical equipment areas.

1.3 COORDINATION DRAWINGS

- A. Present in a clear and thorough manner. Title each drawing with project name. Identify each element of drawings by reference to sheet number and detail, or room number of contract documents. Minimum drawing scale: $\frac{1}{4}'' = 1'-0''$.
- B. Prepare coordination drawings to coordinate installations for efficient use of available space, for proper sequence of installation, and to resolve conflicts. Coordinate with work specified in other sections and other divisions of the specifications.
- C. For each mechanical room and for each outside equipment pad where equipment is located, submit plan and elevation drawings. Show:
 - 1. Actual mechanical equipment and components to be furnished
 - 2. Service clearance
 - 3. Relationship to other equipment and components
 - 4. Roof drains and leader piping
 - 5. Fire protection piping and equipment
- D. Identify field dimensions. Show relation to adjacent or critical features of work or products.

- E. Related requirements:
 - 1. Ductwork shop drawings
 - 2. Coordination drawing specified in Division 26
- F. Submit shop drawings in plan, elevation and sections, showing equipment in mechanical equipment areas.
- G. Gas piping sketch indicating proposed location of piping prior to proceeding with the installation.

1.4 PRODUCT DATA AND INSTALLATION INSTRUCTION

- A. Submit only pages which are pertinent to the project. All options which are indicated on the product data shall become part of the contract and shall be required whether specified are not.
- B. Mark each copy of standard printed data to identify pertinent products, referenced to specification section and article number.
- C. Show reference standards, performance characteristics and capacities; wiring and piping diagrams and controls; component parts; finishes; dimensions and required clearances.
- D. Modify manufacturer's standard schematic drawings and diagrams to supplement standard information and to provide information specifically applicable to the work. Delete information not applicable.
- E. Mark up a copy of the specifications for the product. Indicate in the margin of each paragraph the following: COMPLY, DO NOT COMPLY, or NOT APPLICABLE. Explain all DO NOT COMPLY statements.
- F. Provide a separate transmittal for each submittal item. Transmittals shall indicate product by specification section name and number. Separate all submittals into appropriate specification section number. Do not combine specification sections.

1.5 MANUFACTURERS INSTRUCTIONS

- A. Submit Manufacturer's instructions for storage, preparation, assembly, installation, start-up, adjusting, calibrating, balancing and finishing.

1.6 CONTRACTOR RESPONSIBILITIES

- A. Review submittals prior to transmittal.
- B. Determine and verify:
 - 1. Field measurements.
 - 2. Field construction criteria.
 - 3. Manufacturer's catalog numbers.
 - 4. Conformance with requirements of Contract Documents.
- C. Coordinate submittals with requirements of the work and of the Contract Documents.
- D. Notify the Architect/Engineer in writing at time of submission of any deviations in the submittals from requirements of the Contract Documents.
- E. Do not fabricate products, or begin work for which submittals are specified, until such submittals have been produced and bear contractor's stamp. Do not fabricate products or

begin work scheduled to have submittals reviewed until return of reviewed submittals with Architect / Engineer's acceptance.

- F. Contractor's responsibility for errors and omissions in submittals is not relieved whether Architect / Engineer reviews submittals or not.
- G. Contractor's responsibility for deviations in submittals from requirements of Contract Documents is not relieved whether Architect/Engineer reviews submittals or not, unless Architect / Engineer gives written acceptance of the specific deviations on reviewed documents.
- H. Submittals shall show sufficient data to indicate complete compliance with Contract Documents:
 - 1. Proper sizes and capacities.
 - 2. That the item will fit in the available space in a manner that will allow proper service.
 - 3. Construction methods, materials and finishes.
- I. Schedule submissions at least 15 days before date reviewed submittals will be needed.

1.7 SUBMISSION REQUIREMENTS

- A. Make submittals promptly in accordance with approved schedule, and in such sequence as to cause no delay in the Project or in the work of any other Contractor.
- B. Number of submittals required:
 - 1. Shop Drawings and Coordination Drawings: Submit one reproducible transparency and three opaque reproductions.
 - 2. Product Data: Submit the number of copies which the contractor requires, plus those which will be retained by the Architect/Engineer.
- C. Accompany submittals with transmittal letter, in duplicate, containing:
 - 1. Date.
 - 2. Project title and number.
 - 3. Contractor's name, address and contact number.
 - 4. The number of each Shop Drawing, Project Datum and Sample submitted.
 - 5. Other pertinent data.
- D. Submittals shall include:
 - 1. The date of submission.
 - 2. The project title and number.
 - 3. Contract Identification.
 - 4. The names of:
 - a. Contractor.
 - b. Subcontractor.
 - c. Supplier.
 - d. Manufacturer.
 - 5. Identification of the product.
 - 6. Field dimensions, clearly identified as such.
 - 7. Relation to adjacent or critical features of the work or materials.
 - 8. Applicable standards, such as ASTM or federal specifications numbers.
 - 9. Identification of deviations from contract documents.
 - 10. Suitable blank space for General Contractor and Architect/Engineer stamps.
 - 11. Contractor's signed and dated Stamp of Approval.

- E. Coordinate submittals into logical groupings to facilitate interrelation of the several items:
 - 1. Finishes which involve Architect/Engineer selection of colors, textures or patterns
 - 2. Associated items which require correlation for efficient function or for installation

1.8 SUBMITTAL SPECIFICATION INFORMATION

- A. Every submittal document shall bear the following information as used in the project manual:
 - 1. The related specification section number.
 - 2. The exact specification section title.
- B. Submittals delivered to the Architect/Engineer without the specified information will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been delivered.

1.9 RESUBMISSION REQUIREMENTS

- A. Make re-submittals under procedures specified for initial submittals.
 - 1. Indicate that the document or sample is a re-submittal.
 - 2. Identify changes made since previous submittals.
- B. Indicate any changes which have been made, other than those requested by the Architect / Engineer.

1.10 CONTRACTOR'S STAMP OF APPROVAL

- A. Contractor shall stamp and sign each document certifying to the review of products, field measurements and field construction criteria, and coordination of the information within the submittal with requirements of the work and of Contract Documents.
- B. Contractor's stamp of approval on any submittal shall constitute a representation to Owner and Architect/Engineer that Contractor has either determined and verified all quantities, dimensions, field construction criteria, materials, catalog numbers, and similar data or assumes full responsibility for doing so, and that Contractor has reviewed or coordinated each submittal with the requirements of the work and the Contract Documents.
- C. Do not deliver any submittals to the Architect/Engineer that do not bear the Contractor's stamp of approval and signature.
- D. Submittals delivered to the Architect/Engineer without Contractor's stamp of approval and signature will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been delivered.

1.11 ARCHITECT / ENGINEER REVIEW OF IDENTIFIED SUBMITTALS

- A. The Architect / Engineer will:
 - 1. Review identified submittals with reasonable promptness and in accordance with schedule.
 - 2. Affix stamp and initials or signature, and indicate requirements for re-submittal or approval of submittal.
 - 3. Return submittals to Contractor for distribution or for resubmission.
- B. Review and approval of submittals will not extend to design data reflected in submittals which is peculiarly within the special expertise of the Contractor or any party dealing directly with the Contractor.

- C. Architect / Engineer's review and approval is only for conformance with the design concept of the project and for compliance with the information given in the contract.
 - 1. The review shall not extend to means, methods, sequences, techniques or procedures of construction or to safety precautions or programs incident thereto.
 - 2. The review shall not extend to review of quantities, dimensions, weights or gauges, fabrication processes or coordination with the work of other trades.
- D. The review and approval of a separate item as such will not indicate approval of the assembly in which the item functions.

1.12 SUBSTITUTIONS

- A. Do not make requests for substitution employing the procedures of this Section.
- B. The procedure for making a formal request for substitution is specified in Div. 1.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION - NOT USED

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 23 05 13

ELECTRICAL PROVISIONS OF HVAC WORK

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Electrical provisions to be provided as mechanical work are indicated in other Division 23 sections, on drawings, and as specified.
- B. Types of work, normally recognized as electrical but provided as mechanical, specified or partially specified in this Section, include but are not necessarily limited to the following:
 - 1. Motors for mechanical equipment.
 - 2. Starters for motors of mechanical equipment, but only where specifically indicated to be furnished integrally with equipment.
 - 3. Wiring from motors to disconnect switches or junction boxes for motors of mechanical equipment, but only where specifically indicated to be furnished integrally with equipment.
 - 4. Wiring of field-mounted float control switches, flow control switches, and similar mechanical-electrical devices provided for mechanical systems, to equipment control panels.
 - 5. Wiring of smoke detectors for shutdown of air handling equipment when a fire alarm system is not included in the project.
 - 6. Wiring of oil pump, vibration and oil level limit switches for cooling towers.
 - 7. Refrigerant monitor/sensor/alarming and field installed visual/audible display alarms.
 - 8. Pipe heat tracing.
 - 9. Cooling tower vibration switch/interlock/reset.
 - 10. Field interlock wiring from chiller: flow switches, pump aux. Contacts, pump start/stop.
 - 11. Power supply 120 VAC and control signal from chiller control panel to condenser water flow control valve installed in piping leaving chiller.
 - 12. Wiring of all related circulating water system chemical treatment devices.
 - a. Low voltage electric contacting water meter.
 - b. Solenoid valve/blow-down assembly.
 - 13. Radiant heater timer switches and/or thermostats.
 - 14. Low Voltage thermostat wiring.
- C. Refer to Division 23 Controls Sections for related control system wiring.
- D. Refer to Division 23 sections for specific individual mechanical equipment electrical requirements.
- E. Refer to Division 26 sections for motor starters and controls not furnished integrally with mechanical equipment.
- F. Refer to Division 26 sections for junction boxes and disconnect switches required for motors and other electrical units of mechanical equipment.

1.2 RELATED WORK

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Specification Sections, apply to work of this Section.

1.3 QUALITY ASSURANCE

- A. Wherever possible, match elements of electrical provisions of mechanical work with similar elements of electrical work specified in Division 26 sections for electrical work not otherwise specified.
- B. For electrical equipment and products, comply with applicable NEMA standards, and refer to NEMA standards for definitions of terminology. Comply with National Electrical Code (NFPA 70) for workmanship and installation requirements.

1.4 SUBMITTALS

- A. Include in listing of motors, voltage, notation of whether motor starter is furnished or installed integrally with motor or equipment containing motors.

PART 2 - PRODUCTS

2.1 MOTORS

- A. Provide motors for mechanical equipment manufactured by one of the following:
 - 1. Baldor Electric Company.
 - 2. Century Electric Div., Inc.
 - 3. General Electric Co.
 - 4. Louis Allis Div.; Litton Industrial Products, Inc.
 - 5. Lincoln Electric.
 - 6. Marathon Electric Mfg. Corp.
 - 7. Reliance Electric Co.
 - 8. Westinghouse Electric Corp.
 - 9. WEG.
- B. Motor Characteristics. Except where more stringent requirements are indicated, and except where required items of mechanical equipment cannot be obtained with fully complying motors, comply with the following requirements for motors of mechanical work:
- C. Temperature Rating. Rated for 40 Degrees C environment with maximum 50 Degrees C temperature rise for continuous duty at full load (Class A Insulation).
- D. Provide each motor capable of making starts as frequently as indicated by automatic control system, and not less than 5 starts per hour for manually controlled motors.
- E. Phases and Current Characteristics. Provide squirrel-cage induction polyphase motors for 3/4hp and larger, and provide capacitor-start single-phase motors for 1/2hp and smaller, except 1/6hp and smaller may, at equipment manufacturer's option, be split-phase type. Coordinate current characteristics with power specified in Division 26 sections, and with individual equipment requirements specified in other Division 23 requirements. For 2-speed motors provide 2 separate windings on polyphase motors. Do not purchase motors until power characteristics available at locations of motors have been confirmed, and until rotation directions have been confirmed.
- F. Service Factor. 1.15 for polyphase motors and 1.35 for single-phase motors.
- G. Motor Construction. Provide general purpose, continuous duty motors, Design "B" except "C" where required for high starting torque.
 - 1. Frames. NEMA #56.
 - 2. Bearings are to be ball or roller bearings with inner and outer shaft seals, regreasable except permanently sealed where motor is inaccessible for regular

maintenance. Where belt drives and other drives produce lateral or axial thrust in motor, provide bearings designed to resist thrust loading. Refer to individual section of Division 23 for fractional-hp light-duty motors where sleeve-type bearings are permitted.

3. Except as indicated, provide open drip-proof motors for indoor use where satisfactorily housed or remotely located during operation, and provide guarded drip-proof motors where exposed to contact by employees or building occupants. Provide weather-protected Type I for outdoor use, Type II where not housed. Refer to individual sections of Division 23 for other enclosure requirements.
4. Provide built-in thermal overload protection and, where indicated, provide internal sensing device suitable for signaling and stopping motor at starter.
5. Noise Rating: Provide "Quiet" rating on motors.

H. All motors shall be premium efficiency.

I. Provide an inverter duty motor on all equipment that utilizes a variable frequency drive.

2.2 EQUIPMENT FABRICATION

- A. Fabricate mechanical equipment for secure mounting of motors and other electrical items included in work. Provide either permanent alignment of motors with equipment, or adjustable mountings as applicable for belt drives, gear drives, special couplings and similar indirect coupling of equipment. Provide safe, secure, durable, and removable guards for motor drives. Arrange for lubrication and similar running-maintenance without removal of guards.

2.3 GENERAL REQUIREMENTS – SHAFT GROUNDING RINGS

- A. All motors operated on variable frequency drives shall be equipped with a maintenance-free, conductive microfiber shaft grounding ring to meet NEMA MG-1, 3.4.4.4.3 requirements, with a minimum of two rows of circumferential microfibers to discharge damaging shaft voltages away from the bearings to ground. SGR's Service Life: Designed to last for service life of motor. Provide AEGIS SGR Conductive MicroFiber Shaft Grounding Ring, or approved equal.
- B. Application Note: Motors up to 100 HP shall be provided with one shaft ground ring installed on either the drive end or non-drive end. Motors over 100 HP shall be provided with an insulated bearing on the non-drive end and a shaft grounding ring on the drive end of the motor with the exception of line contact bearings in the drive end of the machine. In this instance the line contact bearing must be electrically insulated and the AEGIS Bearing Protection Ring installed on the opposite drive end of the motor. Grounding rings shall be provided and installed by the motor manufacturer's recommendations.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install motors on motor mounting systems in accordance with motor manufacturer's instructions, anchored to resist torque, drive thrusts, and other external forces inherent in mechanical work. Secure sheaves and other drive units to motor shafts with keys and Allen set screws on flat surface of shaft. Unless otherwise indicated, set motor shafts parallel with machine shafts.
- B. Verify voltage with Electrical Plans.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 23 05 14

HVAC CONDENSATE DRAIN PIPING SYSTEM

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide and install air conditioning condensate drains.

1.2 RELATED WORK

- A. Division 23 - Mechanical
 - 1. Insulation
 - 2. Air Handling Units

PART 2 - PRODUCTS

2.1 PIPE MATERIAL

- A. Type "L" copper with drainage pattern fittings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install the system to facilitate easy removal.
 - 1. Use threaded plugged tee at each change of direction to permit cleaning.
 - 2. Install a cleanout every 50 feet of straight run piping
 - 3. Maintain a positive slope on all piping
- B. Install a water seal trap leg based on the fan pressure.
 - 1. Size the length of the trap leg 1 inch larger than the actual system pressure.
- C. Install traps and cleanout as shown in the drawing details.
 - 1. Confirm requirements with manufacturer's installation instructions

3.2 SIZE PIPE AS SHOWN ON DRAWINGS.

- A. Do not install piping sized smaller than the unit drain connection size.

3.3 SECONDARY DRAINS

- A. Provide secondary drains where required by code, shown on the drawings, or where equipment has secondary drain connections.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 23 05 48

VIBRATION ISOLATION

PART 1 - GENERAL

1.1 SCOPE

- A. Furnish, install, and adjust vibration isolation.

1.2 RELATED WORK

- A. Division 23 Mechanical.
 - 1. Refer to the Section on Ductwork for flexible connections between fans and ducts.

1.3 SUBMITTALS

- A. Submit product data showing type, size, load, deflection and other information required. Include clearly outlined procedures for installing and adjusting isolators.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Amber Booth.
- B. Kinetics.
- C. Mason.
- D. Korfund.
- E. VSI.
- F. Vibration Eliminator Co., Inc.
- G. Metraflex.

2.2 ISOLATOR TYPES

- A. Neoprene mountings shall have a minimum static deflection of 0.35 inches (9mm). All metal surfaces shall be neoprene covered and have friction pads both top and bottom. Bolt holes shall be provided on the bottom and a tapped hole and cap screw on top. Steel rails shall be used above the mountings under equipment such as small vent sets to compensate for the overhang.
- B. Spring isolators shall be free standing and laterally stable without any housing and complete with a molded neoprene cup or ¼ inch (6mm) neoprene acoustical friction pad between the base plate and the support. All mountings shall have leveling bolts that must be rigidly bolted to the equipment. Installed and operating heights shall be equal. The ratio of the spring diameter divided by the compressed spring height shall be no less than 0.8. Springs shall have a minimum additional travel to solid equal to 50% of the rated deflection. Submittals shall include spring diameters, deflection, compressed spring height and solid spring height.
- C. Hangers shall consist of rigid steel frames containing minimum 1-1/4 inch (32mm) thick neoprene elements at the top and a steel spring with general characteristics as in specification B seated in a steel washer reinforced neoprene cup on the bottom. The neoprene element and the cup shall have neoprene bushings projecting through the steel box. In order to maintain stability the boxes shall not be articulated as clevis hangers nor the neoprene element stacked on top of the spring. Spring diameters and hanger box lower hole sizes shall be large enough to permit the hanger rod to swing through a 30-degree arc from side to side before contacting the cup bushing and short circuiting the spring. Submittals

shall include a hanger drawing showing the 30-degree capability.

- Q. Curb mounted rooftop equipment shall be mounted on spring isolation curbs. The lower member shall consist of a sheet metal Z section containing adjustable and removable steel springs that support the upper floating section. The upper frame must provide continuous support for the equipment and must be captive so as to resiliently resist wind forces. All directional neoprene snubber bushings shall be a minimum of 1/4 inch (6mm) thick. Steel springs shall be laterally stable and rest on 1/4 inch (6mm) thick neoprene acoustical pads. Hardware must be plated and the springs provided with a rust resistant finish. The curbs waterproofing shall consist of a continuous galvanized flexible counter flashing nailed over the lower curbs waterproofing and joined at the corners by EPDM bellows. All spring locations shall have access ports with removable waterproof covers. Lower curbs shall have provision for 2 inches (50mm) of insulation.

2.3 ISOLATOR APPLICATION

EQUIPMENT	ISOLATOR TYPE	MINIMUM DEFLECTION
Air Handling Units		
Floor Mounted – up to 15 HP	B	1"
Floor Mounted – 20 HP and Over	B	1.5"
Suspended	D	1"
Suspended Fan Coil Units	D	0.5"
Condensing Units	A	0.35"
Roof Mounted HVAC Units	Q	2"

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Stock Requirements. The isolation manufacturer's representative shall maintain an adequate stock of springs and isolators of type used so that changes required during construction and installation can be made.
- B. Factory Representation. After installation, furnish factory-trained representative of the isolation manufacturer to check various isolators and report measured versus anticipated deflection on all isolators. Have the representative certify that isolators have been installed in accordance with manufacturer's recommendations and approved submittals. Provide written report to Engineer indicating compliance prior to final acceptance.

END OF SECTION

SECTION 23 05 93

TESTING, BALANCING AND ADJUSTING (TAB) OF ENVIRONMENTAL SYSTEMS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Balance, adjust and test the air distribution system including the exhaust system.
- B. Balance, adjust and test the hydronic system.
- C. Verify and record the duct test results performed by the mechanical contractor.

1.2 PAYMENT PROCEDURES

- A. The work of this Section of the Specifications shall bid the project directly to the General Contractor.

1.3 SUBMITTALS

- A. History of the TAB organization.
- B. Agency certification.
- C. Personnel qualifications.
- D. TAB data forms.
- E. Instrumentation list.
- F. Name of the project supervising engineer.
- G. Name and address and contact person of five successfully completed projects of similar size and scope.
- H. To perform required professional services, the balancing agency shall have a minimum of one test and balance engineer certified by the National Environmental Balancing Bureau.

1.4 TAB FIRM QUALIFICATIONS

- A. The organization performing the work shall be a Certified member in good standing of the (NEBB) National Environmental Balancing Bureau .
- B. Able to furnish evidence of having contracted for and completed not less than five systems of comparable size and type that have served their Owners satisfactorily for not less than five years.
- C. A specialist in this field and have the personnel, experience, training, skill, and the organization to perform the work.
- D. The balancing agency shall furnish all necessary calibrated instrumentation to adequately perform the specified services. An inventory of all instruments and devices in possession of the balancing agency may be required by the engineer to determine the balancing agency's performance capability.
- E. The balancing agency shall have operated for a minimum of five years under its current

name.

F. Personnel:

1. The project supervisor shall be a Professional Engineer registered in Texas.
 - a. Extensive knowledge of the work involved.
 - b. At least five years experience conducting tests of the type specified.
 - c. This test and balance engineer shall be responsible for the supervision and certification of the total work herein specified.
2. All work shall be conducted under the direct supervision of the supervising engineer.
3. Technicians shall be trained and experienced in the work they conduct.

1.5 WARRANTY

A. Provide (AABC) guarantee in writing.

B. Extended warranty.

1. Include an extended warranty of 2 years after completion of test and balance work, during which time the Architect/Engineer may request a retest or resetting of any outlet or other items as listed in the test report.
2. Provide technicians and instruments to assist the Architect/Engineer in making any tests he may require during this period.
3. The balancing agency shall perform an inspection of the HVAC system during the opposite season from that which the initial adjustments were made. The balancing agency shall make any necessary modifications to the initial adjustments to produce optimum system operation.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION

3.1 TAB TOLERANCES

A. The water, outside air, supply air, return air, and exhaust air for each system shall be adjusted to within +/- 5% of the value scheduled on the drawings.

3.2 SITE VISITS

A. During construction, the balancing agency shall inspect the installation of the piping systems, sheetmetal work, temperature controls, energy management system, and other component parts of the heating, ventilating, and air conditioning systems. One inspection shall take place when 60% of the ductwork is installed and another inspection shall take place when 90% of the equipment is installed. The balancing agency shall submit a brief written report of each inspection to the architect and engineer.

B. Upon completion of the installation and start-up of the mechanical equipment by the mechanical contractor, the balancing agency shall test and balance the system components to obtain optimum conditions in each conditioned space of the building. If construction deficiencies are encountered that preclude obtaining optimum conditions, and the deficiencies cannot be corrected by the mechanical contractor within a reasonable period of time, the balancing agency shall cease testing and balancing services and advise the architect, engineer, general contractor and owner, in writing, of the deficiencies.

C. Note proper piping installation, location of valves, and flow measuring instruments.

D. Make one series of visits, phased as required by construction progress, prior to

installation of the ceiling. Note proper installation of balancing dampers.

- E. Continue the site visits up to completion of project. In each succeeding report, list corrections made from previous reports.

3.3 TESTING INSTRUMENTS

- A. Submit a list of all instruments to be used for the test and balance procedures.
 - 1. Catalog sheets
 - 2. Certificate of last calibration
 - 3. Calibration within a period of six months prior to balancing
- B. Testing equipment shall be in good working order and tested for accuracy prior to start of work.

3.4 COORDINATION WITH OTHER SPECIFICATION SECTIONS

- A. Review the related ductwork shop drawings and piping shop drawings. Make recommendations concerning suitability with respect to the testing, balancing and adjusting work.
- B. Make tests to verify proper placement of the static pressure sensors for the variable air volume fan system control.
- C. In cooperation with the work specified in Building Management and Control System section, a systematic listing of the testing and verification shall be included in the final TAB report. The TAB firm shall provide a laptop computer to operate with the Building Management and Control System. Building Management and Control System shall provide all necessary software and special interface cables, as required, to communicate with the DDC system:
 - 1. Work with the temperature control contractor to ensure the most effective total system operation within the design limitations, and to obtain mutual understanding of the intended control performance.
 - 2. Verify that all control devices are properly connected.
 - 3. Verify that all dampers, valves, and other controlled devices, are operated by the intended controller.
 - 4. Verify that all dampers and valves are in the position indicated by the controller (open, closed or modulating).
 - 5. Verify the integrity of valves and dampers in terms of tightness of close-off and full open positions. This includes dampers in multizone units, terminal boxes and fire/smoke dampers.
 - 6. Observe that all valves are properly installed in piping system in relation to direction of flow and location.
 - 7. Observe the calibration of all controllers.
 - 8. Verify the proper application of all normally opened and normally closed valves.
 - 9. Observe the locations of all thermostats and humidistats for potential erratic operation from outside influences such as sunlight, drafts or cold walls.
 - 10. Observe the location of all sensors to determine whether their position will allow them to sense only the intended temperatures or pressures of the media. Control contractor will relocate as deemed necessary by the Engineer.
 - 11. Verify that the sequence of operation for any control mode is in accordance with the approved shop drawings and specifications. Verify that no simultaneous heating and cooling occurs.
 - 12. Verify the correct operation of all interlock systems and installation is per the manufacturer recommendations.
 - 13. Check all dampers for free operation.
 - 14. Verify that all controller setpoints meet the design intent.

15. Perform variable volume system verification to assure the system and its components track with changes from full flow to minimum flow.
- D. Upon completion of the testing and balancing, submit three days prior notice that the systems are ready for a running test. A qualified representative of the test and balance organization shall be present, with a representative from the engineers office, to field verify TAB report readings. Specific and random selections of data recorded in the certified test and balance report will be reviewed.

3.5 INSTRUMENT TEST HOLES

- A. When it is required to make holes in the field to measure temperature, static pressure or velocity in the ducts:
1. Drill holes, plug and tape external duct insulation.
 2. Repair damaged insulation to Engineer's approval.

3.6 TESTING THE AIR DISTRIBUTION SYSTEM

- A. The TAB agency shall verify that all ductwork, dampers, grilles, registers, and diffusers have been installed per design and set full open. The TAB agency shall perform the following TAB procedures in accordance with the AABC National Standards and all results shall be recorded in the TAB report:
1. Supply Fans:
 - a. Fan speeds: Test and adjust fan RPM to achieve design CFM requirements.
 - b. Current and Voltage: Test and record motor voltage and amperage, and compare data with the nameplate limits to ensure fan motor is not in or above the service factor.
 - c. Pitot-Tube Traverse: Perform a Pitot-Tube traverse of the main supply and return ducts, as applicable, to obtain total CFM. If a Pitot-Tube traverse is not practical, an explanation of why a traverse was not made must appear on the appropriate data sheet. Measurements must be recorded with an Inclined Manometer or an Inclined/Vertical Manometer.
 - d. Outside Air: Test and adjust the outside air on applicable equipment using a Pitot-Tube traverse. If a Pitot-Tube traverse is not practical, an explanation of why a traverse was not made must appear on the appropriate data sheet. If a traverse is not practical, use the mixed air temperature method, if the inside and outside temperature difference is at least 20°F, or use the difference between Pitot-tube traverse of the supply and return ducts.
 - e. Static Pressure: Test and record system static pressure, including the static pressure profile of each supply fan.
 2. All Other Fans:
 - a. Fan speeds: Test and adjust fan RPM to achieve design CFM requirements.
 - b. Current and Voltage: Test and record motor voltage and amperage, and compare data with the nameplate limits to ensure fan motor is not in or above the service factor.
 - c. Pitot-Tube Traverse: Perform a Pitot-Tube traverse of the main return ducts, as applicable, to obtain total CFM. If a Pitot-Tube traverse is not practical, an explanation of why a traverse was not made must appear on the appropriate data sheet. Measurements must be recorded with an Inclined Manometer or an Inclined/Vertical Manometer.
 - d. Static Pressure: Test and record system static pressure, including the static pressure profile of each return fan.
 3. Diffusers, Registers and Grilles:

- a. Tolerances: Test, adjust, and balance each diffuser, grille, and register to within 5% of design requirements. Minimize drafts. Observe throws are in direction as indicated on drawings.
- 5. Coils (including electric coils):
 - a. Air Temperature: Once air flows are set to acceptable limits, take wet bulb (cooling coil only) and dry bulb air temperatures on the entering and leaving side of each coil. Calculate the sensible and latent (cooling coil only) capacity of the coil. Provide information in TAB report.
- B. Record preliminary air handler data, including fan RPM and static pressures across filter, fans and coils.
- C. Perform a velocity traverse of the main supply ducts using a pitot-tube and inclined manometer to establish initial air delivery. Perform a Pitot-tube traverse of main supply and return ducts, as applicable, to obtain total CFM. If a pitot-tube traverse is not practical, a detailed explanation of why a traverse was not made must appear on the appropriate data sheet.
- D. Where air measuring stations are installed, use pitot tube traverse readings to verify and record the correct calibration of the stations output.
- E. Make adjustments in fan RPM and damper settings, as required, to obtain design supply air, return air, and outside air.
- F. Measure and adjust all supply and return branches to design air delivery.
- G. Measure and adjust all diffusers to design air delivery to +/- 5% of design requirements.
- H. Make a set of recordings showing final system conditions.

3.7 EQUIPMENT POWER READINGS

- A. Record the following information for each motor:
 - 1. Equipment designation.
 - 2. Manufacturer.
 - 3. Unit model number and serial number and frame.
 - 4. Motor nameplate horsepower; nameplate voltage; phase and full load amperes.
 - 5. Heater coil in starter.
 - a. Rating in amperes.
 - b. Manufacturer's recommendation.
 - 6. Motor RPM/driven equipment RPM.
 - 7. Power reading (voltage, amperes of all legs at motor terminals).

3.8 DIRECT EXPANSION EQUIPMENT

- A. With each unit operating at near design conditions, measure and record the following:
 - 1. Manufacturer, model number, serial number and all nameplate data.
 - 2. Ambient temperature, condenser discharge temperature.
 - 3. Amperage and voltage for each phase.
 - 4. Leaving and entering air temperatures.
 - 5. Suction and discharge pressures and temperatures.
 - 6. Tons of cooling.
 - 7. Verification that moisture indicator shows dry refrigerant.

3.9 TAB REPORT

- A. The activities described in this specification shall be recorded in a report form; and four individually bound copies shall be provided to the Architect and Engineer. Neatly type and arrange data. Include with the data the date tested, personnel present, weather conditions, nameplate record of the test instruments used and list all measurements taken after all corrections are made to the system. Record all failures and corrective action taken to remedy any incorrect situation. The intent of the final report is to provide a reference of actual operating conditions for the Owner's operations personnel. Provide a "Preface" which shall include a general discussion of the system and any abnormalities or problems encountered.
- B. All measurements and recorded readings (of air, water, electricity, etc.) that appear in the report must have been recorded on site by the permanently employed technicians or engineers of the TAB firm.
- C. Submit reports on forms approved by the engineer that will include the following data as a minimum:
 1. Title Page
 - a. Company Name
 - b. Company Address
 - c. Company telephone number
 - d. Project name
 - e. Project location
 - f. Project Manager
 - g. Project Engineer
 - h. Project Contractor
 - i. Project Identification Number
 2. Summary of the TAB report data
 3. Index
 4. Instrument List
 - a. Instrument
 - b. Manufacturer
 - c. Model
 - d. Serial Number
 - e. Range
 - f. Calibration Date
 - g. What test instrument is to be used for:
 5. Fan Data
 - a. Location
 - b. Manufacturer
 - c. Model
 - d. Air flow, specified and actual
 - e. Total static pressure (total external) specified and actual
 - f. Inlet pressure
 - g. Discharge pressure
 - h. Fan RPM
 6. Return Air/Outside Air Data
 - a. Identification/location
 - b. Design return air flow
 - c. Actual return air flow
 - d. Design outside air flow
 - e. Actual outside air flow
 - f. Return air temperature
 - g. Outside air temperature
 - h. Required mixed air temperature

- I. Actual mixed air temperature
7. Electric Motors
 - a. Manufacturer
 - b. HP/BHP
 - c. Phase, voltage, amperage, nameplate, actual
 - d. PM
 - e. Service Factor
 - f. Starter size, heater elements, rating
8. Air Distribution Test Sheet
 - a. Air terminal number
 - b. Room number/location
 - c. Terminal type
 - d. Terminal size
 - e. Correction factor
 - f. Design velocity
 - g. Design air flow
 - h. Test (final) velocity
 - i. Test (final) air flow
9. Cooling Coil Data
 - a. Identification/number
 - b. Location
 - c. Service
 - d. Manufacturer
 - e. Entering air DB temperature, design and actual
 - f. Entering air WB temperature, design and actual
 - g. Leaving air DB temperature, design and actual
 - h. Leaving air WB temperature, design and actual
 - i. Water pressure flow, design and actual
 - j. Water pressure drop, design and actual
 - k. Entering water temperature, design and actual
 - l. Leaving water temperature, design and actual
 - m. Air pressure drop, design and actual
 - n. Capacity - sensible and latent
10. Heating Coil Data
 - a. Identification/number
 - b. Location
 - c. Service
 - d. Manufacturer
 - e. Entering air DB temperature, design and actual
 - f. Leaving air DB temperature, design and actual
 - g. Water pressure flow, design and actual
 - h. Water pressure drop, design and actual
 - i. Entering water temperature, design and actual
 - j. Leaving water temperature, design and actual
 - k. Air pressure drop, design and actual
 - l. Capacit.
11. Sound Level Report
 - a. Location (Location established by the design engineer).
 - b. N C curve for eight (8) bands-equipment off.
 - c. N C curve for eight (8) bands-equipment on.
12. Control verification indicating date performed and any abnormalities identified.
 - a. Point Location/Description.
 - b. EMS Readout (Setpoint and Actual).
 - c. Actual Readout of all points.

- d. Interlocks.
- e. Safeties.
- f. Variable speed drive tracking with EMS input.
- g. Variable speed drive Bypass operation.
- h. Sequence of operation.

END OF SECTION

SECTION 23 07 13

EXTERNAL DUCT INSULATION

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install external insulation on supply, return, exhaust and outside air ductwork.
- B. External insulation of concealed and exposed ducts is included in this Section. Internal acoustic duct lining is specified under ductwork and not included in this Section.

1.2 RELATED WORK

- A. Division 9 - FINISHES. Painting and Color Coding.
- B. Division 23 - MECHANICAL.
 - 1. Air Handling Units. Internal insulation for air units is specified in the sections on air handling units. The units do not require external insulation.
 - 2. Refer to insulation and liner plan detail.

1.3 QUALITY ASSURANCE

- A. The intent of insulation specifications is to obtain superior quality workmanship, resulting in an installation that is absolutely satisfactory in both function and appearance. Provide insulation in accordance with the specifications for each type of service and apply as recommended by the manufacturer and as specified.
- B. An approved contractor for this work under this Division shall be:
 - 1. A specialist in this field and have the personnel, experience, training, skill, and the organization to provide a practical working system.
 - 2. Able to furnish evidence of having contracted for and installed not less than 3 systems of comparable size and type that have served their Owners satisfactorily for not less than 3 years.
- C. All duct insulation used on the project inside the building must have a flame spread rating not exceeding 25 and a smoke developed rating not exceeding 50 as determined by test procedures ASTM E84, NFPA 255 and UL 723. These ratings must be as tested on the composite of insulation, jacket or facing, and adhesive. Components such as adhesives, mastics and cements must meet the same individual ratings as the minimum requirements and bear the UL label.
- D. Condensation on any insulated system is not approved.
- E. Replace insulation damaged by either moisture or other means. Insulation that has been wet, whether dried or not, is considered damaged. Make repairs where condensation is caused by improper installation of insulation. Also repair any damage caused by the condensation.
- F. Where existing insulated ductwork or other services are tapped, remove existing insulation back to undamaged sections and replace with new insulation of the same type and thickness as existing insulation. Apply as specified for insulation of the same service.

1.4 APPROVALS

- A. Submittals. Submit product data on each insulation type, adhesive, and finish to be used in the work. Make the submittal as specified in Division 1 General Requirements and obtain approval before beginning installation. Include product description, list of materials and thickness for each service and location, and the manufacturer's installation instructions for each product.
- B. Sample Application. Make an application of each type of insulation to display the material, quality and application method. Obtain approval of the sample application before proceeding with installation of the work.

PART 2 - PRODUCTS

2.1 INSULATION

- A. Glass fiber rigid duct insulation.
 - 1. Minimum density of 3 pcf, installed R value to be 6.0 (when located in a conditioned plenum) and minimum density of 0.75 pcf, installed R value to be 8.0 (when located in an unconditioned plenum) at 75°F mean, facing of 0.7 mil aluminum foil reinforced with glass yarn mesh and laminated to 40 lbs. fire-resistant Kraft. R-value to be indicated on exterior side of insulation to be verified by City inspector.
 - 2. Acceptable Manufacturers
 - a. Schuller 814 spin-glas FSK.
 - b. Owens-Corning Type 703 board RKF.
 - c. Knauf 3 PCF FSK.
- B. Glass fiber blanket duct insulation.
 - 1. Minimum density of 1.0 pcf, installed R value to be 6.0 (when located in a conditioned plenum) and minimum density of 0.75 pcf, installed R value to be 8.0 (when located in an unconditioned plenum) at 75°F mean, facing of 0.35 mil foil reinforced with glass yarn mesh and laminated to 40 lbs. fire resistant Kraft. R-value to be indicated on exterior side of insulation to be verified by City inspector.
 - 2. Acceptable Manufacturers
 - a. Manville R-series Microlite FSKL.
 - b. Owens-Corning ED100 RKF.
 - c. Knauf 1.0 PCF FSK.
- C. Rigid Closed Cell Insulation
 - 1. Acceptable Manufacturers
 - a. Dow Trymer.
 - b. Phenolic Foam.

2.2 COATING AND ADHESIVE

- A. Coating. Provide Childers CP-38 or Foster 30-80 vapor barrier coating. Coating must meet MIL Spec C-19565C, Type II and be QPL Listed. Permeance shall be 0.013 perms or less at 43 mils dry. Tested at 100°F and 90% RH per ASTM E96.
- B. Outdoors: Provide as insulation coating Childers Encacel X or Foster Monolar 60-90. Permeance shall be 0.03 perms or less at 30 mils dry. Tested at 100°F and 90% RH per ASTM F 1249.
- C. Adhesive. Provide Childers CP-82 or Foster 85-20 vapor barrier adhesive.

- D. Reinforcing Mesh. Provide 10 x 10 white glass or polyester reinforcing mesh.

PART 3 - EXECUTION

3.1 FIRE SAFETY REQUIREMENTS

- A. Do not extend duct coverings through walls or floors required to be fire-stopped or required to have a fire resistance rating. Interrupt duct coverings in the immediate vicinity of heat sources such as electric resistance or fuel-burning heater.

3.2 CONCEALED DUCT

- A. Provide flexible glass fiber insulation with factory-applied, reinforced UL labeled Foil-Skrim-Kraft (FSK) facing.
- B. Standing Seams. Insulate standing seams and stiffeners, which protrude through the insulation with 0.6 lb. per cubic foot density, 1-1/2" thick, faced, flexible blanket insulation. Insulation shall not prevent adjustment of damper operators.
- C. Insulation shall be wrapped tightly on the ductwork with all circumferential joints butted and longitudinal joints overlapped a minimum of 2". In addition, secure insulation to the bottom of rectangular ductwork by the use of either weld pins with washers or cup-head pins welded to the ductwork or perforated based insulation hangers glued to the duct on twelve inch centers to prevent sagging of insulation.
- D. Ductwork in mechanical rooms is considered concealed spaces.

3.3 EXPOSED DUCT INSULATION

- A. Ductwork in exposed locations is to be insulated with fiberglass rigid / semi-rigid board insulation.
 - 1. Apply fabric and mastic to provide a smooth surface for painting.
- B. Standing Seams: Insulate standing seams and stiffeners which protrude through the insulation with 0.6 lb per cubic foot density, 1-1/2 inch thick, faced insulation. As a vapor seal, use reinforcing mesh with vapor barrier coating. Insulation shall not prevent adjustment of damper operators.
- C. Insulation shall be wrapped tightly on the ductwork. Adhere insulation to ductwork with adhesive. In addition, secure insulation to the bottom of rectangular ductwork by the use of either weld pins with washers or cup-head pins welded to the ductwork or perforated based insulation hangers glued to the duct on 12 inch centers to prevent sagging of insulation.
- D. Cover all seams, joints, pin penetrations and other breaks with coating reinforced with reinforcing mesh. Fabric shall not be visible after coating.

3.4 OUTDOOR DUCTWORK COVERING

- A. Cover all supply and return ductwork outdoors:
 - 1. 1-1/2" thick, rigid closed cell insulation with reinforced foil facing.
- B. Install a high point in center and slope in both directions so water will not stand on horizontal surfaces.

- C. Impale the insulation over mechanical fasteners and washers.
 - 1. A minimum of 2 rows of fasteners per side on 12-inch centers.
 - 2. Seal all breaks, joints and punctures by applying a 1/8" thick vapor barrier mastic coating, embedded in open mesh reinforcing mesh.
- D. Standing S, or flanged connections shall be covered with the same thickness of insulation overlapped a minimum of 4".
- E. Apply a tack coat of Childers CP-10/11 or Foster 46-50 weather barrier mastic over the entire surface.
 - 1. While this coat is still tacky, Childers #5 glass fiber reinforcing mesh shall be smoothly applied and pressed into the mastic. The cloth shall be taut with adjacent edges overlapped a minimum of 4".
 - 2. After the first coat of mastic has taken its set, the second coat shall be applied over the cloth by palm, trowel, or spray to sufficient thickness that, when dried, the combined thickness of mastic and cloth is not less than 1/8".
 - 3. Upon completion, the openings in the cloth shall be completely sealed and the yarn shall not be visible. The completed work shall be completely smooth and present a plane surface.
 - 4. Aluminum gray or white finish as approved by the Architect.
- F. Standing water on horizontal surfaces is not approved.
- G. Apply outdoor duct laminated jacketing protection over entire insulation surface. Apply rubberized bitumen compound, applied to a cross-laminated high strength polyethylene film, laminated to aluminum foil.

3.5 GENERAL INSTALLATION

- A. Install materials in accordance with manufacturer's instructions.
- B. Apply insulation on clean, dry surfaces only.
- C. Continue insulation with vapor barrier through penetrations.
- D. Neatly finish insulation at supports, protrusions and interruptions.
- E. Install insulation on clean, dry surfaces, and only after building is weatherproofed sufficiently to preclude any rainwater on insulation.
- F. Apply mastic over the fiberglass reinforcing mesh to a thickness where fabric is not visible after completion.
- G. Install fiberglass blanket duct insulation on top of supply air grilles not fire rated.

END OF SECTION

SECTION 23 23 00

REFRIGERANT PIPING AND APPURTENANCES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install copper tubing, valves, strainers and sight glass for refrigerant piping.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS

- A. Furnish refrigerant piping of Type K hard-drawn copper tubing with sweat-type, wrought copper fittings. Cast fittings are not permitted.

2.2 SERVICE VALVES

- A. Provide angle or globe service valves, with sweat connections. Use packed-type, wrench operated, valves with gasketed seal cap and back seat feature. Furnish valves designed for refrigerant service, in conformance with the ARI code.
- B. Place service valves at the inlet and outlet of each compressor, on both sides of each strainer and solenoid valve, and as otherwise shown and specified.

2.3 SOLENOID VALVES

- A. Furnish pilot-operated, floating-piston solenoid valves suitable for operation with refrigerant.
- B. Use valves with a bronze body and sweat-type connections.
- C. Provide stainless steel stem and plunger assembly and a stainless steel piston.
- D. Furnish sealed and moisture proof solenoid coils.
- E. Use electrical characteristics of 115 volt, 60 Hertz.

2.4 SIGHT GLASSES

- A. Provide suitable moisture and liquid sight glass in the liquid line leaving the condenser or receiver.

2.5 FILTER DRYER

- A. Furnish replaceable core liquid line filter dryer.
- B. Provide filter dryer constructed to permit the removal of the core element without removing the filter dryer from the line.

PART 3 - EXECUTION

3.1 BRAZING

- A. During the brazing process, dry nitrogen shall be purged through the tubing to prevent oxides from forming.

3.2 PRESSURE TEST

- A. After refrigeration and piping system items are installed, charge the system with dry nitrogen and test to 450 psig.
 - 1. Test joints with a Halide torch or an electronic leak detector.
 - 2. Repair leaks and retest each system until proved tight.

3.3 EVACUATION AND DRYING

- A. After refrigerant system has been pressure-tested, connect a suitable vacuum pump and evacuate piping system, including lines and equipment.
 - 1. Maintain a vacuum as high as practicable for long enough to evaporate the moisture in the system (at least 48 hours).
 - 2. Check the humidity within the system with a wet bulb indicator, and maintain the vacuum until the wet bulb temperature is reduced to -40°F. After the system has been evacuated and dried, break the vacuum by charging proper refrigerant into the system.

3.4 PIPE SIZE

- A. Pipe shall be routed and sized per condensing unit manufacturer's instructions.

END OF SECTION

SECTION 23 31 13

DUCTWORK

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Duct construction, support and accessories. Dimensions shown on the drawings are free area dimensions.

1.2 RELATED WORK

- A. Division 23 Mechanical
 - 1. Air Devices
 - 2. Air Handling Units
 - 3. Insulation

 - 7. Packaged Rooftop Air Conditioners
 - 8. Testing, Balancing and Adjusting (TAB) of Environmental Systems
- B. Division 9 – Finishes, Painting and Color Coding

1.3 QUALITY ASSURANCE

- A. The intent of ductwork specifications is to obtain superior quality workmanship resulting in an installation that is absolutely satisfactory in both function and appearance. Provide ductwork in accordance with the specifications for each type of service.
- B. An approved contractor for this work under this division shall be:
 - 1. A specialist in this field and have the personnel, experience, training, skill, and the organization to provide a practical working system.
 - 2. Able to furnish evidence of having contracted for and installed not less than 5 systems of comparable size and type that have served their owners satisfactorily for not less than 5 years.

1.4 GUARANTEE

- A. Guarantee ductwork for 1 year from the date of substantial completion. The guarantee covers workmanship, noise, chatter, whistling, or vibration. Ductwork shall be free from pulsation under conditions of operation.

1.5 CONTRACTOR COORDINATION

- A. Erect ducts in the general locations shown, but conform to structural and finish conditions of the building. Before fabricating any ductwork, check the physical conditions at the job site and make necessary changes in cross sections, offsets, and similar items, whether they are specifically indicated or not.
- B. Coordinate location of ductwork with structural members and Architectural drawings and requirements.

1.6 SHOP DRAWINGS AND SAMPLES

- A. Submit shop drawings of all ductwork layouts, including enlarged plans and elevations of all air handling equipment, and submit details of duct fittings, including particulars such as gauge sizes, welds, and configurations prior to starting work.

- B. Submit product data and sealing materials to be used.
- C. Submit sound attenuation data.
- D. Submit shop drawings in plan, elevation and sections, and three-dimensional view showing equipment in mechanical equipment areas.

PART 2 - PRODUCTS

2.1 STANDARDS AND CODES

- A. Except as otherwise indicated, sheet metal ductwork material and installation shall comply with the latest edition of SMACNA HVAC Duct Construction Standards. Air distribution devices (such as dampers) included in this specification shall comply with the latest applicable SMACNA Fire, Smoke and Radiation Damper Installation Guide for HVAC Systems and NFPA 90A.

2.2 DUCT MATERIAL AND CONSTRUCTION

- A. Except for the special ducts specified below use lock forming quality prime galvanized steel sheets or coils up to 60" wide. Stencil each sheet with gauge and manufacturer's name. Stencil coils of sheet steel throughout on 10' centers with gauge and manufacturer's name. Provide certification of duct gauge and manufacturer for each size duct.
- B. Rectangular low and medium pressure duct constructed of sheet metal in accordance with the latest edition of SMACNA HVAC Duct Construction Standards.
- C. Low pressure round ducts shall be shop fabricated with snap lock longitudinal seams. Ducts shall be constructed for a minimum of 2" w.g. static pressure.

2.4 DUCT SEALING OF SEAMS AND JOINTS

- A. Follow seal classification as indicated in Table 1-2 of SMACNA "HVAC AIR DUCT LEAKAGE TEST MANUAL". Use seal class A for 4" w.g. static. All longitudinal and transverse joints and seams shall be sealed by use of a fireproof, non-hardening, and non-migrating elastomeric sealant. With the exception of continuously welded joints and machine made spiral lock seams, joints and seams made air tight with duct sealer.
 - 1. Indoor applications – Foster 32-14.
 - 2. Outdoor applications – Foster 32-17.

2.5 FLEXIBLE DUCT LOW PRESSURE

- A. Construction:
 - 1. Continuous galvanized spring steel wire helix, with reinforced metalized cover
 - a. The fabric shall be mechanically fastened to the steel helix without the use of adhesives.
 - 2. UL 181 Class I air duct label.
 - 3. Reinforced vapor barrier jacket.
 - 4. Rated for use at system pressure (6" wc minimum).
 - 5. Flexible duct connections from lateral taps to variable volume boxes or terminal boxes shall be rated at twice the maximum pressure rating of the medium pressure system.
- B. Fire hazard classification:
 - 1. Flame spread rating 25 maximum.

- 2. Smoke developed rating 50 maximum.
- C. Thermal characteristics:
 - 1. R-6 BTU/hr/sq. ft./°F (when located in a conditioned plenum).
 - 2. R-8 BTU/HR/Sq.Ft./°F (when located in an unconditioned plenum).
 - 3. 2" minimum wall thickness insulation with 1" overlap.
- D. Acceptable manufacturers:
 - 1. Flexmaster.
 - 2. Hart & Cooley.
 - 3. Omniair.
 - 4. Peppertree Air Solutions.

2.6 FLEXIBLE DUCT MEDIUM/HIGH PRESSURE

- A. The duct shall be constructed of a heavy coated fiberglass cloth fabric supported by helical wound galvanized steel. The fabric shall be mechanically fastened to the steel helix without the use of adhesives.
- B. The internal working pressure rating shall be at least as follows with a bursting pressure of at least two times the working pressure:
Positive: 12" w.g.
Negative: 5" w.g.
- C. The duct shall be rated for a velocity of at least 5500 fpm.
- D. Suitable for operating temperature range of -20°F to +250°F.
- E. Factory insulate the flexible duct with fiberglass insulation.
 - 1. R-6 BTU/hr/sq. ft./°F (when located in a conditioned plenum).
 - 2. R-8 BTU/HR/Sq.Ft./°F (when located in an unconditioned plenum).
 - 3. 2" minimum wall thickness insulation with 1" overlap.
- F. Cover the insulation with a fire retarding polyethylene vapor barrier jacket having a permeance of not greater than 0.10 perms when tested in accordance with ASTM E96, Procedure A.
- G. Acceptable manufacturers:
 - 1. Flexmaster.
 - 2. Omniair.
 - 3. Peppertree Air Solutions.

2.7 FIRE DAMPERS

- A. Fire dampers for required wall ratings that are 95% minimum free area. Provide Type B or Type C UL dampers for low, medium and high-pressure rectangular, square or round ducts. Dampers shall be activated by a fusible link designed to react at 165°F. Install per manufactures recommendations to provide a UL assembly. Provide sealed sleeve to meet desired leakage performance.
- B. Acceptable Manufacturers:
 - 1. Ruskin.
 - 2. Prefco Products.
 - 3. Air Balance.
 - 4. Greenheck, Inc.
 - 5. Nailor Industries.

6. Pottoroff.

2.12 FLUES FOR ATMOSPHERIC BOILERS AND WATER HEATERS

A. Type B, round or oval, double-wall vent pipe, equal to Metalbestos or Metal-Fab, including accessories such as vent caps by the same manufacturers. Use oval vent where necessary to fit in wall construction. All exterior components shall be 304 stainless steel for outdoor installations.

2.8 FLUE CAPS

A. Stainless steel flue caps of a design so that wind action from any direction will create a vacuum in the flue. Caps as manufactured by Breidert or equal are acceptable. Refer to installation details on drawings.

2.9 DUCT LINING

A. Duct lining shall be 1" thick, 1-1/2 lb. density, flexible lining coated on the air stream side to reduce attrition. Liner shall be Schuler Lina-Coustic, Certain-Teed Ultralite, or equal meeting requirements of NFPA 90-A. Provide I.A.Q. rated liner.

2.10 CONTROL DAMPERS

A. Opposed blade dampers for 2-position and modulating control. Construct frames of 13-gauge galvanized sheet metal with provisions for duct mounting. Damper blades not exceeding 8" in width, of corrugated-type construction, fabricated from two sheets of 22-gauge galvanized sheet metal spot-welded together or a single 16-gauge sheet. Make bearings of nylon or oil-impregnated, sintered bronze. Make shafts of 1/2" zinc-plated steel. Blades suitable for high velocity performance. Construct damper so that leakage does not exceed 1/2% based on 2000 fpm and 4" static pressure. Provide replaceable resilient seals along top, bottom and sides of frame and along blade edge. Submit leakage and flow characteristics data with shop drawings. Linkage shall be concealed out of the air stream within damper frame to reduce pressure drop and noise.

B. Acceptable Model is Ruskin Model CD60.

2.11 VOLUME DAMPERS

A. Manual balancing dampers that meet or exceed the following minimum construction standards:

1. Frame 16-gauge.
2. Blades 16-gauge.
3. Bearings corrosion resistant.
4. Concealed linkage.
5. Opposed blade dampers.

B. Acceptable manufacturer:

1. Ruskin Model MD-35 or approved equal, by
2. Arrow.
3. American Warming and Ventilating.
4. Nailor Industries.
5. Pottoroff.

2.12 ACCESS DOORS

A. Round spin-in door of galvanized steel.

1. Fire proof sealing gaskets and quick fastening locking devices
2. Insulated door

3. Conform to the requirements of the NFPA.
4. Identification and use of each access door.
5. UL label to match the construction in which it is installed.
6. Cable attached to door and outer frame.
7. Low leakage Access Door.

- B. Acceptable Manufacturer
1. Flex master, Inspector Series.
 2. Approved Equal.

2.13 SMOKE DAMPERS

- A. Smoke dampers meeting the following requirements.
1. Each smoke damper shall be classified by Underwriters Laboratories as a leakage Rated Damper for use in smoke control systems under the latest version of UL555S, and bear a UL label attesting to same. The damper manufacturer shall have tested, and qualified with UL, a complete range of damper sizes covering all dampers required by this specification. Testing and qualifying a single damper size is not acceptable. The leakage rating under UL555S shall be Leakage Class II.
 2. The damper frame shall be a minimum of 16 gauge, galvanized steel, formed into a structural hat channel shape with tabbed corners for reinforcement, as approved in testing by Underwriters Laboratories. Bearings shall be integral high surface area non-electrolytic materials construction to incorporate a friction free frame blade lap seal, or molybdenum disulfide impregnated stainless steel or bronze oilite sleeve type turning in the damper frame. The dampers shall be opposed blade type. The blades shall be constructed with a minimum of 16 gauge, galvanized steel. The blade edge seal material shall be able to withstand 450°F. The jamb seals shall be flexible stainless steel compression type.
 3. As part of the UL qualification, dampers shall have demonstrated a capacity to operate (open and close) under HVAC system operation conditions, with pressures of at least 4" water gauge in the closed position, and 2,000 fpm air velocity in the open position.
 4. Provide UL555S qualified electric actuator at 120 VAC.
 5. Provide air-foil type blades.
- B. Provide integral sleeves.
- C. Acceptable Manufacturers:
1. Ruskin
 2. Air Balance, Inc.
 3. Greenheck, Inc.
 4. Nailor Industries
 5. Pottoroff

2.14 DIFFUSER FITTINGS LOW PRESSURE TAPS

- A. Fitting shall meet or exceed the following minimum construction standards:
1. Conical with a base diameter two inches larger than the tap diameter.
 2. Construct fitting and damper of galvanized steel in accordance with ASTM A 527, G90 finish.
 - a. Fitting with a 3/16-inch high stop bead approximately 2-1/2-inches from the discharge end of the fitting
 - b. Provide the fitting with a butterfly damper, damper rod, end bearings and heavy duty locking quadrant.
 - c. Size the length of the straight section of the fitting to match the damper blade diameter. Center the damper blade in the straight section.

3. Match the fitting body gauge to the SMACNA duct gauge, but not less than:
 - a. Through 8 inches: 26 gauge; Damper blade 22 gauge.
 - b. 10 inches and 12 inches: 24 gauge; Damper blade 22 gauge.
 - c. 14 inches and 16 inches: 22 gauge; Damper blade 22 gauge.
 - d. 18 inches and 20 inches: 20 gauge; Damper blade 20 gauge.
4. Fasten damper blade to a 3/8 X 3/8 continuous square rod with minimum (2) galvanized U-bolts.
5. Support the damper rod to the fitting with airtight nylon end bushings / bearings.
6. Provide the damper with a self-locking regulator and handle.
7. Provide a 2" sheet metal stand-off to extend the regulator.
8. Flex duct grip area – 2 inches behind retaining bead.
9. Flex duct retaining bead – 1 inch from end.
10. Conical length of at least 3 inches.
11. Barrel length of at least 9 inches.

2.15 AUXILIARY DRAIN PANS

- A. Galvanized steel, same gauge and same bracing or cross breaks as a duct with same dimensions. Sides of pan turned up to 1-1/2", all joints soldered watertight. Pan is to be large enough to complete cover drip lines of unit.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Use construction methods and requirements as outlined in SMACNA HVAC Duct Construction Standards as well as SMACNA Balancing and Adjusting publications, unless indicated otherwise in the specifications. Refer to details on the drawings for additional information.
- B. Reinforce ducts in accordance with recommended construction practice of SMACNA. Provide additional reinforcement of large plenums as required to prevent excessive flexing and or vibration.
- C. Cross break or bead sheet metal for rigidity, except ducts that are 12" or less in the longest dimension.
- D. Where ducts pass through walls in exposed areas, install suitable escutcheons made of sheet metal angles as closers.
- E. At locations where ductwork passes through floors, provide watertight concrete curb around penetration.
- F. Support ducts where passing through floors with galvanized steel structural angles of adequate bearing surface.
- G. Metal or lined ductwork exposed to view through grilles, registers, and other openings shall be painted flat black. Do not install grilles, registers, or similar items until painting is complete.
- H. Fire Dampers shall be installed per manufacturer's recommendations to create a UL rated assembly.
- I. Install end bearing at all location where damper shaft penetrates duct wall.
- J. Clean duct to remove accumulated dust. Ducts shall be closed on ends between phases of fabrication to assure that no foreign material enters the ducts.

3.2 DUCTWORK

- A. Construct rectangular ducts and round ducts in accordance with the latest SMACNA HVAC Duct Construction Standards. Use the static pressure specified on the air handling unit schedule or fan schedules as a minimum for duct construction. All ductwork between the variable volume air handling units and the terminal units shall be constructed to the medium pressure ductwork specification.
- B. Provide adjustable, galvanized splitter-dampers, pivoted at the downstream end with appropriate control device at each supply duct split.
- C. For branch ducts wider than 18", and when shown on drawings provide extractors with an appropriate control device at each rectangular zone or branch supply duct connection. Provide controllers for extractors. Branch ducts shall have a 45° angle in the direction of flow. Do not provide extractor at branch ducts to sidewall registers where the registers are within 10 feet of the main duct.
- D. Shop manufactured curved blade scoops may be used for branch duct takeoffs up to 18" wide. Taper scoop blade to the end, to prevent any sagging that may cut into, or damage duct liner if specified during operation.
 - 1. Construct shop manufactured scoops and splitter blades of galvanized sheet metal 2 full gauges heavier than equivalent sheet metal gauge of branch duct (up to 16 gauge).
 - 2. Check extractors, scoops and splitter blades thoroughly for freedom of operation. Oil bearing points before installing.
- E. Use pushrod operator with locking nut and butt hinges assembly.
- F. Provide opposed-blade volume dampers with an appropriate control device in each of the following locations:
 - 1. Return air ductwork
 - 2. Outside air branch duct
 - 3. Exhaust branch duct
 - 4. Exhaust connections to hoods except kitchen grease hoods or equipment
 - 5. In each zone at multi-zone unit discharge installed downstream of duct mounted re-heat coils
 - 6. At each outside air and return air duct connection to plenum of constant volume units
 - 7. At discharge side of constant volume boxes
 - 8. Where otherwise indicated or required for balancing coordinate location of additional dampers required by TAB Contractor.
 - 9. Provide multi-blade dampers when blade width exceeds 12". Provide end bearing where damper shaft penetrates duct wall.
- G. Elbows:
 - 1. Rectangular: Where square elbows are shown, or are required for good airflow, provide and install single-wall or airfoil turning vanes. Job-fabricated turning vanes, if used, shall be single-thickness vanes of galvanized steel sheets of the same gauge metal as the duct in which they are installed. Furnish vanes fabricated for the same angle as the duct offset. The use of radius elbows with a centerline radius of not less than 1-1/2 times the duct width may be provided in lieu of vaned elbows where space and air flow requirements permit.
 - 2. Round Oval Duct. Provide elbows with a centerline radius of 1-1/2 times the duct diameter or duct width. For round ducts, furnish smooth elbows or 5 piece, 90° elbows and 3 piece, 45° elbows.

- H. For control devices concealed by ceilings, furring, or in other inaccessible locations, furnish extension rods and appropriate recessed-type Young regulators, mounted on the surface of the ceiling or the furring, unless specified, or shown otherwise. Provide with chrome plated cover plates. Use only one mitered gear set for each control device.
- I. Install streamline deflectors at any point where dividing a sheet metal duct around piping or where other such obstruction is permitted. Where such obstructions occur in insulated ducts, fill space inside streamliner and around obstructions with glass fiber insulation.
- J. Insulated Flexible Duct:
 - 1. Install in accordance with manufacturer's instructions, and the terms of its UL listing. Duct shall not exceed 6' in length. Make connections by use of sheet metal collars and stainless steel circular screw clamps. Clamps shall encircle the duct completely and be tightened with a worm gear operator to the point that will provide an airtight connection without unnecessary deformation of the duct. Provide one clamp on flexible duct and one clamp on external insulation. Vapor barrier jacket shall be tucked inside to conceal insulation material.
 - 2. Construct bends over 45° with sheet metal elbows.
- K. Duct Supports:
 - 1. Horizontal ducts up to 40". Support horizontal ducts up to and including 40" in their greater dimension by means of #18 U.S. gauge galvanized iron strap hangers attached to the ducts by a minimum of two locations per side by means of screws, rivets or clamps, and fastened to inserts with toggle bolts, beam clamps or other approved means. Place supports on at least 8' centers. Use clamps to fasten hangers to reinforcing on sealed ducts.
 - 2. Horizontal ducts larger than 40". Support horizontal ducts larger than 40" in their greatest dimension by means of hanger rods bolted to angle iron trapeze hangers. Place supports on at least 8' centers in accordance with SMACNA Standards.
 - 3. Support vertical ducts where they pass through the floor lines with 1-1/2" x 1-1/2" x 1/4" angles for ducts up to 60". Above 60", the angles shall be increased in strength and sized on an individual basis considering space requirements.
 - 4. Supports shall be suspended from structural or by independent support. Do not support from structural bridging. Upper attachments should be selected with a safety factor of 4 or 5 times actual load conditions and subject to Engineers approval. Double wrap straps over open web of joist.
- L. Branch connections for medium pressure ductwork shall be made with a conical lateral. Field installed conical branch ducts shall be minimum 20-gauge galvanized sheet metal, "Everdur" welded and coated with "Galvabar".

3.3 PLENUMS

- A. Return air plenums shall be rectangular galvanized sheet metal ductwork.
- B. Fabricate plenums upstream of fan of 16-gauge material.
- C. Fabricate plenums upstream of filters minimum 18-gauge material.

3.4 FLEXIBLE CONNECTIONS

- A. Where ducts connect to fans or air handling units that are not internally isolated, make flexible airtight connections using "Ventglas" fabric. The fabric shall be fire-resistant, waterproof and mildew resistant with a weight of approximately 30 ounces per square yard. Provide a minimum of 1/2" slack in the connections, and a minimum of 2-1/2"

distance between the edges of the ducts. Also, provide a minimum of 1" slack for each inch of static pressure on the fan system. Fasten fabric to apparatus and to adjacent ductwork by means of galvanized flats or draw bands. Where connections are made in outdoor locations, seal fabric to metal with mastic.

3.5 ACCESS DOORS

- A. Install ductwork access doors as noted below, arranged for convenient access. Stencil each door for specific use. Install access doors in each of the following locations:
 - 1. Fire Dampers.
 - 2. Smoke Dampers.
 - 3. Smoke/fire Dampers.
 - 4. Outside Air Dampers.
 - 5. Duct Mounted Coils (up-stream).
 - 6. Control Dampers.
- B. Size access door 1" smaller than ductwork.
 - 1. Available Sizes: 8", 10", 12", 18", 24".
- C. Construct access door air tight, and conform to recommendations of NFPA and SMACNA.
- D. Demonstrate suitability of access for the intended purpose. Install multiple access doors as required.

3.6 DUCT LINING

- A. Install glass fiber acoustical lining where shown on drawings. Secure to duct surfaces with Foster 85-62 / 85-60 or Childers CP-125-1 / CP-127 adhesive and sheet metal fasteners on 12" centers. Coat exposed edges and leading edges of cross-joints with adhesive.
- B. Provide metal nosing that is either channeled or "Z" profiled or are integrally-formed from the duct wall securely installed over transversely oriented liner edges facing the air stream at fan discharge and at any interval of lined duct preceded by unlined duct.
- C. Refer to Insulation & Liner Detail on drawings for locations requiring liner to be installed.
- D. Do not install liner in multi-zone unit ductwork.

3.7 SEALING OF SEAMS AND JOINTS

- A. Seal supply, return, exhaust and outside air duct systems.

3.8 FLUES

- A. Provide and install flues for all gas fired equipment.
- B. Refer to plans for all related locations.
- C. Contractor is responsible for coordinating stack sizing, stack drains, stack test ports, stack termination fittings and all other required fittings with the selected equipment manufacturers.
- D. All fittings and accessories shall be manufactured by the flue manufacturer. The flue shall be installed per manufacturer's instruction.

- E. Terminate flues at height above roof to prevent flue gas from entering the building.

3.9 AUXILIARY DRAIN PANS

- A. Where coils that have a condensate drain are located above ceiling.

3.10 TESTING OF LOW PRESSURE DUCTWORK

- A. Test ductwork for leaks before concealing. Maximum allowable leakage is 5% of total airflow.
- B. Provide equipment necessary for performing tests, including rotary blower large enough to provide required static pressure at allowed CFM quantity, certified orifice section with proper papers, traceable serial numbers and pressure vs CFM leakage rate scale, U-tube gauge board complete with cocks, tubing, and inclined manometer for leakage rates.
- C. Mains: Test mains after risers and branches are tied in and all equipment set. Close runout connections and place fan in operation. Provide pressure in mains at 1-1/2 times design pressure. Visually inspect joints. Repair leaks detected by sound or touch. Release mains for completion after joints are tight.
- D. Ductwork down stream of terminal boxes, return, exhaust, and outside air ducts are to be visually inspected.

END OF SECTION

SECTION 23 37 13

AIR DEVICES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install air distribution devices, including grilles, diffusers, registers, dampers, and extractors.

1.2 RELATED WORK

- A. Division 23 Mechanical.
 - 1. Ductwork.
 - 2. Testing and Balance.
 - 3. Electrical Requirements for Mechanical Work.

1.3 COOPERATION WITH OTHER TRADES

- A. Coordinate this work with work under Division 26 Electrical, to ensure that intended functions of lighting and air systems are achieved.

1.4 SUBMITTALS

- A. Submit product data for outlets, grilles, registers, control devices, and similar equipment for review prior to placement of purchase order.
- B. Submittal shall include performance sheet for each air device type. Performance sheet shall include NC levels, throw, and total pressure loss at various air flows.

1.5 FINISHES

- A. Paint exposed devices with factory standard prime coat, or factory finish coat, as specified.

PART 2 - PRODUCTS

2.1 DIFFUSERS, GRILLES AND REGISTERS - Refer to Drawing Schedule.

2.2 ACCEPTABLE MANUFACTURERS

- A. Titus.
- B. Krueger.
- C. Nailor Industries.
- D. Price.
- E. Metal-Aire.

2.3 ACCESSORIES

- A. Supply Grille Extractors. Provide supply grilles with an air control device capable of positively regulating the volume of air extracted from the supply duct.

Select extractors similar to Titus Model AG25, tight-closing in the minimum position. Include a key-operated or worm-gear adjusting mechanism to facilitate positioning from the grille opening. Where adjustment is not accessible at the grille opening, provide a square control rod equipped with a locking quadrant.

- B. Mounting Frames. Provide each grille or register not equipped with a removable core with a companion, all-purpose mounting frame constructed like grille frame to facilitate installation and removal of the grille or register without marring adjacent mounting surfaces.
 - 1. Furnish frames with 1/2" thick sponge rubber gasket to prevent air leakage.
 - 2. Provide a frame that neatly fits the grille. Mounting frames will not be required for grilles or registers mounted directly on exposed ductwork.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Do not install ceilings adjacent to fixtures until installation of fixtures, air supply assemblies, return-air blank-off strips and flexible duct have been approved. Remove and reinstall any part of the installation found incorrect.

3.2 INSTALLATION

- A. Louvered diffuser outlets mount tight against the ceiling. Fasten outlets to ductwork with sheet metal screws. For perforated diffusers, attach the frame assembly by a concealed hinge assembly to an outer frame compatible with the type of ceiling on which the diffuser is installed.

END OF SECTION

SECTION 23 41 00

AIR FILTRATION

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install air filters.

1.2 SUBMITTALS

- A. Submit manufacturer's product data sheets and capacity information as specified.
- B. Submit recommended Dirty Filter pressure drop.

PART 2 - PRODUCTS

2.1 AIR FILTERS

- A. The filter cells:
 - 1. Disposal media and frame.
 - 2. Coated with high flash point adhesive.
- B. Resistance to air flow of a clean filter not to exceed 0.12" WG at 300 fpm.
- C. UL listed Class II rated.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install the filters and filter gauges in accordance with the manufacturer's instructions.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 23 63 00

AIR-COOLED CONDENSING UNITS

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install air-cooled condensing units complete with casing, compressor, condenser coil, condenser fan and controls required for a split air conditioning system.

1.2 RELATED WORK

- A. Refrigerant Piping.
- B. Electrical Provisions of Mechanical Work.

1.3 PERFORMANCE

- A. Provide performance as scheduled on drawings, and head pressure control to enable unit to operate in temperatures as low as 20 degrees F. ambient.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Carrier.
- B. Daikin.
- C. York.
- D. Lennox.

2.2 COMPRESSOR

- A. Provide a hermetic or semi-hermetic compressor with crankcase heaters, inherently protected motors, spring mounts and capacity modulation. Provide each compressor with a 5-year warranty.

2.3 CONDENSER COILS

- A. Provide copper tubes with mechanically bonded aluminum fins. Protect condenser coils with a heavy gauge, corrosion resistant wire guard.

2.4 FANS AND MOTORS

- A. Provide propeller-type fans with direct drive or belt drive and vertical discharge. Protect fan with a heavy-gauge, corrosion resistant wire guard. Provide inherently protected, permanently lubricated, and weatherproof motors.

2.5 CASING

- A. Furnish a unit designed for outdoor mounting. Fabricate the casing of heavy gauge steel, zinc coated and finished with enamel. Provide removable access panels.

2.6 CONTROLS

- A. Provide safety and operating controls factory wired and mounted in a separate enclosure. Include thermostatic expansion valve, high and low pressure switches and compressor motor overload devices. Furnish a time delay device to prevent short cycling. Employ a control transformer, a pressure relief device and suction and discharge valves with service connections.

2.7 THERMOSTAT

- A. Low voltage, 7-day programmable thermostat is a component of the unit manufacturer unless specified in another Section.
 1. Individual Heating/Cooling setpoints.
 2. Automatic Heat/Cool change-over.
 3. Sub-Base On-Off-Auto fan selection.
 4. Sub-Base Heat-Off-Cool-Auto system selection.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Mount condensing units on 4" foundation pads and pipe as shown on Drawings or as recommended by the equipment manufacturer. Install removable core refrigerant filter dryer and sight indicating glass.

3.2 CONTROL WIRING

- A. Furnish and install control wiring as required. Install control wiring in conduit.

END OF SECTION

SECTION 23 81 21

SINGLE PACKAGE ROOFTOP AIR CONDITIONERS (w/gas-fired heat)

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide and install a single-package, single-zone, electric air conditioner with gas-fired heat for rooftop application.

1.2 RELATED WORK

- A. Division 23 Mechanical.
 - 1. Ductwork.
 - 2. Test and Balance.
 - 3. Electrical provisions for mechanical work.
 - 4. Air Filtration.

1.3 PERFORMANCE

- A. As scheduled on drawings, with head pressure control to enable unit start and operate down to 20 degrees F ambient.

1.4 SUBMITTALS

- A. Manufacturer's certified capacity data.
- B. Submit manufacturer's installation, start-up and service instructions.
- C. Submit recommended clearance dimensions for air flow and service.
- D. Submit coordination drawings as specified. Consideration shall be given to adjacent structures and their effect on air flow patterns.
- E. Submit internal wiring diagram of Control Center.
- F. Submit sequence of operation in narrative form.
- G. Mark-up a copy of the specifications indicating in the margin of each paragraph the following: COMPLY, DO NOT COMPLY, NOT APPLICABLE.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Carrier.
- B. York.
- C. Lennox.

2.2 COMPRESSOR

- A. Provide a thermally protected, serviceable semi-hermetic compressor or hermetic compressor with service valves, vibration isolation, crankcase heaters, slight glass and filter

drier. Provide with a 5 year warranty.

2.3 EVAPORATOR AND CONDENSER COILS

- A. Provide copper tubes with mechanically bonded aluminum fins for evaporator and condenser coils.
- B. Provide hail guards for condenser coils.

2.4 EVAPORATOR FANS

- A. Provide a belt-driven, forward-curved, centrifugal evaporator fan, with adjustable motor sheaves. Motor shall contain permanently lubricated bearings. Provide motor HP as indicated on the drawings.

2.5 GAS HEATING SECTION

- A. Unit shall be equipped with corrosion resistant burners and heat exchangers.
- B. Gas Controls.
 - 1. Automatic gas valve and pressure regulator.
 - 2. A manual shutoff valve.
 - 3. Pilot valve.
 - 4. Two flame rollout limit switches.
 - 5. An adjustable fan control.
 - 6. Fixed high limit controls
- C. Unit shall be equipped with an electric spark pilot ignition system.
 - 1. Electronic flame detection.
 - 2. 100% safety shutoff.
- D. Combustion air shall be induced by a positive pressure power venting fan.
 - 1. Prepurge of combustion chamber.
- E. Furnish through-the-bottom electrical service connection.

2.6 CASING FILTERS AND DUCT CONNECTION

- A. Provide a cabinet constructed of galvanized or zinc-coated steel, primed and coated with baked enamel and suitable for outdoor installation.
- B. Provide duct connections on the bottom of each unit, as indicated on drawings.
- C. Provide manually operated outdoor air dampers.
- D. Furnish 2" thick MERV8 filters as specified.
- E. Furnish through-the-bottom electrical service connection.

2.7 ROOF CURB

- A. Install a roof curb of the same manufacture as the air conditioning unit.
 - 1. Curb to support the unit and provide a watertight enclosure to protect ductwork and utility services.
 - 2. Use a design complying with National Roofing Contractors Association requirements.

3. Level curb according to manufacturer's recommendations.
4. The assembly of the unit and roof curb shall be rated for 150 MPH winds. Provide engineered drawings certifying this requirement is met.

2.8 OUTDOOR FANS

- A. Provide propeller type with direct-driven permanently lubricated motor. Fan shall discharge upward.

2.9 THERMOSTAT ASSEMBLY

- A. Provide staged heating and cooling as required, automatic changeover and fan control.

2.10 HEAD PRESSURE CONTROL

- A. Provide solid state outdoor air fan speed control to permit unit to operate down to -20°F.

2.11 SHORT CYCLE CIRCUIT

- A. Provide circuit to prevent compressor from short cycling as a result of a rapid change in thermostat setting. Circuit also prevents compressor restart at least 5 minutes after shutdown.

2.12 CONVENIENCE OUTLET

- A. Provide 115 volt outlet in unit cabinet.

2.13 MOTORIZED OUTSIDE AIR DAMPER

- A. Low leakage 14-gauge galvanized steel
 1. Airfoil Blades.
 2. Ruskin CD60.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install according to manufacturer's recommendations and as shown on drawings.
- B. Unit is to be provided with a through-the-bottom service connection accessory package and must be used for electrical connections to unit. Use bulkhead connectors to make a waterproof connection.
- C. Seal all duct connections to roof curb for air tight connection. Install a 90 degree flanged ductwork connection to the roof curb. Provide and install gasketing around duct flanges. Provide and install gasketing around outer edge of roof curb.

3.2 STARTUP

- A. Provide the services of a factory trained service technician employed full time by the unit manufacturer to start-up the system, or manufacturer's factory authorized representative under the supervision of the factory trained service technician. Upon completion of the installation, the system shall be started and commissioned by the manufacturer's factory authorized representative who will verify a complete fully functional system. The factory authorized representative will verify that accessories are installed and performing the specified functions. (Contractor startup is unacceptable.)

- B. The written startup report shall be provided to the owner and engineer upon completion.

END OF SECTION

SECTION 23 82 23

GAS FIRED FURNACE WITH DX EVAPORATOR

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Floor mounted high efficiency gas fired furnace with DX evaporator configured for a horizontal installation.

1.2 RELATED WORK

- A. Division 23 Mechanical
 - 1. Test and Balance.
 - 3. Electrical Provisions of Mechanical Work.
 - 4. Ductwork.
 - 5. Air filtration.

1.3 REFERENCES

- A. ANSI/AHRI 410 - force circulation air cooling and air heating coils.
- B. National Electrical Code.

1.4 SUBMITTALS

- A. Submit manufacturer's dimensioned product data sheets.
 - 1. Show location of filter access doors.
- B. Submit fan performance curve for each unit:
 - 1. Plot fan volume against static pressure, horsepower and efficiency.
 - 2. Show point of rating based on static requirements of the system.
- C. Submit the fan performance plot at each motor speed position with consideration for the reduced internal static.
- D. Submit a chart of specific sound power level at each octave band center frequency.
- E. Submit manufacturer's certified heating and cooling coil capacity data.
- F. Submit filter manufacturer's product data sheets and capacity information.
- G. Submit manufacturer's data on housing insulation material.

1.5 CAPACITY

- A. Refer to equipment schedule.

1.6 WARRANTY

- A. Provide a full parts and labor warranty for a period of one year. Warranty shall start the date of the substantial completion certificate. Warranty shall be provided by manufacturer only.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Carrier.
- B. Lennox.
- C. York.

2.2 COMPONENTS

- A. Direct Expansion coil section.
- B. Fan section with a direct drive blower.
- C. Gas fired furnace section.
- D. Filter section.
- E. Insulated sheet metal cabinet with removable panels for access to the interior.

2.3 DIRECT EXPANSION EVAPORATOR SECTION

- A. Coil module shall be designed for either a vertical or horizontal installation as indicated on drawings.
- B. Reference Schedule and Specification Section 23 82 16.
- C. Coil module shall be designed to avoid condensate blow off and moisture carry over into ductwork.
- D. Coil shall be provided with a corrosion resistant IAQ style drain pan.

2.4 FAN SECTION AND GAS FIRED FURNACE

- A. Locate the motor and drive assembly inside the cabinet.
- B. Fan motor shall be a multi-speed direct drive ECM type with integrated vibration isolation.
- C. Select the fan motor so that the brake horsepower required to deliver the design air quantity at the system static pressure will not exceed the motor nameplate amperage rating.
- D. Select fan to operate at or near its maximum efficiency point when handling the required air quantity and static pressure.
- E. Furnace shall be a pilot free, hot surface power heat ignition with single stage operation. Induction motor shall be a fixed speed motor.
- F. Primary heat exchanger shall be an aluminized steel clamshell design and the secondary heat exchanger shall be a stainless steel fin and tube design.
- G. Direct vent, sealed combustion, condensing type AGA certified for use with [natural] [propane] gas. Minimum annual fuel utilization efficiency (A.F.U.E.) of 91. All ratings are to be certified by GAMA. All wiring shall comply with the National Electrical Code.

- H. Construct primary heat exchanger of aluminized steel. Construct secondary heat exchanger of stainless steel with aluminum fins or of polypropylene laminated steel. Aluminized steel multi-port in-shot burner with hot surface or electronic spark ignition, approved for vertical or sidewall venting.
- I. AGA listed gas controls including manual main shut-off valve, double automatic gas valves for redundancy and gas pressure regulator.
- J. Provide solid state integral control unit with all necessary controls and relays including but not limited to:
 - a. Pressure switch for airflow of flue products through furnace and out vent system.
 - b. Rollout switch with manual reset to prevent over temperature in burner area.
 - c. Electronic flame sensor.
 - d. Blower access safety interlock.
 - e. Timed blower start after main burners ignite.
 - f. Factory installed 24 v transformer for controls and thermostat.
 - g. LED's to indicate status and to aid in troubleshooting.
- K. This Contractor shall provide all temperature control and interlocking necessary to perform the specified control sequence. All wiring is to be in conduit in accordance with Division 26 00 00 - Electrical. All relays, transformers and controls are to be in enclosures.
- L. Provide a Honeywell RedLINK Wireless VisionPRO 8000 – TH8110R1008 7 day programmable thermostat with 2 occupied periods per day, automatic changeover, separate heating and cooling set points for both occupied and unoccupied modes. Provide auxiliary controls on sub-base to open minimum outside air damper during occupied mode. Equal to Honeywell model T7300 with Q7300 sub-base. Substitutions will not be accepted.
- M. Provide lockable thermostat guards in public spaces.
- N. During occupied mode run the supply fan continuously, open the outside air damper and cycle the cooling or heating as required to maintain occupied space temperature cooling or heating set point. During unoccupied mode close the outside air damper and cycle the supply fan and cooling or heating as required to maintain unoccupied cooling or heating space temperature set point.

2.5 UNIT CABINET

- A. Construct the unit of 22 gauge steel casing with baked enamel finish or galvanized steel sheets, and formed members.
 - 1. Provide structure to brace the assembly for the pressure of the system.
- d. Cabinet shall be fully internally insulated and be equipped with a noise reduction insulating system.
- D. Insulation, vapor barriers, facings and adhesives:
 - 1. Flame spread not higher than 25
 - 2. Smoke developed rating not higher than 50
- E. Condensation on the exterior of the unit is not approved.

- F. Provide a duct flange on four sides of the return air inlet and supply air outlet of the unit.
 - 1. Sized to permit connection of the flexible connection to the ductwork.
 - 2. Extend beyond the primary drain pan.
 - 3. Minimum dimension 2".
- G. Provide insulated, removable panels for access to the interior.
 - 1. Plated captive screws and nuts.
 - 2. Neoprene gaskets.

2.6 FILTER SECTION

- A. Locate behind access doors.
 - 1. Construct with substantial hinges
 - 2. Neoprene gaskets
 - 3. Permanent quick-release latching devices
- B. Arranged to accommodate the 2" thick MERV 8 minimum disposable filters as specified.
 - 1. Single section filter.
- C. Provide full length tracks to support the filter.

PART 3 - EXECUTION

3.1 SPARE PARTS

- A. Provide the following spare parts and material to the Owner for use after the warranty period.
 - 1. One spare fan motor for each size of fan motor on the project.
 - 2. One spare set of filters or filter media for each fan coil unit on the project.

3.2 ELECTRICAL REQUIREMENTS

- A. Bring electrical connections to a common junction box.

3.3 STORAGE

- A. Storage and shipping in accordance with manufacturer's recommendations.

3.4 INSTALLATION

- A. Install unit so motor connections and filters are accessible.

3.5 FURNACES

- A. Install on concrete housekeeping pad, steel stand or suspend unit from structure as indicated on the drawings. Pipe condensate to floor drain or as indicated on plans.
- B. Provide schedule 40 PVC, ASTM D1785 combustion air and vent piping and fittings with solvent welded joints as indicated on the drawings. Terminate as recommended by the furnace manufacturer.

END OF SECTION

SECTION 26 01 26

FIELD TESTING

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Subject to the General and Special Conditions, this Section includes specifications for testing the complete HVAC replacement.
- B. The addition to the existing electrical system shall be tested by a third party experienced testing company engaged by the Contractor.

1.2 REFERENCES

- A. National Electrical Codes (NEC):
 - 1. NEC Article 110 – Requirements for Electrical Installation.

1.3 SUBMITTALS

- A. Contractor shall provide submittals in conformance with the requirements of the General and Special Conditions and the requirements below.
- B. The name, address and telephone number of the proposed testing company to be engaged for testing of the addition to the existing electrical system, together with their references and samples of recent test results and reports.

1.4 QUALITY ASSURANCE

- A. All work, equipment and materials shall be protected at all times. The Contractor shall make good all damage caused either directly or indirectly by his workmen. Work shall be properly protected to prevent obstruction or damage. All equipment shall be tightly covered and protected against dirt, water, chemical and mechanical injury. At the final completion, all work shall be thoroughly cleaned and delivered in perfect condition.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS / PRODUCTS

- A. Subject to compliance with these specifications, include those manufacturers listed below and with item specifications or approved substitution unless otherwise shown.

2.2 MATERIALS, EQUIPMENT AND PERSONNEL

- A. The Contractor shall provide the following:
 - 1. Qualified personnel to conduct all testing.
 - 2. Labor, temporary power, lighting and wiring and materials required for testing.
 - 3. Submit nameplates and label legends as required for approval by the Chief Engineer. All abbreviations and titles shall be checked for clarity.
- B. Test Equipment: The Contractor shall furnish all test equipment that shall include but not be limited to the following:
 - 1. Submit nameplate and label legends to be approved by the Chief Engineer. Abbreviations and titles must be checked for clarity.
 - 2. Wet and dry bulb thermometer.

3. A 500-volt megger by James G. Biddle Co., or Associated Research, Inc., or approved substitute.
 4. Portable radios.
 5. A Simpson Model 260 Volt-Ohm-Millimeter, or approved substitution.
 6. A phase sequence and rotation meter 60-300 volts 30-60 hertz, by Knopp, Inc. or approved substitution.
 7. A commercial model, three-point, ground test by James G. Biddle Co., a "Vibroground" tester by Associated Research, Inc., or approved substitution.
- C. The Contractor shall furnish and use safety devices such as rubber gloves and blankets, protective screens and barriers, danger signs, etc., to adequately protect and warn all personnel in the vicinity of the tests.

PART 3 - EXECUTION

3.01 GENERAL

- A. Prior to start of testing the installation shall be completed, punch listed and inspected by the Chief Engineer for satisfactory completion of the work.
- B. Under no circumstances shall testing begin without the prior approval of the Chief Engineer.

3.2 TESTING

- A. Testing shall be performed on the following equipment that is installed as part of this project.
- B. Molded Case Breaker Tests shall include the following:
 1. Check adjustable magnetic trip settings against values furnished by the Chief Engineer.
 2. Megger each pole for freedom from grounds.
 3. Check connections and tighten as required.
- C. Tests on Motor Starters and Contactors shall include the following:
 1. Check equipment grounding to assure continuity of connections.
 2. Remove any blocking used for shipment.
 3. Check overload relays for proper current range with motor nameplate full load amperes. Adjust relays for manual or automatic reset.
 4. Check each magnet coil for proper operating voltage.
 5. Check auxiliary contacts for correct arrangement with coil de-energized; i.e.; normally open or normally closed.
 6. Megger each pole of the starter or contactor for freedom from grounds.
 7. Check fuses and/or circuit breakers for proper ratings as prescribed by the manufacturer for the actual motor supplied.
 8. Check overload heater relays or other overload protection for proper ratings as prescribed by the manufacturer.
 9. Check wiring connections and tighten as required.
 10. Check secondary fuses for proper ratings for motor starter control power transformers.
- D. Inspection of Disconnect Switches
 1. Inspect contacts, clean as required.
 2. Inspect arc chutes.
 3. Inspect fuses for proper rating, type and size.
- E. Lighting System Test:
 1. Test lighting systems for proper operation, for conformance with indicated switch

control on the drawings for dimming, etc.

F. 600-Volt Wire and Cable Tests:

1. 600-Volt wire shall be meggered with a 500-volt megger for one minute, and values must be approximately as listed as follows:

Conductor Capacity Amperes	Resistance Ohms
0-24	1,000,000
25-50	250,000
51-100	100,000
101-200	50,000
201-400	25,000
501-800	12,000
Over 800	5,000

The above values shall be determined with switchboards, panelboards, fuse holders, switches, and overcurrent devices in place. Devices containing semi-conductors, such as diodes, transistors, and other devices which can be damaged by the megger shall not be connected during meggering. Motors and transformers shall not be connected during meggering. Wire and cable shall be meggered after installation, not on the reel.

2. Wiring to be meggered shall be limited to feeder wiring between main distribution equipment and power panels, branch circuit panels, motor control centers, individual pieces of mechanical equipment and other similar equipment. Wiring for mechanical equipment connected to branch circuit panels shall also be meggered. Branch circuit wiring for lighting and receptacles shall not be meggered.
3. The Contractor shall perform all phasing tests and shall make changes necessary to assure proper rotation of all motors, the correct phasing and phase sequence of all circuits susceptible of being paralleled, the proper polarity on all instrument transformer wiring, and such other phasing tests and changes as may be required for the equipment to be connected under this contract.

G. Panelboards:

1. Test breaker ON/OFF operation.
2. Test voltages between phases and phase to ground at the following locations:
 - a. Before incoming breaker.
 - b. After the incoming breaker at the bus.
 - c. At all feeder breaking.

H. Miscellaneous Equipment Testing: Test all miscellaneous equipment for proper operation in accordance with equipment manufacturer's instructions.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 05 00

ELECTRICAL GENERAL PROVISIONS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Except as modified in this Section, General Conditions, and Supplementary Conditions, applicable provisions of Division 1 General Requirements, and other provisions and requirements of the Contract Documents apply to work of Division 26 Electrical.
- B. Applicable provisions of this section apply to all sections of Division 26, Electrical.

1.2 CODE REQUIREMENTS AND FEES

- A. Perform work in accordance with applicable statutes, ordinances, codes and regulations of governmental authorities having jurisdiction.
- B. Electrical work shall comply with applicable inspection services:
 - 1. Underwriters Laboratories.
 - 2. National Fire Protection Association.
 - 3. State Health Department.
 - 4. Local Municipal Building Inspection Department adopted codes with amendments.
 - 5. National Electrical Code with local amendments.
 - 6. State Regulatory Agencies.
 - 7. Where the project is located outside a municipal jurisdiction, and has no municipal inspection services, the National Electrical Code with amendments of the municipality with extraterritorial jurisdiction shall govern.
 - 8. Where the project is located outside any municipal jurisdiction, including extraterritorial jurisdictions, the National Electrical Code with local adopted amendments of the largest municipality located in the same county or parish shall govern.
 - 9. International Energy Conservation Code.
 - 10. National Electrical Safety Code.
- C. Resolve any code violations discovered in contract documents with the Engineer prior to award of the contract. After Contract award, any correction or additions necessary for compliance with applicable codes shall be made at no additional cost to the Owner.
- D. This Contractor shall be responsible for being aware of and complying with asbestos NESHAP regulations, as well as all other applicable codes, laws and regulations.
- E. Obtain all permits required.

1.3 CONTRACTOR'S QUALIFICATIONS

- A. An approved contractor for the work under this division shall be:
 - 1. A specialist in this field and have the personnel, experience, training, and skill, and the organization to provide a practical working system.
 - 2. Able to furnish evidence of having contracted for and installed not less than 3 systems of comparable size and type that has served their Owners satisfactorily for not less than 3 years.

1.4 REFERENCE SPECIFICATIONS AND STANDARDS

- A. Materials which are specified by reference to Federal Specifications; ASTM, ASME, ANSI, APWA, or AWWA Specifications; Federal Standards; or other standard specifications must comply with latest editions, revisions, amendments or supplements in effect on date proposals are received. Referenced specifications and standards are minimum requirements for all equipment, material and work. In instances where specified capacities, size or other features of equipment, devices or materials exceed these minimums, meet specified capacities.
- B. Use electrical materials and equipment that is constructed and tested in accordance with the standards of NEMA, ANSI, ASTM, or another recognized commercial standard. If materials and equipment is labeled, listed, or recognized by any Nationally Recognized Testing Laboratory (NRTL) acceptable to the Occupational Safety and Health Administration (OSHA), then provide NRTL-labeled, listed, or recognized material and equipment. Acceptable NRTLs include but are not limited to:
 - 1. Underwriters Laboratories, Inc. (UL)
 - 2. Factory Mutual Research Corp. (FMRC) (also referred to as "Factory Mutual Global," or "FM Global")
 - 3. Intertek Testing Services NA, Inc. (ITSNA, formerly ETL)
 - 4. Canadian Standards Association (CSA)
 - 5. A complete listing of acceptable NRTLs is published on the OSHA website at <http://www.osha.gov/dts/otpca/nrtl/>.
- C. Where material and equipment are not labeled, listed, or recognized by any NRTL, provide a manufacturer's Certificate of Compliance indicating complete compliance of each item with applicable standards of NEMA, ANSI, ASTM, or other recognized commercial standard.
- D. Do not install or use electrical material or equipment for any use other than that for which it was designed, labeled, listed, or identified unless formally approved for such use by the Owner's AHJ. This *National Electrical Code*® requirement is re-stated for emphasis.
- E. Codes and Standards applicable to this Division:
 - 1. ANSI – American National Standards Institute
 - a. ANSI Z535.1, Safety Colors
 - b. ANSI Z535.2, Environmental and Facility Safety Signs
 - c. ANSI Z535.3, Criteria for Safety Symbols
 - d. ANSI Z535.4, Product Safety Signs and Labels
 - 2. ASHRAE – American Society of Heating, Refrigeration, and Air Conditioning Engineers:
 - a. ASHRAE Standard 90.1, *Energy Standards for Buildings Except for Low Rise Residential Buildings* [ANSI, IESNA]
 - 3. ASTM – American Society for Testing and Materials
 - 4. CBM – Certified Ballast Manufacturers
 - 5. ICC – International Code Council
 - a. International Building Code® (IBC)
 - b. International Existing Building Code® (IEBC)
 - 6. ICEA – Insulated Cable Engineers Association
 - a. ICEA S-93-639, *Shielded Power Cables 5-46kV* (NEMA WC-74)
 - 7. IEEE® - Institute of Electronics and Electrical Engineers
 - a. IEEE C2™, *National Electrical Safety Code* (NESC) [ANSI]
 - b. IEEE Std 141™, *Recommended Practice for Electric Power Distribution for Industrial Plants* ("Red Book")
 - c. IEEE Std 143™, *Recommended Practice for Grounding of Industrial and Commercial Power Systems* ("Green Book")

- d. IEEE Std 241™, *Recommended Practice for Electric Power Systems in Commercial Buildings* (“Gray Book”)
- e. IEEE Std 242™, *Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems* (“Buff Book”)
- f. IEEE Std 315™, *Graphic Symbols for Electrical and Electronics Diagrams*
- g. IEEE Std 399™, *Recommended Practice for Power Systems Analysis* (“Brown Book”)
- h. IEEE Std 446™, *Recommended Practice for Emergency and Standby Power Systems for Industrial and Commercial Applications* (“Orange Book”)
- i. IEE Std 493™, *Recommended Practice for the Design of Reliable Industrial and Commercial Power Systems* (“Gold Book”)
- j. IEEE Std 519™, *Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems*
- k. IEEE Std 739™, *Recommended Practice for Energy Management in Industrial and Commercial Facilities* (“Bronze Book”)
- l. IEEE Std 902™, *Guide for Maintenance, Operation, and Safety of Industrial and Commercial Power Systems* (“Yellow Book”)
- m. IEEE Std 1015™, *Recommended Practice Applying Low-Voltage Circuit Breakers Used in Industrial and Commercial Power Systems* (“Blue Book”)
- n. IEEE Std 1100™, *Recommended Practice for Powering and Grounding Electronic Equipment* (“Emerald Book”)
- o. IEEE Std 1584™, *Guide for Performing Arc-Flash Hazard Calculations*
- 8. IESNA – Illuminating Engineering Society of North America
 - a. IESNA *Lighting Handbook*, Ninth Edition
 - b. IESNA RP-1, *American National Standard Practice for Office Lighting*
 - c. IESNA RP-7, *American National Standard Practice for Lighting Industrial Facilities*
- 9. NECA – National Electrical Contractors Association:
 - a. NECA 1, *Good Workmanship in Electrical Construction* [ANSI]
 - b. NECA 90, *Recommended Practice for Commissioning Building Electrical Systems* [ANSI]
 - c. NECA 100, *Symbols for Electrical Construction Drawings* [ANSI]
 - d. NECA 101, *Standard for Installing Steel Conduits (Rigid, IMC, EMT)* [ANSI]
 - e. NECA 104, *Recommended Practice for Installing Aluminum Building Wire and Cable* [ANSI]
 - f. NECA / NEMA 105, *Recommended Practice for Installing Metal Cable Tray Systems* [ANSI]
 - g. NECA 111, *Standard for Installing Nonmetallic Raceways (RNC, ENT, LFNC)* [ANSI]
 - h. NECA / NACNA 120, *Standard for Installing Armored Cable (Type AC) and Metal-Clad Cable (Type MC)* [ANSI]
 - i. NECA 202, *Recommended Practice for Installing and Maintaining Industrial Heat Tracing Systems* [ANSI]
 - j. NECA 230, *Standard for Selecting, Installing and Maintaining Electric Motors and Motor Controllers* [ANSI]
 - k. NECA 331, *Standard for Building and Service Entrance Grounding and Bonding*
 - l. NECA 400, *Standard for Installing and Maintaining Switchboards* [ANSI]
 - m. NECA 402, *Standard for Installing and Maintaining Motor Control Centers* [ANSI]
 - n. NECA / EGSA 404, *Standard for Installing Generator Sets* [ANSI]

- o. NECA 407, *Recommended Practice for Installing and Maintaining Panelboards* [ANSI]
- p. NECA 408, *Recommended Practice for Installing and Maintaining Busways* [ANSI]
- q. NECA 409, *Recommended Practice for Installing and Maintaining Dry-Type Transformers* [ANSI]
- r. NECA 410, *Recommended Practice for Installing and Maintaining Liquid-Filled Transformers* [ANSI]
- s. NECA 411, *Recommended Practice for Installing and Maintaining Uninterruptible Power Supplied (UPS)* (ANSI)
- t. NECA 420, *Standard for Fuse Applications* [ANSI]
- u. NECA 430, *Standard for Installing Medium-Voltage Metal-Clad Switchgear* [ANSI]
- v. NECA / IESNA 500, *Recommended Practice for Installing Indoor Lighting Systems* [ANSI]
- w. NECA / IESNA 501, *Recommended Practice for Installing Exterior Lighting Systems* [ANSI]
- x. NECA / IESNA 502, *Recommended Practice for Installing Industrial Lighting Systems* [ANSI]
- y. NECA / MACSCB 600, *Recommended Practice for Installing and Maintaining Medium-Voltage Cable* [ANSI]
- z. NECA / NEMA 605, *Installing Underground Nonmetallic Utility Duct* [ANSI]
- 10. NEMA – National Electrical Manufacturers Association
- 11. NETA – International Electrical Testing Association, Inc.:
 - a. NETA ATS, *Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems*
 - b. NETA MTS, *Maintenance Testing Specifications for Electrical Power Distribution Equipment and Systems*
 - c. NETA ETT, *Standard for Certification of Electrical Testing Technicians* [ANSI]
- 12. NFPA – National Fire Protection Association:
 - a. NFPA 20®, *Standard for the Installation of Stationary Pumps for Fire Protection*®
 - b. NFPA 70™, *National Electrical Code*® (NEC®)
 - c. NFPA 70E, *Standard for Electrical Safety in the Workplace*.
 - d. NFPA 101®, *Life Safety Code*®
 - e. NFPA 110, *Standard for Emergency and Standby Power Systems*
 - f. NFPA 111, *Standard on Stored Electrical Energy Emergency and Standby Power Systems*
 - g. NFPA 780, *Standard for the Installation of Lightning Protection Systems*
 - h. All other NFPA codes and standards except NFPA 5000
- 13. OSHA – Occupational Safety and Health Administration.
- 14. IECC – International Energy Conservation Code.
- 15. ISO – International Organization for Standardization.
- 16. State and Local Energy Conservation Code.
- 17. Applicable County and Municipal Codes.

1.5 CONTRACT DRAWINGS

- A. Contract drawings are diagrammatic only and do not give fully dimensioned locations of various elements of work. Determine exact locations from field measurements.
- B. Every effort has been made by the Engineer to indicate wiring of all receptacles, light fixtures, switches, telephone outlets, HVAC equipment, other equipment, elevator equipment, and all other devices / appliances requiring electrical power. It is the intent of

the Engineer that all light fixtures be powered and controlled unless specifically noted on the plans; that all wiring devices (receptacles and direct connected equipment) be circuited to a power source of the correct voltage and that all HVAC, elevator equipment and other equipment be properly wired to the correct voltage power source; that all communications and security systems devices and equipment and all fire alarm system devices and equipment are installed, wired and systems are fully operational.

- C. It is the responsibility of the Contractor to review the construction drawings (reflected ceiling plans) for light fixtures, casework elevation details for electrical devices which are not indicated on the electrical drawings; to review the mechanical and plumbing documents and all other drawings to determine the electrical rough-ins for all equipment requiring power connections, and to include in their proposals the correct and complete electrical rough-ins for all of these items which were inadvertently not indicated on the electrical drawings, OR the Contractor shall specifically enumerate each item requiring electrical rough-in which is not specifically shown on the electrical drawings, and indicate the electrical provisions of these items as specifically excluded from his proposal.
- D. It is the responsibility of the Contractor to compare the scale of all electrical drawings with the scale of the architectural drawings and make adjustments to all electrical drawings which have the incorrect drawing scale so that his material takeoffs are not in error due to an incorrectly labeled drawing scale and his proposal is complete.
- E. No proposal shall be accepted which specifically excludes any of the provisions of paragraphs B, C, or D above.

1.6 PROJECT RECORD DOCUMENTS

- A. Maintain at the job site a separate set of white prints (black line) of the contract drawings for the sole purpose of recording the "as-built" changes and diagrams of those portions of work in which actual construction is significantly at variance with the contract drawings. Mark the drawings with a colored pencil. Prepare, as the work progresses and upon completion of work, reproducible drawings clearly indicating locations of various major and minor feeders, equipment, and other pertinent items, as installed. Record underground and under slab service and feeders installed, dimensioning exact location and elevation of such installations.
- B. At conclusion of project, obtain without cost to the Owner, electronic PDF and AutoCAD 2014 and / or Revit CAD files of the original drawings and transfer as-built changes to these. Provide the following as-built documents including all contract drawings regardless of whether corrections were necessary and include in the transmittal: "2 sets of CDs and prints for Owner's use, one set of CDs, prints, and mylars for Architect / Engineers Records". Delivery of these as-built electronic, reproducible and prints is a condition of final acceptance.
 - 1. 3 sets of electronic AutoCAD (2014 dwg) and / or Revit CAD drawing files, on CD-ROM media, of each contract as-built drawing.
 - 2. One reproducible Dayrex Mylar film positive of each contract as-built drawing.
 - 3. Three sets of blue-line prints of each contract as-built drawing.
 - 4. Three sets of pdf prints of each contract as-built drawing on CD.
- C. As-Built Drawings should indicate the following information as a minimum:
 - 1. Indicate all addendum changes to documents.
 - 2. Remove Engineer's Seal, name, address, and logo from drawings.
 - 3. Mark documents RECORD DRAWINGS.
 - 4. Clearly indicate: DOCUMENT PRODUCED BY:
 - 5. Indicate all changes to construction during construction. Indicate actual routing of all conduits, etc. that was deviated from construction drawings.

6. Indicate exact location of all underground electrical raceways, and elevations.
7. Correct schedules to reflect (actual) equipment furnished and manufacturer.
8. During the execution of work, maintain a complete set of Drawings and specifications upon which all locations of equipment, devices, and all deviations and changes from the construction documents in the work shall be recorded.
9. Exact location of all electrical equipment in building. Label panel schedules to indicate actual location.
10. Exact location of all electrical equipment in and outside of the building.
11. Exact location of all outdoor lighting poles and equipment.
12. Location, size and routing of all feeder conduits, equipment, etc. shall be accurately and neatly shown to dimension.
13. Exact location of all roof mounted equipment, wall, roof and floor penetrations.
14. Cloud all changes.
15. Update all panel schedules with all additional circuits added or deleted through construction. Identify each circuit to include all information specified for directory cards for circuit identification in panelboards.

1.7 SPACE REQUIREMENTS

- A. Consider space limitations imposed by contiguous work in selection and location of equipment and material. Do not provide equipment or material that is not suitable in this respect.

1.8 RELATION WITH OTHER TRADES

- A. Carefully study all matters and conditions concerning the project. Submit notification of conflict in ample time to prevent unwarranted changes in any work. Review other Divisions of these specifications to determine their requirements. Extend electrical services and final connections to all items requiring same.
- B. Because of the complicated relationship of this work to the total project, conscientiously study the relation and cooperate as necessary to accomplish the full intent of the documents.
- C. Provide sleeves and inserts in forms as required for the work. Stub up and protect open ends of pipe before any concrete is placed. Furnish sizes of required equipment pads. Furnish and locate bolts and fittings required to be cast in them.
- D. Locate and size openings required for installation of work specified in this Division in sufficient time to prevent delay in the work.
- E. Refer to other Divisions of the specifications for the scope of required connections to equipment furnished under other Division. Determine from the General Contractor / Construction Manager for the various trades, the Owner, and by direction from the Architect / Engineer, the exact location of all items. The construction trades involved shall furnish all roughing-in drawings and wiring diagrams required for proper installation of the electrical work.
 1. Make final electrical connections to all electrically operated equipment indicated on the drawings, except as noted.
 2. The responsibility for alignment of motor and driven equipment is specified in the related division.
- F. Request all Shop Drawings required in ample time to permit proper installation of all electrical provisions.

- G. Extend services as indicated to the various items of equipment furnished by others. Rough-in for the various items and make final connections ready for operation upon placing of the equipment.

1.9 CONCEALED AND EXPOSED WORK

- A. When the word "concealed" is defined as hidden from sight as in chases, furred spaces or above ceilings. "Exposed" is defined as open to view, in plain sight.

1.10 GUARANTEE

- A. Guarantee work for 1 year from the date of substantial completion of the project. During that period make good any faults or imperfections that may arise due to defects or omissions in material, equipment or workmanship. Replacement of failed parts or equipment shall be provided.

1.11 MATERIAL AND EQUIPMENT

- A. Furnish new and unused materials and equipment meeting the requirements of the paragraph specifying acceptable manufacturers. Where two or more units of the same type or class of equipment are required, provide units of a single manufacturer.

1.12 NOISE AND VIBRATION

- A. Select equipment to operate with minimum noise and vibration. If noise or vibration is produced or transmitted to or through the building structure by equipment, piping, ducts or other parts of work, and judged objectionable by the Owner, Architect, or Engineer, rectify such conditions at no additional cost to the Owner. If the item of equipment is judged to produce objectionable noise or vibration, demonstrate at no additional cost that equipment performs within designated limits on a vibration chart.

1.13 ACCEPTABLE MANUFACTURERS

- A. Manufacturers names and catalog number specified under sections of Division 26 are used to establish standards of design, performance, quality and serviceability and not to limit competition. Equipment of similar design, materials, energy efficiency characteristics (where applicable) and lighting performance characteristics (where applicable) equal to that specified, manufactured by a named manufacturer shall be acceptable on approval. A request for prior approval of equipment not listed must be submitted ten (10) days before proposal due date. Submit a marked-up set of the relevant specification section indicating all variances, a comparison to the specified product, and of construction and performance criteria, complete design and performance data for the specified product and the proposed substitution for comparison to the Engineer. The Architect issues approvals of acceptable manufacturers as addenda to the Construction Proposal Documents.

1.14 UTILITIES, LOCATIONS AND ELEVATIONS

- A. Locations and elevations of the various utilities included within the scope of this work:
 1. Obtained from utility maps and other substantially reliable sources.
 2. Are offered separate from the Contract Documents as a general guide only without guarantees to accuracy.
- B. Examine the site and verify the location and elevation of all utilities and of their relation to the work. Existing utilities indicated on the site plans are for reference only and shall be field verified by the Contractor with the respective public or private utility.

1.15 OPERATING TESTS

- A. After all electrical systems have been completed and put into operation, subject each system to an operating test under design conditions to ensure proper sequencing and operation throughout the range of operation. Tests shall be made in the presence of the Architect / Engineer and Owner. Provide minimum 24-hour advance notice of scheduling of all tests. Make adjustments as required to ensure proper functioning of all systems. Special tests on individual systems are specified under individual sections. Submit 3 copies of all certifications and test reports adequately in advance of completion of the work to allow for remedial action as required to correct deficiencies discovered in equipment and systems.

1.16 WARRANTIES

- A. All normal and extended warranties shall include parts, labor, miscellaneous materials, travel time, incidental expenses, normal freight / shipping, refrigerant, oils, lubricants, belts, filters and any expenses related to service calls required to diagnose and correct warranty problems.
- B. Manufacturer's warranty shall be from one year from date of substantial completion. Contractor shall be responsible for extending the warranties regardless of date of installation or commissioning.
- C. Submit 3 copies of all warranties and guarantees for systems, equipment, devices and materials. These shall be included in the Operating and Maintenance Manuals.

1.17 BUILDING CONSTRUCTION

- A. It shall be the responsibility of the sub-contractor to consult the Contract Drawings, details and specifications and thoroughly familiarize himself as to the construction and all job-related requirements. All construction trades shall cooperate with the General Contractor / Construction Manager Job site superintendent and lay out work so that all raceways and other items are placed in the walls, furred spaces, chases, etc., so that there shall be no delay in the job.

1.18 TEMPORARY FACILITIES

- A. General: Refer to Division 1 for general requirements on temporary facilities.
- B. Temporary Wiring: Temporary power and lighting for construction purposes shall be provided under this Division. Installation of temporary power shall be in accordance with NEC Article 527.
- C. Temporary facilities, wire, lights and devices are the property of this Contractor and shall be removed by this Contractor at the completion of the Contract.

PART 2 - PRODUCTS – NOT USED

PART 3 - EXECUTION

3.1 IDENTIFICATION OF EQUIPMENT

- A. Identification of Equipment:
 - 1. All major equipment shall have a manufacturer's label identifying the manufacturer's address, equipment model and serial numbers, equipment size,

- and other pertinent data. Take care not to obliterate this nameplate. The legend on all nameplates or tags shall correspond to the identification shown on the Operating Instructions. All panels, cabinets, or equipment requiring 120 volt or higher power shall be labeled as required which includes circuit designation and circuit panelboard location, regardless of which discipline installs the equipment.
2. Three layer laminated plastic engraved identifying nameplate shall be permanently secured to each switchboard, distribution panel, motor control center, transformer, panelboard, safety disconnect switch, enclosed circuit breaker, transfer switches, remote generator transfer deices not installed inside light fixtures, wireway, busduct plug, terminal cabinet, surge protective device, capacitor, individual motor controller, contactor, fire alarm panels (main and remote booster), and communications (voice, data, video) cabinet or rack, security panels, time clocks, BMCS cabinets, sound reinforcement cabinets and racks, miscellaneous control cabinets, equipment integral disconnect switches, toggle or motor switches, disconnects for equipment, exterior junction boxes, exterior pull boxes, exterior wireways and gutters, and rooftop equipment (i.e.: supply and exhaust fans, rooftop HVAC equipment) with stainless steel screws.
- a. Utility Power: White letters on black background
 Generator Power (White letters on red background)
 UPS Power: White letters on blue background
 Load Bank Circuits: White letters on green background
 Solar or Wind Power Generation: White on orange background
 - b. Identifying nameplates shall have 1/2-inch high, engraved letters for equipment designation and ¼-inch letters indicating source circuit designation, (i.e.: "PANEL HA –fed from MDP-6 located in Mech. Rm. 100"). The words "fed from" and "located" shall be included in the labeling.
 Example: Panel HA
 Fed From MSB
 Located Main Elec. RM 100
 Example: Disconnect for Panel LK
 Location: Kitchen
 Fed From Transformer TLK
 Located Main Elec. RM 100
 - c. Each switchboard, distribution panel, transfer switch, generator transfer device (GTD) for emergency lighting, and motor control center feeder or branch circuit device shall have a nameplate showing the load and location of load served in ¼-inch high, engraved letters. Circuit breaker name and kirk key designation if applicable
 - d. Each section of multiple section panelboards shall also indicate panelboard section number (i.e.: Panel "HA-Section 2 – fed from MDP-6 located in Mech. Rm. 100")
 - e. Motor Controllers, starters, and contactors: Provide neatly typed label inside each motor controller and contactor enclosure door identifying motor or load served, nameplate horsepower, full load amperes, code letter, service factor, and voltage / phase rating.
 - f. Individual motor controller and contactor nameplates shall include load served, location of load served, panel and circuit numbers serving load, location of panel serving load, panel and circuit number serving control circuit, location of panel serving control circuit (if different from panel serving load), description and location (if applicable) of control controlling contactor (i.e. Controlled: Switch in RM 100, and Controlled: BMCS). Contactor nameplate is to include whether it is a lighting or receptacle contactor and name of contactor. i.e., C-1.

Lighting Contactor Example	Receptacle Contactor Example
Lighting Contactor C1	Receptacle Contactor C2

West Parking Lot Pole Lights Fed From Panel HA-2,4,6 Located Main Elec. Rm. 100 Control Circuit-Panel LA 42 Located Main Elec. Rm. 100 Controlled-BMCS	Table Recpts Lab Rm 100 Fed From Panel LA-2,4,6,8 Located Mech. Rm. 110 Control Circuit-Panel LA-42 Controlled-Emer Shut Off Mushroom Switch Rm 101
GTD Example	
Exterior lighting wall packs / north soffit / west metal canopy Fed from Panels EHA-2 located in Elec. RM 105 and HA-1 via Lighting Contactor controlled by BMCS located in Elec. RM 200.	

- g. Exterior J-boxes, pull boxes, and gutters shall have panel identification, circuit numbers, and location of panel listed on name plate. Low voltage shall be identified per contents, examples: DATA, BMCS, F/A
- h. Name plates on equipment served from switchboards, distribution panels, I-Line panels, and motor control centers are not to include circuit numbers shown on drawings as the circuit numbers are for construction drawing purposes only.
- i. Panel names for 277/480v shall start with the letter "H" and 120/208v, 120/240v shall start with the letter "L". No panel shall be named to include a number other than multi sectional panels, example HA-section 2. New panels installed in renovation or site additions shall have names approved or designated by Owner's electrical representative. Panel names shall not include the letter "I". Transformer names shall start with the letter "T" followed by the panel name it serves, i.e., TLA.
- j. Main service ATS label shall include equipment name, emergency source and location, normal power source and location, panel served and location. Wall mounted ATS serving lighting loads shall include type of lighting and location, emergency panel and circuit ID and location of panel, normal panel and circuit ID and location of panel.

Main Service ATS Example ATS-1 Emer Power-Emer Generator Located Chiller Yard Normal Power-MSB Located-Mech Rm 100 Serves Panel EHA Located-Mech Rm 100	Wall Mounted Lighting ATS Example ATS Exterior Wall Packs/Soffit Lights North/West Metal Canopy Lights Fed from EHA-2 Located Mech Rm 200 Fed From HB-4 Located Mech Rm 150
------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------
- k. Name plates shall include rated bus amperage, voltage, number of phases, number of wires and type of essential electrical system as applicable.
- l. Switchgear, switchboards, panelboards, motor control centers, or service equipment available fault current labeling: Provide a 2x3 inch permanently affixed (notice) label with white lettering on contrasting blue background permanently affixed to the equipment prior to energizing the equipment. The label shall include the date of installation and the date of calculation and comply with ANSI Z535.4 current standards design and durability. The date of calculation shall be the date indicated by the Engineer of Record's seal on the Construction Documents. Example:

AVAILABLE FAULT CURRENT: ##, ### AMPS
DATE OF INSTALLATION: MM/DD/YY
DATE OF CALCULATION: MM/DD/YY

3. Cardholders and directory cards shall be furnished for circuit identification in panelboards. Cardholder shall be located on inside of panel door and shall be in a metal frame with clear plastic front. Circuit lists shall be typewritten. Circuit descriptions shall include explicit description and identification of items controlled by each individual breaker, including final graphics room number or name designation and name of each item served. If no building appointed room number or name is given, list locations per the following examples – A. Storage in Rm 100 – B. Office in Rm 100 – C. Storage west of Rm. 100. List corridors as “corridors”. Identify circuits controlled by contactors using a separate notation for each contactor used. List notation at bottom of schedule stating the circuits are controlled by a contactor, list exact location of contactor, and how switched. Do not use architectural room number designation shown on plans. Obtain final graphics room number identification from Architect’s final room number graphics plan. All locations served by breakers shall be listed on schedule. Panel schedule shall be large enough to contain all information required. Also refer to Section 26 24 16.
 4. Permanent, waterproof, black markers shall be used to identify each lighting and power grid junction box, gutter and wireway. Clearly indicate the panel and branch circuit numbers available at that junction box, gutter or wireway. Where low voltage relay panels are used for lighting control, identify the low voltage relay panel and number in addition to the branch circuit panel and number.
 5. Pull Boxes, Transformers, Disconnect Switches, etc.: Field work each with a name plate showing identity, voltage and phase and identifying equipment connected to it. The transformer rating shall be shown on the panels or enclosures. For an enclosure containing a motor starter, the nameplate shall include the Owner’s motor number, motor voltage, number of motor phases, motor load being serviced, motor horsepower, and motor full load current. Nameplates shall also indicate where panel is fed from.
- B. Prohibited Markings: Markings intended to identify the manufacturer, vendor, or other source from whom the material has been obtained are prohibited for installation in public, tenant, or common areas within the project. Also prohibited are materials or devices that bear evidence that markings or insignias have been removed. Certification, testing (example, Underwriters Laboratories), and approval labels are exceptions to this requirement.
 - C. Warning Signs: Provide warning signs where there is hazardous exposure associated with access to or operation of electrical facilities. Provide text of sufficient size to convey adequate information at each location, mount permanently in an appropriate and effective location. Comply with industry standards for color and design.
 - D. Wire and Cable Markers: Provide vinyl cloth markers with split sleeve or tubing type, except in manholes provide stainless steel with plastic ties.
 - E. Wire and Cable Labeling: Provide wire markers on each conductor in all boxes, pull boxes, gutters, wireways, contactors, and motor controllers and load connection. Identify with panelboard / switchboard branch circuit or feeder number for power and lighting circuits, and with control wire number as indicated on equipment manufacturer’s shop drawings for control wiring.
 - F. Underground Warning Tape: Thomas and Betts or approved equal. Six-inch wide plastic tape, colored red for 50 volts or above electrical, or orange for communications and control with suitable warning legend describing buried electrical lines; telephone lines and data lines per APWA recommendations. All underground electrical conduits shall be so identified. Tape shall be buried at a depth of 6-inches below grade and directly above

conduits or ductbanks. Provide magnetic marking tape below all underground electrical conduits.

- G. Lighting Controls and Equipment: Provide self-adhesive machine typed tape labels with ¼" high white letters on ½" tall black background for digital lighting modules as "DLM". Modules or relays located above ceiling: adhere label to bottom of ceiling T-grid below relay location. Modules or relays located in mechanical or electrical rooms or other areas other than above ceiling: Adhere label to the cover of the module or relay and identify the area they control as "MAIN GYM", "BAND HALL", or "CORRIDOR 100", etc. Remote lighting control switches or push-button stations located remotely from the area they control: Adhere label to device face plate, not obstructing screw fasteners, and intuitively identify function such as "GYM LTG LOW-HIGH" or "CAFE LTG DIM", etc.

3.2 CUTTING AND PATCHING

- A. General: Comply with the requirements of Division 1 for the cutting and patching of other work to accommodate the installation of electrical work. Except as authorized by the Architect / Engineer, cutting and patching of electrical work to accommodate the installation of other work is not permitted.

3.3 INSTRUCTION OF OWNER'S PERSONNEL

- A. Prior to substantial completion, conduct an on-site training program to instruct Owner's operating personnel in the operation and maintenance of the electrical systems.
 - 1. Provide the training during regular working day.
 - 2. The instructors shall be experienced in their phase of operation and maintenance of the electrical systems and with the project.
 - 3. Refer to other specification sections for additional training and commissioning requirements.
- B. Time to be allocated for instructions.
 - 1. Minimum of 20 hours dedicated instructor time.
 - 2. Additional instruction time for specific systems as specified in other Sections.
- C. Before on-site training, submit the program syllabus; proposed time and dates; for review and approval, minimum 48 hours prior to proposed training time and date.
 - 1. One copy to the Owner
 - 2. One copy to the Architect / Engineer
- D. The Owner shall provide a list of personnel to receive instructions and shall coordinate their attendance at the agreed upon times.
- E. Use operation and maintenance manuals as the basis of instruction. Review manual with personnel in detail. Explain all aspects of operation and maintenance.
- F. Demonstrate start-up, operation, control, adjustment, troubleshooting, servicing, maintenance, and shut down of each item of equipment.
- G. Demonstrate equipment functions (both individually and as part of the total integrated system).
- H. Prepare and insert additional data in the operating and maintenance manuals when the need for additional data becomes apparent during instructions.

- I. Submit a report within one week after completion of training. List time and date of each demonstration, hours devoted to the demonstration, and a list of people present, with their respective signatures.
- J. At the conclusion of the on-site training program, have the person designated by the Owner sign a certificate to certify that he / she has a proper understanding of the system, that the demonstrations and instructions have been satisfactorily completed, and the scope and content of the operating and maintenance manuals used for the training program are satisfactory.
- K. Provide a copy of the report and the certificate in an appropriately tabbed section of each Operating and Maintenance Manual.

3.4 OPENINGS

- A. Framed, cast or masonry openings for boxes, equipment or conduits are specified under other divisions. Drawings and layout work for exact size and location of all openings are included under this division.

3.5 HOUSEKEEPING PADS

- A. Provide concrete equipment housekeeping pads under all floor and outdoor mounted electrical equipment.
- B. Concrete and reinforcing steel shall be as specified in Division 3, or as indicated or noted.
- C. Concrete pads:
 - 1. 6-inches thick minimum indoors; 8-inches thick minimum outdoors or match existing if indicated on the drawings to extend existing pads, or in other sections of the specifications.
 - 2. Chamfer strips at edges and corner of forms.
 - 3. Smooth steel trowel finish.
 - 4. Extend 3-inches minimum indoors beyond perimeter of equipment unless otherwise shown.
 - 5. 6-inch x 6-inch #8 wire reinforcement mesh.

3.6 OBSTRUCTIONS

- A. The drawings indicate certain information pertaining to surface and subsurface obstructions, which has been taken from available drawings. Such information is not guaranteed, however, as to accuracy of location or complete information.
 - 1. Before any cutting or trenching operations are begun, verify with Owner's representative, utility companies, municipalities, and other interested parties that all available information has been provided.
 - 2. Should obstruction be encountered, whether shown or not, alter routing of new work, reroute existing lines, remove obstruction where permitted, or otherwise perform whatever work is necessary to satisfy the purpose of the new work and leave existing services and structures in a satisfactory and serviceable condition.
- B. Assume total responsibility for and repair any damage to existing utilities or construction, whether or not such existing facilities are shown.

3.7 VANDAL RESISTANT DEVICES

- A. Where vandal resistant screws or bolts are employed on the project, deliver to the Owner 2 suitable tools for use with each type of fastener used, and 25 percent spare fasteners.

- B. Proof of delivery of these items to the Owner shall be included in the Operating and Maintenance Manuals.

3.8 PROTECTION

- A. Protect work, equipment, fixtures, and materials. At work completion, work must be clean and in original manufacturer's condition.
- B. Do not deliver equipment to this project site until progress of construction has reached the stage where equipment is actually needed or until building is closed in enough to protect the equipment from weather. Equipment allowed to stand in the weather shall be rejected, and the contractor is obligated to furnish new equipment of a like kind at no additional cost to the Owner.

3.9 COORDINATION OF BRANCH CIRCUIT OVERCURRENT AND PROTECTION DEVICES

- A. Review with equipment specified which requires electrical connections. Review equipment shop drawings and manufacturer's nameplate data and coordinate exact branch circuit overcurrent protective device and conductors with equipment provided.
 1. Provide equipment manufacturer's recommended overcurrent protective device indicated on nameplate at no additional cost to the Owner.
 2. If branch circuit conductors and / or conduit sizing is less than the minimum required by equipment manufacturer, notify the Architect / Engineer immediately, prior to rough-in.
 3. If equipment manufacturer is a substitution to the specified equipment manufacturer, provide the greater of the conductors specified or those required for the installed equipment manufacturer's minimum circuit conductors, at no additional cost to the Owner.
 4. If conductors indicated on plans are in excess of that permitted by equipment manufacturer, notify Architect / Engineer immediately, prior to rough-in.
 5. If conductors indicated on plans are in excess of that permitted by the equipment manufacturer, provide the maximum conductors permitted by the equipment manufacturer based on NEC ampacity tables, either in a single set, or as a set of parallel conductors as permitted by the NEC. Conductor size and quantity entering the equipment enclosures shall not exceed the equipment manufacturer's maximum recommendations.

3.10 FAULT CURRENT AND ARC FLASH STUDY FOR OVERCURRENT DEVICE COORDINATION

- A. Contractor shall provide a coordination study, fault current analysis, and Arc-Flash study report for new electrical distribution equipment downstream to the last new overcurrent device in each feeder or branch circuit, conducted and prepared by the switchgear manufacturer. The coordination study and fault current analysis shall include the manufacturer's recommendations for all adjustable overcurrent devices specified or provided. Study does not require inclusion of existing switchgear, except it shall include existing or new overcurrent devices in existing switchgear serving new switchgear. Contractor shall submit the report results prior to submitting switchgear submittals to allow changes or modifications to equipment selection.
- B. Contractor shall adjust all overcurrent device settings based on manufacturer's recommendations, or as directed by Owner / Architect at no additional cost to Owner. Settings for GFI shall be set at maximum as permitted by the NEC.
- C. Arc-Flash & Shock-Hazard Warning Labels: Provide arc-flash and shock hazard-warning labels that comply with ANSI Z535.4 on switchgear, switchboards, transformers, motor

control centers, panelboards, motor controllers, safety switches, industrial control panels and other equipment that is likely to require examination, adjustment, servicing, or maintenance while energized. Locate the marking to be clearly visible to qualified persons before examination, adjustment, servicing, or maintenance of the equipment. On renovation projects, install arc-flash warning labels on existing equipment where lock-out / tag-out will be required for the renovation work. Provide the information listed below on each label. Specify that arc-flash warning label information be produced by the electrical equipment manufacturer or supplier as a part of the final power system studies to be submitted by the Contractor in accordance with the electrical acceptance testing.

1. Note: In addition to the final arc-flash analysis, the final power system studies include load flow and fault-current calculations, and an overcurrent protective device (OCPD) coordination study based on the actual equipment to be installed for the project.

D. Information to be determined and applied to electrical equipment:

1. Arc-Flash Protection Boundary
2. Arc-Flash incident energy calculated in accordance with IEEE Std 15841™
3. Working distance calculated in accordance with IEEE Std 1584a™
4. NFPA 70E Hazard / Risk Category Number or the appropriate personal protective equipment (PPE) for operations with doors closed and covers on.
 - a. Typical operations include operating circuit breakers, fused switches, and meter selector switches.
5. System phase-to-phase voltage
6. Condition(s) when a shock hazard exists (e.g., "With cover off")
7. Limited Approach Boundary as determined from NFPA 70E, Table 130.2(C)
8. Restricted Approach Boundary as determined from NFPA 70E, Table 130.2(C)
9. Prohibited Approach Boundary as determined from NFPA 70E, Table 130.2(C)
10. Unique equipment designation or code (described under "Component Identification")
11. Class for insulating gloves based on system voltage (e.g., Class 00 up to 500V)
12. Voltage rating for insulated or insulating tools based on system voltage (e.g., 1000V)
13. Date that the hazard analysis was performed.
14. "Served from" circuit directory information including the serving equipment designation, location (e.g., room number), circuit number, and circuit voltage / number of phases / number of wires.
15. If applicable, the "serves" circuit directory information including the served equipment designation, location (e.g., room number), circuit number, and circuit voltage / number of phases / number of wires.
16. An abbreviated warning label may be used where it has been determined that no dangerous arc-flash hazard exists in accordance with IEEE 1584a™, paragraph 9.2.3.
17. Use a "DANGER" label where the calculated arc-flash incident energy exceeds 40 cal/cm.

- E. Submittals: Submit four copies of coordination study and certified fault current study results to the Architect for review.

3.11 EQUIPMENT BACKBOARDS

- A. Backboards: ¾ inch, fire retardant, exterior grade plywood, painted gray, both sides.
1. Provide minimum of two 4-ft. by 8-ft. sheets of plywood for each new telephone equipment terminal location.
 2. Provide minimum of two 4-ft. by 4-ft. sheets of plywood for each new data / voice / video / communications equipment location / cable TV head end equipment, or security equipment location.

3.12 TESTING

- A. The contractors for the various sub-systems shall submit proposed testing procedures for their systems, subject to review and approval and Owner acceptance. The contract will not be declared to be substantially complete until the functional operation of the subsystems have been demonstrated and verified and reports have been provided, reviewed and accepted.

- B. The project will not be declared substantially complete until the following has taken place.
 - 1. The "As-Built" drawings have been submitted, reviewed and accepted by the Architect / Owner / Owner's Construction Representative.
 - 2. The building emergency lighting system and other systems including but not limited to those listed below have been tested, completed factory start-up and programming and adjusting as required for a complete and fully operational system acceptable to the Architect and Owner.
 - a. Occupancy Sensor and Lighting Controls.
 - b. Surge protective device equipment.
 - c. Overcurrent devices.
 - d. Motor Controllers.
 - e. Emergency Lighting.
 - f. Building Fire Alarm System.
 - g. Clock System.
 - h. Television Distribution System.
 - i. Building Data / Voice Cabling System.
 - j. Surveillance and Security System.
 - k. Intercom / Telephone.
 - l. Sound Reinforcement Systems.
 - m. Building Lightning protection System.

3.13 LOAD BALANCING

- A. Balance the loads on each low-voltage feeder so that the voltage on each phase is within +/- 1.0% of the average voltage of the three phases. Refer to the DOE Office of Industrial Technologies, "Motor Tip Sheet #7" dated September 2005 available for download to PDF format at no charge at:
http://www1.eere.energy.gov/industry/bestpractices/pdfs/eliminate_voltage_un_balanced_motor-systems7.pdf .

END OF SECTION

SECTION 26 05 12

ELECTRICAL SHOP DRAWINGS, COORDINATION DRAWINGS & PRODUCT DATA

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Prepare submittals as required by Division 01 and as outlined below.
- B. Provide individual submittals based on the project specification section number and description and only items specified or required in that specific project specification section.
- C. Submit product data shop drawings only for the following items indicated below when included as part of the project specifications, and for items specifically requested elsewhere in the Contract Drawings and Specifications. Architect / Engineer reserves the right to refuse shop drawings not requested for review, typically for basic materials and commodity off-the-shelf materials, and/or to imply that materials shall be provided as specified without exception.
- D. The term submittal, as used herein, refers to all:
 - 1. Shop Drawings.
 - 2. Coordination Drawings.
 - 3. Product data.
- E. Submittals shall be prepared and produced for:
 - 1. Distribution as specified.
 - 2. Inclusion in the Operating and Maintenance Manual, in the related O&M manual section.

1.2 ARCHITECT / ENGINEER REVIEW OF SUBMITTALS

- A. The Architect / Engineer will:
 - 1. Review requested submittals with reasonable promptness. Specific equipment submittal within a materials specification section that may be required to be expedited shall be submitted separately without other submittal items not requiring the same prompt attention.
 - 2. Affix stamp and initials or signature and indicate requirements for resubmittal or exceptions to submittal as submitted.
 - 3. Return submittals to Contractor for distribution or for resubmission.
- B. Review of submittals will not extend to design data reflected in submittals that is peculiarly within the special expertise of the Contractor or any party dealing directly with the Contractor.
- C. Architect / Engineer's review is only for conformance with the design concept of the project and for compliance with the information given in the contract.
 - 1. The review shall not extend to means, methods, sequences, techniques or procedures of construction or to safety precautions or programs incident thereto.
 - 2. The review shall not extend to review of quantities, dimensions, weights or gauges, fabrication processes, or coordination with the work of other trades.
- D. The review of a separate item as such will not indicate approval of the assembly in which the item functions.

1.3 SUBSTITUTIONS

- A. Do not make requests for product or material substitution employing the procedures of this Section. The procedure for making a formal request for substitution is specified in Division 01.

PART 2 - PRODUCTS

- A. Each individual submittal shall be an individual specific electronic data file with the file name resembling the product specification section number and title. Refer to Division 01 for additional data file format and media requirements.

PART 3 - EXECUTION

3.1 SPECIFICATION COMPLIANCE REVIEW

- A. Do not submit an outline form of compliance, submit a complete copy with the product data.
- B. Mark up a complete copy of the complete specification section for the product to indicate a) acknowledgement of the specification requirement (Comply), or b) acknowledgement that the particular specification requirement does not apply to this specific project (Not Applicable) or, c) acknowledgement that the specification requirement cannot be made or that a variance is being submitted for review to the Architect / Engineer / Owner (Does Not Comply, Explanation:).
- C. Variances for product or materials typically include updated model numbers or updated versions of the specified product from the same manufacture or an equal or better product from the approved manufactures list. Substitutions from manufacture's not on the approved manufacture's will not be reviewed unless prior approval using one of the procedures for substitutions or changes in the contract documents are followed as required in Division 01.

3.2 COMPOSITE COORDINATION DRAWINGS

- A. Produce a set of composite coordination drawings for above ceiling, below ceiling, and below floor of electrical, mechanical, and technology equipment rooms and equipment yards for review and comment within four (4) weeks of receipt of Owner's official Notice to Proceed. Show coordination of items including but not limited to structural and architectural elements, all mechanical and plumbing piping, ductwork, equipment, electrical conduit, low voltage communications and safety/security systems cabling, cable trays, lighting, electrical switchgear, generators and UPSs, and any public or private building utility services.
 1. Prepare the composite plans at one-quarter inch (1/4") equals one-foot scale. Include larger scale sections with vertical elevations of elements as required to confirm coordinate of all elements.
 2. For each room containing major electrical switchgear and each outside equipment area with major electrical switchgear and other equipment also include NEC working space, NEC equipment space, and NEC access to NEC working space, and housekeeping pad location and dimensions.
 3. Prepare coordination drawings to coordinate installations for efficient use of available space allowing for future additional equipment wherever possible, for proper sequence of installation, and to resolve conflicts. Coordinate with work specified in other sections and other divisions of the specifications.
 4. Identify field dimensions. Show relation to adjacent or critical features of work or products.

- B. Submit composite coordination shop drawings in plan, elevation and sections, showing receptacles, outlets, electrical and telecommunication devices in casework, cabinetwork and built-in furniture.
 - 1. Verify location of wiring devices and outlets, communication devices and outlets, safety and security devices, and other work specified in this Division.
 - 2. Coordinate with drawing details, site conditions, composite coordination drawings, and millwork other equipment shop drawings prior to installation.
 - 3. Submit coordination and shop drawings prior to rough-in and fabrication.

3.3 EQUIPMENT SHOP DRAWINGS AND PRODUCT DATA

- A. Submittals shall not be combined or bound together with any other material submittal. Do not submit entire product catalogs, submit only specific data sheets indicating required product information and available product options or accessories.
- B. Submittal Specification Information:
 - 1. Every submittal document shall bear the following information as used in the project manual:
 - a. The related specification section number.
 - b. The exact specification section title.
 - c. Additional identifiers as required in Division 01.
 - 2. Submittals delivered to the Architect / Engineer without the specified information will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been submitted or delivered.
- C. All product options specified shall be clearly indicated on the product data submittal. All options listed on the standard product printed data not clearly identified as either part of or not part of the product data submitted shall become part of the Contract and shall be assumed to be provided with the product submitted.
- D. Mark each copy of standard manufacture's printed data to identify pertinent products, referenced to specification section and article number.
- E. Show reference standards, performance characteristics and capacities; wiring diagrams and controls; component parts; finishes; dimensions and required clearances.
- F. Modify manufacturer's standard schematic drawings and diagrams to supplement standard information and to provide information specifically applicable to the work. Delete or strike through information not applicable.
- G. Submit drawings in a clear and thorough manner. Identify details by reference to sheet and detail, schedule, or room numbers shown on Contract Drawings.
- H. Show all dimensions of each item of equipment in its to be installed assembled condition with all components assembled. Include a series of drawings of individual components as necessary for reference.
- I. Identify field dimensions; show relation to adjacent or critical features or work or products.
- J. Submit individually bound shop drawings and product data for the following when specified or provided.
- K. The Fault Current and Overcurrent Device Coordination Analysis shall be submitted prior to other electrical switchgear dependent on the results of the study for specific product selection by the vendor or contractor for compliance with the study.
 - 1. The emergency life safety power system equipment shall be fully coordinated as

- required by the NEC.
 - 2. The AIC and WCR ratings of all products meet or exceed the available fault current at that equipment's location.
 - 3. Electrical systems other than life safety power systems shall be coordinated as much as practicable while reducing arc flash energy as much as practical.
- L. Required submittals when products are indicated or specified:
- 1. Fault Current and Overcurrent Device Coordination Analysis. Submit this analysis at a minimum of three (3) weeks prior to any overcurrent device submittal to allow review for modifications to overcurrent device product selection submittal based on the manufacture's analysis and recommendations. Manufacture's recommendations for code compliance equipment fault tolerance are a project requirement and shall be provided at no additional cost to the Owner. Manufacture's recommendations for arc flash reduction that result in no additional cost to the Owner shall be provided. Manufacture's recommendations for arch flash reduction which would result in additional cost to the Owner are considered recommendations only and will be reviewed by the Engineer during the submittal review and may or may not result in changes to the specified or submitted equipment.
 - 2. Enclosed Switches, non-fused, fused, or circuit breaker
 - 3. Panelboards
 - 4. Load centers
 - 5. Wiring devices
 - 6. Lighting fixtures
 - 7. Lighting Controls
 - 8. Surge Protection Devices
 - 9. Transformers
 - 10. Electrical Contactors
 - 11. Enclosed Motor Controllers
 - 12. Site Lighting Photometrics, Poles, and Fixtures
 - 13. Switchboards, including renewal components for existing switchboards.
 - 14. Elevator Power Module fused switches.
 - 15. Fuses
 - 16. Recessed floor boxes and fittings
 - 17. Metering equipment for building management energy monitoring, usage, IECC compliance
 - 18. Modular metering equipment for multi-tenant utility electrical services
 - 19. Emergency/Standby generators
 - 20. Automatic transfer switches
 - 21. Manual transfer switches with or without integral generator docking stations
 - 22. Remote generator docking stations
 - 23. Emergency lighting inverters
 - 24. Theatrical Lighting Systems
 - 25. Architectural Dimming Systems
 - 26. Electrical cable trays
 - 22. Sports Lighting Equipment, Photometrics, Fixtures, and Poles
 - 27. Surface Raceways
 - 28. Electrical controls and time switches
 - 29. Motor control centers, including renewal components for existing motor control centers
 - 30. Busway
 - 31. Uninterrupted Power Supply systems
 - 32. Power quality improvement filters or capacitors
 - 33. Lightning protection system
 - 34. Fire Rated Cables and Connectors
 - 35. Low Voltage Switchgear.

3.4 MANUFACTURERS INSTRUCTIONS

- A. Submit Manufacturer's instructions for storage, preparation, assembly, installation, start-up, adjusting, calibrating, balancing and finishing.

3.5 CONTRACTOR RESPONSIBILITIES

- A. Review, make corrections or annotations for clarification of manufacturer supplied data, stamp and sign submittals prior to transmittal.
- B. Determine and verify:
 - 1. Field measurements.
 - 2. Field construction criteria.
 - 3. Manufacturer's catalog numbers.
 - 4. Conformance with the Contract Documents.
- C. Coordinate submittals with requirements of the work and of the Contract Documents.
- D. Notify the Architect / Engineer in writing at time of submission of any deviations in the submittals from requirements of the Contract Documents.
- E. Do not fabricate products, or begin work for which submittals are required, until such submittals have been produced and bear contractor's stamp of acceptance or approval. Do not fabricate products or begin work until return of reviewed submittals with Architect / Engineer's acceptance.
- F. Contractor's responsibility for errors, omissions, or un-approved substitutions in submittals is not relieved whether Architect / Engineer reviews submittals or not.
- G. Contractor's responsibility for deviations in submittals from requirements of Contract Documents is not relieved whether Architect / Engineer reviews submittals or not, unless Architect / Engineer gives written acceptance of the specific deviations identified by the Contractor on reviewed documents.
- H. Submittals shall show sufficient data to indicate complete compliance with Contract Documents:
 - 1. Proper sizes and capacities.
 - 2. That the item will fit in the available space in a manner that will allow proper service; manufacture's and code required clearances.
 - 3. Construction methods, materials and finishes.
- I. Schedule submissions at least 15 days before date reviewed submittals will be needed by the Contractor for processing or for making corrections for re-submittal.
- J. General and Electrical Contractor's Stamp of Approval
 - 1. The general contractor and the electrical contractor shall stamp and sign each document certifying to the review of products, field measurements and field construction criteria, and coordination of the information within the submittal with requirements of the work and of Contract Documents.
 - 2. Contractor's stamp of approval on any submittal shall constitute a representation to Owner and Architect / Engineer that Contractor has either determined and verified all quantities, dimensions, field construction criteria, materials, catalog numbers, and similar data or assumes full responsibility for doing so, and that Contractor has reviewed or coordinated each submittal with the requirements of the work and the Contract Documents.
 - 3. Do not deliver any submittals to the Architect / Engineer that do not bear the

- Contractor's stamp of approval and signature.
4. Submittals delivered to the Architect / Engineer without Contractor's stamp of approval and signature will not be processed. The Contractor shall bear the risk of all delays, as if no submittal had been delivered.

3.6 SUBMISSION REQUIREMENTS

- A. Make submittals promptly in accordance with approved schedule, and in such sequence as to cause no delay in the Project or in the work of any other Contractor. Product and equipment related to site work or other trades which require extensive rough-in, foundations, or structural support shall be submitted as soon as possible after given notice to proceed with construction.
- B. Number of submittals required:
 1. Coordination Drawings: Submit one electronic data file (pdf) and three opaque reproductions or coordination drawings.
 2. Product Data: Submit electronic data PDF files. Refer to Division 01 for specific requirements. PDF files that are 20MB or larger may indicate that a submittal includes information not specifically relevant to the specific product being provided, information not required for the review of the specific product such as a complete product catalog or catalog section. Contractor shall include only the product data required to review the specific products characteristics for compliance with the contract documents.
- C. Accompany submittals with transmittal letter containing:
 1. Date.
 2. Project title and number.
 3. Contractor's name, address and contact information.
 4. The number of each Shop Drawing, Project Datum and Sample submitted.
 5. Other pertinent data as required in Division 01.
- D. Submittals shall include:
 1. The date of submission.
 2. The project title and number.
 3. Contract Identification.
 4. The names of:
 - a. Contractor.
 - b. Subcontractor.
 - c. Supplier.
 - d. Manufacturer.
 5. Identification of the product.
 6. Field dimensions, clearly identified as such.
 7. Relation to adjacent or critical features of the work or materials.
 8. Applicable standards.
 9. Identification of deviations from contract documents.
 10. Suitable blank space for General Contractor and Architect / Engineer stamps.
 11. Contractor's signed and dated Stamp of Approval.
- E. Coordinate submittals into logical groupings to facilitate interrelation of the several items.
 1. Finishes which involve Architect / Engineer selection of colors, textures or patterns.
 2. Associated items requiring correlation for efficient function or for installation.

3.7 RESUBMISSION REQUIREMENTS

- A. Make resubmittals under procedures specified for initial submittals. Re-submittals shall

be a complete submittal as if it were the initial submittal unless otherwise instructed in the review comments on the original submittal.

1. Indicate that the document or sample is a resubmittal.
2. Identify changes made since previous submittals.

- B. Indicate any additional changes which have been made by the contractor other than those requested by the Architect / Engineer.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 05 19

CONDUCTORS AND CONNECTORS – 600 VOLT

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide electrical conductors, wire and connector work as shown, and specified.
- B. Types: The types of conductors and connectors required for the project include the following:
 - 1. 600V building conductors.
 - 2. 600V building conductor connectors.
- C. Application: The applications for conductors and connectors required on the project are as follows:
 - 1. Power distribution circuitry.
 - 2. Lighting branch circuitry.
 - 3. Appliance, receptacle, and equipment branch circuitry.
 - 4. Motor branch circuitry.
 - 5. Control wiring.
 - 6. Line voltage.
- D. Refer to other specific specification sections for voice, video, data, alarm and instrumentation cables.

1.2 QUALITY ASSURANCE

- A. UL Label: Conductors and connectors shall be UL labeled.

1.3 REFERENCES

- A. Refer to other specific specification sections regarding specialized wiring and connections.

PART 2 – PRODUCTS – Provide products manufactured in the USA

2.1 CONDUCTORS AND CONNECTORS

- A. General: Except as indicated, provide conductors and connectors of manufacturer's standard materials, as indicated by published product information, designed and constructed as instructed by the manufacturer, and as required for the installation.
- B. Cable Lubricant: Fire resistant, nonflammable, water-based type for standard building conductors. Provide cable lubricants for fire rated cables as recommended by the cable manufacturer.
- C. Conductors: Provide factory-fabricated conductors of the size, rating, material, and type as indicated for each use. Conductors shall be soft or annealed copper wires meeting, before stranding, the requirements of ASTM B 3, Standard Specification for Soft or Annealed Copper Wire for Electrical Purposes, latest edition.
 - 1. Conductors for control wiring sized #14 AWG through #10 AWG shall be stranded.
 - 2. Conductors for power and lighting shall be stranded. Stranding shall be Class B meeting the requirements of ASTM B 8, Standard Specification for Concentric-

Lay-Stranded Copper Conductors, Hard, Medium Hard, or Soft.

- D. Insulation for standard building conductors: Insulation shall meet or exceed the requirements of UL 83, Standard for Thermoplastic Insulated Wires.
1. All wiring inside lighting fixtures shall be temperature rated per NEC.
 2. Insulation for copper conductors shall be UL Type THHN/THWN, 90 degrees C.

2.2 COLOR CODES FOR CONDUCTORS FOR BRANCH CIRCUITS AND FEEDERS

- A. Color coding for conductors as required by NEC 210.5. Color coding for phase and voltage shall be as required by local codes and local standards. Where such standards do not exist, color coding shall be as follows:

Color Code Table	USE CONTINUOUS COLOR CODED INSULATION THROUGHOUT					
System/ Phase	A	B	C	N	G	IG
120/208 3 Ph	Black	Red	Blue	White	Green	Green/Yellow Stripe
120/240 3 Ph	Black	Orange	Blue	White	Green	Green/Yellow Stripe
120/240 1 Ph	Black	N/A	Blue			
277/480	Brown	Purple	Yellow	Gray	Green	Green/Yellow Stripe

Notes to Color Code Table:

1. 120/208, 120/240, and 277/480 Volt Systems shall be routed in separate raceways.
2. Switched legs of phase conductors for lighting and appliance branch circuits shall be of the same color as described above throughout the entire circuit.
3. Conductors shall be the same color from breaker to device or outlet.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install electrical conductors and connectors as shown, in accordance with the manufacturer's written instructions, the requirements of NEC, the NECA Standard of Installation, and industry practices.
- B. Coordination: Coordinate conductor installation work with electrical raceway and equipment installation work, as necessary for interface.
- C. Conductors:
1. Provide a grounded (neutral) conductor for each branch circuit. Do not share grounded (neutral) conductors.
 2. No more than six phase conductors shall be installed in a single raceway. Any combination of phase conductors and grounded (neutral) conductors in any raceway shall not exceed nine.
 3. When any combination of four or more phase and grounded (neutral) conductors are installed in a raceway, the minimum size for all conductors including equipment ground conductor shall be #10 AWG, and they shall be de-rated accordingly.

4. When more than four (4) conductors are size #10 AWG, they shall be installed in a one-inch conduit.
5. Pull conductors together when more than one is being installed in a raceway. Whenever possible, pull conductors into their respective conduits by hand. Use pulling lubricant when necessary.
6. Before any conductor is pulled into any conduit, thoroughly swab the conduit to remove foreign material and to permit the wire to be pulled into a clean, dry conduit.
7. Run feeders their entire length in continuous section without joints or splices.
8. No wire smaller than #12 AWG shall be permitted for any lighting or power circuit. No wire smaller than #14 AWG shall be used for any control circuit, unless shown otherwise.
9. Provide the same size wire from the panelboard to last outlet on circuit. For 20 amp branch circuits operating at 150V or less, provide #10 AWG wire when the first outlet is over 75-feet from the panelboard. For branch circuits operating at 150 to 600 volts, provide #10 AWG wire when the first outlet is over 150-feet from the panelboard.
10. Branch circuit voltage drop shall not exceed 3% of rated voltage.
 - a. Total voltage drop from the point of service to the last outlet or utilization equipment of the same voltage shall not exceed five-percent of rated voltage.
 - b. Total voltage drop from the point of service to transformers with adjustable taps, buck-boost transformers, uninterruptable power supplies (UPS), or voltage regulators shall not exceed five-percent of rated voltage.
 - c. Total voltage drop from a separately derived system, transformer with adjustable taps, buck-boost transformer, uninterruptable power supply (UPS), or voltage regulator to the last outlet or utilization equipment of the same voltage shall not exceed five-percent of rated voltage.
 - d. Total voltage drop from the point of service to distribution equipment of the same voltage shall not exceed two-percent of rated voltage.
 - e. Branch circuit voltage drop from distribution equipment to the last outlet or utilization equipment shall not exceed three-percent of rated voltage.
 - f. Provide the same size branch circuit conductors to last outlet on circuit unless specifically noted or indicated otherwise on the drawings. For 20 amp branch circuits operating at 150-Volts or less, provide #10 AWG wire when the first outlet is over 75-feet from the panelboard. For branch circuits operating above 150-Volts to 600-Volts, provide #10 AWG wire when the first outlet is over 150-feet from the panelboard.
11. No tap or splice shall be made in any conductor except in outlet boxes, pull boxes, junction boxes, splice boxes, or other accessible locations. Make taps and splices using an approved compression connector. Insulate taps and splices equal to the adjoining conductor. Make splices or taps only on conductors that are a component part of a single circuit, protected by approved methods. Taps or splices in feed through branch circuits for connection to light switches or receptacles shall be made by pigtail connection to the device.
12. Support conductors in vertical raceways, as required by the NEC.
13. Do not permit conductors entering or leaving a junction or pull box to deflect to create pressure on the conductor insulation.
14. Make joints in branch circuits only where circuits divide. These shall consist of one through circuit to which the branch from the circuit shall be spliced.
15. Make connections in conductors up to a maximum of one #6 AWG wire with two #8 AWG wires using twist-on pressure connectors of required size.
16. Make connections in conductors or combinations of conductors larger than specified using cable fittings of type and size required for specific duty.

17. After a splice is made, insulate entire assembly with UL-approved insulating tape to a value equivalent to the adjacent insulation.
 18. Make splices and connections in control circuit conductors using UL-approved solderless crimp connectors.
 19. All conduits shall be installed with an insulated grounding conductor per NEC 250.122. Where green conductor insulation is not available, the ground conductor shall be identified with green phasing tape at all accessible locations.
 20. Neatly train and lace wiring inside boxes, equipment and panelboards. Provide tie-straps around conductors with their shared neutral conductor where there are more than two neutral conductors in a conduit.
 21. Clean conductor surfaces before installing lugs and connectors.
 22. Make splices, taps and terminations to carry full ampacity of conductors with no perceptible temperature rise.
 23. Provide stranded conductors connected with pressure type connectors / compression fittings and terminal lugs UL listed for the type of conductor used (AL-CU) and correctly sized to the diameter of the bare conductors.
 24. Run mains and feeders their entire length in continuous pieces without splices or joints.
 25. Color code conductors.
 26. Do not install a pull string in conduits containing conductors.
 27. Conductors shall be the same color from load side of overcurrent protection device to outlet or utilization equipment.
 28. Spare conductors shall not be installed in any conduit, gutter, raceway, panel or enclosure unless noted otherwise.
- D. Identification: Label each phase conductor in each junction box with corresponding circuit number, using self-adhesive wire markers.
- E. Splices and Joints:
1. In accordance with UL 486A, C, D, E, and NEC.
 2. Aboveground Circuits (No. 10 AWG and smaller):
 - a. Connectors: Solderless, screw-on, reusable pressure cable type, rated 600 V, 220° F, with integral insulation, approved for copper and aluminum conductors.
 - b. The integral insulator shall have a skirt to completely cover the stripped wires.
 - c. The number, size, and combination of conductors, as listed on the manufacturers' packaging, shall be strictly followed.
 3. Motor connections:
 - a. All AHU motors connections shall be split bolt connectors.
 - b. All non-AHU motors 10 HP and larger shall be split bolt connectors.
 - c. All non-AHU motors less than 10 HP shall be split bolt connectors or as recommended by the manufacturer.
- F. Aboveground Circuits (No. 8 AWG and larger):
1. Connectors shall be indent, hex screw, or bolt clamp type of high conductivity and corrosion resistant material, listed for use with copper and aluminum conductors.
 2. Provide field-installed compression connectors for cable sizes 250 kcmil and larger with not less than two clamping elements or compression indents per wire.
 3. Insulate splices and joints with materials approved for the particular use, location, voltage, and temperature. Splice and joint insulation level shall be not less than the insulation level of the conductors being joined.
 4. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

- G. Underground Branch Circuits and Feeders:
 1. Submersible connectors in accordance with UL 486D, rated 600 V, 190°F, with integral insulation.

3.2 TESTING

- A. Pre-Energization Check: Before energizing, check cable and conductors for circuit continuity and short circuits. Correct malfunctions.
- B. Service Entrance and Feeder Insulation Resistance Test: Each main service entrance conductor and each feeder conductor shall have its insulation resistance tested after the installation is complete except for connection at its source and point of termination. Testing shall be performed by qualified technicians who have been trained in testing procedures and in the use of all test equipment.
 1. Make tests using a Biddle Megger or equivalent test instrument at a voltage of not less than 1000 VDC; measure resistance from conductor to conductor, conductor to neutral (if present) and from conductor to ground. Insulation resistance shall not be less than the following:

Wire Size (AWG)	Insulation Resistance (Ohms)
#8	250 K
#6 through #2	100 K
#1 through #4/0	50 K
Larger than #4/0	25 K
 2. Conductors that do not meet or exceed the insulation resistance values listed above shall be removed, replaced, and retested.
- C. Submittals: Contractor shall furnish instruments and personnel required for tests. Submit 4 copies of certified test results to Architect for review. Test reports shall include conductor tested, date and time of test, relative humidity, temperature, and weather conditions.
- D. Voltage and Current Values: The voltage and current in each conductor shall be measured and recorded after connections have been made and the conductor is under load.

SAMPLE DC HIGH VOLTAGE CABLE TEST REPORT
(Specification Paragraph 3.2, C)

Date _____

Contract and Work Location: _____

Contract (Project) No.: _____

Circuit Identification: _____

(Dwg., Title, Number and Ckt. Number)

Test Equipment: _____

(Make, Model, Serial No., Etc.)

Applied Test Voltage _____

Normal Oper. Voltage _____

Cable Installation: New _____ Used _____

(Date) _____ (No. Years)

Cable Size _____ AWG

Cable Length _____ Ft.

Cable Material _____ Cu _____ Al

Temperature _____ Humidity _____

TEST DATA - RESISTANCE IN KILO OHMS

CONDUCTOR PER PHASE	A-N	B-N	C-N	A-G	B-G	C-G	A-B	B-C	A-C

END OF SECTION

SECTION 26 05 26

ELECTRICAL GROUNDING

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Grounding shall conform to the requirements of:
 - 1. National Electrical Code.
 - 2. Governing local codes.
 - 3. All Local Utility Companies.

- B. Ground effectively and permanently.
 - 1. Neutral conductor at the main service disconnect and other separately derived systems.
 - 2. All conduit systems.
 - 3. All electrical equipment and related current carrying supports or structures.
 - 4. All metal piping systems.
 - 5. All building structural metal frames.
 - 6. All telephone/voice/video/CATV/data utilities.

1.2 REFERENCE STANDARDS

- A. ANSI/IEEE Standard 142 - "Recommended Practice for Grounding of Industrial and Commercial Power Systems."
- B. ANSI/UL 467 - "Safety Standard for Grounding and Bonding Equipment."
- C. Article 250 of the NEC (NFPA 70) for grounding.
- D. NECA – Standard of Installation.
- E. NETA ATS – Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems.
- F. EIA / TIA 607.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Copperweld.
- B. nVent ERICO.
- C. Burndy.
- D. O. Z Gedney.
- E. Eaton.
- F. Approved Equal.

2.2 GROUNDING ELECTRODES

- A. Driven Rod Electrode
 1. 3/4" x 10'-0" copper clad grounding electrode.
 2. UL listed.
 3. Approved thermal fusion connector methods (exothermic).
- B. Metal frame of building or enclosure.
- C. Foundation concrete encased rebar.

2.3 DATA / VOICE COMMUNICATIONS CLOSET GROUND BAR

- A. MDF closets/head end rooms: Erico Cadweld #B544A028 ground bar with 7/16-inch holes.
- B. IDF closets, Erico Cadweld #B542A004 ground bar with 7/16-inch holes.
- C. Heavy-duty, two bolt type, copper alloy or bronze for grounding and bonding applications, in configurations required for particular installation.

2.4 EXOTHERMIC CONNECTIONS

- A. Exothermic type for underground and structural steel; Cadweld.
- B. Exothermic materials, accessories, and tools for preparing and making permanent field connections between grounding system components.

2.5 WIRE

- A. Stranded, copper cable.
- B. Foundation Electrodes: 4/0 AWG.
- C. Grounding Electrode Conductor: Size to meet NFPA 70 requirements.

PART 3 - EXECUTION

3.1 GROUNDING AND BONDING

- A. In the service equipment, provide a separate (dedicated) ground bus.
 1. Bond the ground bus with copper bus bar or cable, of equal or greater current carrying capacity of the service grounding conductor, to the neutral bar.
 2. Resistance of neutral to ground shall not exceed 10 Ohms.
 3. Connect the electric service grounding electrode conductors to the incoming metal water pipe system (when available, using a suitable ground clamp) and to a supplemental electrode such as a ground rod or ground ring.
 4. Provide grounding and bonding at the power company's metering equipment.
 5. Provide access and cover for access to the ground grid and removable connections for testing the system.
- B. Connect the grounding electrode conductor between the ground bus and the grounding electrode system.
 1. In rigid PVC conduit.
 2. Provide thermo fusion connection for each rod ground electrode.
 - a. All rod electrodes shall be located outside the building in non-paved

- areas where available. Access cover top shall be flush with finish grade or floor.
- b. Install rod electrodes as required. Install additional rod electrodes as required to achieve specified resistance to ground.
 - c. The minimum distance between driven ground rod electrodes shall be 10'.
3. The total ground resistance shall not exceed 10 Ohms for service entrance grounds and 25 Ohms for equipment grounds.
 - a. Where this condition cannot be obtained with one electrode, install a longer electrode, deep-driven sectional electrodes, or additional grounding electrodes until the required ground resistance is obtained.
- C. Provide an insulated equipment grounding conductor inside all conduits, raceways, surface raceways, gutters and wireways. The ground wire shall be bonded to each box to suitable lug, bus, or bushing. All bonding jumpers shall be routed inside conduit or raceway.
 - D. Provide an insulated isolated equipment grounding conductor in addition to the insulated equipment grounding conductor for all isolated grounding feeders, branch circuits, outlets and isolated grounding receptacles.
 - E. Provide all conduit terminating in switchgear, transformers, switchboards, panelboards and voice/data outlets with grounding bushings, where required, and ground wire extended to ground bus in equipment. Install grounding bushings where reducing washers are used and concentric and eccentric knock-outs are used.
 - F. Main bus and building grounding electrode conductor installation shall be witnessed by the Architect / Engineer.
 - G. Provide bonding to meet Regulatory Requirements.
 - H. Interface with lightning protection system when lightning protection system is specified.
 - I. Locate and install anchors, fasteners, and supports in accordance with NECA "Standard of Installation".
 - J. Do not fasten supports to pipes, ducts, mechanical equipment, or conduit.
 - K. Do not use spring steel clips and clamps.
 - L. Do not use powder-actuated anchors.
 - M. Do not drill or cut structural members.
 - N. Do not use compression or mechanical connectors underground.
 - O. Do not use sheetmetal or self-drilling screws for bonding connections. Provide listed or approved connectors.
 - P. Provide grounding access well for each driven ground electrode, not located in manholes or pull boxes.
 1. Access well top shall be flush with finish paved surfaces.
 2. Ground access wells located in non-paved areas shall be set two-inches above surrounding finished grade. Provide 12-inch wide by 8-inch deep reinforced concrete crown around neck or opening and sloped down away from pull box opening.

3. Provide thermal fusion (exothermic) connectors approved for direct burial.

3.2 METAL FRAME OF BUILDING OR STRUCTURE

- A. Effectively ground the building steel or structure per NEC 250-52 (2).

3.3 UFER GROUND

- A. Provide a UFER ground at bottom of building slab per NEC 250.52 (3), bond to building steel.

3.4 MISCELLANEOUS REQUIREMENTS

- A. Continuity of the equipment grounding system shall be maintained throughout the project. Equipment grounding jumpers shall be installed across conduit expansion fittings, liquid-tight flexible metal and flexible metal conduit, and other non-electrically continuous raceway fittings.
- B. Equipment grounding conductors and grounding electrode conductor shall be stranded copper conductors and run in a suitable raceway. Grounding conductors and grounding electrode conductor shall be continuous, without joints or splices over their entire length, except as allowed by NFPA 70/NEC.
- C. For separately derived alternating current system grounds, bond the case and neutral of each transformer secondary winding directly to the nearest available effectively grounded structural metal member as required in NEC 250.
- D. Exterior Electrical Equipment Racks:
 1. Provide driven ground electrode.
- E. Technology/Data/Voice Communications, CATV, CCTV, and MATV Equipment Grounding: Provide grounding electrode conductor from the communications service equipment to the building grounding system as required. Grounding shall conform to ANSI/TIA/EIA 607(A) – Commercial Building Grounding and Bonding Requirements for Telecommunications, National Electrical Code®, ANSI/NECA/BICSI-568 and manufacturer's grounding requirements as minimum. Bonding shall be of low impedance to assure electrical continuity between bonded elements.
 1. MDF Closets Telecommunications Main Ground Bar (TMGB): Provide Erico #EGBA14424MM ground bar, wall mounted to the telecommunications plywood backboard. Provide one #3 AWG insulated ground conductor from ground bar to building steel. Provide #2/0 AWG insulated ground conductor to the building electrical service ground at the nearest electrical switchboard or panelboard.
 2. IDF Closets Telecommunications Ground Bar (TGB): Provide Erico #EGBA14410FF ground bar mounted to the telecommunications plywood backboard. Provide one #6 AWG insulated ground conductor from ground bar to building steel and to ground bus of nearest electrical panelboard or switchboard.
 3. Provide #2/0 AWG insulated ground conductor between each TMGB and all TGBs.
 4. Provide #2/0 AWG insulated ground conductor from TMGB to electrical service ground bus at main electrical service switch.
 5. Bond each equipment rack, cabinets, frames, together and with #6 AWG insulated ground conductor to the local TMGB / TGB. Bond and ground equipment racks, housings, messenger cables, raceways, and rack-mounted conduit.
 6. Route TMGB – TGB ground conductor using the shortest, straightest, route

- practical with long radius curves.
7. All conduits terminating to cable trays, wireways, and racks shall be mechanically fastened. When connected to a cable tray or rack, it must be connected with ground bushings, wire bonded to the tray or rack, and grounded to the main building grounding system or IDF room grounding bar using #6 AWG copper.
- F. Ground lighting fixture bodies to the conduit grounding system.
- G. Bond receptacle ground to the box and conduit ground system, except where and insulated/isolated grounding receptacle or outlet is specified.
- H. Ground connections to building steel, grounding electrodes and all underground connections shall be by thermal fusion (exothermic).
- I. Provide OZ Type "BJ" bonding jumper at all expansion joints, points of electrical discontinuity or connections in conduit where firm mechanical bond is not possible, such as flexible connections, insulating couplings, etc.
- J. Ground each lighting and power panelboard by connecting the grounding conductors to the grounding stud.
- K. Ground each secondary dry-type transformer to the ground bus of the primary side panelboard. Provide a bonding jumper between the ground stud and the neutral. Ground transformer ground stud to ground ring if a ground ring is installed or the nearest structural steel member.
- L. Bond every item of equipment served by the electrical system to the building equipment ground system. This includes, but is not limited to, switchboards, panelboards, disconnect switches, receptacles, cable trays, controls, fans, air handling units, pumps and flexible duct connections.
- M. Ground each light pole, power distribution poles, and metal conduit stub-ups at each light pole base.
- N. Ground all metal conduit including metal conduit used for bends and penetrations through concrete.
- O. Bond hot water and cold water piping together at each domestic water heater.

3.5 MANHOLE AND/OR PULL BOX GROUNDING

- A. Provide a driven ground rod and ground bond ring in each power and telephone manhole or pull box. Bond cable racks and medium voltage cable shields at splices and terminations, ductbank conduit ground bushings and all other metal components in manholes or pull box to the ground ring.

3.6 COORDINATION

- A. General: Coordinate installation of grounding connections for equipment with equipment installation work.

3.7 TESTING

- A. Ground Resistance Test: Perform a ground resistance test for comparison to future inspection and testing data by the Owner. Test shall be performed using a Biddle Megger Earth Tester or equivalent test instrument. The test shall not be performed within 48

hours after the last rainfall.

1. Inspect and test in accordance with NETA ATS except Section 4
 2. Grounding and Bonding: Perform inspections and tests listed in NETA ATS, Section 7.13
- B. True Root Mean Square (RMS) AC measurements: The True RMS AC Measure test should be performed for all bonding conductors. The recommended maximum AC current value on any bonding conductor should be less than 1 ampere (A). The recommended maximum DC current value should be less than 500 milliamperes (mA). If abnormally high AC current levels are present on any bonding conductor, a dangerous faulty wiring condition likely exists within the room.
- C. Two-Point Bonding Measurements: The Two-point Bonding test should be performed for all bonding conductors. This test should be performed using an earth grounding resistance tester configured for a continuity test. The test is performed by connecting the meter leads between the nearest available grounding electrode (e.g., structural steel) and the TMGB or TGB. The recommended maximum value for the bonding resistance between these two points is 0.1 Ohms (100 milliohms).
- D. Submittals: Furnish instruments and personnel required for tests. Personnel shall be trained in all aspects of testing grounding systems and shall be formally trained on using all test equipment required. Submit 2 copies of certified test results for Owner's record and submit 4 copies of certified test results to Architect / Engineer for review. Test reports shall include date and time of tests, relative humidity, temperature, and weather conditions.

END OF SECTION

SECTION 26 05 33

CONDUIT SYSTEMS

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Furnish and install a complete system of electrical conduits and fittings.

1.2 REFERENCE STANDARDS

- A. National Electrical Code.
- B. Local codes and ordinances.
- C. UL.
- D. ETL.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS – Provide products manufactured in the USA

- A. Raceways:
 - 1. Allied, International Metal Hose, Ipex, Heritage Plastics, Wheatland, Can-Tex, Carlon, Certain-Teed, Anamet, Inc., Electri-Flex Co., Western Tube and Conduit, Sentinel Conduit.
 - 2. PVC Coated RGC: Robroy Perma Cote, Robroy Plasti-Bond, or Calbond – no exceptions.
 - 3. Stainless Steel: Robroy, Calbrite, Gibson.
 - 4. Aluminum: Penn Aluminum, American Conduit, Wheatland, Eaton B-Line, Patriot Aluminum Products.
 - 5. Reinforced Thermosetting Resin Conduit (RTRC): FRE Composites, Champion Fiberglass, United Fiberglass.
- B. Fittings:
 - 1. Appleton, Crouse Hinds, Topaz, Steel City, O.Z. Gedney, Carlon, Heritage Plastics, Racor, Ipex, International Metal Hose, Lew Electric Fittings Co.
 - 2. PVC Coated ferrous fittings: Robroy Perma Cote, Robroy Plasti-Bond, or Calbond – no exceptions.
 - 3. Stainless Steel: Robroy, Calbrite, Gibson, Crouse Hinds
 - 4. Aluminum: Penn Aluminum, American Conduit, Wheatland, Eaton B-Line, Patriot Aluminum Products.
 - 5. Reinforced Thermosetting Resin Conduit (RTRC): FRE Composites, Champion Fiberglass.
- C. Condulets and Conduit Bodies:
 - 1. Appleton, Form 85.
 - 2. PVC Coated: Robroy Perma-cote or Plasti-Bond, – no exceptions.
 - 3. Stainless Steel: Robroy, Calbrite, Gibson, Crouse Hinds.
 - 4. Reinforced Thermosetting Resin Conduit (RTRC): FRE Composites, Champion Fiberglass.
- D. Steel MC Cable for light fixture whips:
 - 1. AFC.

2. Southwire.
3. General Cable.
4. Kaf-Tech.

2.2 GENERAL

- A. The minimum conduit size shall be $\frac{3}{4}$ -inch unless indicated otherwise in Divisions 26, 27 or 28.
 1. Branch Circuits: Minimum conduit size shall be $\frac{3}{4}$ -inch.
 2. Feeder Circuits: Minimum conduit size shall be $\frac{3}{4}$ -inches.
 3. Technology, telecommunications, and low voltage systems: The minimum conduit size shall be $\frac{3}{4}$ -inches unless noted or indicated otherwise.
 4. The minimum conduit size between buildings for technology, voice, data, fire alarm, video, security, surveillance, BMCS, and other telecommunications shall be 2-inch unless indicated otherwise.
- B. The minimum conduit size for flexible metallic conduit for tap connections to individual light fixtures shall be $\frac{1}{2}$ inch, or steel metal clad (MC) cable with insulated ground conductor maximum 6 feet.
- C. Electrical nonmetallic tubing, flexible polyethylene or PVC tubing shall not be used on this project.
- D. BX and AC cable shall not be used on this project.
- E. PVC elbows shall not be used on this project.
- F. Intermediate metal conduit (IMC) shall not be used on this project.

2.3 RIGID METAL CONDUIT

- A. UL labeled, Schedule 40:
 1. Mild steel pipe, zinc coated inside and out.
 2. Aluminum Alloy 6063, T-1 temper.
 3. Threaded ends.
 4. Insulated bushings.
- B. Fittings shall meet the same requirements as rigid metal conduits.
 1. UL labeled.
 2. Threaded fittings.

2.4 ELECTRICAL METALLIC TUBING (EMT)

- A. UL labeled, standard weight:
 1. Cold rolled steel tubing, zinc coated inside and out.
 2. Aluminum Alloy 6005, 6063. Temper T-1.
- B. Fittings shall meet the same requirements as EMT conduits.
 1. UL labeled.
 2. Insulated throat connectors.
 3. Steel fittings with setscrews with lock nuts on threaded ends, no snap locks.
 4. Cast metal fittings are not approved.
 5. Uni-couple type connectors are not approved.
 6. Split ring, anti-short bushings are not approved.

2.5 RTRC CONDUIT FITTINGS AND CONDUIT BODIES

- A. UL listed.
- B. Standard wall thickness sizes ¼-inch through 4-inch.
- C. Underground medium wall thickness sizes 5 and 6-inch.
- D. Conduit interface joints above grade, gasket joint below grade.
- E. Extra heavy wall for above ground and/or UL Class 1 Division 2 and Class 1 Zone 2 applications.

2.6 PVC COATED RIGID STEEL WITH URETHANE INTERIOR COATING

- A. The PVC coated galvanized rigid conduit and fittings must be ETL Listed and Verified. The PVC coating must have been investigated and verified by ETL as providing the primary corrosion protection for the rigid metal conduit. Ferrous fittings for general service locations must be ETL Listed with PVC as the primary corrosion protection. Hazardous location fittings, prior to plastic coating must be UL listed for the hazard conditions to which they are to be used. All conduit and fittings must be new, unused material. Applicable UL standards may include UL 6 Standard for Safety, Rigid Metal Conduit, and UL514B Standard for Safety, Fittings for Conduit and Outlet Boxes.
- B. The PVC coated galvanized rigid conduit and fittings must be ETL Verified to the Intertek ETL SEMKO High Temperature H₂O PVC Coating Adhesion Test Procedure for 200 hours. The PVC coated galvanized rigid conduit must bear the ETL Verified PVC-001 label to signify compliance to the adhesion performance standard.
- C. The conduit shall be hot dip galvanized inside and out with hot galvanized threads.
- D. A PVC sleeve extending one pipe diameter or two inches, whichever is less, shall be formed at every female fitting opening except unions. The inside sleeve diameter shall be matched to the outside diameter of the conduit.
- E. The PVC coating on the outside of conduit couplings shall have a series of longitudinal ribs 40 mils in thickness to protect the coating from tool damage during installation.
- F. Form 8 Condulets, ½-inch through 2-inch diameters, shall have a tongue-in-groove gasket to effectively seal against the elements. The design shall be equipped with a positive placement feature to ease and assure proper installation. Certified results confirming seal performance at 15 psig (positive) and 25 inches of mercury (vacuum) for 72 hours shall be available.
- G. Form 8 Condulets shall be supplied with plastic encapsulated stainless-steel cover screws.
- H. A urethane coating shall be uniformly and consistently applied to the interior of all conduit and fittings. This internal coating shall be a nominal 2 mil thickness. Conduit or fittings having areas with thin or no coating shall be unacceptable.
- I. The PVC exterior and urethane interior coatings applied to the conduit shall afford sufficient flexibility to permit field bending without cracking or flaking at temperatures above 30°F (-1°C).
- J. All male threads on conduit, elbows and nipples shall be protected by application of a

urethane coating.

- K. All female threads on fittings or conduit couplings shall be protected by application of a urethane coating.
- L. Independent certified test results shall be available to confirm coating adhesion under the following conditions
 1. Conduit and conduit exposure to 150°F (65°C) and 95% relative humidity with a minimum mean time to failure of 30 days. (ASTM D1151)
 2. The interior coating bond shall be confirmed using the Standard Method of Adhesion by Tape Test (ASTM D3359).
 3. No trace of the internal coating shall be visible on a white cloth following six wipes over the coating which has been wetted with acetone (ASTM D1308).
 4. The exterior coating bond shall be confirmed using the methods described in Section 3.8, NEMA RN1. After these tests the physical properties of the exterior coating shall exceed the minimum requirements specified in Table 3.1, NEMA RN1.
- M. Right angle beam clamps and U bolts shall be specially formed and sized to snugly fit the outside diameter of the coated conduit. All U bolts shall be provided with plastic encapsulated nuts that cover the exposed portions of the threads.
- N. All fittings, clamps, straps, struts, and hardware used with PVC coated conduit shall be PVC coated or 316 stainless steel.

2.7 STEEL FLEXIBLE CONDUIT

- A. Steel flexible metallic conduit:
 1. Zinc coated inside and out.
 2. 18-inches minimum length, 24-inches maximum length.
- B. Steel flexible metallic conduit for tap connections to light fixtures where steel MC Cable fixture whips are not used:
 1. 18 inches minimum length; 6 feet maximum length.
- C. Liquid tight flexible steel conduit
 1. Type L.A. - Grounded - UL Approved.
 2. 18-inches minimum length, 24-inches maximum length.

2.8 PVC CONDUIT

- A. UL labeled Schedule 40 and Schedule 80.
- B. PVC fittings and solvent welded joints.
- C. Acceptable PVC conduit manufacturer: Ipex, Cantex .

2.9 CONDULETS AND CONDUIT BODIES

- A. UL Labeled.
- B. Form 85.
- C. PVC Coated: Form 8.
- D. LBC Condulets shall be used for size 2 inch and above.

- E. LL and LR Condulets shall not be used for 2 inch and above.

2.10 ROOF MOUNTED CONDUIT AND BOX SUPPORTS

- A. Conduit supports and pads suitable for direct sunlight, conduit size, weight, quantity and roof system with unistrut supports and accessories. Conduit supports shall allow for conduit expansion and contraction.
- B. Refer to roofing specifications for additional information. The limitations and restrictions contained in any roofing specification shall prevail and supercede these specifications for roof mounted supports for conduits and boxes.
- C. Approved Manufacturer:
 - 1. Portable Pipe Hangers.
 - 2. Eaton B-Line.
 - 3. Miro Industries, Inc.

2.11 ALUMINUM CONDUIT

- A. UL Labeled.
- B. Aluminum fittings shall meet the same requirements of aluminum conduits, compatible steel fittings.
 - 1. UL Labeled for use with aluminum conduit.

2.12 STAINLESS STEEL CONDUIT

- A. UL Labeled.
- B. Rigid Stainless Steel:
 - 1. Type 304 Stainless Steel.
 - 2. Threaded ends.
 - 3. Insulated Bushings.
- C. EMT:
 - 1. Type 304 Stainless Steel.
 - 2. Compression Fittings.
 - 3. Insulated Bushings.
- D. Fittings, elbows, nipples, strut, device box, clamps straps, etc.
 - 1. Type 304 Stainless Steel.

2.13 ELECTRICAL NON-METALLIC TUBING (ENT)

- A. UL labeled Schedule 40.
- B. PVC fittings and solvent welded joints.
- C. Acceptable manufacture: Carlon.

2.14 EXTERIOR IN-GRADE PULL BOXES

- A. Enclosures, boxes and covers are required to conform to all test provisions of the most current American Association of State Highway and Transportation Officials (AASHTO) standards for H-20 loading applications.

1. AASHTO H-20 certified precast concrete, cast iron or other AASHTO recognized materials, rated for deliberate traffic.
2. Conduit entry knock-outs as required.
3. Bolt down galvanized steel/cast iron covers.
4. Thin wall knocks outs as required.
4. Integral bottom.
5. Box height as required for specified conduit depth and required top elevation.
6. Concrete design strength of minimum 5,500 PSI at 28-days.
7. Place enclosures on a minimum of 6 inches of coarse gravel with a border of 6-inches beyond the enclosures exterior dimension.
8. Size and volume as required for application.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install electrical conduits and fittings for all wiring of any type unless specifically specified or instructed to do otherwise. Install conduits and fittings in accordance with local codes and applicable sections of the NECA "Standard of Installation", concealed where possible.
 1. Fasten conduit supports to building structure and surfaces; do not support to roof deck.
 2. Arrange supports to prevent misalignment during wiring installation.
 3. Do not support conduit with wire or perforated pipe straps. Remove wire used for temporary supports.
 4. Do not attach conduit to ceiling support wires.
 5. Arrange conduit to maintain head room and present neat appearance.
 6. Maintain 4-inch clearance between conduit and rooftop surfaces.
 7. Cut conduit square using saw or pipe cutter; de-burr cut ends.
 8. Bring conduit to shoulder of fittings; fasten securely.
 9. Conduit penetrations to all individual motor controllers, VFDs, and motor control cabinets shall only be made at the bottom of the enclosure. For other equipment, provide listed water sealing conduit hubs to fasten conduit to sides or tops of electrical equipment enclosures, device box, gutter, wireway, disconnect, etc.
 10. Use suitable caps to protect installed conduit against entrance of dirt and moisture.
 11. Ground and bond conduit as required.
 12. Identify conduit as required.
 13. Route all conduits above building slab perpendicular or parallel to building lines.
 14. Do not use no-thread couplings and connectors for galvanized steel, PVC coated galvanized steel, or aluminum rigid conduit.
- B. Group related conduits; support using conduit rack. Construct rack using steel channel; provide space on each for 25 percent additional conduits.
- C. In areas where raceway systems are exposed and acoustical or thermal insulating material is to be installed on walls, partitions, and ceilings, raceways shall be blocked out proper distance to allow insulating material to pass without cutting or fitting. Also provide Kindorf galvanized steel channels to serve as standoffs for panels, cabinets and gutters.
- D. Securely fasten conduits, supports and boxes, to ceiling (not roof deck), walls, with Rawl Plugs or approved equal anchors. Use lead cinch anchors or pressed anchors. Use only cadmium plated or galvanized bolts, screws. Plastic anchors and lead anchors shall not be used for overhead applications.
- E. Provide separate raceway systems for each of the following when specified, indicated or

required:

1. 120/208 volt circuits.
 2. 277/480 volt circuits.
 3. Emergency
 - a. Life safety branch.
 - b. Critical branch.
 - c. Equipment branch.
 4. Voice/Data.
 5. Sound reinforcement.
 6. Theatrical and Architectural Dimming Controls.
 7. MATV/CATV.
 8. Security CCTV.
 9. Security System.
 10. Communications / PA Systems / Sound System Line Input and Speakers.
 11. Fire Alarm.
 12. Lighting Control Systems.
 13. Building Management Control Systems.
- F. Unless shown otherwise, do not install conduit in or below concrete building slabs.
- G. Unless shown otherwise, do not install conduit horizontally in concrete slabs.
- H. Roof penetrations shall be made in adequate time to allow the roofing installer to make proper flashing. Conduit for equipment mounted on roof curbs shall be routed through the roof curb. Conduit, gutters, pull boxes, junction boxes, etc. shall not be routed on roof unless specified otherwise. Where specifically indicated to be routed or mounted on the roof, supports shall be as specified, as recommended by roofing manufacturer and roof support manufacturer and as required by NEC. Place supports every five feet along conduit run and within 3 feet of all bends, condulets, and junction boxes. Provide roofing pad under stands as directed by Architect and as recommended by roofing manufacturer and roof support manufacturer. Provide additional unistrut supports and accessories as required.
- I. PVC coated conduit shall have all nicks and cuts to the protective coating repaired using manufacturer's approved touch-up material as recommended by manufacturer. Provide a minimum of two-wraps of 3M-50 type tape over touch-up.
- J. Installation of the PVC Coated Conduit System shall be performed in accordance with the Manufacturer's Installation Manual. To assure correct installation, the installer shall be certified by Manufacturer to install coated conduit. Submit copies of training certification with submittal. Contractor shall coordinate installation with manufacturer's representative for field training and observation of installed PVC coated rigid galvanized conduit and fittings. Manufacturer's representative shall certify the installation is in accordance with manufacturer's installation instructions. Submit copies of installation certification prior to cover-up of underground installation.
- K. All conduit terminations at locations including but not limited to, switchgear, pull boxes, outlet boxes, stub-up, and stub-outs:
 1. Provide insulated throat connectors for EMT conduits.
 2. Provide insulated bushing on all rigid conduit terminations.
 3. Provide locknuts inside and outside of all boxes and enclosures.
 4. Provide threaded type plastic bushing at all boxes and enclosures
- L. In suspended ceilings, support conduit runs from the structure, not the ceiling system construction.
 1. Do not support from structural bridging.

2. Do not support from metal roof deck.
- M. Completely install each conduit run prior to pulling conductors. All boxes are to be accessible after completion of construction.
- N. All conduits must be kept dry and free of water or debris with approved pipe plugs or caps. Cap or plug conduit ends prior to concrete pours.
- O. Ream ends of conduits after cutting and application of cutting die to remove rough edges.
- P. Install all above concrete slab conduits perpendicular or parallel to building lines in the most direct, neat and workmanlike manner.
1. Cable Tension:
 - a. 0.008 lb./cmil for up to 3 conductors, not to exceed 10,000 pounds.
 - b. 0.0064 lb./cmil for more than 3 conductors, not to exceed 10,000 pounds
 - c. 1000 lbs. per basket grip.
 2. Sidewall pressure: 500 lbs./ft.
 3. Conduit runs within the following limits of bends and conduit length between pull points shall not exceed the above installation pulling tension and sidewall pressure limits.
 - a. Three (3) equivalent 90-degree bends: not more than fifty feet (50') between pull points.
 - b. Two (2) equivalent 90-degree bends: not more than one hundred feet (100') between pull points.
 - c. One (1) equivalent 90-degree bend: not more than one hundred fifty feet (150') between pull points.
 - d. Straight pull: not more than two hundred feet (200') between pull points.
 4. Indicate sizes of conduits, wireway sections, and cable tray sections on the as-built drawings.
 5. Hold horizontal and vertical conduits as close as possible to walls, ceilings and other elements of the building construction. Conduits shall be kept a minimum of 6 inches clear of roof deck / insulation, and 2 inches clear of above floor deck / insulation.
 6. Install conduits to conserve building space and not obstruct equipment service space or interfere with use of space. Conduit shall not be routed on floors, paved areas or grade.
 7. Where a piece of equipment is wired from a switch or box on adjacent wall, the wiring shall go up the wall from the box, across at or near the ceiling, and back down to the equipment. Wiring shall not block the walkway between wall and equipment.
 8. Horizontal runs of conduit on exposed walls shall be kept to a minimum.
 9. Conduit for mechanical / plumbing equipment installed outdoors shall be routed with the associated mechanical / plumbing pipe support rack system where practical, coordinate with Divisions 22 and 23.
 10. Conduits installed in public areas, not concealed by architectural ceilings, shall be supported by galvanized steel channel racks to bottom of roof deck or floor deck. Conduits shall be grouped for neat workman-like appearance.
- Q. Install expansion and deflection fittings and bonding jumpers on straight runs which exceed 200-feet, on center, and at 200-feet maximum, on center, on straight runs which exceed 400-feet, and where conduits cross building expansion joints.
- R. Provide grounding bushings at concentric/eccentric knockouts or where reducing washers are used.
- S. Run conduit to avoid proximity to heat producing equipment, piping surfaces with

temperatures exceeding 104 degrees F., and flues, keeping a minimum of 13-inches clear.

- T. Install conduit as a complete system, without conductors, continuous from outlet to outlet and from fitting to fitting. Make up threaded joints of conduit carefully in a manner to ensure a tight joint. Fasten the entire conduit system into position. A run of conduit between outlet and outlet, between fitting and fitting, or between outlet and fitting shall not contain more than the equivalent of four quarter bends, including those bends located immediately at the outlet or fitting.
- U. Conceal conduit systems in finished areas. Conduit may be exposed in mechanical and electrical rooms, and where otherwise shown or indicated only. Run the conduit parallel and perpendicular to the structural features of the building and support with malleable iron conduit clamps at intervals as required by NEC or on conduit racks, neatly racked and bent in a smooth radius at corners.
- V. Conduit bends shall be factory elbows or shall be bent using equipment specifically designed to bend conduit of the type used to maintain the conduit's UL listing. Conduit hanger spacing shall be 10 feet or less and as required by the NEC for all conduit. Beam clamp attachments to steel joist chords is prohibited. Beam clamps may only be used at beams, no exceptions. Connections to joists shall be made with galvanized channel extended between joist chords or with galvanized channel bearing on the vertical legs of joist chord angles.
- W. Support conduit on galvanized channel, using compatible galvanized fittings (bolts, beam clamps, and similar items), and galvanized threaded rod pendants at each end of channel and secure raceway to channel and channel to structure. Where rod pendants are not used, channel supports are to be secured to structure at each end. Conduit supports are to be secured to structure using washers, lock washers, nuts and bolts or rod pendants; use of toggle bolt "wings" are not acceptable. Support single conduit runs using a properly sized galvanized conduit hanger with galvanized closure bolt and nut and threaded rod. Raceway support system materials shall be galvanized and manufactured by Kindorf, Unistrut, Superstrut, Caddy, or Spring Steel Fasteners, Inc. Provide chrome or nickel-plated escutcheon plates on conduit passing through walls and ceilings in finished areas. Do not support conduit from other conduit, structural bridging or fire rated ceiling system. Do not support more than one conduit from a single all-thread rod support. Provide electrical insulating sleeve or wrapping for aluminum conduit supported by zinc coated supports or fasteners. Channel supports shall have cut ends filed smooth. When installed outside of the building, or in areas subject to moisture, the cut ends shall be painted with ZRC galvanized paint or equivalent.
- X. Terminate all motor connection conduits in mechanical room spaces with a floor pedestal and with "Tee" conduit at motor outlet height for flexible conduit.
- Y. Where conduit is not embedded in concrete or masonry, conduit shall be firmly secured by approved clamps, half-straps or hangers. Tie wire and short pieces of conduit used as supports and or hangers are not approved.
- Z. Where "LB" condulets are used, 2-inches and larger shall be type "LBD".
- AA. No more than 12 conduits containing branch circuits may be installed in junction boxes, pull boxes or gutters.
- BB. Flexible metal conduit and liquid tight flexible metal conduit shall only be used for final connections from junction box to equipment, light fixtures, power poles, etc. They are not to be used in lieu of conduit runs. They shall not be used for wall or roof penetrations

unless they are installed in a PVC coated RGC conduit sleeve at least one size larger than the OD of the flexible conduit.

- CC. Where 3-1/2-inch conduit is specified and the required or specified material is Schedule 80 PVC, provide 4-inch conduit.
- DD. "Daisy Chaining" light fixtures installed for lay-in ceiling areas is not allowed. Each light fixture shall have its own fixture whip from junction box. The only exception being light fixtures installed end to end using chase nipples between them, or light fixtures recessed in non-accessible ceilings.
- EE. In above ceiling applications, do not install raceways, junction boxes, gutters, disconnects, etc. within 36 inches directly in front of HVAC control boxes or other equipment requiring access from a point starting from the top of control box / equipment down to ceiling.
- FF. Do not install conduit, junction boxes, etc. within 18 inches of outside edges of roof access openings.
- GG. Install minimum size 2-inch nipple, at least one, between multi-sectional panels for branch circuit independent of feeder conductors.

3.2 CONDUITS

- A. Conduit above grade indoors:
 - 1. Concealed Conduits: EMT with set screw fittings
 - 2. Exposed conduits:
 - a. Below nine feet AFF where not directly attached and against building walls, ceiling, or structure: Rigid metal conduit or x-wall RTRC.
 - b. Where subject to physical damage: Rigid metal conduit or x-wall RTRC.
 - c. Wet locations: PVC coated galvanized rigid steel or aluminum conduit
 - d. Damp Locations: Aluminum rigid conduit or x-wall RTRC.
 - e. Exposed conduits in mechanical rooms or electrical rooms shall be rigid galvanized steel or x-wall RTRC when installed below 18-inches above finished floor.
- B. Conduit installed above grade outdoors:
 - 1. Galvanized rigid steel or x-wall RTRC for conduits up utility poles and where subject to physical damage or where located less than four feet above finished floor.
 - 2. Aluminum or x-wall RTRC where not subject to physical damage and where located four feet above finished floor.
- C. Conduit where indicated underground:
 - 1. PVC Coated Galvanized rigid steel or RTRC conduit elbows and Schedule 80 PVC, RTRC, or PVC coated galvanized steel straight run conduits. PVC conduits for underground branch circuits shall be Schedule 80 or Schedule 40 PVC.
 - a. PVC conduit and fittings shall be used only for straight horizontal runs and for vertical risers at site lighting pole bases. Bending straight sections of PVC conduit to less than 25-foot radius or the use of PVC factory bends is not allowed.
 - b. Change in direction of conduit runs, either vertical or horizontal, shall be with RTRC or PVC coated galvanized steel elbows or long sweep bends of straight PVC conduit sections. Long sweep bends of straight PVC 20-foot sections shall have a minimum radius of curvature of 25 feet and a maximum arc of 22.5degrees. Multiple long sweep bends of straight PVC

- sections shall be separated by a minimum of 20-feet of straight, linear, PVC sections.
- c. Provide RTRC or PVC coated rigid galvanized steel conduit elbows and fittings with urethane interior coating at all changes in direction with radius of less than 25-feet and at all vertical runs to 18 inches above finished floor elevation. For interior slab penetrations, provide continuous RTRC or PVC coated rigid galvanized steel conduit and fittings with urethane interior coating from change in direction to 18 inches above finished floor elevation, except where stubbed-up under and inside equipment or switchgear where conduit shall be terminated at minimum two inches above concrete housekeeping pad.
 - d. Elbows for underground electrical service entrance, feeders, transformer primary / secondary, telecommunication, and low voltage conduits shall be RTRC or PVC coated rigid galvanized steel with long radius as follows:
 - 1) Up to 1-inch conduit, minimum 12-inch radius.
 - 2) 1.5-inch conduit, minimum 18-inch radius.
 - 3) 2-inch conduit, minimum 24-inch radius.
 - 4) 2.5-inch conduit, minimum 30-inch radius.
 - 5) 3-inch conduit, minimum 36-inch radius.
 - 6) 3.5 to 6-inch conduit, minimum 48-inch radius.
 - e. Conduit for all floor boxes shall be routed below building slab from floor box to nearest column, wall, or as indicated.
 - f. Conduits shall not be routed horizontally in building slab, grade beams or pavement.
2. Encase all underground conduits in concrete.
 - a. Concrete shall be tinted red throughout with a ratio of 10 pounds of dye per yard of concrete unless prohibited by utility for utility conduits. Concrete encasement for utility installed conductors shall be as specified by the utility and comply with their standards and specifications. Where utility does not require but allows concrete encasement of conduits, provide concrete encasement as specified herein.
 - b. Provide minimum 3-inch concrete encasement around conduits.
 - c. Provide conduit spacers for parallel branch/feeder conduits.
 - d. When prior written approval from Owner and Architect to omit concrete encasement of conduits below building slab is given, conduits either specified or approved in writing to be routed under building slab without concrete encasement for electrical branch circuits or voice / data / video / communications horizontal drops or outlets shall be installed 18 inches below finished floor and on select fill. All other conduits, including but not limited to electrical feeders, voice / data / video / communications vertical, riser, tie, trunk, or service cable conduits shall be installed 48-inches below finished floor and on select fill.
 - e. Use suitable manufactured separators and chairs installed 4 feet on centers. Securely anchor conduit at each chair to prevent movement during backfill placement.
 3. Install building voice / data / video / communications main service conduits and electrical service transformer primary and secondary conduits with top of concrete encasement minimum 48-inches below finished grade or pavement. Voice / data / video / communications conduits and electrical service primary conduits for utility owned electrical service transformers shall also comply with the respective utility company requirements and standards. All other underground conduits outside of building other than voice / data / video / communications main service conduits and electrical service transformer primary and secondary conduits shall have top of concrete encasement at 36 inches minimum below finished grade or pavement.

4. Provide two "caution" plastic tapes at 6-inches and 18-inches below finished slab, grade, or pavement; identify as specified in Section 26 05 00.
 5. Conduits located outside building, provide magnetic locator tape at top of first compacted layer of backfill or concrete.
 6. During construction, partially completed underground conduits shall be protected from the entrance of debris such as mud, sand, and dirt by means of conduit plugs. As each section of the underground conduit is completed, a testing mandrel with diameter ¼-inch smaller than the conduit, shall be drawn through each conduit. A brush with stiff bristles shall be drawn through until conduit is clear of particles of earth, sand, or gravel. Conduit plugs shall then be installed.
 7. Utility underground conduit for Utility Company cable shall be installed per Utility Company standards, and their specifications for this project.
 8. Concrete shall be Portland Cement conforming to ASTM-C-150, Type 1, Type III or Type V if specified. Cement content shall be sufficient to product minimum strength of 2,500 PSI.
 9. Contractor shall stake out routing and location of underground conduits using actual field measurements. He shall obtain approval of the Owner and Architect before beginning trenching, horizontal drilling, and excavation.
 10. Verify location and routing of all new and existing underground utilities with the Owner and Architect on the job site. Stake out these existing utilities so that they will not be damaged. Stake out new utilities to provide coordination with other trades and with new and existing utilities, easements, property lines, restricted land use areas, and right-of-ways. Verify existing public utilities with Call811.
- D. Conduit shown in concrete walls, floor or roof slab:
1. PVC Coated Galvanized Rigid steel.
- E. Conduits that penetrate concrete slab, or within 100 feet of cooling towers, or at designated corrosive locations.
1. RTRC.
 2. PVC coated galvanized rigid steel.
- F. Connections to equipment mounted on roof, rotating equipment, transformers, and kitchen or food processing equipment, or where flexible conduit is required outdoors.
1. Liquid tight flexible metal conduit (1/2 inch may be used for roof top supply / exhaust fans only).
 2. Liquid tight flexible metal conduit for 24-inch maximum length.
 3. Conduit for roof-mounted equipment shall be routed inside the roof curb assembly roof opening. Provide permanent lock-off device at panelboard circuit breakers serving roof equipment and accessories to enable tag-out procedures for all power routed through roof curb and to the roof mounted equipment and accessories.
- G. Light fixture whips:
1. Accessible ceilings and open structure: ½-inch flexible steel conduit or steel MC cable, length not to exceed 6-feet.
 2. Non-accessible ceilings: ½-inch flexible steel conduit. Length as required to make a tap at an accessible j-box. Recessed light fixtures in non-accessible ceilings may be daisy chained using the light fixture's integral, UL listed j-box or internal wire way that is accessible through fixture from below the ceiling.
 3. Dedicated insulated ground wire.
 4. Light fixture whips shall not rest on ceiling grid or tile.
 5. Light fixture whips shall not be supported from the ceiling suspension system. Support from the structure with #13 AWG galvanized iron wire pendants and Caddy clips. Do not support conduit from structural bridging. Flexible conduit and steel MC cable shall be kept a minimum of 2 inches clear of roof deck.

- H. Conduits at Natatorium or therapeutic pool areas:
 - 1. Underground conduit shall be as specified in this section.
 - 2. Exterior conduits and boxes within 100 feet of exhaust openings shall be x-wall RTRC or PVC coated galvanized rigid steel or stainless steel.
 - 3. Exposed conduits in chemical storage rooms, pool mechanical equipment (pump rooms, and pool equipment storage rooms shall be Schedule 80 PVC. Boxes shall be PVC, or 304 Stainless Steel.
 - 4. Exposed conduits and boxes in indoor pool areas and all other indoor public areas shall be Type 304 Stainless Steel.

- I. Conduits located inside greenhouses and natatorium pump and water treatment rooms:
 - 1. X-wall RTRC.
 - 2. Schedule 80 PVC.
 - 3. PVC coated galvanized rigid steel conduit and fittings.

- J. Conduits in classified hazardous (Classified) locations:
 - 1. Conduit fittings and seals UL listed for the classification.

- K. Conduits embedded in parking structure traffic wearing surface and concrete support structures:
 - 1. Schedule 40 PVC, RTRC, PVC coated rigid galvanized conduit.
 - 2. Schedule 40 ENT may only be used for flat runs embedded in traffic wearing surface concrete topping.
 - 2. Solvent welded fittings only for PVC conduit and ENT.
 - 3. Verify with Structural Engineer prior to construction for any additional limitations for raceway installation restrictions installed in parking structure including but not limited to maximum outside diameter of raceways permitted to be used in the wearing surface, and field cutting or drilling through parking structure structural members or support structures.
 - 4. All raceways shall be securely fastened to prevent floating during concrete installation. ENT raceways shall be completely embedded in concrete material to maintain fire and smoke integratory as required by the NEC.
 - 5. When using ENT or PVC conduits, provide transition to x-wall RTRC or PVC coated rigid galvanized conduit elbows and vertical risers to ensure that only flat horizontal runs of PVC conduit or ENT are used along the top of the parking structure structural support deck and that they are completely concealed and embedded by the wearing surface concrete material topping.

3.3 CONDUIT PENETRATIONS, SLEEVES AND ESCUTCHEONS

- A. Furnish sleeves for placing in construction for all conduit passing through concrete or masonry walls, partitions, beams, all floors other than grade level, and roofs. A conduit sleeve shall be one size larger than the size of conduit, which it serves except where larger sizes are required for manufactured water, fire, or smoke stop fittings.
 - 1. Sleeves set in concrete floor construction shall be minimum Schedule 40 galvanized steel.
 - 2. Sleeves shall extend 3-inches above the finished floor.

- B. Sleeves in concrete or masonry walls shall be RTRC or Schedule 40 galvanized steel. Sleeves shall be set flush with finished wall.

- C. Install manufactured UL listed water, fire, and smoke stop fittings, or caulk around conduit or cables in sleeves with sufficient UL listed fire safe insulation or foam to maintain wall or floor slab fire or smoke rating. Refer to Architecture drawings for locations of rated walls.

- D. Provide Linkseal Mechanical Seals around conduit penetrations through walls below grade. Provide a pull box to install a water stop inside wall penetration. Internally seal low voltage cabling conduit penetrations with waterproof caulking.
- E. Sleeves penetrating walls below grade shall be Schedule 40 black steel pipe with ¼-inch thick steel plate secured to the pipe with continuous fillet weld. The plate shall be located in the middle of the wall and shall be 2-inches wider all around than the sleeve that it encircles. The sleeve should extend a minimum of 24-inches on either side of the penetration. The entire assembly shall be hot-dipped galvanized after fabrication. Do not sleeve or penetrate grade beams.
- F. Conduit passing through the housing on connected equipment shall pass through a cleanly cut hole protected with a threaded steel bushing. Route conduit through roof openings, for piping and ductwork or through suitable roof jack, with pitch pocket. Coordinate location with roofing installation as required.
- G. Conduit passing through fire rated wall shall be sealed with Fire Stop. Route conduit to preserve fire resistance rating of partitions and other elements, using materials and methods under the provisions of Division 7.

3.4 POWER DISTRIBUTION UNDERGROUND FEEDER CONDUIT AND UNDERGROUND SERVICE ENTRANCE CONDUIT

- A. Power underground feeder and service entrance shall be of individual conduit encased in concrete. Unless shown otherwise, the type of conduit used shall not be mixed in any one underground conduit and shall be the size indicated on the drawings. The concrete encasement surrounding the underground conduit shall be rectangular in cross-section, having a minimum concrete thickness of 3-inches, except that conduit for 120V and above shall be separated from control and signal conduits by a minimum concrete thickness of 3-inches. Encasement concrete shall be tinted in red.
- B. During construction, partially completed underground conduits shall be protected from the entrance of debris such as mud, sand, and dirt by means of conduit plugs. As each section of the underground conduit is completed, a testing mandrel shall be drawn through until each conduit is clear of particles of earth, sand, or gravel. Conduit plugs shall then be installed.
- C. Furnish the exact dimensions and location of power underground conduit to be encased in time to prevent delay in the concrete work.
- D. Conduit for service entrance underground conduits shall be as indicated on the drawings.
- E. Primary power underground conduit shall be installed in accordance with utility company standards and the utility company specifications for this project.

3.5 TELECOMMUNICATIONS, LOW VOLTAGE AND EMPTY CONDUIT SYSTEM RACEWAYS

- A. Conduit shall be installed in accordance with the specified requirements for conduit and with the additional requirements that no length of run shall exceed 100-feet for 1 inch or smaller trade sizes and shall not contain more than two 90-degree bends or the equivalent. Pull or junction boxes shall be installed to comply with these requirements. Provide plastic bushings at all conduit terminations. Provide a grounding bushing on each data and voice conduit.
- B. Conduits shall be installed from outlet box to above an accessible ceiling. All cables routed through open spaces (no-ceiling below roof deck or above floor deck) shall be

routed in conduit. Telecommunications systems, CATV, CCTV, fire alarm and BMCS cables can be installed above accessible ceilings without conduit. Cables installed above accessible ceiling shall be plenum rated. Conduit rough in of these cables shall include a 90-degree turn-out to an accessible location with insulated bushings on the end of the conduit.

1. Provide conduit from each telecommunications outlet box to accessible ceiling plenum.
 2. Provide conduit from each security / surveillance device outlet box to accessible ceiling plenum.
 3. Provide two conduits for each multi-media outlet box and each outlet box indicated to contain more than four data, audio, or video drops to accessible ceiling plenum.
 4. Provide the following minimum conduits for telecommunications and multi-media wall, floor, and ceiling mounted outlet boxes. Use the largest diameter conduit indicated below unless instructed otherwise in writing from the Architect:
 - a. Non-masonry outlet box: Two 1-inch conduits.
 - b. Masonry outlet box: Two 1-inch conduits, or three 3/4-inch conduits.
 - c. Where indicated differently on plans or where conflicts arise, notify the Architect / Engineer prior to installation.
- C. All conduit in which cable is to be installed by others shall have pull string installed. The nylon pull string shall have not less than 200 lb. tensile strength. Not less than 12-inches of slack shall be left at each end. Provide blank cover plate before substantial completion if box is for a future installation after substantial completion of the project. Conduit shall extend to a minimum six inches above nearest accessible ceiling and be turned horizontally with plastic bushing at terminations.
- D. Conduits for Building Entrance Facilities:
1. Underground Outside Plant: Install a pull box every 300-feet or after 180 degree turns.
 2. Inside Plant: Install a pull box every 150-feet or after 180 degree turns. All turns shall be large sweeps, not sharp 90s, with the radius of the sweep at least 10X the diameter of the conduit. Hence, a 4-inch conduit requires a 40-inch minimum radial sweep. If field conditions absolutely mandate a sharp 90-degree bend to be installed, then a pull box shall be installed at that location regardless of distance.
 3. Building entrance facilities shall not terminate in an IDF or any other space except the MDF.
 4. Coordinate the termination location of the building entrance facilities in the MDF with the room layout and equipment configuration.
 5. Provide 4-inch conduit unless indicated otherwise. Provide (3) fabric innerducts in each 4-inch conduit.

3.6 ALUMINUM ALLOY CONDUCTORS

- A. Where aluminum alloy conductors are specified, approved and substituted for copper conductors, provide the required conduit size based on conduit fill using NEC or recognized cable manufacturer's conduit fill tables for aluminum alloy compact conductors.

3.7 IDENTIFICATION

- A. Conduit Systems: Provide adequate marking of conduit larger than one inch exposed or concealed in interior accessible spaces to distinguish each run as either a power (120/208V or 277/480V) or signal / telecommunication conduit (Fire Alarm, BAS, BMCS, Security, CCTV, Access Control, Intrusion Detection, Telecom, etc.). Except as otherwise

indicated, use orange banding with black lettering. Provide self-adhesive or snap-on type plastic markers. Locate markers at ends of conduit runs, near switches and other control devices, near items of equipment served by the conductors, at points where conduit passes through walls or floors or enters non-accessible construction, and at spacing of not more than 50-feet along each run of exposed conduit. Switch-leg conduit and short branches for power connections need not be marked, except where conduit is larger than 1-inch.

END OF SECTION

SECTION 26 05 35

ELECTRICAL CONNECTIONS FOR EQUIPMENT

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Electrical connections as required and scheduled, and as specified.

1.2 RELATED WORK

- A. Refer to other Divisions for specific individual equipment electrical requirements.

1.3 QUALITY ASSURANCE

- A. UL Label: Products shall be UL listed to the extent possible.

PART 2 - PRODUCTS

2.1 MATERIALS AND COMPONENTS

- A. General: For each electrical connection indicated, provide a complete assembly including, but not limited to, pressure connectors, terminals (lugs), electrical insulating tape, heat-shrinkable insulating tubing, cable ties, solderless wire nuts, and other items and accessories needed to complete splices and terminations.
- B. Raceways: Refer to related sections.
- C. Conductors and Connectors: Refer to related section. Conductors at equipment terminations shall be copper.
- D. Terminals: Provide electrical terminals as indicated by the terminal manufacturer for the application.

PART 3 - EXECUTION

3.1 INSTALLATION OF ELECTRICAL CONNECTIONS

- A. General: Install electrical connections as shown, in accordance with applicable portions of the NECA Standard of Installation, and industry practices.
- B. Conductors: Connect electrical power supply conductors to equipment conductors in accordance with equipment manufacturer's written instructions and wiring diagrams. Where possible, match conductors of the electrical connection for interface between the electrical supply and the installed equipment.
- C. Splice Insulation: Cover splices with electrical insulation equivalent to, or of a higher rating than, insulation on the conductors being spliced.
- D. Appearance: Prepare conductors by cutting and stripping covering, jacket, and insulation to ensure a uniform and neat appearance where cables and wires are terminated.
- E. Routing: Trim cables and wires to be as short as practical. Arrange routing to facilitate inspection, testing, and maintenance.

- F. Motor Connections: Where possible, terminate conduit in conduit boxes at motors. Where motors are not provided with conduit boxes, terminate the conduit in a suitable conduit, and make motor connections. Conduit passing through the housing on connected equipment shall pass through a cleanly cut hole protected with an approved grommet. For all AHU or fan motors and all other motors 10 HP and larger, at the motor connection do not use wire nuts. Provide copper alloy split bolt connectors or compression lugs and bolts. Insulate connection with Scotch Super 88 vinyl electrical tape over rubber tape, or Tyco Gelcap Motor Connection Kit.
- G. Conduit connections to equipment including, but not limited to, Variable Frequency Drives, Manual and Automatic Transfer Switches, Surge Suppression Devices, motor controllers, electrical disconnects, food service / processing equipment, electronics, control panels and Owner furnished equipment:
1. Make conduit penetrations only at the bottom flat surface of the equipment and only where permitted by the equipment manufacturer to avoid un-intentional water entry. Coordinate installation of electrical connections for equipment with equipment installation work. Where equipment manufacture does not permit a bottom conduit entry, verify with Owner/Engineer and locate the conduit entry at the side surface as close as possible to the bottom of the enclosure.
 2. Where conduit originates from an elevation above the conduit entry, provide a "T" conduit below the enclosure's bottom elevation. Provide conduit from the conduit up to the enclosure bottom horizontal surface for electrical connection.
- H. Identification: Refer to Electrical General Provisions for identification of electrical power supply conductor terminations with markers approved as to type, color, letter and marker size by the Architect. Fasten markers at each termination point, as close as possible to each connecting point.
- I. Equipment and Furnishings: Refer to other Divisions. Coordinate power and control provisions shown for equipment and furnishings with the provisions required for the furnished equipment and furnishings. Where the power and control requirements are less than or equal to those specified, modifications to power and control provisions shall be made at no cost as a part of coordination. Where power and control requirements are in excess of those shown, notify the Architect in writing of the requirements.

END OF SECTION

SECTION 26 05 36

SURFACE NON-METALLIC RACEWAY

PART 1 - GENERAL

1.1 DESCRIPTION OF WORK

- A. Furnish and install a complete system of electrical surface nonmetallic raceways.
- B. This specification covers a surface nonmetallic raceway system used for branch circuit wiring and/or data network, voice, video, and other low-voltage cabling. The nonmetallic raceway system shall consist of raceway, appropriate fittings, and accessories to complete installation.

1.2 CLASSIFICATION AND USE

- A. Surface nonmetallic raceway shall be utilized in dry interior locations only as covered in Article 352 part B of the National Electrical Code, as adopted by the National Fire Protection Association and as approved by the American National Standards institute. The raceway system shall be listed by Underwriter's Laboratories UL-5A.

1.3 SUBMITTALS

- A. Shop Drawings: Submit drawings for review showing the complete layout of all products that make up the complete system for each installation prior to installations with device type (power and data), locations, and circuits identified.
- B. Mark up a copy of the specifications for the product. Indicate in the margin of each paragraph the following: "Comply", "Do Not Comply", or "Not Applicable". Explain all "Do Not Comply" statements.
- C. As-Built Drawings: If variations from the approved shop drawings occur during the installation of the system, final, as-built drawings shall be submitted for each item that has been altered.

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. The surface nonmetallic raceway system specified herein for branch circuit wiring and/or data network, voice, video, and other low-voltage cabling shall be the Panway TG-70 System or PD Profile System as manufactured by the Panduit Corporation.

2.2 MATERIALS

- A. The raceway and all system components shall be UL Listed and exhibit nonflammable self-extinguishing characteristics, tested to comparable specifications of UL94V-0. The raceway base, cover, and divider shall be available in 8' and 10' lengths. Raceway color shall be white.
- B. Dual Channel Raceway:
 - 1. The raceway shall be a two-piece design with a base and snap-on cover. The raceway shall maintain complete separation of the power and data channels. Total width shall be 5.32" by 2.68" deep with an approximate wall thickness of .125".

- a. The base shall have a 70mm opening, its own 70mm cover and features for mounting device brackets, hanging boxes, wire retainers and snap on faceplates. Divider walls, which snap onto the base to form additional wiring channels, but be available the base shall be manufactured of rigid PVC compound.
 - b. The cover (T70C) shall have flanges for snapping onto the base. The cover shall be manufactured of a rigid PVC compound. The base and cover shall be off-white electrical ivory.
 - c. The divider wall (TGDW) shall have flanges that snap onto the TG-70 base. The divider shall be manufactured of a rigid PVC compound. The divider shall have a smooth texture and be light gray in color.
2. Fittings: A full complement of fittings (TG series) shall be available including but not limited to flat elbows, internal and external elbows with adjustable angles, tee with insert to separate power and data cabling, cover couplers, base couplers, and end caps. A snap-on transition fitting shall be available to adapt to Panduit T-45, LDP10, LDP5 and LDP3 series raceways. The fittings shall provide a means for connecting to the raceway base and shall be capable of maintaining a 40mm minimum cable bend radius. The fittings shall be manufactured from a rigid PVC (or ABS/PC) compound. They shall overlap the cover and base to hide uneven cuts. All fittings shall be supplied with a base where applicable to eliminate mitering. The fitting color shall match the base and cover color.
 3. Accessories: Device brackets and hanging boxes shall be available for mounting standard devices in-line within the raceway. Faceplates shall be a Pan-Way Snap-On faceplate to match and fit flush with the device bracket. Faceplate color shall match the raceway base and cover.
- C. Single Channel Raceway:
1. The raceway shall be a one-piece solid raceway. Total width shall be 1.01" by 0.55" deep.
 2. Fittings: A full complement of fittings (LDS series) shall be available including but not limited to flat elbows, internal and external elbows, tee, cover couplers, base couplers, and end caps. The fittings shall provide a means for connecting to the raceway base and shall be capable of maintaining a 40mm minimum cable bend radius. The fittings shall be manufactured from a rigid PVC (or ABS/PC) compound. They shall overlap the cover and base to hide uneven cuts. All fittings shall be supplied with a base where applicable to eliminate mitering. The fitting color shall match the base and cover color.
 3. Accessories: Device brackets and hanging boxes shall be available for mounting standard devices in-line within the raceway. Faceplates shall be a Pan-Way Snap-On faceplate to match and fit flush with the device bracket. Faceplate color shall match the raceway base and cover.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Provide surface non-metallic raceway only where indicated on the drawings, and only at renovation construction areas where routing conduits or MC cable concealed in existing masonry or concrete block walls is impossible or impractical. Otherwise, raceway shall be provided as specified in Section 26 05 33 Conduit Systems. Prior to construction Contractor shall identify and coordinate with Owner/Architect all locations requiring surface raceway and identify possible alternatives to surface raceway.

- B. Provide dual channel raceway where branch circuit devices are indicated with or adjacent to other non-branch circuit devices. Provide single channel raceway where only branch circuit or only non-branch circuit devices are indicated or required.
- C. Prior to and during installation, refer to system layout drawing containing all elements of the system.
- D. Work shall include furnishing all raceway and appropriate fittings and device plates to install a nonmetallic surface raceway system as indicated in the electrical drawings and in the specification. Installer shall comply with detailed manufacturer's instruction sheets that accompany system components as well as system instruction sheets.
- E. Install surface raceways and fittings in accordance with local codes and applicable sections of the NECA "Standard of Installation".
 - 1. Fasten surface raceway supports to building structure and surfaces.
 - 2. Arrange supports to prevent misalignment during wiring installation.
 - 3. Maintain 12-inch clearance between surface raceway and surfaces with temperatures exceeding 104 degrees F.
 - 4. Cut raceway square as recommended by manufacturer.
 - 5. Ground and bond surface raceway as required.
 - 6. Securely fasten surface raceway supports, boxes, to ceiling, walls, with Rawl Plugs or approved equal anchors. Use lead cinch anchors or pressed anchors for heavy strain. Use only zinc plated or galvanized bolts, screws.
 - 7. Route all surface raceways perpendicular or parallel to building lines.
 - 8. Completely install each surface raceway run prior to pulling conductors. All surface raceways are to be accessible after completion of construction.
- F. All surface raceways must be kept dry and free of water or debris.
- G. Install all surface raceways in the most direct, neat and workmanlike manner to conserve building space and not obstruct equipment service space or interfere with use of space.
- H. Run surface raceway to avoid proximity to heat producing equipment, piping, and flues, keeping a minimum of 8-inches clear.
- I. Install surface raceway as a complete system, without conductors, continuous from outlet to outlet and from fitting to fitting. Fasten the entire surface raceway into position.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 05 37

ELECTRICAL BOXES AND FITTINGS

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide electrical box and fitting work as required, scheduled, indicated, and specified.

1.2 QUALITY ASSURANCE

- A. UL Label: Electrical boxes and fittings shall be UL listed.

PART 2 - PRODUCTS

2.1 FABRICATED MATERIALS

- A. Interior Outlet Boxes: Provide galvanized steel interior outlet wiring boxes, of the type, shape, and size, including depth of box, to suit respective locations and installation. Construct with stamped knockouts in back and sides. Provide gang boxes where devices are shown grouped. Single box design; sectional boxes are not acceptable, except for wall mounted electronic displays.
 - 1. Type of Various Locations:
 - a. Wall mounted interactive media boards, video displays, televisions, electronic signage and similar installations; recessed wall mounted box for power and/or multi-media (low voltage) outlets: Arlington Industries #TVBS 613, 4-gang steel box with white trim plate.
 - b. Technology, data, voice, video and multi-media outlet boxes at locations other than wall mounted interactive media boards, video displays, televisions, electronic signage and similar installations: minimum 4-inch square (2-gang), 3-inch deep interior outlet boxes. Raco #260H large capacity box with ½ through 2-inch knockouts.
 - c. Security, access control, and video surveillance outlet boxes: single gang, 3-inch deep outlet boxes mounted long axis vertically.
 - d. All other applications: minimum 4-inch square (2-gang) 2-1/8-inch deep boxes.
 - e. Masonry Walls: Galvanized switch boxes made especially for masonry installations; depths of boxes must be coordinated for each installation.
 - f. Surface: Type FS or FD box with surface cover.
 - g. Corrosive locations or natatorium areas: 316 stainless steel construction suitable for the installation.
 - h. Hazardous (Classified) Locations: Explosion proof boxes, seals and fittings.
 - i. Special: Where above types are not suitable, boxes as required, taking into account space available, appearance, and Code requirements
 - 2. Interior Outlet Box Accessories: Outlet box accessories required as for installation, including covers or wall device plates, mounting brackets, wallboard hangers, extension rings, plaster rings for boxes in plaster construction, fixture studs, cable clamps and metal straps for supporting outlet boxes. Accessories shall be compatible with outlet boxes used and meet requirements of individual wiring.
- B. Damp Location Outlet and Damp or Wet Location Switch Boxes: Deep type, hot dipped galvanized cast-metal weatherproof outlet wiring boxes, of type, shape, and size required. Include depth of box, threaded conduit ends, and stainless steel cover plate

with spring-hinged waterproof caps suitable for application. Include faceplate gasket and corrosion-resistant, tamper / vandal proof fasteners.

- C. Wet Location Outlet Boxes: Hot dipped galvanized cast-iron weatherproof outlet wiring boxes, of type, shape, and size required. Include depth of box, threaded conduit ends.
- D. Junction and Pull Boxes: Galvanized sheet steel junction and pull boxes, with screw-on covers, of type, shape, and size, to suit respective location and installation.
 - 1. Type for Various Locations:
 - a. Minimum Size: 4-inch square, 2-1/8-inches deep.
 - b. 150 Cubic Inches in Volume or Larger: Code gauge steel with sides formed and welded, screw covers unless shown or required to have hinged doors. All boxes mounted above ceiling shall have screw covers. Boxes in all other areas with covers larger than 12-inches shall have hinged with screw covers. Knockouts factory stamped or formed in field with a cutting tool to provide a clean symmetrically cut hole.
 - c. Exterior or Wet Areas: 304 stainless steel NEMA 4X construction with gaskets and corrosion-resistant fasteners
- E. Conduit Bodies: Provide galvanized cast-metal conduit bodies, of type, shape, and size, to suit location and installation. Construct with threaded conduit ends, removable cover, and corrosion-resistant screws.
- F. Bushings, Knockout Closures, and Locknuts: Provide corrosion-resistant punched-steel box knockout closures, conduit locknuts, and insulated conduit bushings of type and size to suit use and installation.
- G. Outlet boxes in fire rated walls: Provide 2-hour rated gasket within box and below cover, equal to Rectorseal Metacaulk box guard and cover guard.

PART 3 - EXECUTION

3.1 INSTALLATION OF BOXES AND FITTINGS

- A. Install electrical boxes and fittings as shown and as required, in compliance with NEC requirements, in accordance with the manufacturer's written instructions, in accordance with industry practices.
- B. Provide recessed device boxes for wall mounted interactive media boards, video displays, televisions, electronic signage and similar installations.
- C. Provide minimum 4-inch square (2-gang), 3-inch deep interior outlet boxes for technology, data, voice, video, and multi-media outlet boxes at locations other than wall mounted interactive boards, video or visual displays. Provide single gang only, 3-inch deep outlet boxes mounted long axis vertically for security, access control, and video surveillance, coordinate with security equipment installation. Provide minimum 4-inch square (2-gang) 2-1/8-inch deep boxes for all other applications. Where indicated differently on plans or where conflicts arise, notify the Architect / Engineer prior to installation. Box extenders or plaster rings shall not be used to increase size. Provide increased box size as required.
- D. Junction and pull boxes, condulets, gutters, located above grid ceilings shall be mounted within 18-inches of ceiling grid. Junction and pull boxes above grid ceilings shall be mounted in the same room served. Junction boxes and pull boxes required for areas with inaccessible ceilings shall be located above the nearest accessible ceiling area. All junction box or pull box openings shall be side or bottom accessible. Removal of light

fixtures, mechanical equipment or other devices shall not be required to access boxes. Outlet boxes above ceiling for low voltage terminations shall face towards the floor.

- E. Use outlet and switch boxes for junctions on concealed conduit systems except in utility areas where exposed junction or pull boxes can be used.
- F. Determine from the drawings and by measurement the location of each outlet. Locate electrical boxes to accommodate millwork, fixtures, marker boards, and other room equipment at no additional cost to the Owner. The outlet locations shall be modified from those shown to accommodate changes in door swing or to clear interferences that arise from construction as well as modifying them to center in rooms. The modifications shall be made with no cost as part of coordination. Check the conditions throughout the job and notify the Architect of discrepancies. Verify modifications before proceeding with installation. Set wall boxes in advance of wall construction, blocked in place and secured. Set all wall boxes flush with the finish and install extension rings as required extending boxes to the finished surfaces of special furring or wall finishes. Provide wall box support legs attached to stud to prevent movement of box in wall.
- G. Unless noted or directed otherwise at installation, place outlet boxes as indicated on architectural elevations and as required by local codes.
- H. Outlets above counters, mount long axis horizontally. Refer to architectural elevations and coordinate to clear backsplash and millwork.
- I. Provide pull boxes, junction boxes, wiring troughs, and cabinets where necessary for installation of electrical systems. Surface mounted boxes below 9 feet and accessible to the public shall not have stamped knockouts.
- J. Provide weatherproof boxes for interior and exterior locations exposed to weather or moisture.
- K. Provide knockout closures to cap unused knockout holes in boxes.
- L. Locate boxes and conduit bodies to ensure access to electrical wiring. Provide minimum 12-inch clearance in front of box or conduit body access.
- M. Secure boxes to the substrate where they are mounted or embed boxes in concrete or masonry.
- N. Boxes for any conduit system shall not be secured to the ceiling system, HVAC ductwork or piping system.
- O. Provide junction and pull boxes for feeders and branch circuits where shown and where required by NEC, regardless of whether or not boxes are shown.
- P. Coordinate locations of boxes in fire rated partitions and slabs to not affect the fire rating of the partition or slab. Notify the Architect in writing where modification or construction is required to maintain the partition or slab fire rating.
- Q. Exterior boxes installed within 50-feet of cooling towers or water treatment areas shall be of 304 stainless steel, weatherproof NEMA 4X construction.
- R. Identification: Paint the exterior and cover plates of building interior junction boxes and pull boxes located above accessible ceilings or non-finished areas to correspond to the following colors:
 - 1. Orange: - 480/277 VAC systems

2. Light Blue: - 240 VAC three phase delta systems.
 3. Red – All Emergency circuits, regardless of voltage, and fire alarm system.
 4. Light Green - 120/208 VAC 3 phase and 120/240 VAC single-phase systems
 5. Yellow – Building Management and Control System - BMCS
 6. White - Security and Surveillance equipment circuits
- S. All box covers shall be labeled with Panel ID and circuit numbers of all circuits available in box using permanent black marker. Boxes containing main feeders are to list where fed from and load (example “MSB to Panel HA”). Information listed is to be legible, markovers are not acceptable. Multi-sectional panel numbers are not to be listed on covers (example “LA2” referring to Panel LA sec. 2 is to be listed as “LA”). Label covers for special applications explaining contents (example “Emerg. Gen. Annunciator controls”, “IDF ground”). Do not attach box covers that have both sides painted or labeled differently. In public areas where boxes are painted same color as room per architect, label inside covers. Boxes that are not used shall be labeled as not used and include panel ID. Example “Not Used Panel LA”. Unused raceways not in sight of panel shall be terminated in a box and labeled not used and include panel identification.
- T. Align adjacent wall mounted outlet boxes for switches, thermostats, and similar devices.
- U. Use flush mounting outlet box in finished areas unless specifically indicated as being used with exposed conduit.
- V. Locate flush-mounting box in masonry wall to require cutting of masonry unit corner only. Coordinate masonry cutting to achieve neat opening.
- W. Do not install flush mounting box back-to-back in walls; provide minimum 6 inches with stud separation. Provide minimum 24 inches with separation in acoustic rated walls.
- X. Secure flush mounting box to interior wall and partition studs. Accurately position to allow for surface finish thickness. Provide UL listed materials to support boxes in walls to prevent movement. Ensure box cannot be pushed inside wall.
- Y. Use stamped steel bridges to fasten flush mounting outlet box between studs.
- Z. Install flush mounting box without damaging vapor barriers, wall insulation or reducing its effectiveness.
- AA. Use adjustable steel channel fasteners for hung ceiling outlet box.
- BB. Do not fasten boxes to ceiling support wires.
- CC. Support systems are to hang vertically straight down. All-thread supports, when used, are not to be installed at an angle or bent.
- DD. Use gang box where more than one device is mounted together. Do not use sectional box.
- EE. Use gang box with plaster ring for single device outlets.
- FF. Support outlets flush with suspended ceilings to the building structure.
- GG. Mount boxes to the building structure with supporting facilities independent of the conduits or raceways.

- HH. Where multiple feeders are in one pull box, conductors shall be wrapped with 3M No. 7700 Arc and fireproof tape.
- II. Provide plaster rings of suitable depth on all outlet boxes. Face of plaster ring shall be within 1/8 inch from finished surface.
- JJ. Equip boxes supporting fixtures designed to accept fixture studs with 3/8-inch stud (galvanized malleable iron) inserted through back of box and secured by locknut. Boxes not equipped with outlets shall have level metal covers with rust-resisting screws.
- KK. Do not mount junction boxes above inaccessible ceilings or in inaccessible spaces. Do not mount junction boxes above ceilings accessible only by removing light fixture, mechanical equipment or other devices. At inaccessible spaces use junction box furnished with light fixture or light fixture wiring compartment UL listed for through wiring.
- LL. No more than 12 conduits containing branch circuits may be installed in any junction or pull box.
- MM. All junction boxes shall be protected from building finish painters' over spray and from fire proofing overspray. Remove protective coverings when painting and fire proofing are complete.
- NN. Bond equipment grounding conductor to all junction and pull boxes.
- OO. Do not mount boxes or conduit bodies on walls directly above electrical panels or switchgear located next to walls.
- PP. Do not mount boxes or conduit bodies within 18 inches of outside edges of roof access openings.
- QQ. Box extenders or plaster rings shall not be used to increase the Code mandated cable capacity of a box. Provide proper size box.

3.2 ADJUSTING

- A. Adjust flush-mounting outlets to make front flush with finished wall material.
- B. Install knockout closures in unused box openings.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 05 40

ELECTRICAL GUTTERS AND WIREWAYS

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide electrical gutter work as shown, as specified and as required.
- B. Application: The types of electrical gutters required for the project include the following:
 - 1. Electrical wiring gutters
 - 2. Voice / Data / Video / Communication and signal distribution wireway

1.2 QUALITY ASSURANCE

- A. UL Label: Gutters and wireways shall be UL labeled.

PART 2 - PRODUCTS

2.1 ELECTRICAL GUTTERS AND WIREWAYS

- A. General: Provide hinged electrical gutters and wireways in the types and sizes indicated or required, minimum 16 gauge thickness, with rounded edges and smooth surfaces; constructed in compliance with applicable standards; with features required.
- B. Size: Provide size indicated. Where size is not indicated, construct in accordance with the NEC and other standards. Gutters shall be of manufacturer's standard lengths, without field cutting or field extensions.
- C. Accessories: Provide gutter and wireway accessories where indicated, constructed of same metal and finish as gutters or wireways.
- D. Supports: Provide gutter and wireway supports indicated, conforming to NEC, and as recommended by the manufacturer, and as specified in Section 26 05 33 Conduit Systems.
- E. Materials and Finishes: NEMA 1 gutters and wireways shall have gray powder coat finish over galvanized steel. Gutters and wireways installed outside shall be NEMA 3RX minimum. Gutters or wireways installed within 100-feet of cooling towers, at kitchen or food preparation areas, and natatorium, spa or therapy pool areas shall be of 304 stainless steel NEMA 4X construction.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Provide gutters and wireways only where specified or required. Use of gutters and wireways shall be kept to a minimum.
- B. Finishing: Remove burrs and sharp edges of gutters and wireways wherever they could be injurious to conductor insulation or jacket.
- C. Installation: Install gutters and wireways where shown or required, in accordance with the manufacturer's written instructions, NEC, NECA "Standard of Installation," and with recognized industry practices to ensure that the gutters and wireways comply with the

specified requirements. Comply with requirements of NEMA and the NEC pertaining to installation of electrical gutters.

- D. Grounding: Electrically ground gutters and wireways to ensure continuous electrical conductivity. Provide equipment grounding conductor.
- E. Conductors:
 - 1. Complete gutter and wireway installation before starting the installation of conductors.
 - 2. Provide sufficient space to permit access for installing, splicing, and maintaining the conductors.
- F. A maximum of 12 conduits containing branch circuits shall be allowed to be installed in any gutter or wireway.

END OF SECTION

SECTION 26 05 45

CABLE TRAY

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Continuous, rigid, welded steel wire mesh cable management system.

1.2 REFERENCES

- A. ASTM A 123 - Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products.
- B. ASTM A 510 - General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel.
- C. ASTM B 633 - Electrodeposited Coatings of Zinc on Iron and Steel.

1.3 DESIGN REQUIREMENTS

- A. Maximum Deflection Between Supports: $L/240$.

1.4 SUBMITTALS

- A. Provide line-by-line specification review.
- B. Product Data: Submit manufacturer's product data, including UL classification.
- C. Shop Drawings: Submit shop drawings indicating materials, finish, dimensions, and accessories. Show layout, support, and installation details.
- D. Manufacturer Qualifications: Submit manufacturer's certification indicating ISO 9002 quality certified.

1.5 QUALITY ASSURANCE

- A. Manufacturer Qualifications: ISO 9002 quality certified.
- B. A pre-construction meeting is required with Owner / Architect prior to any installation. Provide a mock-up installation for approval by Owner.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Delivery: Deliver materials to site in manufacturer's original, unopened containers and packaging, with labels clearly indicating manufacturer and material.
- B. Storage: Store materials in a dry area indoors, protected from damage, and in accordance with manufacturer's instructions.
- C. Handling: Protect materials and finishes during handling and installation to prevent damage.

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. Cablofil, Inc.
- B. Approved Equal.

2.2 CABLE MANAGEMENT SYSTEM

- A. Description: Cablofil EZ Tray continuous, rigid, welded steel wire mesh cable management system.
 - 1. Mesh System: Permits continuous ventilation of cables and maximum dissipation of heat.
 - 2. Safety Edge: Continuous safety edge T-welded wire lip.
 - 3. Wire Mesh: Welded at all intersections.
- B. UL Classification: Straight sections 4" x 6-12 inches, Cablofil #CF105 Series, UL Classified
- C. Material: Carbon steel wire, ASTM A 510, Grade 1008. Wire welded, bent, and surface treated after manufacture.
- D. Finish for Carbon Steel Wire: Finish applied after welding and bending of mesh.
 - 1. Electro-Plated Zinc Galvanizing: ASTM B 633, Type III, SC-1.
- E. Nominal Dimensions:
 - 1. Mesh: 2 x 4 inches.
 - 2. Straight Section Lengths: 10 feet
 - 3. Width: 6-12 inches
 - 4. Depth: 4 inches
- F. Fittings: Field fabricated in accordance with manufacturer's instructions from straight sections.
- G. Support System: Cablofil FAS System.
 - 1. Floor and Wall Installation: FAS
 - 2. Wall Installation:
 - a. FAS Universal Bracket. Maximum tray width of 24 inches.
 - b. FAS L Bracket. Maximum tray width of 12 inches.
 - 3. Ceiling Installation: FAS AS hanging clips for trapeze hung. FAS SF hanger for center hung.
 - 4. Under Floor Support: UFS Under Floor Support Stand.
- H. Hardware, including splice connectors and support components by manufacturer.

2.3 ACCESSORIES

- A. Grounding: GNDCL grounding lugs for attachment on tray of continuous ground conductor fixing system. Ground lugs shall be UL listed and attached to tray runs at a minimum of every 60 feet and at ends of runs. Test grounding, maximum 25 ohms.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas to receive cable management system. Notify the Engineer of conditions

that would adversely affect the installation or subsequent utilization of the system. Do not proceed with installation until unsatisfactory conditions are corrected.

3.2 INSTALLATION

- A. Install cable tray at locations indicated on the drawings and in accordance with manufacturer's instructions.
- B. Load Span Criteria: Install and support cable management system in accordance with span load criteria of L/240 and manufacturer's recommendations. Support spacing for center hung tray shall not exceed 6 feet on center.
- C. Cutting:
 - 1. Cut wires in accordance with manufacturer's instructions.
 - 2. Cut wires with side action bolt cutters to ensure integrity of galvanic protective layer.
 - 3. Cut each wire with 1 clean cut to eliminate grinding or touch-up.
- D. Install cable management system using hardware, splice connectors, support components, and accessories as recommended by manufacturer.
- E. Provide minimum six-inch separation from all light fixtures and lighting ballast. Provide minimum 12-inch separation from EMI producing sources running in parallel. Coordinate routing with other trades to conserve space above ceiling and to ensure access to cable tray system.
- F. Support cable tray with 3/8" all-thread on 5'-0" centers with manufacturer recommended support components. All-thread shall not be positioned inside the cable tray.
- G. Minimize bends and offsets during installation and provide cable waterfalls at large cable drops from tray system.
- H. Install cable tray near corner of room when entering all telecommunications closets.
- I. Cable tray shall not penetrate walls.
- J. No power cables shall be installed in cable tray.
- K. Cable tray sides are not to be cut or altered due to existing or new installations such as conduits, boxes, piping, support systems, etc.
- L. Cable tray, when installed, shall not cover any part of a box, gutter, conduit, or in any way hinder access to an item that may require maintenance activity.
- M. Cut pendant rods maximum 1 inch below nut under cable tray support.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 09 25

ELECTRICAL CONTACTORS

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Miscellaneous electrical contactors as shown, required, scheduled, and specified.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Manufacturers: Provide products produced by one of the following:
 1. Schneider Electric - Square D
 2. ABB-General Electric
 3. Siemens
 4. Eaton
 5. Approved Equal

2.2 CONTACTORS

- A. Provide contactors as shown, required, and specified. The number of poles, ampere-ratings, and pole arrangements shall be as required. Contactors shall conform to the following:
 1. Rated for continuous duty at full rated current in an unventilated enclosure. Eight-hour duty ratings are not acceptable.
 2. Contacts shall be readily replaceable, self-aligning, silver alloy.
 3. Load contactors shall be rated for not less than 30A continuous rating. Auxiliary contacts shall be rated for not less than 10 amperes.
 4. Contactors rated for lighting and mixed loads shall have an interrupting capacity of 150% of their continuous duty rating.
 5. Contactors shall be capable of successfully handling inrush currents at 20 times rating.
 6. Provide a minimum of two spare load contacts on each individual contactor rated 60A or less for future use.
- B. Electrically-held Devices shall conform to the following:
 1. AC operated units shall have laminated low loss electrical steel core pieces with machine ground pole faces and shading coils.
 2. Units rated at 300A and above shall have DC operating coils and include the necessary rectifier for the AC/DC operation.
 3. Normally open contactors shall be spring-loaded open and magnetically closed.
 4. Contactors for emergency lighting or power shall be normally closed.
- C. Controls: Individual contactors operated by automatic controls shall have 30.5mm HAND-OFF-AUTOMATIC switches, otherwise provide HAND-OFF switches. Contactor controls shall be mounted in the contactor enclosure cover. Contactors serving receptacle loads controlled by local switching shall not have Hand-Off-Auto nor Hand-Off switching.
- D. Control Power. Provide dedicated 120-volt circuit for contactor control power and indicator pilot lights. Do not use same circuit feeding load.
- E. Enclosure:
 1. Contactors and control enclosures installed in indoor locations shall be NEMA 1

- heavy-duty enclosures unless shown otherwise.
- 2. Contactors and control enclosures installed at kitchen and food preparation locations, hose down areas, cooling towers, exterior locations, in greenhouses, and in other corrosive areas shall be NEMA 4X, stainless steel.

F. Minimum interrupting rating shall be 35KAIC.

PART 3 - EXECUTION

3.1 INSTALLATION OF MISCELLANEOUS ELECTRICAL CONTROLS

- A. Provide electrically held contactors, with line side wiring complete, in accordance with the National Electrical Code and manufacturer's recommendations.
- B. Fuses: Install fuses where coil control power is fed from line side of contactor.
- C. Adjustment: Adjust operating mechanisms for free mechanical movement.
- D. Coordinate contactor control and operation requirements with the Building Management Control System.
- E. Identify each contactor as specified in Section 26 05 00.
- F. Contactors shall not be installed above ceiling and shall be readily accessible. Locate contactors in same room as panelboard serving the load unless otherwise indicated.

3.2 INTERIOR AND EXTERIOR LIGHTING CONTROL

- A. Parking lot lighting, building mounted exterior lighting, and exterior signage shall be controlled by separate lighting contactors by the specified Building Management and Control System. Interior lighting as noted on the plans shall be controlled as noted on the plans and as specified by the Building Management and Control System. Contractor shall circuit all systems to be controlled by the Building Management and Control System through contactors compatible with system controls and shall ensure the control and operation of lighting control system is complete.
- B. Provide mechanically held contactors where control is three-wire, momentary control signal.
- C. Provide electrically held contactors where control is two-wire, constant control signal for open or close.
- D. Provide normally closed contactors for emergency lighting and power circuits where contactors are indicated or required.
- E. Provide normally closed contactors for circuits controlled by "emergency power off" or teacher control switches in science classrooms, computer labs, and vocational instructional areas.
- F. Provide control contactors and cabling for bi-level or tri-level LED drivers. Bi / tri level control contactors for exterior lighting shall be controlled by the Building Management Control System, with local BMCS manual override for both "ON" and "HIGH" settings. Bi / tri level controls for interior lighting shall be controlled by occupancy sensors and local control switch.

END OF SECTION

SECTION 26 09 26

LIGHTING OCCUPANCY SENSORS – CEILING MOUNT

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide ceiling mounted occupancy sensing control devices so that lighting is turned off automatically in individual rooms or sections of rooms after a reasonable time delay when the last person leaves the room or area. Sensor wall switches are not allowed.
- B. Occupancy sensing controls shall accommodate for irregular use of rooms or areas, all individual work habits, and all occupancy habits or conditions of space utilization. Occupancy sensors must provide full volumetric coverage.

1.2 SCOPE

- A. Contractor shall furnish and install a complete and operable occupancy sensing lighting control devices, as described in the specifications herein.
- B. Work included: All labor, materials, appliances, tools, equipment necessary for and incidental to performing all operations in connection with furnishing, delivery and installation of the work of this Section, complete, as shown on the drawings and/or specified herein. Work includes, but is not necessarily limited to the following:
 - 1. Examine all other specification sections and drawings for related work required to be included as work under Division 26.
 - 2. General provisions and requirements for electrical work.
 - 3. Refer to Wiring Devices for wall switch cover plates.

1.3 QUALITY ASSURANCE

- A. Product manufacturer shall have a minimum of (5) years experience in the manufacturing of occupancy sensors.
- B. All components shall be UL listed, meet all state and local applicable code requirements.
- C. All components shall offer a five (5) year manufacturer's warranty.

1.4 SUBMITTALS

- A. Submit applicable manufacturer's specifications sheets, installation instruction, wiring diagrams and performance data for all components required.
- B. Submit floor plans indicating ceiling heights and coverage patterns of all occupancy sensors to indicate complete coverage of small motion. Occupancy sensor layout shall be prepared by the manufacturer. Minimum size floor plans 11x17 inch; minimum scale one inch equals 16 feet.
- C. Provide a complete written item-by-item, line-by-line specification review stating compliance or deviation in full description. Any deviations to this specification must be clearly stated in writing. It is the contractor's responsibility to provide submittals that meet or exceed the specifications herein prior to commencement of work.

- D. Submit a sample of each style and color of occupancy sensor and switch with related cover plate. Attach plate to wiring device and label backside of plate with job description with permanent black marker.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Sensor Switch.
- B. Watt Stopper.
- C. My-Tech.
- D. Hubbell.
- E. Leviton.
- F. Schneider Electric.
- G. Greengate.
- H. Lutron – Athena.
- I. ILC – Intelligent Lighting Controls.
- J. Approved Equal.

2.2 FEATURES AND PERFORMANCE PARAMETERS

- A. Dual Technology sensors shall provide no-gap minor motion coverage throughout the entire controlled area.
- B. Dual Technology, and High Bay sensors shall be available in more than one frequency to enable individual control of adjacent spaces without gaps in coverage. Ultrasonic sensor shall operate at 30-34 kHz.
- C. All sensors shall operate on 24 VAC as supplied by a class 2 transformer and provide an isolated (dry) maintained Form C contact closure to signal occupancy / no occupancy for Building Management and Control (BMCS / BAS) Systems.
- D. All sensors shall have a manual override switch to allow the load to be turned on without the use of tools or pins in the event of sensor malfunction.
- E. Dual Technology, and High Bay Sensors shall have easily accessible, adjustable controls for time delay and sensitivity. Controls shall be recessed to limit tampering.
- F. Dual Technology, and High Bay Sensor housings shall comply with UL 94V0 and shall be equipped with a protective grill to shield detectors from damage.
- G. All sensors shall be provided with an indicator light to verify that motion is being detected and that the unit is in operation.
- H. Dual Technology, High Bay and Extreme Temperature sensors shall contain timing circuitry to provide adjustable "time to lights off" delay.

- I. Dual Technology, High Bay and Extreme Temperature sensors shall include a lighting sweep function that shall ensure that lights remain off immediately after power on sweeps.
- J. Dual Technology, and High Bay sensors shall utilize Airflow Tolerant Technology™ to resist false activation in high airflow environments.
- K. Dual Technology, High Bay and Extreme Temperature sensors shall self-adjust sensitivity to optimize performance.
- L. All sensors shall utilize the NEMA WD 7 Guide and robotic method to verify coverage patterns.
- M. All sensors and Switchpacks shall be manufactured by the same company and shall be aesthetically compatible, i.e., from the same product line or generation of products.

2.3 SWITCHPACKS

- A. For ease of mounting, installation and future service, Switchpacks shall be able to externally mount through a 1/2" knock-out on a standard electrical enclosure and shall be an integrated, self contained unit consisting internally of a load switching relay and transformer to provide low voltage power of 15 VDC. Switchpacks shall power up to five (5) sensors.
- B. Relay contacts shall be isolated and have ratings of:

15 Amps:	120 VAC Tungsten
20 Amps:	120 VAC Ballast
20 Amps:	277 VAC Ballast
1HP:	120 VAC
2HP:	250 VAC
- C. Enclosures for Switchpacks shall be pressed steel, NEMA I Construction with mounting plates and barriers to provide separation between line and low voltage wiring or standard 4" deep junction box with Switchpack mounting through a 1/2" knockout.
- D. The Heavy Duty Switchpack shall have a heavy duty Form A relay and zero crossing circuitry that forces the relay contacts to engage and disengage at the zero crossing point of the AC voltage source, minimizing the magnitude of the inrush current and increasing the life of the Switchpack.

2.4 LOW VOLTAGE CONTROL WIRING

- A. Control wiring between sensors and switchpacks shall be Class 2, 18 AWG stranded UL classified, Teflon jacketed cable suitable for use in plenum ceilings. Outer jacket insulation color shall be white.

PART 3 - EXECUTION

3.1 GENERAL

- A. Provide the quantity of occupancy sensors required for complete and proper volumetric coverage to completely cover the controlled areas. Contractor shall verify room coverage and ceiling heights with manufacturer and provide the quantity of occupancy sensors as required. Rooms shall have one hundred (100) percent volumetric coverage of small

motion detection to completely cover the controlled areas to accommodate all occupancy habits of single or multiple occupants at any location within the room(s). The locations and quantities of sensors shown on the drawings are diagrammatic and indicate only rooms that are to be provided with sensors. Proper judgment must be exercised in executing the work so as to ensure the best possible installation in the available space and to overcome local difficulties due to space limitations or interference of structural or architectural components. Provide sensors to provide complete and proper volumetric coverage.

- B. Exact locations of Switchpack boxes shall be based on observing good installation practice and shall be consistent throughout the project. Switchpacks shall be located in accessible ceiling spaces. Attention shall be paid to all aspects of installation to ensure that there is the minimum aesthetic impact of the hardware on the appearance of the affected rooms. All control unit hardware shall be completely contained within a suitable NEMA-type enclosure, with no exposed wire other than low voltage Class 2 wiring.
- C. Control units used for the security or fire systems shall be powered from the emergency power source as indicated on the drawings. Other control units shall be powered from the lighting circuit, which they control.

3.2 INSTALLATION

- A. All occupancy sensors and switchpacks shall be of the same manufacturer throughout unless otherwise noted.
- B. Install occupancy sensors in areas shown, in accordance with manufacturer's written instructions, requirements of NEC, and in accordance with industry practices. Do not install devices until wall construction and wiring is completed.
- C. Install occupancy sensors and switches only in electrical boxes that are clean, free from excess building materials, debris, and similar matter.
- D. Install occupancy sensors plumb and aligned in the plane of the ceiling where they are installed.
- E. Refer to Architectural drawing, elevations, etc. for exact location of wall switches where indicated on the Architectural plans. Coordinate location of all wall switches with other specialty items and millwork and avoid conflicts. Coordinate with all trades to avoid conflicts during construction.
- F. Unless indicated otherwise, circuit switchpacks ahead of local control switches - source – switchpack – local toggle switch(s).
- G. Low voltage cabling installed from switchpack to sensor(s) and from sensor to sensor shall be supported every 5 feet at a minimum height of 3 feet above grid/ceiling but no closer than six-inches below deck. Support system shall be ceiling wire attached to structure and clipped to ceiling support grid using Caddy drop wire securing clip #EC311. Cabling shall hang plumb to devices.
- H. Coordinate with BMCS / BAS Contractor for interface of BMCS / BAS System and wiring connections.

3.3 SENSOR TESTING AND ADJUSTMENT

- A. At the time of installation the contractor shall test and adjust each sensor for proper detection of motion appropriate to room usage. The contractor shall follow the testing and

adjustment procedures as written in the manufacturer's installation instructions for each sensor model.

- B. Prior to testing and adjusting, verify with Owner/Architect the initial settings for each type of area based on its intended function and use.
- C. Verify with Owner all adjustable functions of each type of occupancy sensor prior to installation. Set all adjustable functions of each type of occupancy sensor as directed by Owner. Initial settings unless directed by Owner / Architect:
Ceiling Sensors:
 - 1. Auto-On = On (Occupancy) Auto = OFF (Vacancy).
 - 2. Lighting Sweep = Off.
 - 3. Ultrasonic Self-Adjust = On.
 - 4. Infrared Self-Adjust = On.
 - 5. BAS Interface = On.
 - 6. Zero Time Delay = Off.
 - 8. Manual Override = Off.
 - 9. Range = Adjust relative to room size or as directed by Owner.
 - 10. Delay = 30 minutes.
 - 11. Frequency = 32 kHz.
- D. Before energizing, check for continuity of circuits, short circuits, and grounding connections. After energizing, check devices to demonstrate proper operation.
- E. Operate each wall switch with circuit energized and verify proper operation.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 24 16

PANELBOARDS AND ENCLOSURES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Panelboards and enclosures, including cabinet, as shown, scheduled, indicated, and specified.

1.2 QUALITY ASSURANCE

- A. UL Standards: Panelboards and enclosures shall confirm to all applicable UL standards and shall be UL labeled.

1.3 SUBMITTALS

- A. Indicate:
 1. Detailed dimensions.
 2. Enclosure material, finish, and NEMA classification type.
 3. Location of main circuit breaker.
 4. Mounting and trim.
 5. Acceptable incoming conductors' size.
 6. Electrical characteristics including voltage, ampacity, overcurrent device frame size and trip ratings, bus material and rating, withstand ratings, lugs, and time current curves of all overcurrent devices and components.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Schneider Electric - Square D.
- B. ABB-General Electric Co.
- C. Siemens.
- D. Eaton.
- E. Approved Equal.

2.2 MATERIALS AND COMPONENTS

- A. General: Panelboards shall be dead-front type equipped with fusible switches or circuit breakers as shown and as required.
- B. The overcurrent protective device short circuit, coordination and arc flash studies performed by the overcurrent protective device manufacturer shall be used by the respective switchgear vendor(s) to select appropriate equipment, switchgear, and overcurrent protective device characteristics such as but not limited to: equipment bracing, AIC rating, circuit breaker frame size and trip settings, and fuse type/class. The appropriate equipment suitable and required by the studies for code compliance shall be included with the submittal data for review and provided at no additional cost to the Owner. The appropriate equipment recommended by the studies for enhanced selective coordination or enhanced arc flash energy reduction beyond code compliance shall be

included with the submittal data for review and consideration purposes by the engineer.

- C. Busing Assembly: Panelboard phase, neutral, and equipment ground busing shall be copper. Bus structure and mains shall have ratings as shown and scheduled. Furnish a bare uninsulated ground bus inside each panelboard enclosure. Two section panelboards shall be connected with copper cable, with an ampacity conforming to the upstream overcurrent device. Neutral bus termination quantity for branch circuit panelboards shall match or exceed the maximum number of single pole circuit breakers the panelboard will accept.
- D. Main circuit breakers and feeder / branch circuit breakers:
1. Less than 125 Amps: Thermal magnetic with factory fixed trip.
 2. 125-600 Amps: Thermal magnetic with adjustable instantaneous trip of 5X – 10X with short time tracking.
 3. 601 Amps and larger: Solid state true RMS sensing with adjustable: current set by rating plug or adjustable dial, I²t settings, ground fault (where required), instantaneous trip, and short time trip; 80-percent continuous current rating.
 4. Provide permanent lock-off device for all fire alarm system branch circuit breakers, for all smoke control fans and equipment, and where indicated or required for circuit breaker to be used as a remote safety disconnect switch.
 5. General requirements:
 - a. Make prepared space provisions for additional breakers or fused switches so that no additional bus or connectors will be required to add circuit breakers or fused switches in the available device mounting space.
 - b. Two and three pole breakers shall have internal common trips.
 - c. All circuit breakers used as the main or branch mounted back-fed main shall be bolt-on. All circuit breakers used in 600 Amp and smaller panelboards shall be bolt-on breakers. Circuit breakers for distribution panelboards rated 601 amps and larger shall have plug-on or bolt-on circuit breakers.
 - d. Branch circuit panelboard shall have interrupting capacity as shown or as required, but in no case less 10k AIC for 120/208/240-Volt systems, and 18k AIC for 277/480-Volt systems.
 - e. 15- and 20-Amp circuit breakers for lighting circuits shall be UL listed switch duty (SWD).
 - f. Personnel ground fault interrupter (GFI) circuit breakers, where shown, shall be maximum 5 mA ground fault trip and shall include a TEST button.
 - g. Equipment ground fault interrupter (EGFI/EGPD) circuit breakers, where shown or required shall be 30mA ground fault trip and shall include TEST button.
 - h. Circuit breakers with 1,200 Amp and larger frame shall have Energy Reducing Maintenance Switching with local status indicator (ERMS).
- E. Fusible Switches for distribution panelboards: Fusible switches shall be quick-make, quick-break type. Each switch shall be enclosed in a separate steel enclosure. The enclosure shall employ a hinged cover for access to the fuses. Interlock cover with the operating handle to prevent opening the cover when the switch is in the ON position. This interlock shall be constructed so that it can be overridden for testing fuses without interrupting service. The switches shall have padlocking provisions in the OFF position. Switches shall include positive pressure rejection type fuse clips for use with UL Class J fuses and be UL labeled for 200,000 AIC.
- F. Spaces: Where space for future breakers or switches is shown, panelboard enclosure shall include removable blank panels or knockouts to allow installation of future breakers

or switches, prepared spaces, and panelboard busing shall be complete, including required connectors.

- G. Integrated Equipment Rating: Do not apply series ratings. Each panelboard, as a complete unit, shall have a short-circuit rating equal or greater than the available short circuit current. Rating shall have been established by tests on similar panelboards with the circuit breakers or fusible switches installed.
- H. GFCI circuit breakers not available in the required panel AIC rating shall be series rated with the upstream over current protection device to provide the panelboard with required AIC rating. Coordinate series rating requirements with manufacturer. Mark the panel per NEC 110. The marking shall be visible and state the following: "CAUTION-ENGINEERED SERIES COMBINATION SYSTEM RATED XXX AMPERS. IDENTIFIED REPLACEMENT COMPONENTS REQUIRED".
- I. Panelboard Enclosures:
 - 1. Provide sheet steel enclosures, minimum 16-gauge nominal thickness, with multiple knockouts, unless shown otherwise. Provide all NEMA 1 panelboard fronts with spring-loaded door pulls, and flush lock and key, panelboard enclosures keyed alike to match the Owner's standard key system; coordinate with Owner.
 - 2. All NEMA 1 enclosure panelboards shall be hinged "door-in-door" type with interior hinged door with hand operated latch or latches, as required providing access only to circuit breaker or fusible switch operating handles, not to exposed energized parts. Outer hinged door shall be securely mounted to the panelboard box with factory bolts, screws, clips, or other fasteners, requiring a tool for entry. Hand operated latches are not acceptable. Push inner and outer doors shall open left to right. Manufacturer hardware (OEM), screws, and bolts shall be used to secure dead fronts and covers. Do not use third party hardware. Do not use power tools to secure panel hardware. Provide gray powder coat finish over a rust inhibitor.
 - 3. Equip with interior circuit directory frame, card, and clear plastic covering for panelboards.
 - 4. Panelboards located in kitchen preparation or natatorium areas shall have Type 316 stainless steel front, door, and trim with a NEMA 1 rating for the entire enclosure.
 - 5. Panelboards at exterior locations shall be NEMA 4X Type 316 stainless steel.
 - 6. Panelboards at hose down areas, cooling towers, in greenhouses, and other corrosive locations shall be NEMA 4X 316 stainless steel.
 - 7. Enclosure shall be for recessed or surface mounting as shown or as required.
 - 8. Enclosures shall be fabricated by the same manufacturer as panelboards to be enclosed. Multi-section panelboards shall have same physical dimensions.

PART 3 - EXECUTION

3.1 INSTALLATION OF PANELBOARDS AND ENCLOSURES

- A. General: Install panelboards and enclosures, as shown, including electrical connections, in accordance with the manufacturer's written instructions, the requirements of NEC, NECA Standard of Installation, and industry practices. Circuit breakers shall be factory installed except for required field modifications due to actual site conditions.
- B. Coordination: Coordinate installation of panelboards and enclosures with conductor and raceways installation work.
- C. Anchoring: Anchor enclosures to walls and structural surfaces ensuring that they are

permanently and mechanically secured.

- D. Directory Card: Provide a typed circuit directory card(s) upon completion of work. Directory card shall be of super heavy-weight index card stock, 110 lb, white. Directory shall include type of load (i.e.: receptacles, lighting, exhaust fan, etc.) and location (i.e.: Room 102, Office, etc.) Room number shall be identified as the actual graphics room number assigned to the space and not the room number identified on the Plans. Circuits with shunt trip shall be identified with the control circuit operating the shunt trip (i.e.: Kitchen Hood No. 2). Shunt trip breakers with common trip circuit shall be grouped in the panelboard (i.e.: circuits 1, 3, 5 and 7).
- E. Fuses: Install fuses, of the ratings and class shown.
- F. Circuit Arrangement: Branch circuits shall be arranged to provide the best possible phase balance, unless shown otherwise.
- G. Panelboards not intended to be used as service entrance (SE) rated or for establishing a separately derived neutral system shall have the factory installed neutral to ground bonding screws and straps removed and disposed of.
- H. Recessed or flush mounted panelboards: Terminate spare conduits in junction box 18-inches above accessible ceiling close to panelboard location. Label junction box cover as "not used" and include panel identification.
 - 1. Provide (3) 1-inch and (3) ¾-inch spare conduits above accessible ceiling to j-box from each panelboard section.
 - 2. Where recessed panelboard is located above another building floor, also provide (3) 1-inch and (3) ¾-inch conduits to j-box in ceiling space on floor below.
- I. Conductors shall be bent neatly opposite the fuse switch or circuit breaker to which they are to be attached. Vertically installed conductors shall be neatly tie-wrapped. Conductors shall be connected in a neat and professional manner. Conductors brought in from the top or bottom of the cabinet shall be bent neatly opposite the fuse or circuit breaker to which they are to be attached. Each conductor shall be run along the full height of the panel and returned to the circuit breaker or fuse location to allow relocation of the conductor to any position along the bus. Panelboard shall be cleaned of all construction debris prior to substantial completion review. Neutral and grounding conductors shall be installed similar to the phase conductors.
- J. Circuit breakers and conductors installed for SPD devices shall be located on the same side as the SPD to allow the shortest and straightest run of conductors in respect to the location of the SPD device. Route all conductors to the SPD device with straight as possible run, using longest sweep bends and the shortest conductor length possible. Twist all SPD conductors and secure with tie straps wherever possible.
- K. Install copper ground bus for copper ground conductors. Ground conductors' size #1 and larger are to be landed to panelboard enclosure with mechanical lugs and not to ground bus.
- L. Install panels so that breaker number 1 is the top left breaker.
- M. In panels that contain multi-layered neutral bus, install neutrals beginning with the back neutral bus row and work forward. Do not make up neutrals on front neutral bus row unless all other rows are full.
- N. Label breaker mounting space with stick-on number labels.

- O. Mount the fully aligned panelboard such that the maximum height of the top circuit breaker above the finished floor shall not exceed 78-inches. Mount panelboards as high as practical and such that the bottom of the cabinets will not be less than 6 inches above the finished floor.

3.2 TESTING

- A. Before energizing, energization, check for continuity of circuits and short circuits.
- B. Provide thermal infrared scan of panelboards under full load as directed and witnessed by Owner. Correct any deficiencies causing abnormal heating and repeat the scan. Provide digital video documentation with deficiencies corrected for comparison to future test. Make corrections as needed as soon as possible as directed by the Owner. Repeat the scan at the 11-month prior to close-out and make corrections prior to close-out.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 24 25

ENCLOSED SWITCHES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Safety and disconnect switch work where required, scheduled, indicated, specified, and required. For switches indicated or rated above 1,200 Amps, provide switchboard construction as specified for switchboards.
- B. UL Approved: Safety and disconnect switches shall have UL approval and the UL label.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Schneider Electric - Square D.
- B. ABB-General Electric Co.
- C. Siemens.
- D. Eaton.
- E. Approved Equal.

2.2 ENCLOSED SWITCHES

- A. General: Provide heavy duty type, dead-front, sheet steel enclosed, surface-mounted safety switches of the type and size indicated. Safety switches shall be rated for the voltage of the circuit where they are installed. Safety switches used as motor disconnects shall be rated for the motor horsepower served.
- B. The overcurrent protective device short circuit, coordination and arch flash studies performed by the overcurrent protective device manufacturer shall be used by the respective switchgear vendor(s) to select appropriate equipment, switchgear, and overcurrent protective device characteristics such as but not limited to: equipment bracing, AIC rating, circuit breaker frame size and trip settings, and fuse type/class. The appropriate equipment suitable and required by the studies for code compliance shall be included with the submittal data for review and provided at no additional cost to the Owner. The appropriate equipment recommended by the studies for enhanced selective coordination or enhanced arc flash energy reduction beyond code compliance shall be included with the submittal data for review and consideration purposes by the engineer.
- C. Switch Mechanism:
 - 1. Safety switches shall be quick-make, quick-break type with permanently attached arc suppressor. Constructed so that switch blades are visible in the OFF position with the door open. The operating handle shall be an integral part of the box, not the cover. Switch shall have provision to padlock in the OFF position. Safety switches shall have a cover interlock to prevent unauthorized opening of the switch door when the switch mechanism is in the ON position, or closing of the switch mechanism when the switch door is open.
 - 2. Cover interlock shall have an override mechanism to permit switch inspection by authorized personnel. Current-carrying parts shall be constructed of high

conductivity copper with silver-plated switch contacts. Lugs shall be suitable for copper conductors and front removable.

- D. Neutral: Provide safety switches with number of switched poles indicated. Where a neutral is present in the circuit, provide a solid neutral with the safety switch. Where a ground conductor is present in the circuit, provide a separate solid ground with the safety switch.
- E. Auxiliary Contacts: Disconnect switches related to all smoke control fans shall have auxiliary contacts for fire alarm system monitoring of the position of the disconnect switch.

2.3 ENCLOSED SWITCHES WITH OVERCURRENT AND/OR GROUND FAULT PROTECTION

- A. Overcurrent protective devices 1,200 Amps and below:
 - 1. Where switch is intended as a building service disconnect provide solid neutral and ground bus and service entrance SE rating.
 - 2. Molded case circuit breakers:
 - a. Greater than 800 Amp: Solid state true RMS sensing with adjustable: current, I²t settings, ground fault (where required), instantaneous trip, and short time trip; 80-percent continuous current rating.
 - b. 800 Amp and smaller: Solid state true RMS sensing with fixed current setting by rating plug or dial. Breaker shall have adjustable instantaneous trip function with short time tracking.
 - c. 1,200 Amp and larger frame circuit breakers regardless of trip shall have Energy Reducing Maintenance System switch with local status indicator (ERMS).
 - 3. Fusible switches:
 - a. Quick-make, quick-break units utilizing the double-break principle of circuit interrupting to minimize arcing and pitting and shall conform to the ratings shown.
 - b. Individual door over the front, equipped with a voidable interlock that prevents the door from being opened when the switch is in the ON position unless the interlock is purposely defeated by activation of the voiding mechanism. All switches shall have externally operated handles.
 - c. 600 Amps and below equipped for Class J fuses.
 - d. 601 Amps and above shall be equipped for Class R or L fuses.
 - e. When required by the latest edition of the NEC or the AHJ, 1,200 Amp fused switches regardless of fuse size installed shall have Energy Reducing Maintenance System switch with local status indicator (ERMS).
- B. Ground Fault Interrupter (GFI) protection: Where shown or required, ground fault protection shall be achieved with adjustable pickup for ground fault currents, field-adjustable from 200 amperes and instantaneous to 60 cycle time delay. The ground fault protection system shall include necessary current sensors, internal wiring, and relays to coordinate opening the monitored faulted circuits.
 - 1. Ground fault protection shall be set at minimum setting for both current and time during construction. The manufacturer shall include in the submittal data the minimum setting of the device and the recommended setting for normal building operation.
 - 2. The ground fault system shall be factory-tested before shipment as specified:
 - a. The manufacturer shall provide a factory ground fault protection system test for circuit testing and verification of tripping characteristics. The manufacturer shall pass predetermined values of current through the sensors and measure the tripping time for each phase and neutral. The

measured time-current relationships shall be compared to the trip-characteristic curves. If the ground fault device trips outside the range of values indicated on the curve, the ground fault device shall be replaced or recalibrated.

- b. Relays, electrically operated switches, shunt-trip switches, circuit breakers, and similar items shall have proper voltages applied to their circuits and satisfactory operation demonstrated.
- c. Upon completion of the factory ground fault protection system test, the current and time on each ground fault device shall be set to minimum values.

2.4 ENCLOSURES

- A. Enclosures in indoor locations shall be NEMA 1 unless shown otherwise.
- B. Enclosures in exterior locations shall be NEMA 3R unless shown otherwise.
- C. Enclosures at kitchen and food preparation locations, exterior kitchen supply and exhaust fans, hose down areas, cooling towers, in greenhouses, and in other corrosive areas shall be NEMA 3R unless shown otherwise.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install safety and disconnect switches where required or indicated, in accordance with the manufacturer's written instructions, requirements of the NEC, NECA Standard of Installation, and industry practices. Provide fuse identification label when fused switches are required showing type and size inside door of each switch. Include devices in coordination study to indicate overcurrent devices will selectively coordinate.
- B. Location: Provide safety switches within 50' and in sight of motor served. There shall be minimum code required clearance in front of safety switch and a clear path in which to access the switch. (i.e.: not having to walk and/or stand on obstacles such as drain pans on floor to service).
- C. Supports: Provide all safety and disconnect switches with galvanized angle or other supports where mounting on wall or other rigid surface is impractical. Switches shall not be supported by conduit alone. Where safety and disconnect switches are mounted on equipment served, the switch shall not inhibit removal of service panels or interfere with access areas, not void the warranty of the equipment served. Provide mounting hardware that will allow removal of safety and disconnect switches with common work tools. Do not utilize drive pin anchors through enclosure.
- D. Ground Fault Interrupter (GFI) test and settings: Where adjustable ground fault interrupter settings are provided or required, after completion of construction and before final acceptance testing, the ground fault protection system shall be field-tested and reset to the manufacturer's settings for both current and time by a representative of the manufacturer's engineering service department. After the test, set ground fault to 50-percent of the overcurrent device rating.
- E. Safety and Disconnect Switches: Install disconnect switches for motor-driven equipment, appliances, motors, and motor controllers within sight of the controller position unless indicated otherwise.
- F. Variable Frequency Drive (VFD) Warning Plaque: Provide VFD warning plaque at safety

disconnect switches which are located down-stream of VFDs. Secure plaque to disconnect switch or immediately adjacent to disconnect switch with fasteners. Plaque shall be Yellow-White-Yellow 3-layer plastic laminated engraved with: "WARNING" (1/2 Inch Letters). "TURN OFF VFD BEFORE OPENING THIS SWITCH FOR MAINTENANCE." (1/4 inch letters).

- G. Provide disconnect switch for electric duct heaters.
- H. Where disconnect switch is used or indicated as the utility service building disconnect, provide main bonding jumper and neutral to ground bond connected to the building's grounding system. Do not bond neutral to ground when there is a neutral to ground bond upstream from the same derived neutral system serving the disconnect switch.
- I. Disconnect switches related to all smoke control fans shall have auxiliary contacts for fire alarm system monitoring of the position of the disconnect switch, coordinate with Division 28. Coordinate with fire detection and alarm contractor for the fire alarm and detection system to monitor all disconnect switches open/closed position that serve the smoke control system. All fire alarm and control wiring directly related to the monitoring of the supply power disconnect switches and control of the smoke control fans shall be installed in conduit.

3.2 TESTING

- A. General: Before energizing, check for continuity of circuits and short circuits.
- B. Provide thermal infrared scan of the enclosed switches rated 200 Amps or larger under full load prior to testing / maintenance and modifications and of the modified and new switchboard sections after construction as directed and witnessed by Owner. Make corrections as needed as soon as possible as directed by the Owner. Repeat the scan at the 11-month prior to closeout, and make corrections prior to closeout. Provide digital video documentation with test results for comparison between prior condition and post construction modifications and future tests.

END OF SECTION

SECTION 26 24 30

FUSES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Fuse work as shown and scheduled, and as specified.
- B. Types: Fuses required for the project include the following:
 - 1. 250 volt current limiting fuses.
 - 2. 600 volt current limiting fuses.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Manufacturers: Provide products produced by Bussman, Littlefuse, or Approved Equal.

2.2 CURRENT LIMITING FUSES - 600 VOLTS AND LESS

- A. General: Provide 200,000 amperes interrupting capacity (AIC) current-limiting fuses of the current ratings shown and voltage rating equal to or greater than the voltage at the point of application.
- B. Types:
 - 1. Fuses in circuits supplying individual motors, groups of motors, or loads including motors, 600 amperes or less, shall be UL Class RK1 or Class J, time delay fuses, Bussman LPS-RK (600V) LPJ-SP (600V), LPN-RK (250V).
 - 2. Fuses in circuits supplying individual motors, groups of motors, or loads including motors, 601 to 4000 amperes, shall be UL Class L time delay fuses, Bussman KRPC "HI-CAP".
 - 3. Fuses in circuits supplying other than motor loads, 600 amperes or less, shall be UL Class RK1, time delay fuses, Bussman LPS-RK (600V), LPN-RK (250V).
 - 4. Fuses supplying surge protection devices (SPD) shall be surge rated for use with SPD devices.

2.3 SPARE FUSES

- A. General: Provide spare fuses in the amount of 10% of each type and size installed, but not less than 3 spares of a specific size and type. Deliver to the Owner at the time of project acceptance. Fuses shall be encased in a labeled steel enclosure with padlock provision, to be wall mounted where directed.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install fuses in fuse holders immediately before energizing of the circuit where the fuses are installed. Fuses shall not be installed and shipped with equipment.
- B. Labels: Place fuse identification labels, showing fuse size and type installed, inside the cover of each switch.

END OF SECTION

INTENTIONALLY LEFT BLANK

SECTION 26 27 73

LINE VOLTAGE WIRING DEVICES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Provide wiring device work as shown, scheduled, indicated, and specified. Low voltage and/or digital control switches required for lighting controls and lighting control systems shall be as specified and required for the low voltage and / or digital control lighting system. Refer to drawings or other specification sections for low voltage / digital lighting control systems. Cover plates for lighting control systems shall be as specified in this section unless specifically required otherwise by the low voltage / digital control device bulkhead or form factor.

1.2 QUALITY ASSURANCE

- A. UL Label: Wiring devices shall be UL labeled.
- B. NEMA Standard WD1 and WD6.
- C. Fed. Spec. WC596, W-S-896.

1.3 SUBMITTALS

- A. Mark up a complete copy of the specification section for the product to indicate a) acknowledgement of the specification requirement (Comply), or b) acknowledgement that the particular specification requirement does not apply to this specific project (Not Applicable) or, c) acknowledgement that the specification requirement cannot be made or that a variance is being submitted for review to the Architect/Engineer/Owner (Does Not Comply, Explanation:.) Do not submit an outline form of compliance, submit a complete copy of the specification section with the product data.
- B. Submit a sample of each style and color of 120-Volt duplex receptacle and each 120/277-Volt switch with related cover plate. Attach plate to wiring device and label back side of plate with job description with permanent black marker.
- C. Submit manufacturer's product data sheet for each style of device and plate on the project.
- D. Submit drawings of plans, elevation and sections of receptacles and outlets in casework, cabinetwork and built-in place furniture. Coordinate dimensions with millwork shop drawings and related architectural drawing series.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. Toggle switches, straight blade and twist lock devices, interior cover plates:
 - 1. Leviton.
 - 2. Hubbell.
 - 3. Pass and Seymour .
 - 4. Eaton.
 - 5. Approved Equal.

- B. Dimming
 - 1. Leviton.
 - 2. Lutron.
 - 3. Approved Equal.

2.2 WIRING DEVICE COLOR

- A. Device color shall be gray except 20A, 125V receptacles and toggle wall switches which are directly supplied from an emergency source shall be red, and heavy duty 30 Amp and larger simplex devices which shall be black in color where the building standard color is not available. Provide equivalent hospital grade devices where red is not available in grade specified. Verify with Owner / Architect prior to submitting for approval. Color change kits as required for dimming switches. Low voltage lighting control devices specified elsewhere shall match the line voltage wiring device color specified in this section.
- B. All device faceplates shall be stainless steel unless otherwise noted on plans. Verify with Owner / Architect prior to submitting for approval.

2.3 RECEPTACLES

- A. Industrial grade tamper resistant smooth face duplex receptacles, 2 pole, 3 wire grounding, with ground connection and poles internally connected to mounting yoke, with metal mounting straps, locking plug-tail or back and side wired with screw type terminals, NEMA indicated, (X=color designation).
 - 1. 20A, 125V duplex NEMA #5-20R: Leviton #5362-SGX
 - 2. 20A, 125V isolated ground duplex NEMA #5-20R: Leviton #5362-IGX
 - 3. 20A, 125V ground fault circuit interruption (GFCI) NEMA #5-20R weather and tamper resistant: Leviton #G5362-WTX
 - 4. 20A, 125V weather resistant (WR), tamper resistant: Leviton #TWR20-GY
 - 5. 20A, 125V plug load control, split circuit marked for "controlled", tamper resistant: Leviton #TDR20-S1G
 - 6. 15A, with 20A feed-through, NEMA #5-15R, 125V duplex, arc fault (AFCI), tamper resistant: Leviton #AFTR1-HGX
- B. Heavy-Duty Simplex: Single heavy-duty type receptacles, with green hexagonal equipment ground screw, with metal mounting straps, back or side wiring, black molded phenolic compound.
 - 1. 15-60A, 125-250V, straight blade, NEMA configuration as indicated or as required by Owner.
 - 2. 15-50A, 125-480V, twist lock, NEMA configuration as indicated or as required by Owner.
- C. Hospital grade receptacles, 2 pole, 3 wire grounding, with ground connection and poles internally connected to mounting yoke, with metal mount straps, locking plug-tail or back and side wired with screw type terminals, molded phenolic compound, NEMA configuration indicated.
 - 1. 20A, 125V grounded duplex NEMA #5-20R: Leviton #8300-X.
 - 2. 20A, 125V isolated ground duplex NEMA #5-20R: Leviton #8300-LIG (orange).
 - 3. 20A, 125V ground fault circuit interruption (GFCI) with indicator light: Leviton .NEMA 5-20R-8898-HGX.
 - 4. 20A/125V Tamper Resistant Duplex NEMA 5-20R: Leviton 8300-SGX.
- D. USB 2-port charger / tamper-resistant with 125-Volt receptacles:
 - 1. USB type A/C, 1 type A and 1 type C port, 5.1A 5.0VDC charging. 20A, 125V, NEMA 5-20R: Leviton #T5833-HGX.
 - 2. USB A, 2 type A ports, 5.1A 5.0VDC charging. 20A, 125V, NEMA 5-20R: Leviton #T5832-HGX.

- E. USB 4-port charger:
 - 1. USB type A+C, 2 type A ports and 2 type C ports. 5.0A 5.0VDC charging. Hubbell #USB4ACX.
 - 2. USB type A, 4 type A ports. 5.0A 5.0VDC charging. Hubbell #USB4X.

2.4 WALL SWITCHES

- A. Toggle: Industrial grade flush toggle switches, with mounting yoke insulated from mechanism, equipped with plaster ears, switch handle, back and side-wired screw terminals.
 - 1. Single-pole, 120/277V, 20A switch: Leviton #1221-2X.
 - 2. Double pole 120/277V, 20A switch: Leviton #1222-2X.
 - 3. Three-way, 120/277V, 20A switch: Leviton #1223-2X.
 - 4. Four-way, 120/277V, 20A switch: Leviton #1224-2G.
 - 5. Pilot light single-pole, 120/277V, 20A switch: Leviton #1221-PL.
 - 6. Momentary, 120/277V, 20A, single-pole double throw, center off: Hubbell only, #HBL 1557G.
- B. Toggle key operated switch:
 - 1. Single-pole, 120/277V, 20A key operated switch: Hubbell HBL #1221GY.
 - 2. Two-pole, 120/277, 20A key operated, Hubbell HBL #1222GY.
 - 3. Three-way, 120/277V, 20A key operated switch: Hubbell HBL #1223GY.
 - 4. Four-way, 120/277V, 20A key operated switch: Hubbell HBL #1224GY.
 - 5. Momentary, single pole double throw, center off, 20A key switch: Hubbell #HBL 1557LG.
 - 6. Key: Hubbell #HBL 1209. Key switches shall be keyed alike to match the Owner's standard key system. Coordinate with Owner.

2.5 WALL DIMMERS

- A. Wall Box Dimmers: Self-contained, wall box mounted, linear slide square law dimmers with ON/OFF switch. Dimmers shall operate continuously at rated load in an ambient temperature up to 40°C and an input of 100 to 277V. Heat sink fins may be removed only as approved by Owner / Engineer for narrow ganging after applying de-rating.
 - 1. Single-pole, 120/277V, 1000/2308 Watt incandescent / magnetic low voltage: Leviton #AWSMT-MBW.
 - 2. Single-pole, 120/277V, 1500/3463 Watt incandescent / magnetic low voltage, 2-gang heat sink: Leviton #AWSMT-MCW.
 - 3. Single-pole, 120/277V, 1920/4432-Watt LED / fluorescent 0-10V dc, 75 mA current sink: Leviton #AWSMT-7DW.
 - 4. Three, four- or five-way remote switch: Leviton #AWSRT-00W.
 - 5. Color change kit as required.

2.6 GFCI – GROUND FAULT CIRCUIT INTERRUPTER, BLANK FACE

- A. 20A, 125V, GFCI, switch rated, blank face feed through, Hubbell #GFBF20GYL, gray finish, stainless steel cover plate black laser engraved with device protected, (example: DRINKING FOUNTAIN GFCI).

2.7 INTERIOR WALL COVER PLATES AND FASTENERS

- A. Type 302 non-magnetic stainless-steel with satin finish.
- B. Cover plate laser plate engraving for device identification (other than low voltage lighting controls).
 - 1. Provide laser cover plate engraving with black filling for all wiring devices

- indicating panelboard name, circuit, and voltage.
- 2. Wiring devices connected to emergency/stand-by generator or inverter shall include the word "EMERGENCY".
- 3. Text orientation shall be upright, readable from left to right when cover plate is installed.
- 4. Remotely located lighting switches shall also indicate the room or area and zone controlled by each switch. Coordinate specific wording with Owner/Architect.
- 5. Blank face GFCI cover plates shall also intuitively indicate the load or equipment served, device, or area protected downstream ("EDF" for drinking fountains, "RM RECEPPTS", "HOOD RECEPPTS", "VENDING", "REFRIG", etc.) For other loads, Owner/Architect shall determine name plate wording.

2.8 EXTERIOR COVER PLATES

- A. Thomas & Betts CK Series, cast aluminum standard depth, locking mount, while-in-use, wet location, universal configuration.
 - 1. Vertical mount receptacle: #CKSUV.
 - 2. Horizontal mount receptacle: #CKMU.
 - 3. Two-gang: #2CKU.
 - 4. 30-60 Amp Devices: #CKLSUV.

2.9 CORD REELS AND DROP CORDS

- A. Cord Reels:
 - 1. Lighted cord reels: Industrial grade, LED hand Lamp only, 125V, 45-foot 16/3 SJEO cord, white finish, LED hand lamp. Hubbell #HBLI45163LED with #HBL340PB pivot base.
 - 2. 20 Amp (2) duplex receptacle cord reels: Industrial grade, 125V, (2) 20A duplex receptacles, GFCI protection, 45-foot 12/3 SJO cord, white finish, yellow outlet box. Hubbell #HBLI45123GF220 with #HBLI340PB pivot base.
 - 3. 30 Amp receptacle cord reels: Industrial grade, 125/250V, 30A, 45-foot 10/4 SJO cord, white finish, yellow outlet box. Hubbell #HBLI45104 with #HBLI340PB pivot base. 30 Amp NEMA receptacle termination as required by Owner.
 - 4. 50 Amp receptacle cord reels: Industrial grade, NEMA 4 wet location, 600V, 55A, 50-foot 6/4 SOOW cord, yellow finish, self-retracting, with NEMA 50-Amp maximum receptacle termination as required by Owner. KH-Industries RTMH4L-WW-K6K.
 - 5. Recessed enclosure for 20 and 30-Amp cord reels recessed above T-grid drop ceilings: Hubbell #HBLIPRBOX recessed cord reel enclosure, white finish, plenum rated.
- B. Drop cord receptacles:
 - 1. 20A, 125V, 25-feet 600 VAC, 3-conductor 12 AWG SOOW cable, twist lock plug, two 125V, 20A duplex WR GFCI outlets, safety yellow rubber outlet box, mesh strain relief cord grips. KH Industries #PP4DD-520-B12F-520.
 - 2. 20A, 125/250V, 25-feet 600 VAC, 4-conductor 12AWG SOOW cable, twist lock plug, four 125/250V NEMA L1420P outlets, safety yellow rubber outlet box, mesh strain relief cord grips. KH Industries #PP7DD-520-B12F-L1420.
 - 3. 30-60 Amp, voltage, NEMA plug/receptacle as required by Owner, SOOW cable, number of conductors and length as required, mesh strain relief cord grips.

2.10 FIRST RESPONDER EMERGENCY REMOTE POWER OFF (FREPO) STATION

- A. Knox Company Remote Power Rapid Access 4500 Series Shutdown Station
 - 1. Recessed mount for public spaces and new construction, surface mount for when mounted to equipment or existing construction.
 - 2. Single lock keyed for local Fire Department/AHJ, verify configuration and keying with Knox Company.

3. Red Finish.
4. Tamper alert for integration with building security system.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Cover plates for receptacles and toggle switches shall be of the same manufacturer throughout unless otherwise noted.
 1. Key switches and keys shall be as specified and also as approved by Owner.
 2. Submit samples for each specified toggle switch and duplex receptacle color to Architect.
- B. Install wiring devices where shown and as required, in accordance with manufacturer's written instructions, requirements of NEC, and in accordance with industry practices. Do not install devices until wall construction and wiring is completed.
- C. Install receptacles and switches only in electrical boxes that are clean, free from building materials, debris, and similar matter.
- D. Install wiring devices plumb and aligned in the plane of the wall, floor, ceiling or equipment rack.
- E. Install switches in boxes on the strike side of doors as hung. Install so the up position will close the circuit or will be the highest level of illumination. Where more than one switch is in the same location, install switches in a multi-gang box with a single cover plate.
- F. Provide a cover plate for every wiring device and blank cover plates for unused rough-in-only boxes that matches the building standard. Fasten all plates outdoors with type 302 Allen Head "tamper-proof" screws.
- G. Mounting heights of all wiring devices shall comply with local accessibility standards and local codes, except where wiring devices are indicated for special purpose and access is only required by maintenance or service personnel.
- H. Refer to Architectural drawing and elevations, etc. for exact location of wiring devices. Coordinate location of all wiring devices with other trades, specialty items, and millwork and resolve all conflicts prior to rough-in. Field coordinate exact mounting location with all trades to avoid and resolve conflicts during construction.
- I. Locate receptacles for electric drinking fountains/coolers and bottle fill stations below equipment so that the receptacle is accessible and concealed as much as practical from public view by the equipment open cowling so that the receptacle remain readily accessible. For dual level basin equipment, locate receptacle under the upper basin.
- J. Provide convenience outlet receptacle within 25-feet of all new electrically operated mechanical equipment.
- K. Where exterior receptacles are intended for continuous use, mount in horizontal position with while in use cover plate. (Exterior electric drinking fountains, ice makers, ice storage bins, landscape lighting low voltage transformers, seasonal decorative lighting, etc.)
- L. Install wall box dimmers to achieve full rating specified after de-rating for ganging as recommended by manufacturer.
- M. Do not share neutral conductor on load side of dimming switches.

- N. Install receptacles with grounding pole down, except in any of the following conditions where the grounding pole shall be installed in the up position: healthcare occupancies, if required by local AHJ, if required by Owner's construction standards or if directed by Owner or Architect. If installed horizontally, install with neutral pole on top.
- O. Connect wiring device grounding terminal to branch circuit equipment grounding conductor.
- P. Provide pigtail to each receptacle and each switch. Neutral and phase conductors shall be installed using side or rear entry lugs only. Do not wrap conductors around screw terminals. Tighten all screws and lugs as recommended by manufacturer.
- Q. All receptacles and switches shall have a minimum of two wraps of Scotch 33 or equivalent tape around terminal screws.
- R. Provide toggle switch within sight of all trap primers, circulation pumps, 120-Volt motors and motorized equipment to serve as the equipment disconnect switch.
- S. Mount cord reels and cord reel recessed enclosures to structure with galvanized steel struts and as recommended by manufacturer. Field verify exact location of cord reels with Owner/Architect. Mounting location shall avoid conflicts with piping, light fixtures and ductwork, etc. when cord reel is extended and retracted. Set ball stop as directed by Owner / Architect. Provide hand lamp only type cord reels in commercial / educational automotive garages with classified (hazardous) locations. Provide local toggle switch at standard switch height for hand lamp only cord reels.
- T. Mount drop cord suspension hook or j-box to structure to support the cord's weight and additional normal use pulling tension and as recommended by manufacturer. Use cable grips, either with cord grip hanging hook at open ceilings or with chrome plated escutcheon cover plate mounted to recessed j-box at finished ceilings. Field verify exact location, drop height, and NEMA outlet configuration of drop cords with Owner/Architect. Provide weatherproof receptacle cap or covers if located in wet location. Mounting location shall avoid conflicts with piping, light fixtures and ductwork, etc.

3.2 GROUND FAULT PROTECTION FOR PERSONELL

- A. When GFCI personnel protection receptacles are not commercially available or cannot be installed at a readily accessible location or indicated otherwise on the drawings, GFCI personnel protection shall be provided by a remote blank face GFCI wiring device or by an up-stream GFCI receptacle that also provides downstream GFCI protection and located in a readily accessible location. When branch circuit breaker device with integral GFCI protection is required or specified, it shall be within the manufacture's recommended distance limitations of the connected receptacle(s) or load(s) for proper GFCI personnel protection at the farthest outlet.
- B. GFCI personal protection locations include but are not limited to the following:
 - 1. For other than dwelling units: All single phase 125-250-Volt (150-Volts to ground or less) receptacles 50-Amperes or less, and all three phase 125-250-Volt (150-Volts to ground or less) receptacles 100-Ampres or less in the locations indicated below.
 - 2. Dwelling units: All single phase 125-250-Volt receptacles installed in the following locations indicated below.
 - 3. Provide personnel GFCI protection as indicated above in the following locations and all additional locations as required by the NEC.
 - a. Outdoors (with exceptions for not readily accessible receptacles with dedicated branch circuits for snow melting, deicing, pipeline/vessel heat

receptacles. Provide these loads with 30mA EGFI circuit breaker protection).

- b. Bathrooms/toilets/restrooms.
 - c. Janitors/custodial closets and mop sinks.
 - d. Laundry areas.
 - e. Parking structures, service garages, garages and accessory buildings
 - f. Basements, crawl spaces (including 120-Volt lighting) .
 - g. Within 6-feet of all water sources including sinks, mop-sinks, lavatories, bathtubs, shower stalls, faucets, eye wash stations, emergency shower stations.
 - h. Indoor damp and wet locations.
 - i. Locker rooms.
 - j. Indoor swimming pools and natatoriums areas and adjacent corridor/hall convenience receptacle outlets located within 25-feet of all access doors.
 - k. Non-dwelling unit therapeutic tubs/pools/whirlpool areas and adjacent corridor/hall convenience receptacle outlets located within 25-feet of all access doors.
 - l. Receptacles serving dwelling unit kitchen counter tops.
 - m. Vending machines.
 - n. Elevators, dumb waiters, escalators, moving sidewalks: receptacles in pits, hoist ways, well ways or those mounted on the cars of elevators and dumb waiters.
 - o. Electric vehicle charging equipment.
 - p. All receptacles serving kitchen or food preparation counter tops.
 - q. Automotive vacuum machines.
 - r. Drinking water fountains/coolers and bottle fill stations.
 - s. Corded high-pressure spray washing machines.
 - t. Tire inflation machines.
 - u. Dish washers.
 - v. Receptacles at end of cord reels or drop cords.
 - w. Boat houses, boat hoist, and all pier/dock receptacles and lighting (excludes shore power that requires GFPE).
 - x. Central plant, mechanical rooms and electrical rooms.
 - y. Wood, metal, or other material fabrication or vocational training shops.
 - z. Receptacles that serve educational science and science prep room counter tops.
- C. Where a GFCI protected receptacle outlet is required or indicated behind vending machine, refrigerators or other equipment, provide remote GFCI blank face in same room as protected receptacle and at a readily accessible location with standard receptacle outlet behind equipment. Refrigerators shall be GFCI protected only where located within 6-feet of power cord distance from the edge of a sink to the surface of the refrigerator.
- D. Unless indicated otherwise, locate blank face GFCI device near light switches at same height as light switches or ganged with the light switch. Provide GFCI protection for all receptacle outlets located below 42-inches in all infant through 2-year old day care and similar areas designated for occupancy by infant through 2-year old day care occupants so the GFCI device can easily be intentionally tripped or tested and reset.
- E. Provide branch circuit breaker 30mA (EDP) or 100mA (EPE) equipment protection for utilization equipment as required by the NEC and where indicated on the drawings.

3.3 FIRST RESPONDER REMOTE EMERGENCY POWER OFF (FREPO) STATION

- A. Provide Knox Company first responder remote emergency power off (FREPO) stations as indicated and/or where required by local AHJ. Mounting locations shall be as directed by the local AHJ and exact locations coordinated with the Architect. FREPOs shall be

circuited only to shunt trip or shut-down control circuiting. FREPOs shall be recessed mounted in public locations and in all new construction when attached to building construction. Provide surface mount FREPOs when mounted to equipment or existing construction.

- B. Integrate the FREPOs to shut-down the building non-emergency and non-legally required power sources which include the main electrical utility service disconnect circuit breaker(s), other than non-life safety or non-legally required distribution scale UPS equipment, and non-life safety or non-legally required local power generation equipment.
- C. Provide FREPOs for fire pump, life safety, and legally required electrical generation equipment only when required by the AHJ. When required by the AHJ, fire pump, life safety, and legally required power generation and/or stored energy power supply equipment shall each have separate dedicated FREPOs that shut down only their associated power generation/stored energy equipment. FREPOs for emergency, and legally required systems shall have minimal 25-foot physical separation from the building main utility service FREPOs and clearly labeled with the equipment that they will shut down. FREPOs for fire pumps shall have minimal 25-foot physical separation from the any other FREPOs and from the building main utility service disconnect and clearly labeled with the equipment that it will shut down.
- D. Integrate the FREPOs tamper switch with the building security or building management control system (BMCS) as directed by Owner.

3.4 TESTING

- A. Before energizing, check for continuity of circuits, short circuits, and grounding connections.
- B. After energizing, check wiring devices to demonstrate proper operation and receptacles for correct polarization, voltage and phase orientation if intended 3-phase equipment is phase orientation dependent for proper motor rotation or operation.
- C. Test each individual GFCI receptacle and all downstream receptacles protected by an upstream GFCI device with simulated ground fault tester, make corrections as necessary.
- D. Operate each wall switch with circuit energized and verify proper operation.

END OF SECTION

SECTION 26 51 13
LIGHTING FIXTURES

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. Work Included: Lighting fixture work is as shown, scheduled and specified.
- B. Applications: The applications of lighting fixtures required for the project include the following:
 - 1. General lighting.
 - 2. Emergency lighting.
 - 3. Outdoor area lighting.

1.2 QUALITY ASSURANCE

- A. Provide interior building LED fixtures that comply with the Design Lights Consortium (DLC) standards and are DLC or DLC Premium listed as a Qualifying Product at time of proposal submittal date.
- B. UL Standards: Lighting fixtures shall conform to applicable UL standards, and be UL or ETL labeled.
- C. Light fixtures shall conform to the requirements of NFPA 101, and 70 (NEC).

1.3 SUBMITTALS

- A. Submit product data for light fixtures, and emergency lighting equipment, including generator transfer devices.
- B. Specification Compliance Review: Mark up a complete copy of the specification section for the product to indicate a) acknowledgement of the specification requirement (Comply), or b) acknowledgement that the particular specification requirement does not apply to this specific project (Not Applicable) or, c) acknowledgement that the specification requirement cannot be made or that a variance is being submitted for review to the Architect / Engineer / Owner (Does Not Comply, Explanation:). Do not submit an outline form of compliance, submit a complete copy with the product data.
- C. Submittal data shall include luminaire efficiency parameters.
- D. Submittal data for exterior luminaires shall include IESNA BUG ratings, backlight, uplight, and glare ratings of each unique luminaire for the orientation and tile specified. Indicate total absolute lumens per luminaire and absolute lumens emitted above horizontal based by each luminaire for the orientation and tile specified.

1.4 WARRANTY

- A. Provide 5-year warranty on all light fixtures, including internal or remote LED drivers, all other electrical internal electrical or electronic components except for emergency battery packs or emergency load control device relays. Refer to other specific component warranty requirements below.

PART 2 - PRODUCTS

2.1 ACCEPTABLE MANUFACTURERS

- A. See the Light Fixture Schedule on the drawings for type of luminaires and catalog numbers. Catalog numbers are shown on the drawings for quality and performance requirements only. Luminaires manufactured by others are equally acceptable provided they meet or exceed the performance of the indicated luminaires, and meet the intent of the design.
- B. Luminaire shall be certified by a Nationally Recognized Testing Laboratory (UL, ETL, or IEC).
- C. Provide luminaires with quick-connect disconnecting means, similar to Thomas & Betts Sta-Kon.
- D. Where alternate fixtures to those specified are provided, notification of alternates are required prior to bid in accordance with Section 26 05 00. Full photometric drawings and a spreadsheet indicating the differences between the specified fixtures and alternate fixtures shall be provided as part of the pre-bid notification. The spreadsheet shall indicate all aspects of the alternate fixture that differ from the specified fixture, including, but not limited to the following:
 - 1. Physical Dimensions.
 - 2. Mounting Type.
 - 3. Fixture Ratings/Listings.
 - 4. Housing Materials/Construction.
 - 5. Lumen Output.
 - 6. Fixture Voltage.
 - 7. Fixture Wattage.
 - 8. Fixture Efficacy.
 - 9. CCT.
 - 10. CRI.
 - 11. Beam Angles/Distribution.
 - 12. Manufacturer Warranty.
 - 13. Emergency Power.
 - 14. Controls Requirements.
- E. Emergency Battery Packs with self-testing drivers/inverters: Shall be the same manufacturer as the low voltage lighting controls provided on this project. Where there are no low voltage lighting controls specified or provided, the manufacturer shall be Bodine.
 - Bodine.
 - Chloride.
 - Lithonia.
 - Dual Lite.
 - IOTA.
- F. Emergency Generator/Inverter Load Control Bypass Relay (ELC); UL924 listed and 0-10Vdc compatible: Shall be the same manufacturer as the low voltage lighting controls provided on this project. Where there are no low voltage lighting controls specified or provided, the manufacturer shall be Bodine.
- G. Emergency Generator / Inverter Branch Circuit Transfer Switch, UL 1008 listed and 0-10Vdc compatible:
 - Bodine GTD20A.

2.2 MATERIALS AND COMPONENTS

- A. General: Provide lighting fixtures of the size, type, and rating indicated, with all accessories for a complete aesthetic installation.

- B. Fixture Types:
1. General:
 - a. LED Lay-in edge lit or back flat panel / troffer fixtures: Opaque, edge or back lighted, 4000 Kelvin color temperature. 0-10 Vdc dimmable, L70: 60,000 minimum hours.
 - b. Safety chains and wire guards at fixtures in mechanical and electrical rooms, and high abuse areas. Provide safety chains only for gymnasium fixtures which shall be inherently vandal proof, no wire guards.
 - c. Fixtures located outdoors, in interior unconditioned spaces, and in wet locations shall be of aluminum construction.
 - d. Fixtures with door frames shall be of aluminum construction, white finish where located in kitchens, food prep areas, toilets, restrooms, locker rooms, dressing rooms, showers, and unconditioned spaces.
 - e. DLC, DLC Premium or Energy Star qualified unless specified otherwise.
 - f. Outdoor fixtures shall include a discrete / replaceable surge suppression device in addition to the surge suppression incorporated in the LED driver.
 - g. Operating temperature rating shall be between -40 degrees F and 120 degrees F.
 - i. Color Rendering Index (CRI): ≥ 80 Indoor; ≥ 65 Outdoor
 - j. The manufacturer shall have performed JEDEC (Joint Electron Devices Engineering Council) reliability tests on the LEDs as follows: High Temperature Operating Life (HTOL), Room Temperature Operating Life (RTOL), Low Temperature Operating Life (LTOL), Powered Temperature Cycle (PTMCL), Non-Operating Thermal Shock (TMSK), Mechanical Shock Variable Vibration Frequency, and Solder Heat Resistance (SHR).
 2. Downlight Fixtures: Provide recessed downlight fixtures with trim rings compatible with the ceiling material where fixture is to be installed.
 3. LED Exit Signs: Provide red lettering. Exit lighting fixtures shall meet the requirements of Federal, State, and Local Codes. Edge-lit exit signs shall have a silver background so that "EXIT" cannot be read backwards from the opposite side.
 - a. Gymnasiums, locker rooms, athletic/PE wing and associated corridors, black box theaters, auditorium stages, cafeteriums and kitchens: Vandal resistant, wet location cast aluminum with polycarbonate protective cover exit signs, Lithonia Extreme Series.
 4. Emergency Lighting Units: Lead Calcium batteries with self-diagnostics. Provide full light output at 90 minutes of battery operation. LED lamps.
 5. Gymnasium light fixtures, glass or acrylic refractors or lenses, round profile, single point swivel pendant or hook mounting, designed to be vandal proof without the need for wire guards, no wire guards.
- C. LED drivers:
1. NEMA 410 compliant for in-rush current.
 2. Starting Temperature: -40° F [-40° C].
 3. Input Voltage: 120 to 480 ($\pm 10\%$) V.
 4. Power Supplies: Class I or II output.
 5. Surge Protection: The system must survive 250 repetitive strikes of "C Low" (C Low: 6kV/1.2 x 50 μ s, 10kA/8 x 20 μ s) waveforms at 1-minute intervals with less than 10% degradation in clamping voltage. "C Low" waveforms are as defined in IEEE/ASNI C62.41.2-2002, Scenario 1 Location Category C.
 6. Power Factor (PF): ≥ 0.90 .
 7. Total Harmonic Distortion (THD): $\leq 20\%$.
 8. Comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
 9. Drivers shall be reduction of hazardous substances (ROHS)-compliant.

- D. Voltage: Equipment for use on 120V systems shall be suitable and guaranteed for voltage range of 100V to 130V. Equipment on 277V systems shall be suitable and guaranteed for voltage range of 225V to 290V. Universal voltage equipment shall be suitable and guaranteed for a voltage range of 100V to 290V.
- E. Light fixture housing for exterior use: Provide aluminum or stainless housing. Where stainless steel hardware is used, both male and female fasteners shall be stainless steel.
- F. Emergency LED battery self-testing drivers and inverters; 5-year warranty. Basis of Design:
 - 1. Bodine BSL-ST Series for OEM installation.
 - 2. Bodine BSL310-SI Series for field installation.
 - 3. Bodine ELI-S Series for line voltage sine wave inverter field installation.
- G. Emergency Battery Packs – Exit Signs: Nickel Cadmium battery with self- diagnostics; Minimum 3-year non-prorated replacement warranty.
- H. Emergency Generator / Inverter Load Control Device (ELC):
 - 1. 16 Amp minimum ballast / driver load.
 - 2. Compatible with 0-10 Volt dimmer switches.
 - 3. UL 924.
 - 4. Minimum 3-year warranty.
 - 5. Integral or remove test switch.
- I. Emergency Generator / Inverter branch circuit transfer switch:
 - 1. UL 1008.
 - 2. 20 Amp ballast/driver load.
 - 3. 0-10Vdc dimming compatible.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install lighting fixtures of the types indicated, where shown, and at indicated heights in accordance with the fixture manufacturer's written instructions and industry practices to ensure that the fixtures meet the specifications. Fixtures shall fit the type of ceiling system scheduled.
- B. Standards: Comply with NEMA standards, applicable requirements of NEC pertaining to installation of interior lighting fixtures, and with NECA Standard of Installation.
- C. Attachment: Fasten fixtures to the indicated structural support members of the building. Provide four separate wire supports for recessed ceiling mounted lighting fixtures, one at each corner of fixture. Check to ensure that solid pendant fixtures are plumb. Provide T-bar locking clips on all four sides for lay-in fixtures.
- D. Coordination: Field coordinate and locate lighting fixtures in open ceiling areas including mechanical and electrical rooms so that light is not obstructed by piping, ductwork, etc. Locate light fixtures in front of electrical and mechanical equipment to provide adequate illumination for testing and maintenance. Relocate installed light fixtures as directed by Owner / Architect at no additional cost.
- E. Final adjustment of all aimable exterior light fixtures shall be in coordination with, and to the satisfaction of, the Owner's designated representative. Pre-aim all fixtures prior to scheduled final aiming and adjustment with Architect / Owner. Verify that all rotatable optics are in their proper orientation prior to final aiming.

- F. Provide vandal resistant exit signs without wire guards in all physical education and athletic sports areas, including egress corridors adjacent to these areas, black box theaters, auditorium stages, vocational shops, cafeteriums and kitchens.
- G. Provide exit sign directional arrows as required. Provide a minimum of two and a maximum of 10% spare exit signs to be installed as directed by Architect.
- H. Install in accordance with manufacturers instructions.
- I. Install suspended luminaires using pendants supported from swivel hangers. Provide pendant length required to suspend luminary at indicated height.
- J. Locate recessed ceiling luminaires as indicated on the Architectural reflected ceiling plan.
- K. Install surface mounted luminaires plumb and adjust to align with building lines and with each other. Secure to prohibit movement.
- L. Exposed Grid Ceilings: Support surface mounted luminaires on grid ceiling directly from building structure. Provide auxiliary members spanning ceiling Ts to support surface mounted luminaires. Fasten surface mounted luminaires to ceiling T using bolts, screws, rivets, or suitable clips.
- M. Install recessed luminaires to permit removal from below.
- N. Install recessed luminaires using accessories and fire stopping materials to meet regulatory requirements for fire rating.
- O. Install wall-mounted luminaires at height as directed by Architect.
- P. Install accessories furnished with each luminary.
- Q. Connect luminaires to branch circuit outlets using flexible conduit as specified.
- R. Make wiring connections to branch circuit using building wire with insulation suitable for temperature conditions within luminaires.
- S. Bond products and metal accessories to branch circuit equipment grounding conductor.
- T. Provide emergency transfer devices for light fixtures powered by generator or inverter emergency lighting circuits which are used for normal lighting and to be switched with the switched normal lighting circuit in the same room, corridor or area.
- U. Provide un-switched, constant-hot circuit to all battery powered emergency lighting equipment and emergency load control devices (ELC). Where normal light fixture circuit is switched or contactor controlled, non-switched battery charging or ELC circuit shall originate from same branch circuit breaker as switched lighting circuit.
- V. Provide emergency powered light fixture in front of all electrical switchgear, including but not limited to panelboards, switchboards, motor control centers, low voltage control panels, transfer switches, motor controllers and disconnect switches.
- W. Provide emergency battery operated light fixtures at all transfer switch locations and at all central battery emergency lighting inverters.
- X. Provide automatic controls for exterior light fixtures. Exterior building mounted light

fixtures shall be circuited through lighting contactors. Lighting contactors shall be controlled by the Building Management System. Provide separate lighting contactors for:

1. Parking Lot Lighting
2. Building Mounted Lighting
3. Exterior Signage

- Y. Lighting contactors shall not be installed above ceiling and shall be readily accessible, located in same room as panelboard serving load.
- Z. Wall mounted light fixtures shall be attached to the studs in the walls. Attachment to gypsum board only is not acceptable. Where wall mounted fixtures attach to junction box only, firmly secure junction box to adjoining studs in wall.
- AA. Lighting Fixture Supports:
1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction to the structural slab or to structural members within a partition, or above a suspended ceiling.
 2. Shall maintain the fixture positions after cleaning and relamping.
 3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
- BB. Hardware for surface mounting fixtures to suspended ceilings:
1. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 1/4 inch secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
 2. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 1/4-inch studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 1/4-inch toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.
- CC. Lighting Fixture Supports for aluminum canopies:
1. Light fixtures mounted under aluminum canopies shall be UL wet location from above listed without a protective ceiling or cover. Light fixture shall not have conduit penetrations or mounting hole penetrations field made in the top of the fixture. Conduit penetration shall be at the end of the fixture only.

3.2 TESTING

- A. General: Upon installation of lighting fixtures, and after building circuits are energized, apply electrical energy to demonstrate proper operations of lighting fixtures, emergency lighting, and controls. When possible, correct malfunctioning units at the site, then retest to demonstrate proper operation; otherwise, remove and replace with new units, and proceed with retesting.
- B. Pre-Inspection Tasks: Immediately before final inspection, clean fixtures inside and out, including plastics and glassware, adjust trim to fit adjacent surfaces, replace broken or damaged parts, and lamp and test fixtures for electrical and mechanical operations. Any fixtures, or parts of fixtures that show signs of rust or corrosion at the time of completion, shall be removed, and replaced with protected metal parts.

- C. Final aiming and adjustment: Aim and adjust lighting fixtures for their intended purpose as specified or as required. Adjustments may include but not be limited to directional aiming, adjusting selectable lumen output, selectable correlative color temperature (CCT), selectable beam pattern, replacing/installing fixture manufacture's optional optical lens used for adjusting beam patterns or for softening beam edges, replacing/installing manufacture's optional theatrical/specialty color lens colors. Re-aim and re-adjust as required to the satisfaction of the Architect / Owner, including nighttime adjustment of exterior lighting in the presence of the Architect / Owner.

END OF SECTION

INTENTIONALLY LEFT BLANK

MECHANICAL EQUIPMENT SCHEDULE									
CALLOUT	DESCRIPTION	VOLTS	KVA	MCA	MOCF	WIRE CALLOUT	DISCONNECT	DISC PROV BY	DISC INST BY
CU-1	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-2	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-3	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-4	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-5	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-6	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-7	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-8	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-9	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-10	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-11	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-12	CONDENSING UNIT	208/120V 2P 3W	3.54	17	30	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-13	CONDENSING UNIT	208/120V 2P 3W	2.5	12	15	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
CU-14	CONDENSING UNIT	208/120V 2P 3W	2.5	12	15	3/4"C,2#10,#10N,#10G	NON-FUSED	EC	EC
F-1	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-2	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-3	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-4	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-5	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-6	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#12,#12N,#12G	DUPLEX RECEPTACLE	EC	EC
F-7	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-8	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-9	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-10	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-11	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-12	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-13	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
F-14	FURNACE	120V 1P 2W	1.18	9.8	15	3/4"C,1#10,#10N,#10G	DUPLEX RECEPTACLE	EC	EC
RTU-1	ROOFTOP UNIT	208V 3P 3W	18.73	52	60	1"C,3#4,#10G	NON-FUSED	EC	EC

ELECTRICAL ABBREVIATIONS

AC	ABOVE COUNTERTOP	MC	MECHANICAL CONTRACTOR
AFF	ABOVE FINISH FLOOR	MCA	MINIMUM CIRCUIT AMPS
AFG	ABOVE FINISH GRADE	MDP	MAIN DISTRIBUTION PANEL
ANNC	ANNUNCIATOR	MTD	MOUNTED
CC	CONTROLS CONTRACTOR	NIC	NOT IN CONTRACT
DF	DRINKING FOUNTAIN	OCC	OCCUPANCY
EC	ELECTRICAL CONTRACTOR	PC	PLUMBING CONTRACTOR
EF	EXHAUST FAN	PNL	PANEL
EX	EXISTING	SPST	SINGLE POLE SINGLE THROW
EXR	EXISTING RELOCATED	TTB	TELEPHONE TERMINAL BOARD
GC	GENERAL CONTRACTOR	TYP	TYPICAL
GFI	GROUND FAULT INTERRUPT	WG	WIRE GUARD
HP	HORSEPOWER	WP	WEATHER PROOF
IBC	INTERNATIONAL BUILDING CODE	20A	20 AMP
IG	ISOLATED GROUND	Ø	PHASE
LV	LOW VOLTAGE	3W	3 WIRE
LVRP	LV RELAY PANEL	1P20A	SINGLE POLE 20 AMP

GENERAL ELECTRICAL NOTES

- CONTRACTOR TO VERIFY EXISTING ELECTRICAL CONDITIONS AND NOTIFY ARCHITECT/ENGINEER OF ANY ELECTRICAL OR CODE ISSUES PRIOR TO BID. CONTRACTOR IS RESPONSIBLE FOR PROVIDING A COMPLETE AND OPERATIONAL CODE COMPLIANT SYSTEM.
- ALL WORK SHALL BE IN CONFORMANCE WITH NATIONAL, STATE, AND LOCAL CODES AND/OR ORDINANCES.
- ELECTRICAL CONTRACTOR SHALL COORDINATE WORK WITH ALL OTHER CONTRACTORS & LOCAL UTILITY. E.G. SHALL CONTACT LOCAL UTILITY FOR EXACT SERVICE REQUIREMENTS TO INCLUDE BUT NOT LIMITED TO TRANSFORMER, METERING AND CABLING. LOCAL UTILITY REQUIREMENTS SUPERSEDE DRAWINGS AND SPECIFICATIONS.
- SEE ARCHITECTURAL, MECHANICAL, & PLUMBING DRAWINGS FOR ADDITIONAL REQUIREMENTS.
- ELECTRICAL DRAWINGS ARE DIAGRAMMATIC ONLY. THEY ARE INTENDED TO GIVE APPROXIMATE LOCATIONS AND OVERALL DESIGN INTENT. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PRODUCTS, MATERIALS, AND ELECTRICAL METHODS WHICH HAVE NOT BEEN SHOWN OR INDICATED BUT ARE REQUIRED FOR A COMPLETE SYSTEM TO THE STANDARDS OF THE INDUSTRY.
- INSTALL LIGHTING FIXTURES IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. PROVIDE SUPPORTING DEVICES FOR ADEQUATE SUPPORT OF FIXTURES FROM STRUCTURE.
- UPON COMPLETION OF THE ELECTRICAL WORK, THE INSTALLATION SHALL BE TESTED FOR CONTINUITY, GROUNDS, AND SHORT CIRCUITS. THE ELECTRICAL CONTRACTOR SHALL DEMONSTRATE PROPER PERFORMANCE OF ALL SYSTEMS. ALL DEFECTIVE WORK OR MATERIALS SHALL BE REPLACED OR REPAIRED AS NECESSARY AND RETESTED.
- ELECTRICAL RACEWAYS THAT PENETRATE FIRE RATED ASSEMBLIES SHALL BE SLEEVED AND SEALED AS PER THE LOCAL BUILDING CODE.
- THE ELECTRICAL CONTRACTOR SHALL PROVIDE A TEMPORARY ELECTRICAL SYSTEM FOR THE PROJECT. AT LEAST ONE 120 VOLT SINGLE PHASE RECEPTACLE SHALL BE PROVIDED FOR EACH 500 SQUARE FEET OF FLOOR SPACE. SUFFICIENT TEMPORARY LIGHTING SHALL BE PROVIDED TO ALLOW ALL CONTRACTORS TO COMPLETE THEIR WORK. TEMPORARY ELECTRICAL CIRCUITS SHALL BE EQUIPPED WITH COMBINATION GROUND FAULT INTERRUPTER AND CIRCUIT BREAKER PER NEC. TEMPORARY ELECTRICAL SYSTEM SHALL BE INCLUDED IN THIS BID. USAGE CHARGES SHALL BE PAID FOR BY THE GENERAL CONTRACTOR.

ELECTRICAL LEGEND

	PANEL BOARD
	DISTRIBUTION PANEL BOARD
	TRANSFORMER
	UTILITY METER
	SEPARATE CIRCUIT BREAKER
	DISCONNECT
	FUSED DISCONNECT SWITCH
	EMERGENCY FUSED DISCONNECT SWITCH
	MOTOR STARTER/CONTRACTOR
	COMBINATION MOTOR STARTER
	PUSH BUTTON STATION AS NOTED
	PULL BOX, SIZE AS REQUIRED BY CODE
	ELECTRICAL CONNECTION
	MOTOR CONNECTION
	HOME RUN TO PANEL BOARD

ELECTRICAL SHEET INDEX

E-000	ELECTRICAL TITLE SHEET
ED-101	ELECTRICAL DEMOLITION PLAN - FIRST FLOOR
ED-201	ELECTRICAL DEMOLITION PLAN - ROOF
E-101	ELECTRICAL LIGHTING PLAN - ALTERNATE
E-102	ELECTRICAL POWER PLAN
E-201	ELECTRICAL ROOF PLAN
E-401	ELECTRICAL ONE-LINE DIAGRAM AND SCHEDULES
E-501	ELECTRICAL DETAILS SHEET

AGP
the Abla Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



JV

drawn by

TVO

checked by

MARCH 2024

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

E-000



2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

ED-101

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

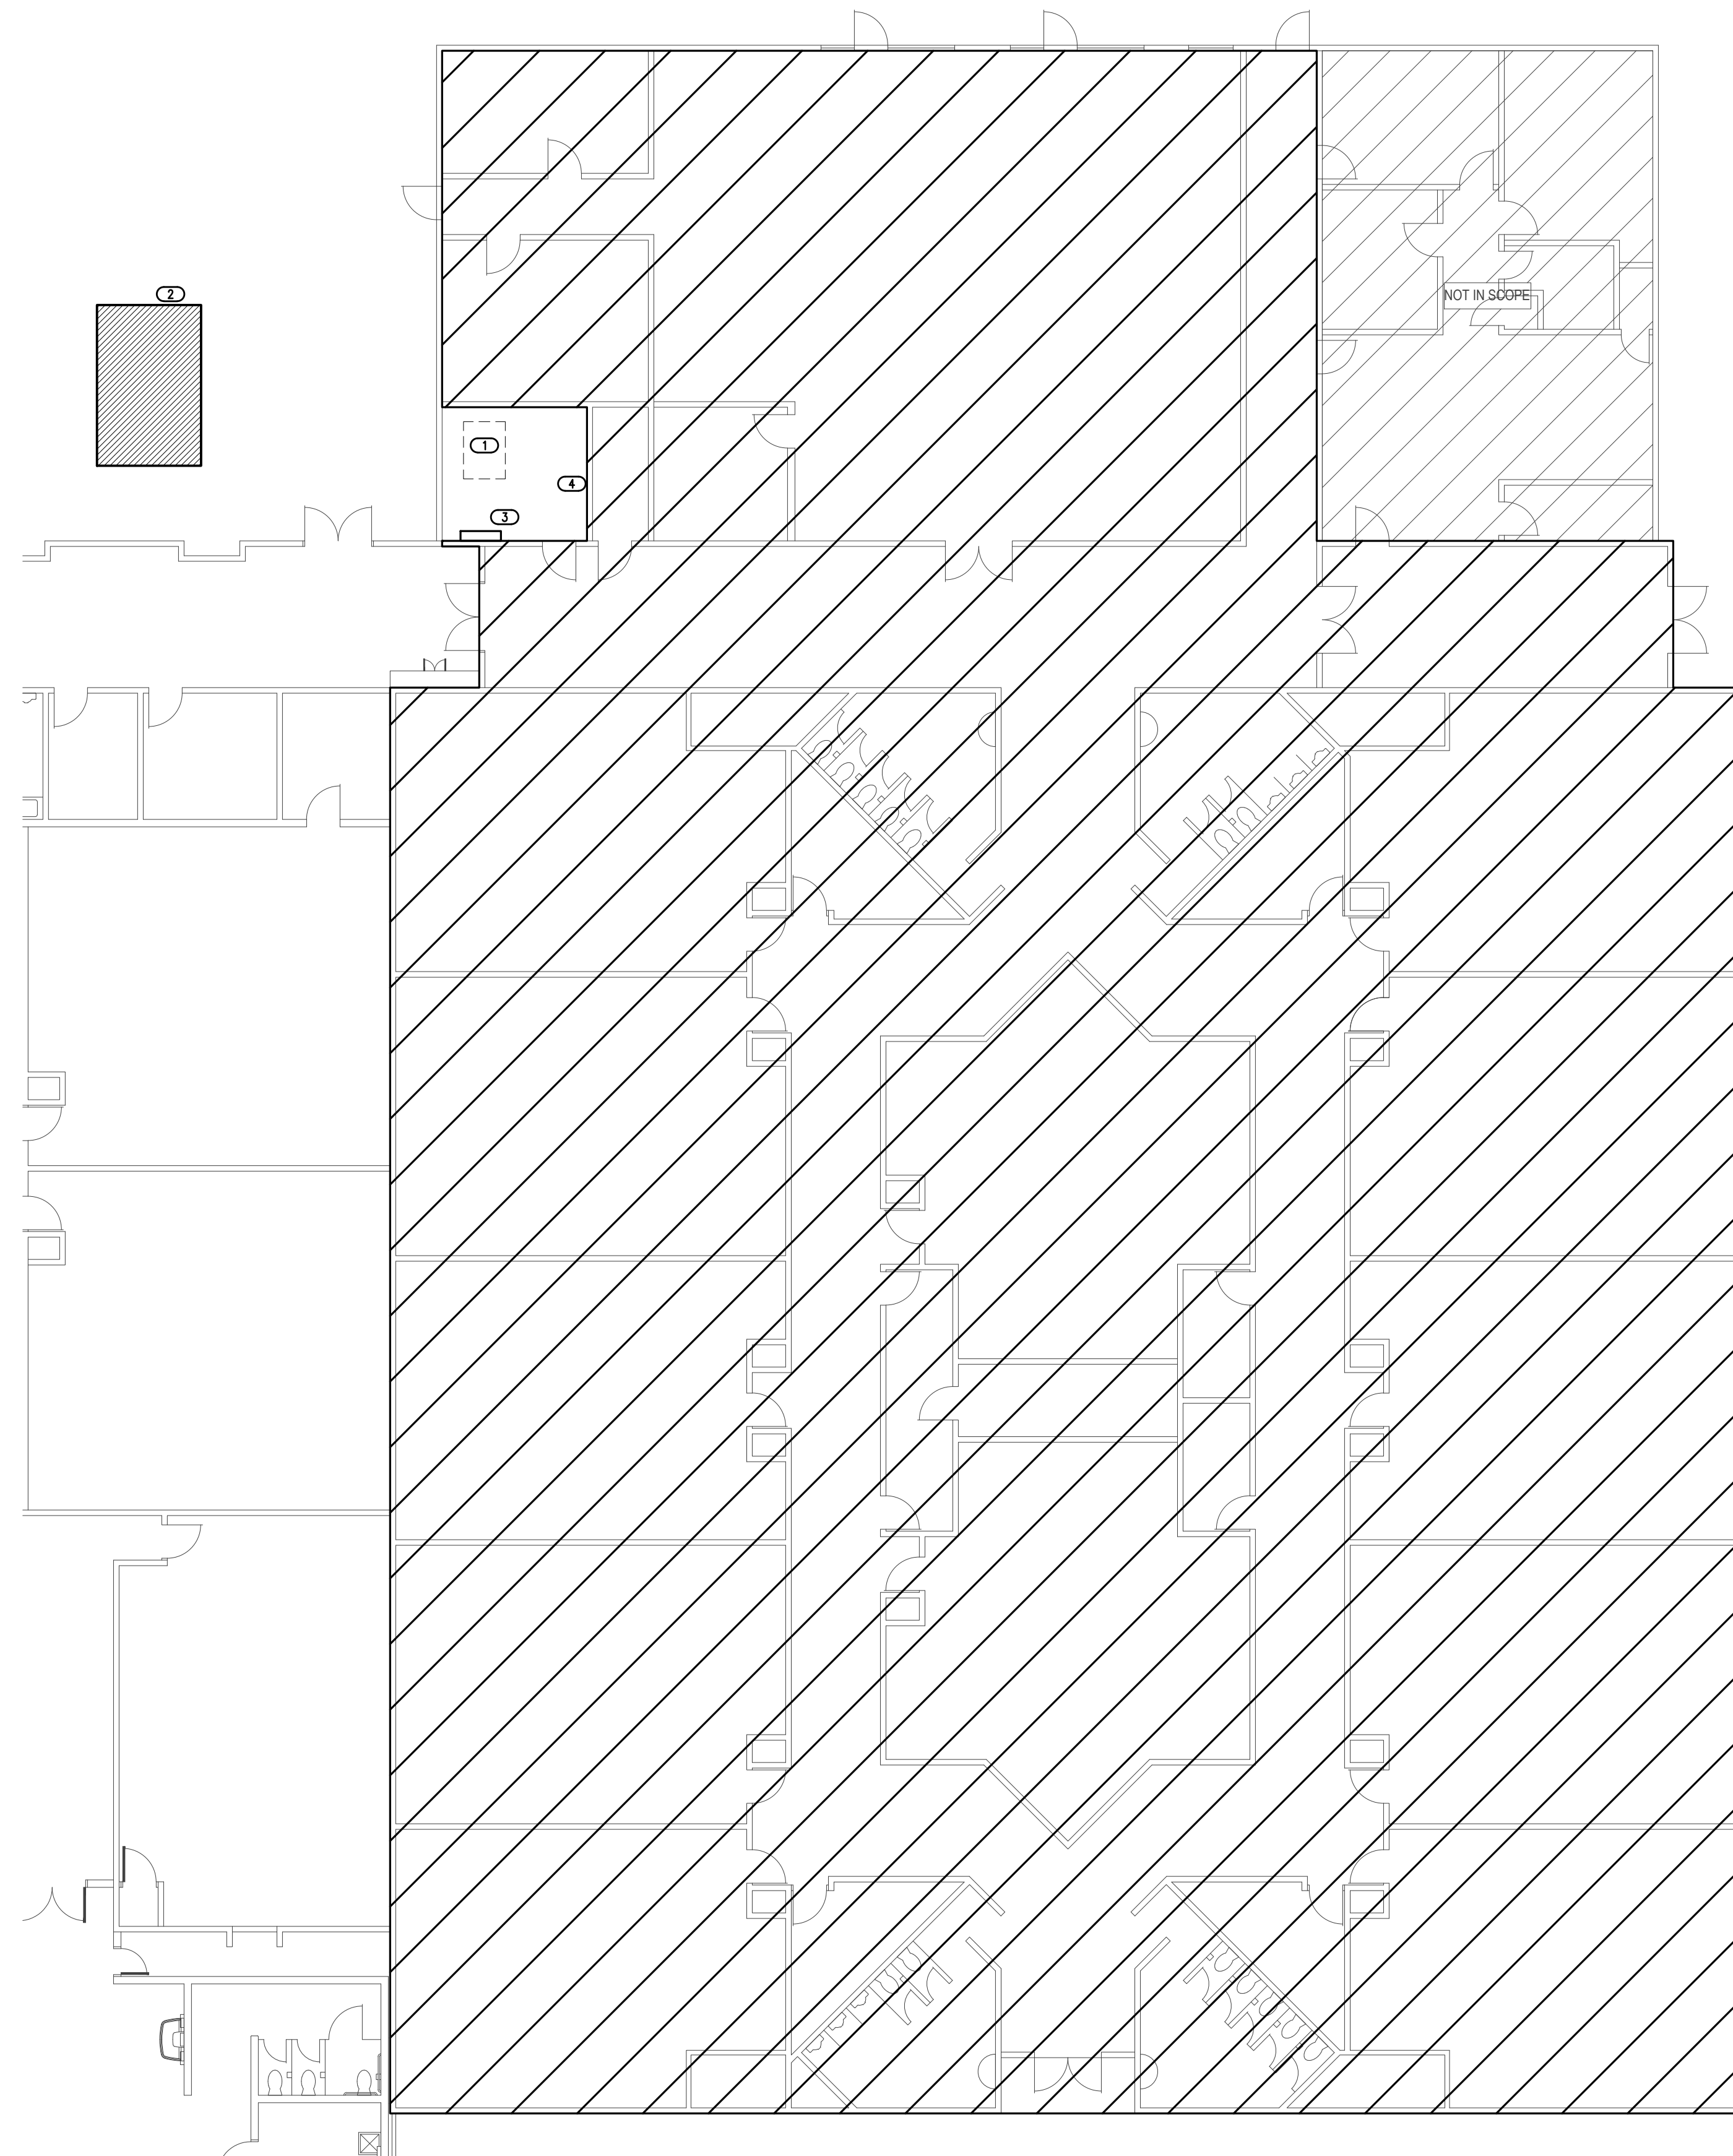

ALTERNATE BID

EC TO DEMOLISH AND REPLACE ALL EXISTING LIGHT FIXTURES IN THE BUILDING WITH NEW.


DEMOLITION GENERAL NOTES

1. THESE DEMOLITION PLANS HAVE BEEN PREPARED TO ASSIST THE CONTRACTOR IN DETERMINING THE SCOPE OF DEMOLITION WORK TO BE INCLUDED IN THIS PROJECT. THE CONTRACTOR SHOULD REVIEW ALL DRAWINGS AND SPECIFICATIONS, INCLUDING DEMOLITION SHOWN FOR OTHER TRADES, AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS, IN ORDER TO DETERMINE THE SCOPE OF DEMOLITION WORK.
2. PROVIDE NEW CONDUIT AND WIRING AS REQUIRED FOR A COMPLETE CONNECTION. EXISTING CONDUIT AND WIRING MAYBE REUSED IF IN SERVICEABLE CONDITION. NEW DEVICES AND FIXTURES SHALL BE CIRCUITED TO NEW PANELS AS INDICATED. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT ANY ANOMALIES TO THE ARCHITECT AND ENGINEER PRIOR TO PROCEEDING.
3. DEMOLITION PLAN INFORMATION SHOWN AT TIME OF DESIGN. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ANY NECESSARY CHANGES TO COMPLETE THE WORK.

KEYED NOTES

- 1 APPROXIMATE LOCATION OF EXISTING BOILER TO BE DE-ENERGIZED. EC TO REMOVE ALL ELECTRICAL CONNECTIONS AND FEEDERS BACK TO SOURCE PANEL AND LABEL BREAKER AS SPARE.
- 2 APPROXIMATE LOCATION OF EXISTING CHILLER TO BE DE-ENERGIZED. EC TO REMOVE ALL ELECTRICAL CONNECTIONS AND FEEDERS BACK TO SOURCE PANEL AND LABEL BREAKER AS SPARE.
- 3 APPROXIMATE LOCATION OF EXISTING 'MDP' PANEL ON THE FIRST FLOOR OF THE BUILDING. EC TO FIELD VERIFY EXACT LOCATIONS OF PANELS AND BREAKERS FEEDING BOILER AND CHILLER PRIOR TO BEGINNING WORK.
- 4 EC TO DEMOLISH EXISTING WATER HEATER CONNECTION AND PREPARE AREA FOR NEW LOCATION. REFER TO SHEET 'E-102' FOR NEW LOCATION.



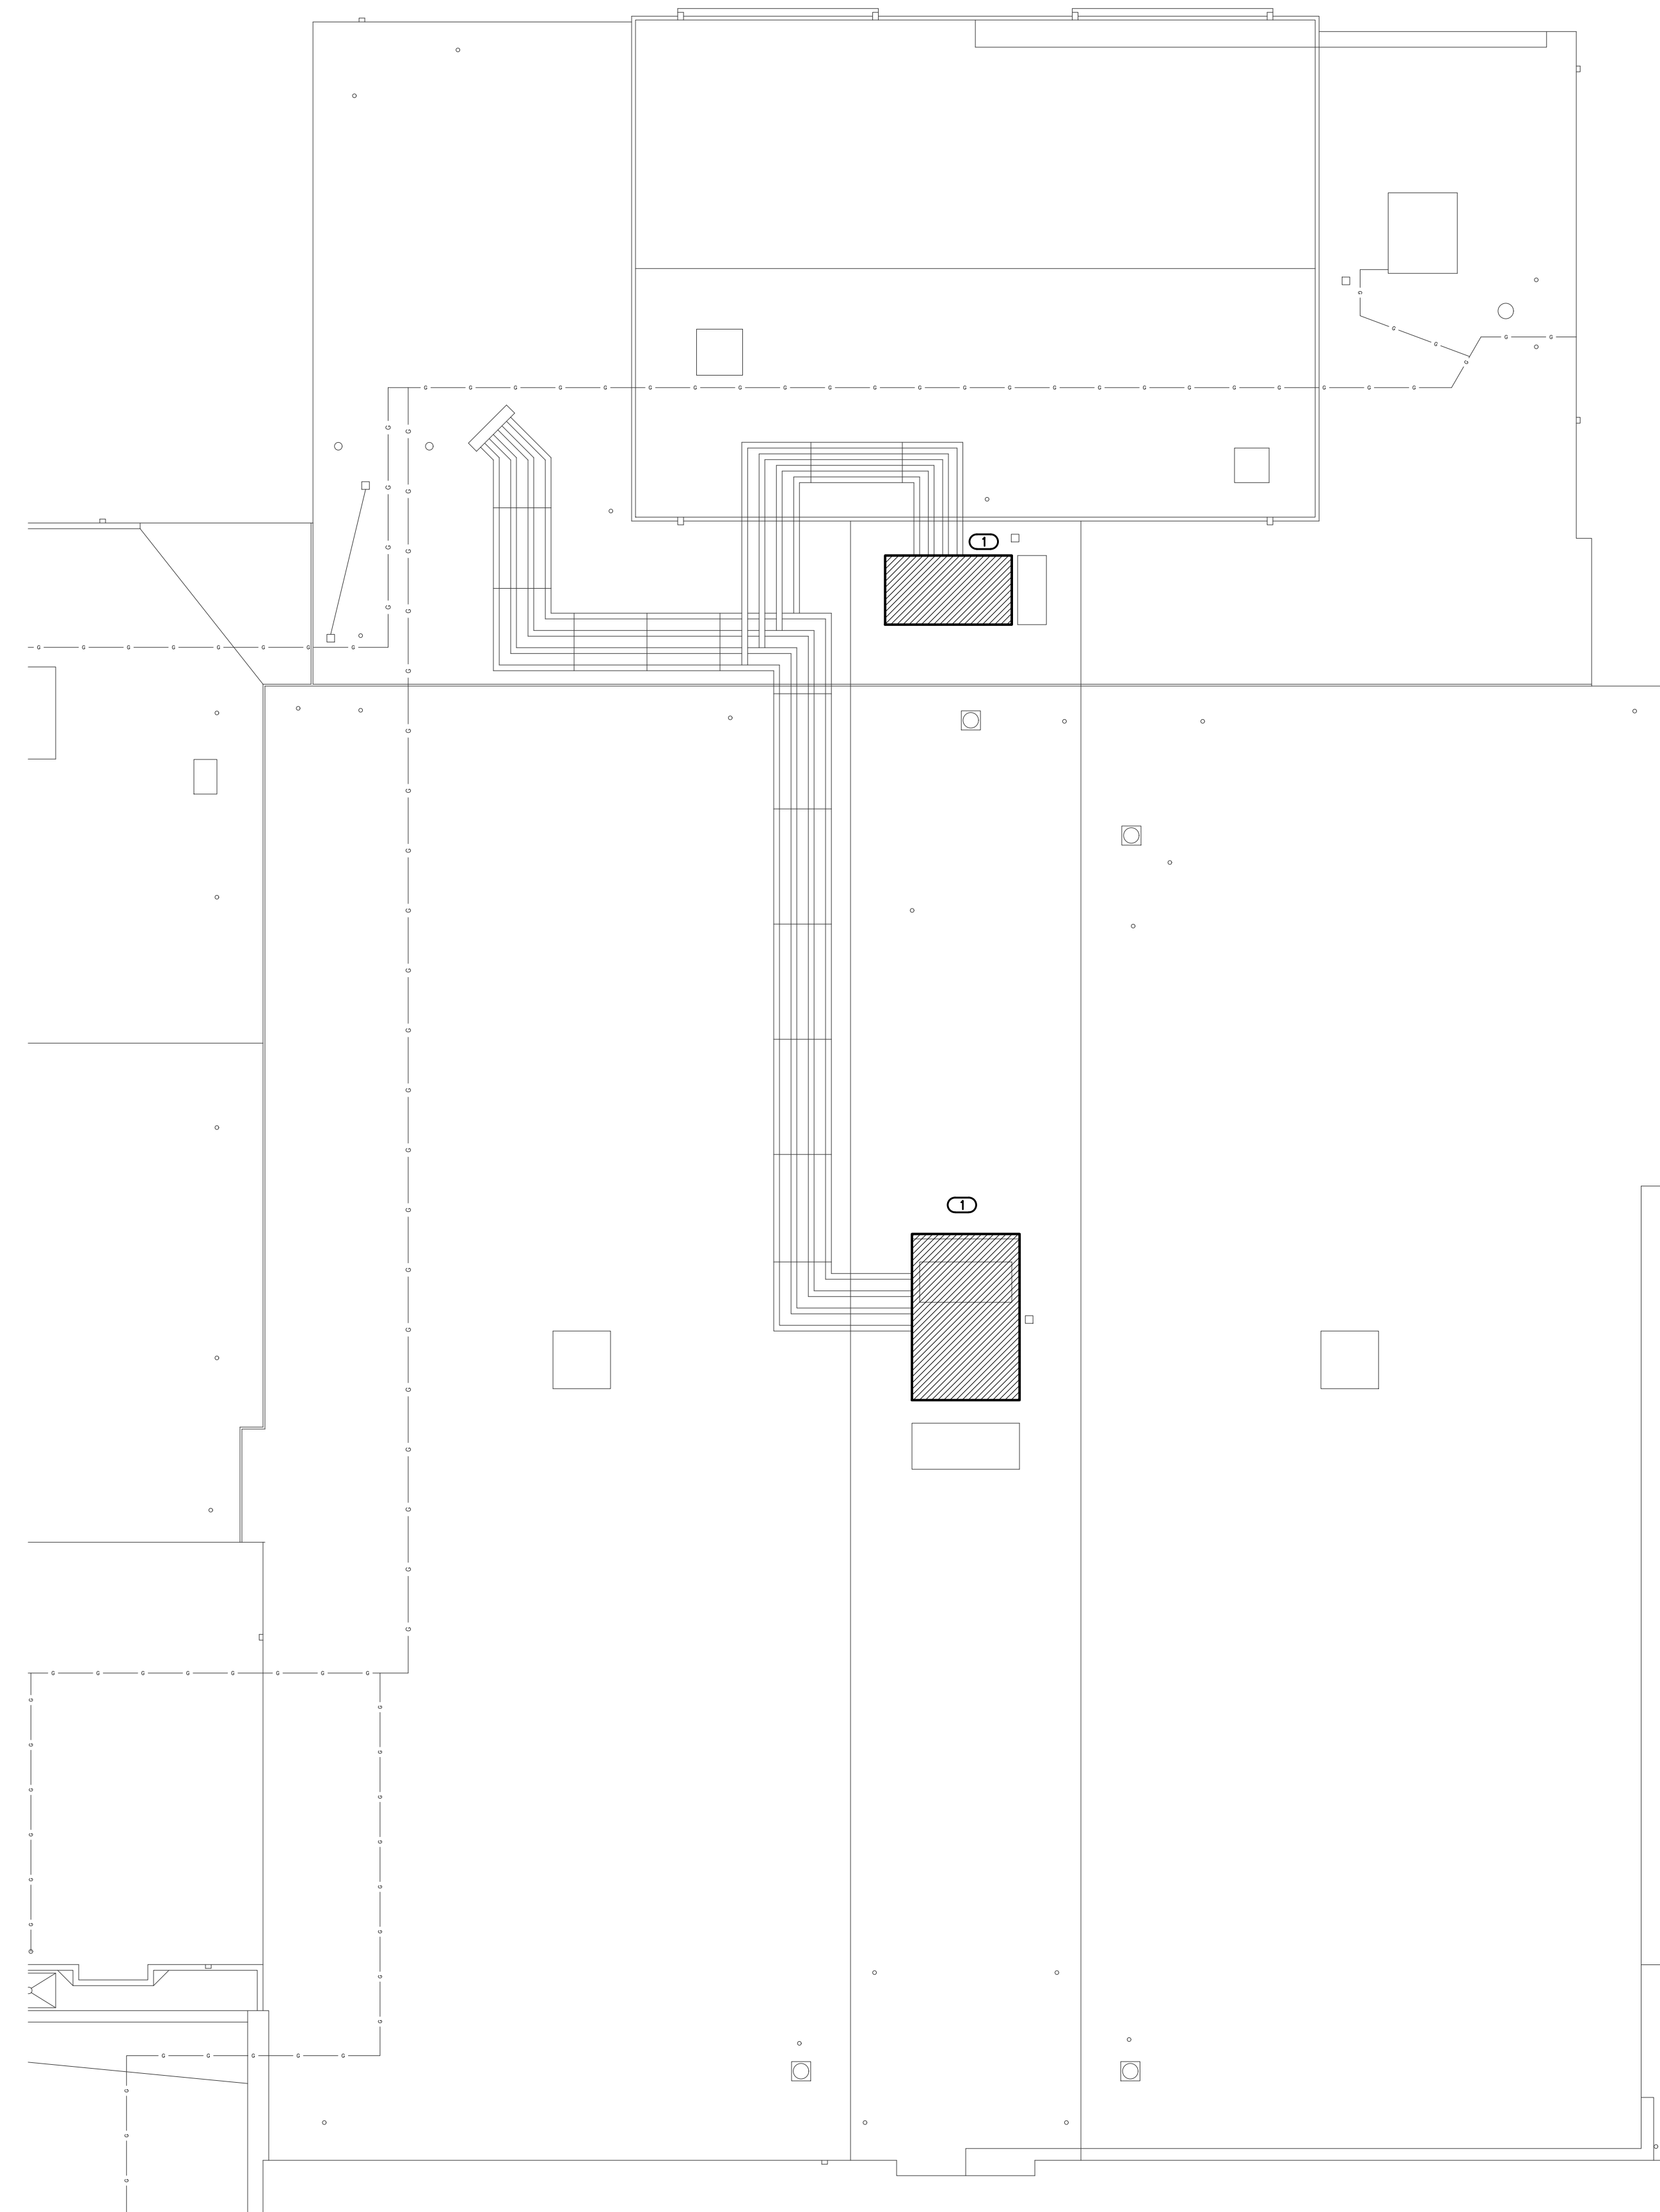

- | DEMOLITION GENERAL NOTES | |
|--------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1. | THESE DEMOLITION PLANS HAVE BEEN PREPARED TO ASSIST THE CONTRACTOR IN DETERMINING THE SCOPE OF DEMOLITION WORK TO BE INCLUDED IN THIS PROJECT. THE CONTRACTOR SHOULD REVIEW ALL DRAWINGS AND SPECIFICATIONS, INCLUDING DEMOLITION SHOWN FOR OTHER TRADES, AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS, IN ORDER TO DETERMINE THE SCOPE OF DEMOLITION WORK. |
| 2. | PROVIDE NEW CONDUIT AND WIRING AS REQUIRED FOR A COMPLETE CONNECTION. EXISTING CONDUIT AND WIRING MAYBE REUSED IF IN SERVICEABLE CONDITION. NEW DEVICES AND FIXTURES SHALL BE CIRCUITED TO NEW PANELS AS INDICATED. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT ANY ANOMALIES TO THE ARCHITECT AND ENGINEER PRIOR TO PROCEEDING. |
| 3. | DEMOLITION PLAN INFORMATION SHOWN AT TIME OF DESIGN. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ANY NECESSARY CHANGES TO COMPLETE THE WORK. |
-
- | KEYED NOTES | |
|-------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Ⓚ | APPROXIMATE LOCATION OF EXISTING AIR HANDLING UNIT TO BE DEMOLISHED. EC TO REMOVE ALL ELECTRICAL CONNECTIONS AND FEEDERS BACK TO SOURCE PANEL AND LABEL BREAKER AS SPARE. |

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions


MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL


sheet no:
ED-201

1 ELECTRICAL DEMOLITION PLAN - ROOF
SCALE: 1/16" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

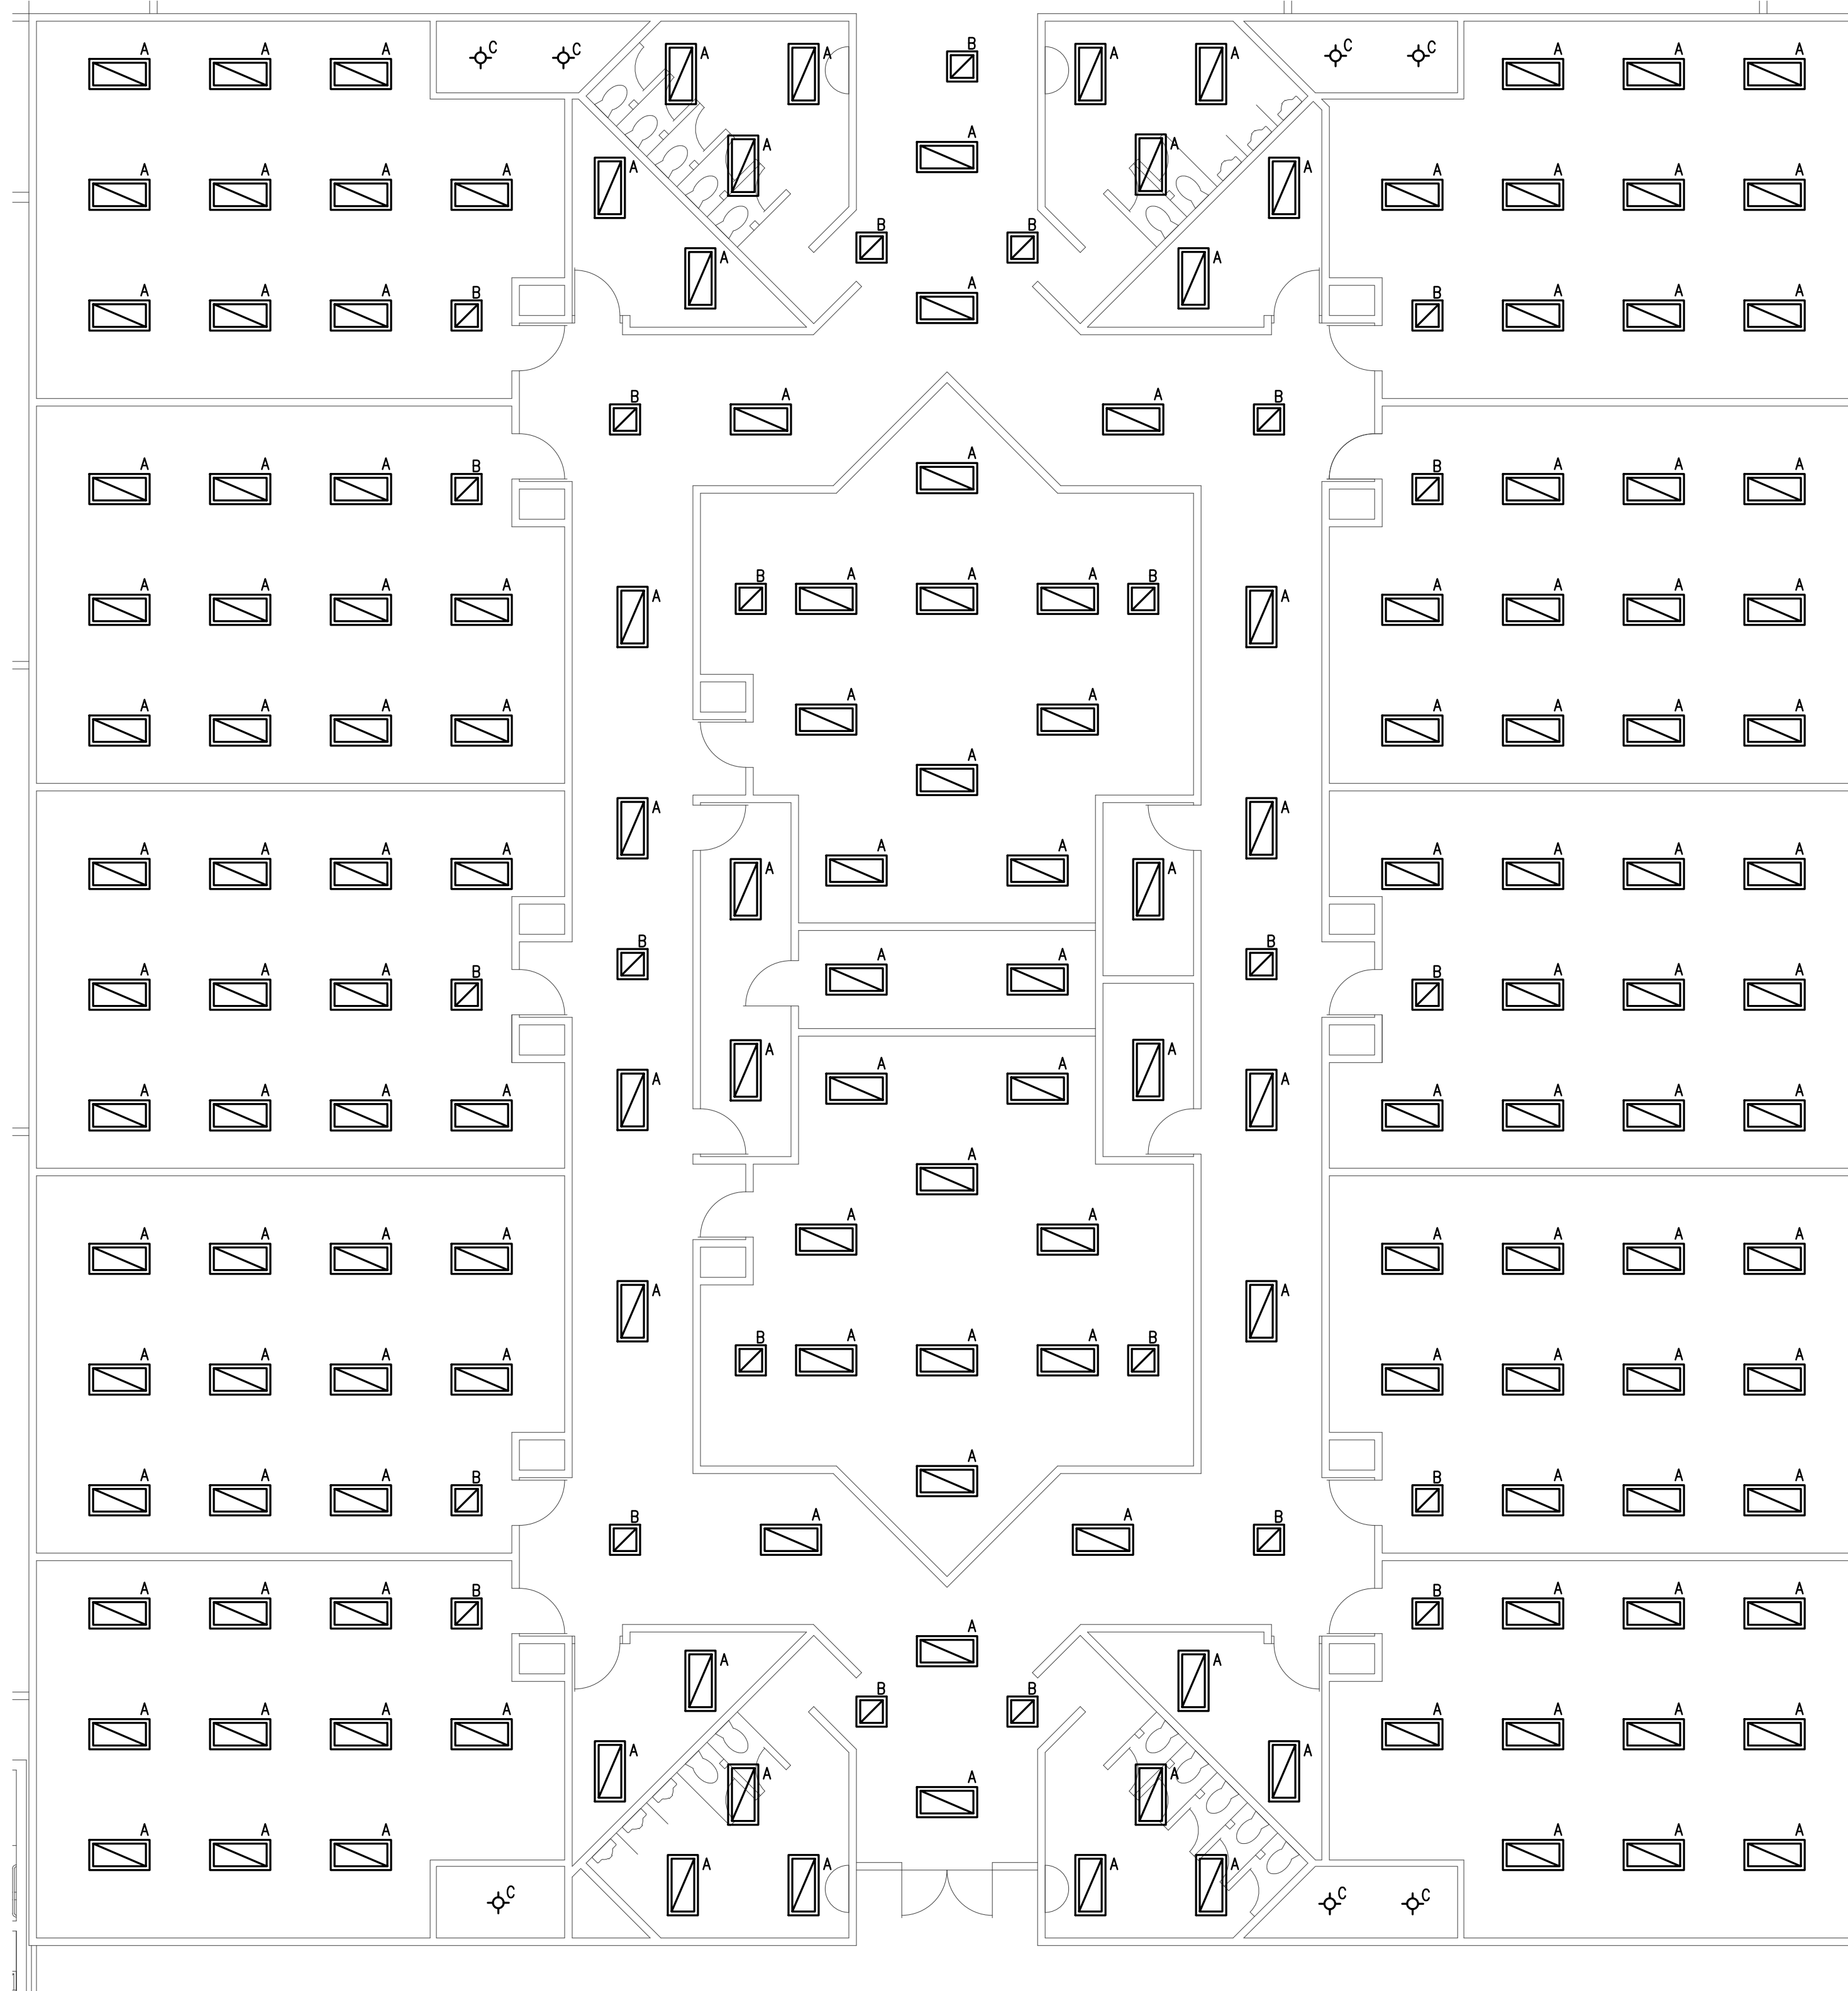

- LIGHTING GENERAL NOTES**
1. FIELD VERIFY EXISTING CONDITIONS/QUANTITIES AND REPORT ANY ANOMALIES TO ENGINEER PRIOR TO BEGINNING WORK
 2. NEW LIGHT FIXTURES SHALL BE POWERED FROM THEIR EXISTING BRANCH CIRCUITS. EC SHALL REUSE/EXTEND EXISTING CONDUIT AND WIRE TO FEED NEW FIXTURES AS NECESSARY FOR A COMPLETE CONNECTION.
 3. NEW LIGHTING TO BE CONTROLLED BY EXISTING CONTROLS UNLESS OTHERWISE NOTED IN DRAWINGS.
 4. CONNECT BATTERY PACKS TO UNSWITCHED HOT OF LOCAL LIGHTING CIRCUIT.
 5. LABEL SWITCH PLATES AND J-BOXES WITH CIRCUIT PER SPECS.
 6. PULL ALL UNUSED WIRING AND CONDUIT BACK TO SOURCE PANEL AND LABEL AS SPARE.
 7. EC SHALL UPDATE CIRCUIT DIRECTORIES IN EXISTING PANELS AS REQUIRED FOR NEW LIGHTING. NEW CIRCUITS DIRECTORIES ARE TO BE TYPED AND PRINTED.

LIGHT FIXTURE SCHEDULE				
TYPE	SYMBOL	DESCRIPTION	MANUFACTURER	REFERENCE CATALOG #
A		2x4 LED RECESSED TROFFER. 38W, 4000 LUMENS, 3500K CCT. 0-10V DIMMING.	LSI INDUSTRIES	LPASC24 LED 40L UNV DIM1 35
B		2x2 LED RECESSED TROFFER. 38W, 3900 LUMENS, 3500K CCT. 0-10V DIMMING.	LSI INDUSTRIES	LPASC22 LED 39L UNV DIM1 35
C		4 INCH ROUND DOWNLIGHT. 22W, 2200 LUMEN, 3500K CCT. 0-10V DIMMING.	LSI INDUSTRIES	LAD4R LED 24L UNV DIM1 35 TR4B WH

GENERAL NOTES:
EQUIVALENT ALTERNATE LIGHT FIXTURES MAY BE PROVIDED FOR BIDDING PURPOSES. THE ENGINEER DOES NOT TAKE RESPONSIBILITY FOR ENSURING ALTERNATE LIGHT FIXTURES USED FOR BIDDING ARE EQUAL; THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING ALTERNATE FIXTURES ARE EQUIVALENT TO THOSE SPECIFIED PRIOR TO BID. THE WINNING BID PACKAGE SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW IN ACCORDANCE WITH THE SPECIFICATIONS.

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:


E-101

1 ELECTRICAL LIGHTING PLAN - ALTERNATE
SCALE: 1/4" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

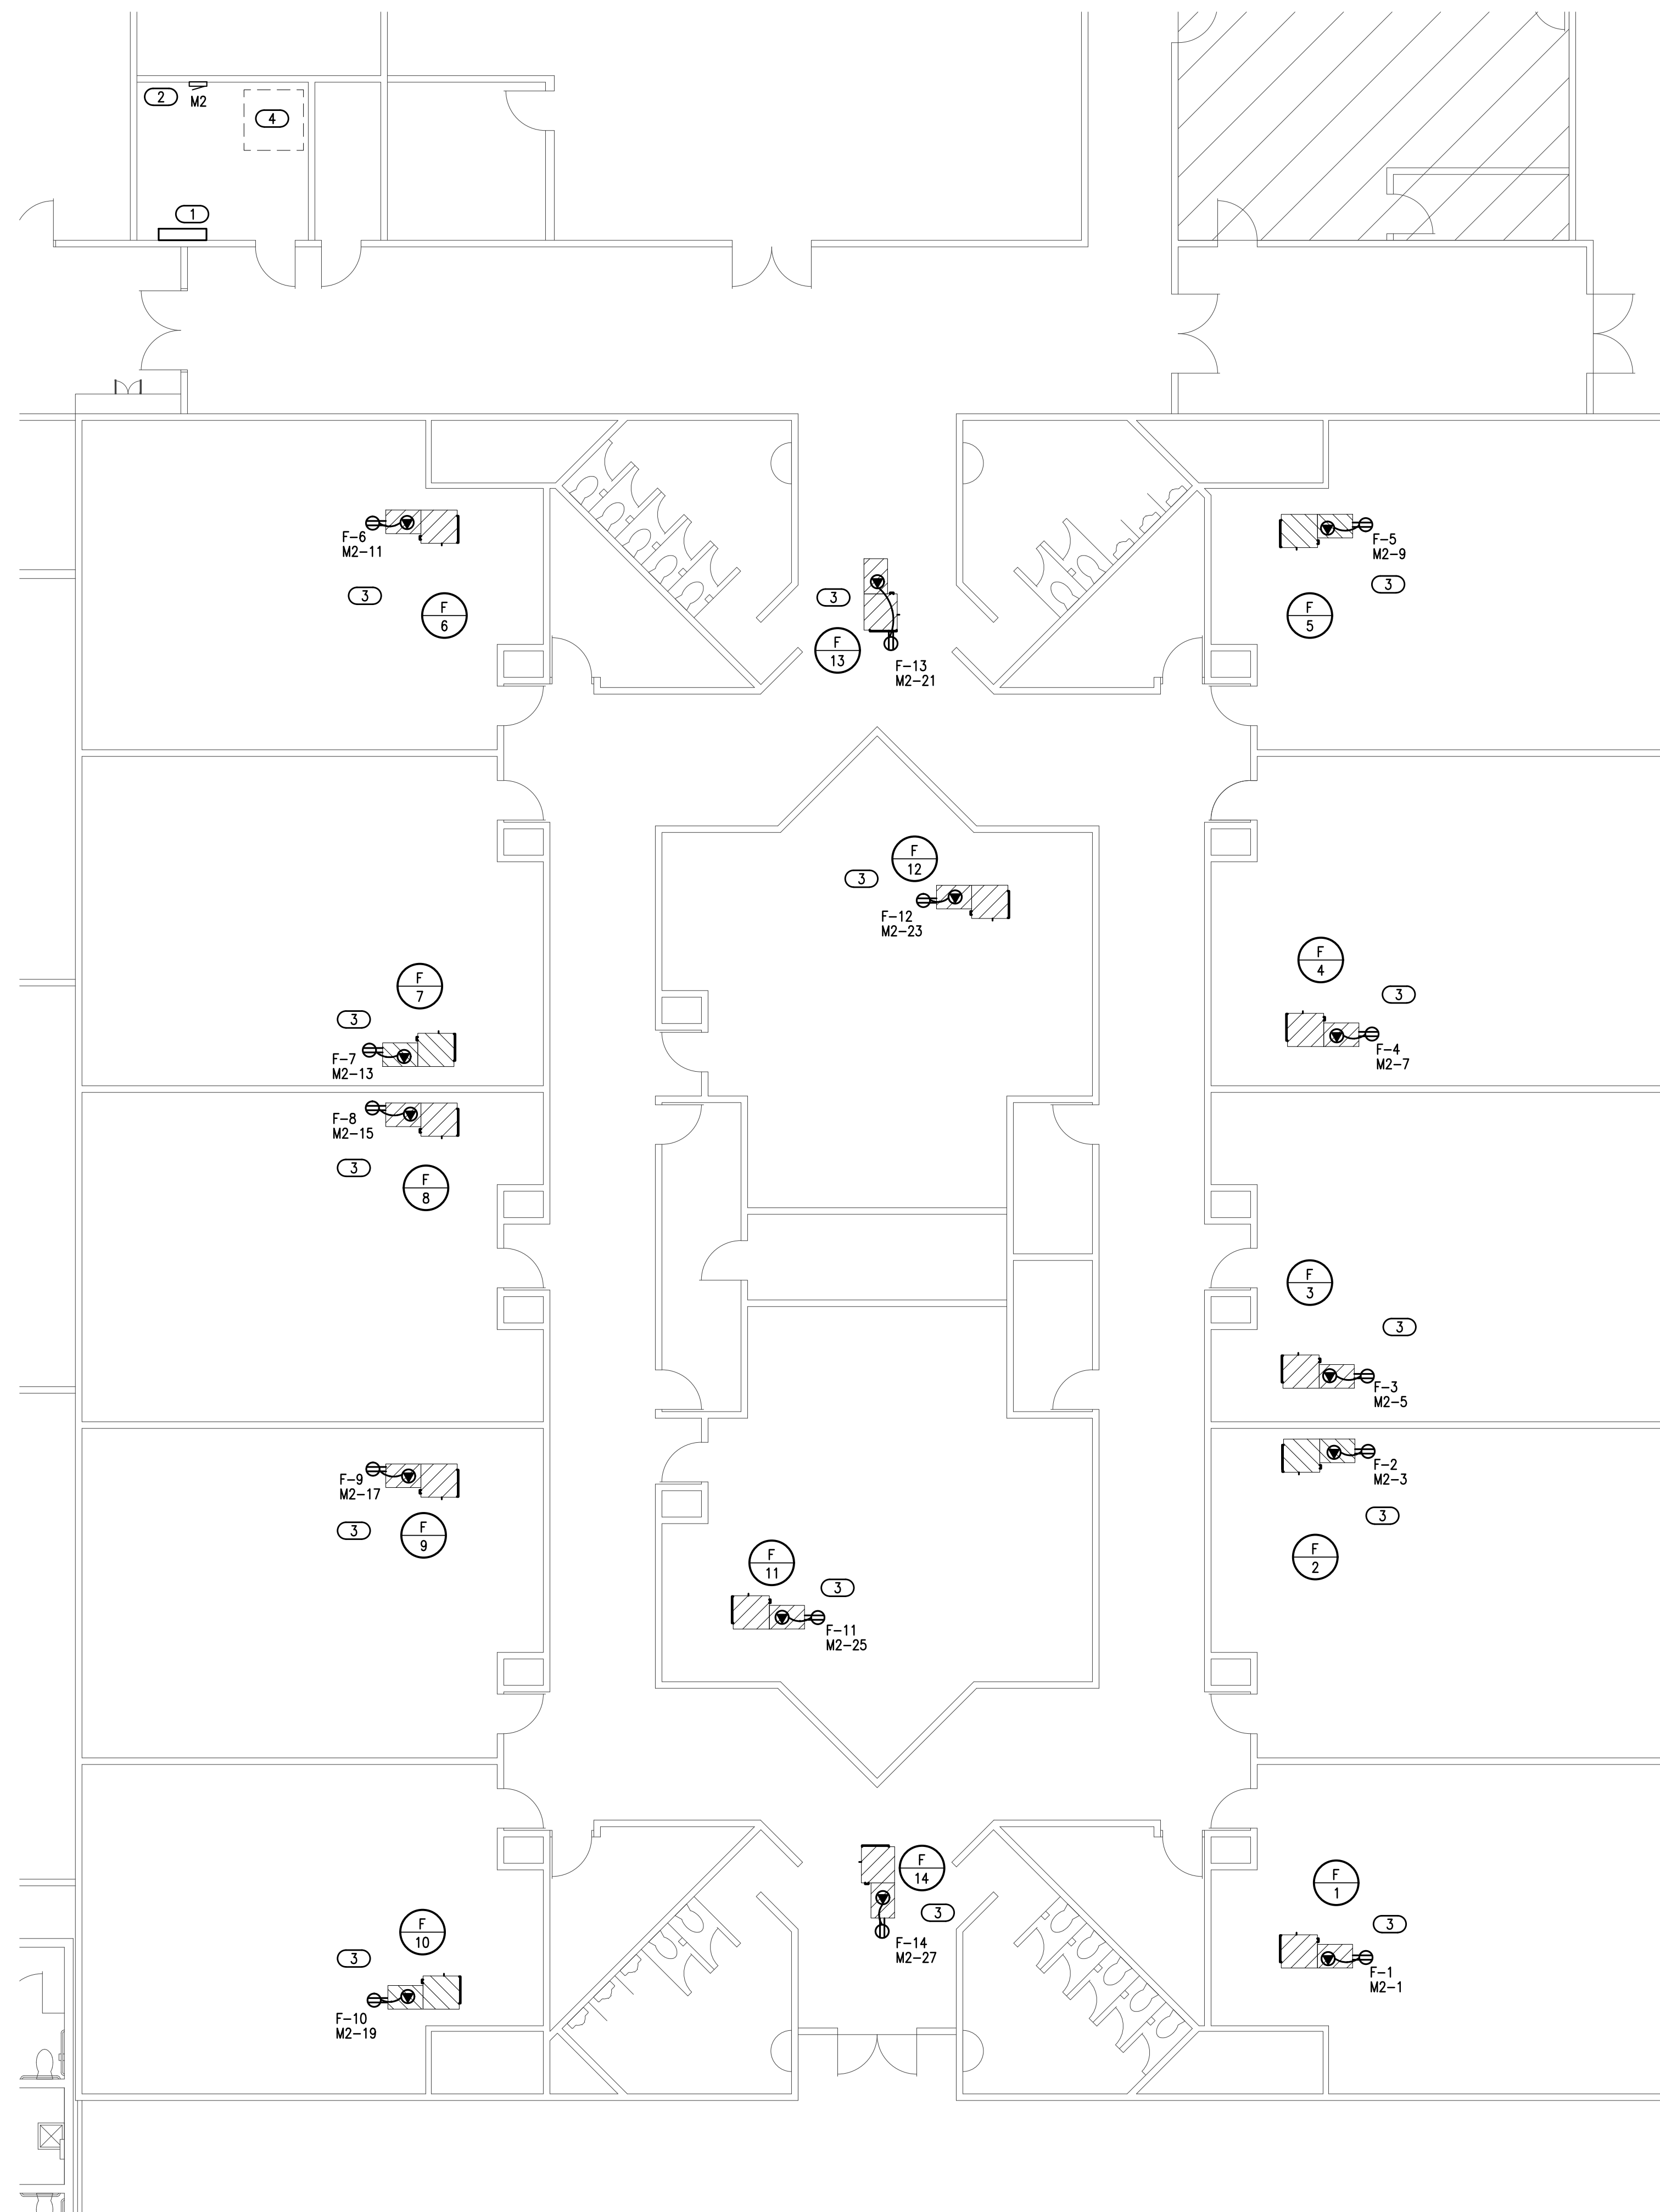

- POWER GENERAL NOTES**
- COORDINATE EXACT LOCATIONS OF DEVICES SHOWN WITH OTHER EQUIPMENT. COORDINATE EXACT LOCATION OF CEILING MOUNTED DEVICES WITH LIGHTS, HVAC EQUIPMENT, AND OTHER DEVICES.
 - COORDINATE WITH MECHANICAL CONTRACTOR AND PROVIDE ALL RELAYS, CONNECTIONS, AND ALL DEVICES NECESSARY TO INTERLOCK EXHAUST FANS, DAMPERS, ETC WITH PROPER CONTROL DEVICES.
 - COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR. REFER TO MECHANICAL PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
 - FIRE STOP ALL PENETRATIONS IN FIRE AND SMOKE RATED WALLS. REFER TO ARCHITECTURAL PLANS FOR LOCATIONS AND ADDITIONAL INFORMATION.

- KEYED NOTES**
- APPROXIMATE LOCATION OF EXISTING MAIN PANEL. EC TO FIELD VERIFY EXACT LOCATION AND CONDITION OF PANEL AND REUSE EXISTING 600A POLE BREAKER FROM DEMOLISHED CHILLER FOR NEW PANEL 'M2'.
 - NEW PANEL 'M2' TO FEED NEW MECHANICAL EQUIPMENT. REFER TO 'E-401' FOR MORE INFORMATION.
 - NEW 120V/1PH CONNECTION FOR FURNACE. EC TO COORDINATE EXACT LOCATION AND CONNECTION REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO BEGINNING WORK.
 - EC TO EXTEND ELECTRICAL CONNECTION FOR NEW LOCATION OF EXISTING WATER HEATER. COORDINATE WITH PLUMBING CONTRACTOR.

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:


E-102

1 ELECTRICAL POWER PLAN
SCALE: 1/8" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

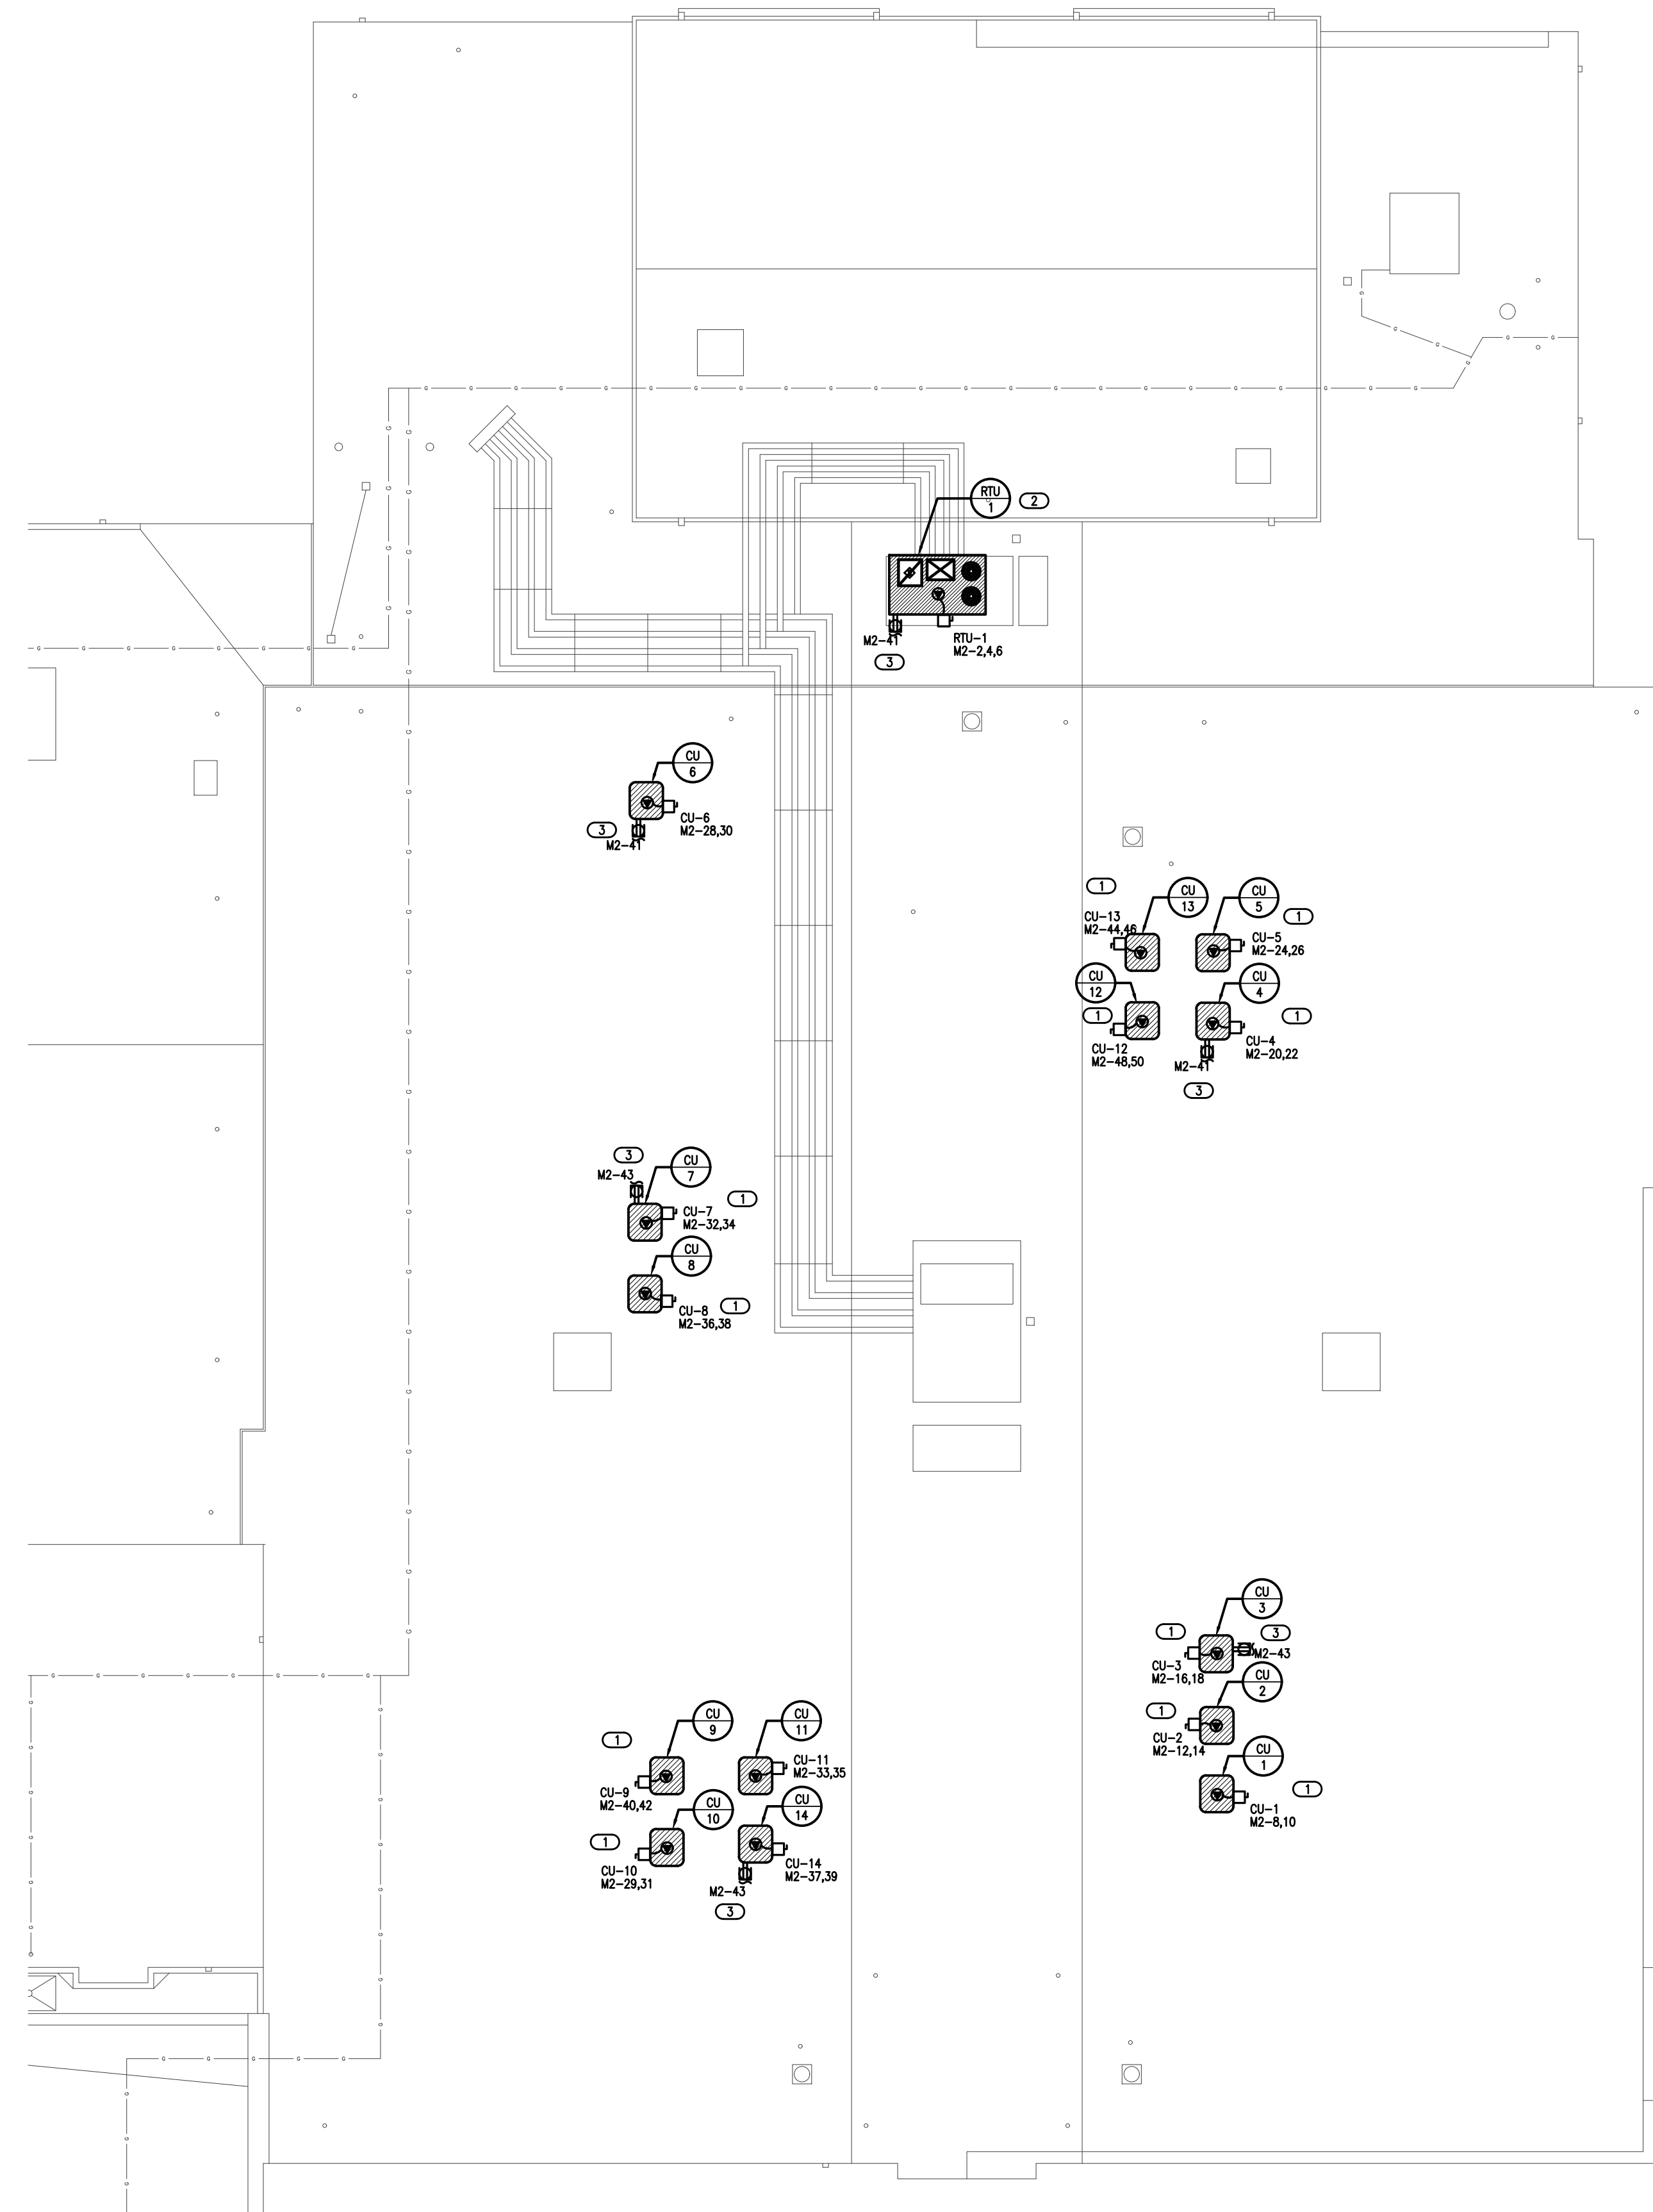

- POWER GENERAL NOTES**
- COORDINATE EXACT LOCATIONS OF DEVICES SHOWN WITH OTHER EQUIPMENT. COORDINATE EXACT LOCATION OF CEILING MOUNTED DEVICES WITH LIGHTS, HVAC EQUIPMENT, AND OTHER DEVICES.
 - COORDINATE WITH MECHANICAL CONTRACTOR AND PROVIDE ALL RELAYS, CONNECTIONS, AND ALL DEVICES NECESSARY TO INTERLOCK EXHAUST FANS, DAMPERS, ETC WITH PROPER CONTROL DEVICES.
 - COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR. REFER TO MECHANICAL PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
 - FIRE STOP ALL PENETRATIONS IN FIRE AND SMOKE RATED WALLS. REFER TO ARCHITECTURAL PLANS FOR LOCATIONS AND ADDITIONAL INFORMATION.
 - FIRMLY MOUNT WEATHERPROOF 120V CONVENIENCE OUTLET ON UNISTRUT/KINDORF. COORDINATE WITH OTHER TRADES PRIOR TO ROUGH-IN. REDUNDANT RECEPTACLES WHETHER STAND-ALONE OR INTEGRAL TO A UNIT MAY BE OMITTED SO LONG AS ALL THE REQUIREMENTS OF NEC 210.63 ARE SATISFIED.

- KEYED NOTES**
- NEW 208/1PH CONNECTION FOR CONDENSING UNITS. EC TO COORDINATE EXACT LOCATION AND CONNECTION REQUIREMENTS WITH MECHANICAL CONTRACTOR.
 - NEW 208/3PH CONNECTION FOR ROOFTOP UNITS. EC TO COORDINATE EXACT LOCATION AND CONNECTION REQUIREMENTS WITH MECHANICAL CONTRACTOR.
 - NEW 120V CONNECTION FOR WEATHERPROOF CONVENIENCE OUTLETS.



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions


MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:
E-201

1 ELECTRICAL ROOF PLAN
SCALE: 1/16" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

Panel	ROOM	ELECTRIC ROOM	VOLTS	208Y/120V 3P 4W	AIC	65,000	
M2	MOUNTING	SURFACE	BUS AMPS	400	MAIN BKR	400	
	FED FROM	MDP	NEUTRAL	100%	LUGS	STANDARD	
NOTE							
CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION	CKT #	CKT BKR	LOAD KVA	CIRCUIT DESCRIPTION
1	15/1	1.18	F-1	a	2	60/3	RTU-1
3	15/1	1.18	F-2	b	4		
5	15/1	1.18	F-3	c	6		
7	15/1	1.18	F-4	a	8	30/2	CU-1
9	15/1	1.18	F-5	b	10		
11	15/1	1.18	F-6	c	12	30/2	CU-2
13	15/1	1.18	F-7	a	14		
15	15/1	1.18	F-8	b	16	30/2	CU-3
17	15/1	1.18	F-9	c	18		
19	15/1	1.18	F-10	a	20	30/2	CU-4
21	15/1	1.18	F-13	b	22		
23	15/1	1.18	F-12	c	24	30/2	CU-5
25	15/1	1.18	F-11	a	26		
27	15/1	1.18	F-14	b	28	30/2	CU-6
29	30/2	3.54	CU-10	c	30		
31				a	32	30/2	CU-7
33	30/2	3.54	CU-11	b	34		
35				c	36	30/2	CU-8
37	15/2	2.5	CU-14	a	38		
39				b	40	30/2	CU-9
41	20/1	0.54	ROOF RECEPTACLE	c	42		
43	20/1	0.54	ROOF RECEPTACLE	a	44	15/2	CU-13
45	20/1	0	SPACE	b	46		
47	20/1	0	SPACE	c	48	30/2	CU-12
49	20/1	0	SPACE	a	50		
51	20/1	0	SPACE	b	52	20/1	SPACE
53	20/1	0	SPACE	c	54	20/1	SPACE

	CONN KVA	CALC KVA		CONN KVA	CALC KVA
LARGEST MOTOR	18.7	4.68	(25%)	MOTORS	82.6
				RECEPTACLES	1.08
				TOTAL LOAD	88.4
				BALANCED 3-PHASE LOAD	245 A
				PHASE A	105%
				PHASE B	96.7%
				PHASE C	98.2%

FEEDER SCHEDULE				
AMPS	CONDUIT SIZE 4W	CONDUIT SIZE 3W	PHASE CONDUCTORS	EQUIPMENT GROUND CONDUCTOR
20	3/4"	3/4"	#12	#12
25	3/4"	3/4"	#10	#10
30	3/4"	3/4"	#10	#10
35	1"	3/4"	#8	#10
40	1"	3/4"	#8	#10
45	1"	1"	#6	#10
50	1"	1"	#6	#10
60	1 1/4"	1 1/4"	#4	#10
70	1 1/4"	1 1/4"	#4	#8
80	1 1/4"	1 1/4"	#3	#8
90	1 1/2"	1 1/4"	#2	#8
100	1 1/2"	1 1/4"	#2	#8
110	2"	1 1/2"	#1	#6
125	2"	1 1/2"	#1	#6
150	2"	1 1/2"	#1/0	#6
175	2"	2"	#2/0	#6
200	2"	2"	#3/0	#6
225	2 1/2"	2"	#4/0	#4
250	3"	2 1/2"	250 kcmil	#4
300	3"	3"	350 kcmil	#4
350	3 1/2"	3"	500 kcmil	#3
400	(2) 2"	(2) 2"	2 SETS OF #3/0	#3
450	(2) 2 1/2"	(2) 2"	2 SETS OF #4/0	#2
500	(2) 2 1/2"	(2) 2 1/2"	2 SETS OF 250 kcmil	#2
600	(2) 3"	(2) 3"	2 SETS OF 350 kcmil	#1
700	(2) 3 1/2"	(2) 3"	2 SETS OF 500 kcmil	#1/0
800	(3) 3"	(3) 2 1/2"	3 SETS OF 300 kcmil	#1/0
900	(3) 3 1/2"	(3) 3"	3 SETS OF 400 kcmil	#2/0
1000	(3) 3 1/2"	(3) 3"	3 SETS OF 500 kcmil	#2/0
1200	(4) 3"	(4) 3"	4 SETS OF 350 kcmil	#3/0
1600	(5) 3 1/2"	(5) 3"	5 SETS OF 500 kcmil	#4/0
1800	(6) 3 1/2"	(6) 3"	6 SETS OF 400 kcmil	250 kcmil
2000	(6) 3 1/2"	(6) 3"	6 SETS OF 500 kcmil	250 kcmil
2500	(7) 3 1/2"	(7) 3"	7 SETS OF 500 kcmil	350 kcmil


NOTES:

- FEEDER SIZES ARE ON THE PLAN WHERE 60 REFERS TO A 60A FEEDER WITHOUT NEUTRAL AND 60N REFERS TO A 60A FEEDER WITH NEUTRAL.
- SOME FEEDER SIZES DO NOT MATCH BREAKER SIZE DUE TO UP-SIZING OF THE FEEDER FOR VOLTAGE DROP.
- CONDUITS ARE SIZED PER NEC TABLES FOR THHN/THWN AND MAY BE UPSIZED FOR EASE OF PULLING OR DOWNSIZED AS ALLOWED PER NEC FOR CONDUIT TYPE(S) BEING INSTALLED.
- ALL CONDUCTORS 100A AND LESS ARE SIZED PER 90 DEGREE LUGS, EC MAY SIZE CONDUCTORS FOR ACTUAL RATING OF LUGS PER NEC.

KEYED NOTES

① EC TO RE USE EXISTING 600/3 POLE BREAKER FROM DEMOLISHED CHILLER FOR NEW 400 AMP PANEL. EC FIELD VERIFY EXISTING CONDITIONS AND DETERMINE BEST ROUTE FOR NEW FEED.

② AIR HANDLING UNIT TO BE DEMOLISHED. REFER TO DEMO SHEET 'ED-201' FOR ADDITIONAL INFORMATION.

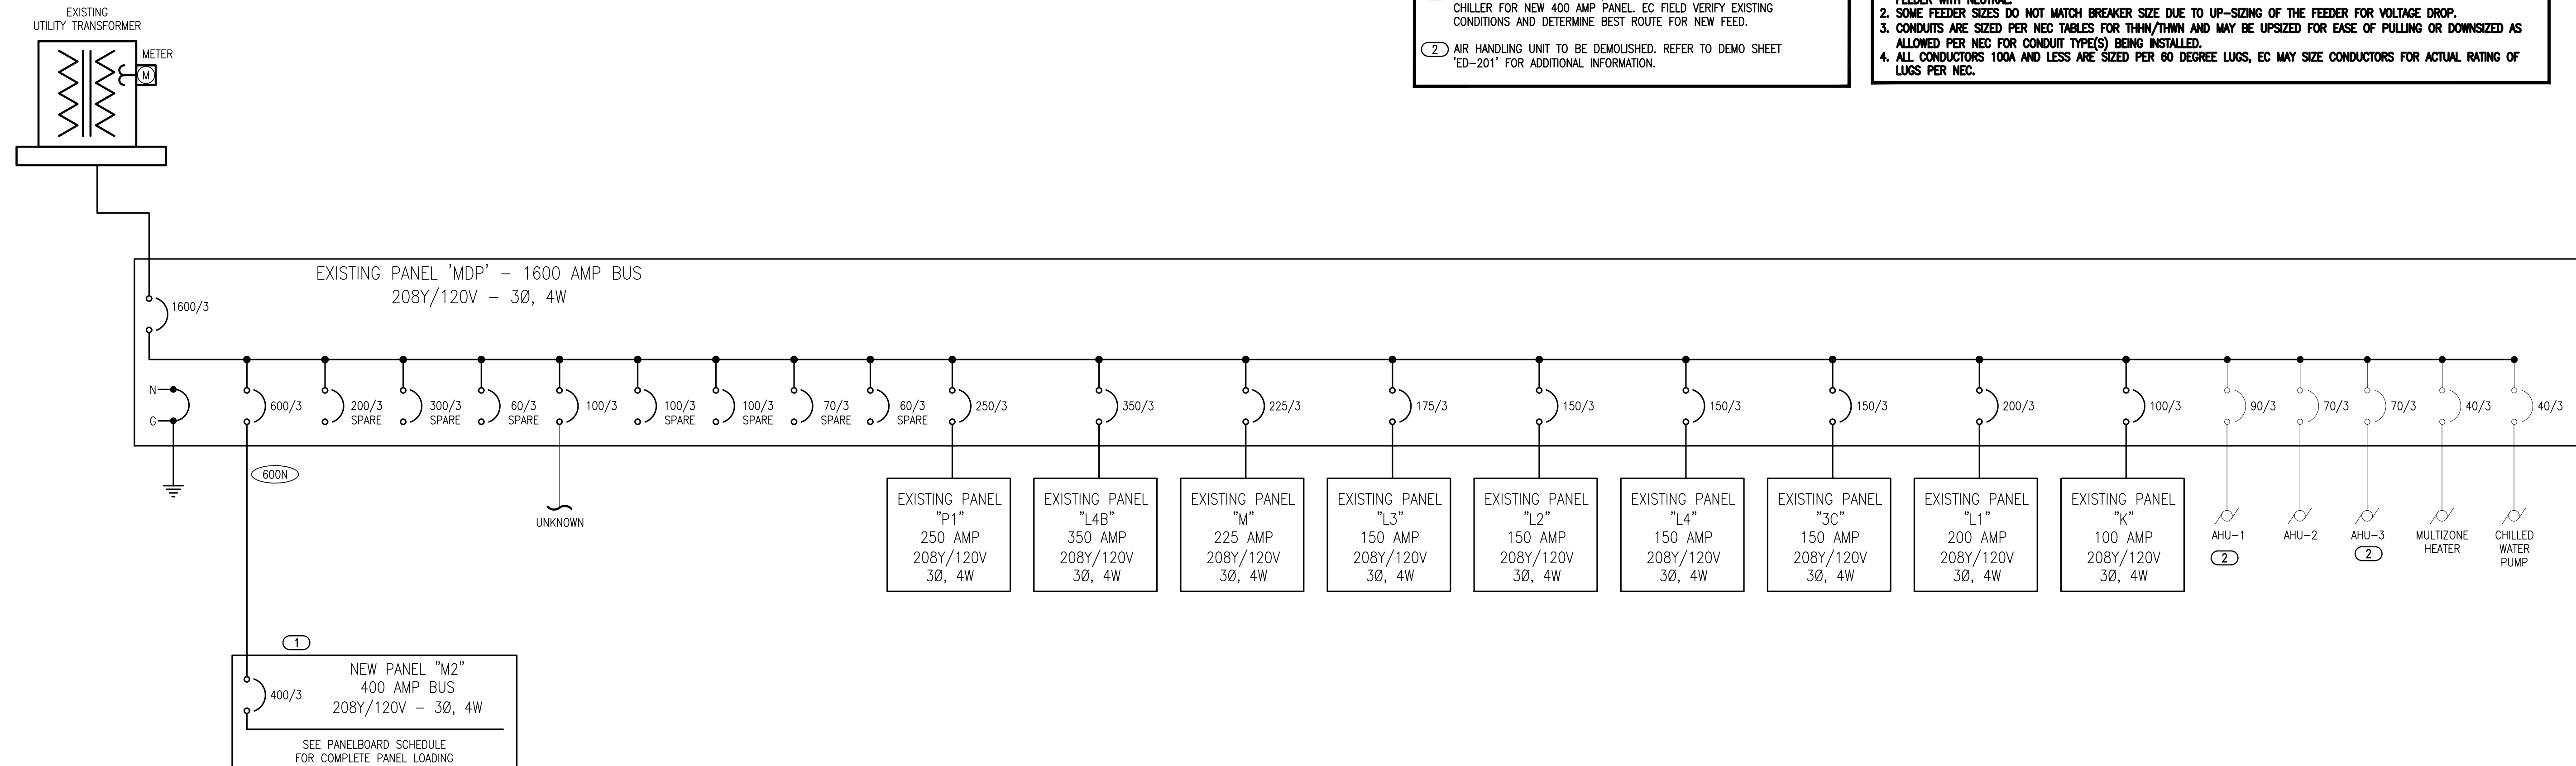

1 RISER DIAGRAM
NO SCALE



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions



sheet no:



JV
drawn by
TVO
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:


E-501

Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00


OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

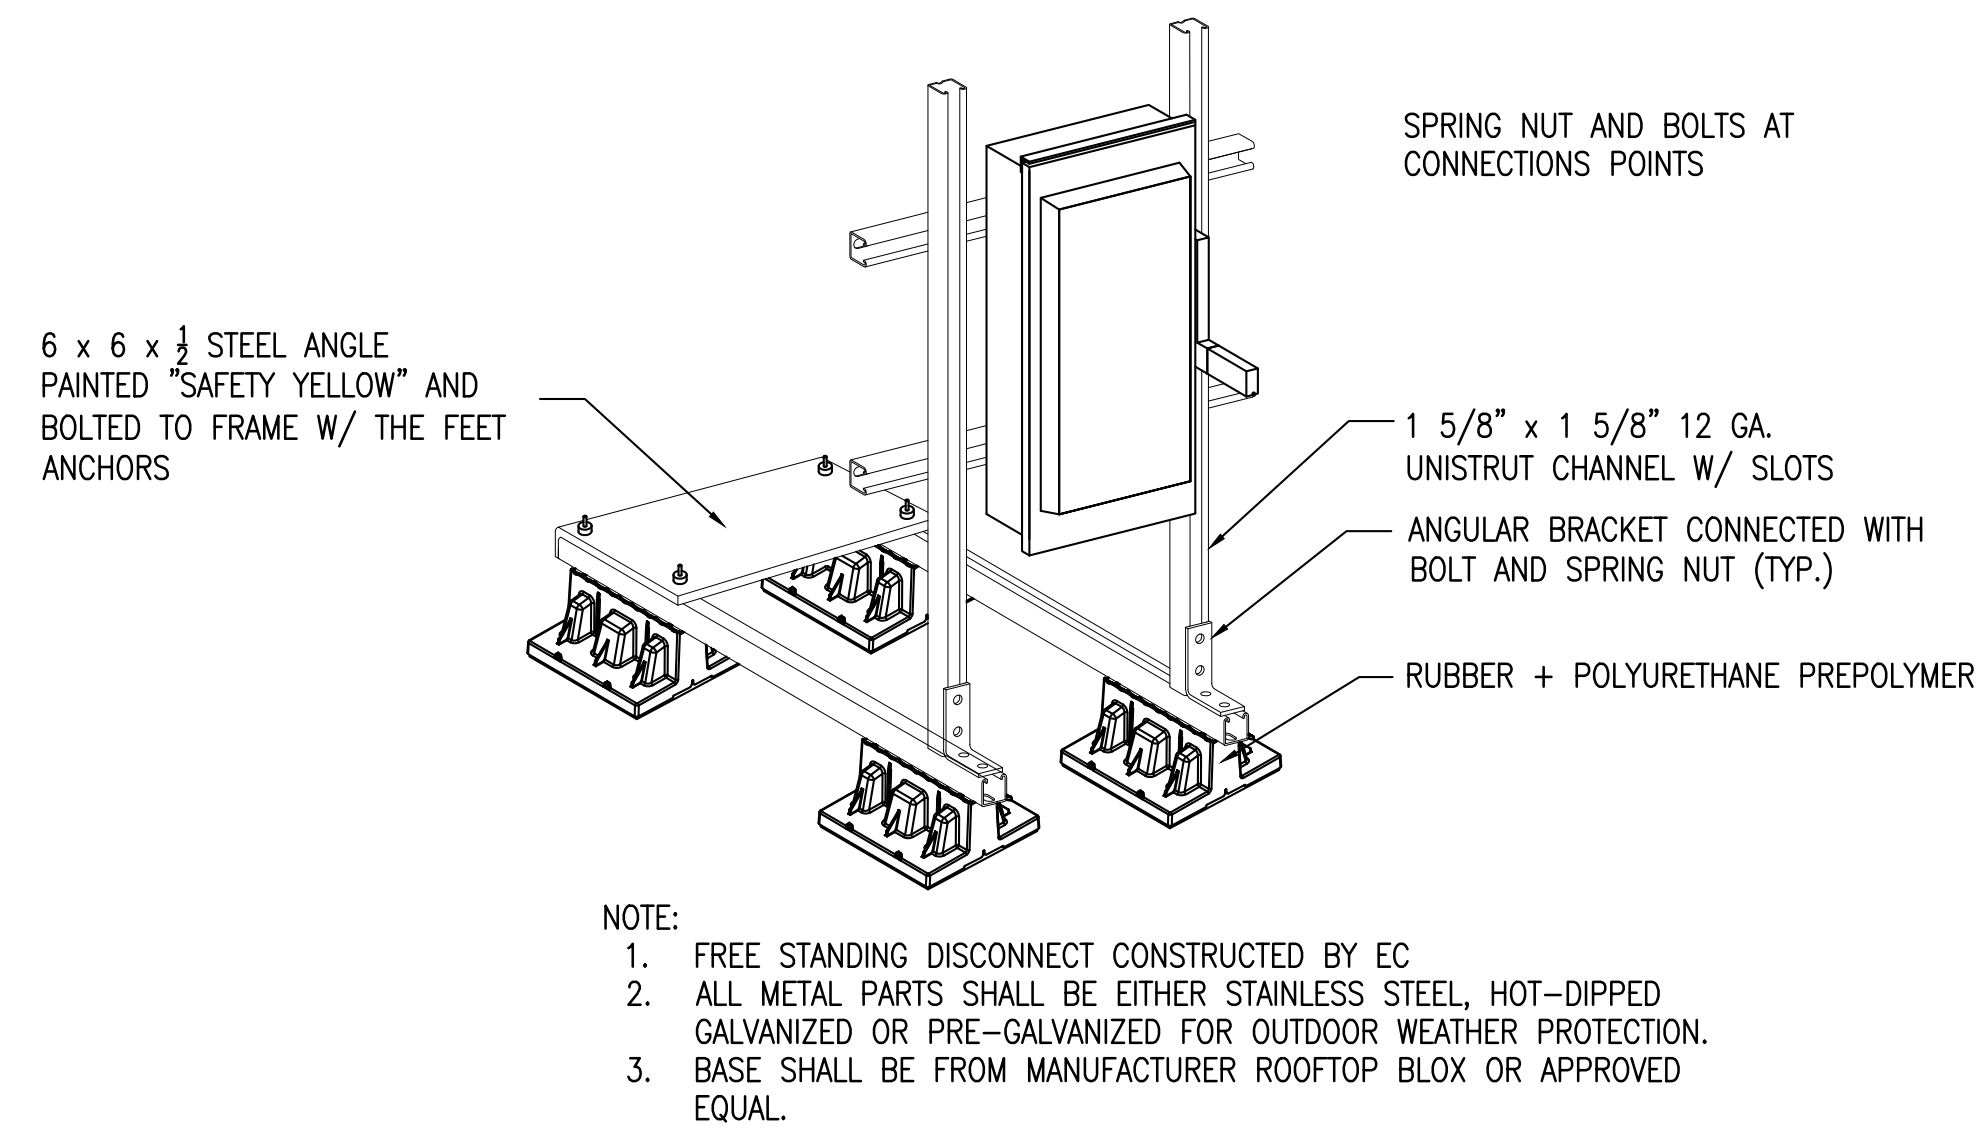


1 DISCONNECT ROOF MOUNTING DETAIL
NO SCALE

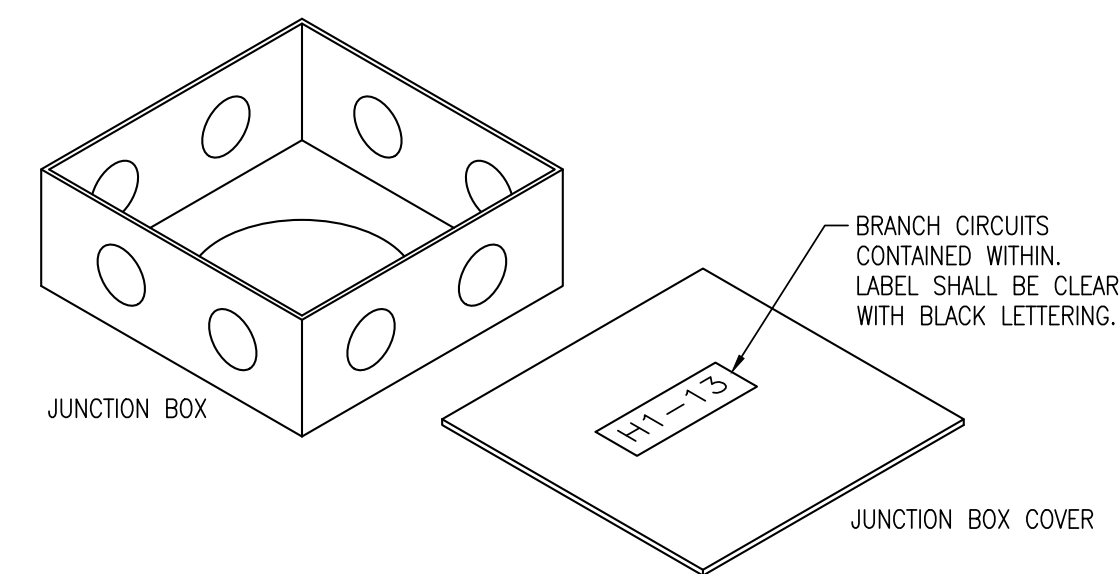


2 JUNCTION BOX LABELING DETAIL
NO SCALE

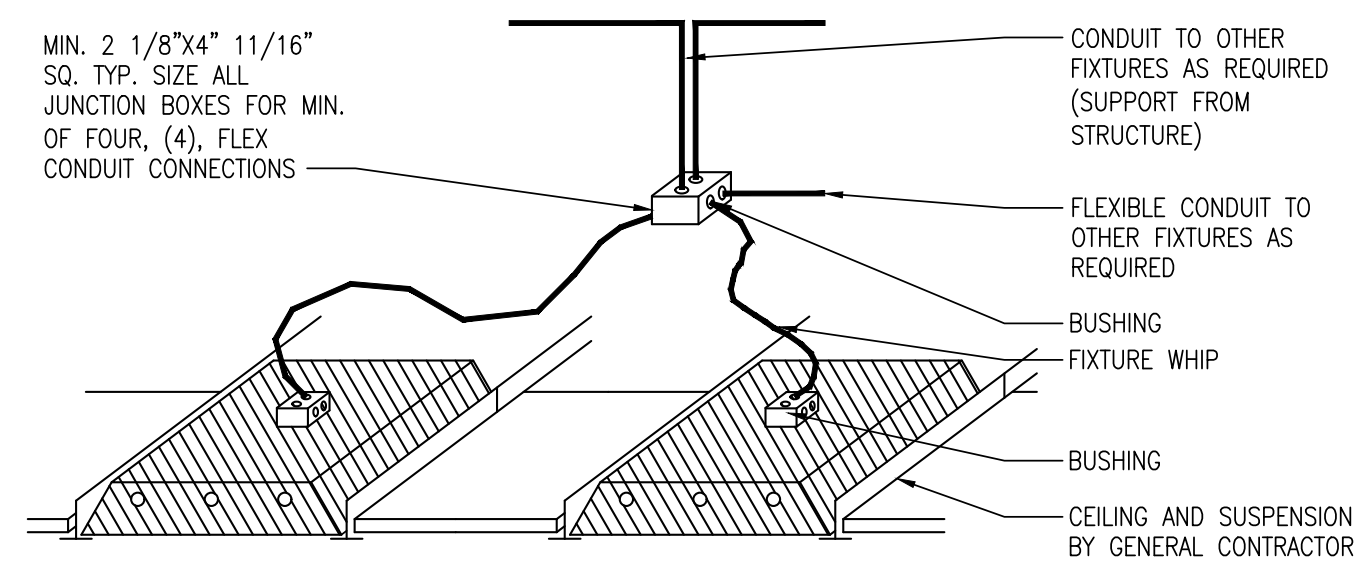

4 TYP. TROFFER POWER DETAIL
NO SCALE

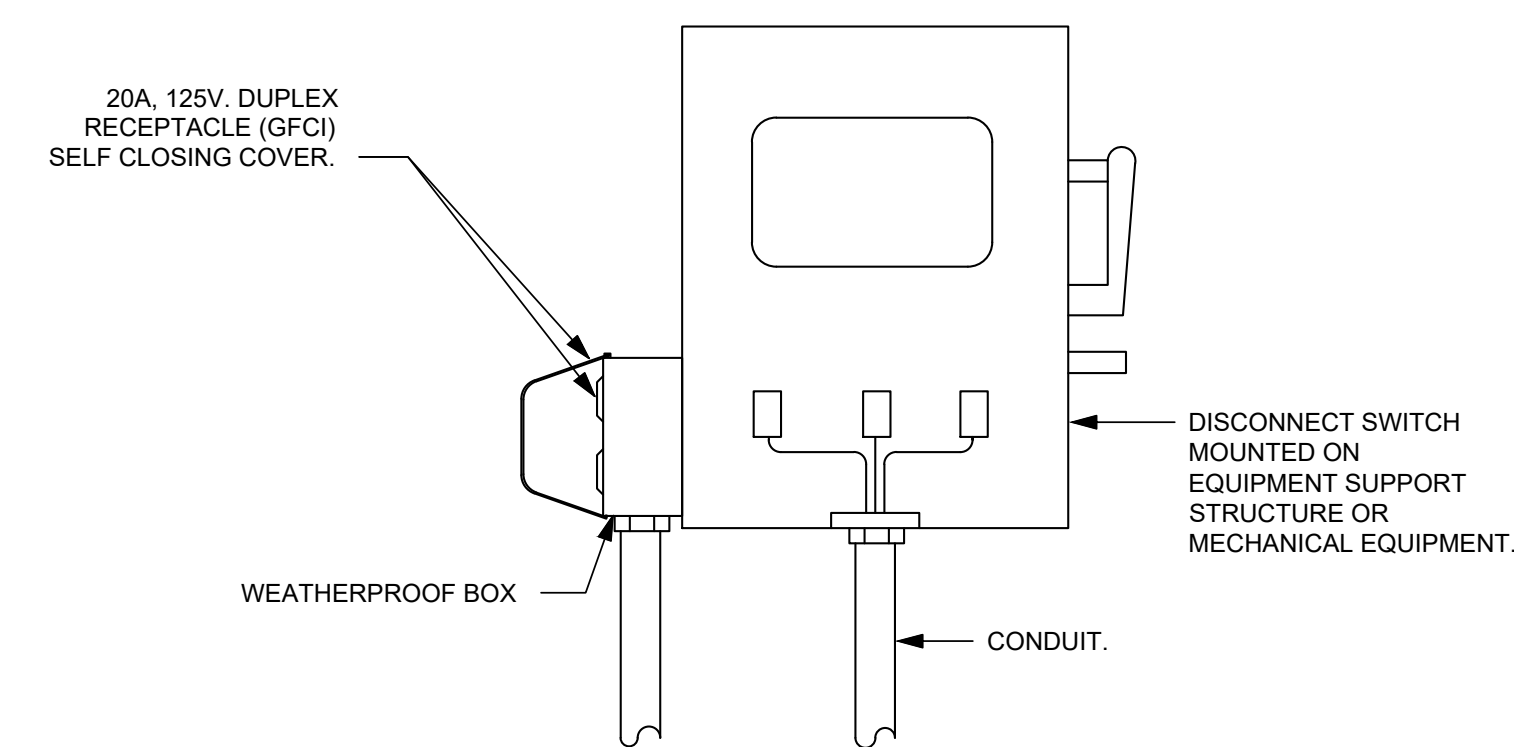

3 TYP. ROOF MOUNTED RECEPTACLE DETAIL
NO SCALE

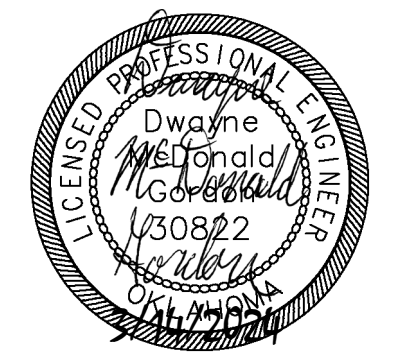

GENERAL MECHANICAL NOTES

- ALL WORK SHALL BE IN COMPLIANCE WITH STATE AND LOCAL CODES.
- THE CONTRACTOR SHALL PAY FOR ALL FEES, PERMITS, LICENSES, ETC., NECESSARY FOR PROPER COMPLETION OF THE WORK.
- INSTALL ALL EQUIPMENT IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
- VERIFY ALL EXISTING CONDITIONS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN CONTRACT DRAWINGS AND ACTUAL CONDITIONS.
- EXISTING UTILITIES TO BE ABANDONED SHALL BE PROPERLY DISCONNECTED AND CAPPED AS REQUIRED BY CODE OR LOCAL ORDINANCE.
- THESE DRAWINGS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED. ADDITIONAL DATA SHALL BE FROM THE ENGINEER THROUGH WRITTEN CLARIFICATION ONLY. VERIFY ALL EXISTING CONDITIONS, ELEVATIONS, AND DIMENSIONS BEFORE PROCEEDING WITH ANY PORTION OF ANY WORK. THE CONTRACTOR SHALL PROVIDE ALL OFFSETS AND TRANSITIONS REQUIRED TO MEET EXISTING CONDITIONS.
- THE CONTRACTOR SHALL PERFORM WORK IN A SKILLED AND PROFESSIONAL MANNER.
- ALL CONTRACTORS ARE RESPONSIBLE TO FIELD COORDINATE WORK SCHEDULE WITH OWNER REPRESENTATIVE.
- THE CONTRACTOR SHALL WORK AND COORDINATE WITH THE OTHER TRADES.
- ALL EQUIPMENT SHALL BE NEW AND IN UNDAMAGED CONDITION. ANY EQUIPMENT FOUND DEFECTIVE SHALL BE IMMEDIATELY REMOVED FROM THE PROJECT.
- PROVIDE 3 COPIES OF AN OPERATION AND MAINTENANCE MANUAL FOR ALL MAJOR EQUIPMENT REQUIRING SERVICE. MAJOR EQUIPMENT INCLUDES BUT IS NOT LIMITED TO COILS, FANS, AND CONTROL WIRING DIAGRAMS. EACH PIECE OF EQUIPMENT SHALL STATE THE CONTRACT DATE AND THE NAME, ADDRESS AND PHONE NUMBER FOR THE PRIME CONTRACTOR, SUBCONTRACTOR PERFORMING THE INSTALLATION, AND THE LOCAL VENDOR FOR SPARE PARTS. THE MANUALS SHALL CONTAIN MAINTENANCE INSTRUCTIONS REQUIRED FOR THE INSTALLED EQUIPMENT. MANUALS SHALL BE BOUND IN A THREE RING HARD COVER BINDER, O & M MANUALS SHALL BE SUBMITTED TO THE OWNER PRIOR TO FINAL WALK THROUGH OF THE PROJECT.
- PROVIDE 8 HOURS OF OWNER TRAINING FOR THE INSTALLED EQUIPMENT. TRAINING SHALL BE HELD ONLY AFTER ALL OF THE EQUIPMENT IS INSTALLED AND PROPER OPERATION IS VERIFIED.
- CONTRACTOR SHALL SUBMIT A CERTIFIED REPORT INDICATING SYSTEM PERFORMANCE INCLUDING, BUT NOT LIMITED TO, VOLTAGE AND AMPERAGE MEASUREMENTS OF ALL EQUIPMENT GREATER THAN 1/3 H.P. AIR BALANCE MEASUREMENTS OF OUTSIDE AIR DELIVERY, AIR HANDLING UNIT SUPPLY, SUPPLY DIFFUSERS, EXHAUST AND RETURN GRILLES. AIR BALANCE SHALL BE WITHIN 10% OF DESIGN CONDITIONS. THE REPORT CERTIFICATION SHALL BE AS FOLLOWS:

I (name) of (company) CERTIFY THAT ALL MEASUREMENTS, FIGURES AND STATEMENTS INDICATED IN THIS REPORT WERE TAKEN BY ME OR UNDER MY SUPERVISION AND ARE ACCURATE AS OF (date). DESIGN FLOWS WERE BASED UPON PLANS DATED (xx/xx/xx).
- DUCT MATERIAL SHALL BE GALVANIZED OR ALUMINUM CONSTRUCTION IN ACCORDANCE WITH SMACNA DUCT CONSTRUCTION STANDARD 2005 FOR THE PRESSURE AND SEAL CLASS LISTED IN DUCTWORK/INSULATION SCHEDULE.
- DUCT SIZES LISTED ON PLANS ARE THE REQUIRED CLEAR INTERIOR DIMENSIONS.
- SUPPLY AND RETURN BRANCH DUCTS MAY BE INSULATED FLEX DUCT IF THE RUN IS LESS THAN 5 FEET IN LENGTH. ANY LENGTHS OVER 5 FEET SHALL BE RIGID DUCTWORK. DUCT SHALL BE THE SAME SIZE AS THE LISTED DIFFUSER THROAT UNLESS NOTED OTHERWISE.
- PROVIDE VOLUME CONTROL DAMPERS WHERE INDICATED AND AT ALL TAKEOFFS, BOTH SUPPLY AND RETURN SYSTEMS, AND MAJOR DUCT RUNS. DAMPERS SHALL BE FACTORY-FABRICATED WITH ZINC-PLATED, DIE-CAST CONTROL HARDWARE. CONTROL HARDWARE SHALL INCLUDE HEAVY GAUGE DIAL AND HANDLE WITH ELEVATED PLATFORM FOR INSULATED DUCT MOUNTING.
- PROVIDE TURNING VANES IN ALL RECTANGULAR ELBOWS CONFORMING TO SMACNA DUCT CONSTRUCTION STANDARD 2005 FIG. 4-2, TYPE RE-3 WITH STANDARD RADIUS. WHERE SPACE PERMITS, PROVIDE RADIUS ELBOWS IN ACCORDANCE WITH FIGURES 4-2, TYPE RE-1.
- ALL RECTANGULAR MAIN TO RECTANGULAR BRANCH CONNECTIONS, BOTH CONVERGING AND DIVERGING CONFIGURATIONS, SHALL HAVE A 45 DEG. ENTRY TAP CONSTRUCTED IN ACCORDANCE WITH SMACNA DUCT CONSTRUCTION STANDARD 2005 FIG. 4-6.
- DIFUSER PATTERN 4-WAY UNLESS OTHERWISE INDICATED. PROVIDE FIBERGLASS DUCT INSULATION WITH VAPOR BARRIER AS SCHEDULED UNLESS NOTED OTHERWISE.
- MECHANICAL CONTRACTOR TO REPAIR ANY DAMAGE DONE TO THE FIRE PROOFING WHILE INSTALLING THE MECHANICAL TRADES. SEAL ALL PENETRATIONS THROUGH RATED STRUCTURES WITH UL LISTED FIRE SEAL DESIGNED FOR THE SPECIFIED APPLICATION.
- THE CONTRACTOR SHALL TAKE ALL PRECAUTIONARY MEASURES TO PROTECT THE PUBLIC AND ADJACENT PROPERTIES FROM DAMAGE THROUGHOUT CONSTRUCTION.
- THE CONTRACTOR SHALL GUARANTEE ALL WORKMANSHIP AND MATERIALS FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION OR AS OTHERWISE REQUIRED IN THE SPECIFICATIONS.
- MECHANICAL CONTRACTOR TO INCLUDE THE TEST AND BALANCE, AND ANY PERMIT FEES IN THEIR BID.
- MECHANICAL CONTRACTOR SHALL VERIFY ALL ROOFTOP EQUIPMENT WEIGHTS, SIZES, LOCATIONS AND OPENINGS REQUIRED AND SHALL COORDINATE ANY CHANGES WITH THE ARCHITECT.
- UPON PROJECT COMPLETION, RECORD (AS-BUILT) DRAWINGS SHALL BE PROVIDED BY THE CONTRACTOR TO THE BUILDING OWNER. ALL CHANGES MADE TO EQUIPMENT, DUCTWORK, AND GENERAL DESIGN SHALL BE NOTED ON THE DRAWINGS. PROVIDE IN PDF FORMAT OR PRINTED SET AT THE OWNER'S REQUEST.

ABBREVIATIONS

A	AMP	IN	INCH
ADD	ADDENDUM	LAT	LEAVING AIR TEMPERATURE
ADJ	ADJUSTABLE	LB	POUND
AFF	ABOVE FINISH FLOOR	LWT	LEAVING WATER TEMPERATURE
AHU	AIR HANDLER UNIT	MAX	MAXIMUM
AI	ANALOG INPUT	MBH	1000 BTU PER HOUR
ALT	ALTERNATE	MC	MECHANICAL CONTRACTOR
AO	ANALOG OUTPUT	MCA	MINIMUM CIRCUIT AMPS
APPRX	APPROXIMATE	MECH	MECHANICAL
ARCH	ARCHITECT, ARCHITECTURAL	MIN	MINIMUM
BDD	BACK DRAFT DAMPER	MFR	MANUFACTURER
BLDG	BUILDING	NTS	NOT TO SCALE
BTUH	BRITISH THERMAL UNIT PER HOUR	OA	OUTSIDE AIR
C	CENTER	OC	ON CENTER
CD	CEILING DIFFUSER	P	PUMP
CFM	CUBIC FEET PER MINUTE	PC	PLUMBING CONTRACTOR
CO	CLEAN OUT	PLBG	PLUMBING
COND	CONDENSATE	PSI	POUNDS PER SQUARE INCH
CONT	CONTINUOUS	QTY	QUANTITY
COP	COEFFICIENT OF PERFORMANCE	RA	RETURN AIR
DB	DRY BULB	REQD	REQUIRED
DET	DETAIL	REV	REVERSE OR REVISION
DG	DOOR GRILLE	RG	RETURN AIR GRILLE
DI	DIGITAL INPUT	RPM	REVOLUTIONS PER MINUTE
DIA OR Ø	DIAMETER	RTU	ROOF TOP UNIT
DIM	DIMENSION	SA	SUPPLY AIR
DN	DOWN	SQFT	SQUARE FEET
DO	DIGITAL OUTPUT	SG	SUPPLY GRILLE
DWG	DRAWING	SP	STATIC PRESSURE
EA	EXHAUST AIR	SPEC	SPECIFICATIONS
EAT	ENTERING AIR TEMPERATURE	SS	STAINLESS STEEL
EC	ELECTRICAL CONTRACTOR	T&B	TEST AND BALANCE
EER	ENERGY EFFICIENCY RATIO	TEMP	TEMPERATURE OR TEMPORARY
EF	EXHAUST FAN	TC	TRANSFER GRILLE
EG	EXHAUST GRILLE	TYP	TYPICAL
ELEC	ELECTRICAL	V	VOLT
ERV	ENERGY RECOVERY VENTILATOR	VAR	VARIABLE OR VARIES
ESP	EXTERNAL STATIC PRESSURE	VEL	VELOCITY
EWT	ENTERING WATER TEMPERATURE	VFD	VARIABLE FREQUENCY DRIVE
EXIST	EXISTING	VTR	VENT THRU ROOF
FA	FRESH AIR	W/	WITH
FPM	FEET PER MINUTE	W/IN	WITHIN
FT	FOOT (FEET)	W/O	WITHOUT
GA	GAUGE/GAGE	WG	WET BULB
GALV	GALVANIZED	WC	WATER COLUMN (INCHES OF)
GC	GENERAL CONTRACTOR	WT	WEIGHT
GPM	GALLONS PER MINUTE		
GYP	GYPSONUM		
HORIZ	HORIZONTAL		
HP	HORSEPOWER		
HT	HEIGHT		
I/O	INPUT/OUTPUT		

MECHANICAL HVAC LEGEND

EXHAUST AIR DUCT (DOWN)		EXHAUST AIR DUCT (UP)	
RETURN AIR DUCT (DOWN)		RETURN AIR DUCT (UP)	
OUTSIDE OR SUPPLY AIR DUCT (DOWN)		OUTSIDE OR SUPPLY AIR DUCT (UP)	
DUCT SIZE		NEW DUCTWORK	
FLEX DUCT		EXISTING DUCTWORK	
DEMOLITION LINETYPE		SUPPLY AIR CEILING DIFFUSER	
RETURN AIR GRILLE		EXHAUST AIR GRILLE	
DIFFUSER, GRILLE, AND REGISTER CALL-OUTS		SCHEDULED EQUIPMENT TAG	
MANUAL BALANCING DAMPER		PIPE PENETRATION THROUGH FIRE RATED WALL	
FIRE DAMPER		SMOKE DAMPER	
MOTORIZED DAMPER		FIRE/SMOKE DAMPER	
THERMOSTAT		HUMIDISTAT	
REMOTE SENSOR		CARBON DIOXIDE SENSOR	
DUCT SMOKE DETECTOR			

MECHANICAL SHEET INDEX

M000	MECHANICAL LEGEND AND NOTES
MD101	MECHANICAL DEMOLITION FLOORPLAN
MD102	MECHANICAL DEMOLITION ROOF PLAN
M101	MECHANICAL OVERALL PLAN
M102	MECHANICAL DUCTWORK PLAN - CLASSROOMS
M103	MECHANICAL DUCTWORK PLAN - MEDIA CENTER
M104	MECHANICAL ROOF PLAN
M501	MECHANICAL DETAILS
M502	MECHANICAL DETAILS
M601	MECHANICAL SCHEDULES

KF
drawn by
DWG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:
M000




2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

GENERAL NOTES	
1.	COORDINATE DEMOLITION OF EQUIPMENT WITH ALL TRADES, CONSTRUCTION MANAGER, AND ARCHITECT.
2.	CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS PRIOR TO PERFORMING WORK. LOCATIONS OF EXISTING EQUIPMENT ARE DIAGRAMMATICAL IN NATURE.
3.	CONTRACTOR SHALL REPAIR AND/OR REPLACE ANY UNINTENDED DAMAGES TO SURROUNDING AREAS DUE TO DEMOLITION.
4.	OWNER SHALL HAVE FIRST SALVAGE RIGHTS OF DEMOLISHED EQUIPMENT. DISPOSE OF EQUIPMENT ACCORDING TO CODE. RECYCLE ALL RECYCLABLE MATERIALS.

KEYED NOTES	
①	REMOVE CHILLER AND ASSOCIATED HYDRONIC PIPING.
②	REMOVE ALL FAN COIL UNITS, SUPPLY, RETURN, AND OUTSIDE AIR DUCTWORK, AND AIR DEVICES IN AREA SHOWN. EXHAUST SYSTEMS AND UNIT HEATERS ARE EXISTING TO REMAIN.
③	REMOVE BOILER AND GAS PIPING. COORDINATE WITH PLUMBING CONTRACTOR.
④	DEMOLISH BOILER VENT THRU WALL. CAP AND INSULATE WALL PENETRATION WEATHER TIGHT. COORDINATE WITH GENERAL CONTRACTOR.
⑤	DUCTWORK IN MEDIA CENTER IS EXISTING TO REMAIN. CLEAN DIFFUSERS AND GRILLES.

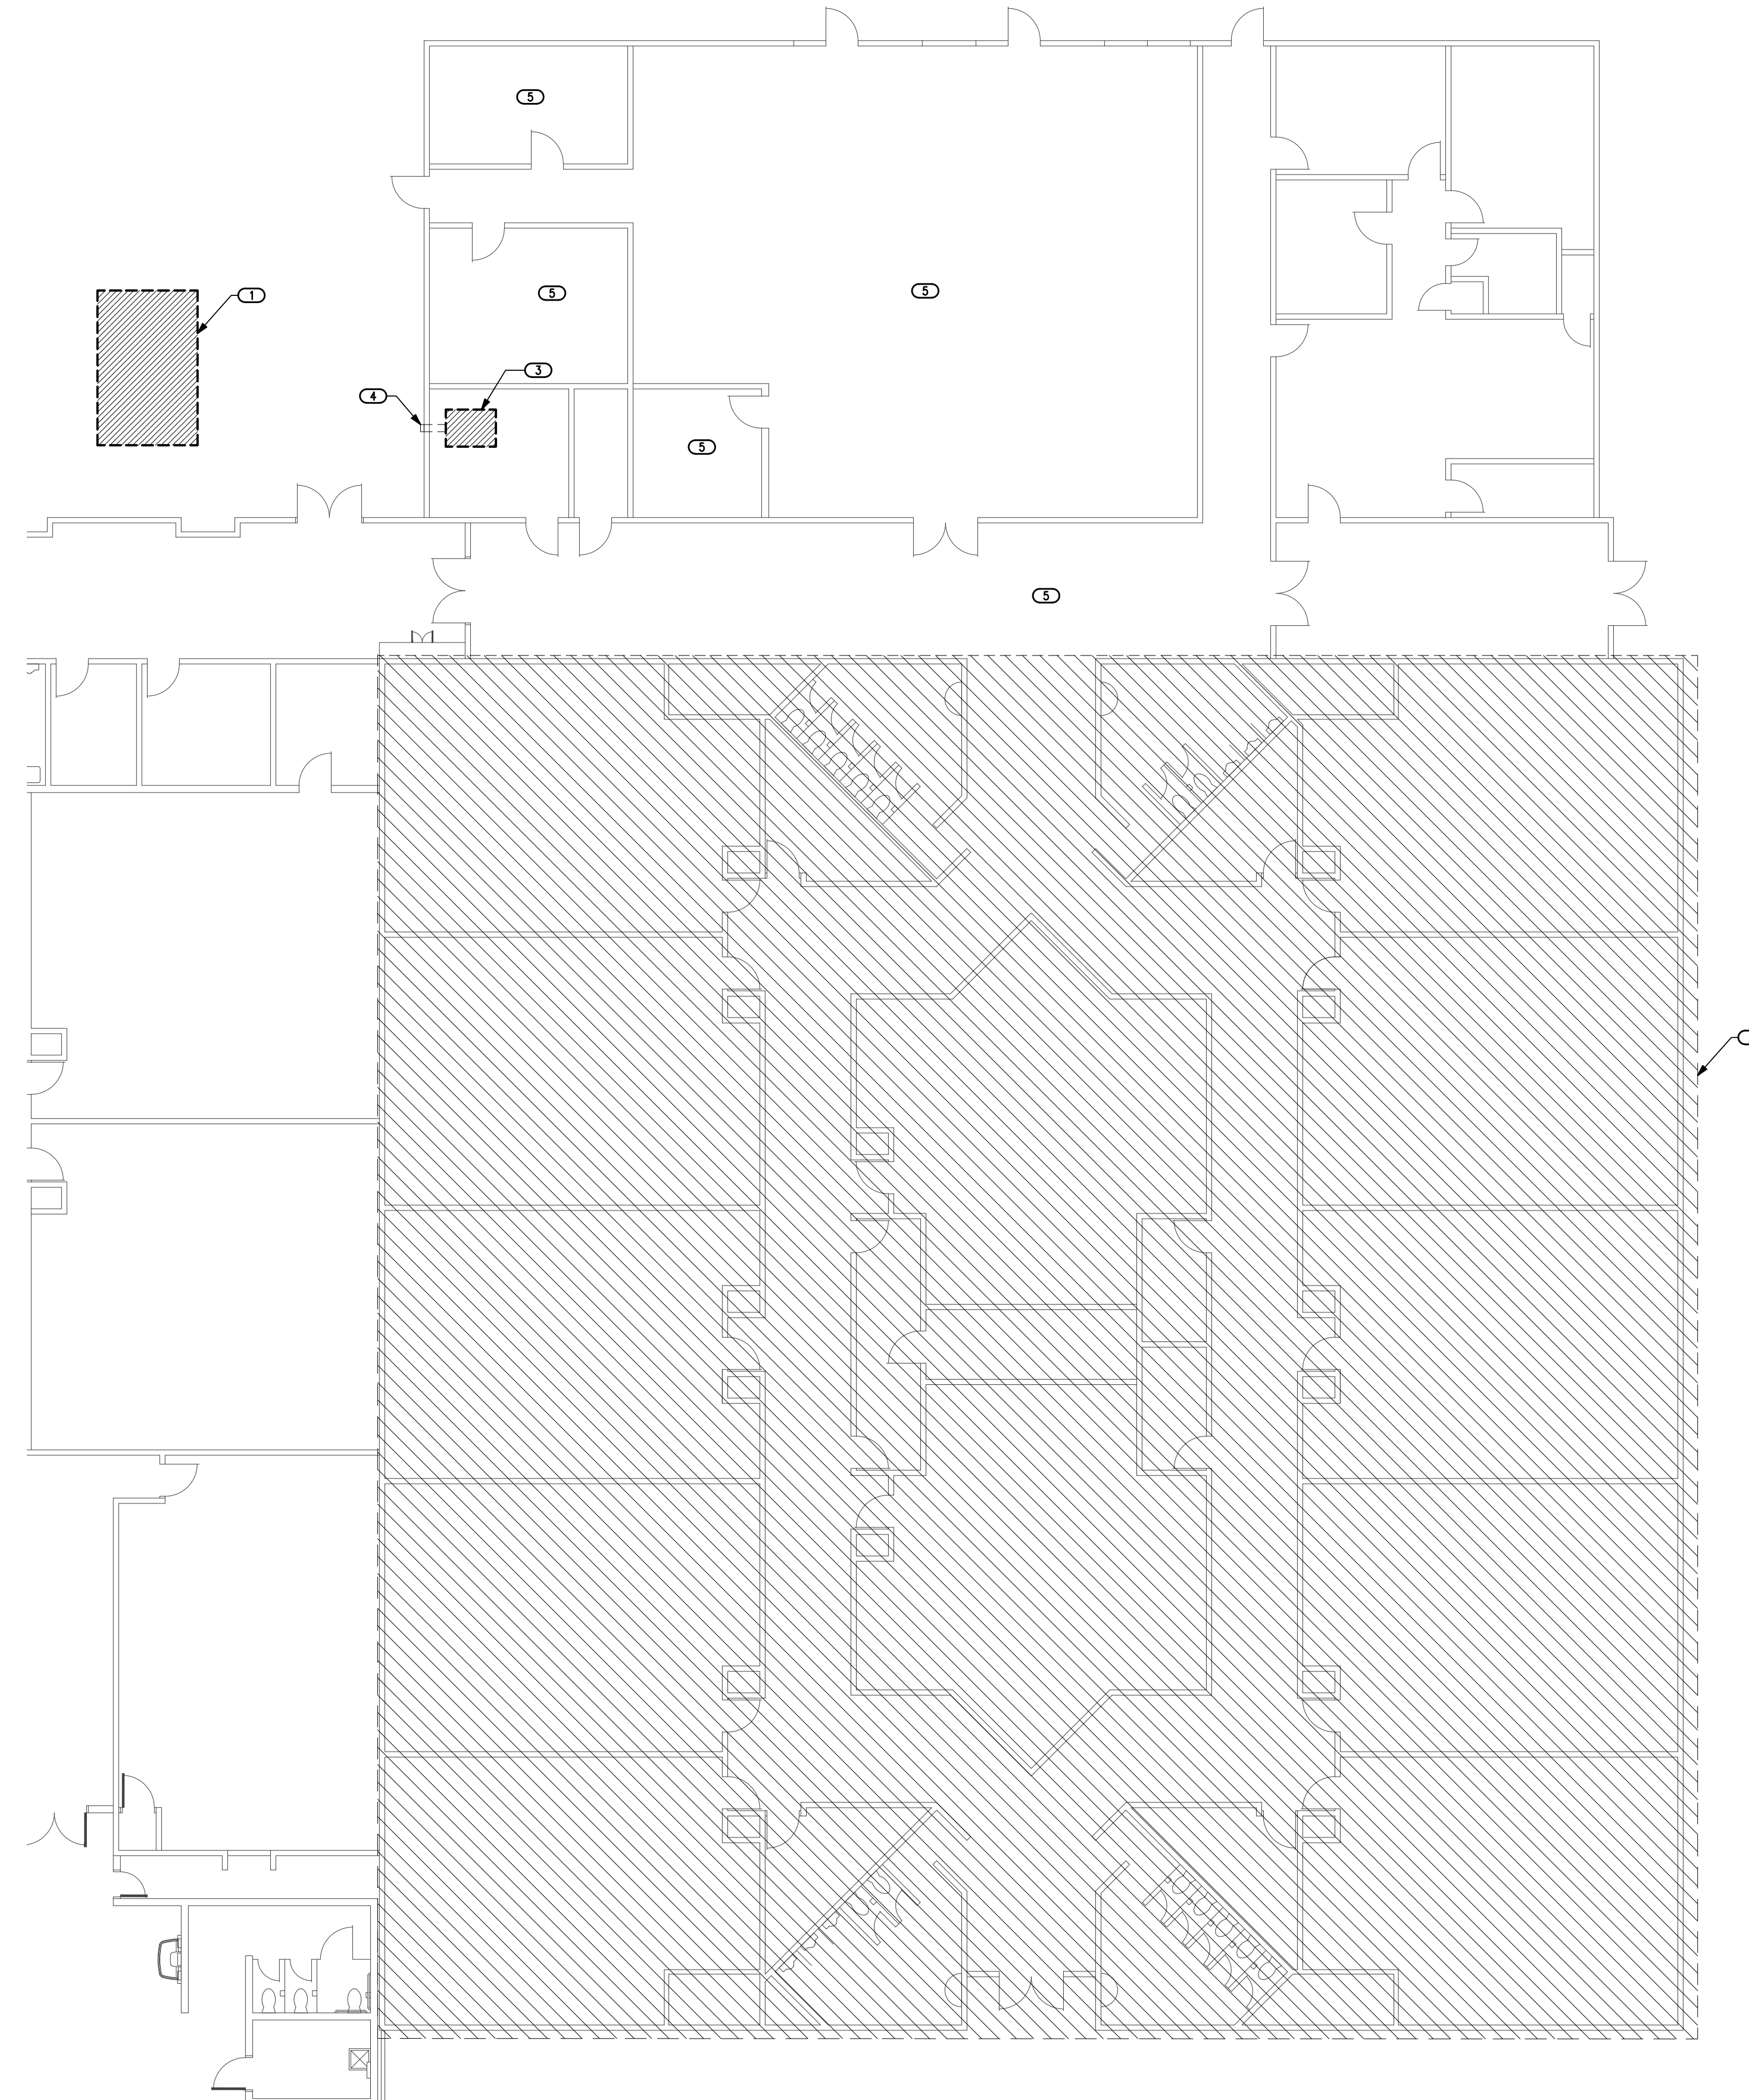

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL


sheet no:
MD101

1 MECHANICAL DEMOLITION FLOORPLAN
SCALE: 3/32" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

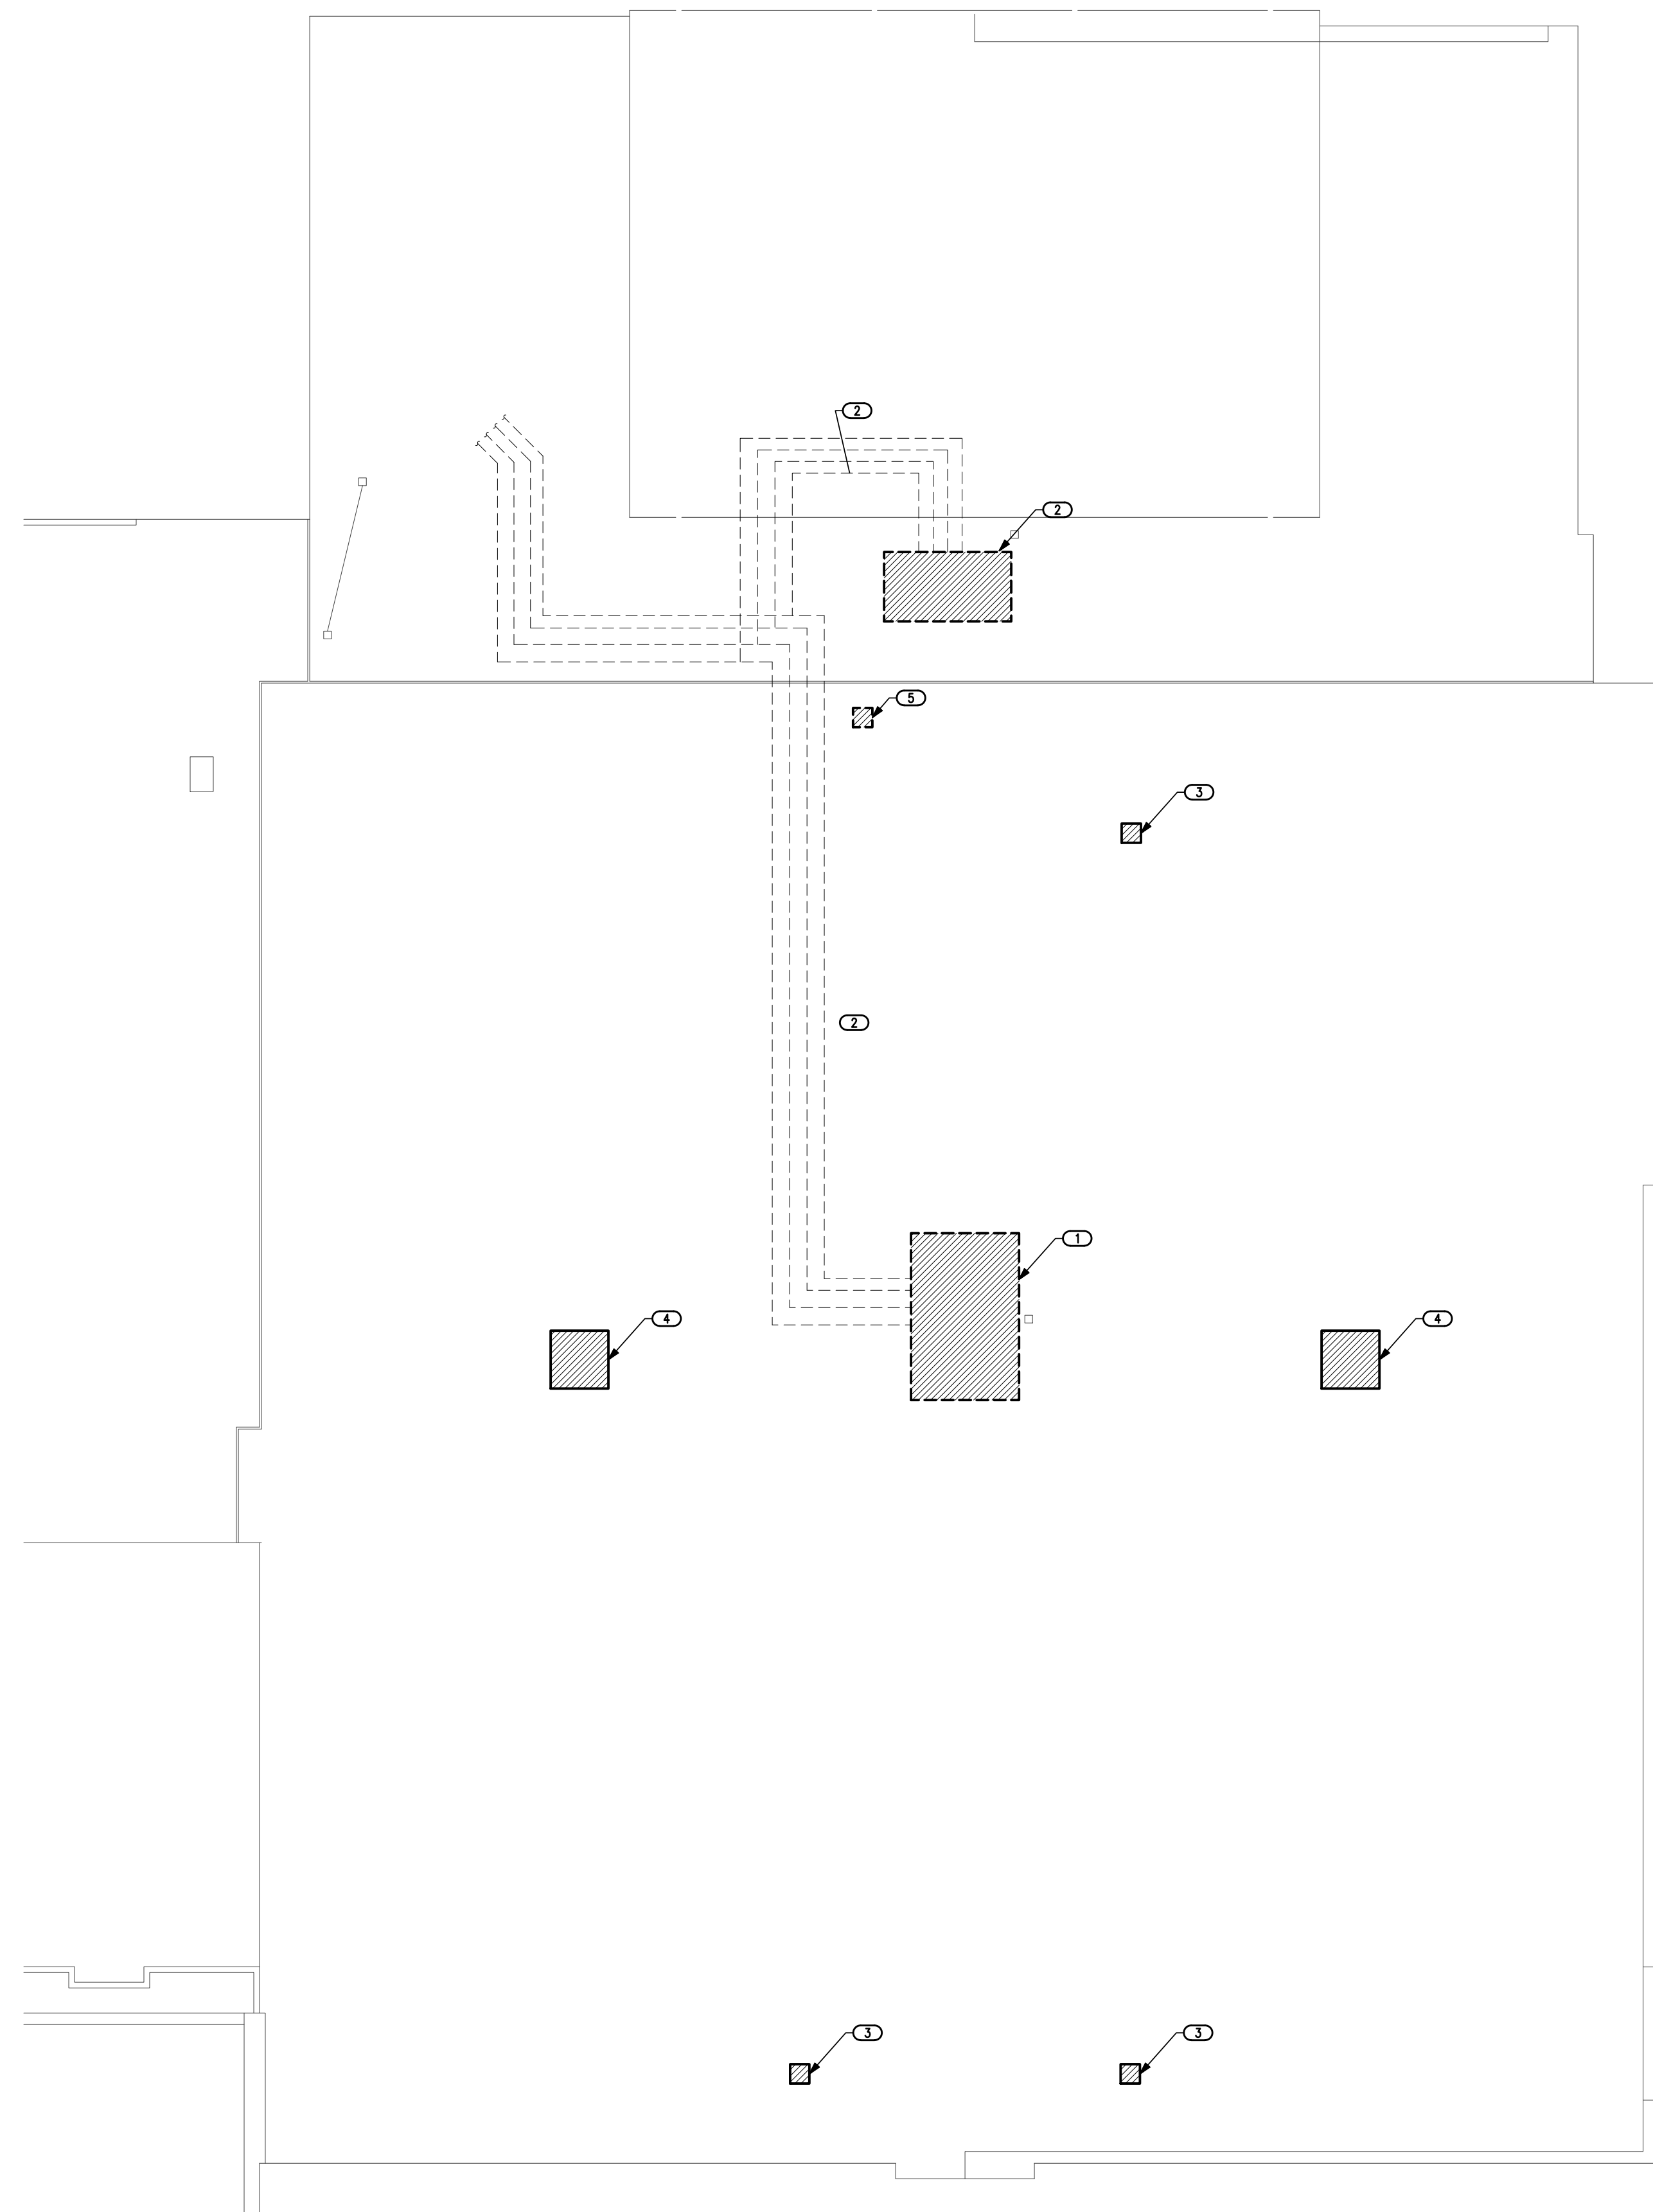

1 MECHANICAL DEMOLITION ROOF PLAN
SCALE: 3/32" = 1'-0"



GENERAL NOTES

1. COORDINATE DEMOLITION OF EQUIPMENT WITH ALL TRADES, CONSTRUCTION MANAGER, AND ARCHITECT.
2. CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS PRIOR TO PERFORMING WORK. LOCATIONS OF EXISTING EQUIPMENT ARE DIAGRAMMATICAL IN NATURE.
3. CONTRACTOR SHALL REPAIR AND/OR REPLACE ANY UNINTENDED DAMAGES TO SURROUNDING AREAS DUE TO DEMOLITION.
4. OWNER SHALL HAVE FIRST SALVAGE RIGHTS OF DEMOLISHED EQUIPMENT. DISPOSE OF EQUIPMENT ACCORDING TO CODE. RECYCLE ALL RECYCLABLE MATERIALS.

KEYED NOTES

- ① REMOVE AIR HANDLING UNIT AND ROOF PIPING BACK TO CHILLER. PATCH AND INSULATE ROOF PENETRATIONS TO MATCH EXISTING.
- ② REMOVE AIR HANDLING UNIT AND ROOF PIPING. ROOF PENETRATIONS TO BE REUSED IN NEW WORK.
- ③ EXHAUST FANS ARE EXISTING TO REMAIN.
- ④ REMOVE ROOF HOOD. PATCH AND SEAL ROOF PENETRATION.
- ⑤ EXHAUST FAN TO BE RELOCATED. PATCH AND SEAL ROOF PENETRATION AND PREPARE DUCTWORK FOR NEW CONNECTION.

AGP
the Abila Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



XX
drawn by
XX
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

MD102

Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.


GENERAL NOTES

1. COORDINATE INSTALLATION OF EQUIPMENT AND DUCTWORK WITH ALL TRADES.
2. COORDINATE LOCATION OF THERMOSTATS WITH E.C. ROUGH-IN BY E.C.
3. CONNECT NEW EVAPORATOR COILS CONDENSATE TO EXISTING NEARBY CONDENSATE PIPES. REFER TO PLUMBING PLANS FOR CONNECTIONS.

AGP
the Abla Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

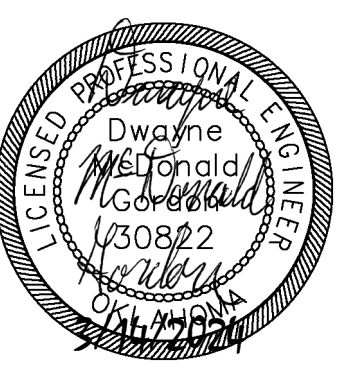

KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

M101


OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

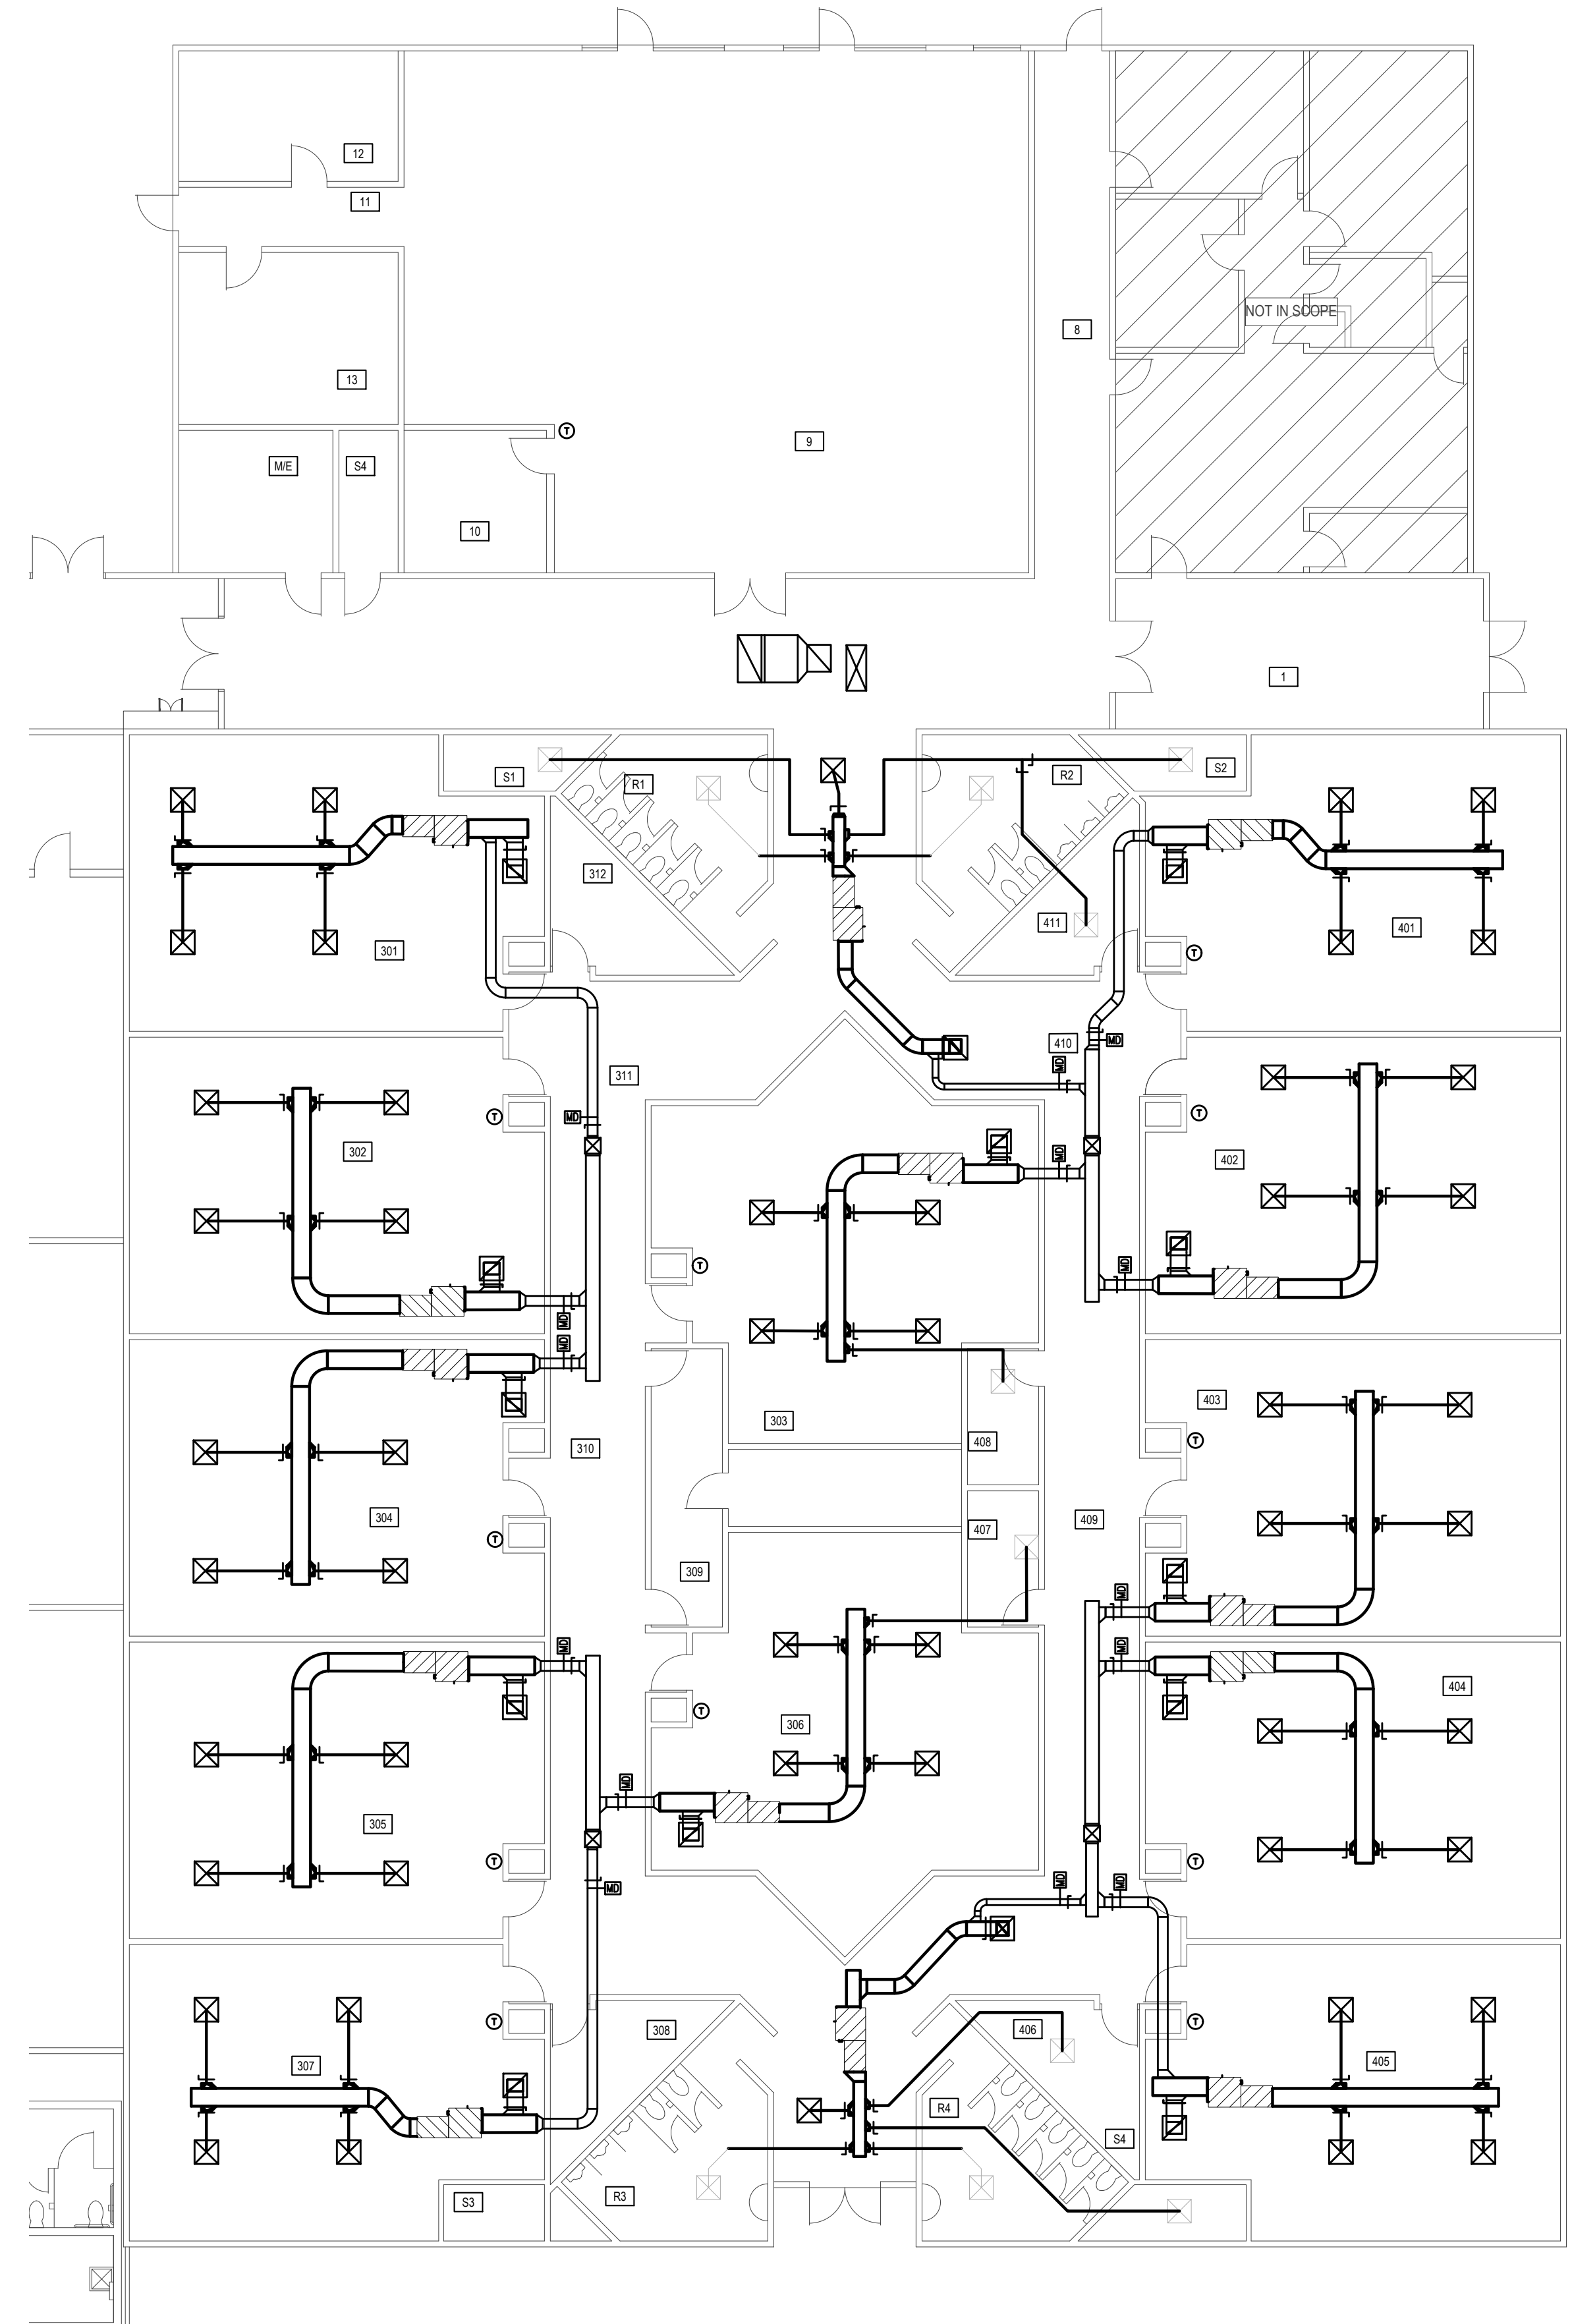

1 MECHANICAL OVERALL PLAN
SCALE: 3/32" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

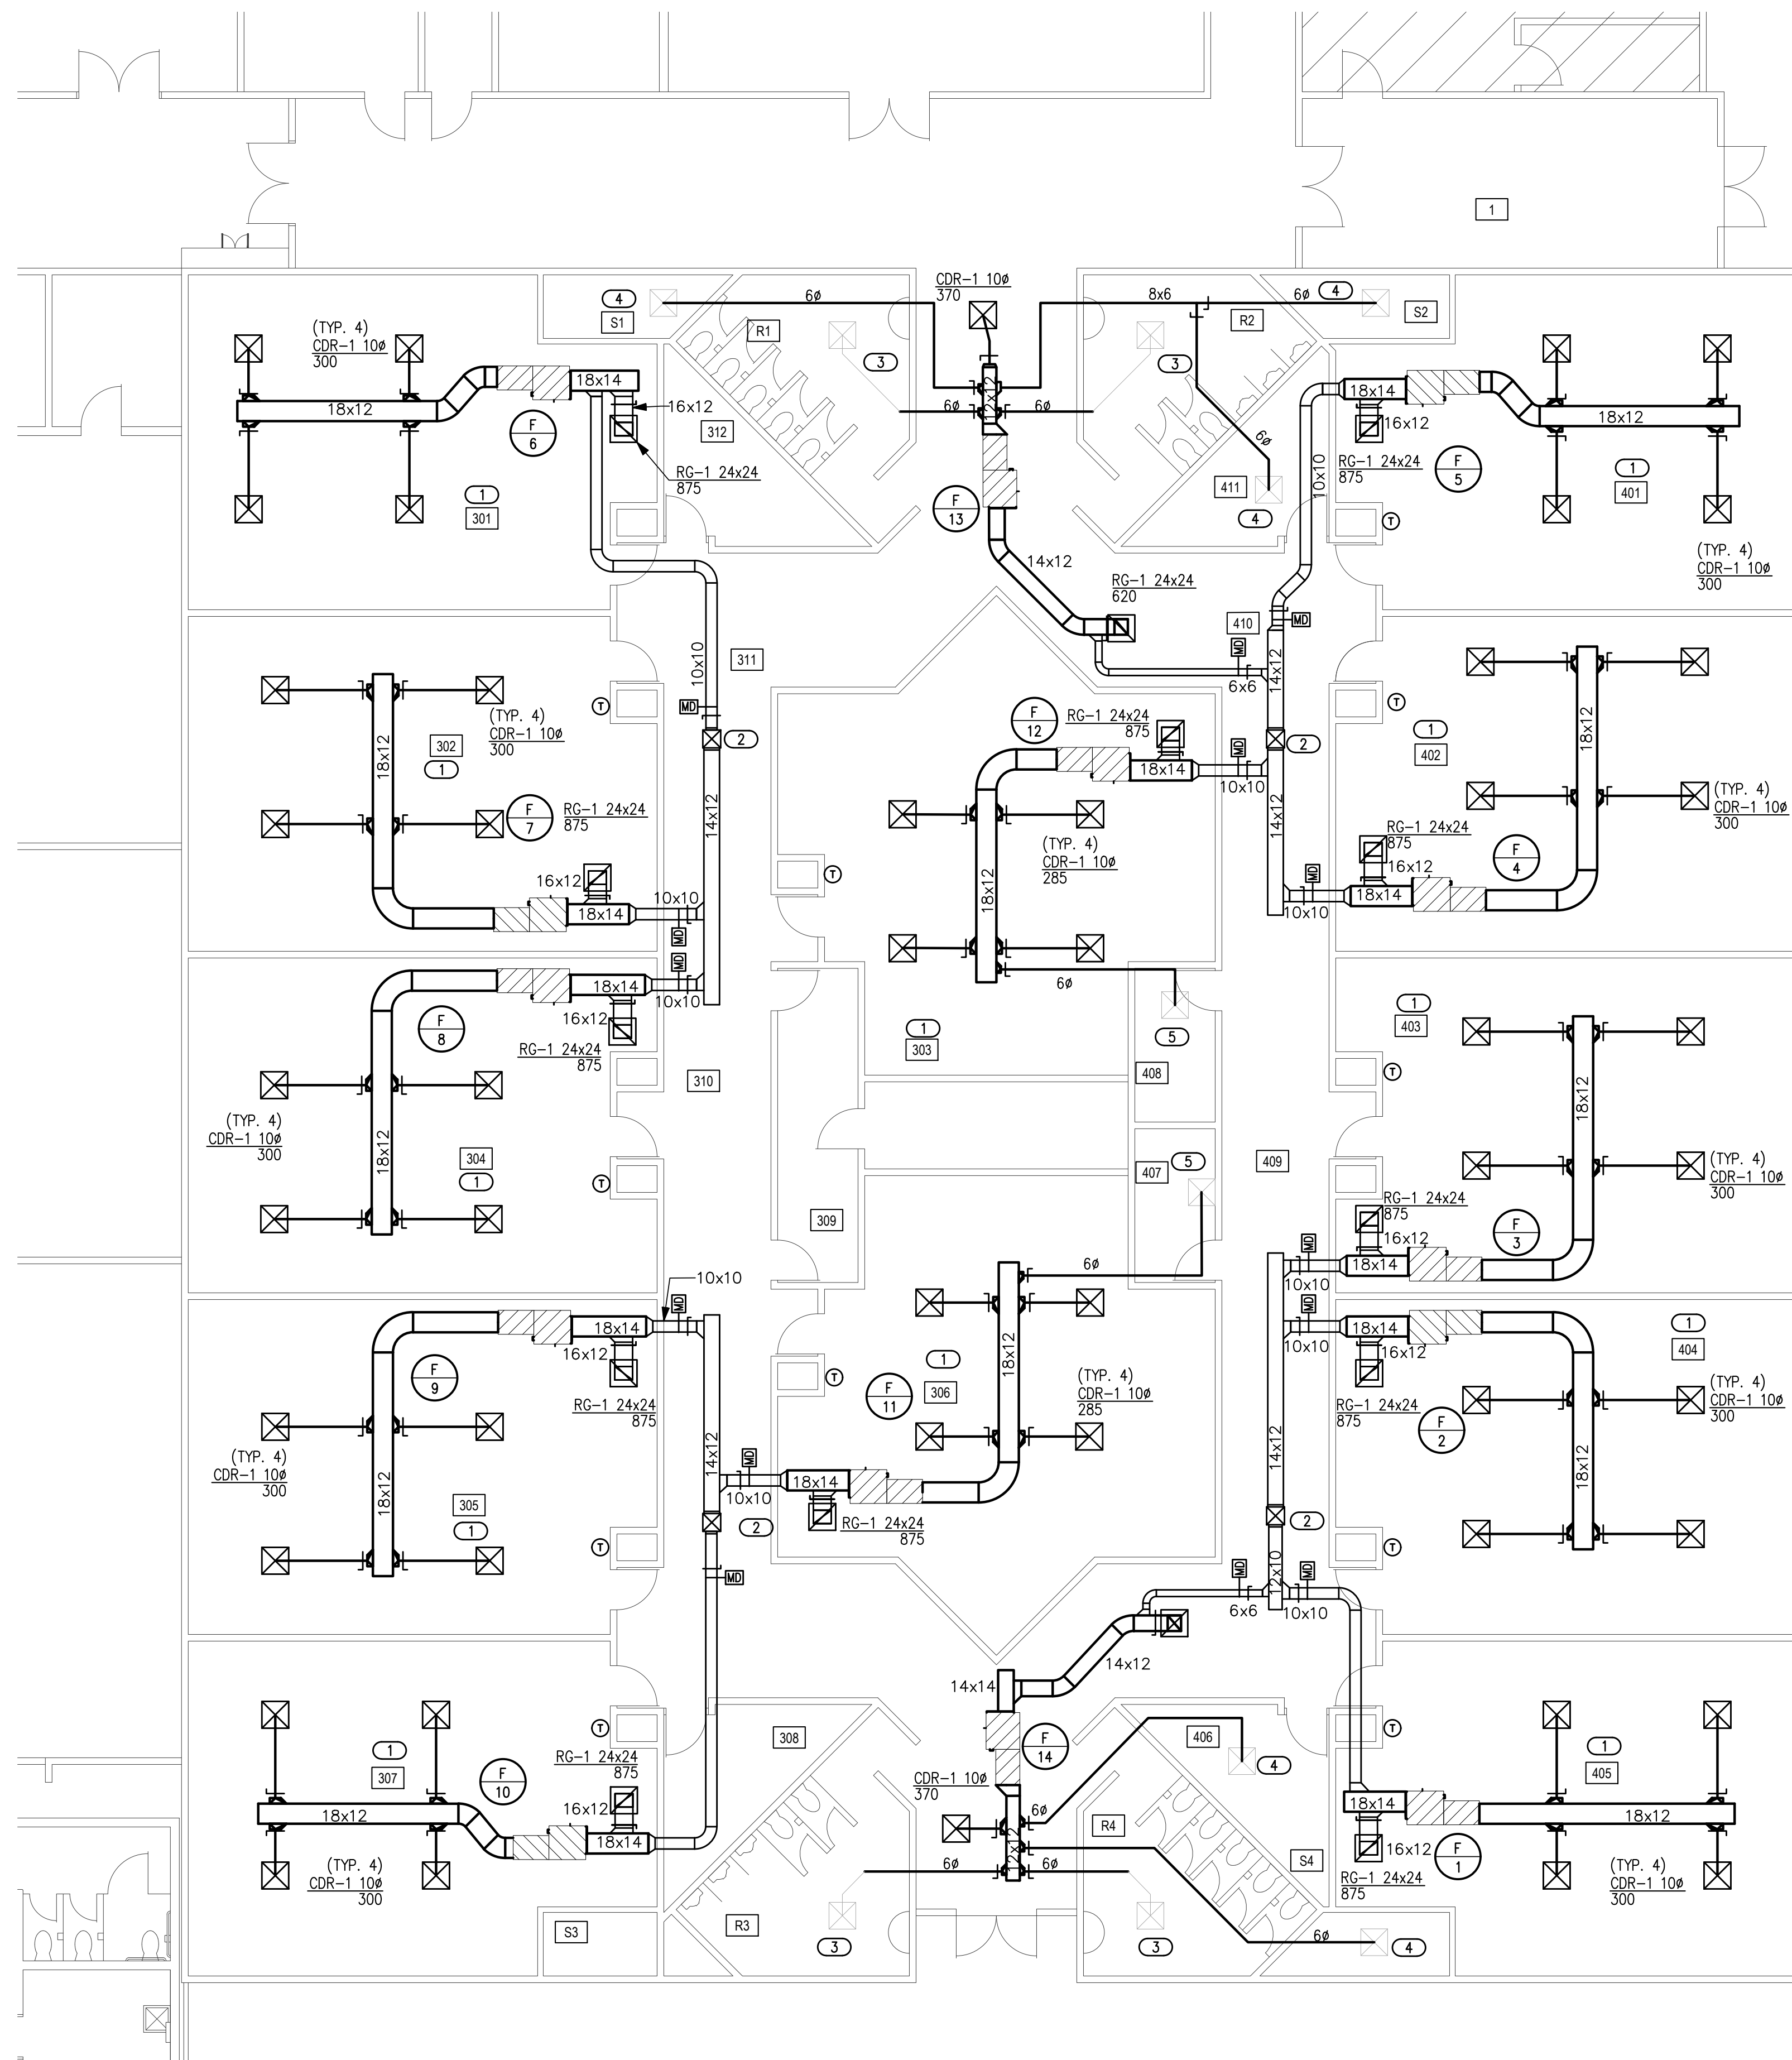


- GENERAL NOTES**
- COORDINATE INSTALLATION OF EQUIPMENT AND DUCTWORK WITH ALL TRADES.
 - COORDINATE LOCATION OF THERMOSTATS WITH E.C. ROUGH-IN BY E.C.
 - COORDINATE CARBON DIOXIDE SENSOR LOCATION WITH EARTHSMART PRIOR TO INSTALLATION.
 - M.C. SHALL PROVIDE CARBON MONOXIDE SENSORS WHERE NEEDED PER CODE FOR EXISTING EQUIPMENT THROUGHOUT THE ENTIRE BUILDING. M.C. IS RESPONSIBLE FOR SURVEYING ENTIRE BUILDING AND LOCATING FUEL BURNING HVAC EQUIPMENT FOR SENSOR LOCATIONS. COORDINATE WITH E.C FOR POWER CONNECTIONS.
 - CONNECT NEW EVAPORATOR COILS CONDENSATE TO EXISTING NEARBY CONDENSATE PIPES. REFER TO PLUMBING PLANS FOR CONNECTIONS.

- KEYED NOTES**
- CARBON MONOXIDE DETECTOR TO BE INSTALLED ACCORDING TO ALL APPLICABLE CODES. DETECTOR SHALL BE INSTALLED CENTRALLY ON CEILING. ALSO INCLUDE BATTERY BACKUP IN EVENT PRIMARY POWER IS INTERRUPTED. ALARM SIGNAL SHALL BE ROUTED TO ADMINISTRATION OFFICE. COORDINATE WITH E.C. WITH PRIMARY POWER CONNECTION AND SYSTEM CONNECTION.
 - DUCT UP 16x16 TO CONNECT TO THROAT OPENING OF ROOF HOOD.
 - CLEAN AND CONNECT EXISTING DIFFUSER TO NEW 6" DIA. SUPPLY DUCT. BALANCE TO 125 CFM.
 - CLEAN AND CONNECT EXISTING DIFFUSER TO NEW 6" DIA. SUPPLY DUCT. BALANCE TO 50 CFM.
 - CLEAN AND CONNECT EXISTING DIFFUSER TO NEW 6" DIA. SUPPLY DUCT. BALANCE TO 60 CFM.

AGP
the Abila Griffin
Partnership L.L.C.
201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

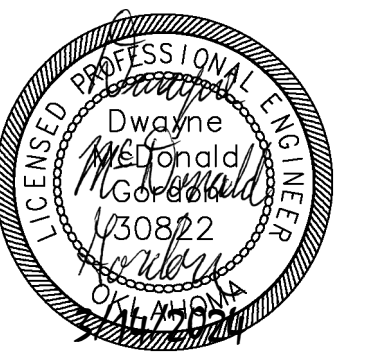

KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:
M102

1 MECHANICAL FLOOR PLAN - CLASSROOMS
SCALE: 1/8" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

GENERAL NOTES

- COORDINATE INSTALLATION OF EQUIPMENT AND DUCTWORK WITH ALL TRADES.
- COORDINATE LOCATION OF THERMOSTATS WITH E.G. ROUGH-IN BY E.C.


KEYED NOTES

- PROVIDE DUCT TRANSITION AS NEEDED TO CONNECT EXISTING SUPPLY DUCT TO NEW RTU.
- CONNECT 24X28 RETURN DUCT TO RTU.

AGP
the Abla Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

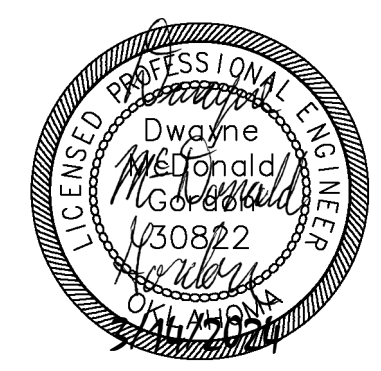


KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:
M103

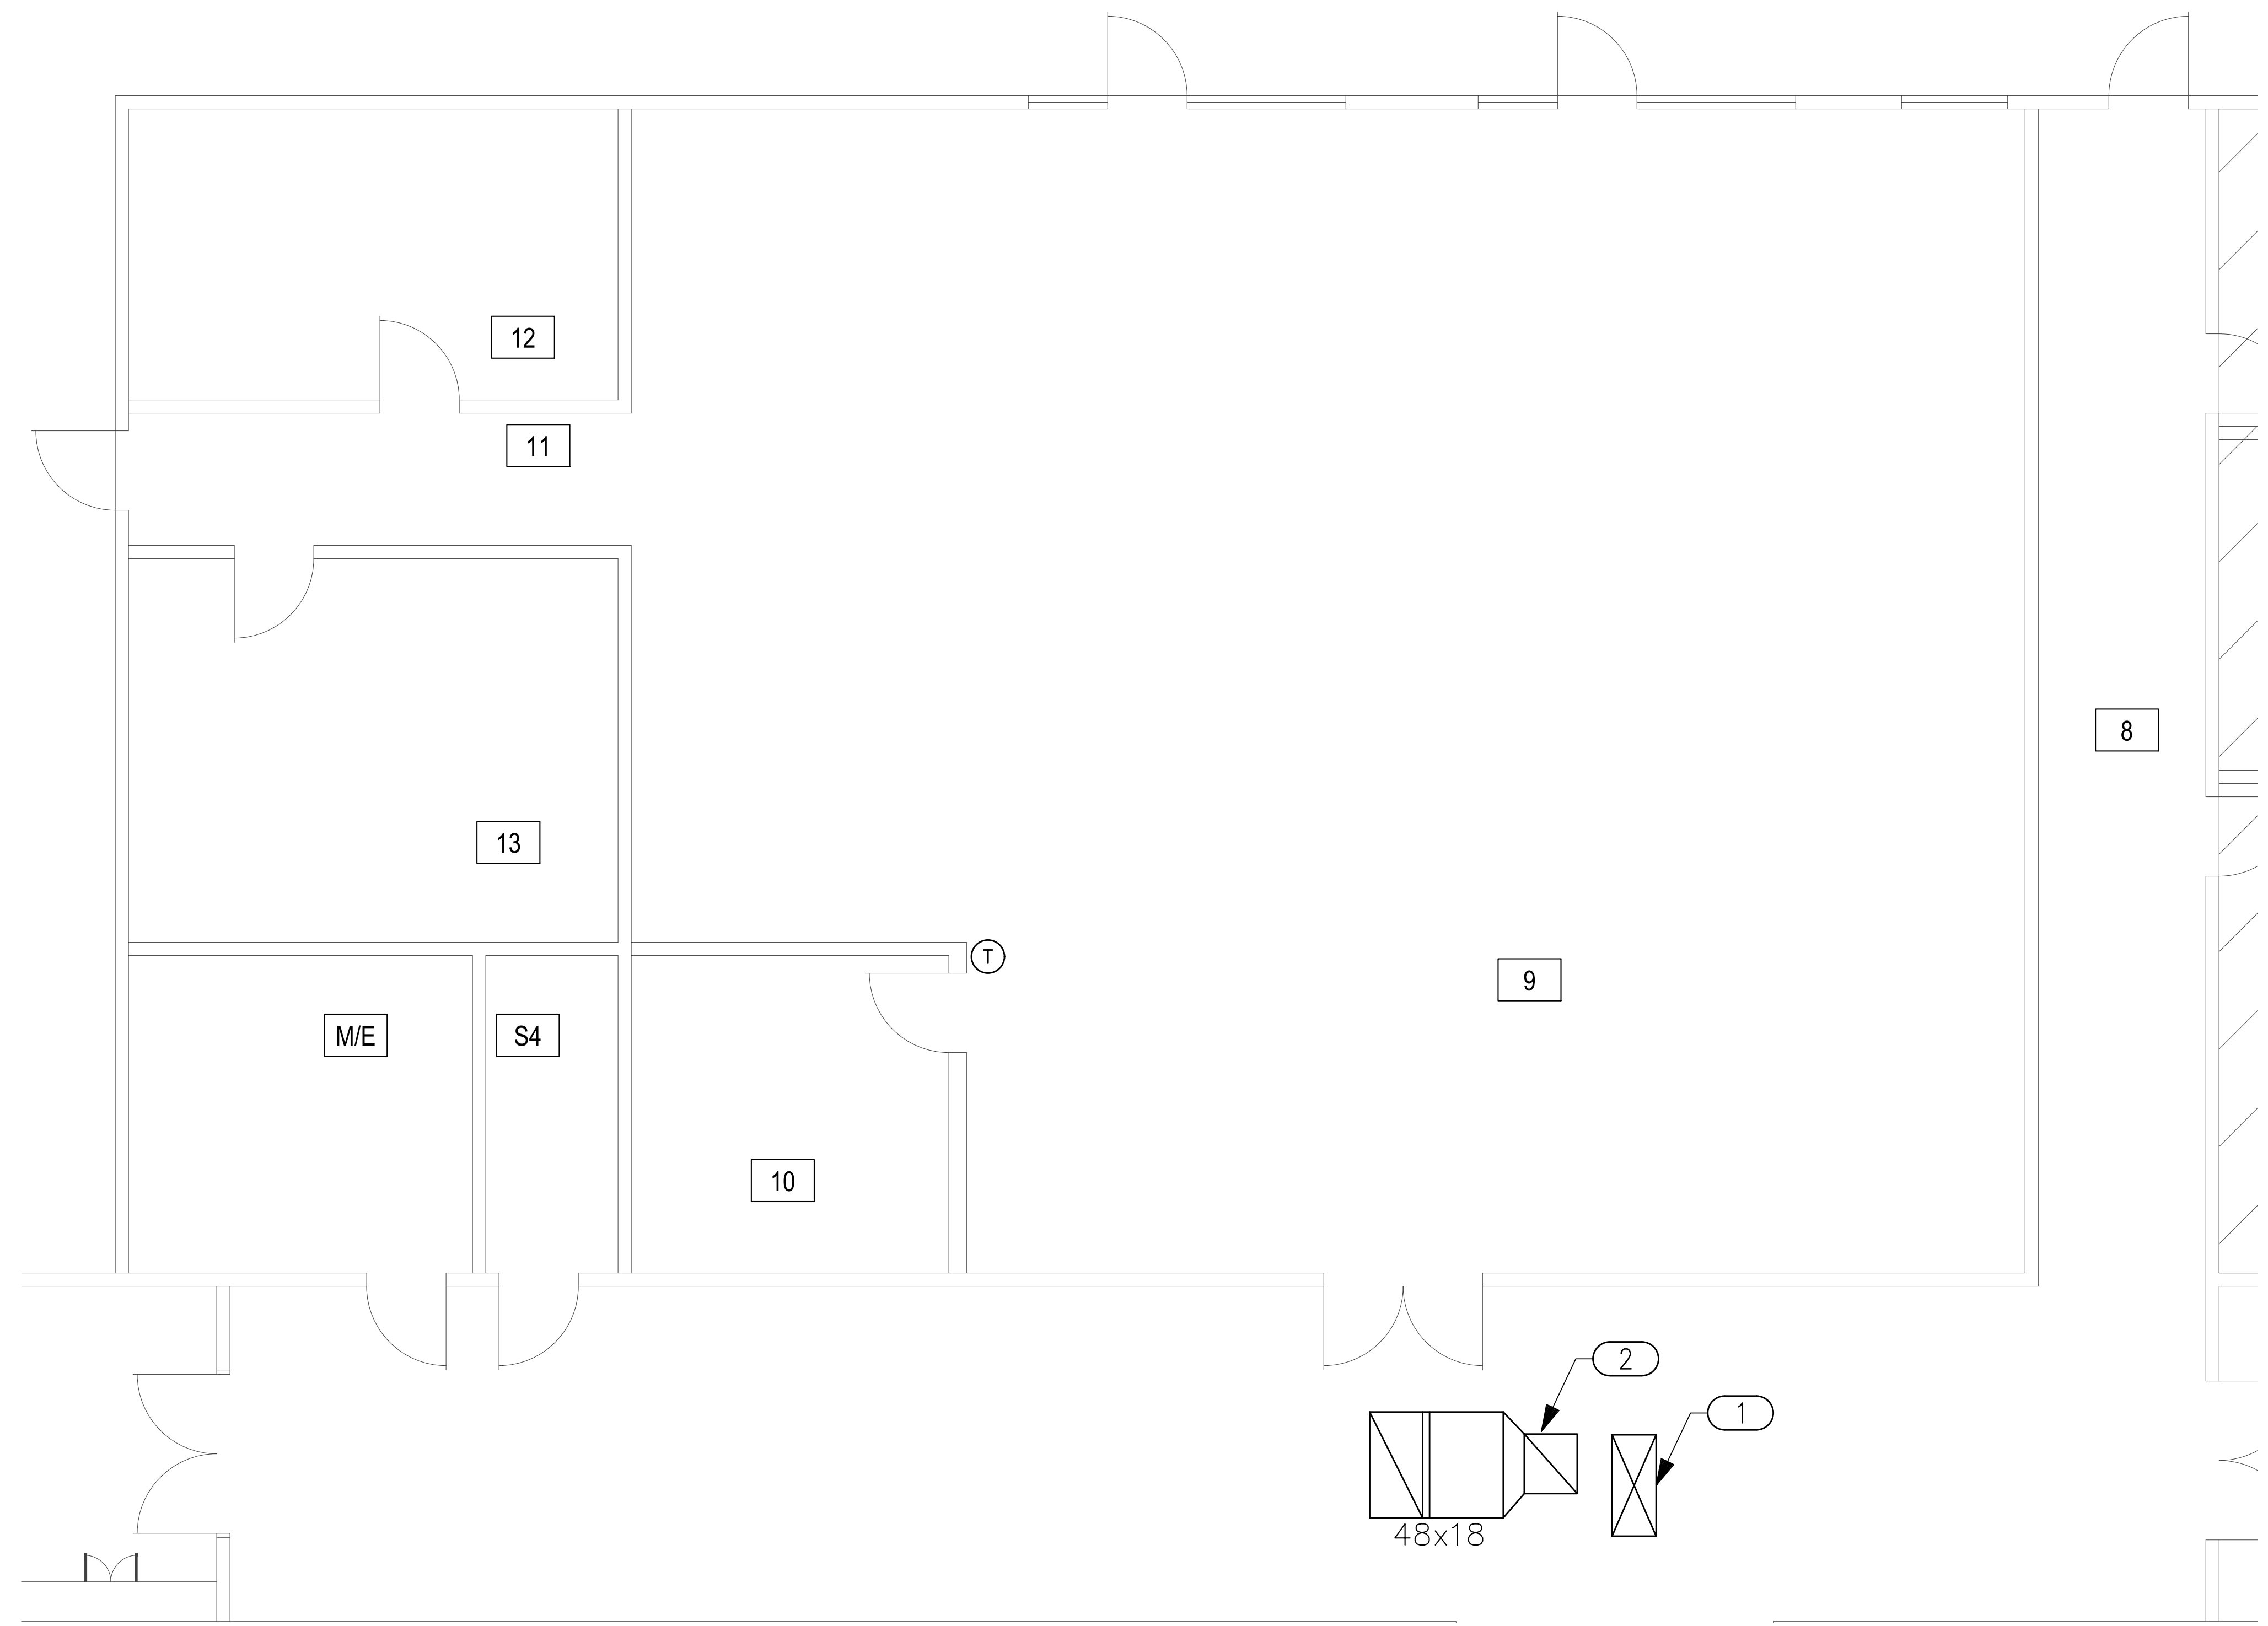


1 MECHANICAL FLOOR PLAN - MEDIA CENTER
SCALE: 1/4" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

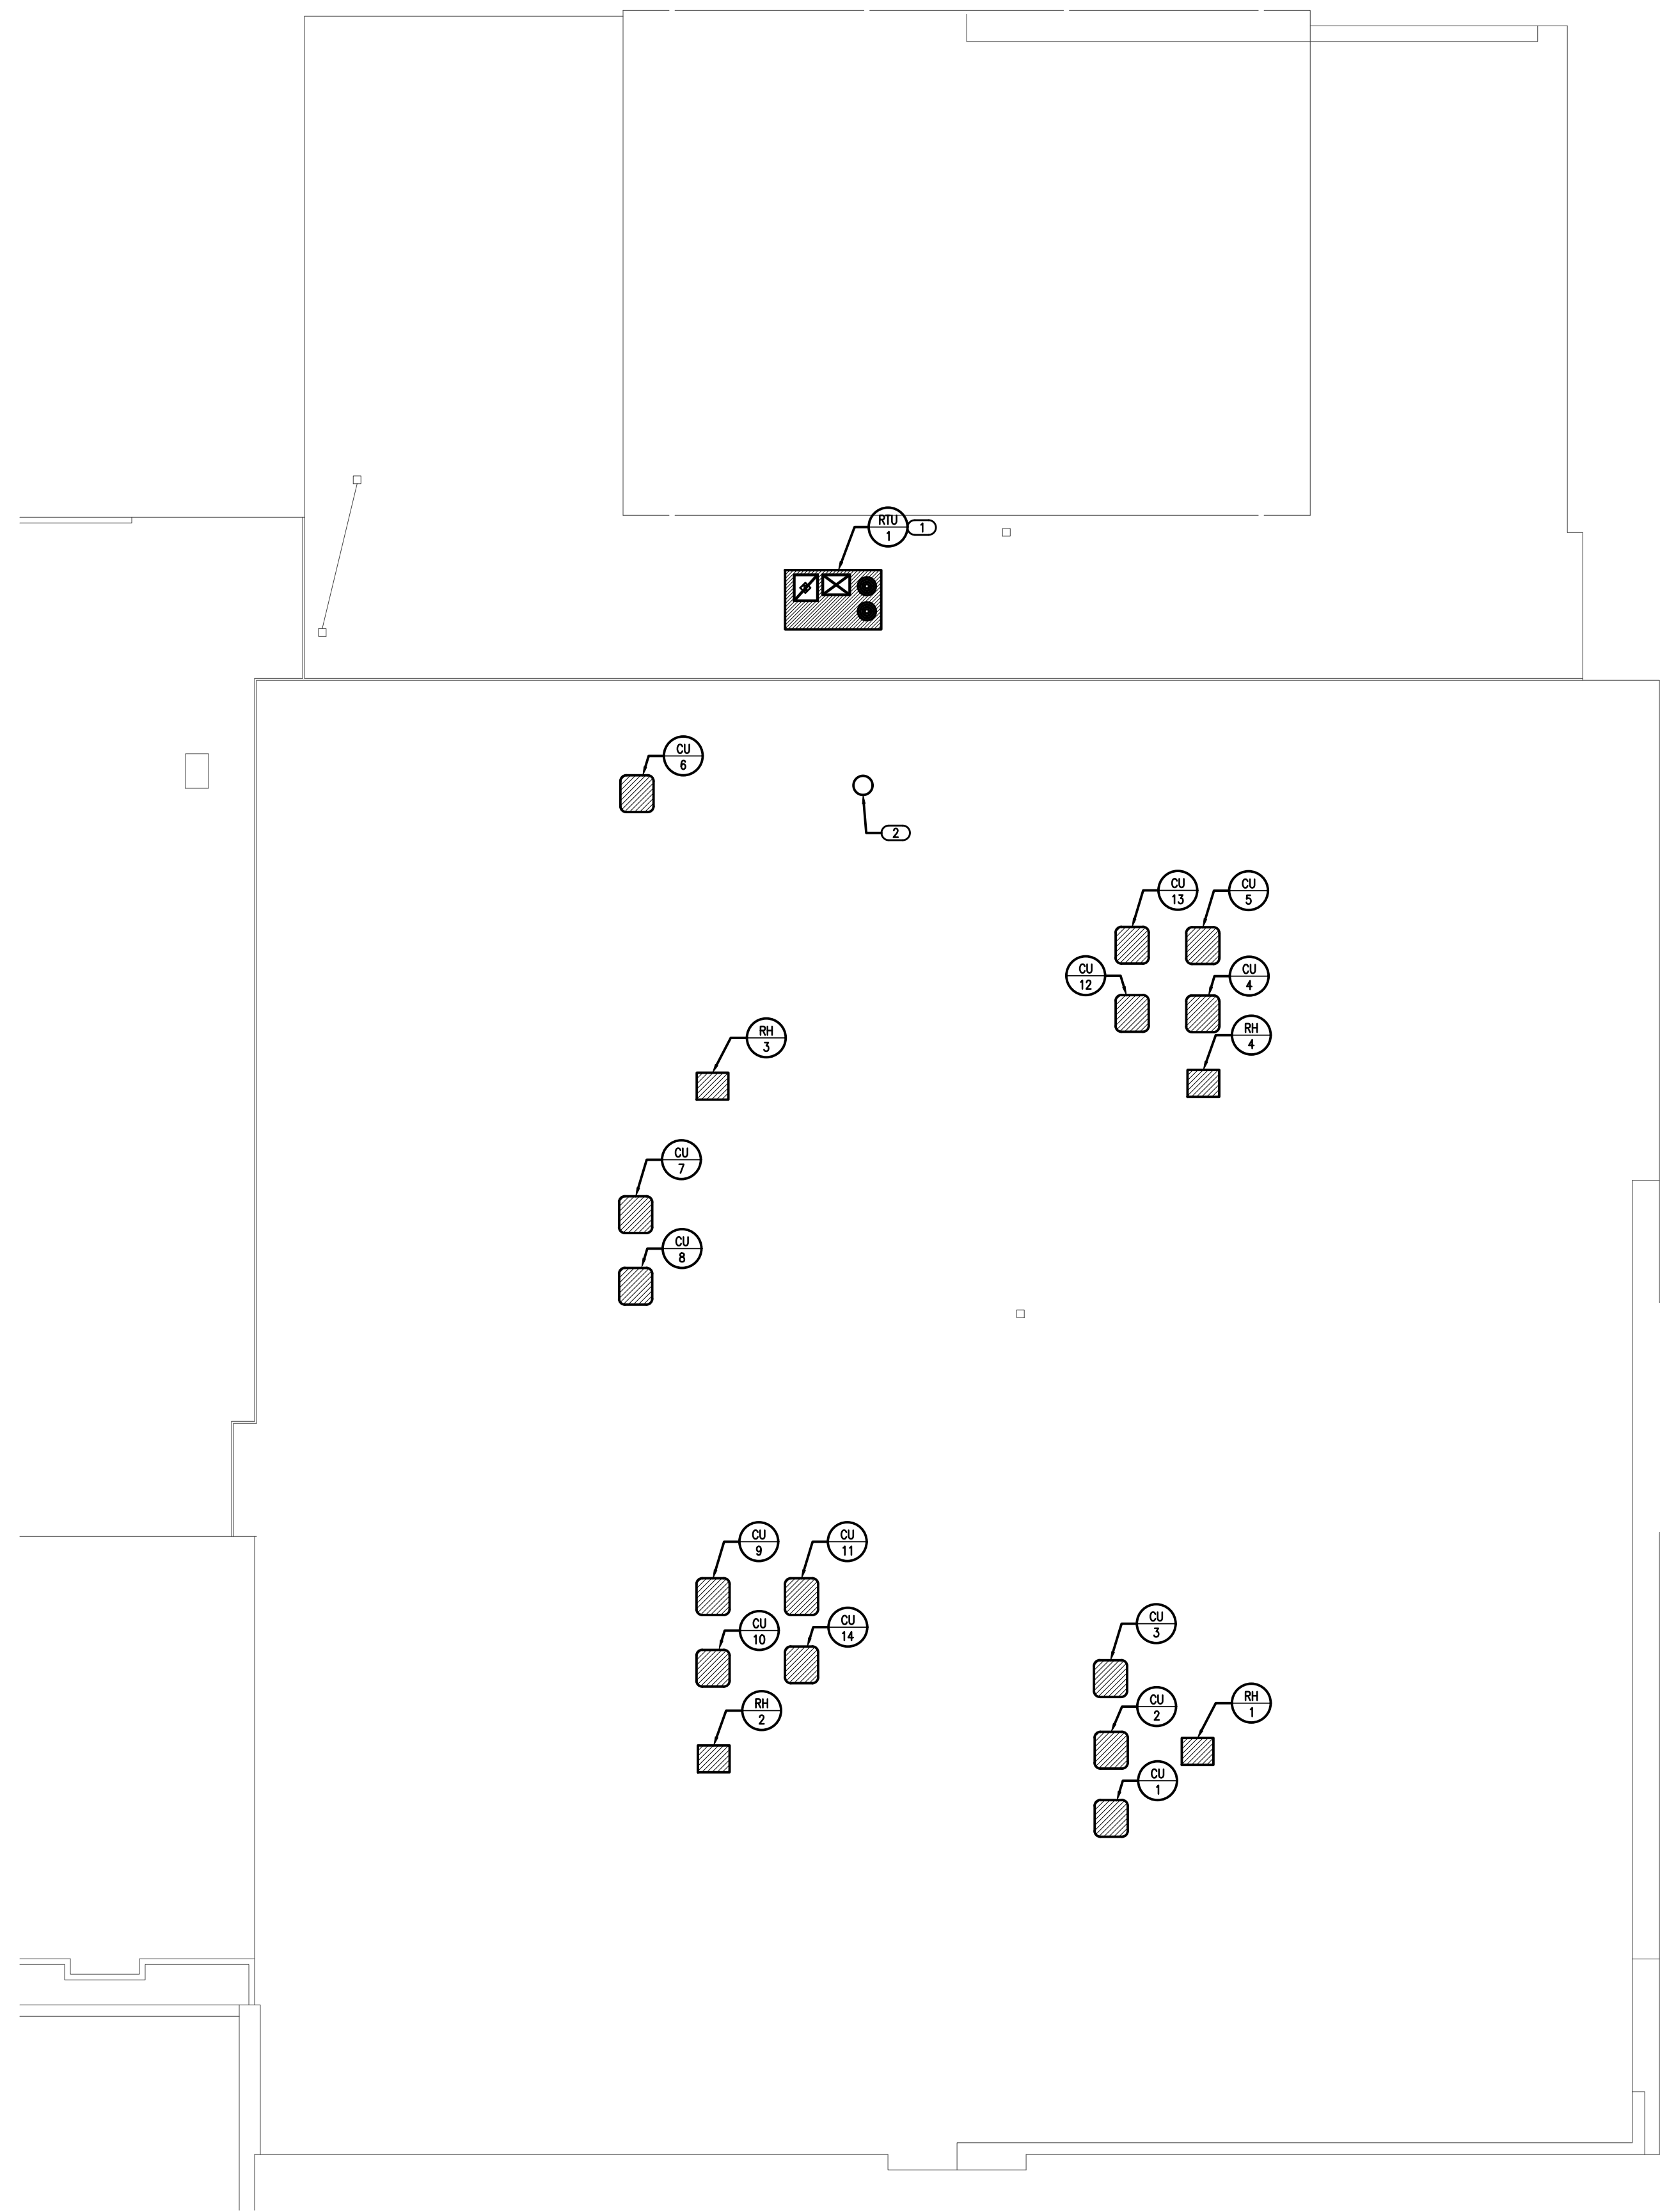

GENERAL NOTES

1. ALL ROOF TOP EQUIPMENT TO BE LOCATED A MINIMUM 10'-0" AWAY FROM ROOF EDGE.
2. MAINTAIN A MINIMUM OF 10'-0" HORIZONTAL CLEARANCE BETWEEN ALL EXHAUST OUTLETS AND ANY FRESH AIR INTAKES.
3. ALL ROOF SUPPORT SYSTEMS ARE TO BE MANUFACTURED FOR THE ROOF MATERIAL/SYSTEM TO BE INSTALLED. REFER TO ARCHITECTURAL PLANS FOR THE ROOF SYSTEM, CURB INSTALLATION TO BE WARRANTED BY ROOFING CONTRACTOR.

KEYED NOTES

- ① REUSE SUPPLY DUCT ROOF PENETRATION FOR RTU 1. PROVIDE NEW ROOF PENETRATION FOR RETURN DUCT.
- ② RELOCATE EXHAUST FAN TO BE AT LEAST 10'0" FROM OUTSIDE AIR INTAKE OF RTU 1 PER IMC CODE REQUIREMENTS. PROVIDE NEW ROOF PENETRATION AND DUCTWORK AS NEEDED TO RECONNECT TO BATHROOM EXHAUST.

AGP
the Abila Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL



KF
drawn by

DG
checked by

MARCH 2024
date

revisions


MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:
M104

1 MECHANICAL ROOF PLAN
SCALE: 3/32" = 1'-0"



Salas O'Brien

2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.



KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:


M501

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.




2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

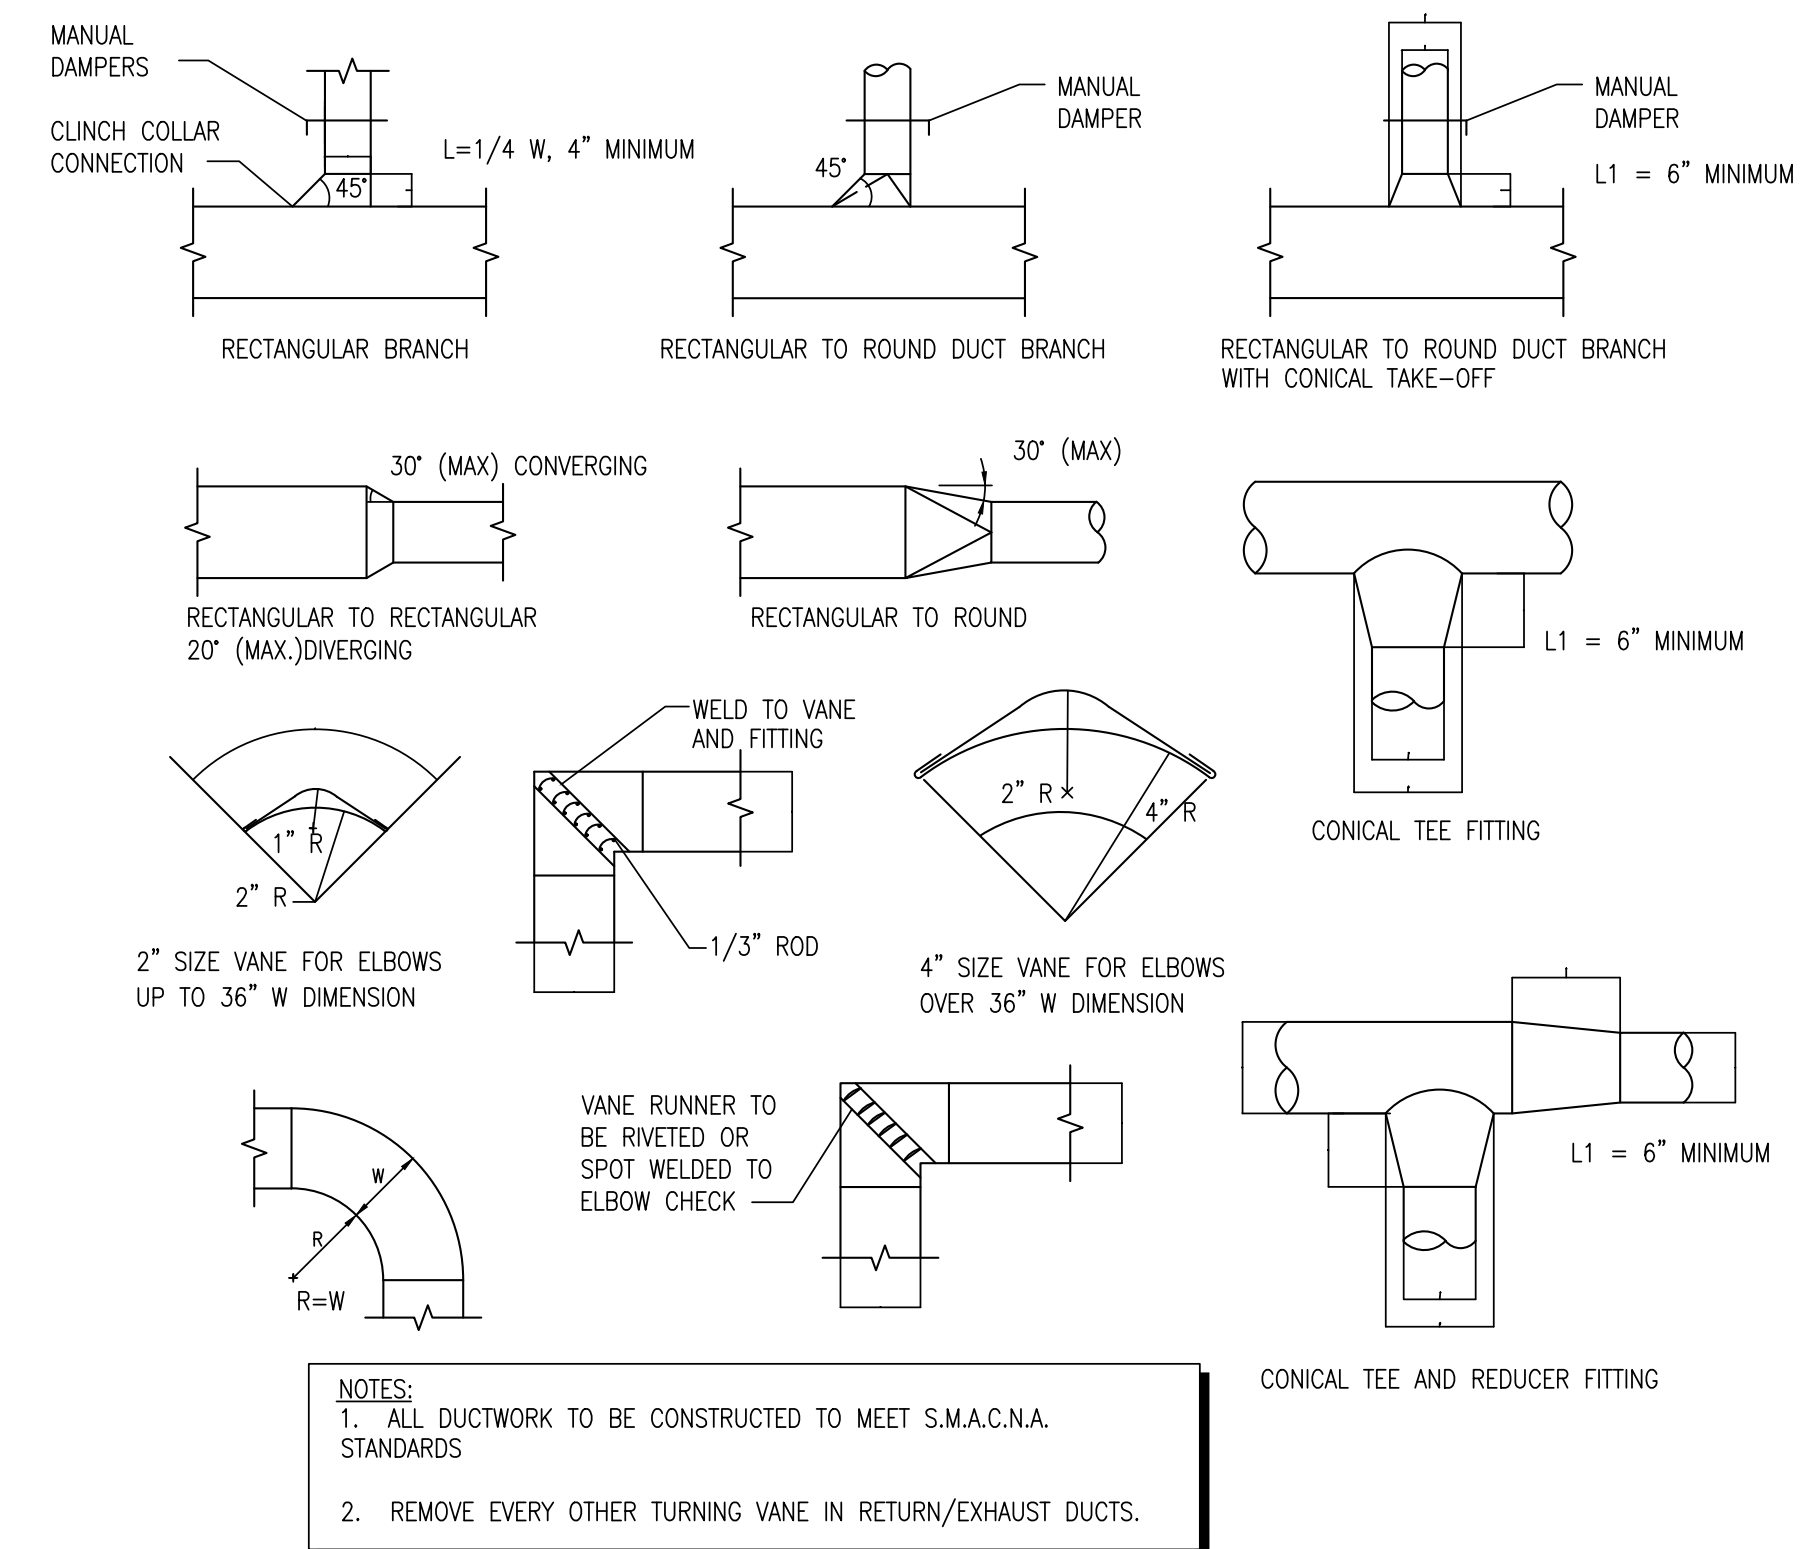


1 TYPICAL DUCTWORK DETAILS
NO SCALE

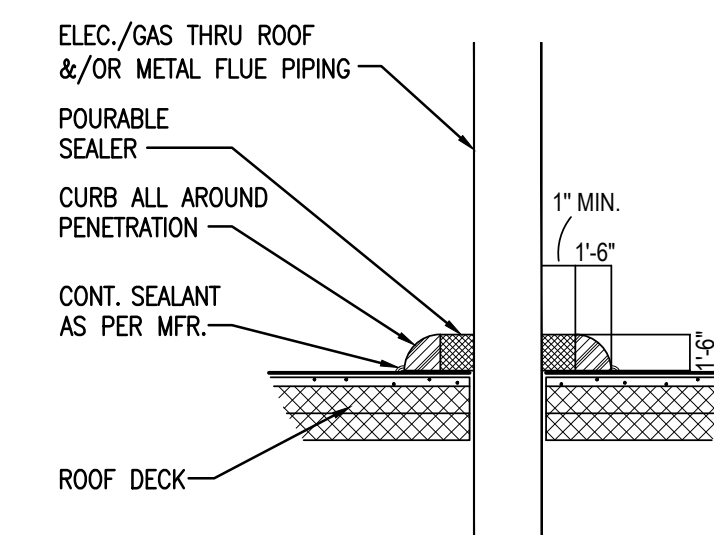


6 PENETRATION DAM/SEALER POCKET DETAIL
NOT TO SCALE

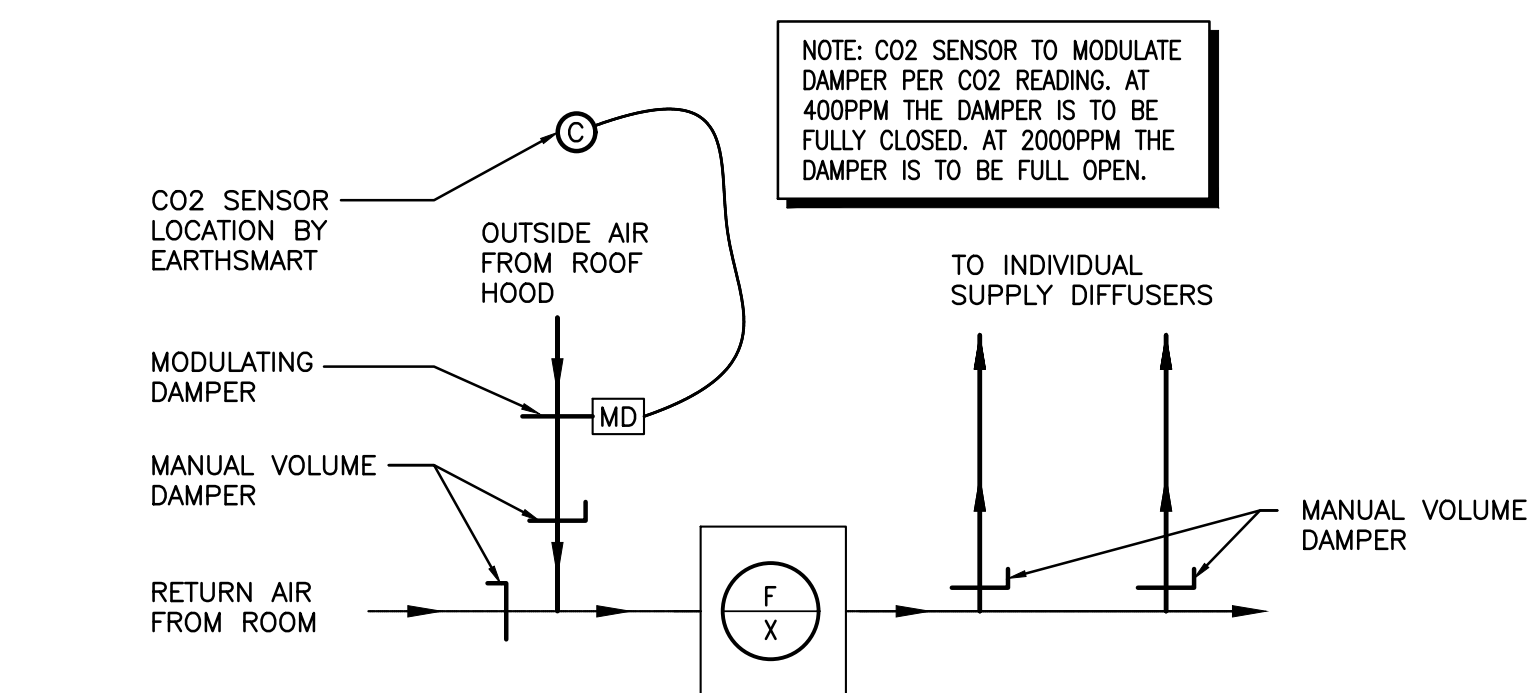


7 TYPICAL FURNACE AIR BALANCING SCHEMATIC
NOT TO SCALE

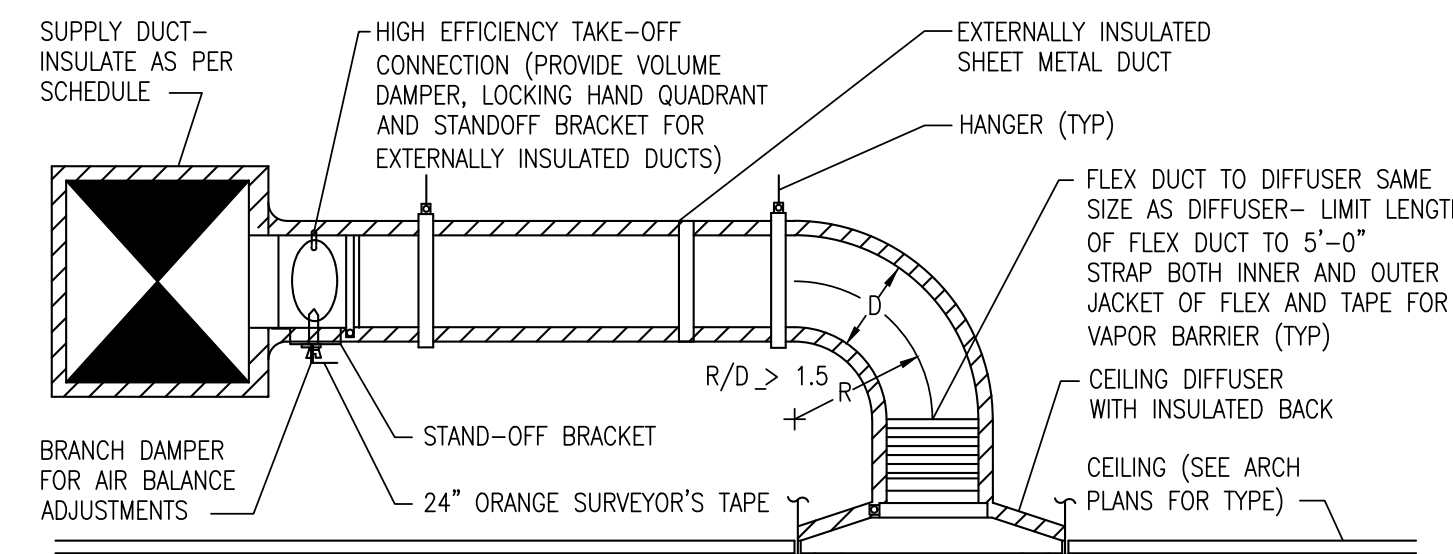


3 CEILING DIFFUSER DETAIL
NOT TO SCALE

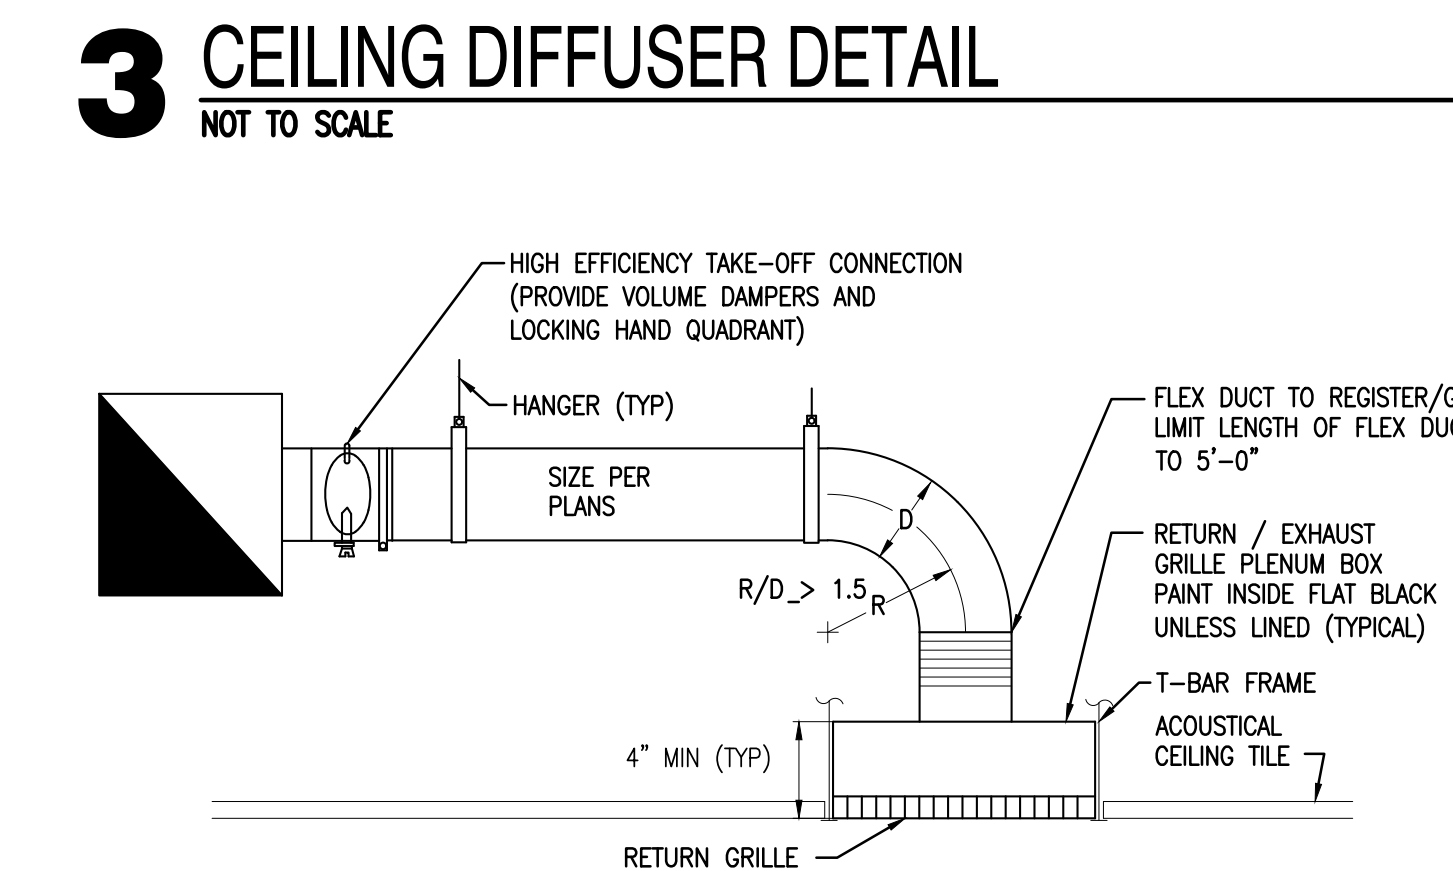


2 RETURN / EXHAUST AIR GRILLE PLENUM BOX
NOT TO SCALE

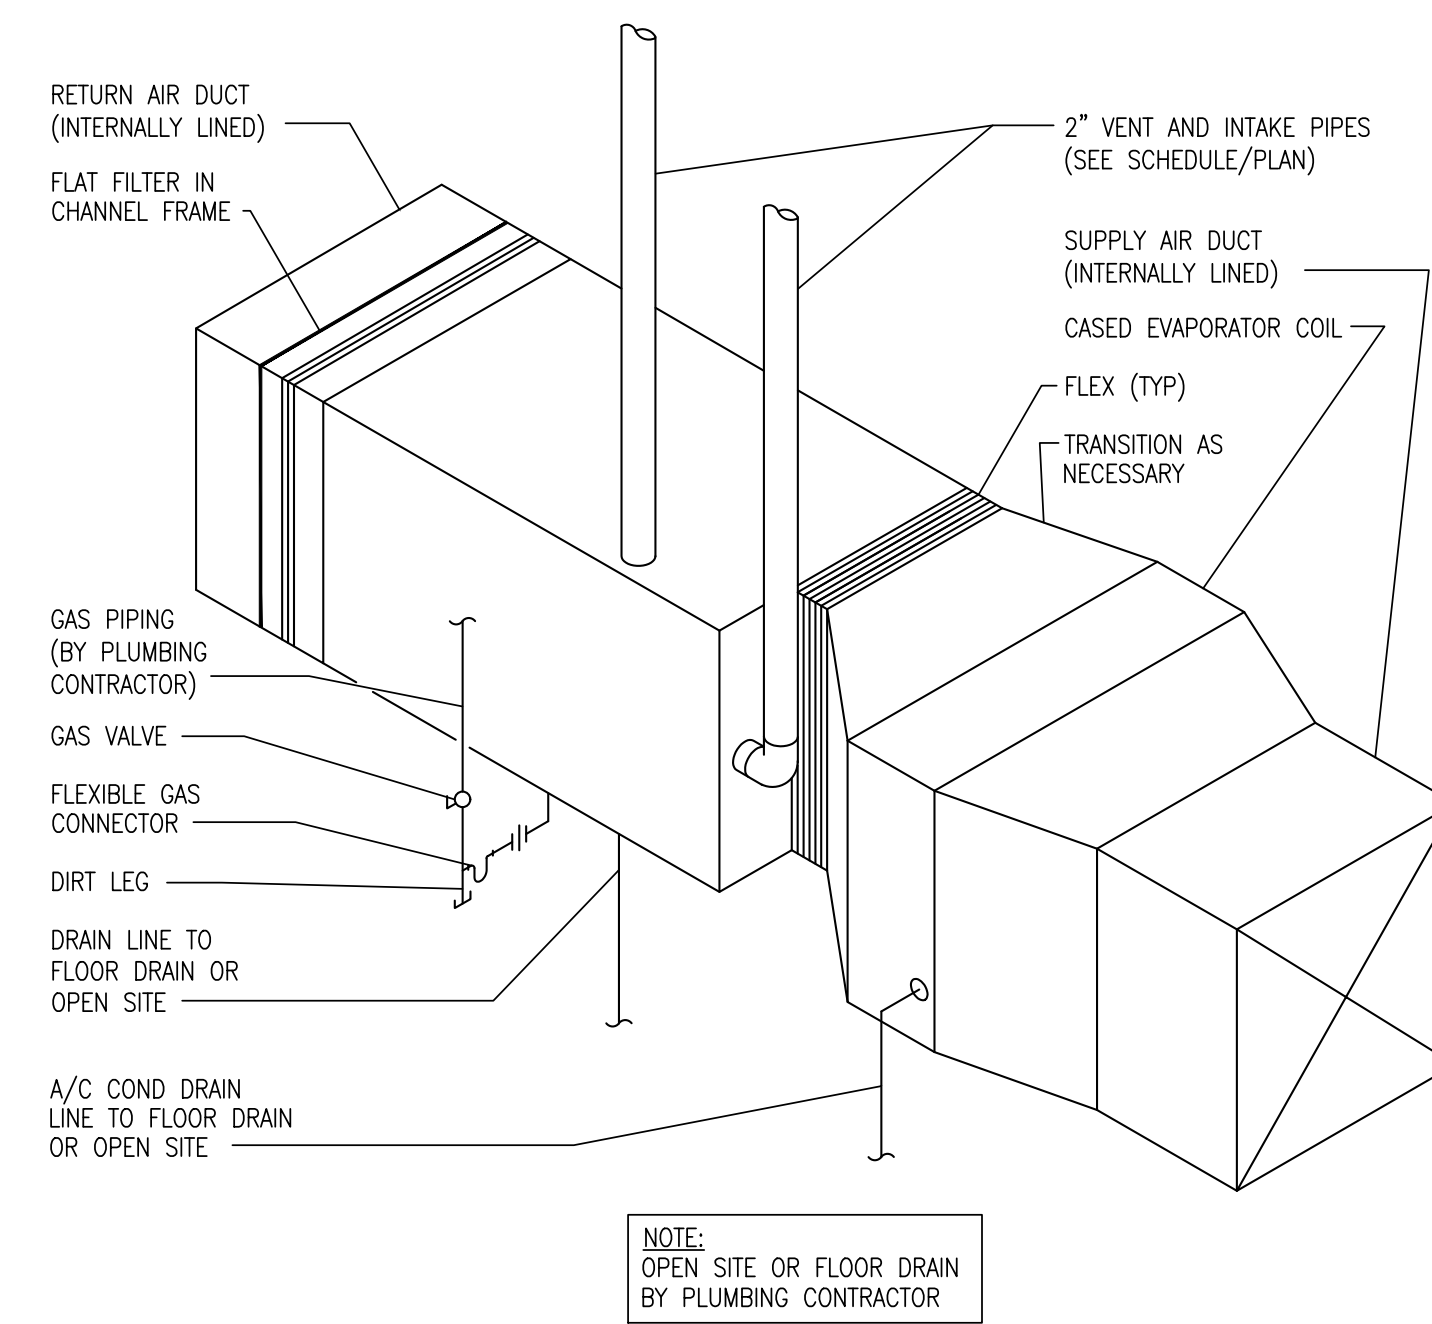


8 HORIZONTAL GAS FURNACE DETAIL
NOT TO SCALE

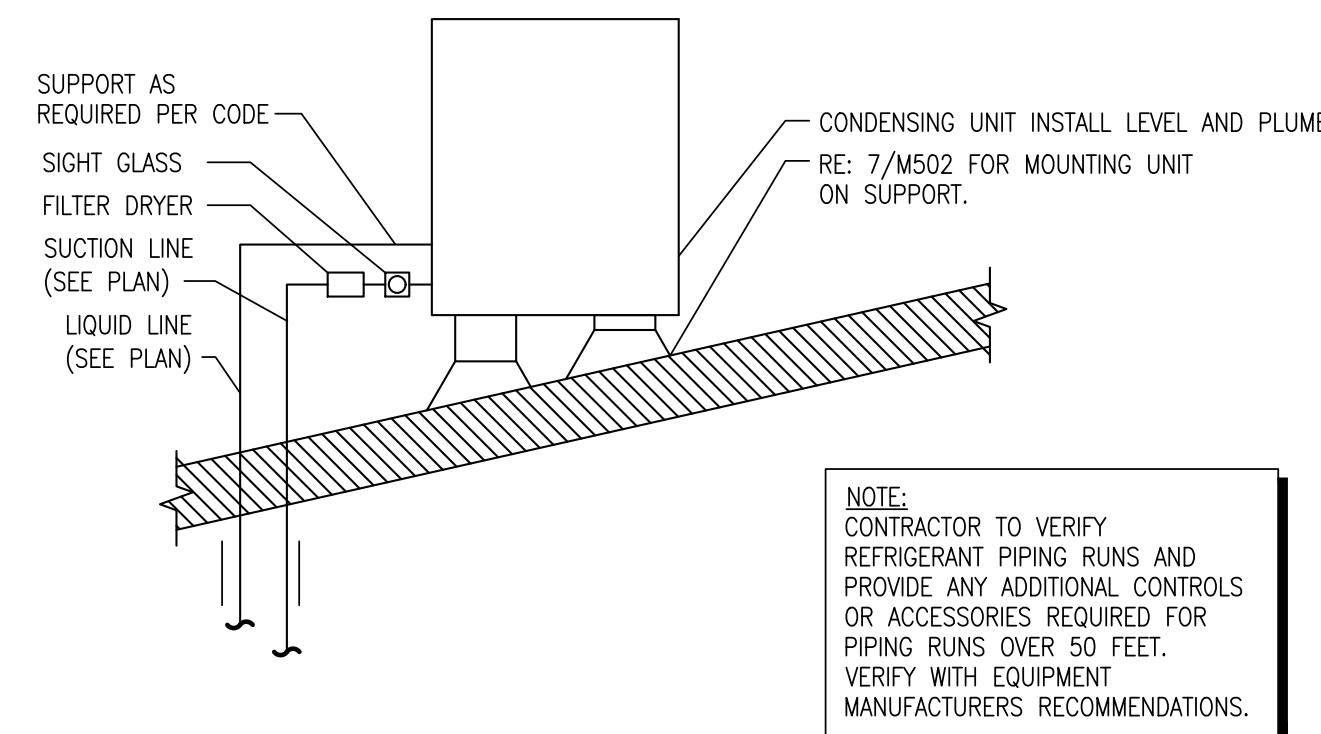


4 CONDENSING UNIT PIPING DETAIL
NOT TO SCALE

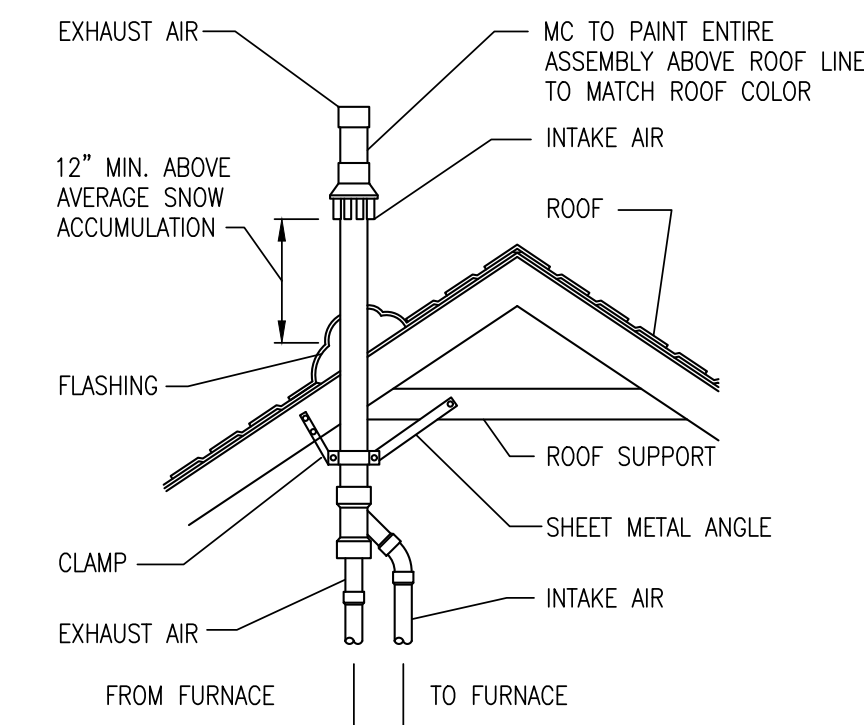


5 VENT TERMINATION DETAIL
NOT TO SCALE

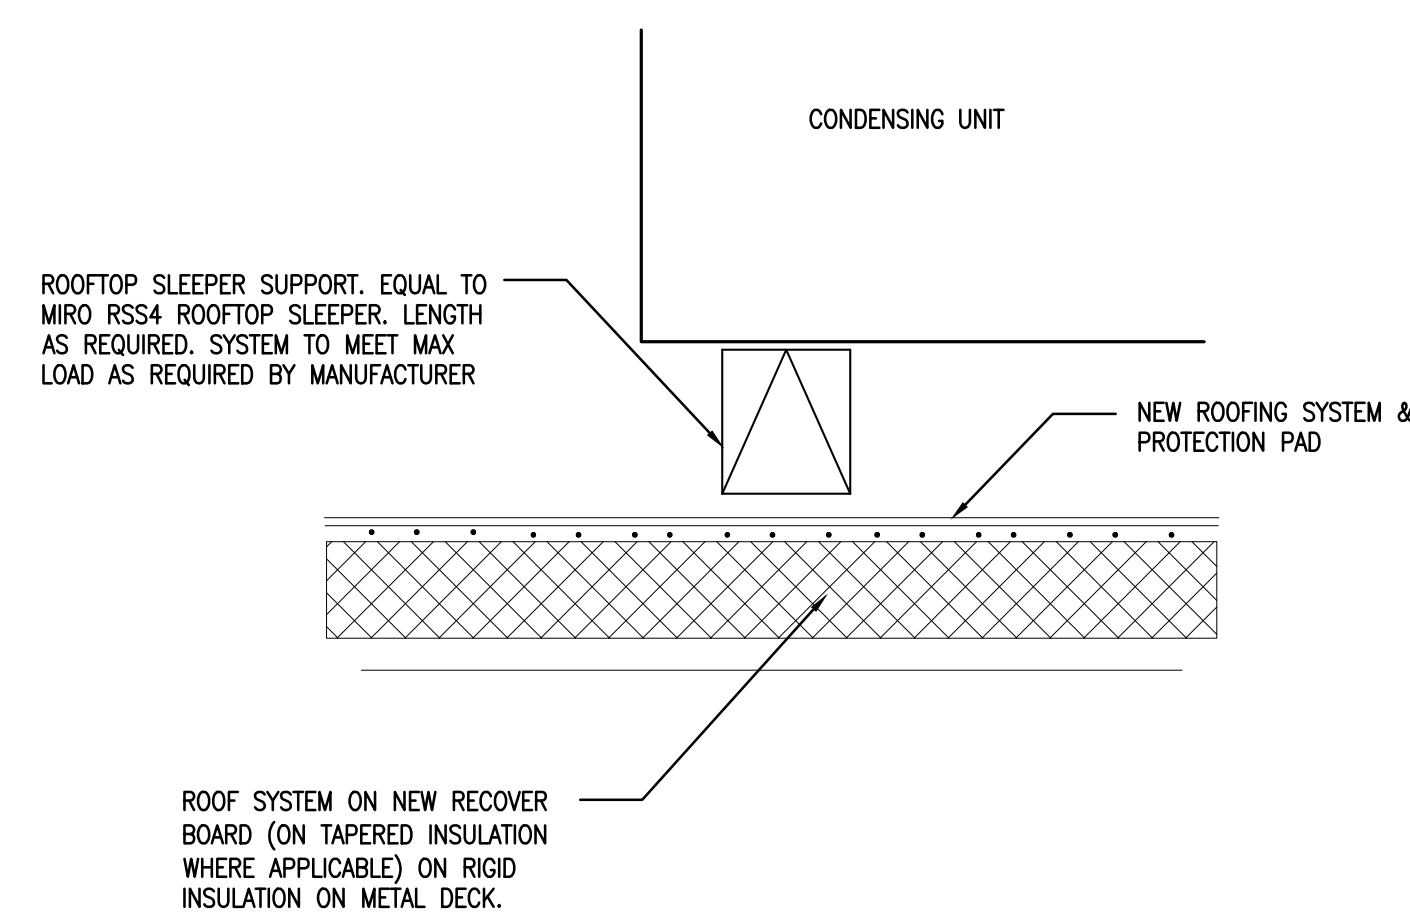


9 CONDENSING UNIT ROOF SUPPORT
NOT TO SCALE

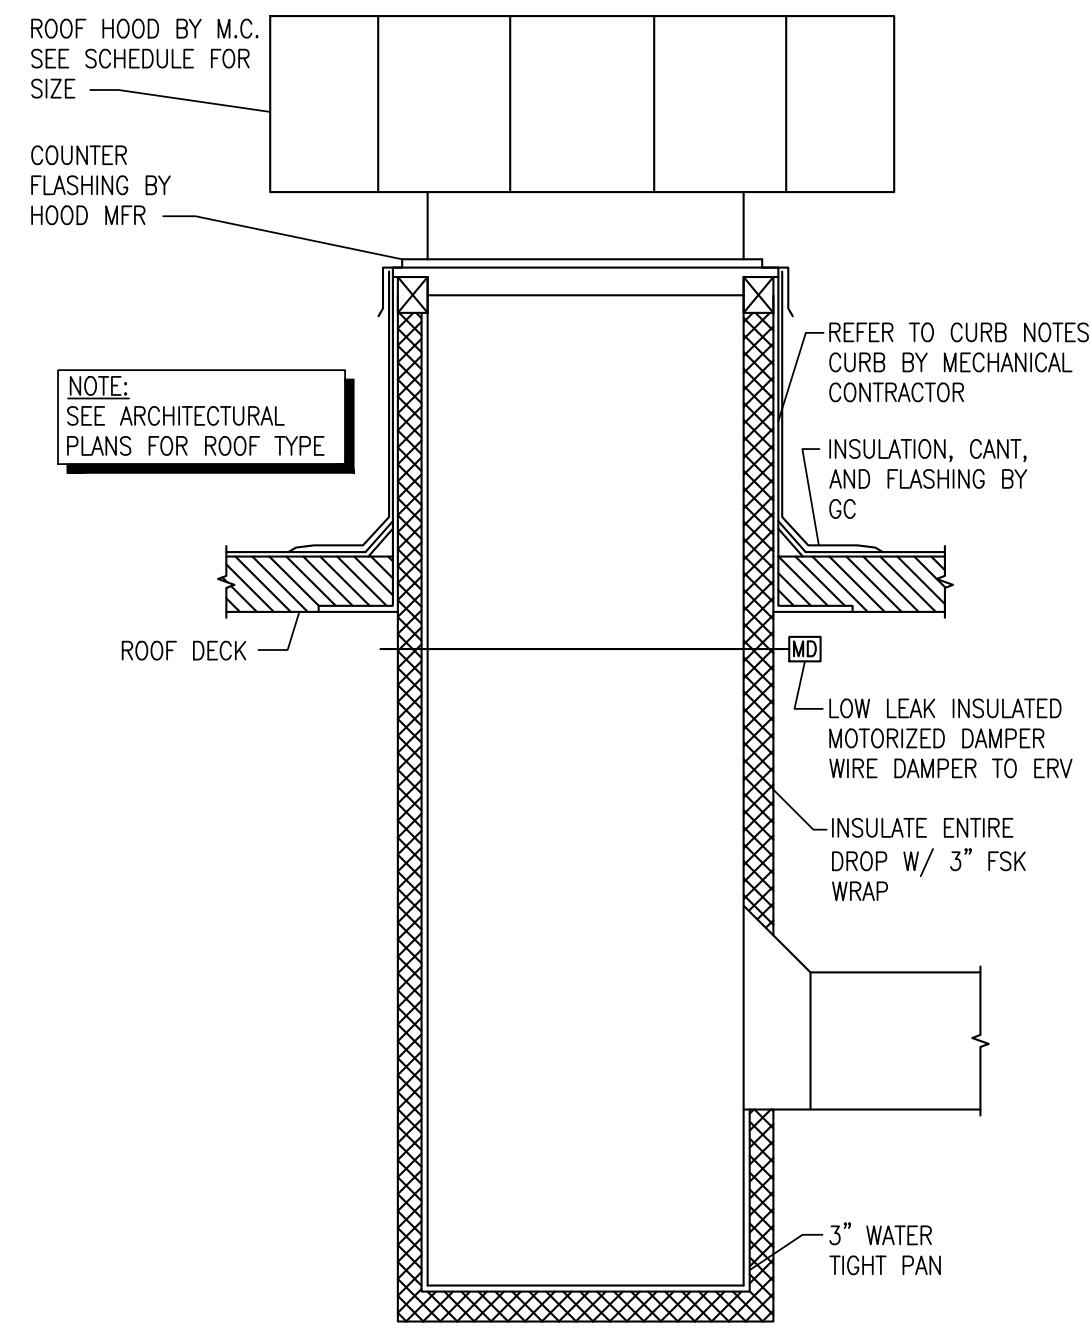

2 ROOF HOOD DETAIL
NOT TO SCALE

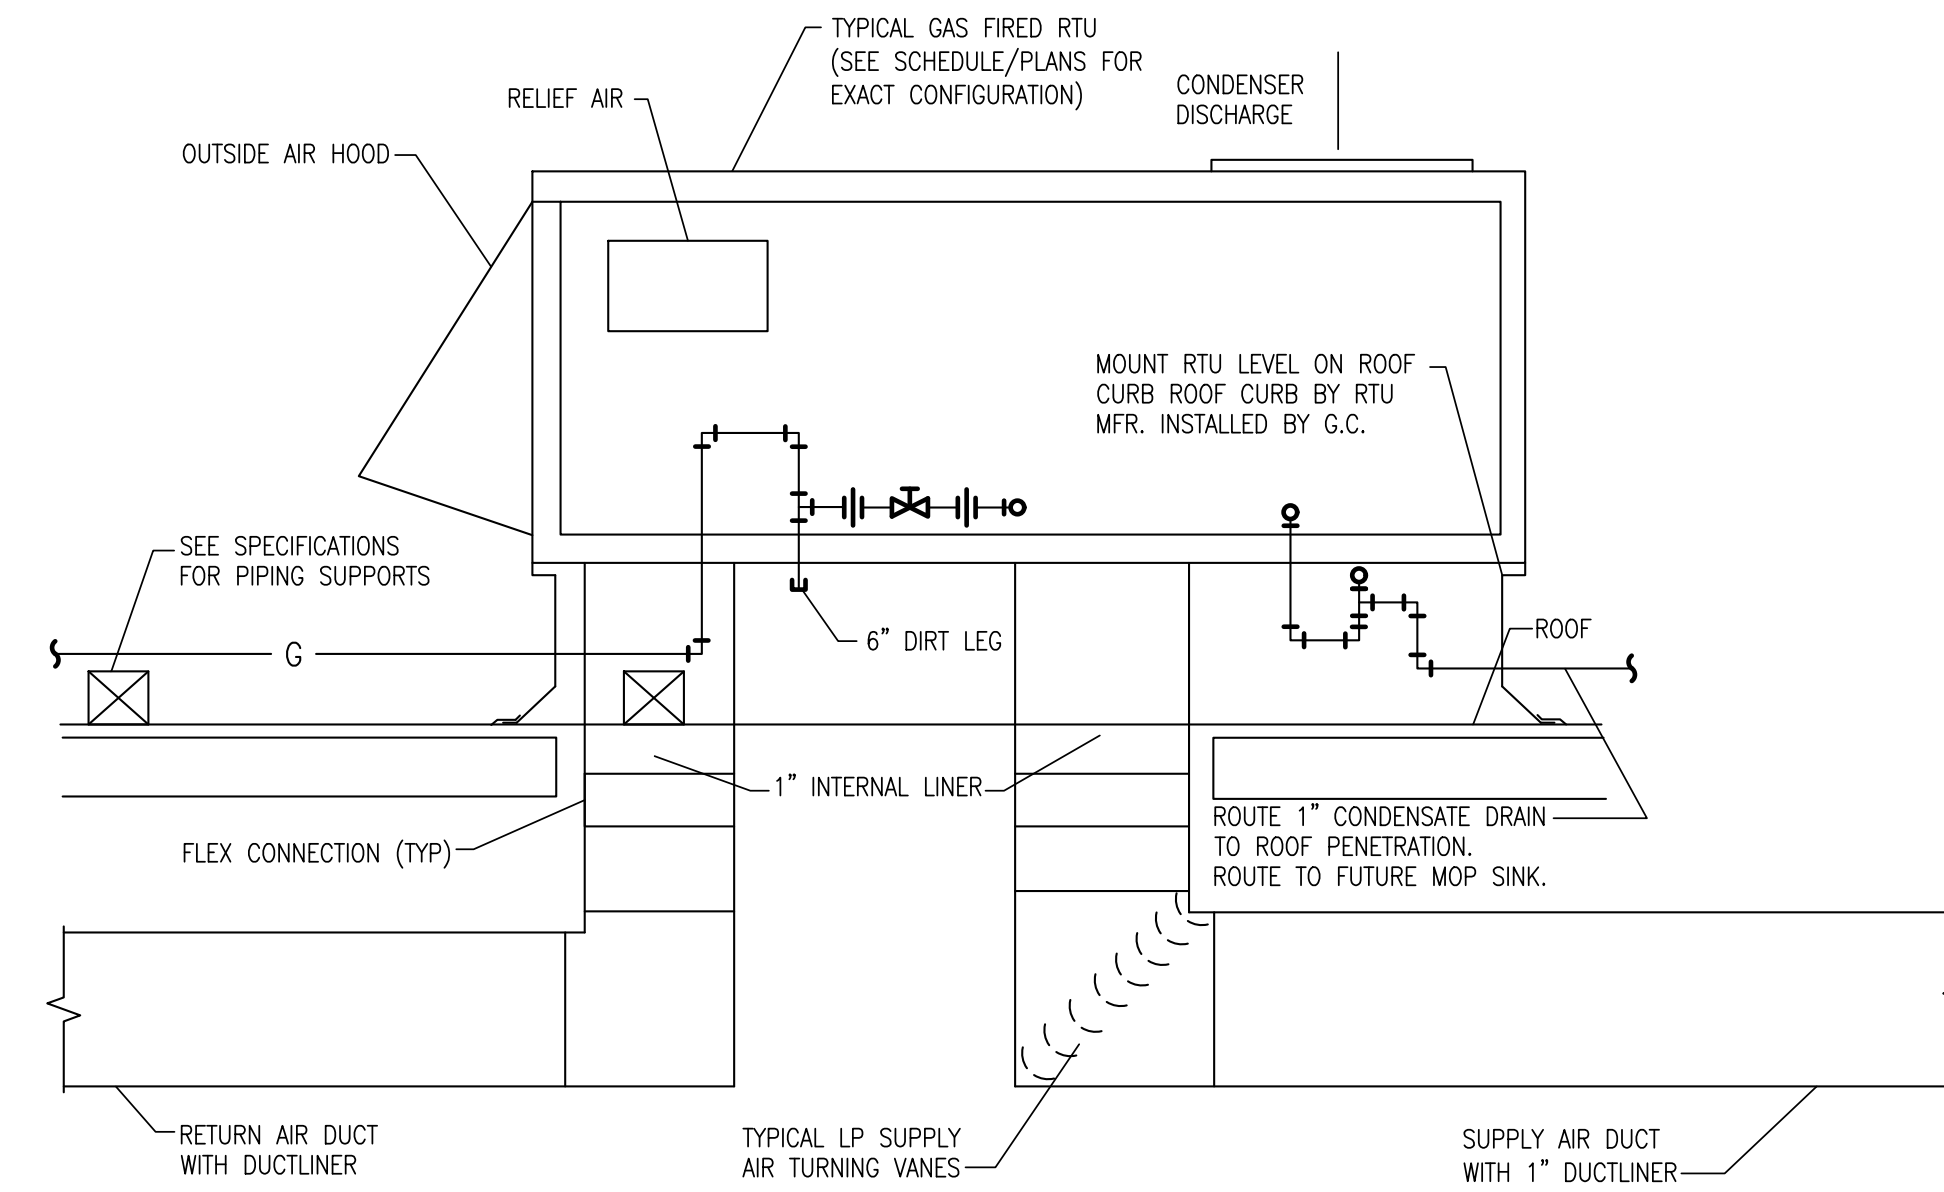

1 TYPICAL ROOF TOP UNIT DETAIL
NOT TO SCALE

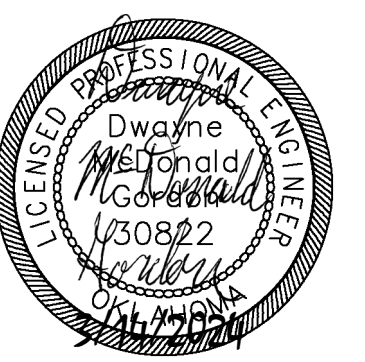

KF
drawn by
DG
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

M502

Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

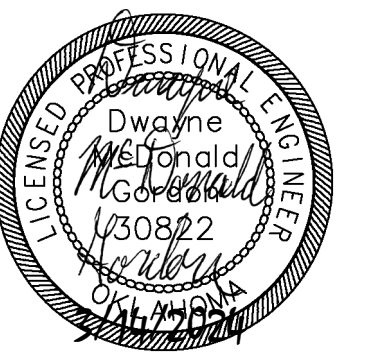

KF

drawn by

DG

checked by

MARCH 2024

date

revisions



sheet no:

M601

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

GRILLE, REGISTER, AND DIFFUSER SCHEDULE							
PLAN SYMBOL	DESCRIPTION	MANUFACTURER & MODEL NO.	MATERIAL	FINISH	NOISE CRITERIA		
CDR-1	SQUARE FACE, ROUND NECK, 4-WAY DEFLECTION CEILING DIFFUSER, SPRING LOCK INNER CORE, FOR LAY-IN CEILING INSTALLATION.	PRICE SCD (4C)	STEEL	WHITE	-		
RG-1	SQUARE PATTERN GRILLE, FIXED CORE OF 1/2"x1/2"x1/2" FABRICATED ALUMINUM SQUARES, FLAT FRAME WITH 1 1/4" MARGIN, FOR LAY-IN CEILING INSTALLATION.	PRICE 80	ALUMINUM	WHITE	-		

NOTES:
SEE PLANS FOR QUANTITY AND SIZES.
M.C. TO FIELD VERIFY CEILING TYPE FOR ALL GRD BEFORE PURCHASING EQUIPMENT. PROVIDE REQUIRED MOUNTING.

DUCTWORK/INSULATION SCHEDULE											
SYSTEM	LOW PRESSURE			MED. PRESS.		HIGH PRESS.		INSULATION			
	MAX. PRES.	SEAL A	SEAL B	MAX. PRES.	SEAL A	MAX. PRES.	SEAL A	INTERNAL THICKNESS	EXTERNAL THICKNESS	NOTES	
SUPPLY AIR WITHIN 10' OF UNIT	2"	X	-	-	-	-	-	YES	1"	NO	-
SUPPLY AIR BEYOND 10' OF UNIT	2"	X	-	-	-	-	-	NO	-	YES	2" FSK
RETURN AIR WITHIN 10' OF UNIT	2"	-	X	-	-	-	-	YES	1"	NO	-
RETURN AIR BEYOND 10' OF UNIT	2"	-	X	-	-	-	-	NO	-	YES	2" FSK
OUTSIDE AIR/MIXED AIR	2"	-	X	-	-	-	-	NO	-	YES	3" FSK
EXHAUST AIR	2"	-	X	-	-	-	-	NO	-	YES	2" FSK

NOTES:
M.C. IS RESPONSIBLE FOR PROVIDING ANY AND ALL NECESSARY DIMENSIONAL, ELECTRICAL, MECHANICAL, AND STRUCTURAL ALTERATIONS NECESSITATED BY PROVIDING ALTERNATE EQUIPMENT.

ROOF HOOD SCHEDULE - BASE DESIGN							
THROAT SIZE DIMENSION (IN)	THROAT AREA (FP)	DAMPER BDD OR MOD	CONSTRUCTION	MANUFACTURER & MODEL NO.	COMMENTS	NOTES	
1 16X16	1.78	MOD	ALUMINUM	GREENHECK FGJ	COLOR BY ARCHITECT	1-3	
2 16X16	1.78	MOD	ALUMINUM	GREENHECK FGJ	COLOR BY ARCHITECT	1-3	
3 16X16	1.78	MOD	ALUMINUM	GREENHECK FGJ	COLOR BY ARCHITECT	1-3	
4 16X16	1.78	MOD	ALUMINUM	GREENHECK FGJ	COLOR BY ARCHITECT	1-3	

NOTES:
M.C. IS RESPONSIBLE FOR PROVIDING ANY AND ALL NECESSARY DIMENSIONAL, ELECTRICAL, MECHANICAL, AND STRUCTURAL ALTERATIONS NECESSITATED BY PROVIDING ALTERNATE EQUIPMENT.
1. M.C. TO PROVIDE ROOF HOOD WITH ALUMINUM BROSSCREEN.
2. M.C. SHALL PROVIDE ROOF CURB CURB INSTALLATION BY G.C.
3. M.C. SHALL PROVIDE LOW VOLTAGE MOTORIZED DAMPER.

PACKAGED ROOFTOP GAS/ELECTRIC UNIT SCHEDULE														
LOCATION	INPUT MBH	OUTPUT MBH	COOLING NOMINAL TONS	MIN EER	CAPACITY STAGES	TOTAL CFM	MIN F.A. CFM	ELEC CHAR	MCA	MOP	ESP (M)	WEIGHT	MANUFACTURER & MODEL NUMBER	NOTES
1 ROOF-SEE PLANS	130	104	10	10.0	2(H)/4(C)	4000	900	208/3	52	60	1	1400	LENNOX LGT120H4E	1-12


NOTES:
M.C. IS RESPONSIBLE FOR PROVIDING ANY AND ALL NECESSARY DIMENSIONAL, ELECTRICAL, MECHANICAL, AND STRUCTURAL ALTERATIONS NECESSARY BY PROVIDING ALTERNATE EQUIPMENT.
1. PROVIDE CONDENSER COIL HAIL GUARD.
2. PROVIDE FACTORY-INSTALLED UNIT DISCONNECT SWITCH.
3. PROVIDE FACTORY-INSTALLED RETURN DUCT SMOKE DETECTOR WITH REMOTE TEST STATION TO BE LOCATED IN OCCUPIED SPACE. INSTALLATION OF REMOTE TEST STATION AND CONNECTION TO FIRE ALARM SYSTEM BY E.C.
4. PROVIDE FACTORY-INSTALLED 120V GFCI CONVENIENCE OUTLET. GFCI POWERED FROM UNIT. RECEPTACLE SHALL BE COMPLIANT WITH NEC 210.6.3.
5. PROVIDE ANTI-SHORT CYCLE TIMER AND LOW AMBIENT CONTROLS.
6. PROVIDE FACTORY ROOF CURB SO THAT THE BOTTOM OF THE ROOFTOP UNIT IS A MINIMUM OF 14" ABOVE FINISHED ROOF. MOUNT LEVEL ON SLOPED ROOF.
7. PROVIDE HINGED AND TOOL-LESS ACCESS DOORS.
8. PROVIDE PHASE MONITOR.
9. PROVIDE FULL ENTHALPY ECONOMIZER WITH POWERED EXHAUST.
10. PROVIDE DIGITAL, WI-FI ACCESSIBLE 7-DAY PROGRAMMABLE THERMOSTAT WITH OCCUPIED/UNOCCUPIED SETTINGS CAPABLE OF CONTROLLING THE H/C STAGES OF SPECIFIED UNIT.
11. PROVIDE UNIT WITH HGRH.
12. MODULATE OUTSIDE AIR BASED ON DEMAND REPORTED BY CO2 SENSOR.

GAS FURNACE SCHEDULE															
TYPE	INPUT MBH	OUTPUT MBH	CFM	MIN FA	EXT. S.P.	HEAT EXCH. MTL	BLOWER				PILOT	VENT	FILTER MERV 8 MIN.	MANUFACTURER & MODEL NO.	NOTES
							SIZE	DRIVE	H.P.	ELEC. CHAR					
1 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
2 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
3 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
4 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
5 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
6 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
7 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
8 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
9 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
10 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
11 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
12 HORZ	66	62	1200	325	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH070XV36B	1-4
13 HORZ	44	42	720	100	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH045V36B	1-4
14 HORZ	44	42	720	100	0.5	ALUMINIZED STL	11X11	DIRECT	0.5	120/1	HOT S	3"	2" TA	LENNOX ML296UH045V36B	1-4

NOTES:
M.C. IS RESPONSIBLE FOR PROVIDING ANY AND ALL NECESSARY DIMENSIONAL, ELECTRICAL, MECHANICAL, AND STRUCTURAL ALTERATIONS NECESSITATED BY PROVIDING ALTERNATE EQUIPMENT.
1. PROVIDE CONCENTRIC VENT. INSTALL PER MANUFACTURER INSTRUCTIONS. MAINTAIN MINIMUM CLEARANCES: 36" BETWEEN VENTS, 10'-0" FROM ANY FRESH AIR INTAKE.
2. PROVIDE CO2 SENSOR. INSTALLATION BY CONTROLS CONTRACTOR. INTERLOCK CO2 SENSOR WITH MOTORIZED DAMPER IN OUTSIDE AIR DUCT.
3. PROVIDE FURNACE WITH 2 STAGE HEATING.
4. DUCT SMOKE DETECTOR AND REMOTE TEST STATION PROVIDED BY AND INSTALLED BY E.C. REMOTE TEST STATION TO BE LOCATED IN OCCUPIED SPACE AND CONNECTION TO FIRE ALARM SYSTEM BY E.C. COORDINATE WITH E.C.

CONDENSING UNIT SCHEDULE														
NOMINAL TONNAGE	ELEC. CHAR	CONDENSING UNIT					EVAPORATOR UNIT					NOTES		
		MCA	MOP	S.E.E.R	WEIGHT (LBS)	MANUFACTURER & MODEL NO.	CFM	MAX S.P.	BLOWER MOTOR	ELEC. CHAR	MCA		MANUFACTURER & MODEL NO.	
1 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
2 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
3 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
4 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
5 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
6 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
7 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
8 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
9 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
10 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
11 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
12 3	208/1	17	30	16	200	LENNOX ML17XC1-036-230	1805	0.3	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-30B-6F	1-7	
13 1.5	208/1	12	15	17	155	LENNOX ML17XC1-018-230	1200	0.5	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-24B-6F	1-7	
14 1.5	208/1	12	15	17	155	LENNOX ML17XC1-018-230	1200	0.5	-	SEE FURNACE SCHEDULE	-	LENNOX CHX35-24B-6F	1-7	

NOTES:
M.C. IS RESPONSIBLE FOR PROVIDING ANY AND ALL NECESSARY DIMENSIONAL, ELECTRICAL, MECHANICAL, AND STRUCTURAL ALTERATIONS NECESSITATED BY PROVIDING ALTERNATE EQUIPMENT.
1. E.C. TO PROVIDE AND INSTALL POWER DISCONNECT FOR UNIT. COORDINATE WITH M.C.
2. M.C. TO INCLUDE PRE-CHARGED LINE KIT. INSULATE SUCTION LINE.
3. TWO STAGE COOLING.
4. FOR LINE LENGTH EXCEEDING 50', M.C. MUST PROVIDE FACTORY DESIGNED AND FACTORY OR FIELD FABRICATED REFRIGERANT PIPING.
5. MOUNT UNITS ON CONDENSING UNIT SUPPORTS RE: 10/M501 FOR MORE INFORMATION.
6. INSULATE SUCTION LINE WITH 5/8" AP ARMAFLEX INSULATION OR EQUAL. SEAL ALL JOINTS WATER TIGHT TO PREVENT CONDENSATE IN THE CEILING.
7. PROVIDE UNIT WITH HAIL GUARD.

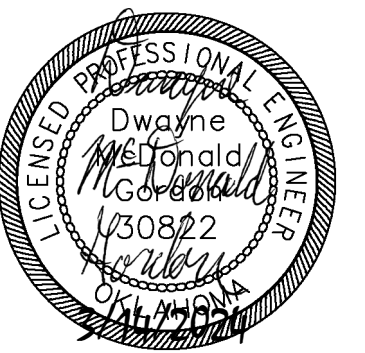

GAS LOAD TABLE					
⊖	INPUT(MBH)	REQUIRED PRESSURE	REQUIRED REGULATOR	SYSTEM PRESSURE	NOTES
F-1	66	7"	-	LOW	1,2,3
F-2	66	7"	-	LOW	1,2,3
F-3	66	7"	-	LOW	1,2,3
F-4	66	7"	-	LOW	1,2,3
F-5	66	7"	-	LOW	1,2,3
F-6	66	7"	-	LOW	1,2,3
F-7	66	7"	-	LOW	1,2,3
F-8	66	7"	-	LOW	1,2,3
F-9	66	7"	-	LOW	1,2,3
F-10	66	7"	-	LOW	1,2,3
F-11	66	7"	-	LOW	1,2,3
F-12	66	7"	-	LOW	1,2,3
F-13	44	7"	-	LOW	1,2,3
F-14	44	7"	-	LOW	1,2,3
RTU-1	130	7"	325-3LB	2 PSI	1,2
(E) WH	199.9	7"	(E) REGULATOR	2 PSI	1
TOTAL LOAD	1,210 MBH				

NOTES:

- INSTALL AND VENT REGULATOR PER MANUFACTURER'S RECOMMENDATIONS.
- COORDINATE WITH MECHANICAL CONTRACTOR FOR EQUIPMENT LOCATIONS AND REQUIRED CONNECTION.
- NEW GAS SYSTEM FOR FURNACES:
 - PROVIDE PRESSURE REGULATOR (2 PSI - 10" W.C.) MAXITROL 325-3LB.
 - GAS PIPING DESIGNED FOR LOW PRESSURE (10" W.C.) WITH PRESSURE DROP OF 3" W.C. AND TOTAL LENGTH OF 300 FEET.


GENERAL PLUMBING NOTES	
1. THESE DRAWINGS SHALL NOT BE SCALED. SEE ARCHITECTURAL/CIVIL DRAWINGS FOR DIMENSIONAL INFORMATION. THIS ENGINEER WILL NOT BE LIABLE FOR MISCALCULATED PRODUCT TAKE-OFFS DUE TO SCALING OF DRAWINGS.	
2. ALL SANITARY PIPING SHALL HAVE A 1/8" PER FOOT SLOPE UNLESS OTHERWISE NOTED. 2" SANITARY OR SMALLER SHALL HAVE A 1/4" PER FOOT SLOPE.	
3. VALVES AND FITTINGS SHALL BE OF SAME SIZE AS THE LINE ON WHICH THEY ARE LOCATED, UNLESS OTHERWISE INDICATED ON DRAWINGS.	
4. CONTRACTOR SHALL COORDINATE ALL WORK WITH OTHER TRADES.	
5. CONTRACTOR SHALL FIELD VERIFY ALL GIVEN MEASUREMENTS PRIOR TO LAYING AND CONNECTING ALL SANITARY AND WASTE PIPING AND NOTIFY ENGINEER OF ANY DISCREPANCIES.	
6. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING FIRE RATING AND WEATHERPROOFING INTEGRITY OF ALL PIPING AND PENETRATIONS.	
7. ALL WATER SUPPLY AND SANITARY LINES SHALL BE RUN AS CLOSE TO PLANS AS POSSIBLE WITH NO CHANGES IN SIZING.	
8. CHANGES IN THE DIRECTION OF SANITARY DRAIN PIPING SHALL NOT BE MADE WITH FITTINGS WHICH WILL CAUSE EXCESSIVE REDUCTION IN THE VELOCITY OF FLOW OR CREATE ANY OTHER ADVERSE EFFECT UNLESS PHYSICALLY IMPOSSIBLE (I.E.: USE OF SANITARY TEE IN A HORIZONTAL CONNECTION, USE OF A DOUBLE SANITARY TEE IN A VERTICAL STACK, IN GENERAL, USE OF SHORT-RADIUS FITTINGS FOR BRANCH TO HOUSE DRAIN OR STACK CONNECTION).	
9. CONTRACTOR SHALL GIVE 48 HOURS HOUR EMERGENCY LOCATE NOTICE TO APPLICABLE UTILITY COMPANY PRIOR TO PERFORMING WORK INVOLVING UTILITIES.	
10. ALL DRAINAGE PIPING SHALL BE MARKED WITH THE SEAL OF APPROVAL OF THE NATIONAL SANITATION FOUNDATION.	
11. ROUTE ALL PIPING CONCEALED ABOVE CEILINGS, WITHIN WALLS, OR IN CHASES. PIPING EXPOSED SHALL BE SLOPED AND PAINTED TO MATCH ARCHITECTURAL FINISHES. PIPING IN MECHANICAL ROOMS MAY BE EXPOSED.	
12. CONTRACTOR SHALL VERIFY INVERT ELEVATIONS OF SEWERS TO WHICH NEW SEWER LINES ARE TO BE CONNECTED BEFORE INSTALLATION OF NEW SEWER LINE.	
13. ALL VENTS THROUGH ROOF SHALL BE MIN. 10'-0" FROM ANY AIR INTAKES.	
14. CONTRACTOR SHALL INSTALL DIELECTRIC UNIONS AT CONNECTIONS OF DISSIMILAR METALS.	
15. CONTRACTOR SHALL ROUGH-IN ALL WASTES AND SUPPLIES TO SPECIAL EQUIPMENT ACCORDING TO MANUFACTURER'S SHOP DRAWINGS AND MAKE FINAL CONNECTIONS. ALL SUPPLIES SHALL BE VALVED. INSTALL VACUUM BREAKERS WHERE REQUIRED BY CODE.	
16. DO NOT PENETRATE WALL FOOTINGS WITH PIPING, COORDINATE WITH GENERAL CONTRACTOR TO DROP FOOTINGS AS REQUIRED TO CLEAR PLUMBING SERVICES WHERE ABSOLUTELY NECESSARY. ALL PIPING PENETRATING A BEARING WALL OR FOOTING MUST BE SLEEVED AND LOCATION APPROVED BY STRUCTURAL ENGINEER. PROVIDE LINK-SEALS IN ALL PENETRATIONS OF EXTERIOR WALLS.	
17. ALL PIPING SHALL BE INSTALLED AS HIGH AS POSSIBLE IN PROVIDED CEILING SPACE.	
18. COORDINATE PIPING INSTALLATION AS TO NOT INTERFERE WITH HVAC EQUIPMENT ACCESS.	
19. ANY ERRORS OR AMBIGUITIES IN THE PLANS AND/OR SPECIFICATIONS THAT ARE DISCOVERED BY THE CONTRACTOR SHALL BE REPORTED TO THE ARCHITECT/ENGINEER BEFORE WORK IS STARTED. OMISSION OF PARTICULAR REFERENCE TO ANY ITEM NECESSARY FOR COMPLETE INSTALLATION AND PROPER OPERATION THEREOF SHALL NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY OF FURNISHING THE SAME AT NO EXTRA COST. THE CONTRACTOR IS RESPONSIBLE FOR REVIEWING ALL CONSTRUCTION DOCUMENTS FOR INFORMATION PRIOR TO BID.	
20. VERIFY WITH ARCHITECT ON ALL EQUIPMENT AND FIXTURES REQUIRING PLUMBING PRIOR TO BID. COORDINATE EXACT LOCATIONS AND CONNECTIONS.	
21. ALL WORK SHALL BE IN COMPLIANCE WITH STATE AND LOCAL CODES.	
22. CONTRACTOR SHALL PAY ALL FEES, PERMITS, LICENSES, ETC. NECESSARY FOR PROPER COMPLETION OF WORK.	
23. INSTALL ALL EQUIPMENT IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.	

PLUMBING PIPING LINETYPES	
LINETYPE	DESCRIPTION
----	DEMOLITION
—G—	GAS
=====	SANITARY ABOVE GRADE
-----	SANITARY BELOW GRADE
=====	STORM ABOVE GRADE
-----	STORM BELOW GRADE
-----	VENT ABOVE GRADE
-----	VENT BELOW GRADE
-----	COLD WATER
-----	COLD WATER BELOW GRADE
-----	HOT WATER
-----	HOT WATER BELOW GRADE
-----	RECIRC WATER
-----	RECIRC WATER BELOW GRADE

PLUMBING PIPING LEGEND	
	CIRCUIT SETTER
	BALL VALVE OR SHUT-OFF VALVE
	SPRING CHECK VALVE
	END CAP
	NEW TO EXISTING PIPE CONNECTION
	FLOW DIRECTION ARROW
	NEW TO EXISTING POINT OF CONNECTION SYMBOL
	PIPE CONNECTION
	HAMMER ARRESTOR (PISTON TYPE)
	HAMMER ARRESTOR (BELLOWS TYPE)
	PIPING LINEWEIGHT: NEW/DEMOLITION
	PIPING LINEWEIGHT: EXISTING

PLUMBING ABBREVIATIONS			
AG	ABOVE GRADE	MAU	MAKE-UP AIR UNIT
ADD	ADDENDUM	MC	MECHANICAL CONTRACTOR
ADDL	ADDITIONAL	MECH	MECHANICAL
ADJ	ADJUSTABLE	MIN	MINIMUM
AFF	ABOVE FINISH FLOOR	NC	NATURAL GAS
AFG	ABOVE FINISH GRADE	NTS	NOT TO SCALE
ALT	ALTERNATE	NPCW	NON POTABLE COLD WATER
BG	BELOW GRADE	ORD	OVERFLOW ROOF DRAIN
CO	CLEANOUT	OS	OPEN SITE
COL	COLUMN	OSD	OVERFLOW STORM DRAIN
CW	COLD WATER	PC	PLUMBING CONTRACTOR
DN	DOWN	PLBG	PLUMBING
DS	DOWNSPOUT	PRES	PRESSURE
EC	ELECTRICAL CONTRACTOR	QTY	QUANTITY
ECO	EXTERIOR CLEANOUT	RD	ROOF DRAIN
EQ	EQUAL	RTU	ROOFTOP UNIT
FCO	FLOOR CLEANOUT	SAN	SANITARY
FD	FLOOR DRAIN	SCH	SCHEDULE
FLR	FLOOR	SD	STORM DRAIN
FS	FLOOR SINK	SPEC	SPECIFICATIONS
FT	FOOT (FEET)	SS	STAINLESS STEEL
F	FURNACE	TEMP	TEMPERATURE
GAL	GALLON	TYP	TYPICAL
GC	GENERAL CONTRACTOR	UR	URNAL
GPM	GALLONS PER MINUTE	V	VENT
GI	GREASE INTERCEPTOR	VTR	VENT THRU ROOF
GW	GREASE WASTE	W/	WITH
HW	HOT WATER	WCO	WALL CLEANOUT
HWR	HOT WATER RETURN	WC	WATER CLOSET

PLUMBING SHEET INDEX	
P000	PLUMBING TITLE SHEET
P100	PLUMBING SITE PLAN
P101	PLUMBING PLAN
P201	PLUMBING PLAN - ROOF
P501	PLUMBING DETAILS

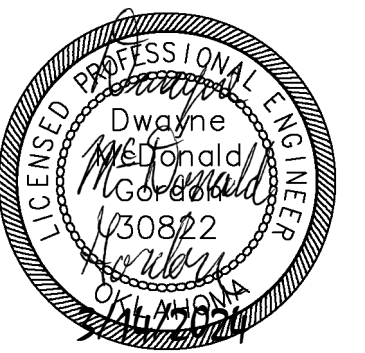

KC	drawn by
KP	checked by
MARCH 2024	date
	revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

P100


OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

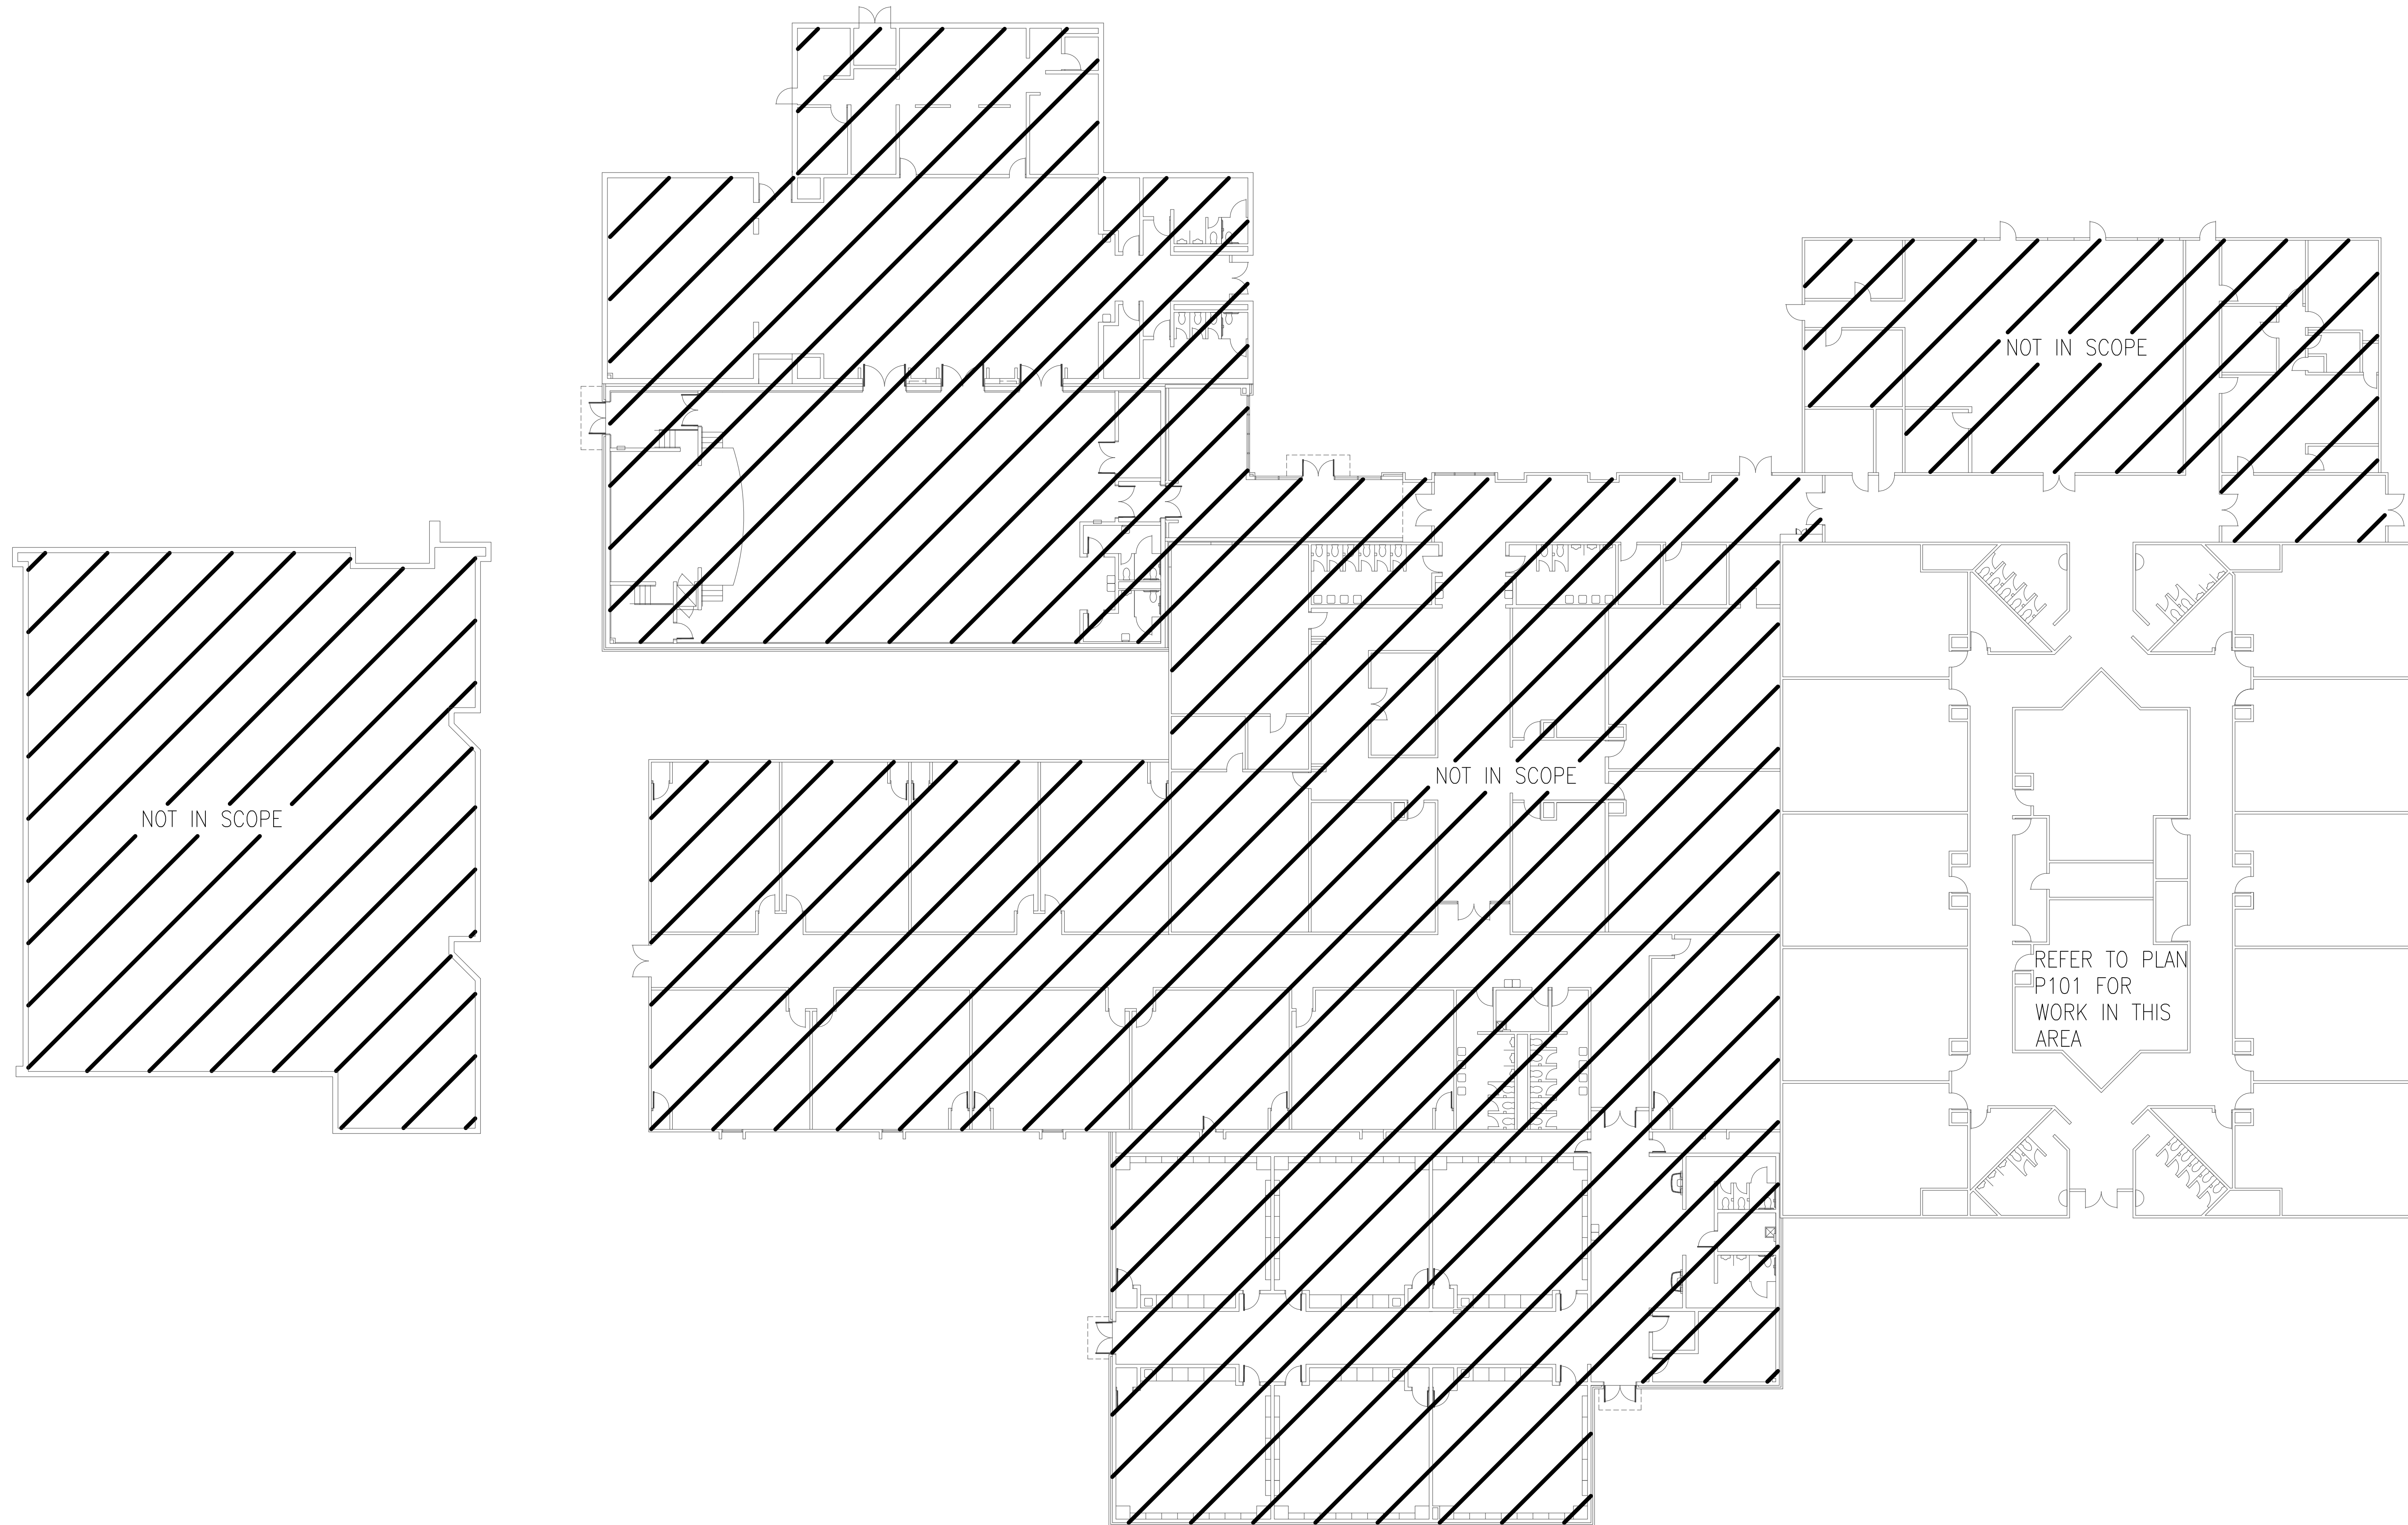

1 PLUMBING PLAN - OVERALL
SCALE: 1/16" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

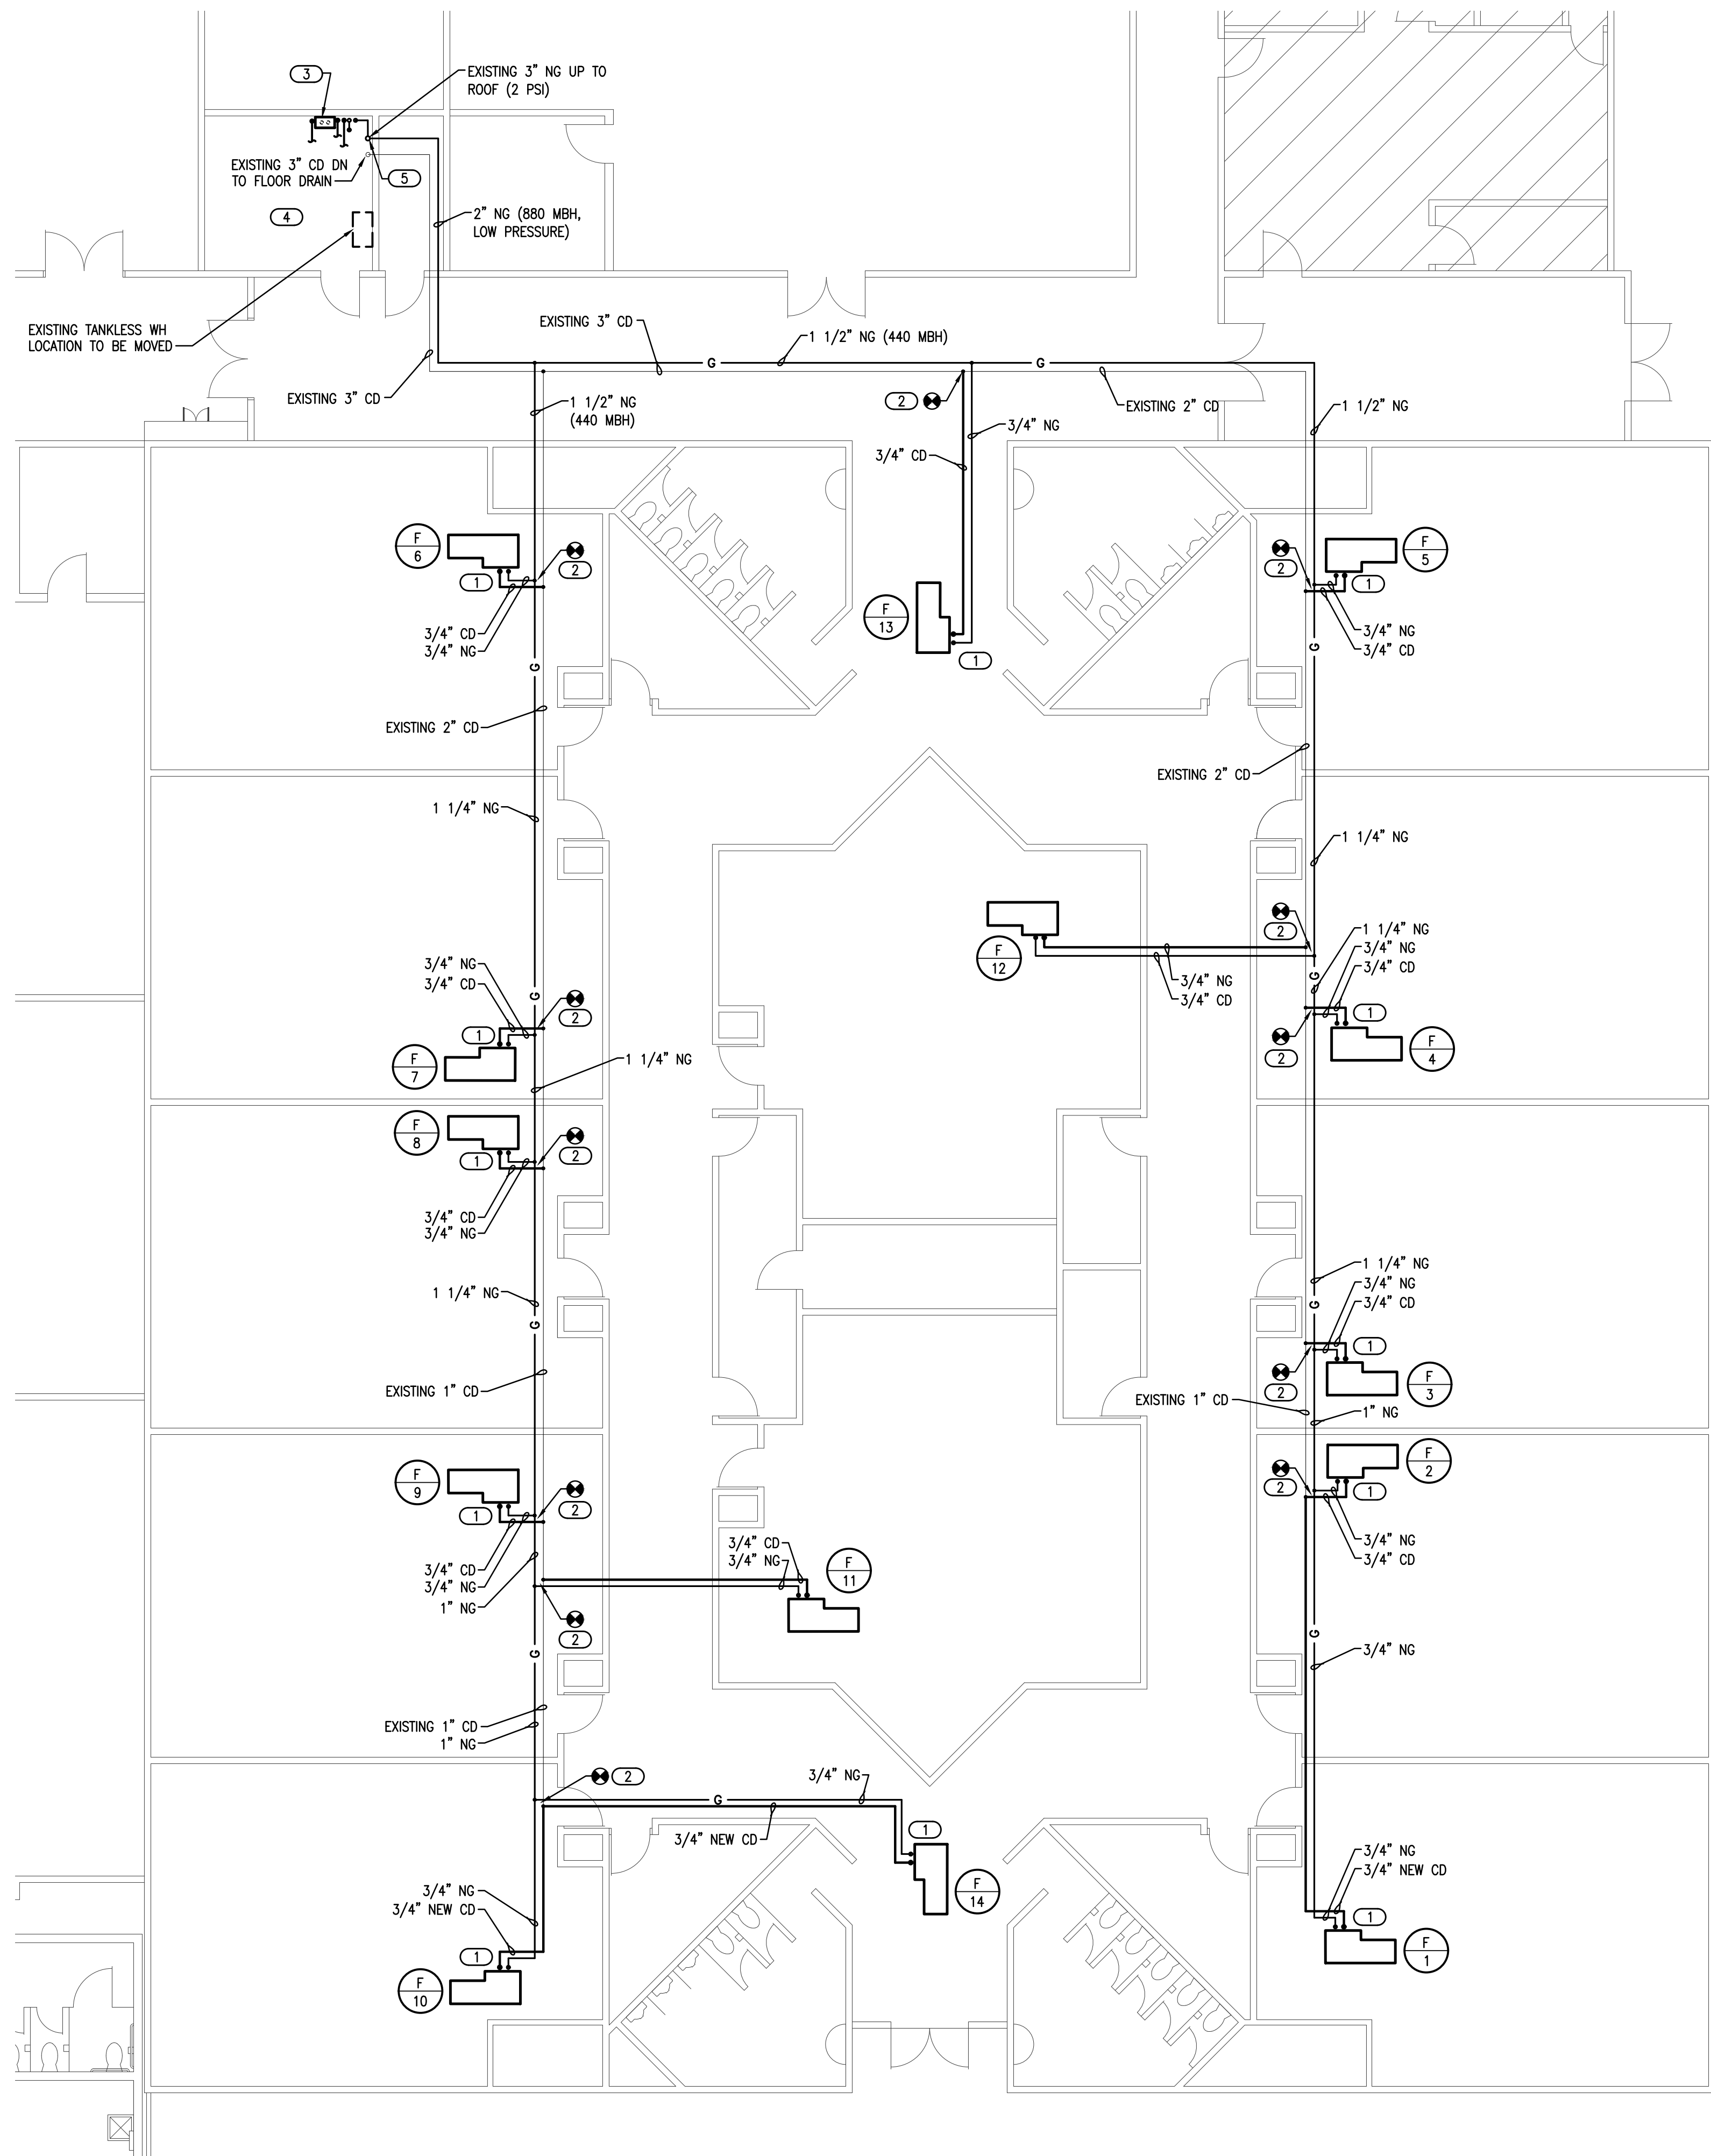

GENERAL NOTES

- COORDINATE WORK WITH ALL OTHER TRADES ON SITE.
- FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.
- SUPPORT PIPING PER LOCAL PLUMBING CODES.


KEYED NOTES

- INSTALL 3/4" NATURAL GAS (LOW PRESSURE). PROVIDE SHUTOFF VALVE, DRIP LEG, PRESSURE REGULATOR (IF REQUIRED) AND UNIT CONNECTION. ROUGH-IN AND COORDINATE FINAL CONNECTION WITH MC. SEE DETAIL 2/PS01.
- CONNECT NEW 3/4" CONDENSATE LINE TO EXISTING CONDENSATE MAIN. FIELD VERIFY EXISTING SIZES AND LOCATIONS.
- REMOVE AND RELOCATE EXISTING GAS FIRED TANKLESS WATER HEATER FROM CURRENT LOCATION TO NEW LOCATION AS INDICATED. PLUMBING CONTRACTOR TO REINSTALL AND ADJUST ALL WATER PIPING, VENT PIPING AND GAS PIPING. RELOCATE PRESSURE REGULATOR ON GAS LINE SERVING WATER HEATER. FIELD VERIFY EXISTING SIZES AND LOCATIONS.
- REMOVE GAS PIPING FROM BOILER UP TO EXISTING 3" GAS RISER BELOW EXISTING BRANCH GAS PIPE SERVING EXISTING WATER HEATER. FIELD VERIFY EXISTING SIZE AND LOCATION.
- CONNECT NEW 1 1/4" NATURAL GAS LINE (2 PSI) TO EXISTING 3" GAS RISER BELOW BRANCH LINE SERVING WATER HEATER. INSTALL PRESSURE REGULATOR (2 PSI - 10" W.C.) MAXITROL 325-3L OR EQUAL. EXTEND 2" NATURAL GAS LINE (LOW PRESSURE) TO SERVE NEW FURNACES.

AGP
the Abila Griffin
Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

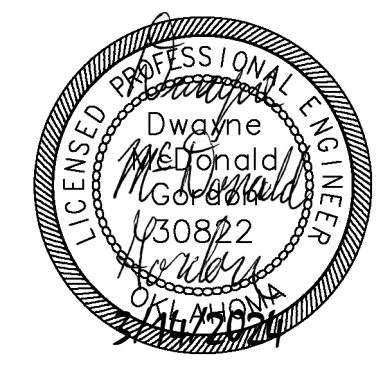

KC
drawn by
KP
checked by
MARCH 2024
date
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL


sheet no:
P101

1 PLUMBING PLAN
SCALE: 1/8" = 1'-0"



Salas O'Brien
2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

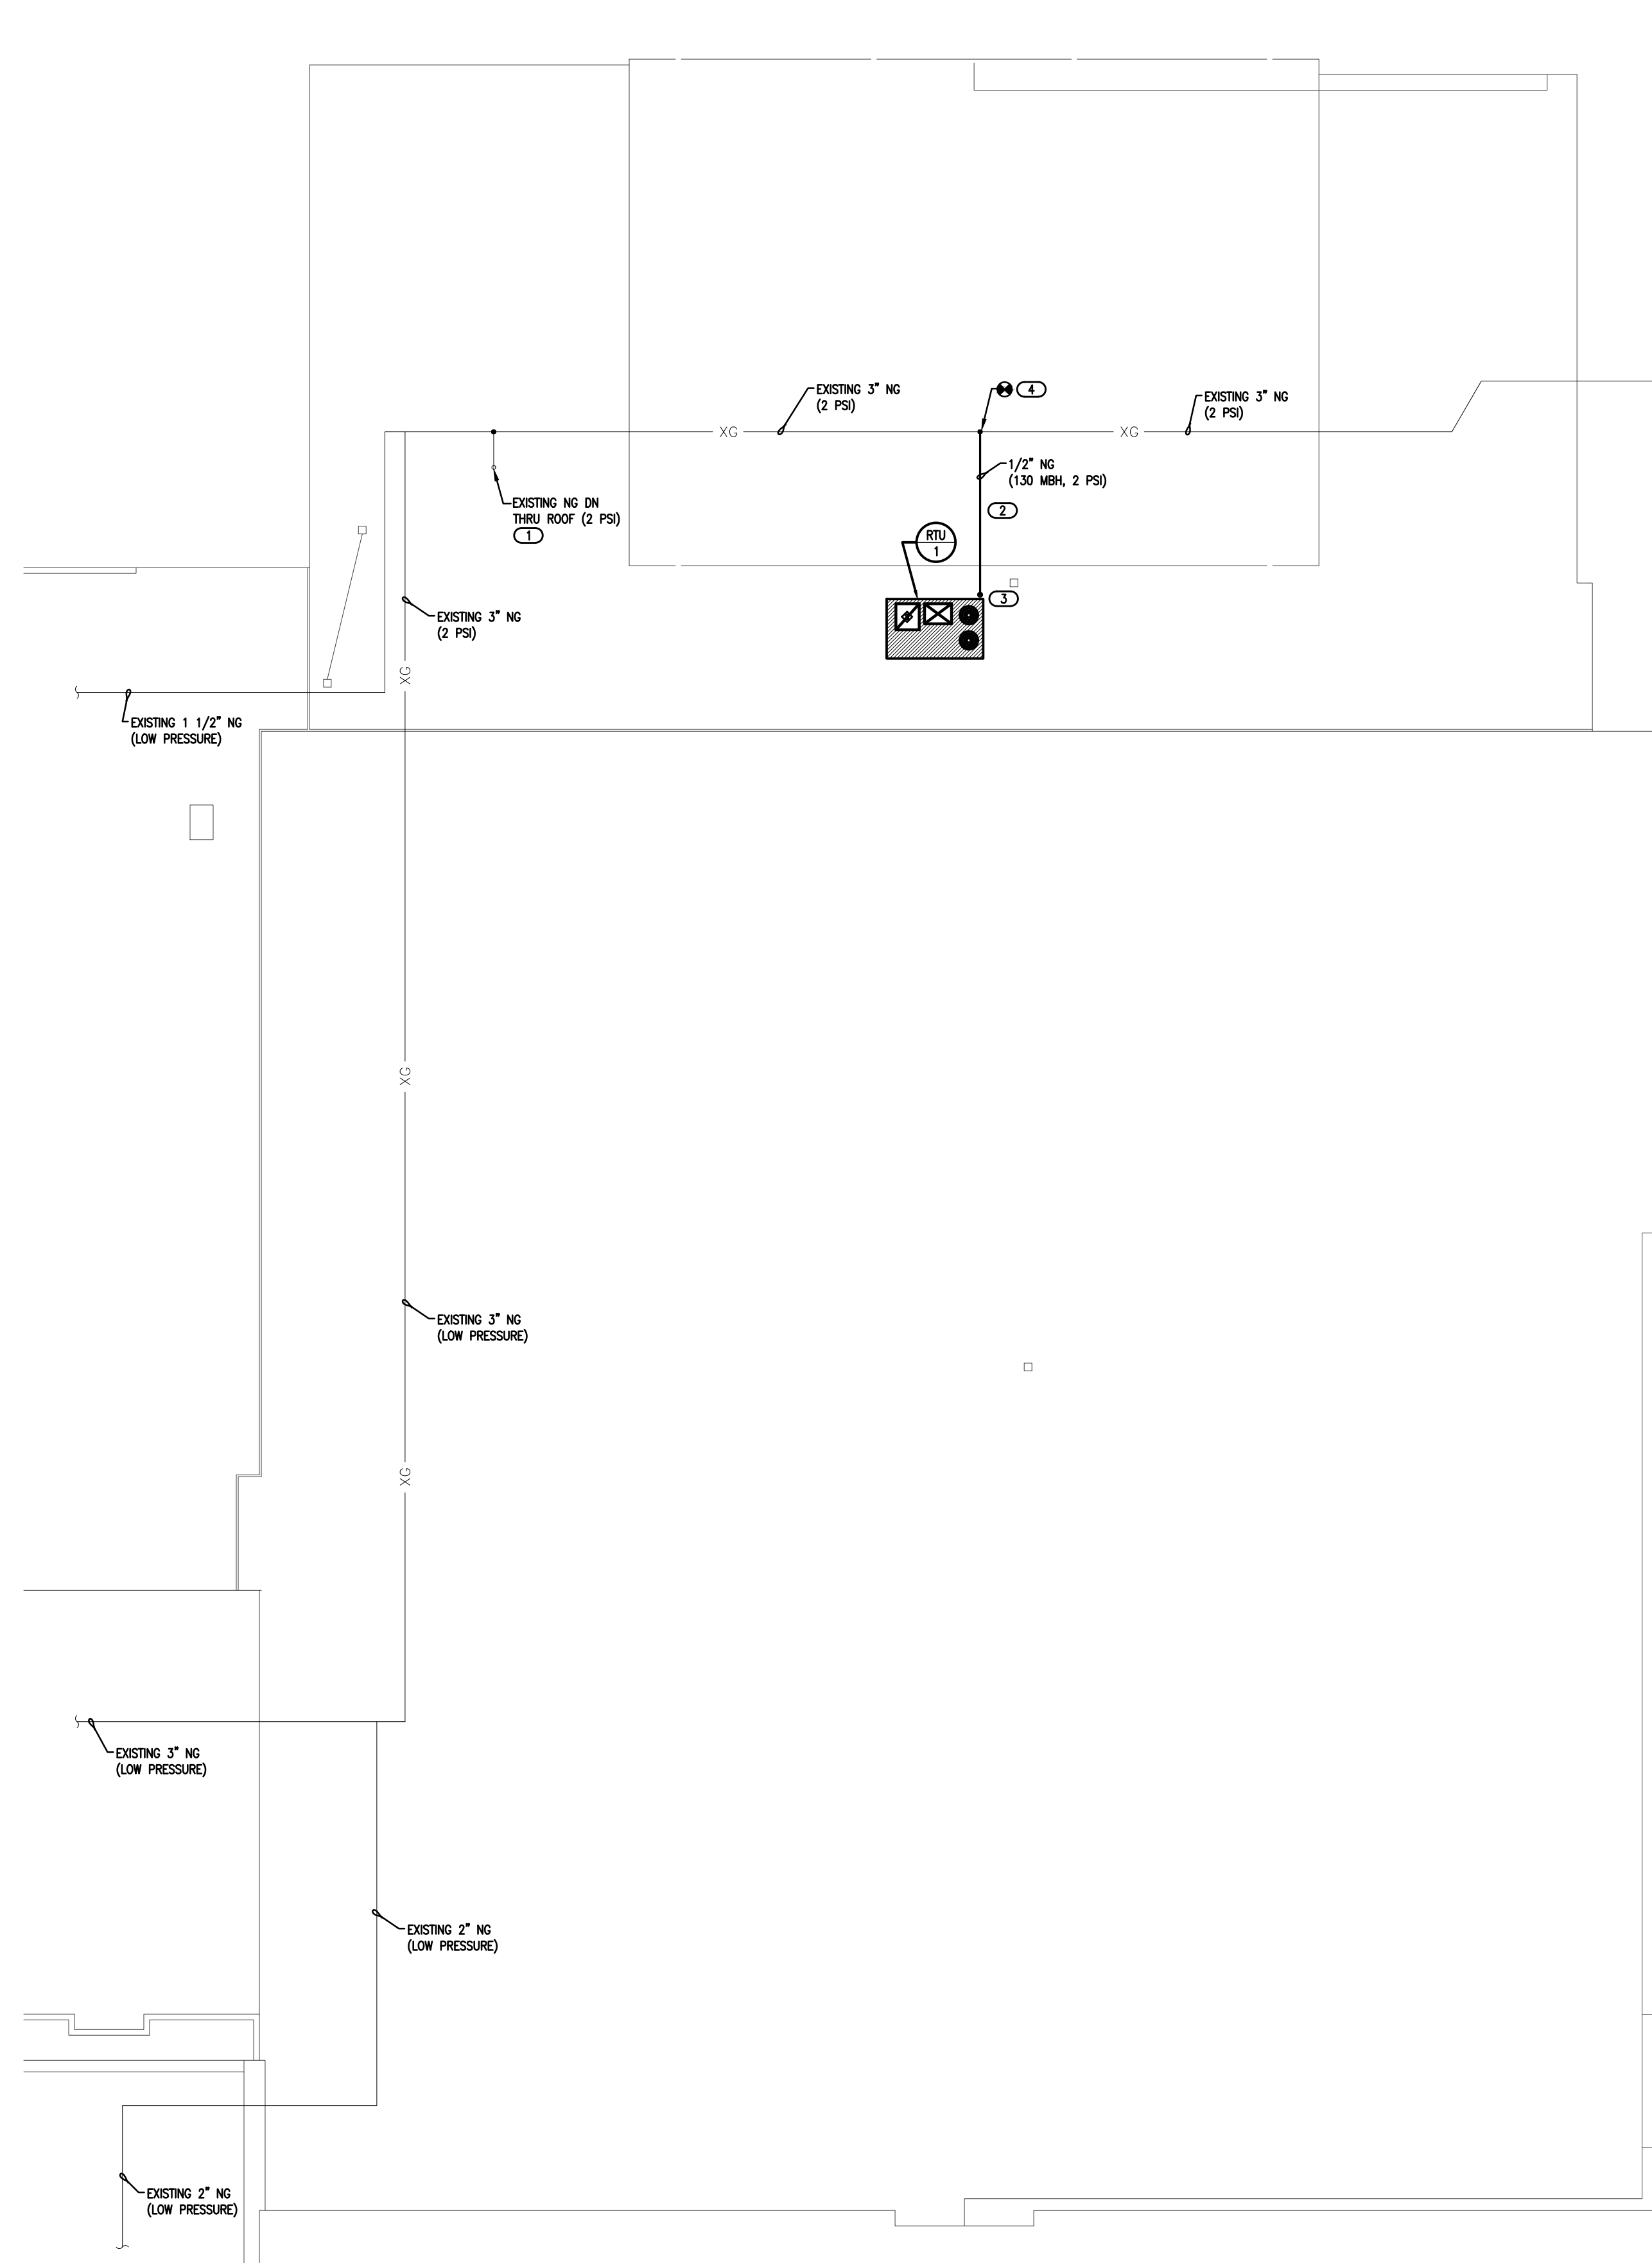

- ### GENERAL NOTES
- COORDINATE WORK WITH ALL TRADES ON SITE.
 - FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.
 - ALL ABOVE GRADE EXTERIOR NATURAL GAS PIPE SHALL BE CLEANED AND DEGREASED PRIOR TO BEING PRIMED THEN PAINTED YELLOW WITH WEATHER RESISTANT ZINC RICH PAINT.
 - PIPE IDENTIFICATION SHALL BE THE WORD "NATURAL GAS" IN BLACK LETTERS AT 5 FT INTERVALS USING PLASTIC PIPE MARKERS OR STENCILED PAINTED LETTERS.
 - ALL GAS PIPE SHALL COMPLY WITH IFGC. BRANCH LINES SHALL TAP OFF TOP OF GAS MAINS AND INSTALL SHUT-OFF VALVE ON BRANCH LINE.
 - MAINTAIN MINIMUM OF 10'-0" CLEAR BETWEEN EXHAUST AND INTAKE VENTS WITH MECHANICAL EQUIPMENT AND OTHER ROOF OPENINGS.


- ### KEYED NOTES
- EXISTING NATURAL GAS LINE (2 PSI) DOWN THRU ROOF. PROVIDE NEW BOOT JACK AT ROOF PENETRATION AND SEAL WATERTIGHT. COORDINATE INSTALLATION WITH ROOFING CONTRACTOR. SEE PLAN P101 FOR CONTINUATION.
 - ROUTE NATURAL GAS LINE (LOW PRESSURE) ON ROOF. PROVIDE MIRO INDUSTRIES MODEL 3-704H-7 ROOF TOP SUPPORTS OR APPROVED EQUAL. INSTALL AT MAXIMUM OF 10'-0" APART (CENTER TO CENTER) ON ALL 1/4" NATURAL GAS PIPING OR LARGER. INSTALL AT 8'-0" APART ON 1" OR 3/4" NATURAL GAS PIPING. INSTALL AT 6'-0" APART ON 1/2" NATURAL GAS PIPING. REFER TO GENERAL NOTES FOR PAINTING GAS LINE. SEE DETAIL 1/P501 FOR PIPE SUPPORT DETAIL.
 - INSTALL NATURAL GAS (2 PSI) LINE TO ROOFTOP UNIT. PROVIDE SHUTOFF VALVE, PRESSURE REGULATOR, DRIP LEG AND FINAL UNIT CONNECTION. ROUGH-IN AND COORDINATE FINAL CONNECTION WITH MC. SEE DETAIL 3/P501.
 - CONNECT NEW 1/2" NATURAL GAS LINE INTO TOP OF EXISTING NATURAL GAS LINE.

AGP

the Abla Griffin Partnership L.L.C.

201 N. BROADWAY
SUITE 210
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

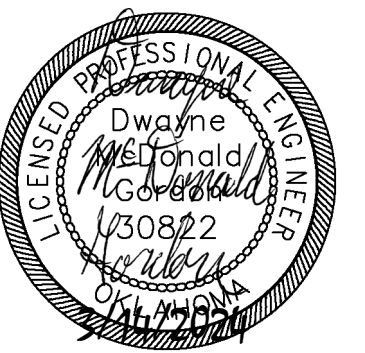

KC
drawn by

KP
checked by

MARCH 2024
date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

P201

1 PLUMBING PLAN - ROOF

SCALE: 3/32" = 1'-0"




Salas O'Brien


2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.

- NOTES:**
1. INSTALL PRESSURE REGULATOR PER MANUFACTURERS RECOMMENDATIONS. PROVIDE GAS REGULATOR VENT PROTECTOR. REFER TO GAS LOAD TABLE FOR REGULATOR SIZE.
 2. PROVIDE ROOF PIPE SUPPORTS FOR NATURAL GAS PIPING.
 3. PIPING ABOVE GRADE SHALL BE SCHEDULE 40 BLACK IRON. REFER TO SPECIFICATIONS FOR PAINTING PIPING YELLOW.
 4. COORDINATE FINAL CONNECTION TO UNIT WITH MC.


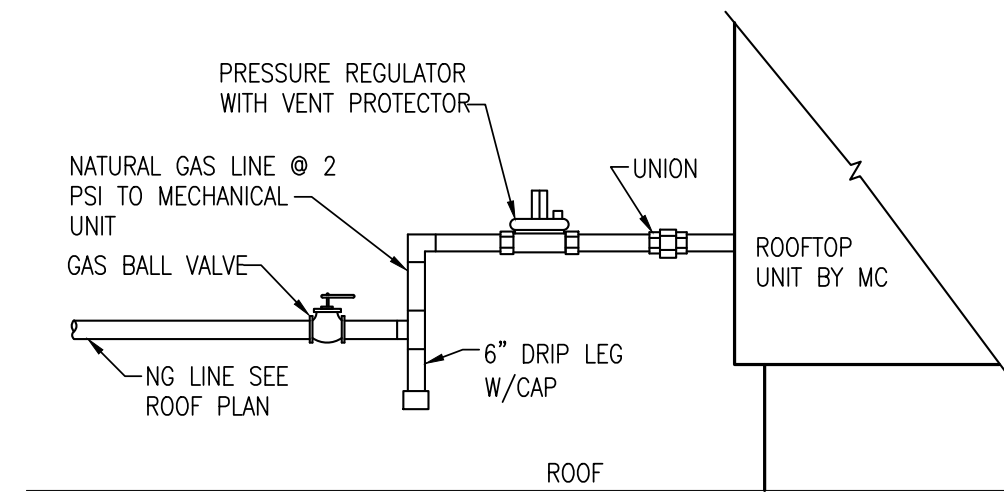


3 ROOFTOP UNIT GAS CONNECTION DETAIL
NOT TO SCALE

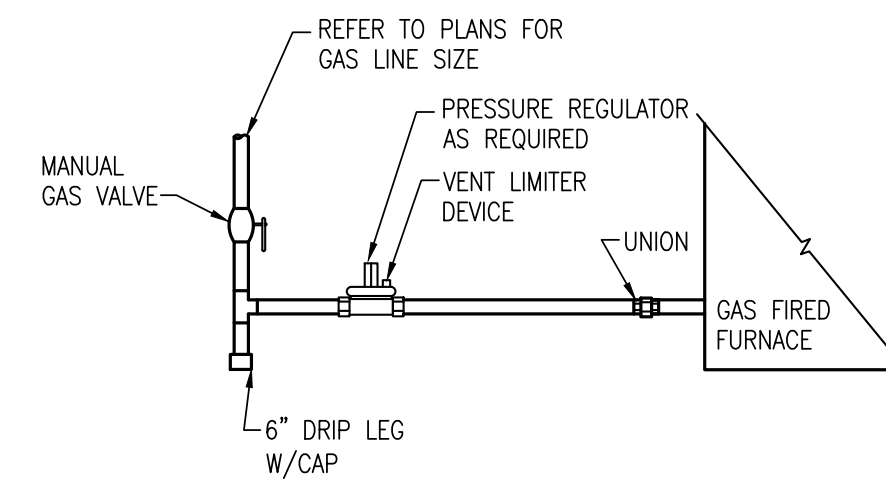

- NOTES:**
1. VENT GAS REGULATOR RELIEF TO ATMOSPHERE OR PROVIDE APPROVED VENT LIMITING DEVICE AS REQUIRED.
 2. COORDINATE FINAL CONNECTION TO UNIT WITH MC.

2 FURNACE GAS CONNECTION DETAIL
NOT TO SCALE

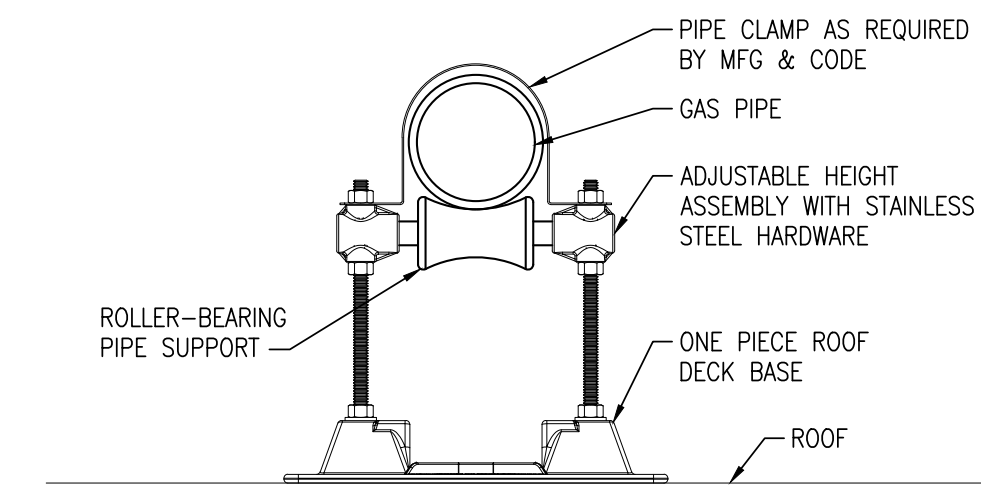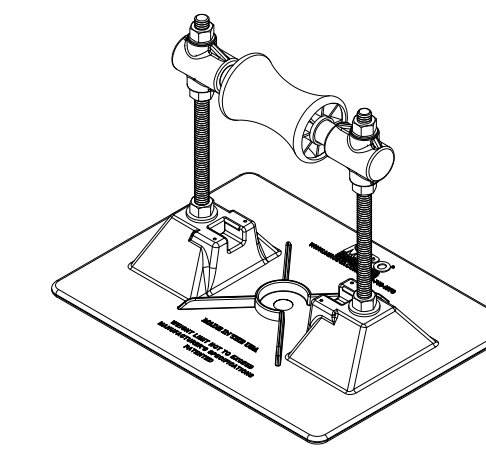

1 ROOF PIPE SUPPORT DETAIL
NOT TO SCALE



KC
drawn by

KP
checked by

MARCH 2024
date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

P501

Salas O'Brien

2600 Van Buren St., Suite 2635
Norman, OK 73072
Salas O'Brien Registration: CA# 7058
Expiration Date: 6/30/2025
Salas O'Brien Project Number: 2024-01144-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.



3/14/24

CG
drawn by
MA
checked by
MARCUS 2024
0808
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA





HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL


Sheet No.

A101

OWNERSHIP USE OF DOCUMENTS:


AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED BY AGP.
REPRODUCTION OR TRANSMISSION
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

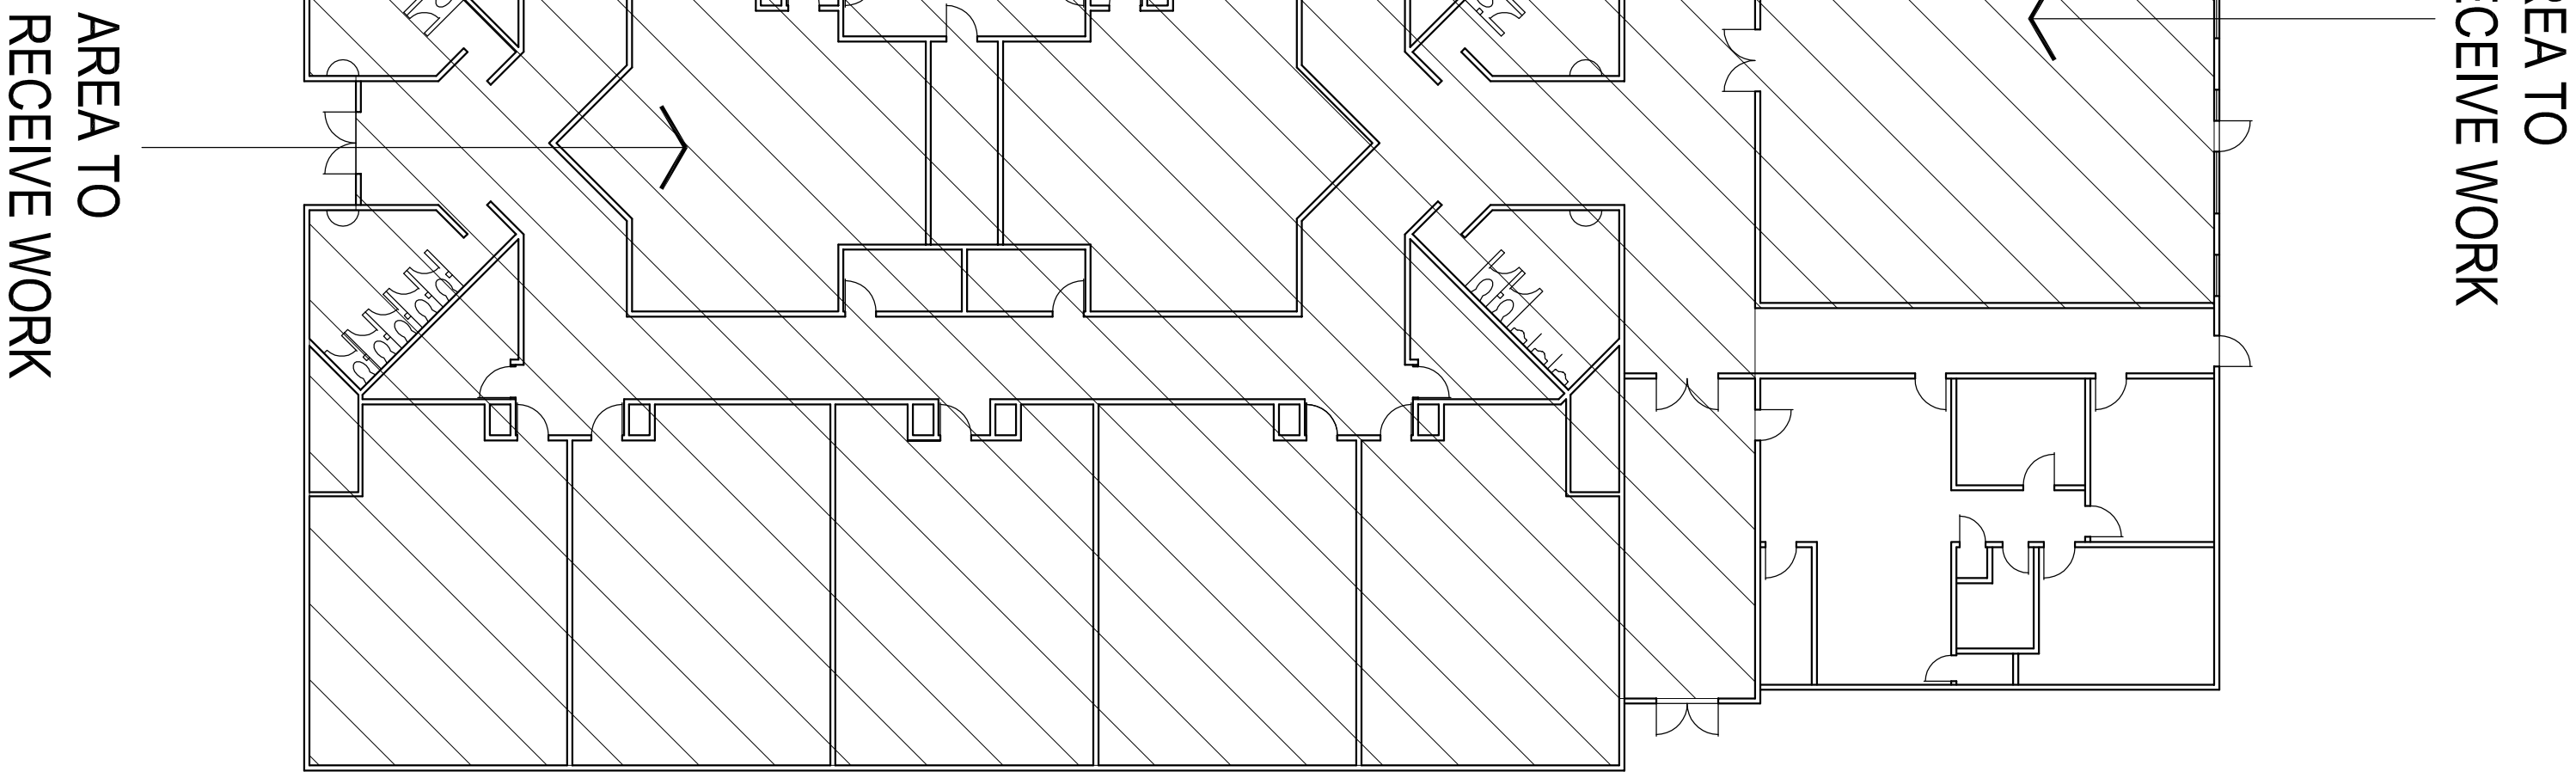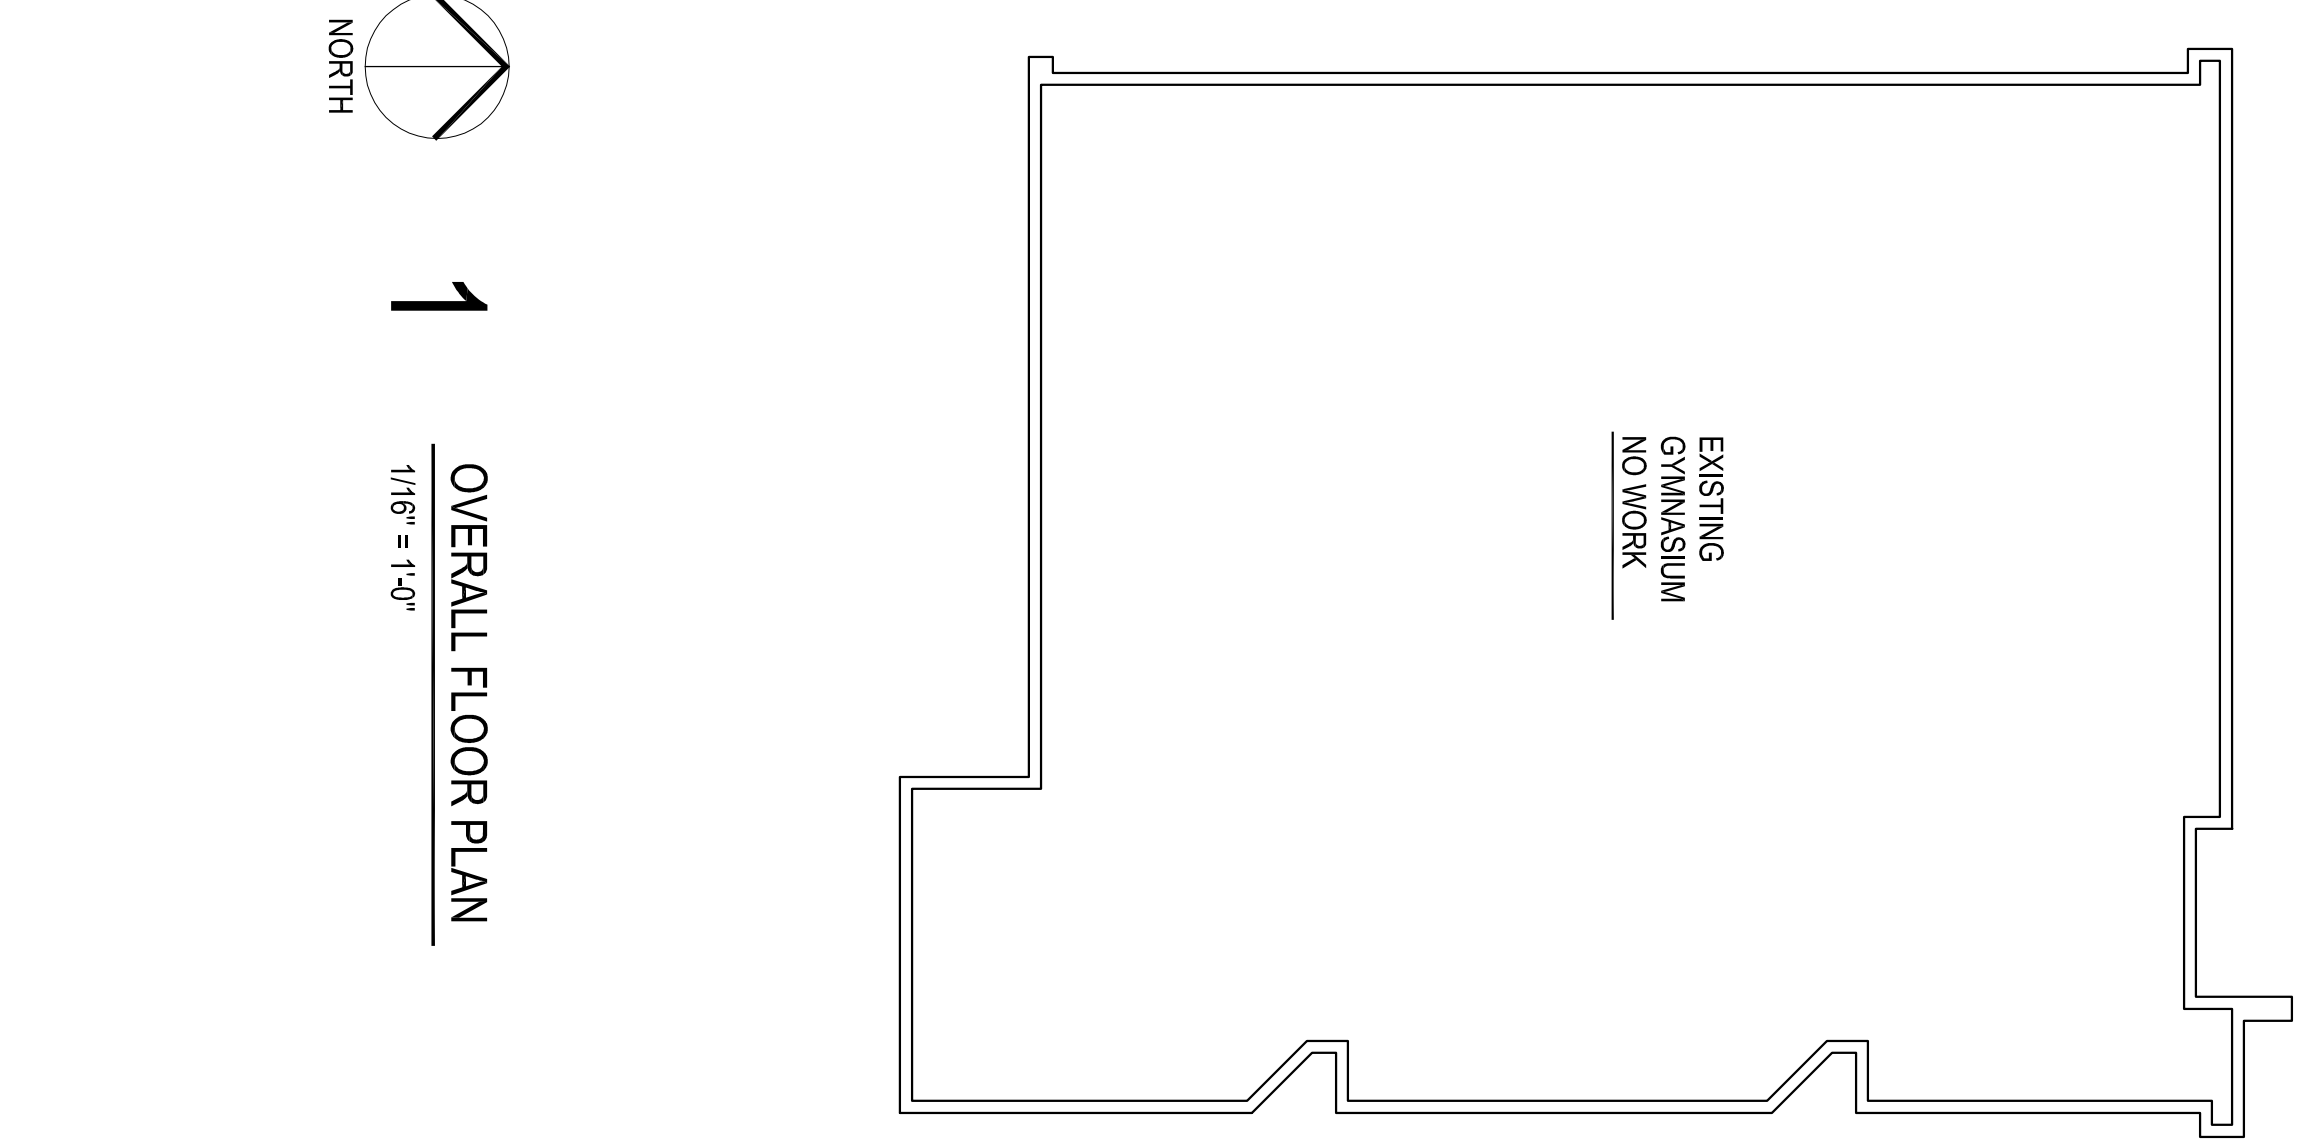

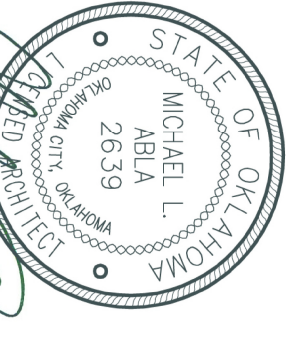


3/14/24


CG
designed by
MA
checked by
MRCOJ 2024
0408
revisions

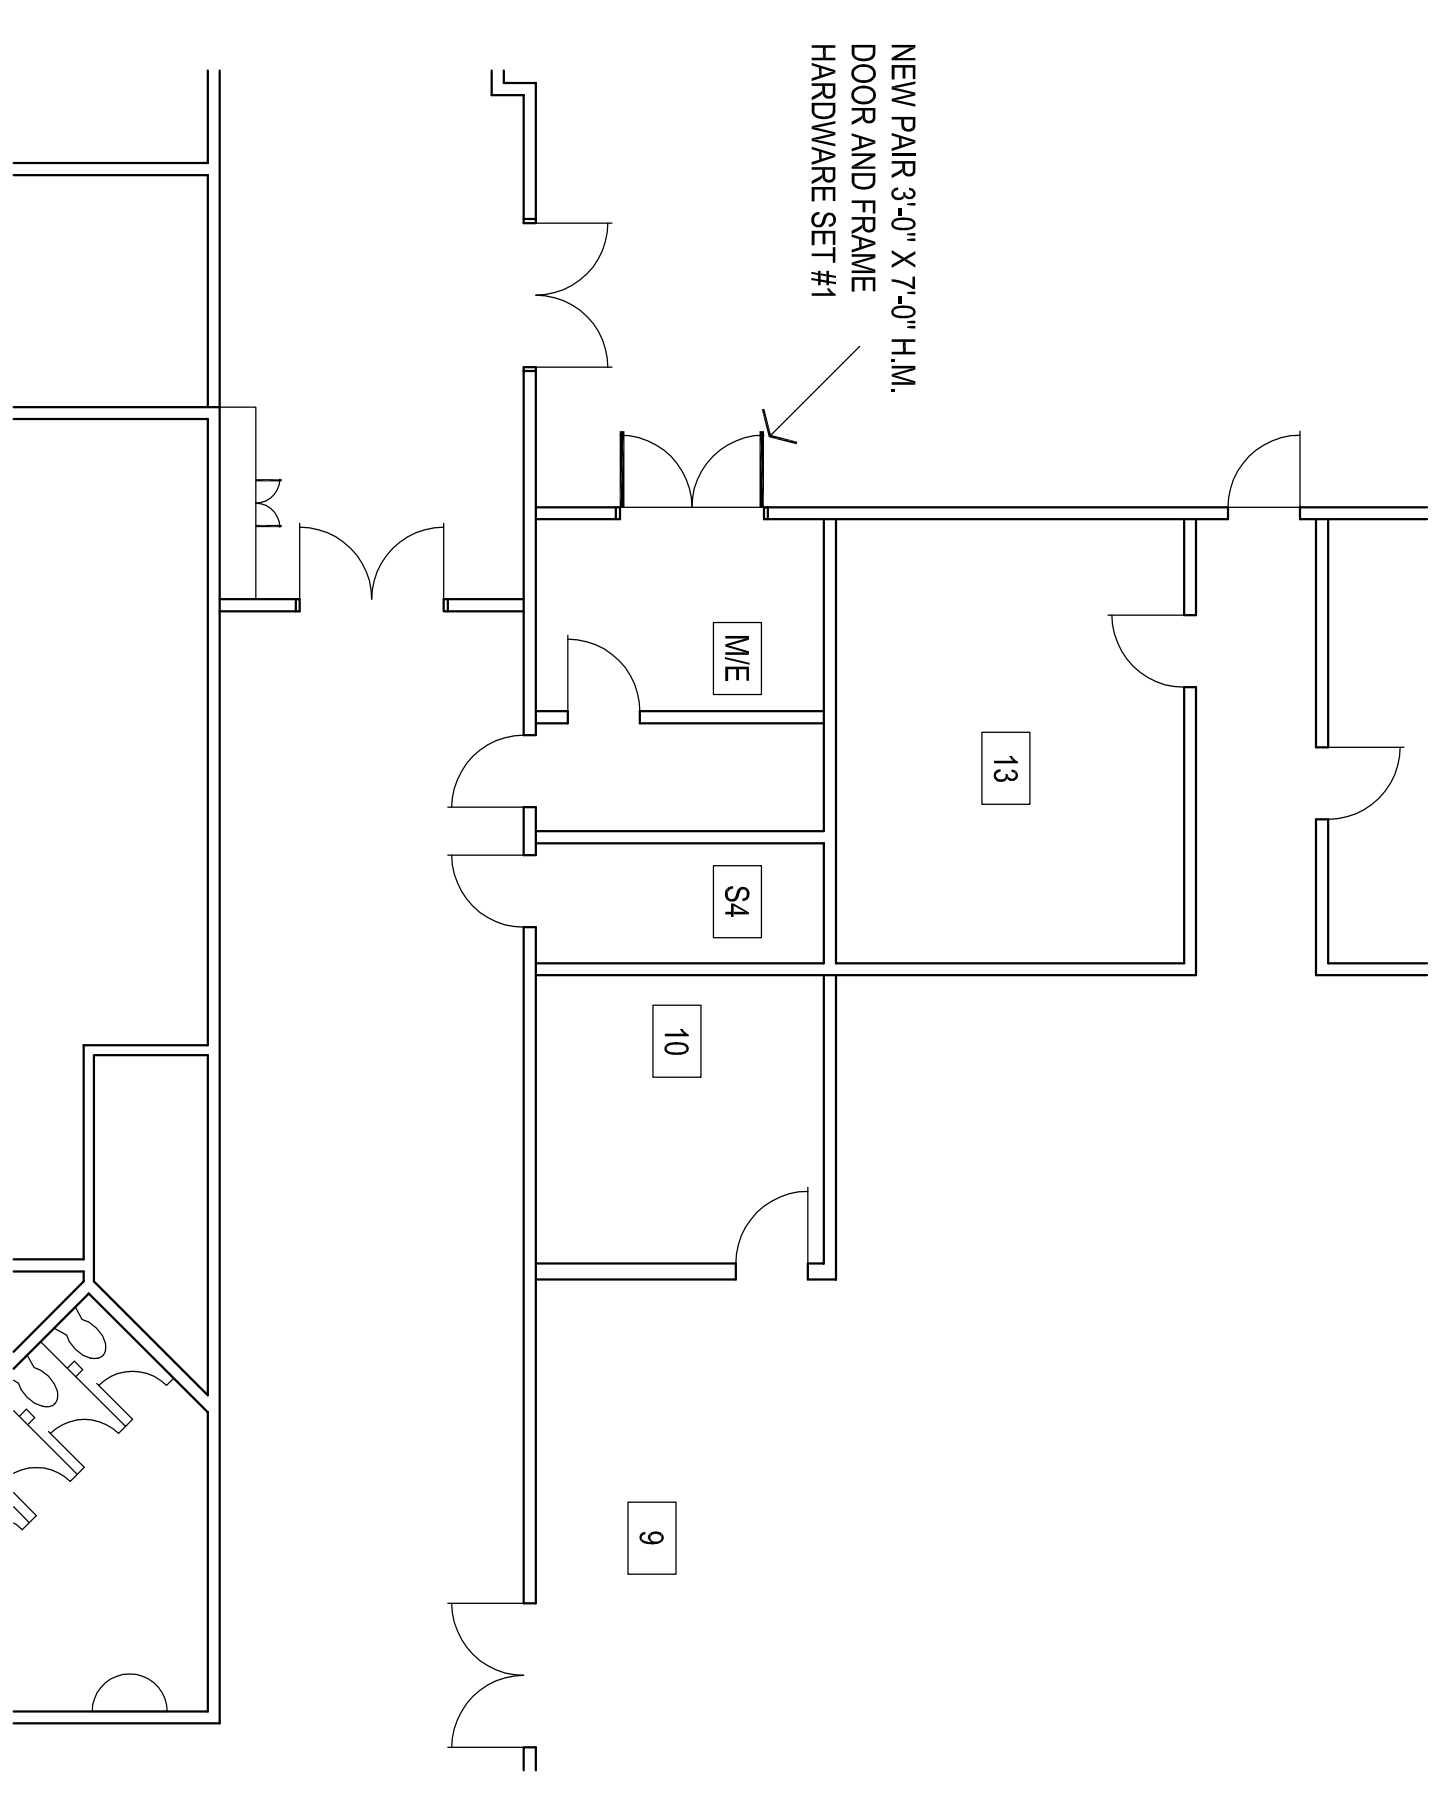


2 MECHANICAL ROOM PLAN
1/8" = 1'-0"




- GENERAL NOTES:**
- UNLESS NOTED OTHERWISE ALL ROOMS TO RECEIVE NEW 2x2 LAY-IN CEILING
 - @ WORK AREA - REINSTALL ALL EXISTING ELECTRICAL (EXCLUDING EXISTING LIGHT FIXTURES), SPEAKERS, FIRE PROTECTION, ETC. PROVIDE ALL MATERIALS NECESSARY FOR A COMPLETE INSTALLATION
 - REMOVE EXISTING LIGHT FIXTURES AS REQUIRED BY CODE. RE: ELECTRICAL FOR NEW LIGHT FIXTURE INFORMATION
 - REMOVE EXISTING MECHANICAL DEVICES AS REQUIRED BY CODE. RE: MECHANICAL FOR NEW DEVICES.
 - REFER PLUMBING AND MECHANICAL SHEETS FOR ROOF PENETRATION LOCATIONS. PROVIDE ALL ROOFING MATERIALS REQUIRED TO MEET MFR. REQUIREMENTS FOR WARRANTY. PROVIDE WATER TIGHT INSTALLATION. CONTRACTOR TO MOVE FURNITURE AS NECESSARY FOR INTERIOR HVAC AND CEILING WORK.
 - PROTECT EXISTING SMARTBOARDS AS DIRECTED BY WPS PERSONNEL. REPLACE ALL DAMAGED DEVICES.
 - CONTRACTOR SHALL THOROUGHLY CLEAN EXISTING AFFECTED AREAS AFTER COMPLETION OF WORK.
 - REMOVE EXISTING H.M. DOOR AND FRAME AND PREPARE OPENING TO RECEIVE NEW H.M. DOOR AND FRAME

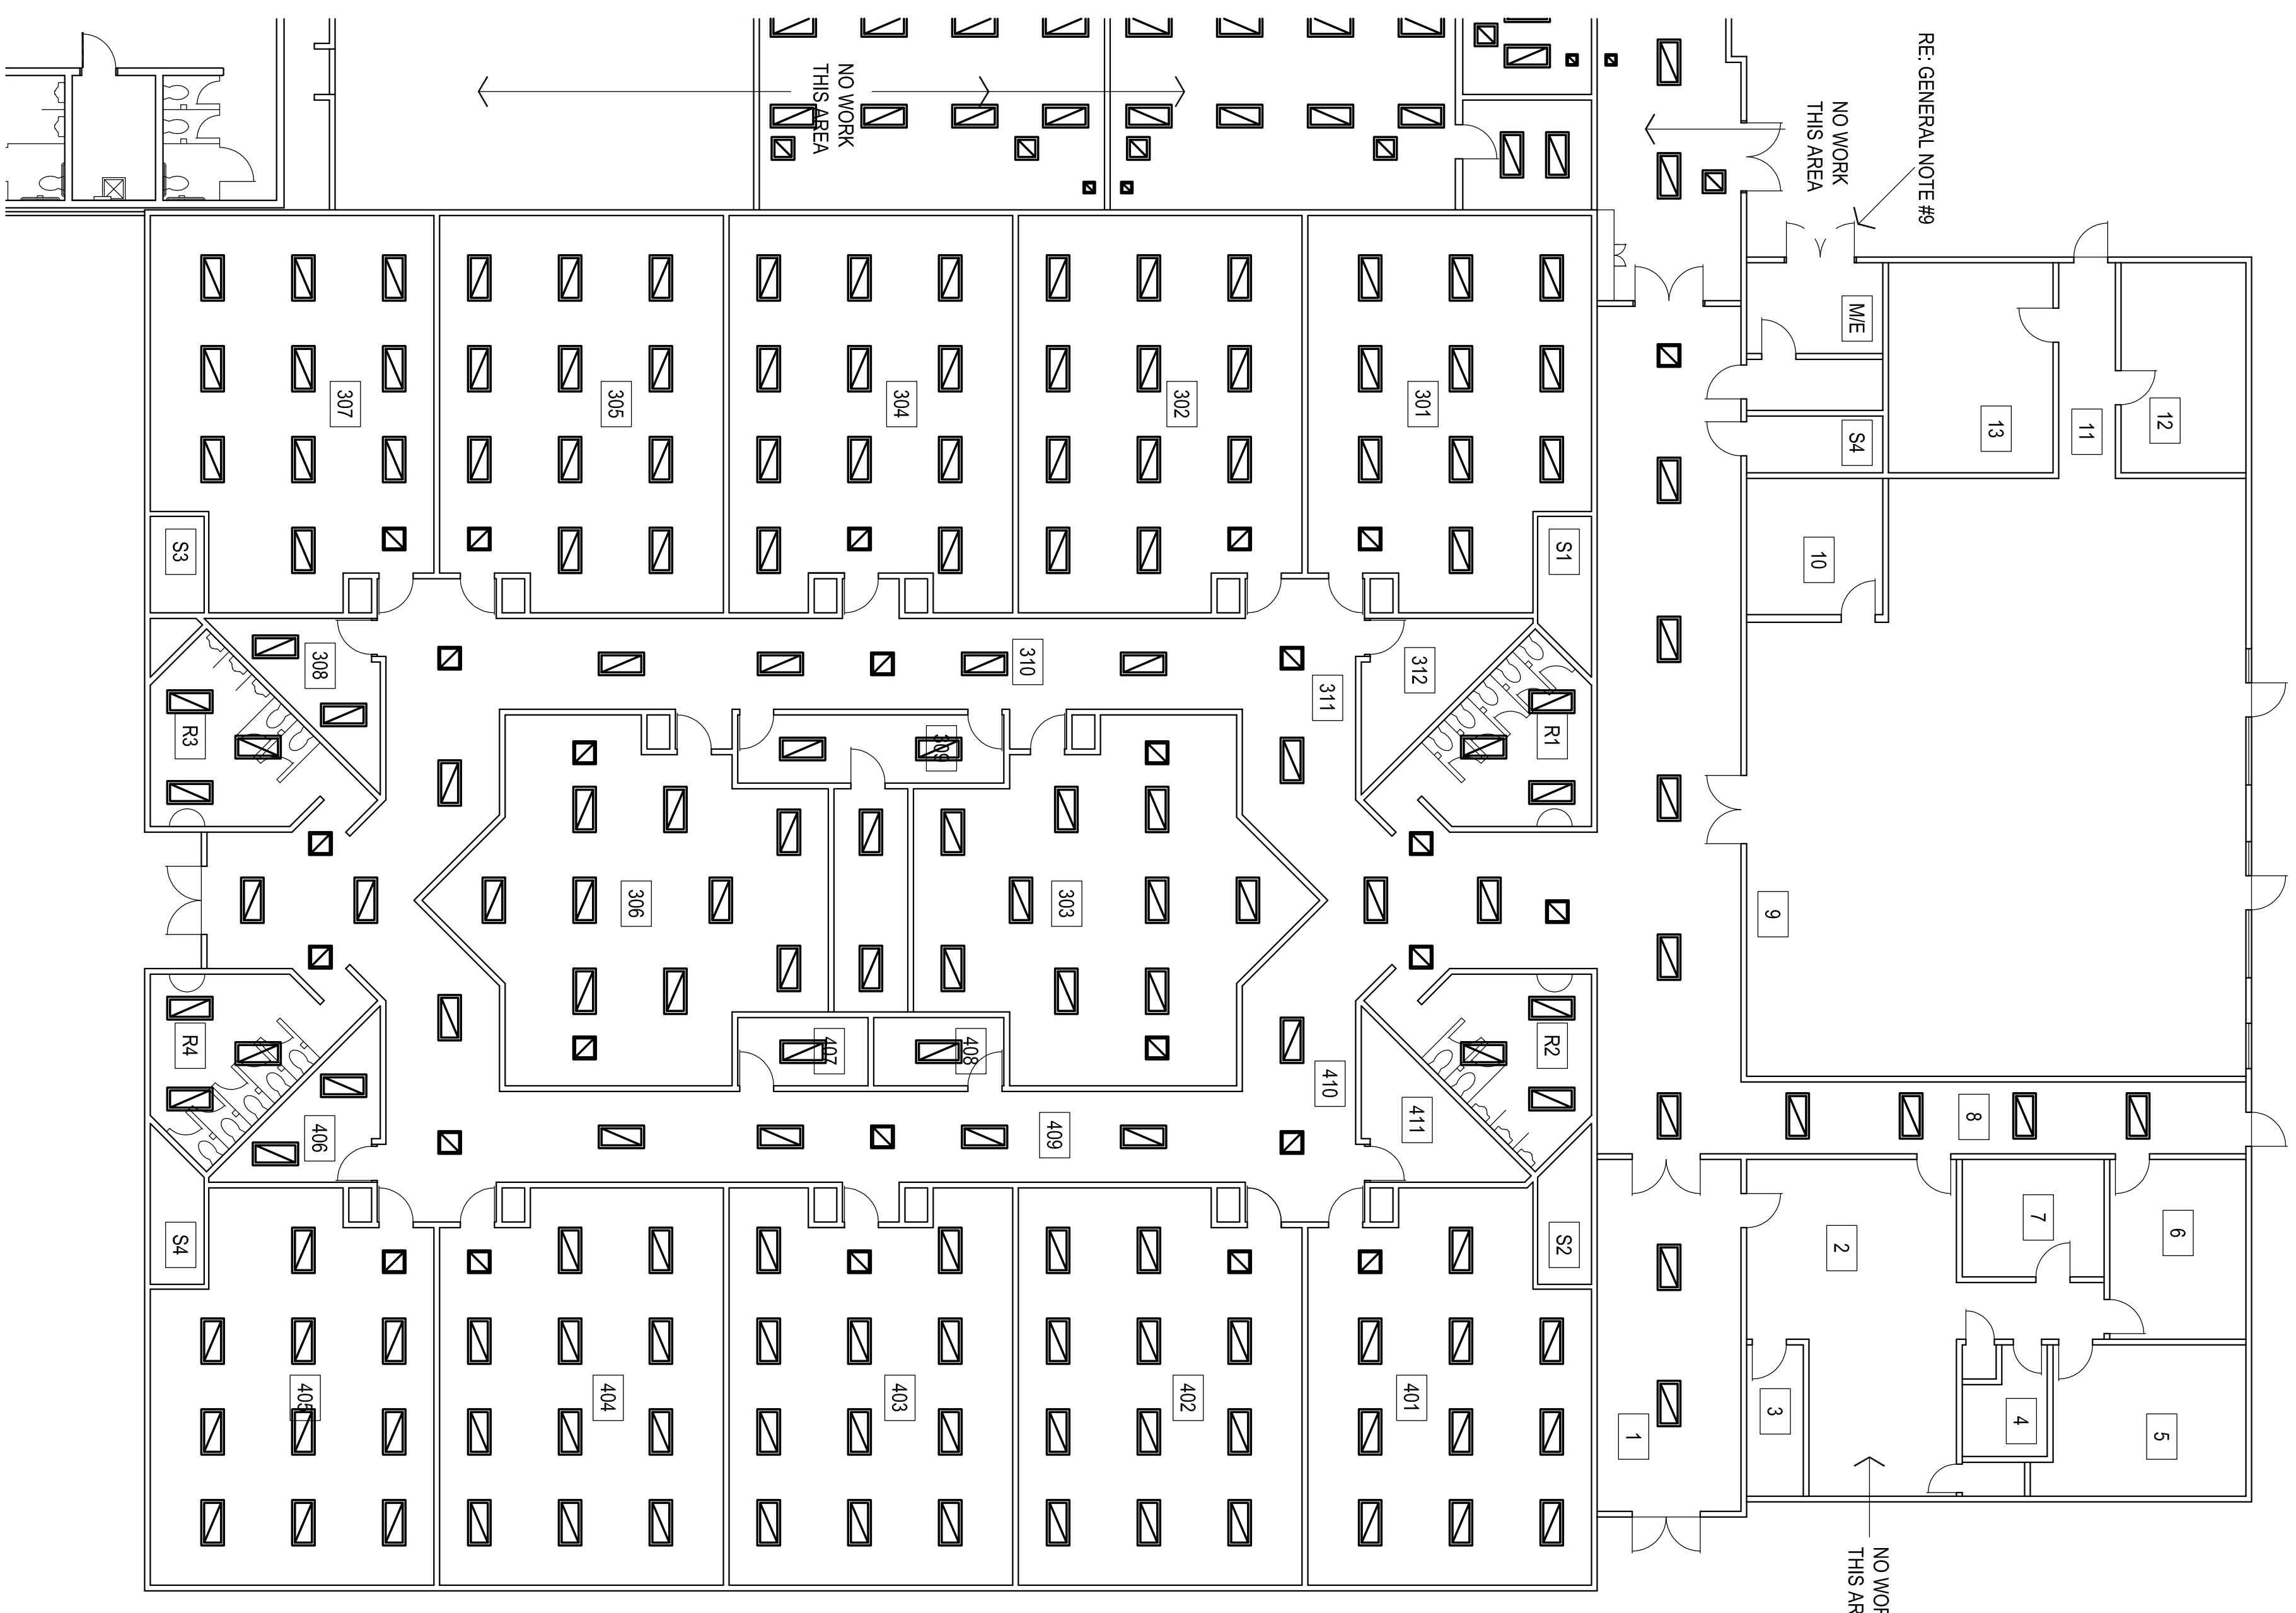


1 DEMOLITION PLAN
1/8" = 1'-0"



3 DOOR ELEVATION

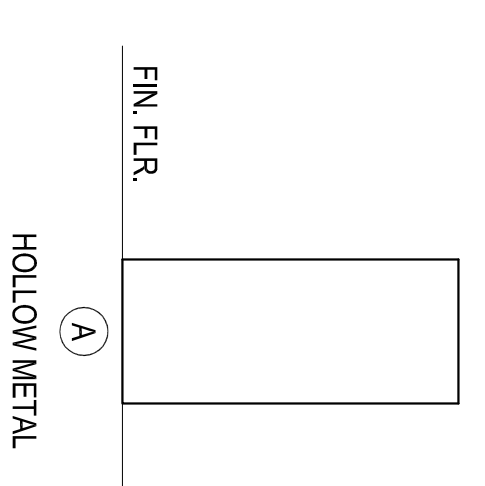

4 DOOR FRAME ELEVATIONS

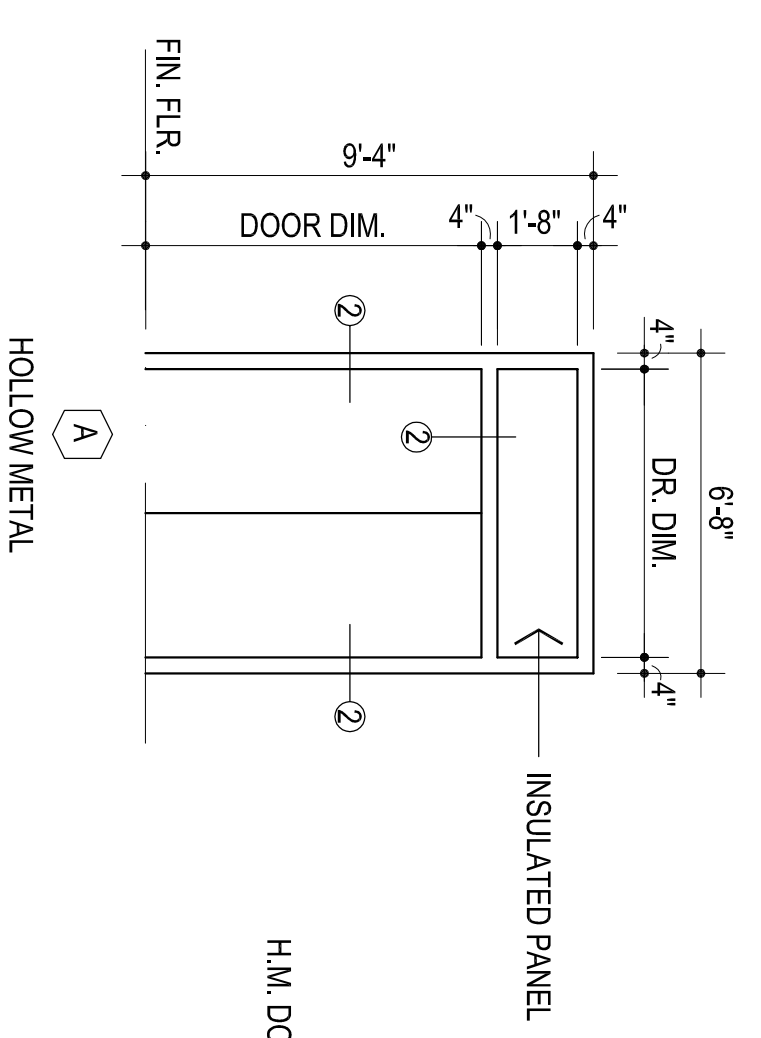

H.M. DOORS & FRAMES : SHERWIN-WILLIAMS - SW6992 - INKWELL



3/14/24

CG
designed by
MA
checked by
MARCO 2024
0818
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA




MOORE Public Schools
LEARNING FOR LIFE

HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

Sheet No:

A103

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED HEREON.
REPRODUCTION IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

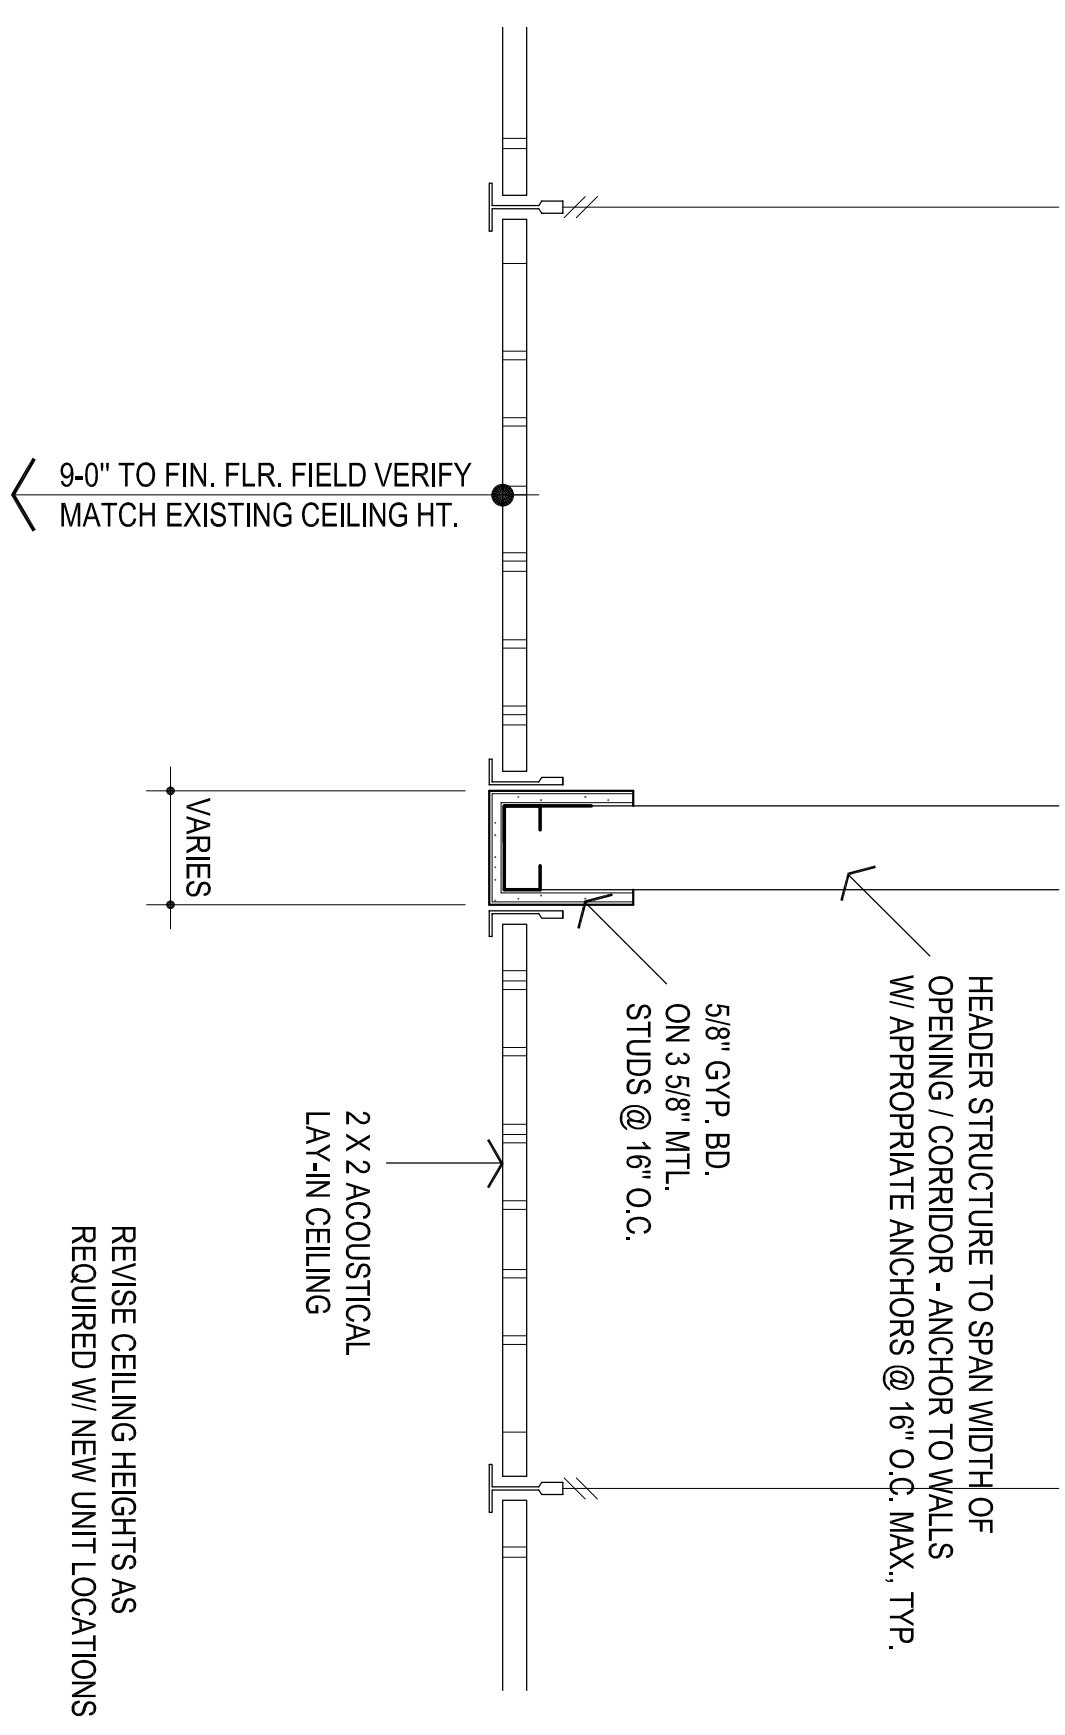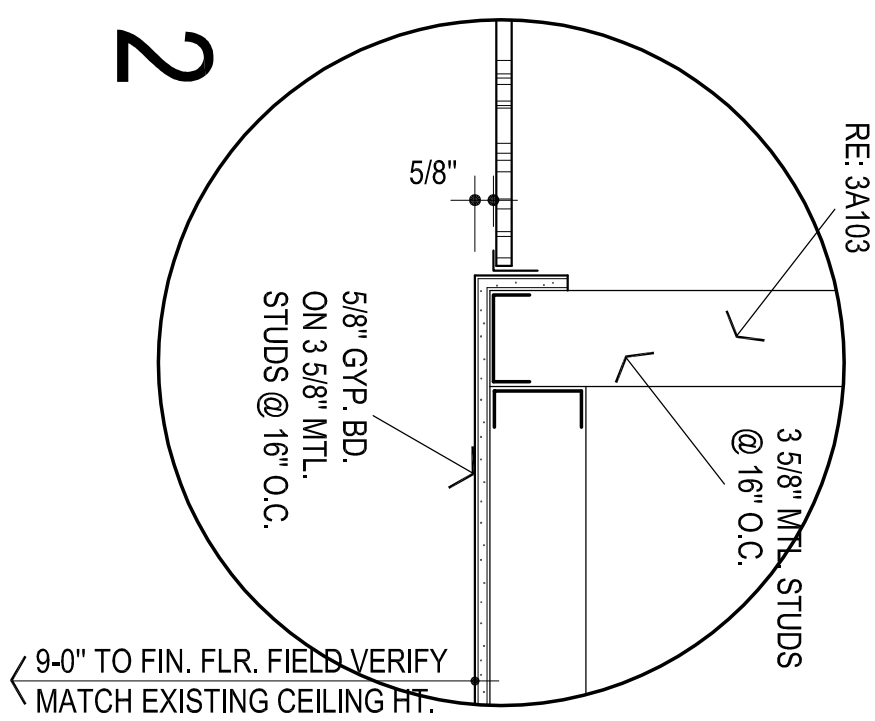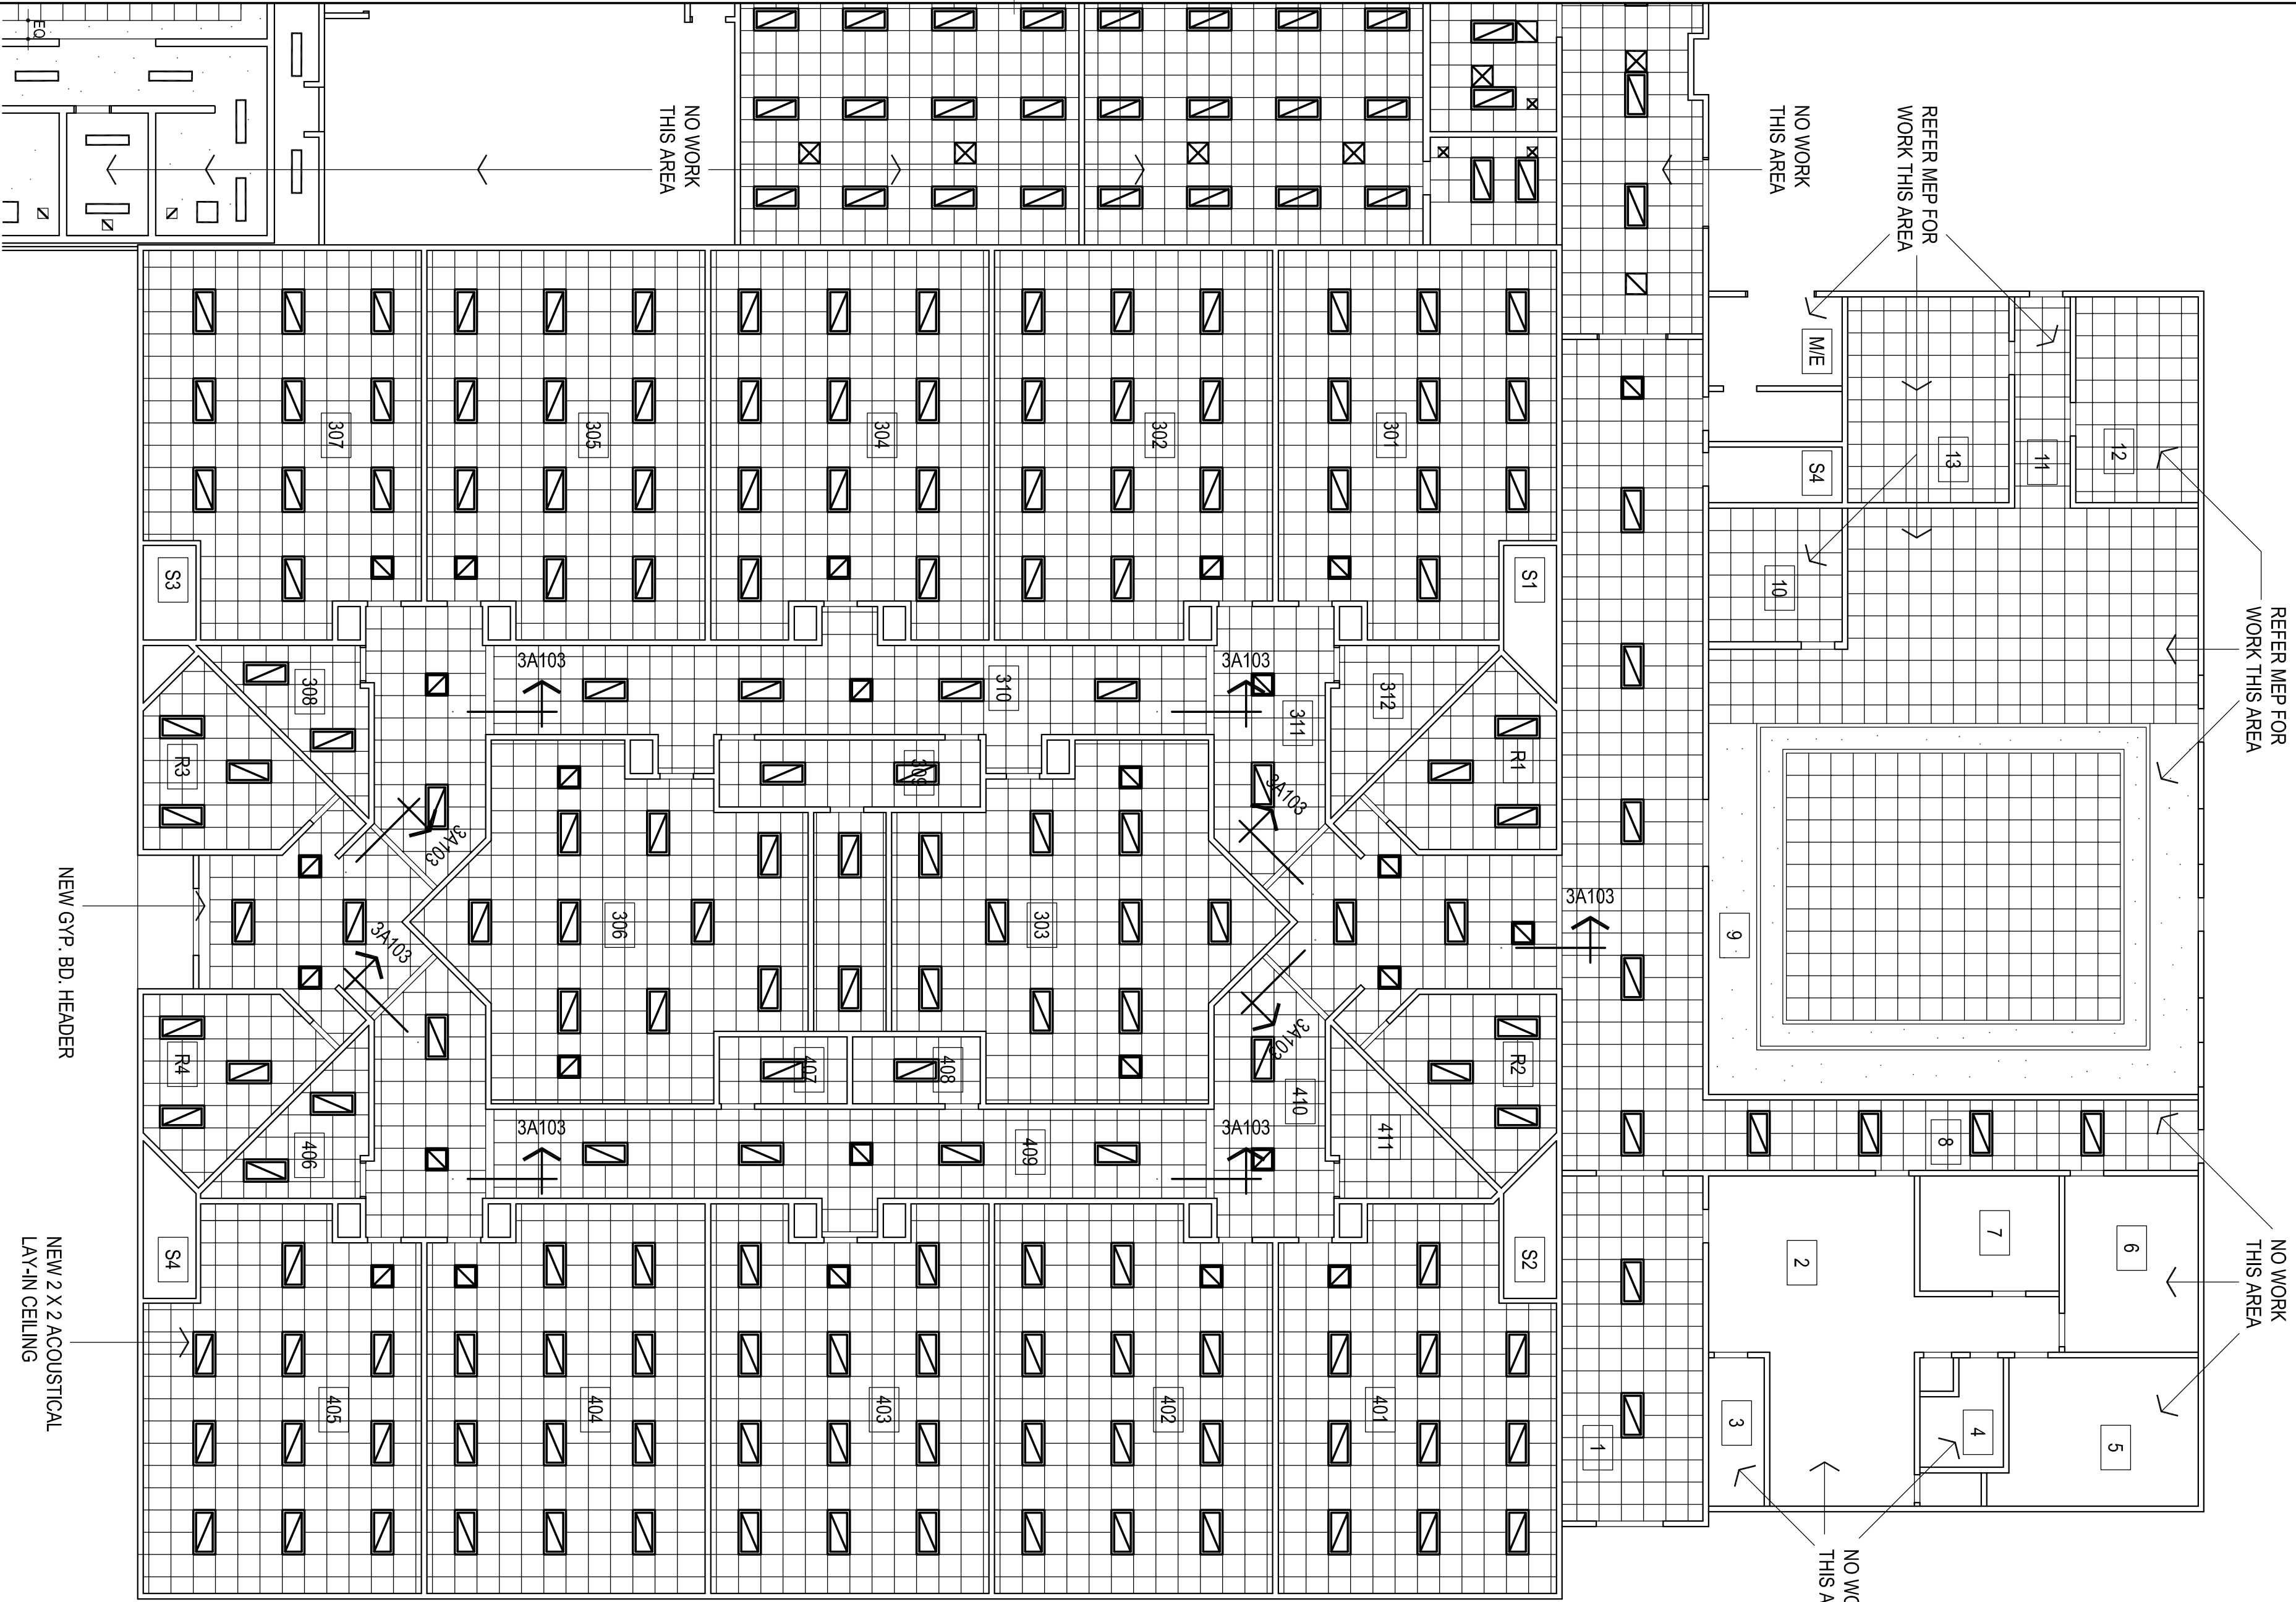

3
GYP. BD. HEADER
1 1/2" = 1'-0"

LEGEND:


- ☒ MECHANICAL OPENINGS
- ELECTRICAL FIXTURES
- Ⓢ CEILING MOUNTED SMOKE DETECTOR, RE. ELEC

NOTES:


1. REFER MECHANICAL & ELECTRICAL FOR ANY ADDITIONAL CEILING MOUNTED FIXTURES
2. REFER TO SHEET A100 FOR LOCATIONS OF FIRE-RATED WALLS
3. ALL CORRIDOR CEILING TILES TO HAVE REGULAR EDGE. ALL OTHER ROOMS (CLASSROOMS, ETC.) SHALL HAVE SQUARE EDGES.
4. REVISE EXISTING FIRE SUPPRESSION HEADS AS REQUIRED W/ NEW CEILING HEIGHTS - APPROX. 15' TOTAL

REFLECTED CEILING PLAN

3/32" = 1'-0"



NORTH

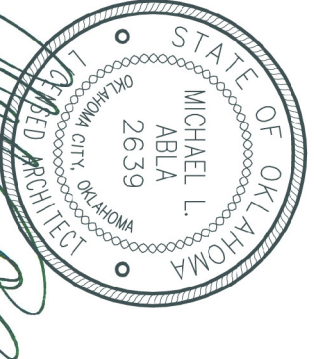

3/14/24

CG
drawn by
MA
checked by
MARCH 2024
dms
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA

MOORE Public Schools
LEARNING FOR LIFE

HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL



Sheet No.

A104

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED BY
AGP. ANY REPRODUCTION OR
REPRODUCTION IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

NO WORK THIS
AREA UNLESS
NOTED OTHERWISE

NEW
WORK

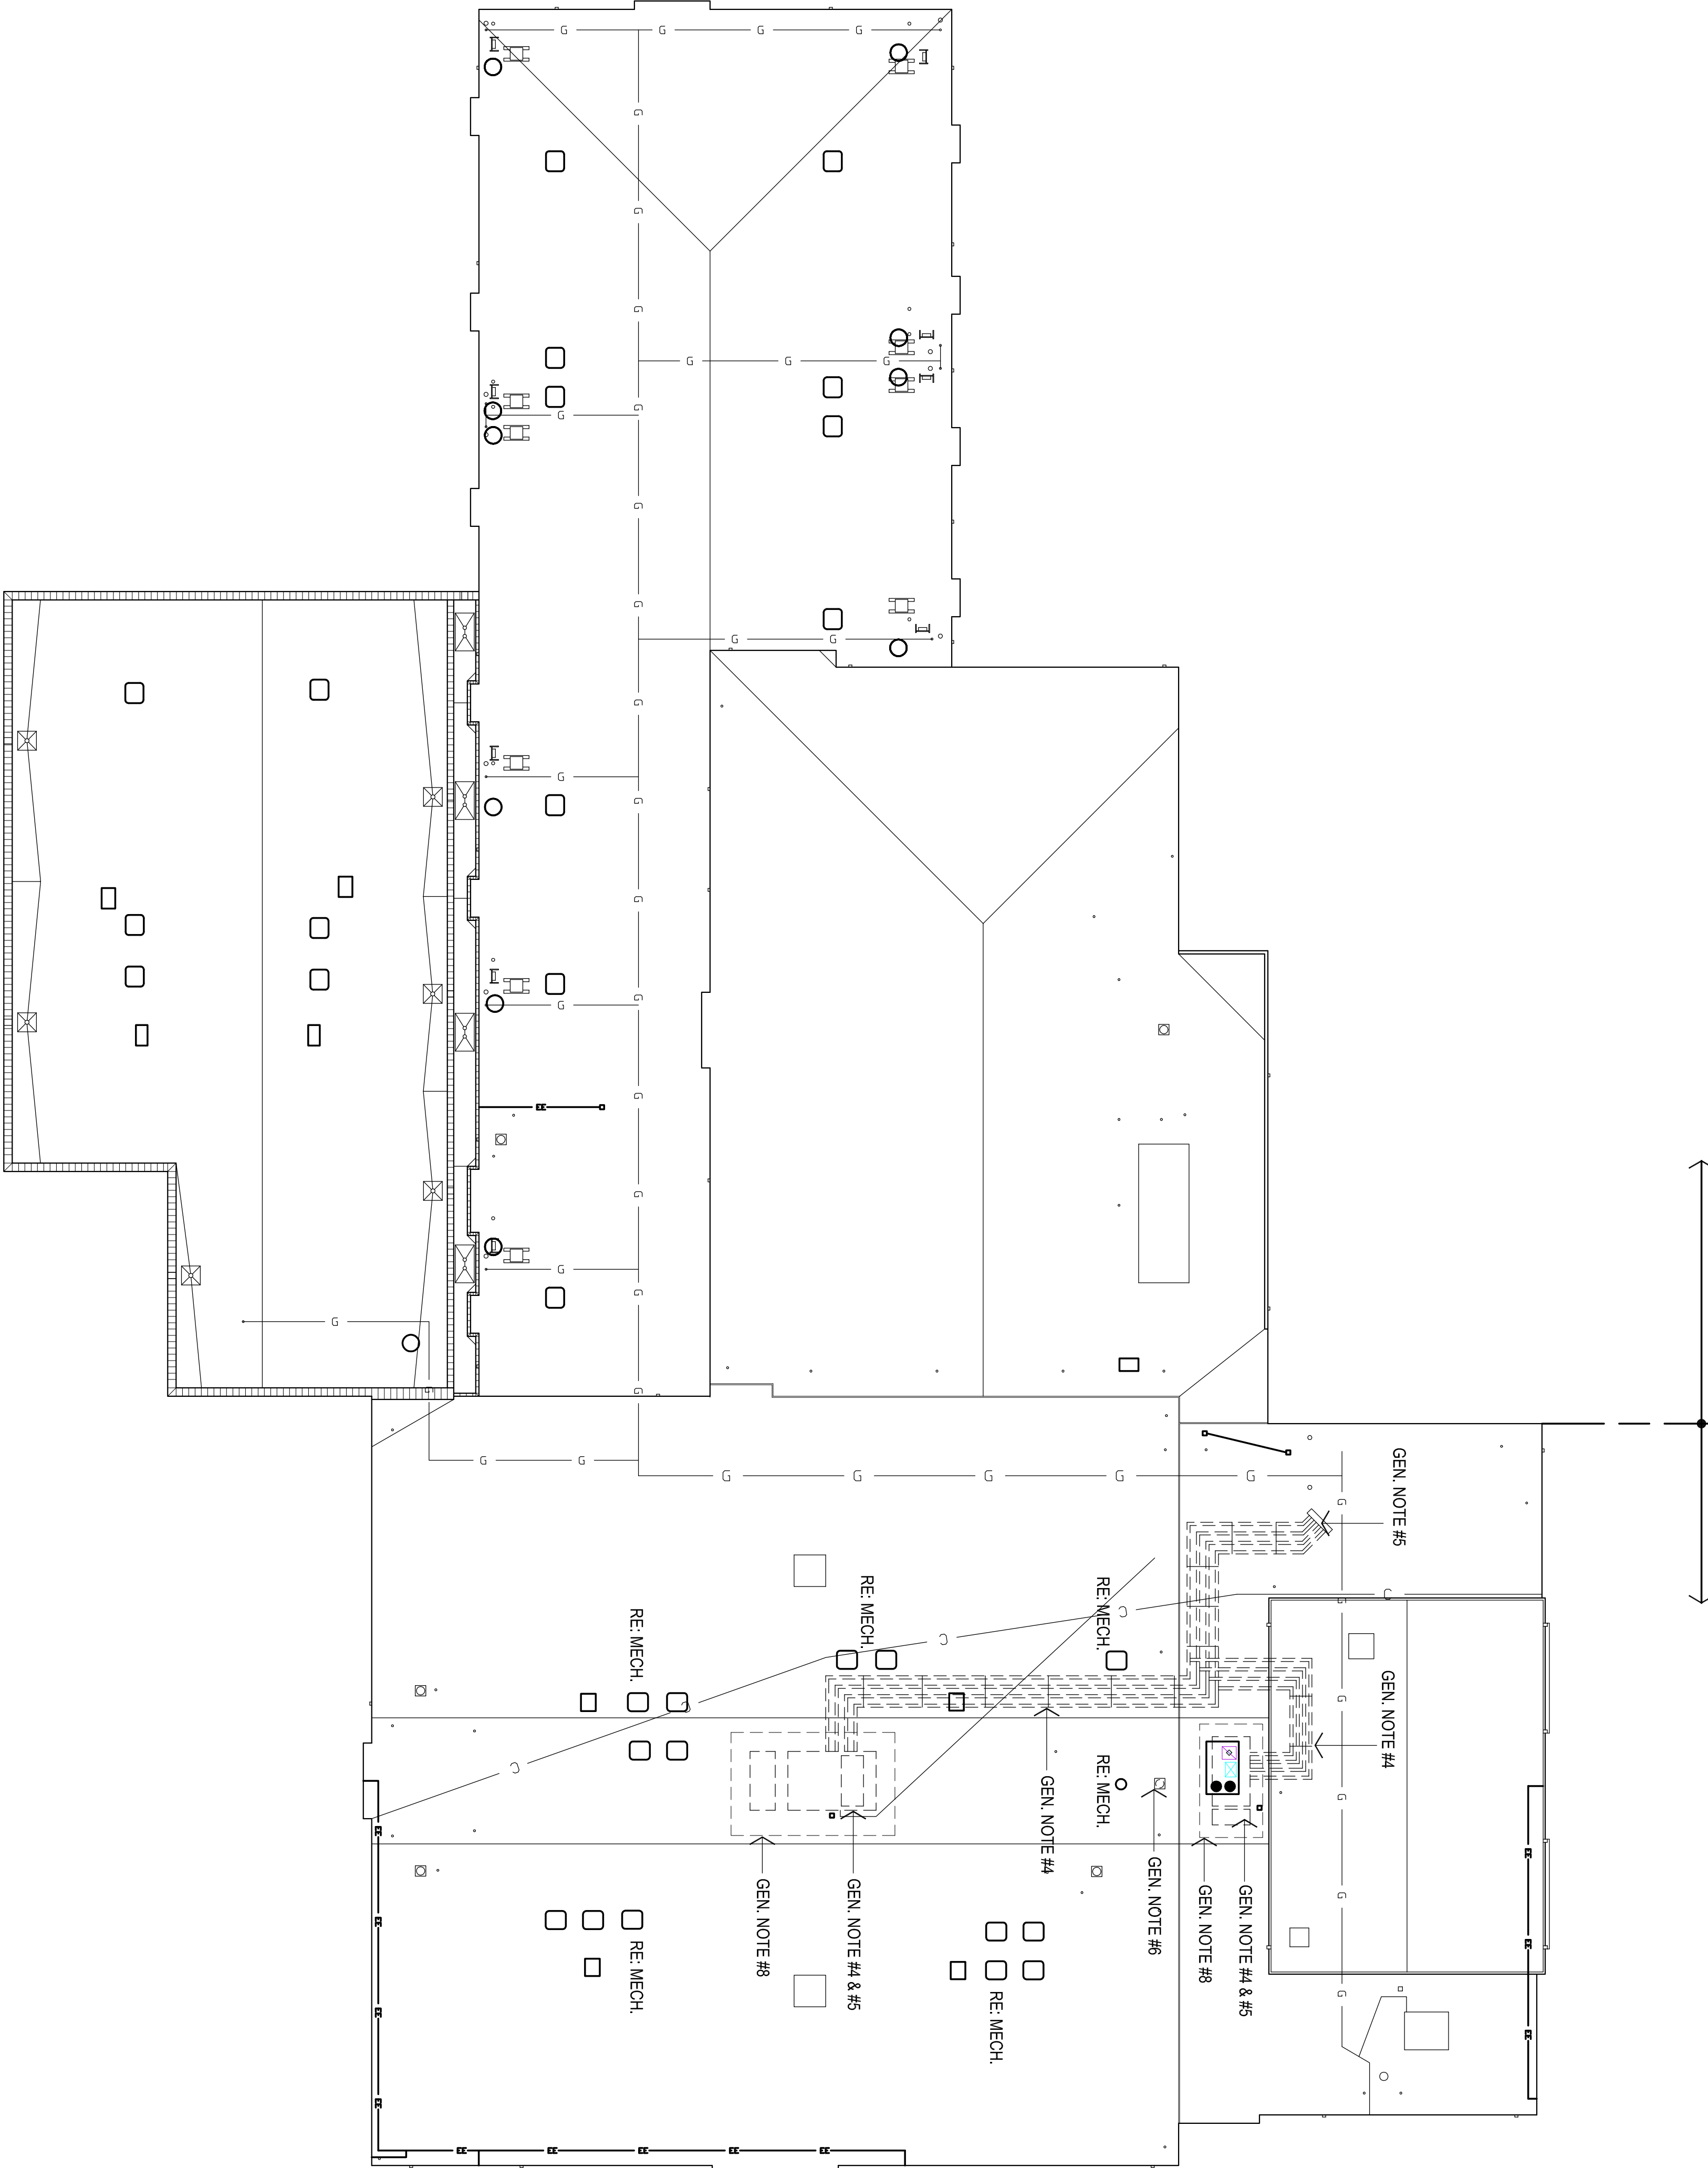


1


ROOF PLAN
1/8" = 1'-0"

GENERAL NOTES:


1. RE: MECH & ELEC. FOR ADDITIONAL DEMOLITION NOTES CONTRACTOR TO COORDINATE ALL ROOF MOUNTED ITEMS & PENETRATIONS W/ APPLICABLE TRADES
2. CONTRACTOR TO COORDINATE ROOF VENT PENETRATIONS W/ ARCHITECT.
3. PROVIDE @ ALL ROOF PENETRATIONS - PENETRATION DAM / SEALER POCKETS AS PER 04108
4. REMOVE EXISTING AIR HANDLER UNIT AND ASSOCIATED PIPING. EXISTING PIPE SUPPORTS THAT PENETRATE THE ROOFING SYSTEM ARE TO REMAIN. REPAIR / PATCH EXISTING ROOFING SYSTEM AS NEEDED TO PROVIDE WATER TIGHT SYSTEM. RE:MECHANICAL PLANS FOR ADDITIONAL INFORMATION.
5. PREPARE EXISTING ROOF PENETRATIONS & CURB TO RECEIVE NEW PREFINISHED METAL CAP WITH INSULATION. COORDINATE W/ ARCHITECT.
6. PREPARE EXISTING ROOF PENETRATIONS AT EXISTING EXHAUST FAN TO BE RELOCATED. RE: MECHANICAL. PROVIDE METAL CAP WITH INSULATION AT EXISTING CURB TO REMAIN. COORDINATE W/ ARCHITECT.
7. CONTRACTOR TO FIELD VERIFY DIMENSIONS AND PIPE SUPPORTS QUANTITIES.
8. APPROX AREA OF REROOF WORK. COORDINATE WITH CONTRACTOR. PROVIDE INSULATION (TAPERED WHERE REQUIRED) COVER BOARD AND ROOFING SYSTEM TO MATCH EXISTING. PROVIDE POSITIVE DRAINAGE TO EXISTING ROOF DRAINS.

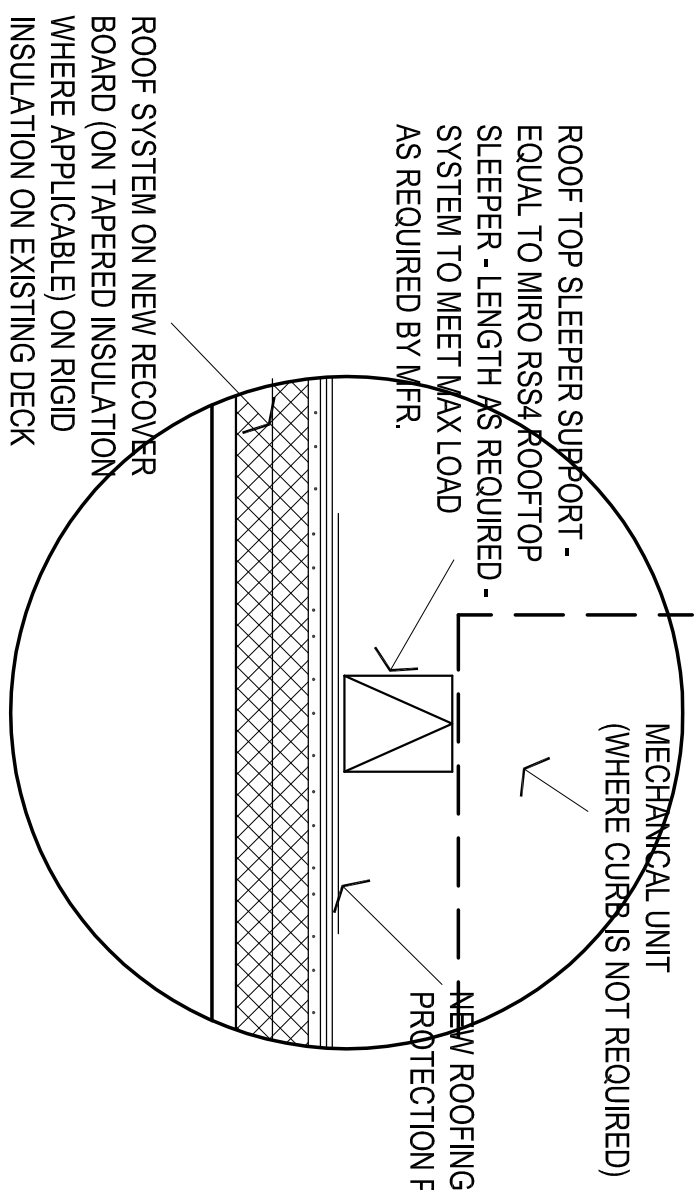


1
MECH. UNIT SUPPORT
NO SCALE

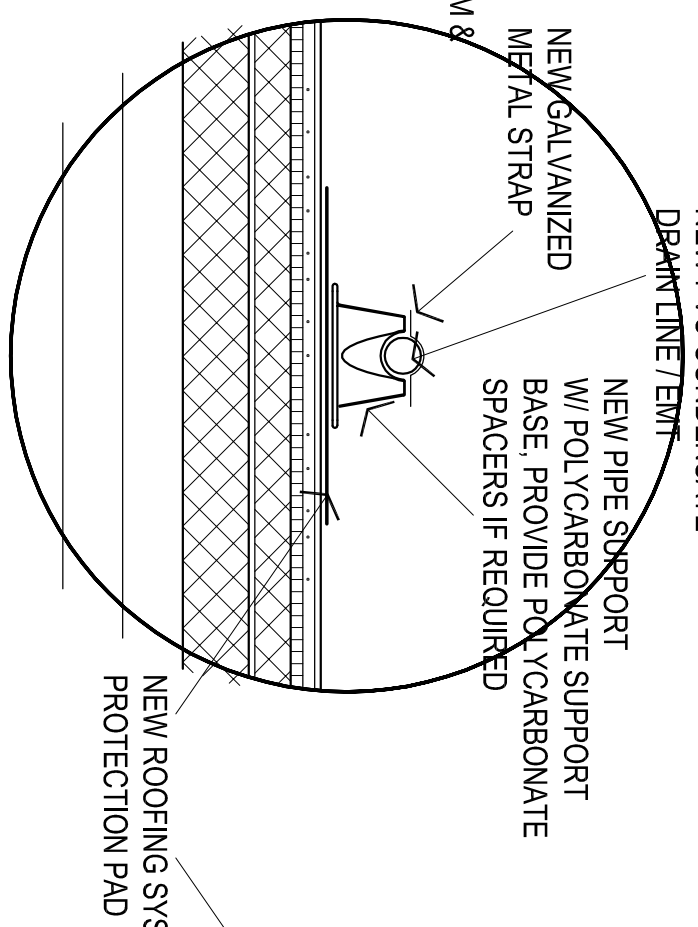


2
DETAIL @ PVC/EMT
SUPPORT
NO SCALE

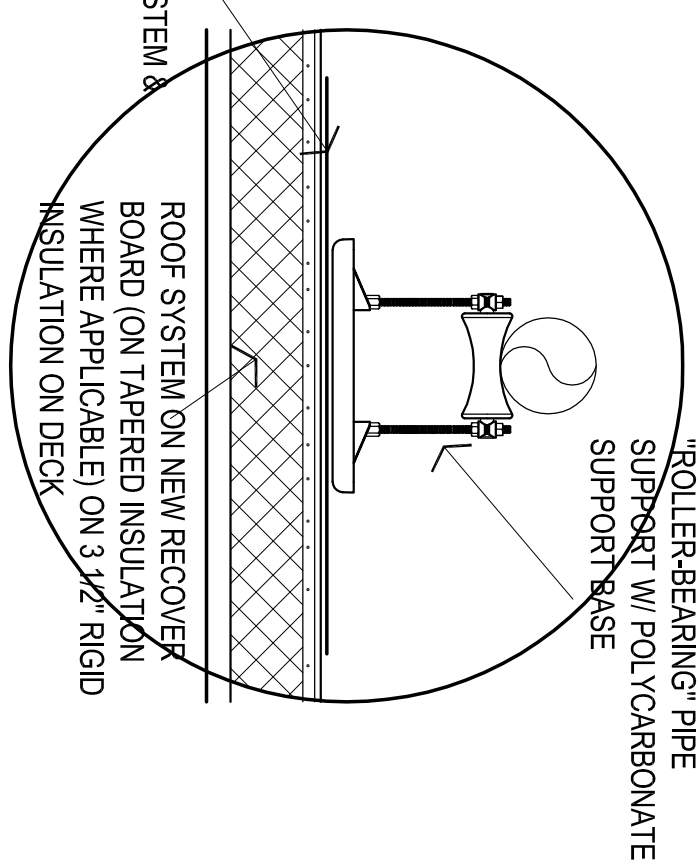


3
ADJUSTABLE PIPE SUPPORTS -
FRONT VIEW
NO SCALE

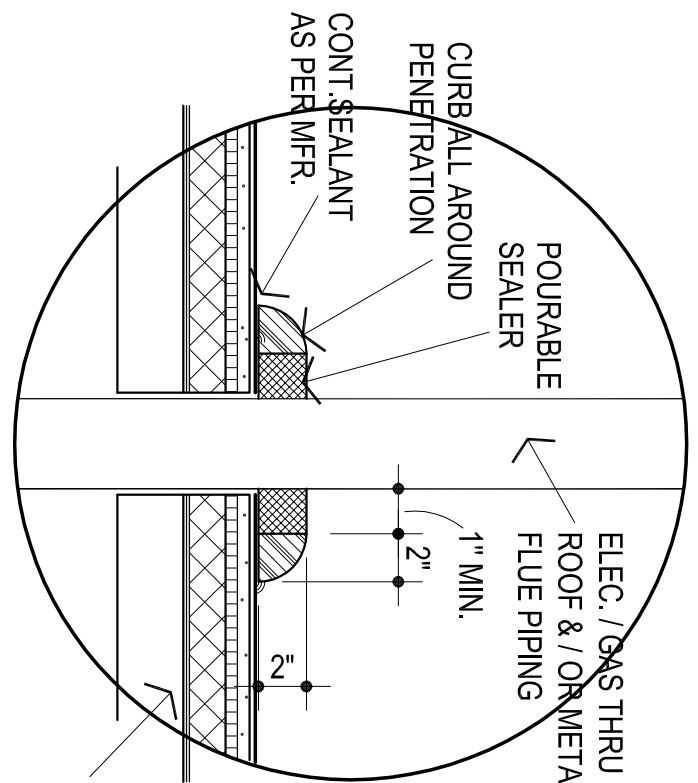

4
PENETRATION DAM /
SEALER POCKET @
MAJOR PENETRATIONS

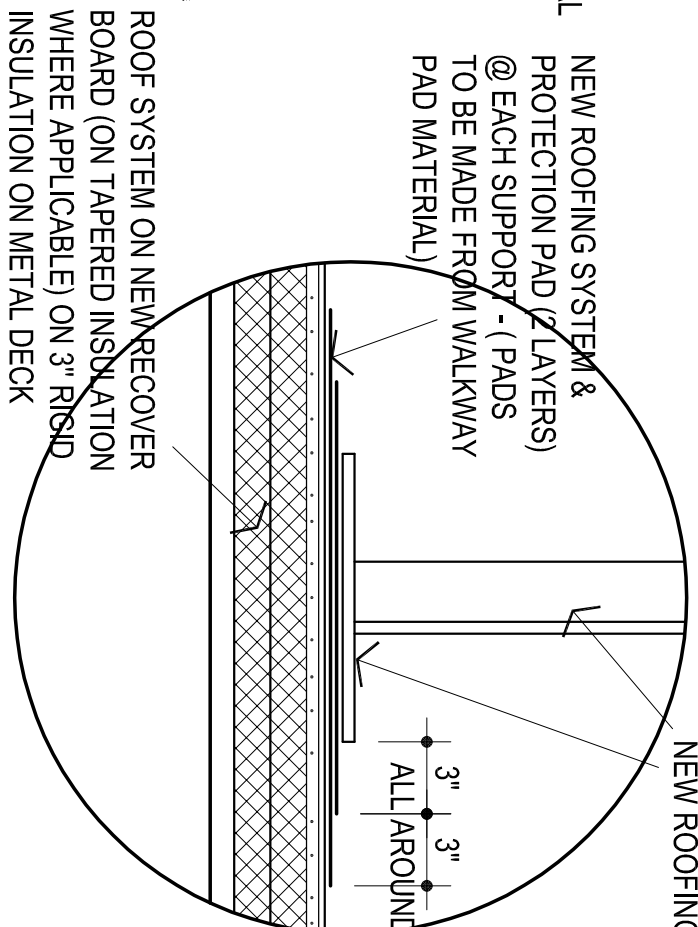

5
DETAIL @ EQUIPMENT SUPPORT
NO SCALE

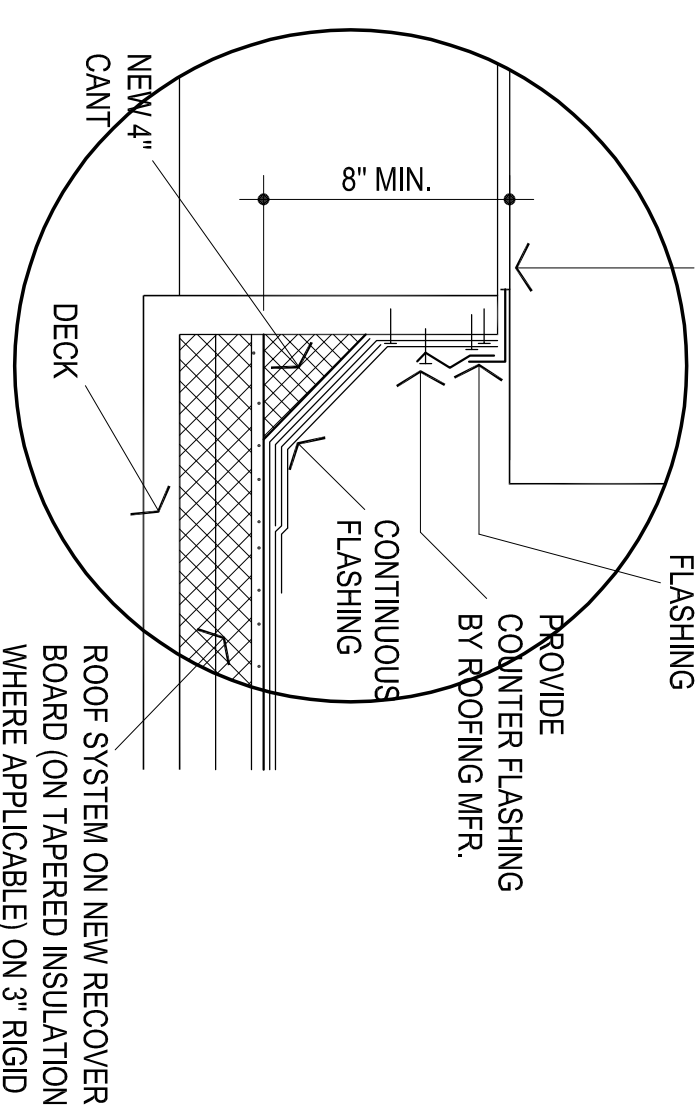

6
DETAIL @ EQUIPMENT
FAN CURB FLASHING
NO SCALE



KINGSGATE ROAD
GREENBRIAR KINGSPARK 3 ADDITION

GREENBRIAR KINGSPARK 2 ADDITION
BLOCK 5

GREENBRIAR KINGSPARK 2 ADDITION
BLOCK 5

GREENBRIAR KINGSPARK 3 ADDITION
COMMON AREA B

GREENBRIAR KINGSPARK 3 ADDITION
COMMON AREA B

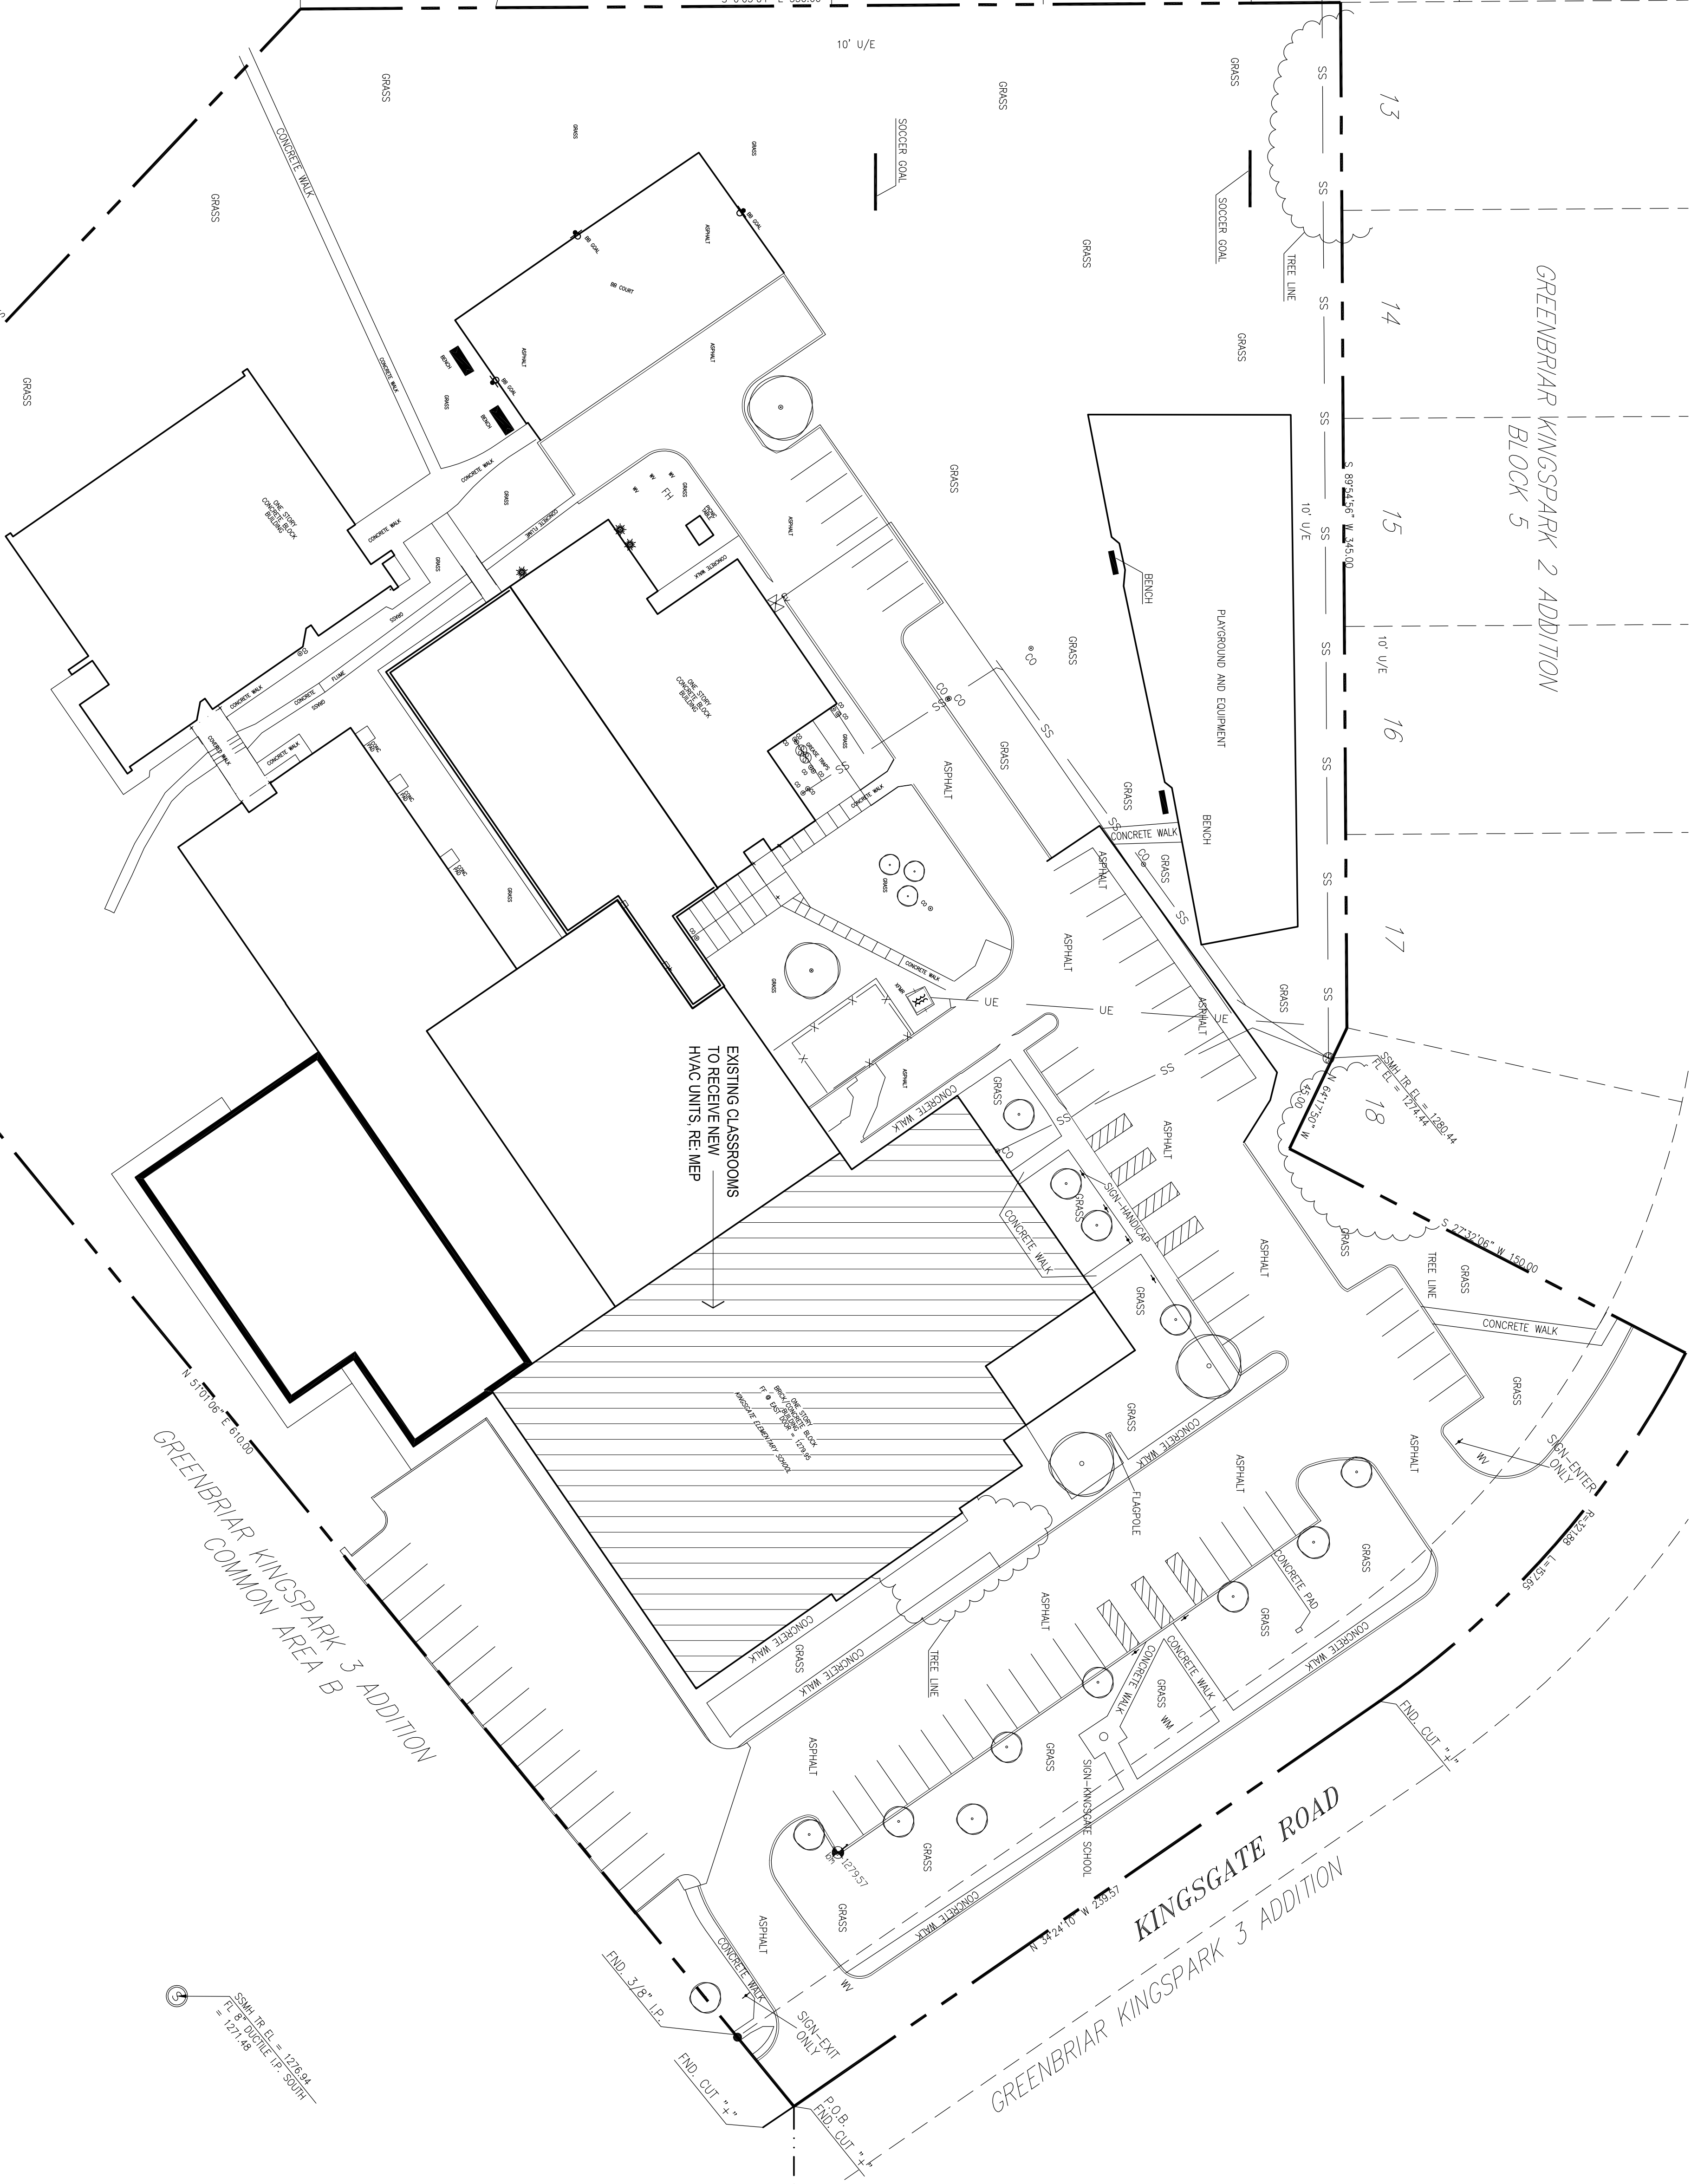


OVERALL SITE PLAN
1" = 30'-0"

1

CS	drawn by
MA	checked by
MARCH 2024	date
revisions	



MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA

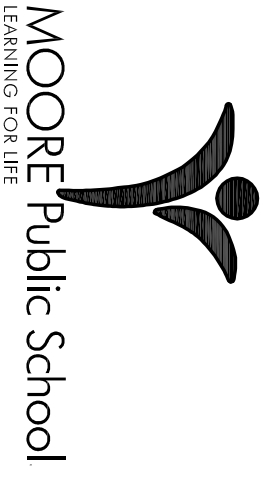

HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

C100

OWNERSHIP USE OF DOCUMENTS.
AGP EXPRESSLY RESERVES ITS
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

INDEX TO DRAWINGS

**MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION**




MOORE PUBLIC SCHOOLS DISTRICT NO. 1-2
CLEVELAND COUNTY MOORE, OKLAHOMA

HVAC REPLACEMENT KINGSGATE ELEMENTARY

1400 KINGSGATE ROAD
OKLAHOMA, OK. 73159

AGP | the Abla Griffin
Partnership

201 N. BROADWAY SUITE 210 MOORE, OK. 73160
405.735.3477 AGP@theAGP.net www.the-AGP.net

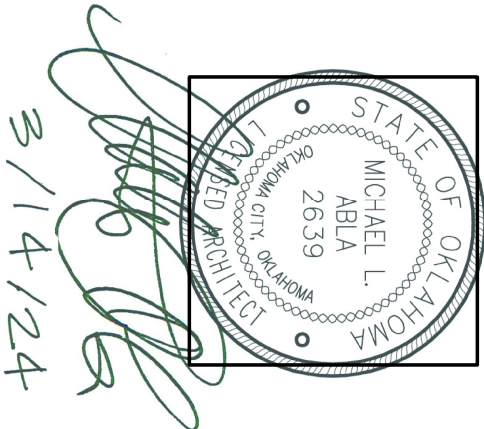

CONSTRUCTION MANAGER



201 NORTH BROADWAY
MOORE, OK 73160

STRUCTURAL

KFC ENGINEERING

205 NW 63rd, SUITE 300
OKLAHOMA CITY, OK 73116

MECHANICAL/ELECTRICAL/PLUMBING

SALAS O'BRIEN

2600 VAN BUREN ST., SUITE 2604
NORMAN, OKLAHOMA 73072

SHEET NUMBER	DESCRIPTION
C	COVER SHEET
G100	LEGENDS / MANS / ETC.
C100	OVERALL SITE PLAN
S300	GENERAL NOTES / SECTIONS
S301	EXISTING FRAMING PLAN
A101	OVERALL FLOOR PLAN
A102	DEMOLITION PLAN / MECHANICAL PLAN / DETAILS
A103	REFLECTED CEILING PLAN / DETAILS
A104	ROOF PLAN
A105	ROOF DETAILS
P000	PLUMBING SCHEDULE
P100	PLUMBING PLAN OVERALL
P101	PLUMBING PLAN
P201	PLUMBING PLAN ROOF
P301	DETAILS
M000	MECHANICAL NOTES
MD101	MECHANICAL DEMOLITION PLAN
MD102	MECHANICAL OVERALL PLAN
M101	MECHANICAL FLOOR PLAN - CLASSROOMS
M102	MECHANICAL FLOOR PLAN - MEDIA CENTER
M103	MECHANICAL FLOOR PLAN - MEDIA CENTER
M104	MECHANICAL ROOF PLAN
M501	DETAILS
M502	DETAILS
M601	SCHEDULES
E000	ELECTRICAL NOTES / SCHEDULES
ED101	ELECTRICAL DEMOLITION PLAN
ED201	ELECTRICAL DEMOLITION PLAN ROOF
E101	ELECTRICAL LIGHTING PLAN - ALTERNATE
E102	ELECTRICAL POWER PLAN
E201	ELECTRICAL ROOF PLAN
E401	ELECTRICAL RISER DIAGRAM / SCHEDULE
E901	ELECTRICAL DETAILS

HVAC REPLACEMENT
KINGSGATE ELEMENTARY SCHOOL
SET NO.

REVISIONS

sheet no.

C

date:

MARCH 2024

ABBREVIATIONS

ABV	ABOVE	HDWD	HARDWOOD
ACQST.	ACQUSTICAL	HDR	HARDWARE
ADJ.	ADJUSTABLE	HORLZ.	HORIZONTAL
ANCH.	ANCHOR	HT	HEIGHT
APPROX.	APPROXIMATE	INSUL.	INSULATION
BD.	BOARD	JST.	JOIST
BLG.	BLOCKING	JT.	JOINT
BLT.	BOTTOM	L.V.	LAVATORY
BT.	BEAM	MAT.	MAT
C.	CENTERLINE	MAX.	MAXIMUM
CL.G.	CEILING	MECH.	MECHANICAL
CONC.	CONCRETE	MFG.	MANUFACTURING
CMU	CONCRETE MASONRY UNIT	MFR.	MANUFACTURER
COL.	COLUMN	MIN.	MINIMUM
CONT.	CONTINUOUS	MISC.	MISCELLANEOUS
D.F.	DRINKING FOUNTAIN	MTL.	METAL
DM.	DIMENSION	N.I.C.	NOT IN CONTRACT
DR.	DOOR	N.I./#	NUMBER NOT TO SCALE
DWG.	DRAWING	N.T.S.	NOT TO SCALE
DWL.	DOWEL	O.C.	ON CENTER
E.	EACH	OPN.	OPENING
ELECT.	ELECTRICAL	OPP.	OPPOSITE
ELEV.	ELEVATION	P.P.	POWER POLE
EQ.	EQUAL	PREFN.	PREFINISHED
E.I.	EXPANSION JOINT	P.T.	PAPER TOWEL
E.W.	EACH WAY	P.V. / PLY. WD.	PLYWOOD
EXP.	EXPANSION	REDD.	REQUIRED
EXT.	EXISTING	RM.	ROOM
FD.	FLOOR DRAIN	S.B.	SCHEDULE BLOCK
FE.	FIRE EXTINGUISHER	SCHD.	SCHEDULE
FEC.	FIRE EXTINGUISHER CABINET	STD.	STANDARD
FEL.	FINISH FLOOR LINE	STL.	STEEL
FIN.	FINISH	S.U.	SKY
FRMG.	FRAMING	T.C.	TYPICAL
GA.	GAUGE	T.P.H.	TOP OF CURB
GB.	GRAB BAR	TYP.	TYPICAL
GALV.	GALVANIZED	UNO.	UNLESS NOTED OTHERWISE
GYP. BD.	GYP. BOARD	VTR.	VENT THROUGH ROOF
H.C.	HANDICAP	W.C.	WATERCLOSET
		WD.	WOOD
		WVF.	WEIDED WIRE FABRIC

MATERIALS LEGEND


	MASONRY VENEER
	C.M.U.
	CONCRETE
	FRAME PARTITION, METAL STUDS
	FOR DETAILS
	GYP. BOARD
	PARTICLE BOARD
	RIGID INSULATION
	WOOD BLOCKING / FRAMING, CONTINUOUS
	WOOD BLOCKING, DISCONTINUOUS
	FINISH WOOD
	SMALL SCALE STRUCTURAL STEEL / MISCELLANEOUS METAL
	LARGE SCALE STRUCTURAL STEEL
	BATT INSULATION
	ACOUSTICAL CEILING TILE
	EARTH FILL

SYMBOLS LEGEND

	EXISTING SPOT ELEVATION
	FINISH SPOT ELEVATION
	EXISTING GRADE CONTOUR
	FINISH GRADE CONTOUR
	EXISTING TREE TO BE PROTECTED
	EXISTING TREE TO BE REMOVED
	PROJECT LIMITS
	CHANLINK FENCE
	BARBED WIRE FENCE
	CONCRETE PAVING
	ASPHALT PAVING
	CONCRETE SIDEWALK
	EXISTING PAVING/SIDEWALK TO REMAIN
	EXISTING PAVING TO BE REMOVED
	NEW BUILDING
	EXISTING BUILDING - NO WORK
	ROOM NUMBER
	ROOM NUMBER, LARGE SCALE PLAN REFERENCE
	ROOM NUMBER/INTERIOR ELEVATION REFERENCE
	WALL SECTION/DETAIL CUT MARK
	LARGE SCALE DETAIL MARK
	STRUCTURAL GRID COORDINATES
	144 BUILDING SECTION CUT MARK
	6 DOOR NUMBER
	8 WINDOW MARK
	8 FRAME MARK
	8 GLAZING MATERIAL MARK
	8 EQUIPMENT MARK
	148 EXTERIOR ELEVATION MARK
	#4 TEST HOLE
	#4 BENCH MARK/BUILDING ELEVATION (SECTION)


GENERAL NOTES:

- ALL REQUIRED HANDICAP ACCESSIBLE ITEMS TO COMPLY WITH AMERICANS WITH DISABILITIES ACT AND ARCHITECTURAL BARRIERS ACT ACCESSIBILITY GUIDELINES.
- THE CONTRACTOR SHALL NOT USE ANY LEAD-BASED PAINT OR ASBESTOS CONTAINING MATERIAL ON THIS PROJECT
- THESE CONTRACT DOCUMENTS INCLUDING BUT NOT LIMITED TO THE DRAWINGS, PROJECT MANUAL AND ANY SUBSEQUENT ADDENDA ARE ISSUED AS A "WHOLE" AND SHALL BE BID AS SUCH. EACH DISCIPLINE / SUBCONTRACTOR SHALL REVIEW THE ENTIRE SET OF CONTRACT DOCUMENTS AND INCLUDE APPLICABLE WORK IN THEIR BID REGARDLESS OF LOCATION WITHIN THE CONTRACT DOCUMENTS. REVIEWING ONLY A PORTION OF THE CONTRACT DOCUMENTS SHALL NOT RELIEVE THE CONTRACTOR OR SUBCONTRACTOR OF THE REQUIREMENT TO PERFORM THE WORK OF THEIR RESPECTIVE DISCIPLINES.
- LOCATIONS OF EXISTING BUILDINGS, SITE FEATURES, & UNDERGROUND UTILITIES HAVE BEEN OBTAINED FROM EXISTING AVAILABLE SOURCES. THE CONTRACTOR IS TO FIELD VERIFY EXISTING LOCATIONS PRIOR TO STARTING CONSTRUCTION AND NOTIFY THE ARCHITECT IMMEDIATELY IF ANY EXISTING BUILDING OR SITE FEATURE CONFLICTS WITH THE NEW CONSTRUCTION.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING SITE UTILITIES AND PROTECT DURING CONSTRUCTION. COORDINATE NEW UTILITY REQUIREMENTS WITH APPLICABLE UTILITY COMPANIES (WATER, GAS, ELECTRICITY, SANITARY, SEWER, TELEPHONE, CABLE, SITE DRAINAGE AND OTHERS AS REQUIRED). COMPLY WITH ALL APPLICABLE REGULATIONS. INCLUDE ALL CONNECTION FEES AND OTHER CHARGES IN BID.
- REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR UTILITY INFORMATION.
- REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL REQUIREMENTS AND CONCRETE TO BE PROVIDED BY CONTRACTOR.
- GENERAL CONTRACTOR TO VERIFY LOCATIONS OF EASEMENTS, ENCUMBRANCES AND SET BACKS PRIOR TO STARTING CONSTRUCTION
- CONFLICTS BETWEEN DRAWINGS AND SPECIFICATIONS SHALL BE BROUGHT TO ARCHITECTS ATTENTION. FAILURE TO BID ITEMS NOTED ON DRAWINGS AND OMITTED FROM SPECIFICATIONS DOES NOT REMOVE RESPONSIBILITY TO PROVIDE AND INSTALL SUCH.
- GENERAL CONTRACTOR SHALL PAY "FEE IN LIEU OF DETENTION POND" AS REQUIRED BY THE CITY OF OKLAHOMA CITY & INCLUDE ALL APPLICABLE FEES / PAYMENTS IN BID.

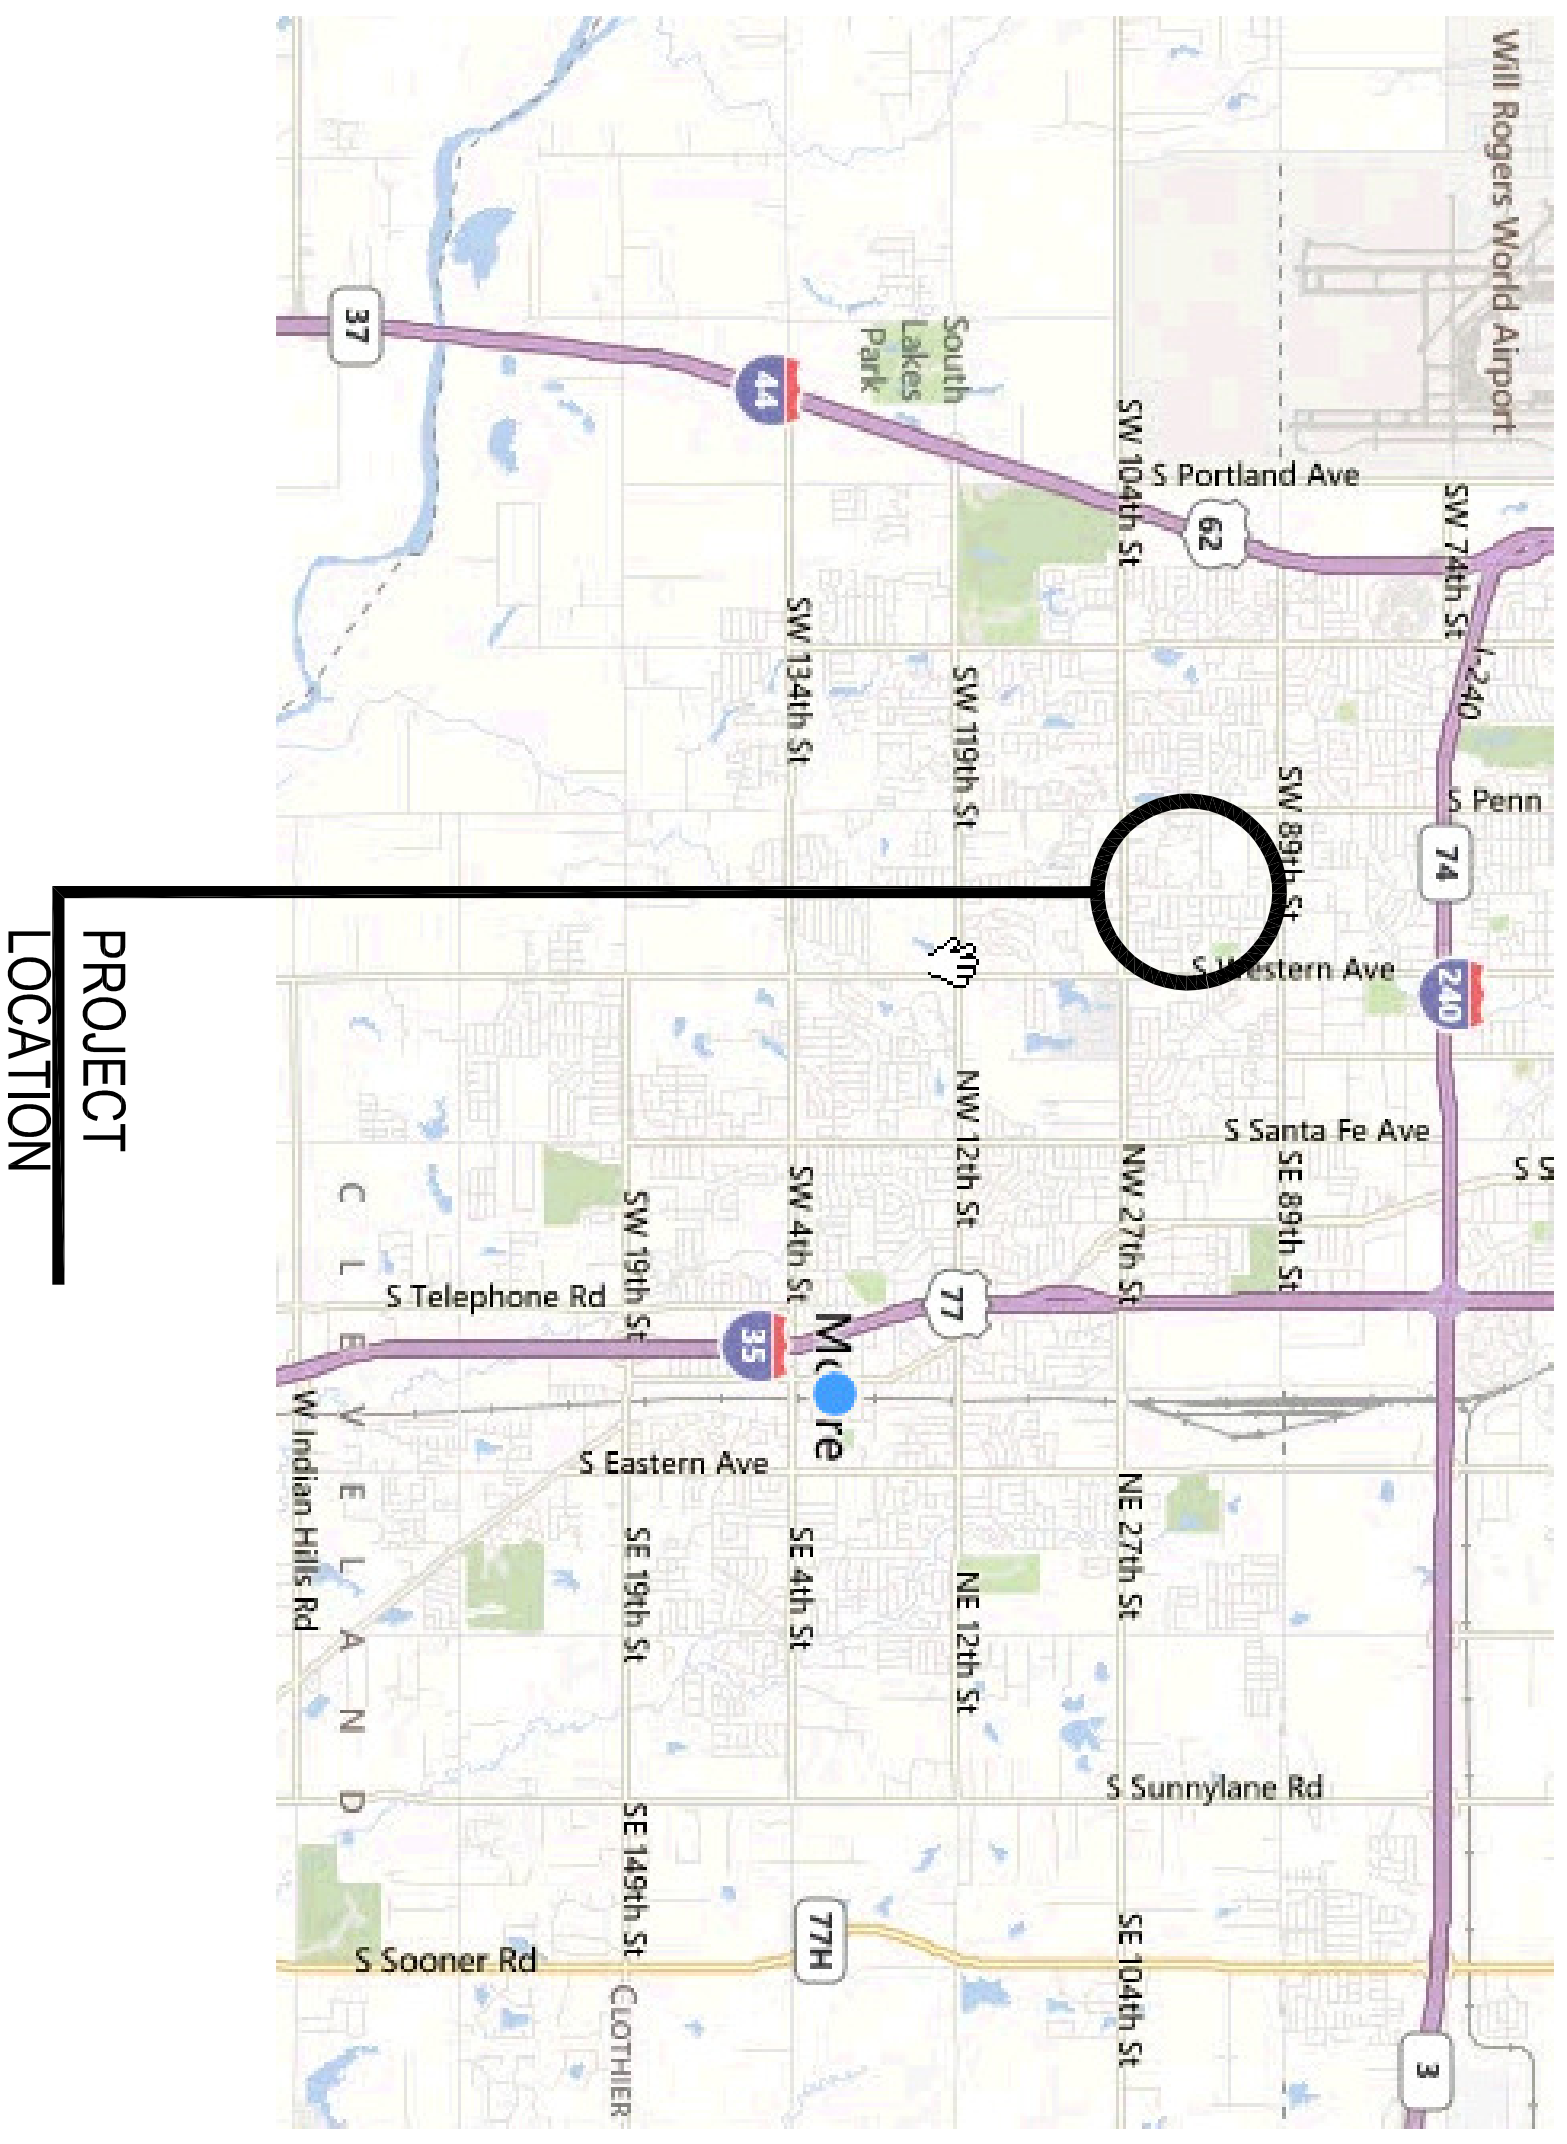

PROJECT LOCATION

KINGSGATE ELEMENTARY SCHOOL
1400 KINGSGATEE ROAD
OKLAHOMA CITY, OKLAHOMA 73159



VICINITY MAP

Legal Description:
S-10-3W-6.3 AC PRT SW/4 BEG S488.92' W431.80' NE/C SW/4 SW610.10' NW320.62' N360' E345' N45' NE180'

CG
designed by
MA
checked by
MAGCJ 2024
0818
revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA

MOORE Public Schools
LEARNING FOR LIFE

HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

G100

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED BY AGP.
REPRODUCTION IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

1. GENERAL INFORMATION

- A. GOVERNING BUILDING CODE: 2015 INTERNATIONAL BUILDING CODE (IBC-2015).
- B. BUILDING RISK CATEGORY: THE BUILDING RISK CATEGORY ACCORDING TO IBC-2015 TABLE 1604.5 AND ASCE 7-10 TABLE 1.5-1 IS CATEGORY II.
- C. CONTRACT DOCUMENTS:
- 1) THE CONTRACT DOCUMENTS CONSIST OF THE AGREEMENT BETWEEN THE OWNER AND CONTRACTOR, CONDITIONS OF THE CONTRACT, DRAWINGS, SPECIFICATIONS, ADDENDA ISSUED PRIOR TO EXECUTION OF THE CONTRACT, OTHER DOCUMENTS LISTED IN THE AGREEMENT AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT.
 - 2) THE GENERAL CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND DISSEMINATING ALL CONTRACT DOCUMENTS AND LATEST ADDENDA TO ALL SUB-CONTRACTORS PRIOR TO DETAILING, FABRICATION OR INSTALLATION OF WORK.
 - 3) CORRELATION OF THE CONTRACT DOCUMENTS: THE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IF CONFLICTING REQUIREMENTS ARE FOUND BETWEEN THE DRAWINGS, SPECIFICATIONS AND/OR THESE GENERAL NOTES, THE MORE STRINGENT AND HIGHEST COST REQUIREMENT SHALL CONTROL UNLESS DIRECTED OTHERWISE IN WRITING BY THE OWNER'S REPRESENTATIVE.
 - 4) THE GENERAL CONTRACTOR SHALL COMPARE THE ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR DISCREPANCIES BETWEEN EACH SET, AND WITHIN EACH SET OF DRAWINGS, AND REPORT DETAILS DISCREPANCIES, IF ANY, TO THE OWNER'S REPRESENTATIVE PRIOR TO THE DETAILING, FABRICATION AND INSTALLATION OF AFFECTED WORK.
 - 5) GENERAL CONTRACTOR SHALL COORDINATE SIZES AND LOCATIONS OF OPENINGS THROUGH FLOORS, ROOF, AND WALLS SHOWN ON ELECTRICAL, PLUMBING, AND FIRE SUPPRESSION SYSTEM DESIGN DOCUMENTS WITH ASSOCIATED SUBCONTRACTORS.
 - 6) ALTHOUGH NOT NECESSARILY SPECIFICALLY REFERENCED IN THE CONTRACT DOCUMENTS, TYPICAL DETAILS AND GENERAL NOTES APPLY TO THE ENTIRE PROJECT WHEREVER CONDITIONS SIMILAR TO THOSE DETAILED OR NOTED EXIST.
 - 7) THE USE OF ELECTRONIC FILES OR REPRODUCTION OF CONTRACT DOCUMENTS BY ANY TRADE OR MATERIAL SUPPLIER IN LIEU OF COMPLETELY INDEPENDENT PREPARATION OF SHOP DRAWINGS SIGNIFIES THE SUPPLIER'S CERTIFICATION THAT ALL INFORMATION SHOWN IN THE SHOP DRAWINGS IS CORRECT, AND ASSIGNS THEMSELVES TO RESPONSIBILITY FOR ANY JOB EXPENSE ARISING DUE TO ANY ERRORS OCCURRING THEREIN.
- D. FIELD MODIFICATIONS: CONTRACTOR OR SUBCONTRACTOR FIELD MODIFICATIONS TO THE STRUCTURE WITHOUT THE PRIOR WRITTEN CONSENT OF THE STRUCTURAL ENGINEER ARE EXPRESSLY PROHIBITED AND MAY REQUIRE SUBSEQUENT REMEDIATION DIRECTED BY THE STRUCTURAL ENGINEER AT CONTRACTOR'S EXPENSE.

2. DESIGN LOADS

- A. DEAD LOAD: SELF WEIGHT OF MATERIALS, UNLESS NOTED OTHERWISE
- B. UNIFORM LIVE LOADS:
- 1) ROOF LIVE LOAD (UNREDUCIBLE).....20 PSF
- C. WIND LOADS:
- 1) GOVERNING CODE:.....ASCE 7-10
 - 2) RISK CATEGORY:.....II
 - 3) EXPOSURE CATEGORY:.....C
 - 4) INTERNAL PRESSURE COEFFICIENT, $GPCI$:.....+/- 0.18
 - 5) TOPOGRAPHIC FACTOR, KZT :.....1.0
 - 6) DIRECTIONALITY FACTOR, KD :.....0.85
 - 7) ULTIMATE DESIGN WIND SPEED, V_{ult} :.....115 MPH
- D. SNOW LOADS:
- 1) GOVERNING CODE:.....ASCE 7-10
 - 2) SNOW IMPORTANCE FACTOR, I_s :.....1.0
 - 3) GROUND SNOW LOAD, P_g :.....10 PSF
 - 4) EXPOSURE OF ROOF:.....PARTIALLY EXPOSED
 - 5) EXPOSURE FACTOR, C_e :.....1.0
 - 6) THERMAL FACTOR, C_t :.....1.0
 - 7) ROOF SLOPE FACTOR, C_s :.....1.0
 - 8) CALCULATED FLAT ROOF SNOW LOAD, P_f :.....7.0 PSF
 - 9) MINIMUM FLAT ROOF SNOW LOAD, I^*P_g :.....10 PSF
 - 10) RAIN ON SNOW SURCHARGE LOAD:.....5 PSF
- E. SEISMIC DESIGN CRITERIA:
- 1) GOVERNING CODE:.....ASCE 7-10
 - 2) RISK CATEGORY:.....II
 - 3) SEISMIC IMPORTANCE FACTOR, I_e :.....1.00
 - 4) SOIL SITE CLASSIFICATION:.....C
 - 5) 0.2 SEC. MAPPED SPECTRAL ACCELERATION, S_s :.....0.270
 - 6) 1.0 SEC. MAPPED SPECTRAL ACCELERATION, S_1 :.....0.078
 - 7) SITE COEFFICIENT, 0.2 SEC. PERIOD, F_a :.....1.20
 - 8) SITE COEFFICIENT, 1.0 SEC. PERIOD, F_v :.....1.70
 - 9) 0.2 SEC. DESIGN SPECTRAL ACCELERATION, S_{ds} :.....0.216
 - 10) 1.0 SEC. DESIGN SPECTRAL ACCELERATION, S_{d1} :.....0.089
 - 11) SEISMIC DESIGN CATEGORY:.....B

3. MATERIAL DESIGN VALUES




- A. STRUCTURAL STEEL (MINIMUM YIELD STRENGTH)
- 1) ALL OTHER SHAPES AND PLATES UNLESS NOTED (ASTM A36)....FY = 36 KSI
- B. COLD FORMED STEEL (MINIMUM YIELD STRENGTH)
- 1) ROOF DECK (ASTM A653, SS GRADE 33, G-60 GALVANIZED)....FY = 33 KSI

4. EXISTING CONSTRUCTION


- A. ALL DETAILS FOR THE EXISTING STRUCTURE SHALL BE VERIFIED IN THE FIELD PRIOR TO PROCEEDING WITH ANY DEMOLITION OR INSTALLATION OF NEW WORK.
- B. PRIOR TO DEMOLITION OR INSTALLATION OF NEW WORK, THE CONTRACTOR SHALL MAKE WRITTEN DOCUMENTATION IF UNFORESEEN CONDITIONS OCCUR IN THE EXISTING CONSTRUCTION. THESE UNFORESEEN CONDITIONS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR REVIEW AND A WRITTEN RESPONSE BEFORE PROCEEDING WITH THE WORK.
- C. CORING FOR PIPING OR CONDUIT THROUGH EXISTING STRUCTURAL MEMBERS IS NOT ALLOWED UNLESS SPECIFICALLY SHOWN IN THE CONTRACT DOCUMENTS OR SPECIFICALLY ALLOWED BY THE STRUCTURAL ENGINEER IN WRITING.
- D. DAMAGE TO PORTIONS OF THE EXISTING STRUCTURE OR OTHER EXISTING BUILDING COMPONENTS CAUSED BY DEMOLITION OPERATIONS SHALL BE REPAIRED BY THE CONTRACTOR AT THE CONTRACTOR'S EXPENSE AND TO A LEVEL ACCEPTABLE TO THE OWNER'S REPRESENTATIVE.

5. STEEL CONSTRUCTION NOTES

- A. GOVERNING STANDARDS: ALL STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED, AND ERECTED IN ACCORDANCE WITH THE FOLLOWING STANDARDS AND AS SUPPLEMENTED BY THESE GENERAL NOTES AND THE PROJECT DRAWINGS AND SPECIFICATIONS.
- 1) ANSI/AISC 360-10 "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS" (JUNE 22, 2010)
 - 2) ANSI/AWS "D1.1-STRUCTURAL WELDING CODE - STEEL", 2011 EDITION.
- B. STEEL FABRICATION & FINISH:
- 1) ALL SHOP AND FIELD WELDS SHALL BE MADE IN ACCORDANCE WITH THE ANSI/AWS "D1.1-STRUCTURAL WELDING CODE - STEEL", 2011 EDITION. ALL WELDING SHALL USE LOW HYDROGEN PROCESSES.

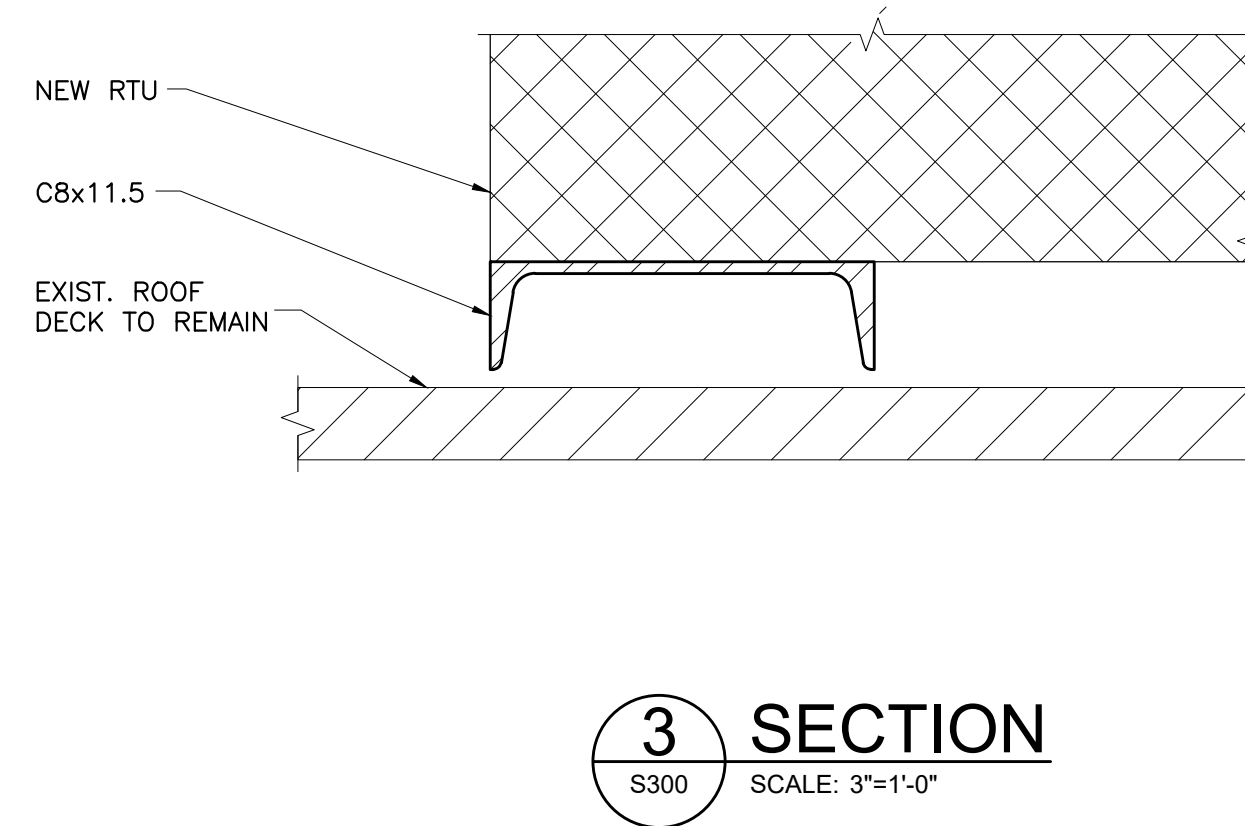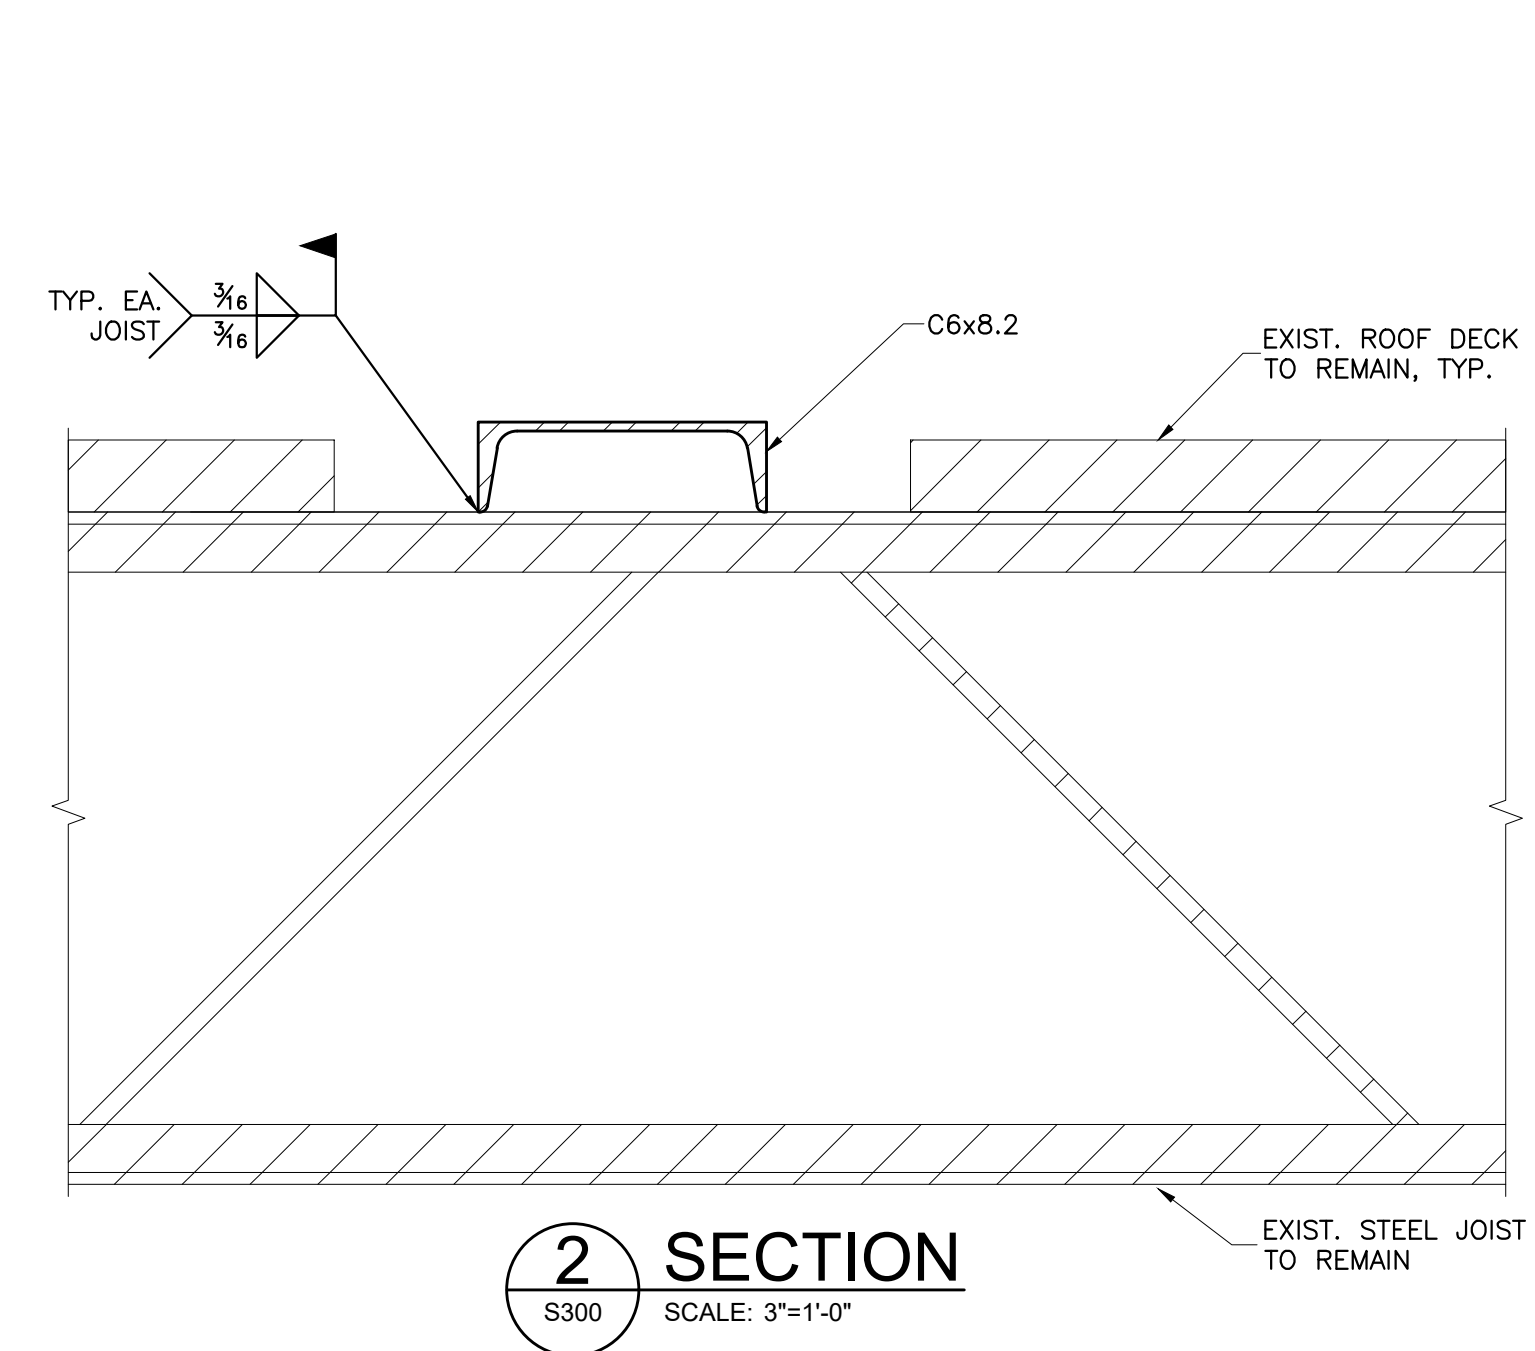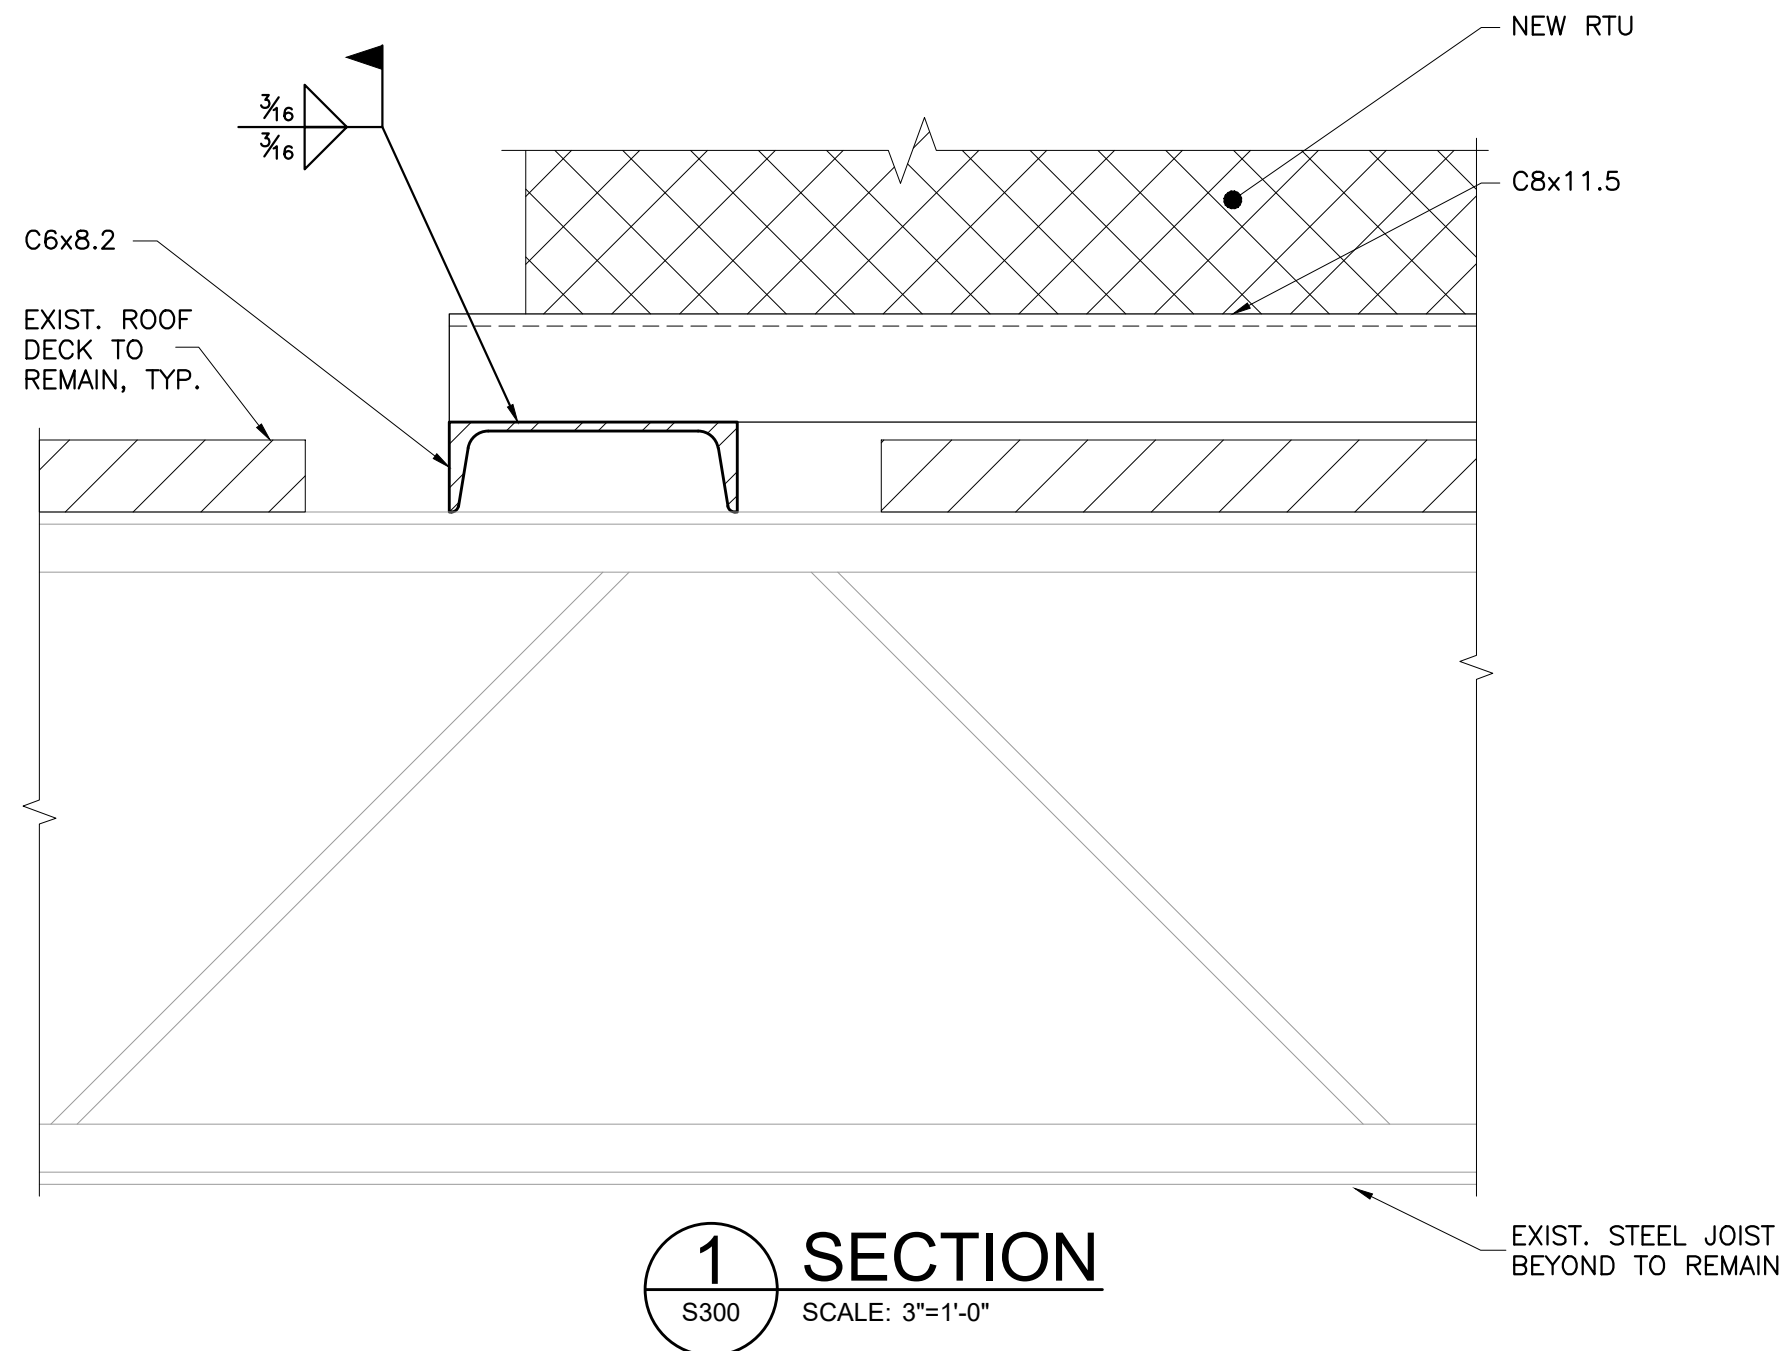

NOTE:
IF EXIST. CONDITIONS DIFFER
FROM WHAT IS SHOWN CONTACT
ARCH./ENGR. FOR FURTHER
EVALUATION AND INSTRUCTION

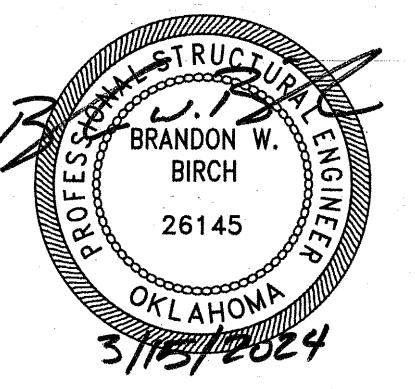

CJC	drawn by
BWB	checked by
MARCH 2024	date
	revisions



sheet no:

S300

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.




CIVIL

KFC ENGINEERING

STRUCTURAL

SALAS O'BRIEN

MECHANICAL / ELECTRICAL

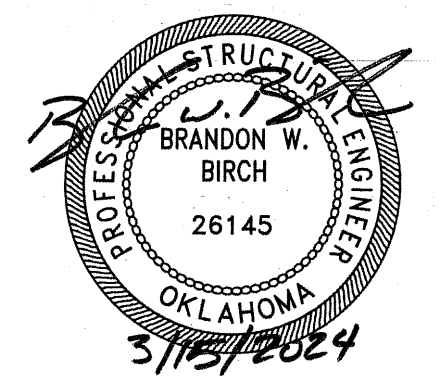

CJC

drawn by

BWB

checked by

MARCH 2024

date

revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



MOORE Public Schools
LEARNING FOR LIFE



HVAC REPLACEMENT
KINGSGATE
ELEMENTARY SCHOOL

sheet no:

S301

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

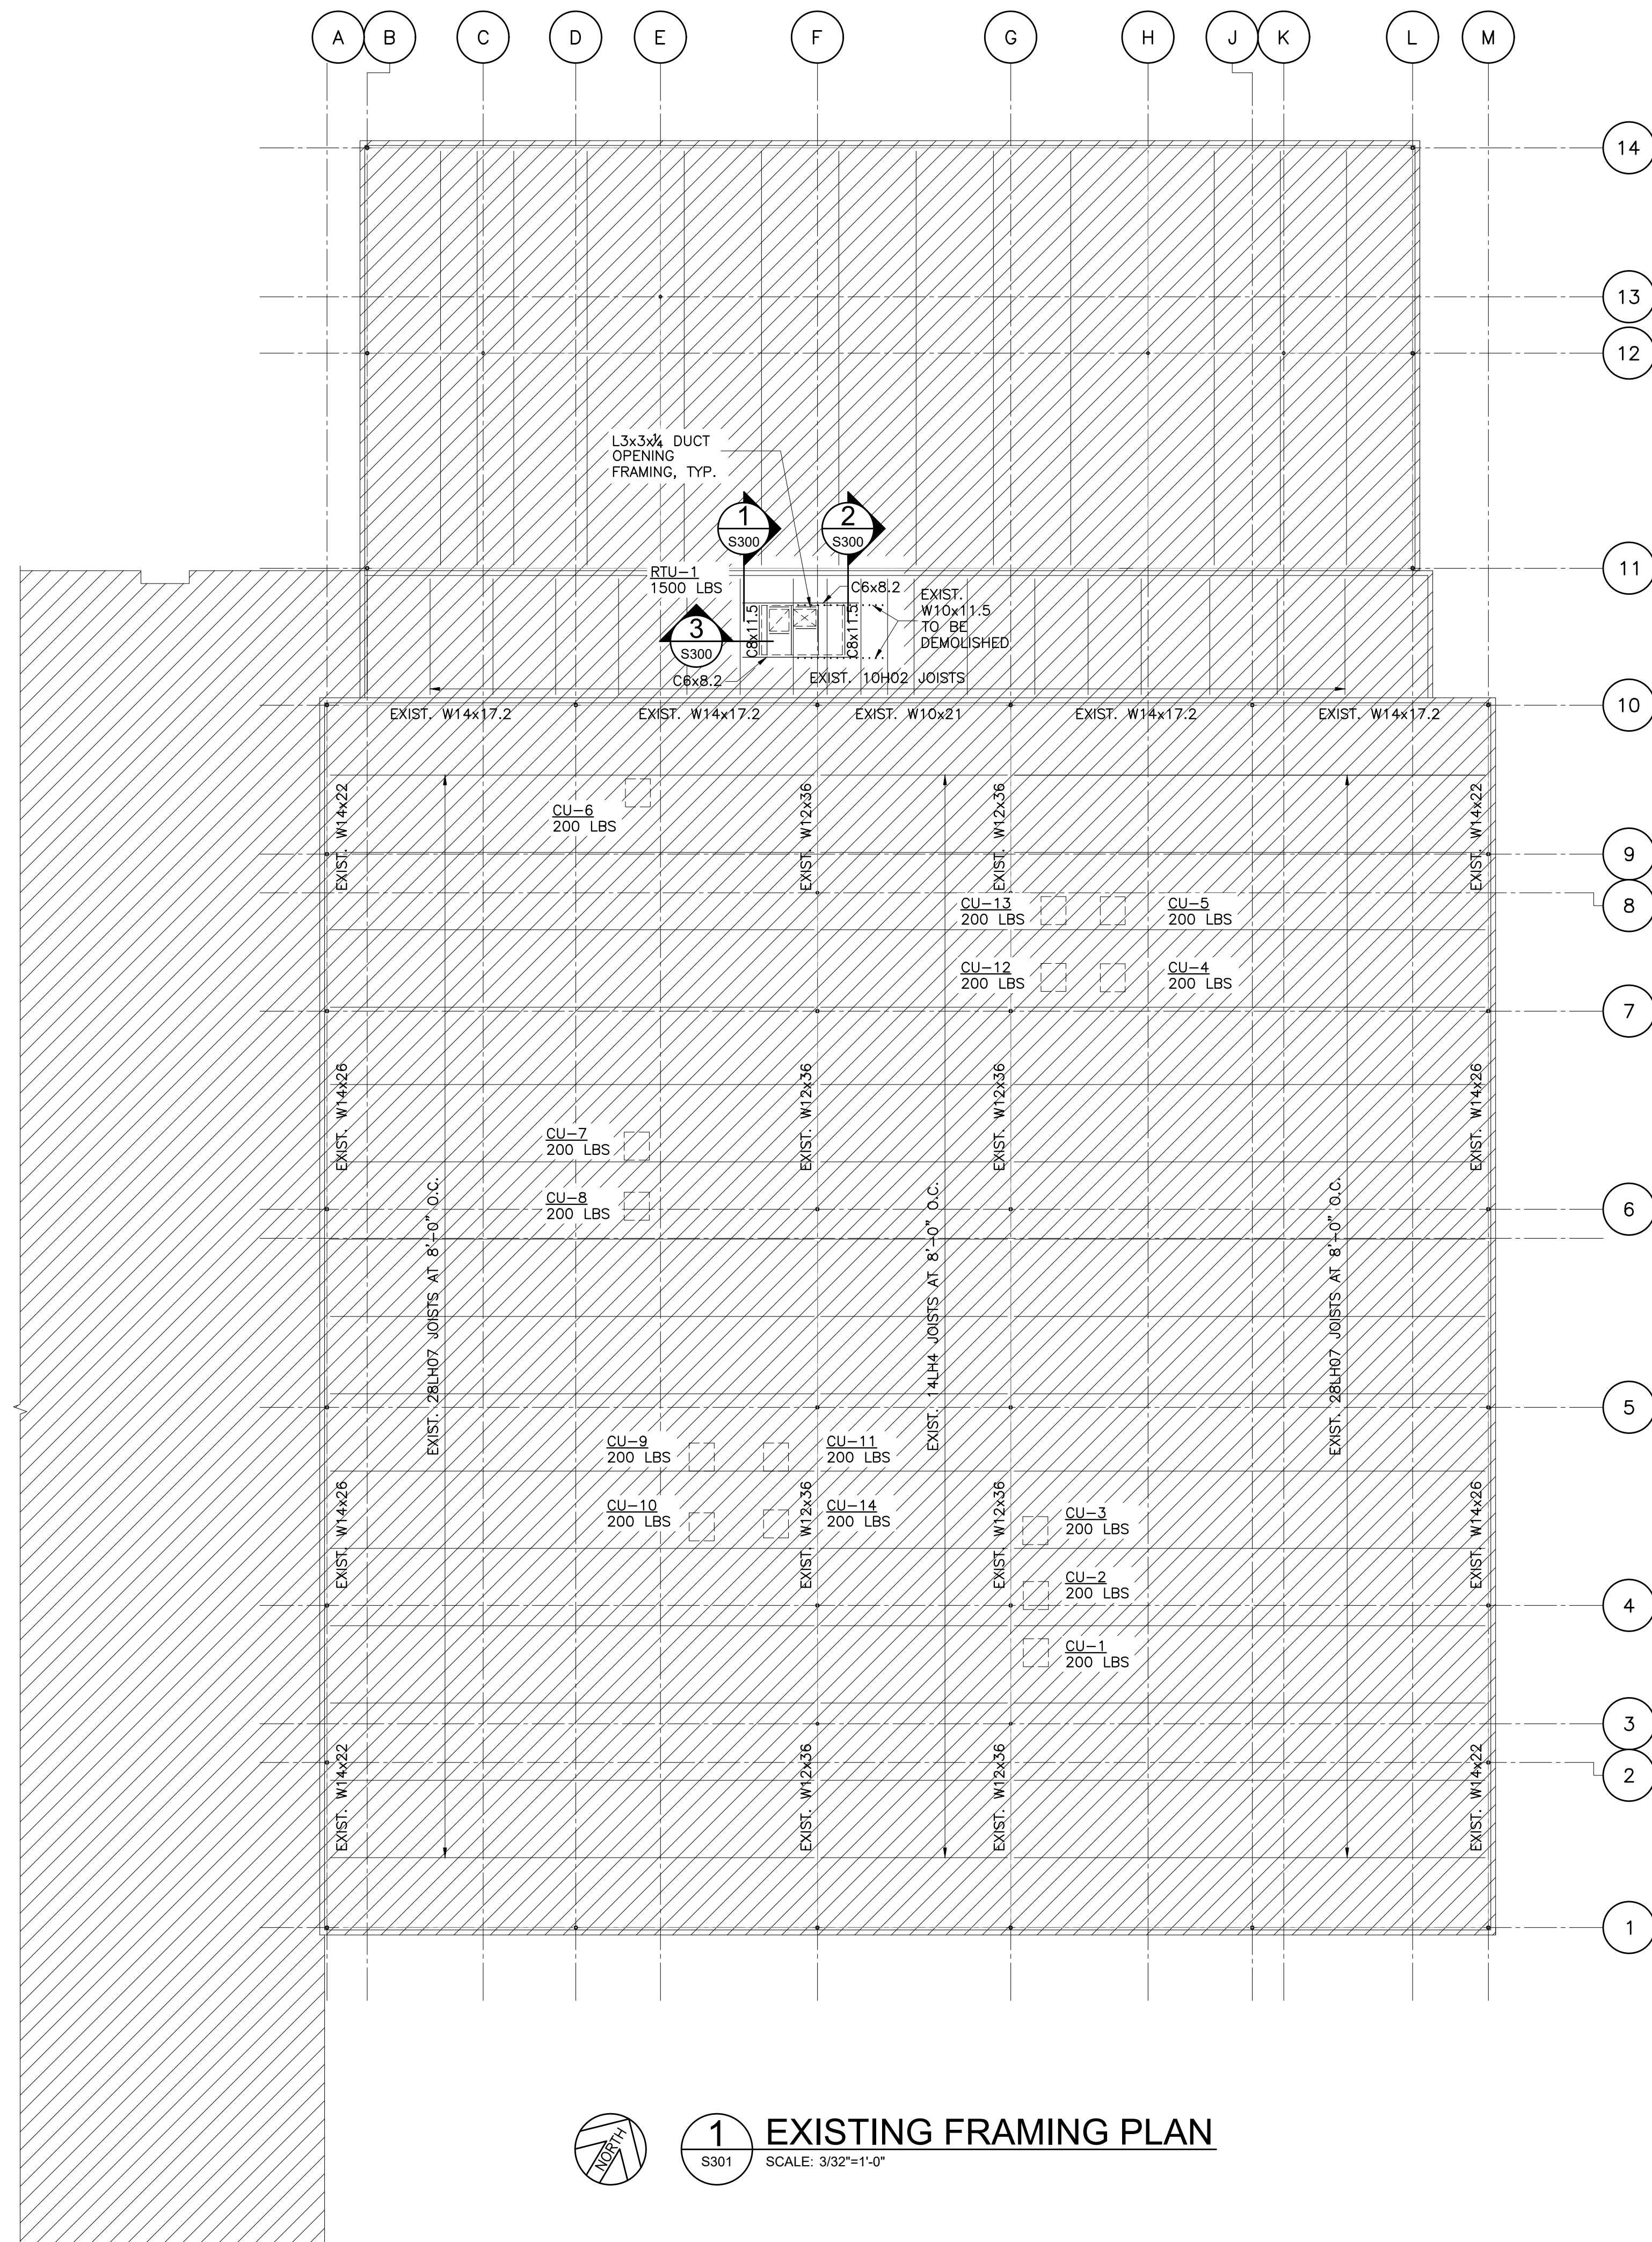

1 EXISTING FRAMING PLAN
S301 SCALE: 3/32"=1'-0"