



ELECTRICAL PACKAGE - JOB#7165196							
NO	TAG	PACKAGE #	LOCATION	SWITCHES	QUANTITY	OPTION	FANS CONTROLLED
1		SC-311109A	UTILITY CABINET RIGHT	SHIP LOOSE V/ PREFABR	1 LIGHT 1 FAN	SMART CONTROL S, THERMOSTATIC CONTROL V/ RELAY DIV/IFF WITH SUPPLY	EXHAUST 3 12000 208 7.2 SUPPLY 3 15001 208 4.4

JOB NO	7165196	MODEL NUMBER	SC-311109A	DESCRIPTION OF OPERATION	2 Panel 12000/208/7.2 Exhaust Fan and 15001/208/4.4 Supply Fan. Smart Control S, Thermostatic Control V/ Relay Div/IFF with Supply.
JOB NAME	Moore Public Schools Child Care	DATE	11/13/2024	REVISED	REV A-1

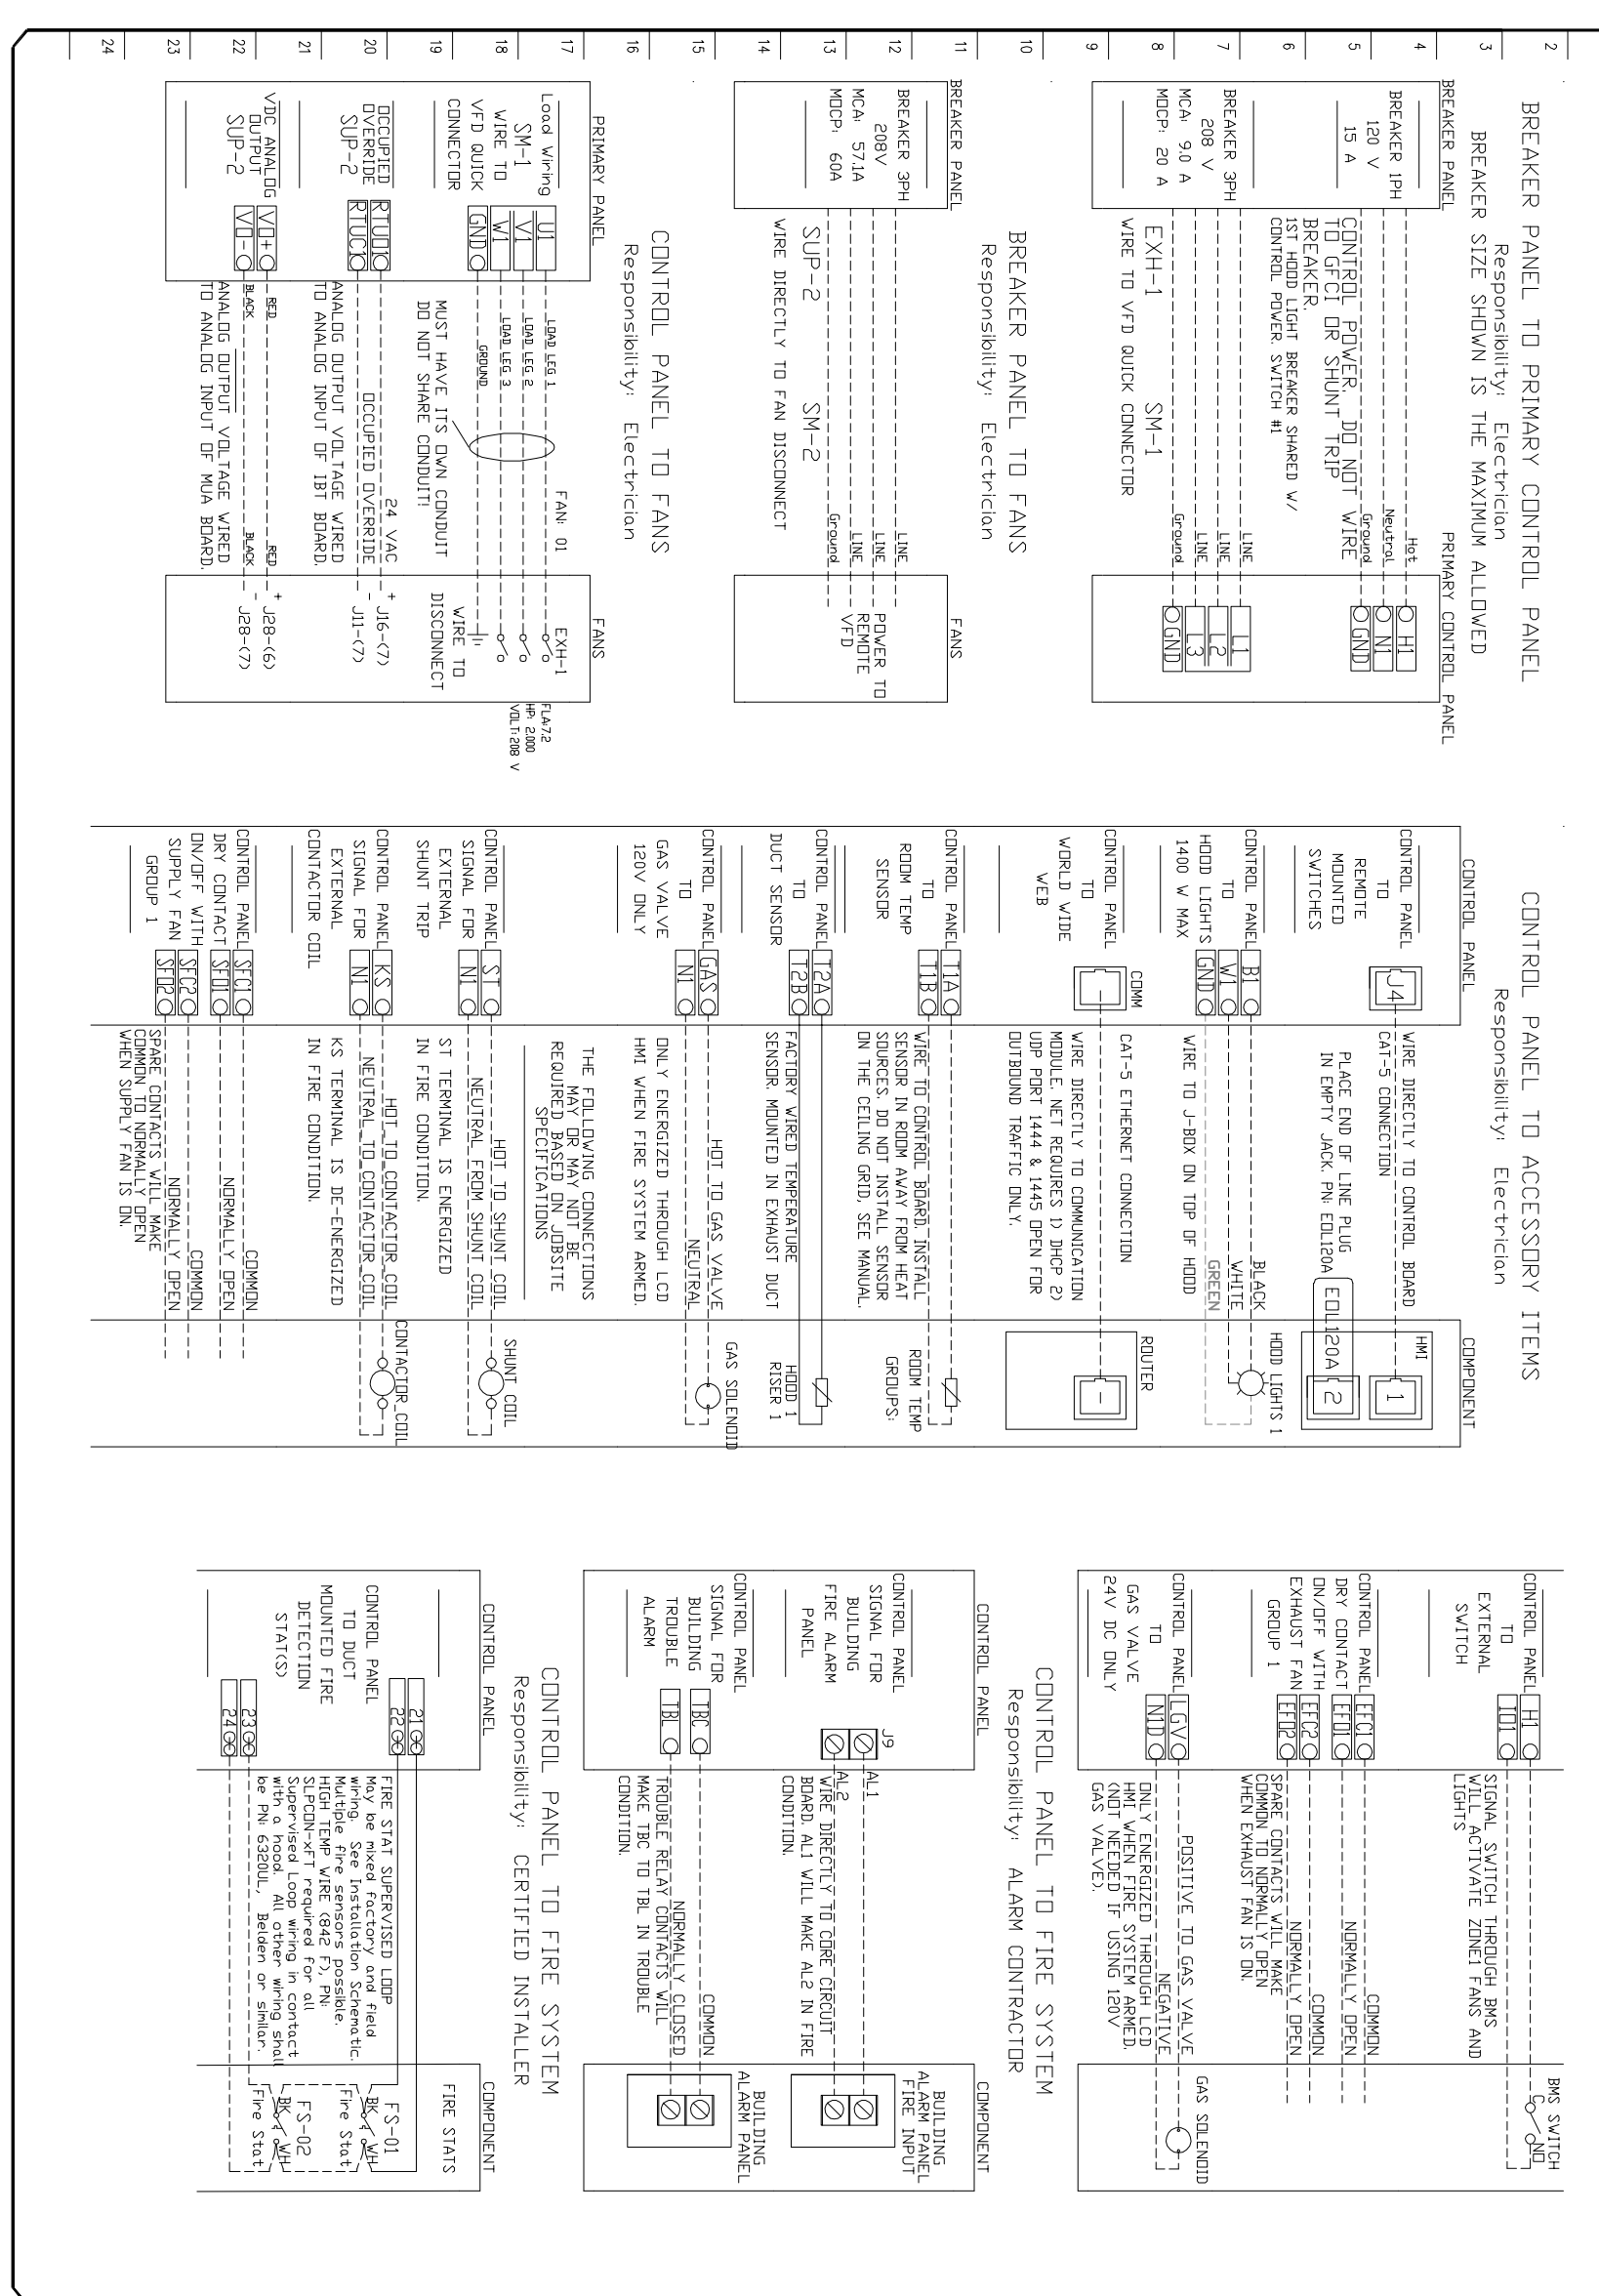

JOB NO 7165196							
NO	TAG	PACKAGE #	LOCATION	SWITCHES	QUANTITY	OPTION	FANS CONTROLLED
1		FS-1	TANK PROTECTION ELECTRICAL DETAIL				

JOB NO	7165196	MODEL NUMBER	SC-311109A	DESCRIPTION OF OPERATION	02/10/2021 Rev. 2
JOB NAME	Moore Public Schools Child Care	DATE	11/13/2024	REVISED	REV A-1

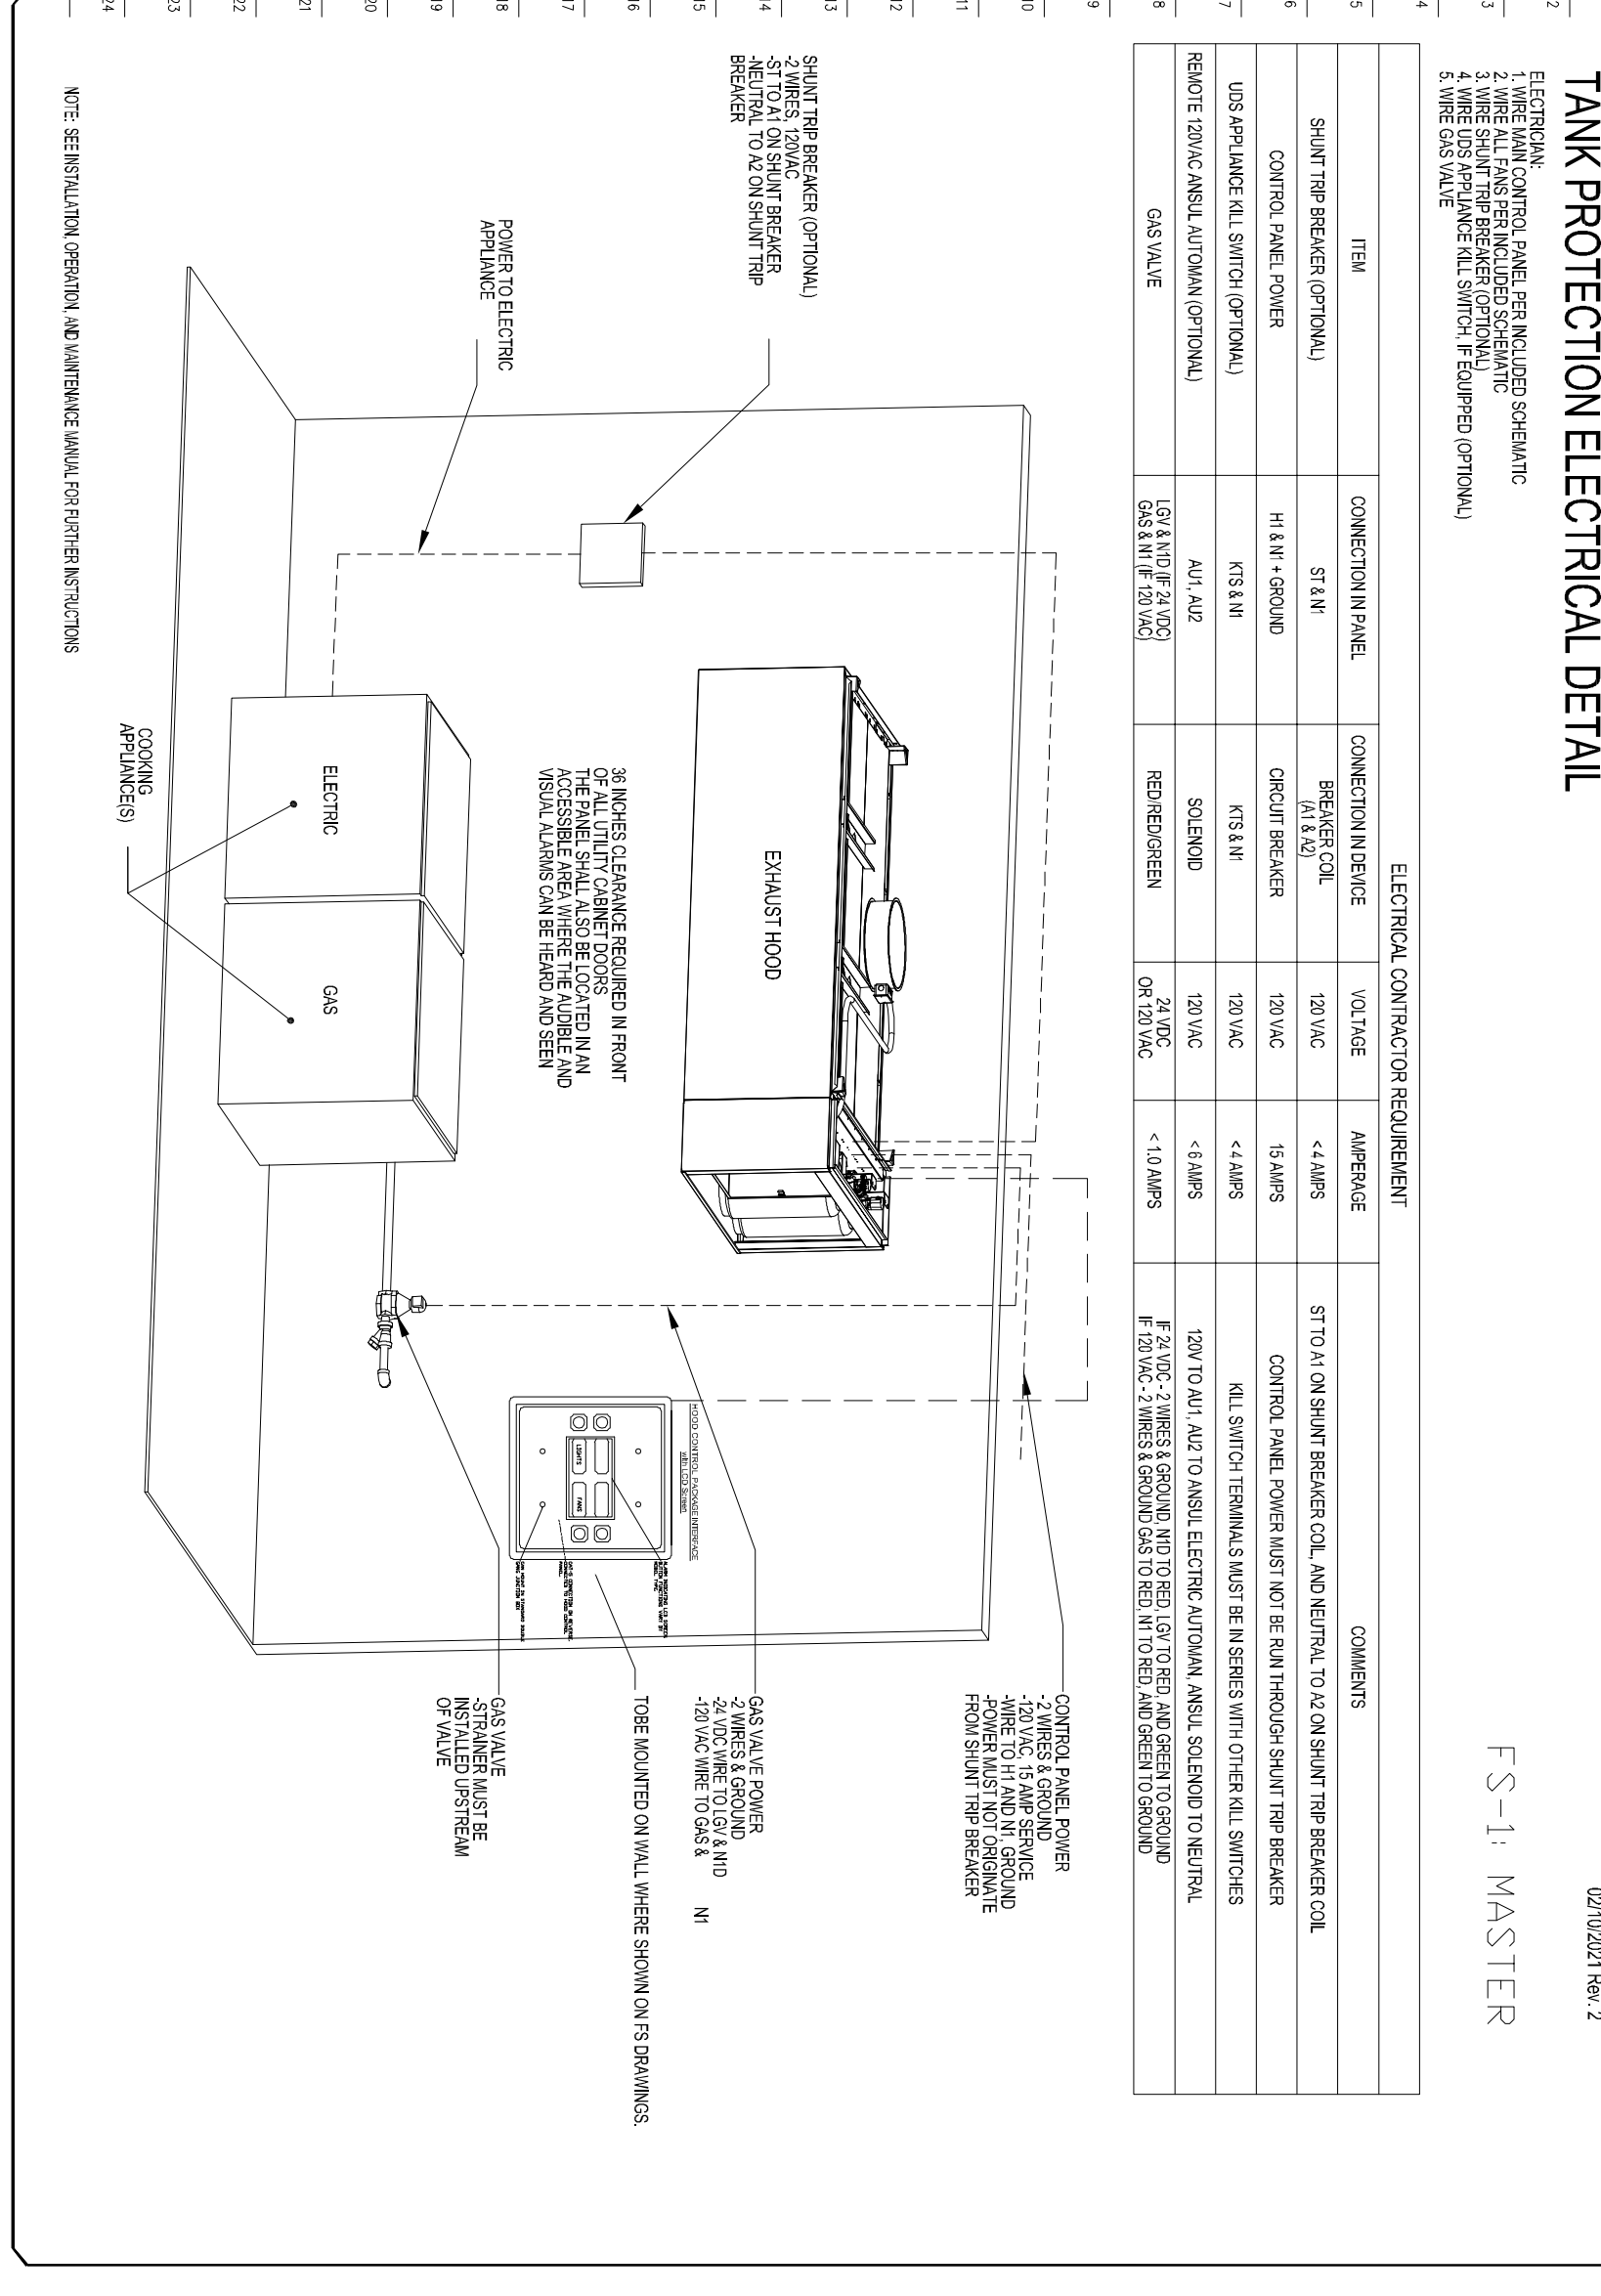


SYSTEM DESIGN VERIFICATION (SDV)

IF ORDERED, GAS SERVICE WILL PERFORM A SYSTEM DESIGN VERIFICATION (SDV) ONCE ALL EQUIPMENT HAS HAD A COMPLETE START UP PER THE OPERATION AND INSTALLATION MANUAL. TYPICALLY, THE SDV WILL BE PERFORMED AFTER ALL INSPECTIONS ARE COMPLETE.

ANY FIELD RELATED DISCREPANCIES THAT ARE DISCOVERED DURING THE SDV WILL BE BROUGHT TO THE ATTENTION OF THE GENERAL CONTRACTOR AND CORRESPONDING TRADES ON SITE. THESE ISSUES WILL BE DOCUMENTED AND FORWARDED TO THE APPROPRIATE SALES OFFICE. IF GAS SERVICE HAS TO RESOLVE A DISCREPANCY THAT IS A FIELD ISSUE, THE GENERAL CONTRACTOR WILL BE NOTIFIED AND BILLED FOR THE WORK. SHOULD A RETURN TRIP BE REQUIRED DUE TO ANY FIELD RELATED DISCREPANCY THAT CANNOT BE RESOLVED DURING THE SDV, THERE WILL BE ADDITIONAL TRIP CHARGES.

DURING THE SDV, GAS SERVICE WILL ADDRESS ANY DISCREPANCY THAT IS THE FAULT OF THE MANUFACTURER. SHOULD A RETURN TRIP BE REQUIRED, THE GENERAL CONTRACTOR AND APPROPRIATE SALES OFFICE WILL BE NOTIFIED. THERE WILL BE NO ADDITIONAL CHARGES FOR MANUFACTURER DISCREPANCIES.



FOODSERVICE EQUIPMENT VENTILATOR PLAN
NO SCALE

REVISIONS

NO	DATE	DESCRIPTION
1		

Tulsa Office
12101 East 51st Street, Suite 101A, Tulsa, OK, 74146 PHONE: (918) 258 - 0291 FAX: 9192275947 EMAIL: reg80@captivair.com

Moore Public Schools Child Care
201 North Eastern Avenue,
Moore, OK, 73160

DATE: 11/13/2024
DWG#: 7165196
DRAWN BY: R/JH-80
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO. 9

the Abila Griffin Partnership L.L.C.
313 S. E. 5th Street
MOORE, OK, 73160
405.735.3477
ACP@theAGP.net
www.theAGP.net

CEDAR CREEK
ONE
KFC ENGINEERING
STRUCTURAL
SALAS O'BRIEN
MECHANICAL/ELECTRICAL

RS
drawn by
RS
checked by
10/29/2024
date
revisions
Addendum #1 11/20/2024

MOORE PUBLIC SCHOOLS

CHILD CARE FACILITY
201 N. EASTERN AVE.

FS506

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.