


**MOORE PUBLIC SCHOOLS -
CHILD CARE CENTER**

Moore Public Schools - Moore, Oklahoma
AGP - Moore, Oklahoma

ADDENDUM NO. 4

December 19, 2024

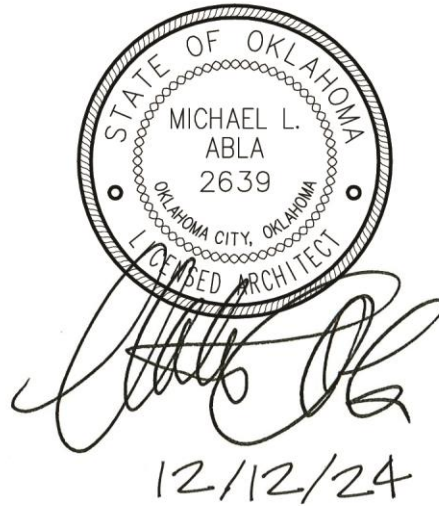

This addendum applicable to work designated herein, shall be understood to be an Addendum, and as such shall be included in the Contract Agreement.

Receipt of this Addendum shall be acknowledged by the Construction Management Firm notifying this office in writing, and by any applicable subcontractor to the CM.

This addendum consists of two (2) pages with attachments of eight (8) 8.5"x11" pages and seven (7) 24"x36" sheets.

A. Drawings:

General

1. Updated Cover Sheet. Refer to attachment.

Civil

No changes.

Structural

No changes.

Architectural

1. Sheet A100, Detail 1, Overall Floor Plan: added cubbies and lockers to classrooms as indicated. Refer to attachment.
2. Sheet A100d, Slab Demolition Plan: added sheet in its entirety. Refer to attachment.
3. Sheet A108, Detail 1, LVT Dimension / Design Plan: added flooring layouts at Indoor Plan Area, Room #417. Refer to attachment.

4. Sheet A403, Interior Elevations and Sections: added sheet in its entirety for cubbies and locker elevations and details. Refer to attachment.
5. Sheet A601, Detail 1, Room Finish Schedule: revised flooring at Room #417, Indoor Play Area to LVT and added colors to Color Schedule. Refer to attachment.
6. Sheet A602, Detail 1, Door Schedule: revised Door #1 to aluminum door and frame. Refer to attachment.
7. Sheet A602, Detail 1, Door Schedule: revised frame elevation for Door #87 to Frame Elevation "B". Refer to attachment.
8. Sheet A602, Detail 1, Door Schedule: at Doors #41 and #89, add panic device to Hardware Set #4 at each door.

Mechanical, Electrical, and Plumbing

No changes.

Food Service Documents

No changes.

B. Specifications:

1. Section 08000, Glazing: added specification in its entirety.
2. 09670, Resinous Flooring: added specification in its entirety.

END OF ADDENDUM NO. 4

DIVISION 8 - DOORS AND WINDOWS

SECTION 08800 - GLAZING

Part 1 - General

1.01 Work Included:

- A. The General Conditions and applicable sections of Division 1 shall apply to this entire section.
- B. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Quality Assurance:

- A. Standards:
 - 1. Federal Specifications
 - a. DD-G-451d, Glass, Plate, Sheet (for glazing and other uses).
 - 2. Flat Glass Jobber Association: Glazing Manual.
- B. Comply with UBC 2406, and ANSI 97.1 with testing requirements of 16 CFR 1201, Cat II.

1.03 **Products of certain manufacturers are specified herein to simplify descriptions of design, construction, and/or materials only. Proprietary names are not intended to imply that products of named manufacturer are required to the exclusion of equivalent products of other manufacturers.**

Part 2 - Products

2.01 Materials:

- A. Glass Types and Examples:
 - 1. 1/4" Tempered Glass:
 - a. Type example: 1/4" Clear Herculite - PPG.
 - 2. 1" Nominal Thickness Insulating Tempered Glass - 1/4" tinted glass @ exterior side and 1/4" 100 Low E glass @ interior side of 2" air space - **both sides tempered.** Low Emissivity coating on 3rd glass surface from building exterior.
 - a. Type Example: Versalux Green 2000 Insulated with Low-E, Visteon (Ford). **Note: Color will be a factor in approval.**
- B. Glazing Compounds and Preformed Glaze Sealants: Suitable type as approved for the installation, in accordance with Glazing Materials section of the FGJA Glazing Manual.
- C. Glazing Accessories: Provide miscellaneous materials such as cleaners, primers, setting blocks, spacers, filler rods, beads, etc., as required for complete installation.

DIVISION 8 - DOORS AND WINDOWS

SECTION 08800 - GLAZING

Part 3 - Execution

3.01 Installation:

- A. Glazing-General:
 - 1. Items to be glazed may be field-or shop-glazed, using glass of the quality and thickness specified or indicated. Preparation of surrounds and glazing, unless otherwise specified, shall be in conformance with the details and general conditions governing glazing in the FGMA Glazing Manual, beads or stops which are furnished with the items to be glazed shall be used to secure the glass in place.
 - 2. All glass shall be set with the waves parallel to the sill. Glass that has been misordered, i.e. with the width and height dimensions not properly correlated with the Drawing process in manufacturing, resulting in pronounced waviness at right angles to the sill, will be rejected.
 - 3. Install plastic glass edging strips where indicated. Joints shall be as tight and imperceptible as possible.
- B. Breakage: Replace all glass broken during or after setting. Breakage due to accident or carelessness or other will be charged to trade at fault.
- C. Inspection: Prior to final acceptance of project, inspect all work done under this section and make all necessary adjustments, repairs or replacements of defective work, and clean all glass surfaces.
- D. Clean-up: Remove all glass cuttings, scraps, packaging and rubbish upon completion of the work.

End of Section

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

Part 1 - General

1.01 Work Included:

- A. All materials, labor, services and incidentals necessary for the completion of this section of the work.

1.02 Quality Assurance:

- A. The Manufacturer shall have a minimum of 10 years experience in the production, sales, and technical support of epoxy and urethane industrial flooring and related materials.
- B. The Applicator shall have experience in installation of the flooring system as confirmed by the manufacturer in all phases of surface preparation and application of the product specified.
- C. No requests for substitutions shall be considered that would change the generic type of the specified System.
- D. System shall be in compliance with requirements of United States Department of Agriculture (USDA), Food, Drug Administration (FDA), and local Health Department.
- E. System shall be in compliance with the Indoor Air Quality requirements of California section 01350 as verified by a qualified independent testing laboratory.
- F. A pre-installation conference shall be held between Applicator, General Contractor and the Architect for review and clarification of this specification, application procedure, quality control, inspection and acceptance criteria and production schedule.

1.03 Submittals:

- A. Provide submittals in the form of samples (3 x 3 inch square), and documentation, to the Architect for review.

1.04 Product Delivery, Storage and Handling:

- A. All materials shall be delivered to the job site with manufacturer's labels intact and stored in an enclosed dry storage area providing protection from damage, out of direct sunlight, and exposure to the elements in accordance with the manufacturer's recommendations and relevant health and safety regulations.

1.05 System Description:

- A. The work shall consist of preparation of the substrate, the furnishing and application of a cementitious urethane based self-leveling seamless flooring system with Q-Rok quartz aggregate broadcast and novolac epoxy topcoat.
- B. The system shall have the color and texture as specified by the Owner with a nominal thickness of 1/4 inch. It shall be applied to the prepared area(s) as defined in the plans strictly in accordance with the Manufacturer's recommendations.
- C. Cove base (if required) to be applied where noted on plans and

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

per manufacturers standard details unless otherwise noted.

1.06 Project Conditions:

A. Site Requirements:

1. Application may proceed while air, material and substrate temperatures are between 60 F and 85 F providing the substrate temperature is above the dew point. Outside of this range, the Manufacturer shall be consulted.
2. The relative humidity in the specific location of the application shall be less than 85 % and the surface temperature shall be at least 5 F above the dew point.
3. The Applicator shall be supplied with adequate lighting equal to the final lighting level during the preparation and installation of the system.

B. Conditions of new concrete to be coated with cementitious urethane material.

1. Concrete shall be moisture cured for a minimum of 7 days and have fully cured for 14 days in accordance with ACI-308 prior to the application of the coating system pending moisture tests. Outside of these parameters manufacturer shall be consulted.
2. Concrete shall have a flat rubbed finish, float or light steel trowel finish (a hard steel trowel finish is neither necessary nor desirable).
3. Sealers and curing agents should not to be used.
4. Concrete surfaces on grade shall have been constructed with a vapor barrier to protect against the effects of vapor transmission and possible delamination of the system.

C. Safety Requirements:

1. The Owner shall be responsible for the removal of foodstuffs from the work area.
2. Non-related personnel in the work area shall be kept to a minimum.

1.07 Waste Disposal:

- A. The Applicator shall be provided with adequate disposal facilities for non-hazardous waste generated during installation of the system.

1.08 Warranty:

- A. Dur-A-Flex, Inc. warrants that material shipped to buyers at the time of shipment substantially free from material defects and will perform substantially to Dur-A-Flex, Inc. published literature if used in accordance with the latest prescribed procedures and prior to the expiration date.
- B. Dur-A-Flex, Inc. liability with respect to this warranty is strictly limited to the value of the material purchase.

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

Part 2 - Products

2.01 Flooring:

- A. Dur-A-Flex, Inc, Poly-Crete MDB (self leveling broadcast quartz), Novolac topcoat seamless flooring system.
 - 1. System Materials:
 - a. Topping: Dur-A-Flex, Inc, Poly-Crete MD resin, hardener and MD aggregate.
 - b. The aggregate shall be Dur-A-Flex, Inc. Q-Rok quartz aggregate.
 - d. Topcoat: Dur-A-Flex, Inc. Dur-A-Glaze Novolac resin and hardener.
 - 2. Patch Materials:
 - a. Shallow Fill and Patching: Use Dur-A-Flex, Inc. Poly-Crete MD (up to ¼ inch).
 - b. Deep Fill and Sloping Material (over ¼ inch): Use Dur-A-Flex, Inc. Dur-A-Tex UM

2.02 Manufacturer:

- A. Dur-A-Flex, Inc., 95 Goodwin Street, East Hartford, CT 06108, Phone: (860) 528-9838, Fax: (860) 528-2802
- B. Manufacturer of Approved System shall be single source and made in the USA.

2.03 Product Requirements:

- A. Topping Poly-Crete MD
 - 1. Percent Reactive 100 %
 - 2. VOC 0 g/L
 - 3. Bond Strength to Concrete ASTM D 4541 >400 psi, substrates fails
 - 4. Compressive Strength, ASTM C 579 9,000 psi
 - 5. Tensile Strength, ASTM D 638 2,175 psi
 - 6. Impact Resistance @ 125 mils, MIL D-3134, >160 inch lbs
No visible damage or deterioration
- B. Topcoat Dur-A-Glaze Novolac
 - 1. Percent Solids 100 %
 - 2. VOC 8 g/L
 - 3. Flexural Strength, ASTM C 580 5,500 psi
 - 4. Tensile Strength, ASTM D 638 2,500 psi
 - 5. Flexural Modulus, ASTM D 790 1.95 x 10⁶ psi
 - 6. Coefficient of thermal expansion ASTM D 696 2.2 x 10⁻⁵ in/in/F
 - 7. Water Absorption ASTM D 570 0.05 %, 24 hrs in water
 - 8. Abrasion Resistance, ASTM D 4060 C-10 Wheel, 1,000 gm load, 1,000 cycles 0.075 mg weight loss
 - 9. Flammability, ASTM D 636 Self-Extinguishing

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

10. Potlife @ 70 F	30 minutes
11. Tack Free Time @ 70 F (ready for re-coat)	8-10 hours
12. Cure Time for Traffic @ 70 F	24 hours
13. Heat Resistance Limitation	250 F

Part 3 - Execution

3.01 Examination:

A. Examine substrates, areas and conditions, with Applicator present, for compliance with requirements for maximum moisture content, installation tolerances and other conditions affecting flooring performance.

1. Verify that substrates and conditions are satisfactory for flooring installation and comply with requirements specified.

3.02 Preparation:

A. General:

1. New and existing concrete surfaces shall be free of oil, grease, curing compounds, loose particles, moss, algae growth, laitance, friable matter, dirt, and bituminous products.
2. Moisture Testing: Perform tests recommended by manufacturer and as follows.
 - a. Perform anhydrous calcium chloride test ASTM F 1869-98. Application will proceed only when the vapor/moisture emission rates from the slab is less than and not higher than 20 lbs/1,000 sf/24 hrs.
 - b. Perform relative humidity test using in situ probes, ASTM F 2170. Proceed with installation only after substrates have a maximum 99% relative humidity level measurement.

3. Mechanical surface preparation

- a. Shot blast all surfaces to receive flooring system with a mobile steel shot, dust recycling machine (Blastrac or equal). All surface and embedded accumulations of paint, toppings hardened concrete layers, laitance, power trowel finishes and other similar surface characteristics shall be completely removed leaving a bare concrete surface having a minimum profile of CSP 4-6 as described by the International Concrete Repair Institute.
- b. Floor areas inaccessible to the mobile blast machines shall be mechanically abraded to the same degree of cleanliness, soundness and profile using diamond grinders, needle guns, bush hammers, or other suitable equipment.
- c. Wherever a free edge will occur, including doorways, wall perimeters, expansion joints, columns, doorways, drains and equipment pads, a ¼ inch deep by 1/4 inch wide keyways shall be cut in.

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

d. Cracks and joints (non-moving) greater than 1/4 inch wide are to be chiseled or chipped-out and repaired per manufacturer's recommendations.

4. At spalled or worn areas, mechanically remove loose or delaminated concrete to a sound concrete and patch per manufactures recommendations.

3.03 Applying Texture Finishes:

A. General:

1. The system shall be applied in three distinct steps as listed below:
 - a. Substrate preparation
 - b. Topping/overlay application with quartz aggregate broadcast.
 - c. Topcoat application
2. Immediately prior to the application of any component of the system, the surface shall be dry and any remaining dust or loose particles shall be removed using a vacuum or clean, dry, oil-free compressed air.
3. The handling, mixing and addition of components shall be performed in a safe manner to achieve the desired results in accordance with the Manufacturer's recommendations.
4. The system shall follow the contour of the substrate unless pitching or other leveling work has been specified by the Architect.
5. A neat finish with well-defined boundaries and straight edges shall be provided by the Applicator.

B. Topping:

1. The topping shall be applied as a self-leveling system as specified. The topping shall be applied in one lift with a nominal thickness of 3/16 inch.
2. The topping shall be comprised of three components, a resin, hardener and filler as supplied by the Manufacturer.
3. The hardener shall be added to the resin and thoroughly dispersed by suitably approved mechanical means. Aggregate shall then be added to the catalyzed mixture and mixed in a manner to achieve a homogenous blend.
4. The topping shall be applied over horizontal surfaces using a pin rake, trowels or other systems approved by the Manufacturer.
5. Immediately upon placing, the topping shall be degassed with a 15/16 inch spiked roller.
 6. Quartz aggregate shall be broadcast to excess into the wet material at the rate of 1 lbs/sf.
7. Allow material to fully cure. Vacuum, sweep and/or blow to remove all loose aggregate.

DIVISION 9 - FINISHES

SECTION 09670 - RESINOUS FLOORING

- C. Topcoat:
 - 1. The topcoat shall be squeegee applied and back rolled with a coverage rate of 60 sf per kit
 - 2. The topcoat shall be comprised of a liquid resin and a liquid hardener that is mixed as a kit in and installed per the manufacturer's recommendations.
 - 3. The finish floor will have a nominal thickness of 1/4 inch.
- 3.04 Field Quality Control:
 - A. Tests, Inspection:
 - 1. The following tests shall be conducted by the Applicator:
 - a. Temperature
 - 1. Air, substrate temperatures and, if applicable, dew point.
 - b. Coverage Rates
 - 1. Rates for all layers shall be monitored by checking quantity of material used against the area covered.
- 3.05 Cleaning and Protection:
 - A. Cure flooring material in compliance with manufacturer's directions, taking care to prevent their contamination during stages of application and prior to completion of the curing process.
 - B. Remove Masking - perform detail cleaning at floor termination, to leave cleanable surface for subsequent work of other sections.

End of Section



MOORE PUBLIC SCHOOLS DISTRICT NO. 1-2
CLEVELAND COUNTY MOORE, OKLAHOMA

CHILD CARE CENTER

201 NORTH EASTERN AVE.
MOORE, OK. 73160

AGP | the Abila Griffin
Partnership

313 SE. 5TH ST. MOORE, OK. 73160
405.735.3477 AGP@theAGP.net www.theAGP.net



CONSTRUCTION MANAGER



1909 S. EASTERN AVE.
MOORE, OK 73160

STRUCTURAL
KFC ENGINEERING

205 NW 63rd, SUITE 390
OKLAHOMA CITY, OK 73116

MECHANICAL/ELECTRICAL/PLUMBING

SALAS O'BRIEN

2900 S. TELEPHONE RD., SUITE 120
MOORE, OKLAHOMA 73160

CIVIL

CEDAR CREEK

11912 N. PENNSYLVANIA AVE., SUITE D4
OKLAHOMA CITY, OK 73120

KITCHEN CONSULTANT

STURM CONSULTING, INC.

6838 S. HUDSON PL.
TULSA, OK. 74135

INDEX TO DRAWINGS

SHEET NUMBER	DESCRIPTION	SHEET NUMBER	DESCRIPTION
C	COVER SHEET	F101	FIRE PROTECTION PLAN - SITE
--	TOPOGRAPHIC SURVEY - FOR INFORMATION ONLY	P000	GENERAL NOTES
G100	LEGENDS / MAPS / ETC.	P001	PLUMBING SITE PLAN
G101	SHELTER CALCULATION PLAN / SHELTER LOCATION PLAN	P100	PLUMBING PLAN - BELOW GRADE
GEN-101	GENERATOR BUILDING FLOOR PLAN / ELEVATIONS / SECTIONS / DETAILS	P110	PLUMBING PLAN - ABOVE GRADE
C200	DEMOLITION SITE PLAN	P201	PLUMBING PLAN - ROOF
C300	SITE PLAN - PARKING REQUIREMENTS	P301	PLUMBING ISOMETRIC WASTE & VENT
C900	ENLARGED SITE PLAN / DETAILS	P302	PLUMBING ISOMETRIC WATER SUPPLY
		P501	DETAILS
		P502	DETAILS
		P801	SCHEDULES
		M000	MECHANICAL NOTES
		M101	MECHANICAL PLAN
		M201	MECHANICAL ROOF PLAN
		M501	DETAILS
		M801	SCHEDULES
		T000	TECHNOLOGY LEGENDS / NOTES
		T101	TECHNOLOGY SITE PLAN
		T201	TECHNOLOGY PLAN
		T301	DETAILS
		T302	DETAILS
		T303	DETAILS
		T304	DETAILS
		T401	SYSTEM SPECIFICATIONS
		T402	SYSTEM SPECIFICATIONS
		T403	SYSTEM SPECIFICATIONS
		E000	ELECTRICAL NOTES / SCHEDULES
		E100	ELECTRICAL SITE PLAN
		E101	ELECTRICAL LIGHTING PLAN
		E201	ELECTRICAL POWER PLAN
		E202	ELECTRICAL ROOF PLAN
		E203	ELECTRICAL KITCHEN PLAN
		E401	ELECTRICAL ONE-LINE DIAGRAM / SCHEDULE
		E501	DETAILS
		E502	DETAILS
		E801	SCHEDULES
		E802	SCHEDULES

A100a	FOUNDATION PLAN	A100a	FOUNDATION PLAN
A100b	PARTIAL FOUNDATION PLAN	A100b	PARTIAL FOUNDATION PLAN
A100c	OVERALL FRAMING PLAN	A100c	OVERALL FRAMING PLAN
A100d	FRAMING PLAN	A100d	FRAMING PLAN
A101	FOUNDATION SECTIONS	A101	FOUNDATION SECTIONS
A102	FRAMING SECTIONS	A102	FRAMING SECTIONS
A103	FRAMING SECTIONS	A103	FRAMING SECTIONS
A104	FRAMING SECTIONS	A104	FRAMING SECTIONS
A105	FRAMING SECTIONS	A105	FRAMING SECTIONS
A106	FRAMING SECTIONS	A106	FRAMING SECTIONS
A107	FRAMING SECTIONS	A107	FRAMING SECTIONS
A107a	FRAMING SECTIONS	A107a	FRAMING SECTIONS
A107b	FRAMING SECTIONS	A107b	FRAMING SECTIONS
A109	FRAMING SECTIONS	A109	FRAMING SECTIONS
A301	FRAMING SECTIONS	A301	FRAMING SECTIONS
A302	FRAMING SECTIONS	A302	FRAMING SECTIONS
A303	FRAMING SECTIONS	A303	FRAMING SECTIONS
A401	FRAMING SECTIONS	A401	FRAMING SECTIONS
A402	FRAMING SECTIONS	A402	FRAMING SECTIONS
A403	FRAMING SECTIONS	A403	FRAMING SECTIONS
A601	FRAMING SECTIONS	A601	FRAMING SECTIONS
A602	FRAMING SECTIONS	A602	FRAMING SECTIONS
A701	FRAMING SECTIONS	A701	FRAMING SECTIONS
A702	FRAMING SECTIONS	A702	FRAMING SECTIONS
F102	FRAMING SECTIONS	F102	FRAMING SECTIONS
FS201	FRAMING SECTIONS	FS201	FRAMING SECTIONS
FS301	FRAMING SECTIONS	FS301	FRAMING SECTIONS
FS401	FRAMING SECTIONS	FS401	FRAMING SECTIONS
FS501	FRAMING SECTIONS	FS501	FRAMING SECTIONS
FS601	FRAMING SECTIONS	FS601	FRAMING SECTIONS
FS701	FRAMING SECTIONS	FS701	FRAMING SECTIONS
FS801	FRAMING SECTIONS	FS801	FRAMING SECTIONS

CHILD CARE CENTER
SET NO.

Revisions:

- △ ADDENDUM #1
- △ ADDENDUM #2
- △ ADDENDUM #4

Sheet no:

C

date:

OCTOBER 2024



10/22/24

CG
drawn by _____
MA
checked by _____
OCTOBER 2024
date
revisions
A ADDENDUM #1
B ADDENDUM #2
C ADDENDUM #4



MOORE
PUBLIC SCHOOLS


CHILD CARE FACILITY
201 N. EASTERN AVE.

Sheet No.:


A100

OWNERSHIP USE OF DOCUMENTS:

APP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESS WRITTEN
CONSENT OF AGP.

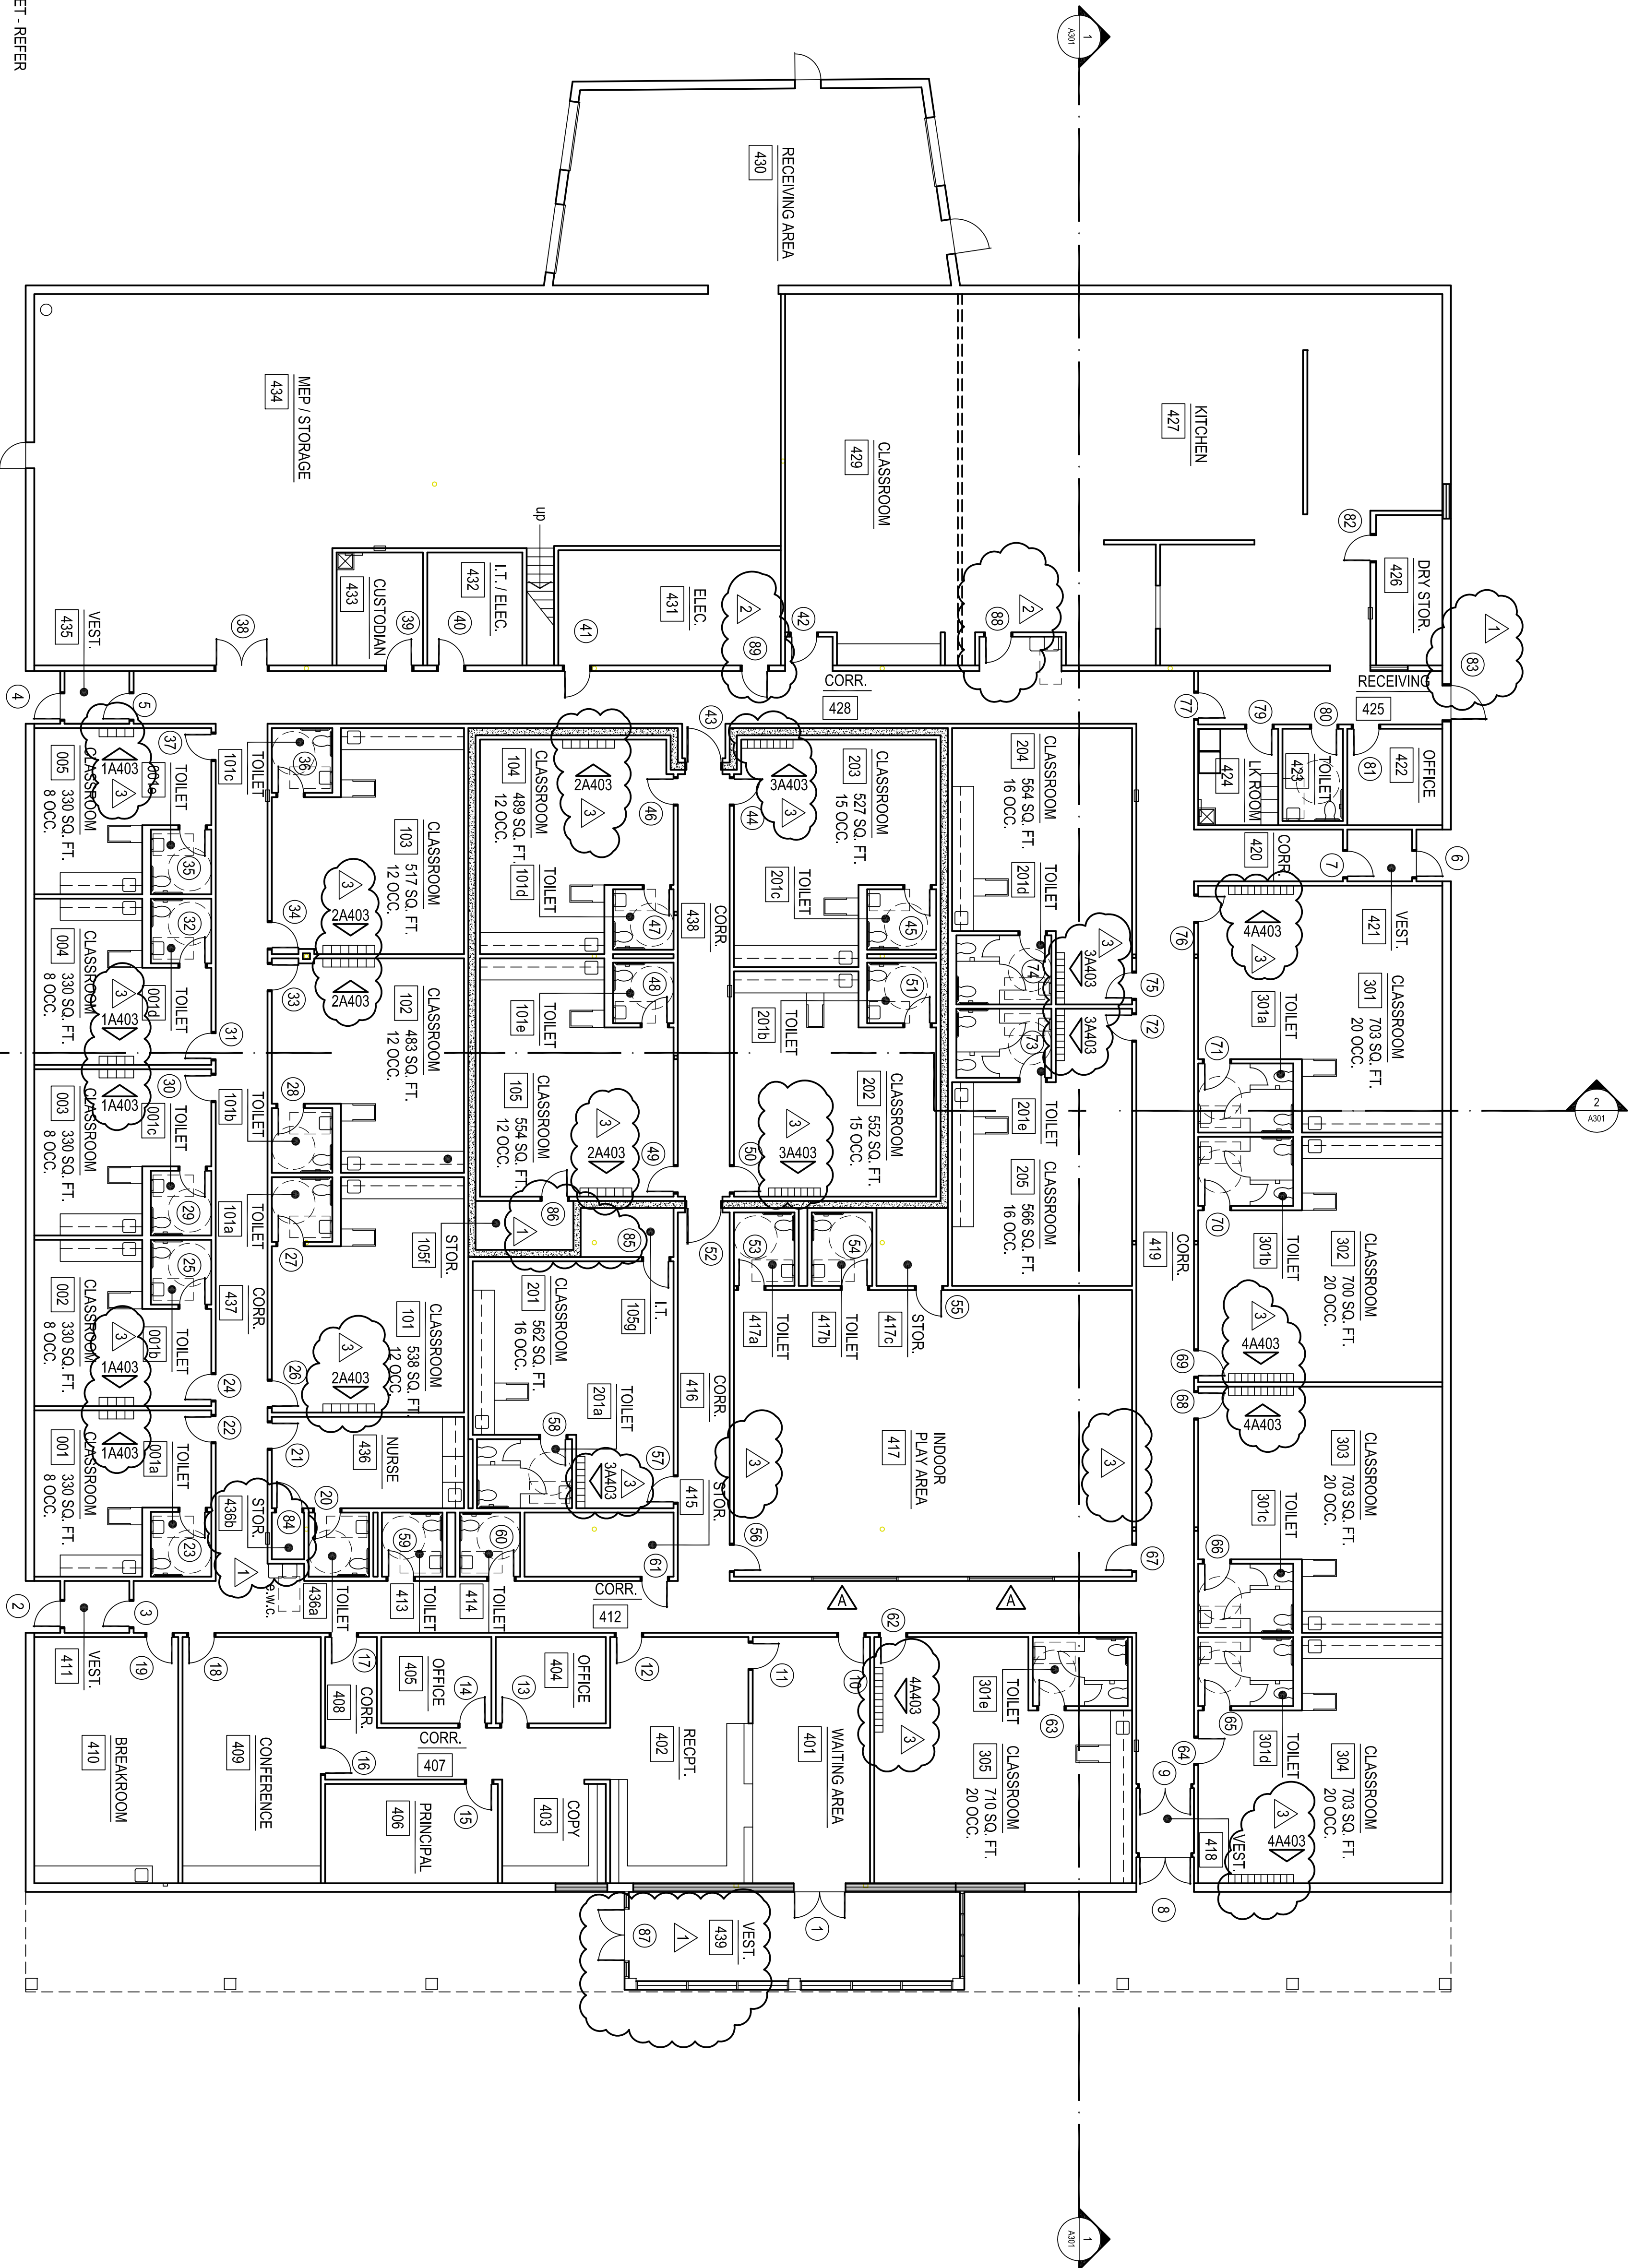




- GENERAL NOTES:
1. F.E.C. - FIRE EXTINGUISHER AND CABINET - REFER EQUIPMENT PLAN FOR LOCATIONS
 2. ADD CORNER GUARDS (C.G.) AT ALL INTERIOR LOCATIONS
 3. REFER SHEETS A103, A104 & A105 FOR ENLARGED PLANS
 4. REFER SHEETS A100a FOR DIMENSION PLAN
 5. NUMBER OF CLASSROOM STUDENT OCCUPANTS ARE BASED ON DEPARTMENT OF HUMAN SERVICES' 2022 LIMITS



1

OVERALL FLOOR PLAN
3/8" = 1'-0"

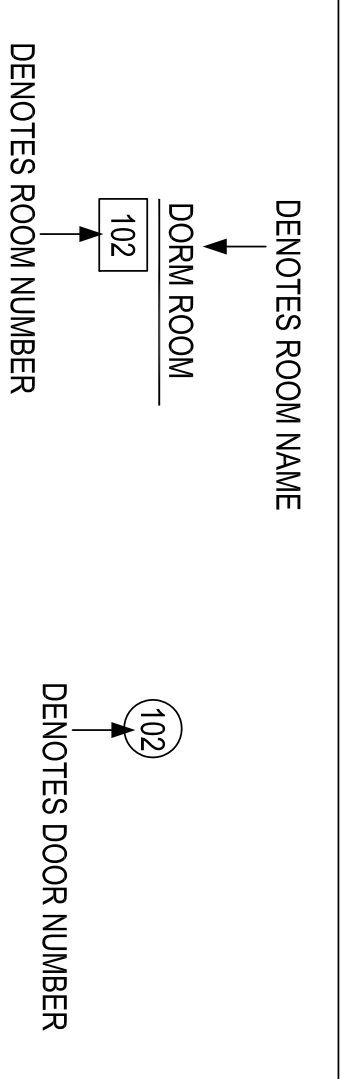

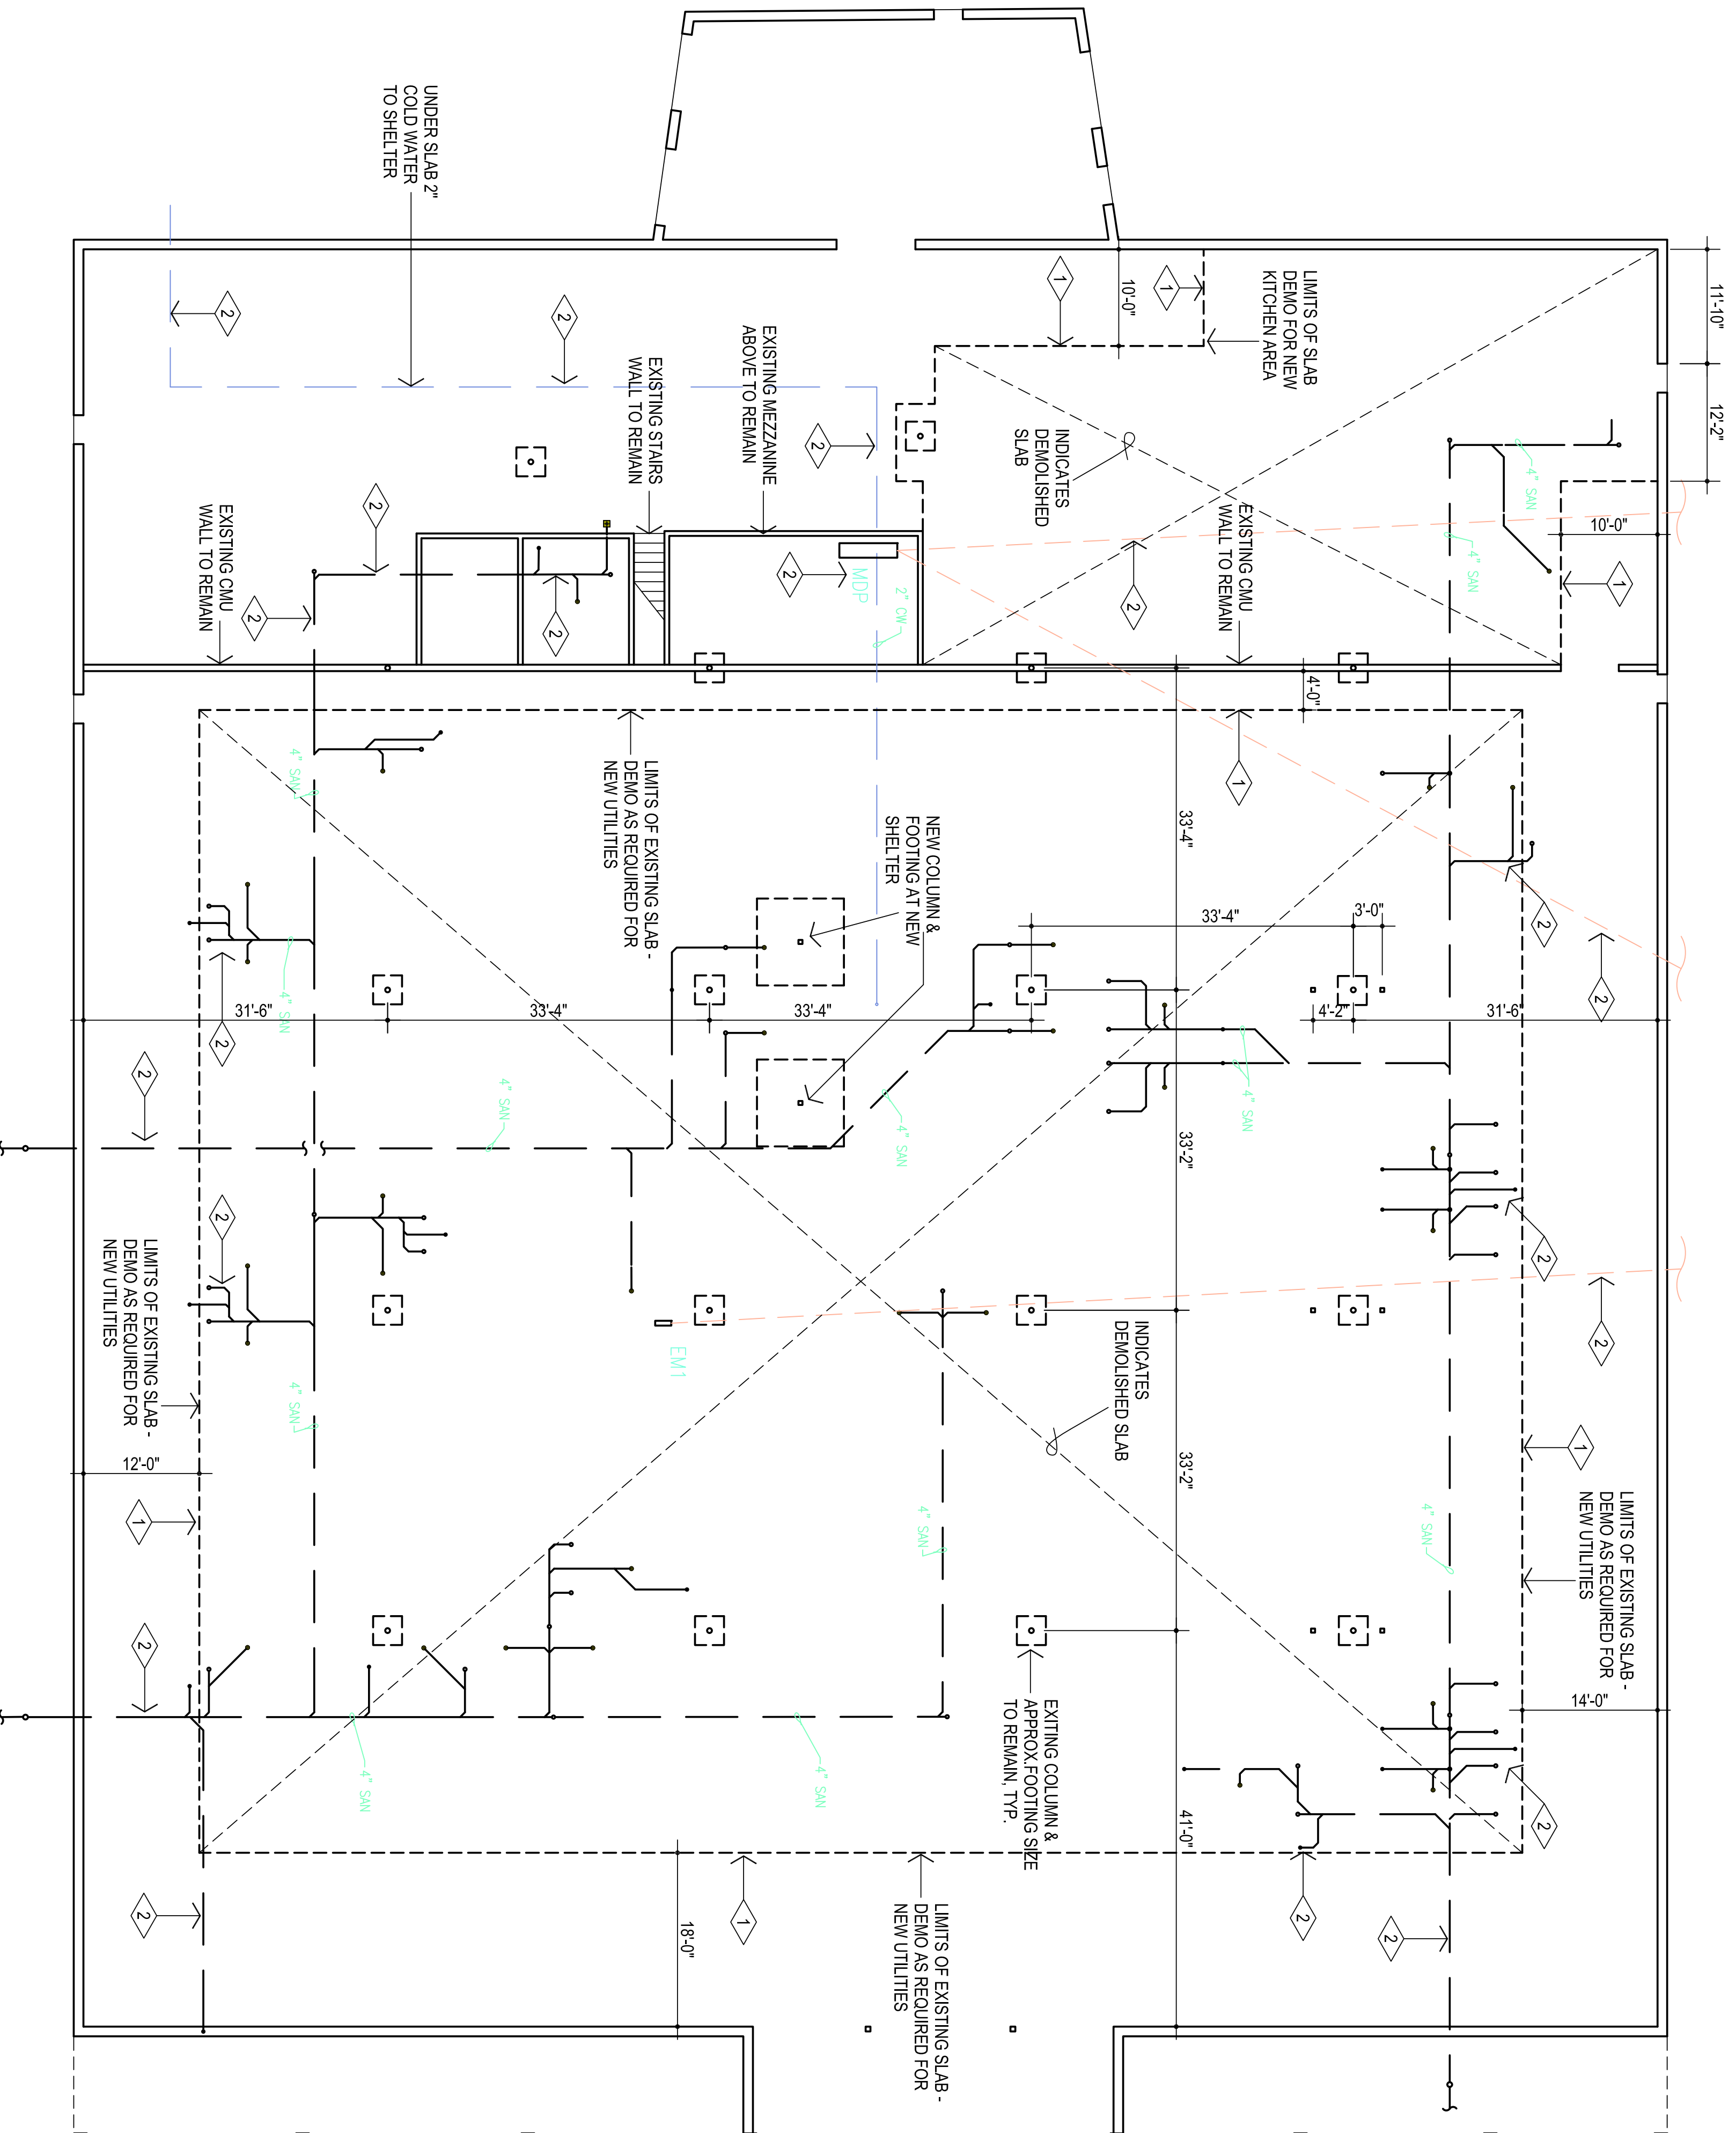

1

SLAB DEMOLITION PLAN


3/32" = 1'-0"

GENERAL NOTES:

1. CONTRACTOR TO VISIT SITE PRIOR TO PREPARING BID, & VERIFY ALL ITEMS TO BE DEMOLISHED. ANY ADDITIONAL ITEMS REQUIRING DEMOLITION THAT ARE NOT INCLUDED IN THESE DOCUMENTS SHOULD BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ARCHITECT AND INCLUDED IN THE BASE BID.
2. ALL SALVAGEABLE ITEMS TO REMAIN OWNERS' PROPERTY & SHALL BE STORED OR DISPOSED OF AS PER OWNERS' INSTRUCTIONS.
3. CONSTRUCTION SHALL MEET ALL APPLICABLE CODES, ORDINANCES, REGULATIONS & STANDARDS REQUIRED BY THE CITY OF MOORE, OKLAHOMA.
4. PROTECT EXISTING STRUCTURE TO REMAIN AS REQUIRED. PROTECT EXISTING CMU WALL TO REMAIN AS REQUIRED. PROTECT EXISTING EXTERIOR WALL TO REMAIN.

DEMOLITION NOTES:

- 1 - - - - - INDICATES EXISTING EDGE OF SLAB TO BE DEMOLISHED
- AS REQUIRED FOR NEW UTILITIES
- 2 - - - - - SAW CUT & REMOVE EXISTING CONCRETE FLOOR SLAB TO ALLOW FOR INSTALLATION OF NEW UNDERFLOOR CONDUIT, PLUMBING, ETC.

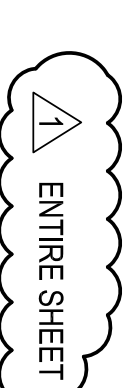

A1100d

OWNERSHIP USE OF DOCUMENTS:
 ACP EXPRESSLY RESERVES ITS
 COPYRIGHT AND OTHER PROPERTY
 RIGHTS OF ALL PLANS AND DRAWINGS
 DESIGNED AND/OR PRODUCED. PLANS
 AND DRAWINGS ARE NOT TO BE
 REPRODUCED IN ANY FORM OR MANNER
 WITHOUT THE EXPRESS WRITTEN
 CONSENT OF ACP.



DEMOLITION PACKAGE
 CHILD CARE FACILITY
 201 N. EASTERN AVE.

Sheet No.:

313 S. E. 5th Street
 MOORE, OK. 73160
 405.735.3477
 ACP@theACP.net
 www.theACP.net

KFC ENGINEERING
 STRUCTURAL
 SALAS O'BRIEN
 MECHANICAL / ELECTRICAL

CG
 drawn by
 MA
 checked by
 SEPTEMBER 2024
 date
 revisions
 ADDENDUM #4



the Abia Griffin
 Partnership L.L.C.



CG
drawn by
MA
checked by
OCTOBER 2024
title

revisions
ADDENDUM #1
ADDENDUM #4




CHILD CARE FACILITY
201 N. EASTERN AVE.

Sheet no.:


A108

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESS WRITTEN
CONSENT OF AGP.

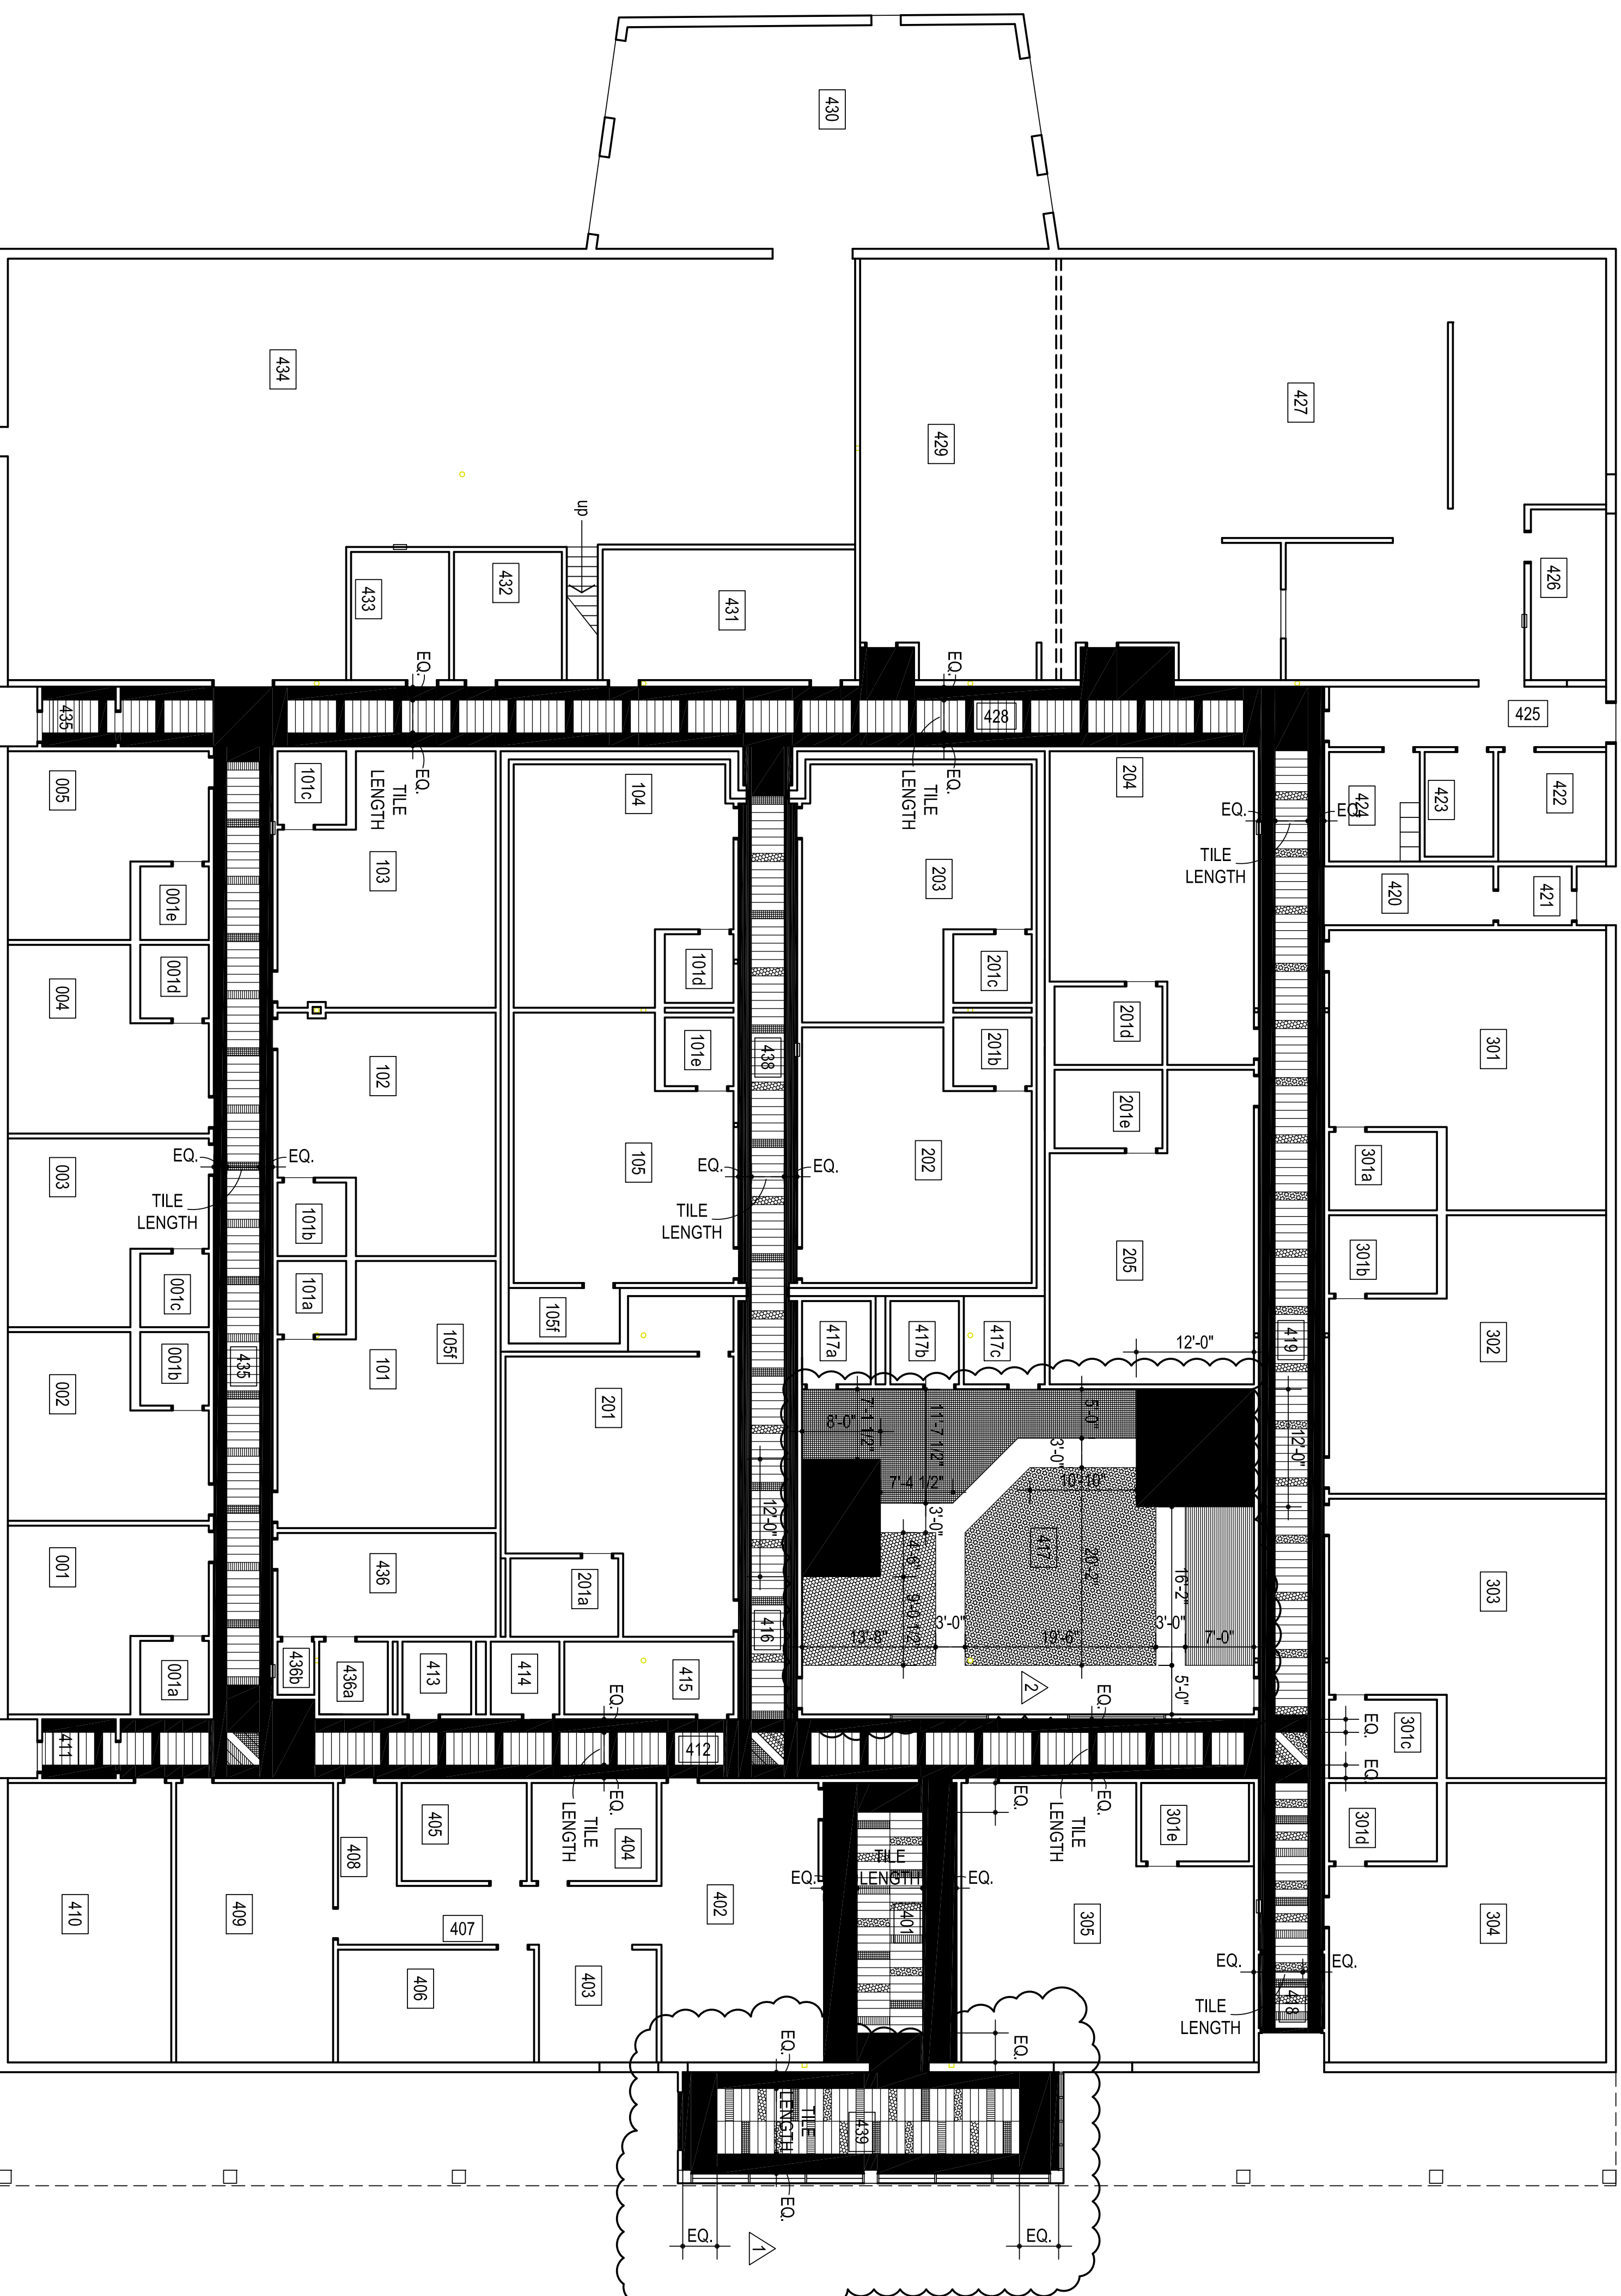


- LUXURY VINYL TILE LEGEND:
- INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A00702 PEWTER (12)
 - INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A00717 RED (139)
 - INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A00716 ORANGE (139)
 - INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A00714 YELLOW (139)
 - INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A0021 ELECTRIC BLUE (139)
 - INTERFACE LVT
STUDIO SET VOL. 2
COLOR - A00701 SILVERLIGHT (139)


REFER TO ROOM FINISH SCHEDULE FOR ADDITIONAL LOCATIONS OF LVT




1
LVT DIMENSION / DESIGN PLAN
1/8" = 1'-0"

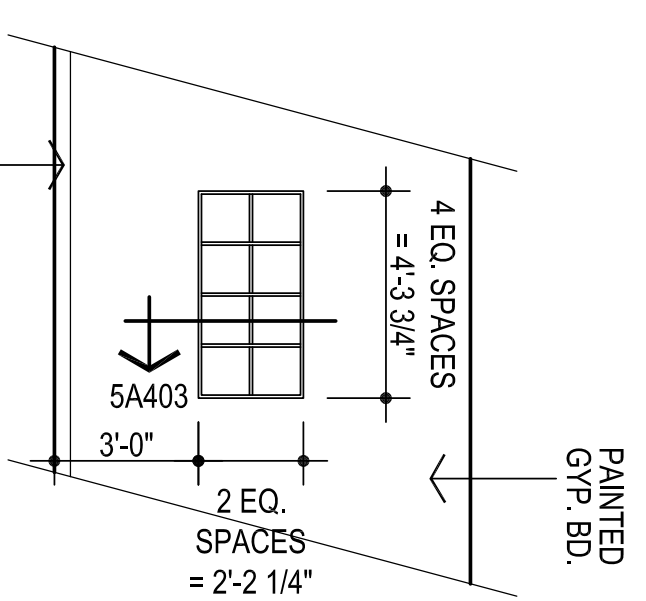


1
TYP. 8 CUBBIE MILLWORK
1/4" = 1'-0"

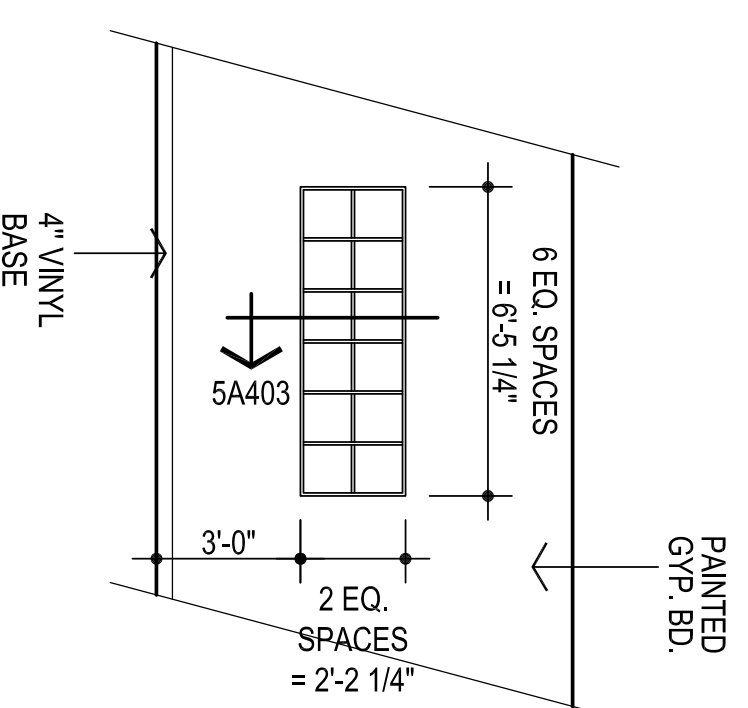

2
TYP. 12 CUBBIE MILLWORK
1/4" = 1'-0"

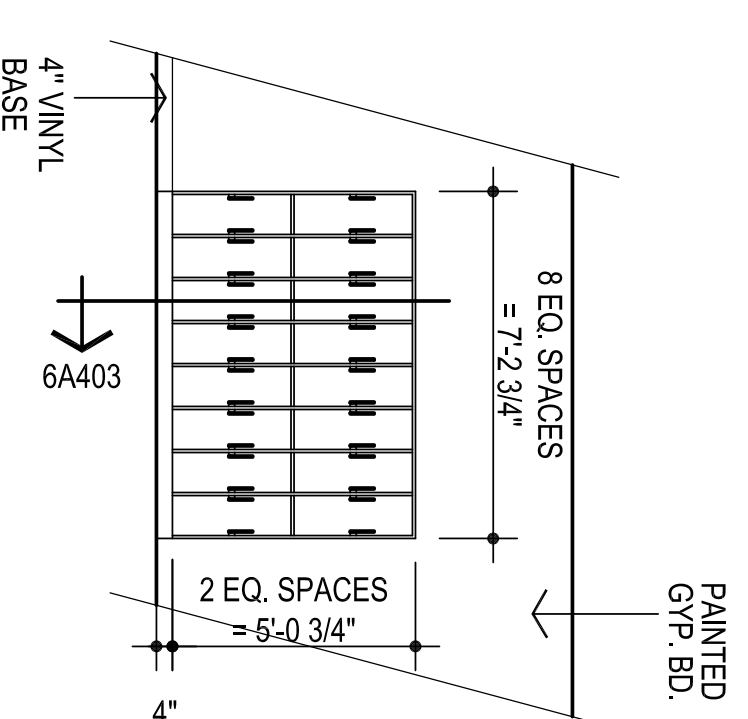


3
TYP. 16 LOCKER MILLWORK
1/4" = 1'-0"

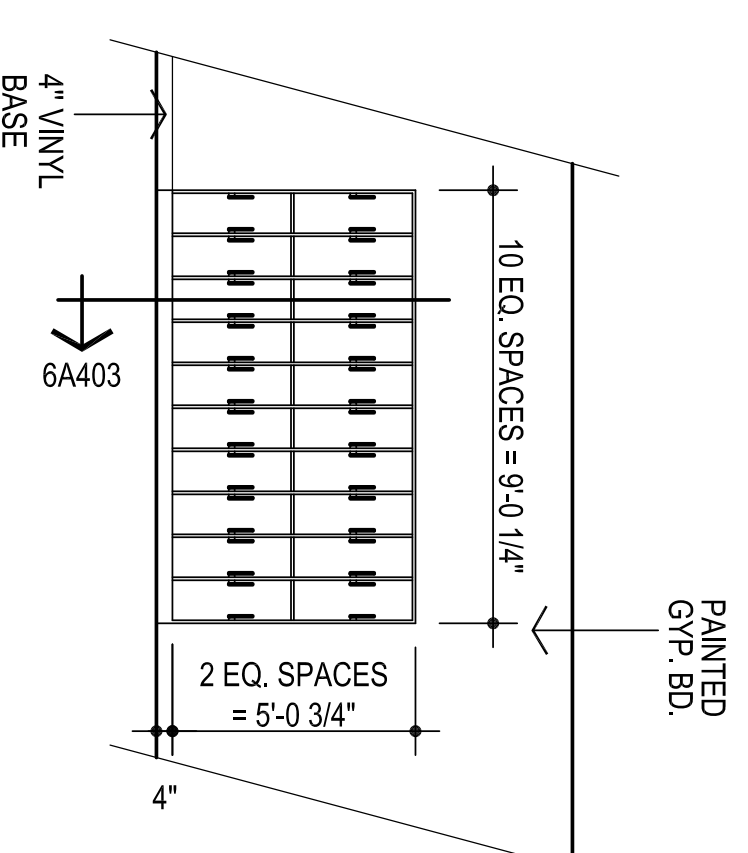


4
TYP. 20 LOCKER MILLWORK
1/4" = 1'-0"


NOTE: CONTRACTOR TO VERIFY THAT THE MOUNTING HEIGHTS & MINIMUM CLEARANCES OF ALL WALL MOUNTED FIXTURES (I.E. PLUMBING FIXTURES, GRAB BARS, MIRRORS, ETC.) MEET ALL APPLICABLE CODES & STANDARDS PRIOR TO INSTALLATION.

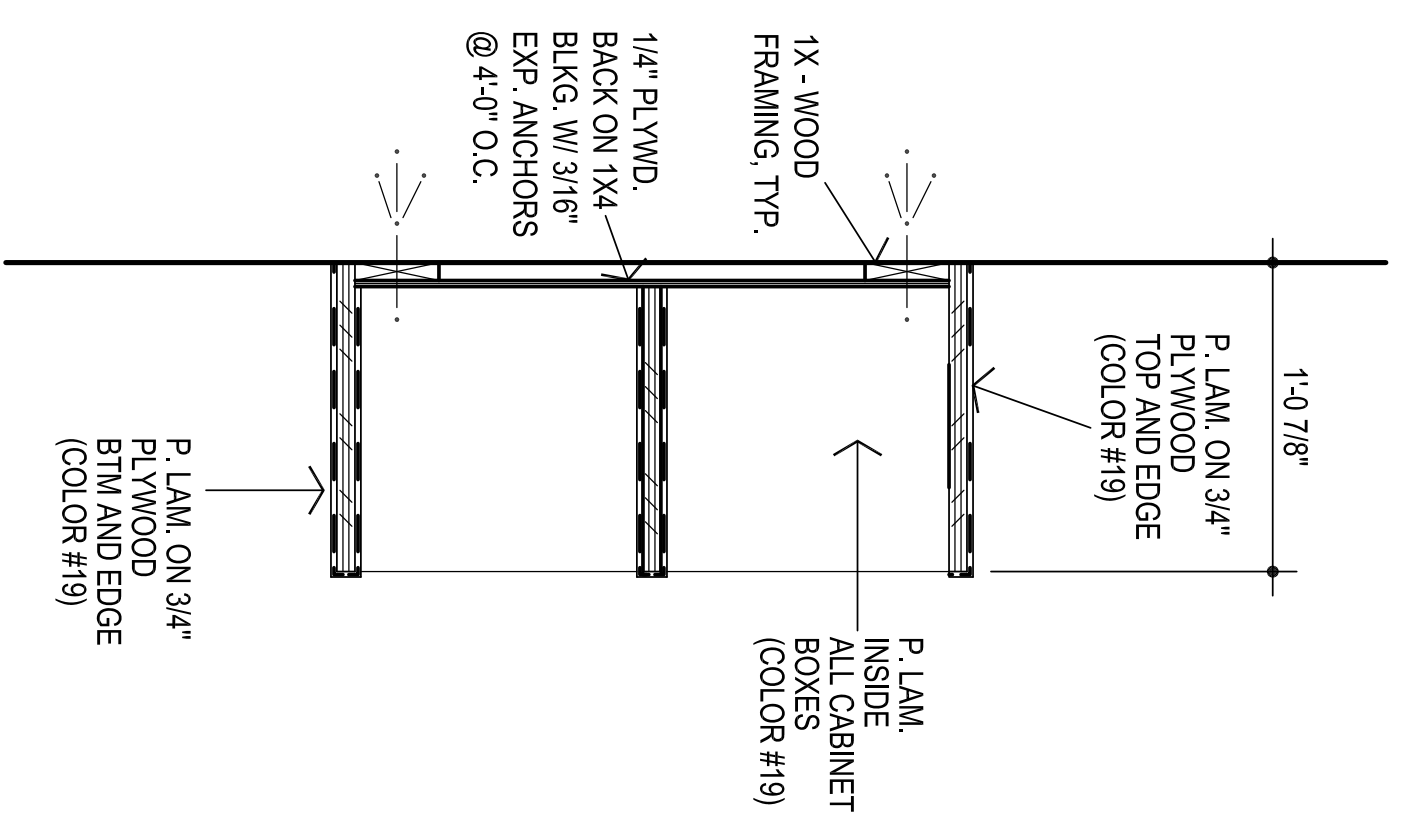

5
SECTION
1 1/2" = 1'-0"

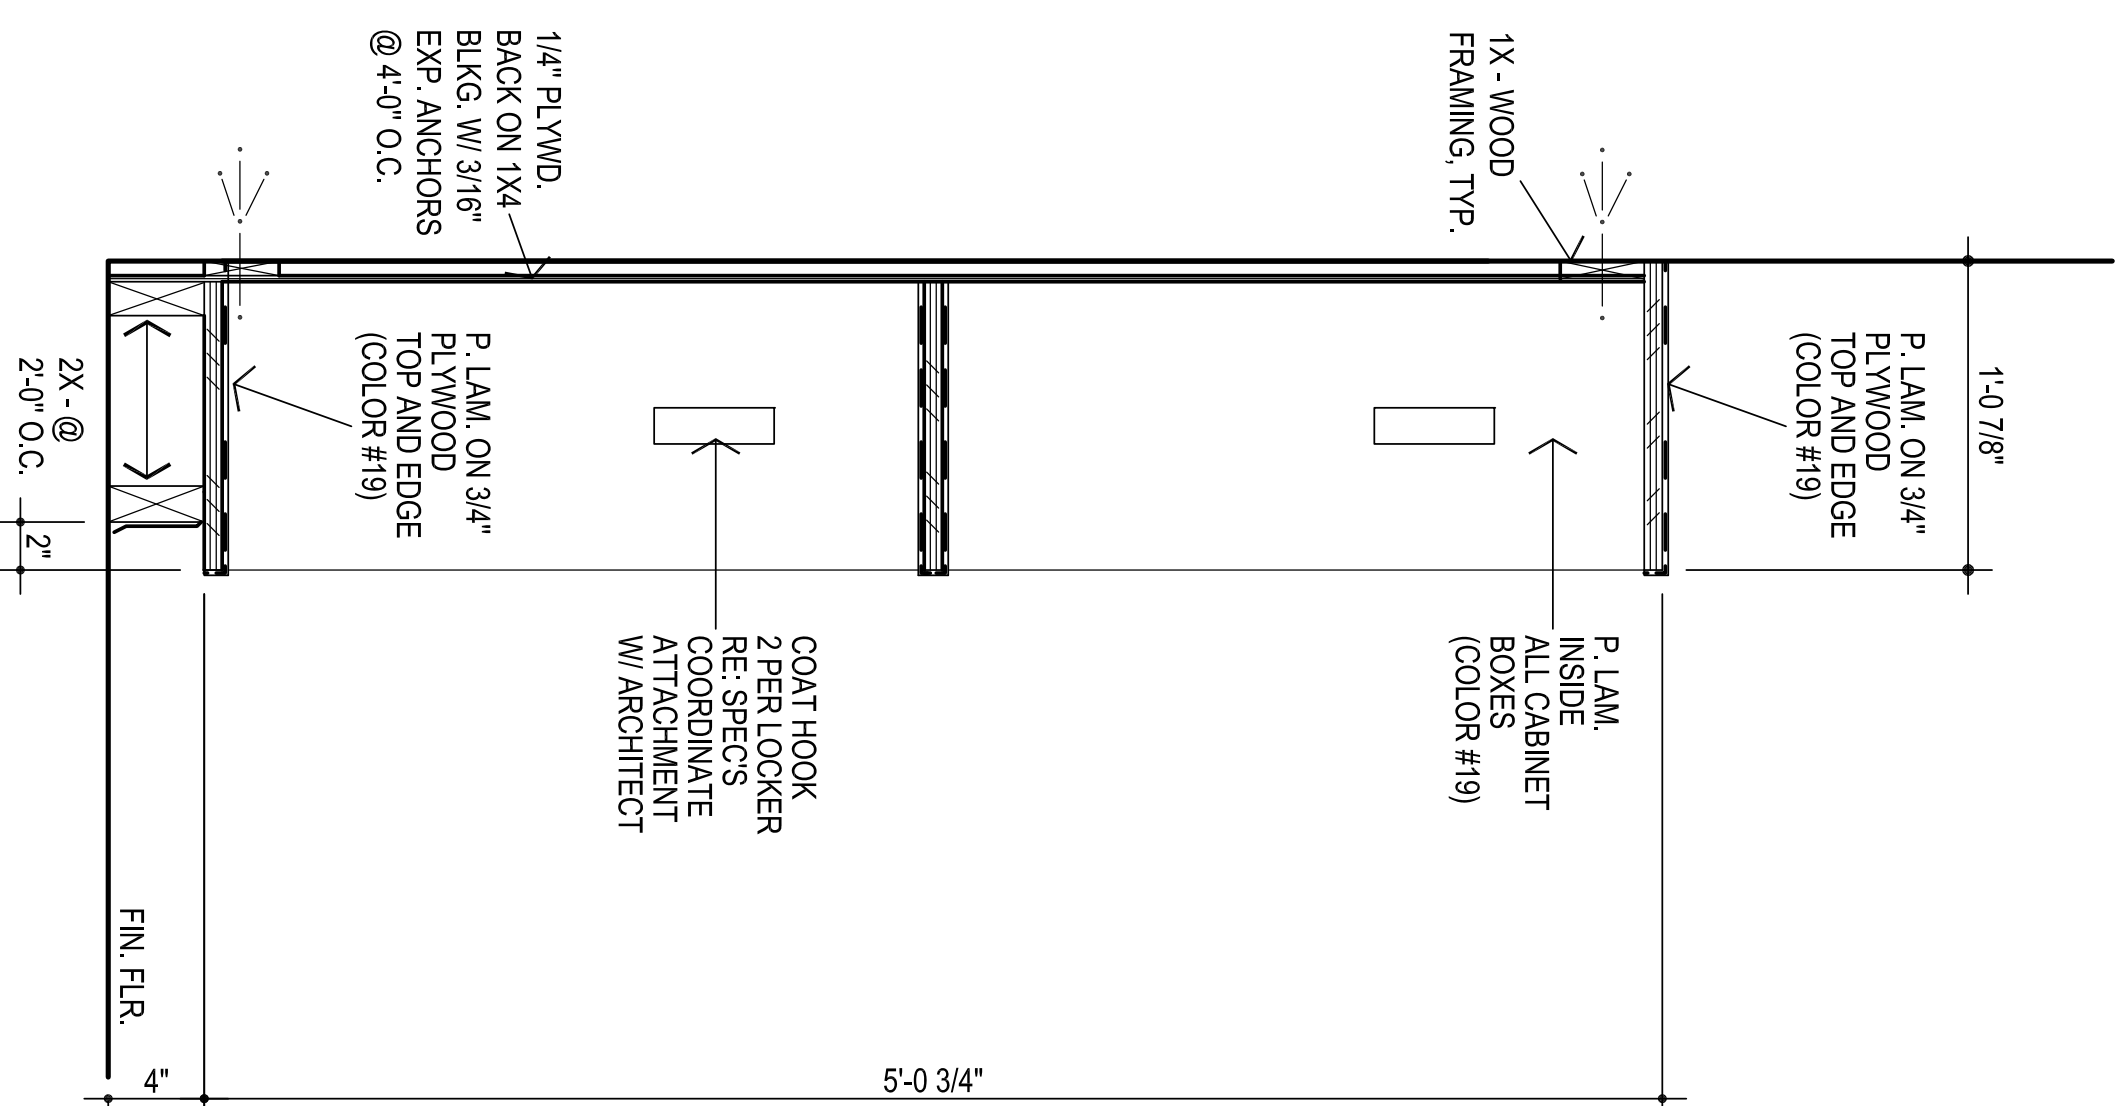

6
SECTION
1 1/2" = 1'-0"

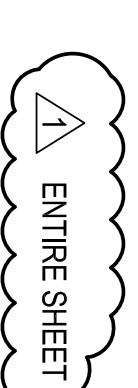

A403

AGP
the Abia Griffin
Partnership L.L.C.

313 S. E. 5th Street
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK
CIVIL
KFC ENGINEERING
STRUCTURAL
SALAS OBIEN
MECHANICAL / ELECTRICAL

10/22/24

CG
drawn by
MA
checked by
OCTOBER 2024
date
revisions
ADDENDUM #4



MOORE
PUBLIC SCHOOLS





CHILD CARE FACILITY
201 N. EASTERN AVE.

Sheet no.:

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF AGP.

DOOR NO.	LOCATION FROM TO	DOOR ELEV.	DOOR MATL	DOOR SIZE			FRAME ELEV.	DOOR DETAILS			REMARKS	HWDR. SET NO.		
				WIDTH	HEIGHT	TH-K		HEAD	SILL	JAMB				
1	401	EXT. C	ALUM.	3'-0"	7'-0"	1 3/4"	A	16A501	16A501	29A501	29A501	20 MIN. DR & FRAME	5	
2	411	EXT. A	H.M.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		7	
3	412	411	<	<	<	<	<	4A501	16A501	11A501	11A501		10	
4	435	EXT.	<	<	<	<	<	22A501	16A501	29A501	29A501		5	
5	428	435	<	<	<	<	<	4A501	16A501	11A501	11A501		10	
6	421	EXT.	<	<	<	<	<	22A501	15A501	29A501	29A501		5	
7	420	421	<	<	<	<	<	4A501	16A501	11A501	11A501		10	
8	418	EXT.	<	<	<	<	<	22A501	15A501	29A501	29A501		13	
9	419	418	H.M.	PR. 3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		15	
10	412	401	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		16	
11	402	401	<	<	<	<	<	3A501	10A501	10A501	10A501		16	
12	412	402	<	<	<	<	<	4A501	11A501	11A501	11A501		5	
13	407	404	<	<	<	<	<	4A501	11A501	11A501	11A501		11	
14	407	405	<	<	<	<	<	4A501	11A501	11A501	11A501		11	
15	407	406	<	<	<	<	<	4A501	11A501	11A501	11A501		11	
16	409	407	<	<	<	<	<	4A501	11A501	11A501	11A501		12	
17	412	408	<	<	<	<	<	4A501	11A501	11A501	11A501		8	
18	412	409	<	<	<	<	<	4A501	11A501	11A501	11A501		14	
19	412	410	A	<	<	<	<	4A501	11A501	11A501	11A501		14	
20	436	438a	B	<	<	<	<	3A501	10A501	10A501	10A501		2	
21	435	436	A	<	<	<	<	4A501	11A501	11A501	11A501		14	
22	435	001	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
23	001	001a	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
24	435	002	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
25	002	001b	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
26	435	101	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
27	101	101a	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
28	102	101b	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
29	003	101c	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
30	435	003	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
31	435	004	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
32	004	001d	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
33	435	102	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
34	435	103	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
35	005	001e	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
36	103	101c	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
37	435	005	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
38	428	434	B	PR. 3'-0"	7'-0"	1 3/4"	A	2A501	9A501	9A501	9A501	20 MIN. DR & FRAME	3	
39	428	433	B	<	<	<	<	2A501	9A501	9A501	9A501	20 MIN. DR & FRAME	4	
40	428	432	B	<	<	<	<	2A501	9A501	9A501	9A501	20 MIN. DR & FRAME	4	
41	428	431	B	<	<	<	<	2A501	9A501	9A501	9A501	20 MIN. DR & FRAME	4	
42	429	428	A	<	<	<	<	4A501	11A501	11A501	11A501		9	
43	428	436	B	<	<	<	<	19A501	16A501	20A501	20A501	TORNADO DOOR & FRAME	11	
44	436	203	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
45	203	201c	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
46	436	104	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
47	104	201d	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
48	105	201e	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
49	436	105	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
50	436	202	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
51	202	201b	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
52	436	416	B	<	<	<	<	19A501	20A501	20A501	20A501	TORNADO DOOR & FRAME	11	
53	417	417a	B	<	<	<	<	4A501	11A501	11A501	11A501		12	
54	417	417b	B	<	<	<	<	4A501	11A501	11A501	11A501		12	
55	417	417c	B	<	<	<	<	4A501	11A501	11A501	11A501		12	
56	416	417	A	<	<	<	<	4A501	11A501	11A501	11A501		9	
57	416	201	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
58	201	201a	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
59	412	413	B	<	<	<	<	4A501	11A501	11A501	11A501		2	
60	412	414	B	<	<	<	<	4A501	11A501	11A501	11A501		2	
61	415	412	B	<	<	<	<	4A501	11A501	11A501	11A501		4	
62	412	305	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
63	305	301e	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
64	419	304	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
65	304	301d	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
66	303	301c	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
67	419	417	A	<	<	<	<	4A501	11A501	11A501	11A501		9	
68	419	303	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
69	419	302	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
70	302	301b	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
71	301	301a	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
72	419	205	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
73	205	201e	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
74	204	201d	B	<	<	<	<	3A501	10A501	10A501	10A501		12	
75	419	204	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
76	419	301	D	<	<	<	<	4A501	11A501	11A501	11A501		9	
77	419	425	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		9
78	NUMBER NOT USED							NUMBER NOT USED						
79	425	424	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		2
80	425	423	B	<	<	<	<	4A501	16A501	11A501	11A501		2	
81	425	422	A	<	<	<	<	4A501	16A501	11A501	11A501		11	
82	427	426	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501	8" GIP BD. WALL ADJUST FRAME AS REQUIRED	6
83	425	EXT.	B	H.M.	4'-0"	7'-0"	1 3/4"	A	1A501	15A501	8A501	8A501		5
84	438d	436	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		12
85	105g	201	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		6

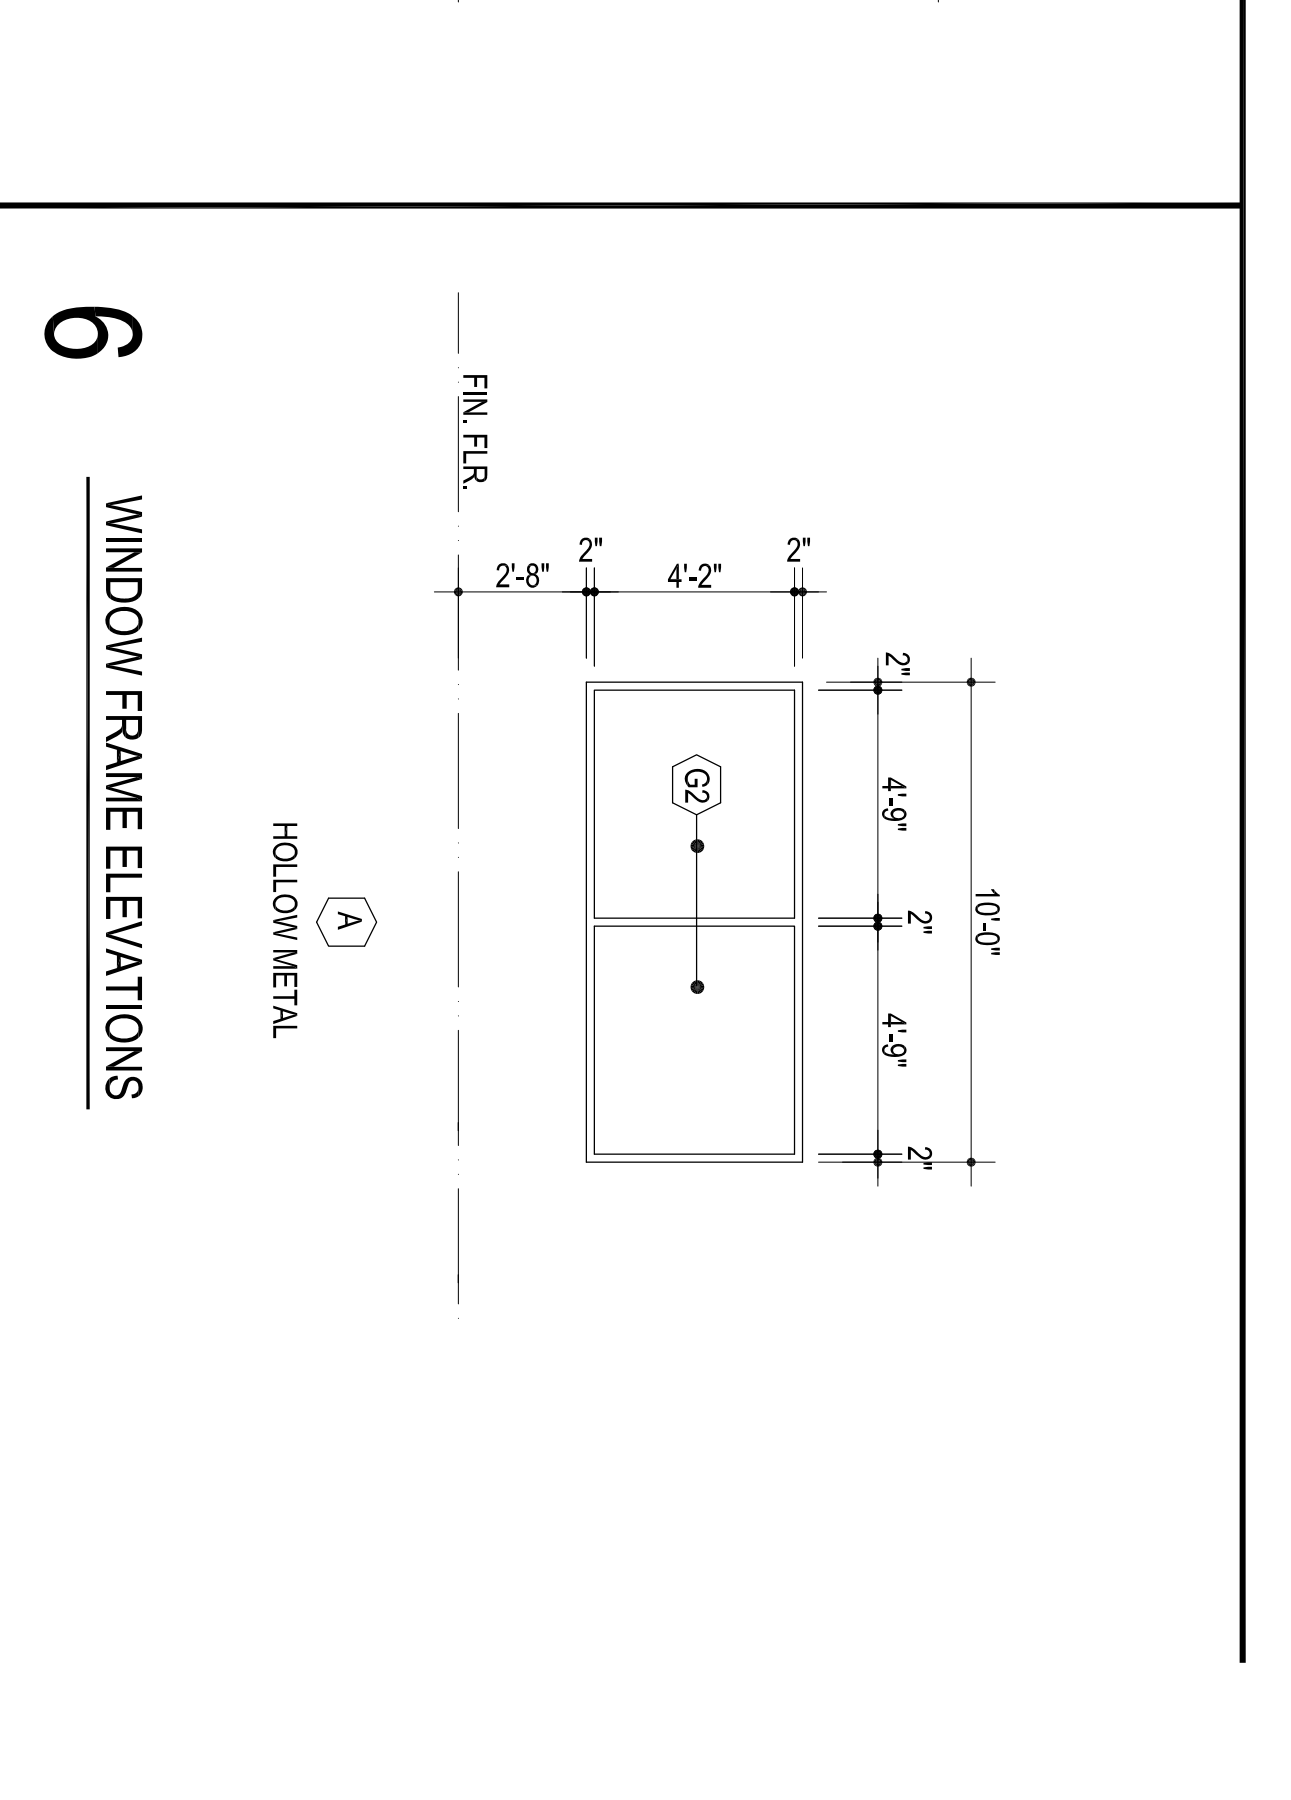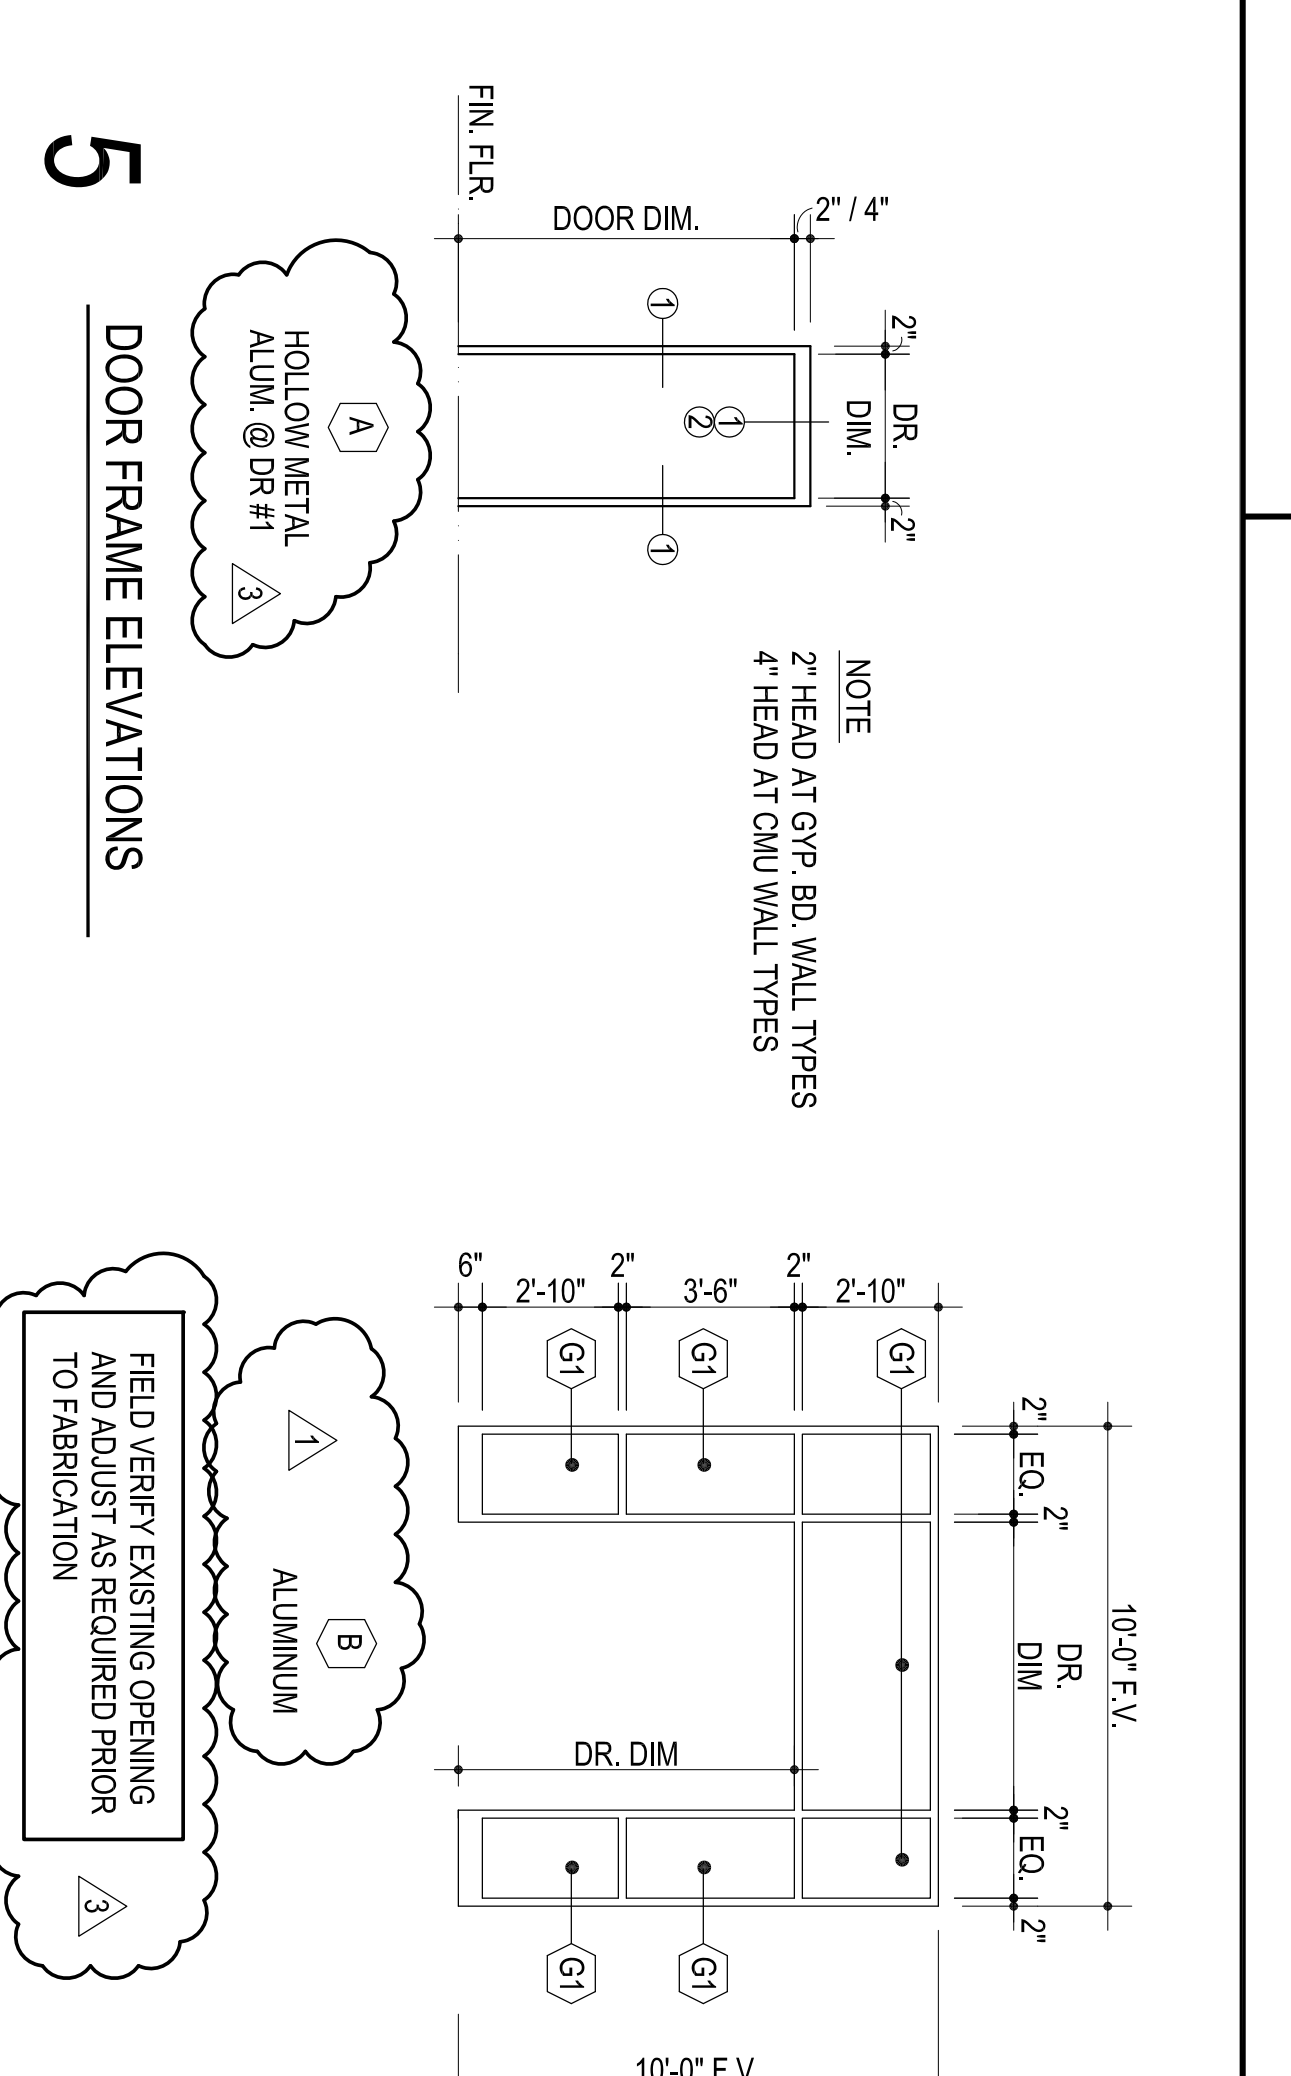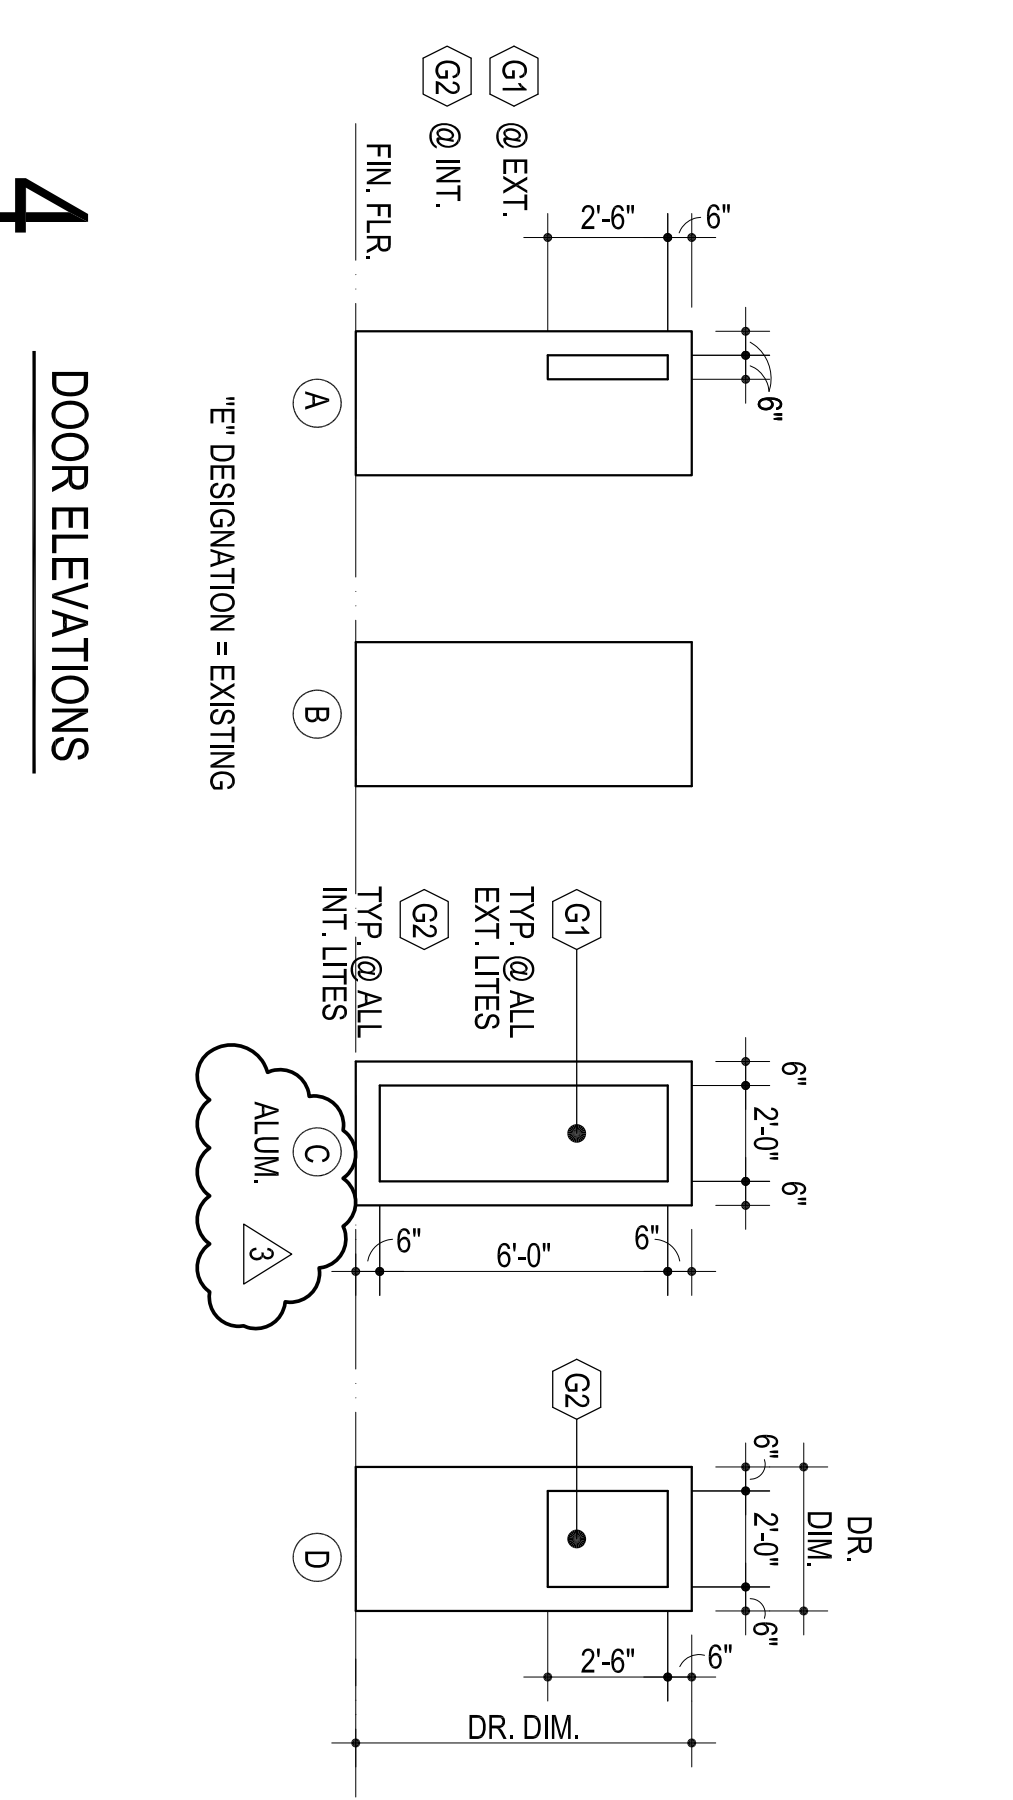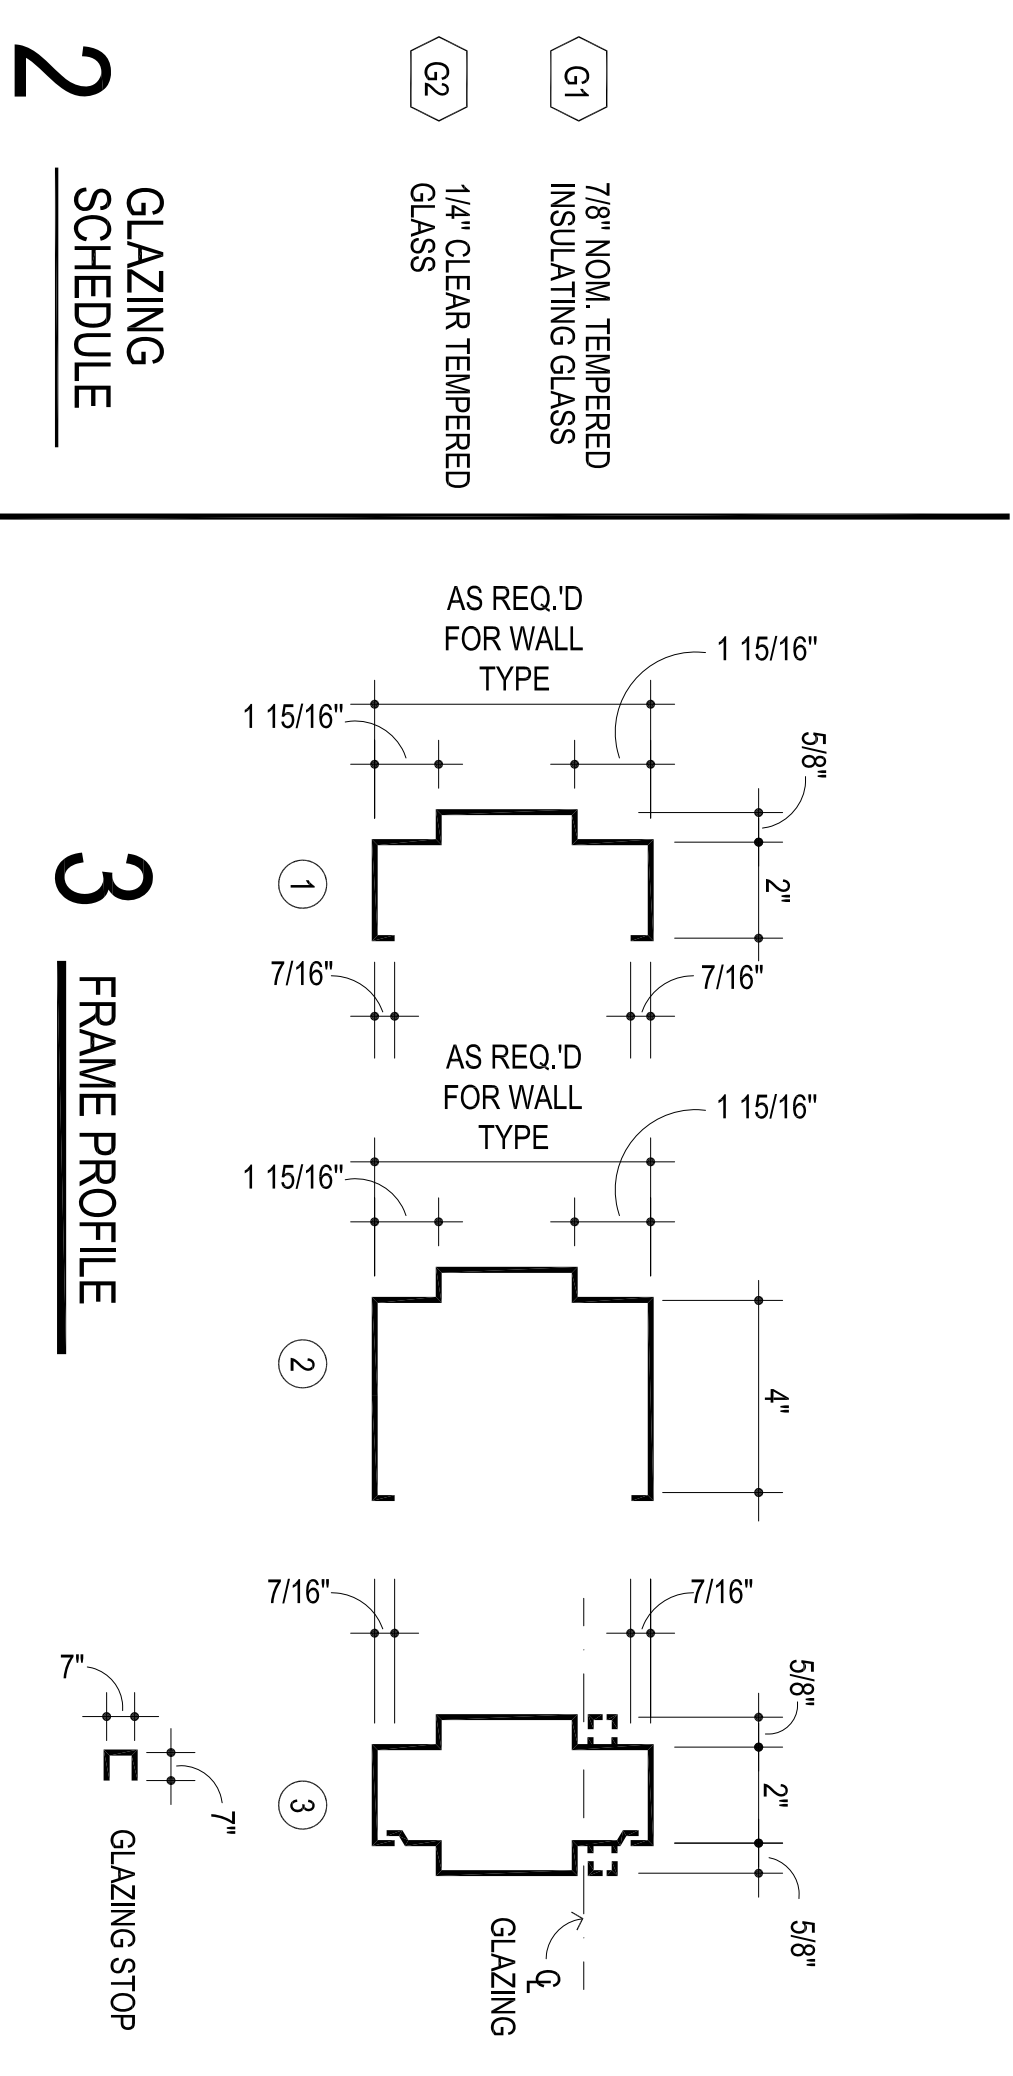

1 DOOR SCHEDULE

DOOR NO.	LOCATION FROM TO	DOOR ELEV.	DOOR MATL	DOOR SIZE			FRAME ELEV.	DOOR DETAILS			REMARKS	HWDR. SET NO.		
				WIDTH	HEIGHT	TH-K		HEAD	SILL	JAMB				
86	105f	105	B	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		6
87	439	EXT.	C	ALUM.	PR. 3'-0"	7'-0"	1 3/4"	A	17A501	15A501				1
88	427	428	A	WD.	3'-0"	7'-0"	1 3/4"	A	4A501	16A501	11A501	11A501		9
89	431	428	B	WD.	3'-0"	7'-0"	1 3/4"	A	2A501	16A501	9A501	9A501		4

Sheet no: **A602**

OWNERSHIP USE OF DOCUMENTS:
APP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESS WRITTEN
CONSENT OF ACP.

DEMOLITION PACKAGE
CHILD CARE FACILITY
201 N. EASTERN AVE.

MOORE
PUBLIC SCHOOLS

Revisions:
A ADDENDUM #1
B ADDENDUM #2
C ADDENDUM #4

GC
drawn by
checked by
MA
checked by
SEPTEMBER 2024
date

AGP
the Abia Griffin
Partnership L.L.C.

313 S. E. 5th Street
MOORE, OK. 73160
ACP@theAGP.net
www.theAGP.net

KFC ENGINEERING
STRUCTURAL
SALAS O'BRIEN
MECHANICAL/ELECTRICAL