




## 3 TYP.TROFFER POWER DETAIL NO SCALE

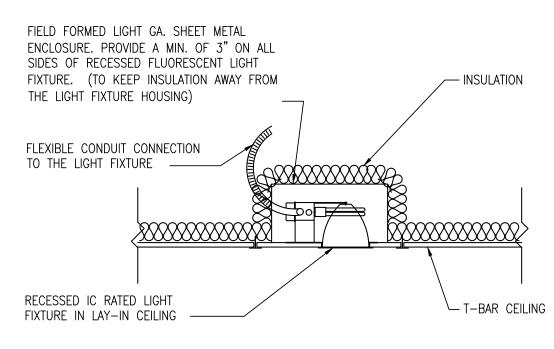


# 4 IC LIGHT FIXTURE DETAIL NO SCALE

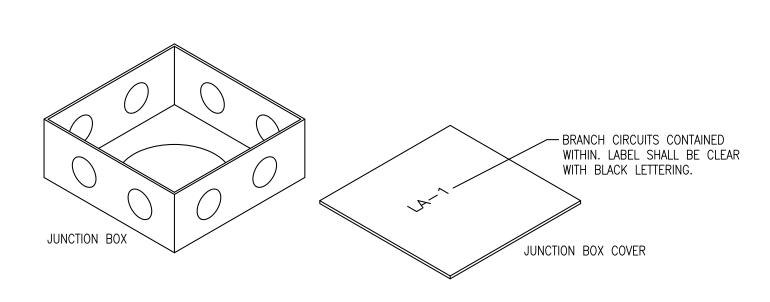

## 6 JUNCTION BOX DETAIL NO SCALE

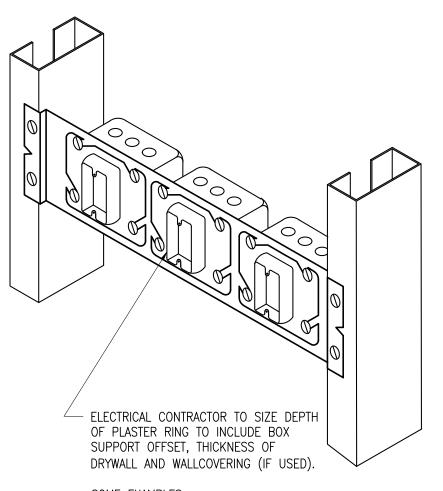


SOME EXAMPLES: - 3/4" PLASTER RING FOR SINGLE LAYER 5/8" GYPŚUM BOARD WALL FINISH – 1" PLASTER RING FOR TWO LAYER WALL FINISH 1/2"

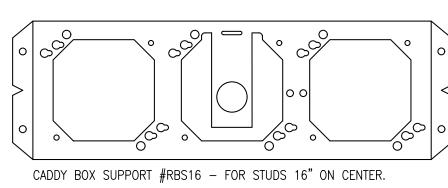

CADDY BOX SUPPORT #RBS24 - FOR STUDS 24" ON CENTER.

## 2 MULTIPLE BOX SUPPORT DETAIL NO SCALE

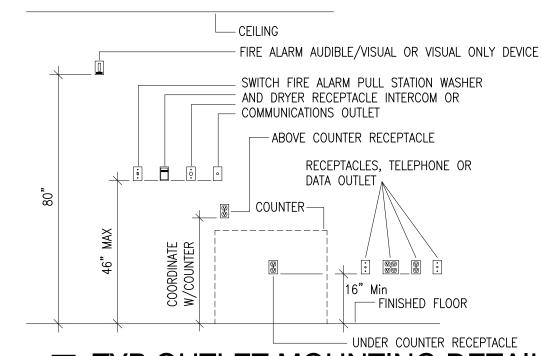

BOX SUPPORT DETAIL

NO SCALE

WOOD OR METAL WALL STUD —

BOX SUPPORT

CADDY QUICK MOUNT BOX SUPPORT CADDY BOX SUPPORT #H23, H4,

ELECTRICAL CONTRACTOR TO SIZE DEPTH

SOME EXAMPLES:
- 3/4" PLASTER RING FOR SINGLE LAYER 5/8"

- 1" PLASTER RING FOR TWO LAYER WALL FINISH 1/2" OVER 1/4"

COMBUSTABLE WALLS

NON-COMBUSTABLE WALLS

OF PLASTER RING TO INCLUDE BOX

SUPPORT OFFSET, THICKNESS OF DRYWALL AND WALLCOVERING (IF USED).

GYPŚUM BOARD WALL FINISH

FOR ALL COMBUSTIBLE WALLS PLASTER RING MUST BE FLUSH WITH OUTER SURFACE OF

OUTER SURFACE

OF FINISHED WALL

FOR ALL NON-COMBUSTIBLE

WITHIN 1/8" FROM OUTER

SURFACE —

WALLS PLASTER RING MUST BE

H53 (AS APPROPRIATE) -

OFFSET -

5 TYP OUTLET MOUNTING DETAIL
NOT TO SCALE



201 N. BROADWAY SUITE 210 MOORE, OK. 73160 405.735.3477 AGP@theAGP.net www.theAGP.net

KFC ENGINEERING STRUCTURAL

SALAS O'BRIEN MECHANICAL / ELECTRICAL

drawn by TVO checked by APRIL 2023 date revisions

MOORE PUBLIC SCHOOLS BOARD OF EDUCATION MOORE, OKLAHOMA



OFFICE ADDITION -NORTHMOOR **ELEMENTARY SCHOOL** 

sheet no:

E501



Salas O'Brien Project Number: 2023-01177-00

Expiration Date : 6/30/2023

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.