
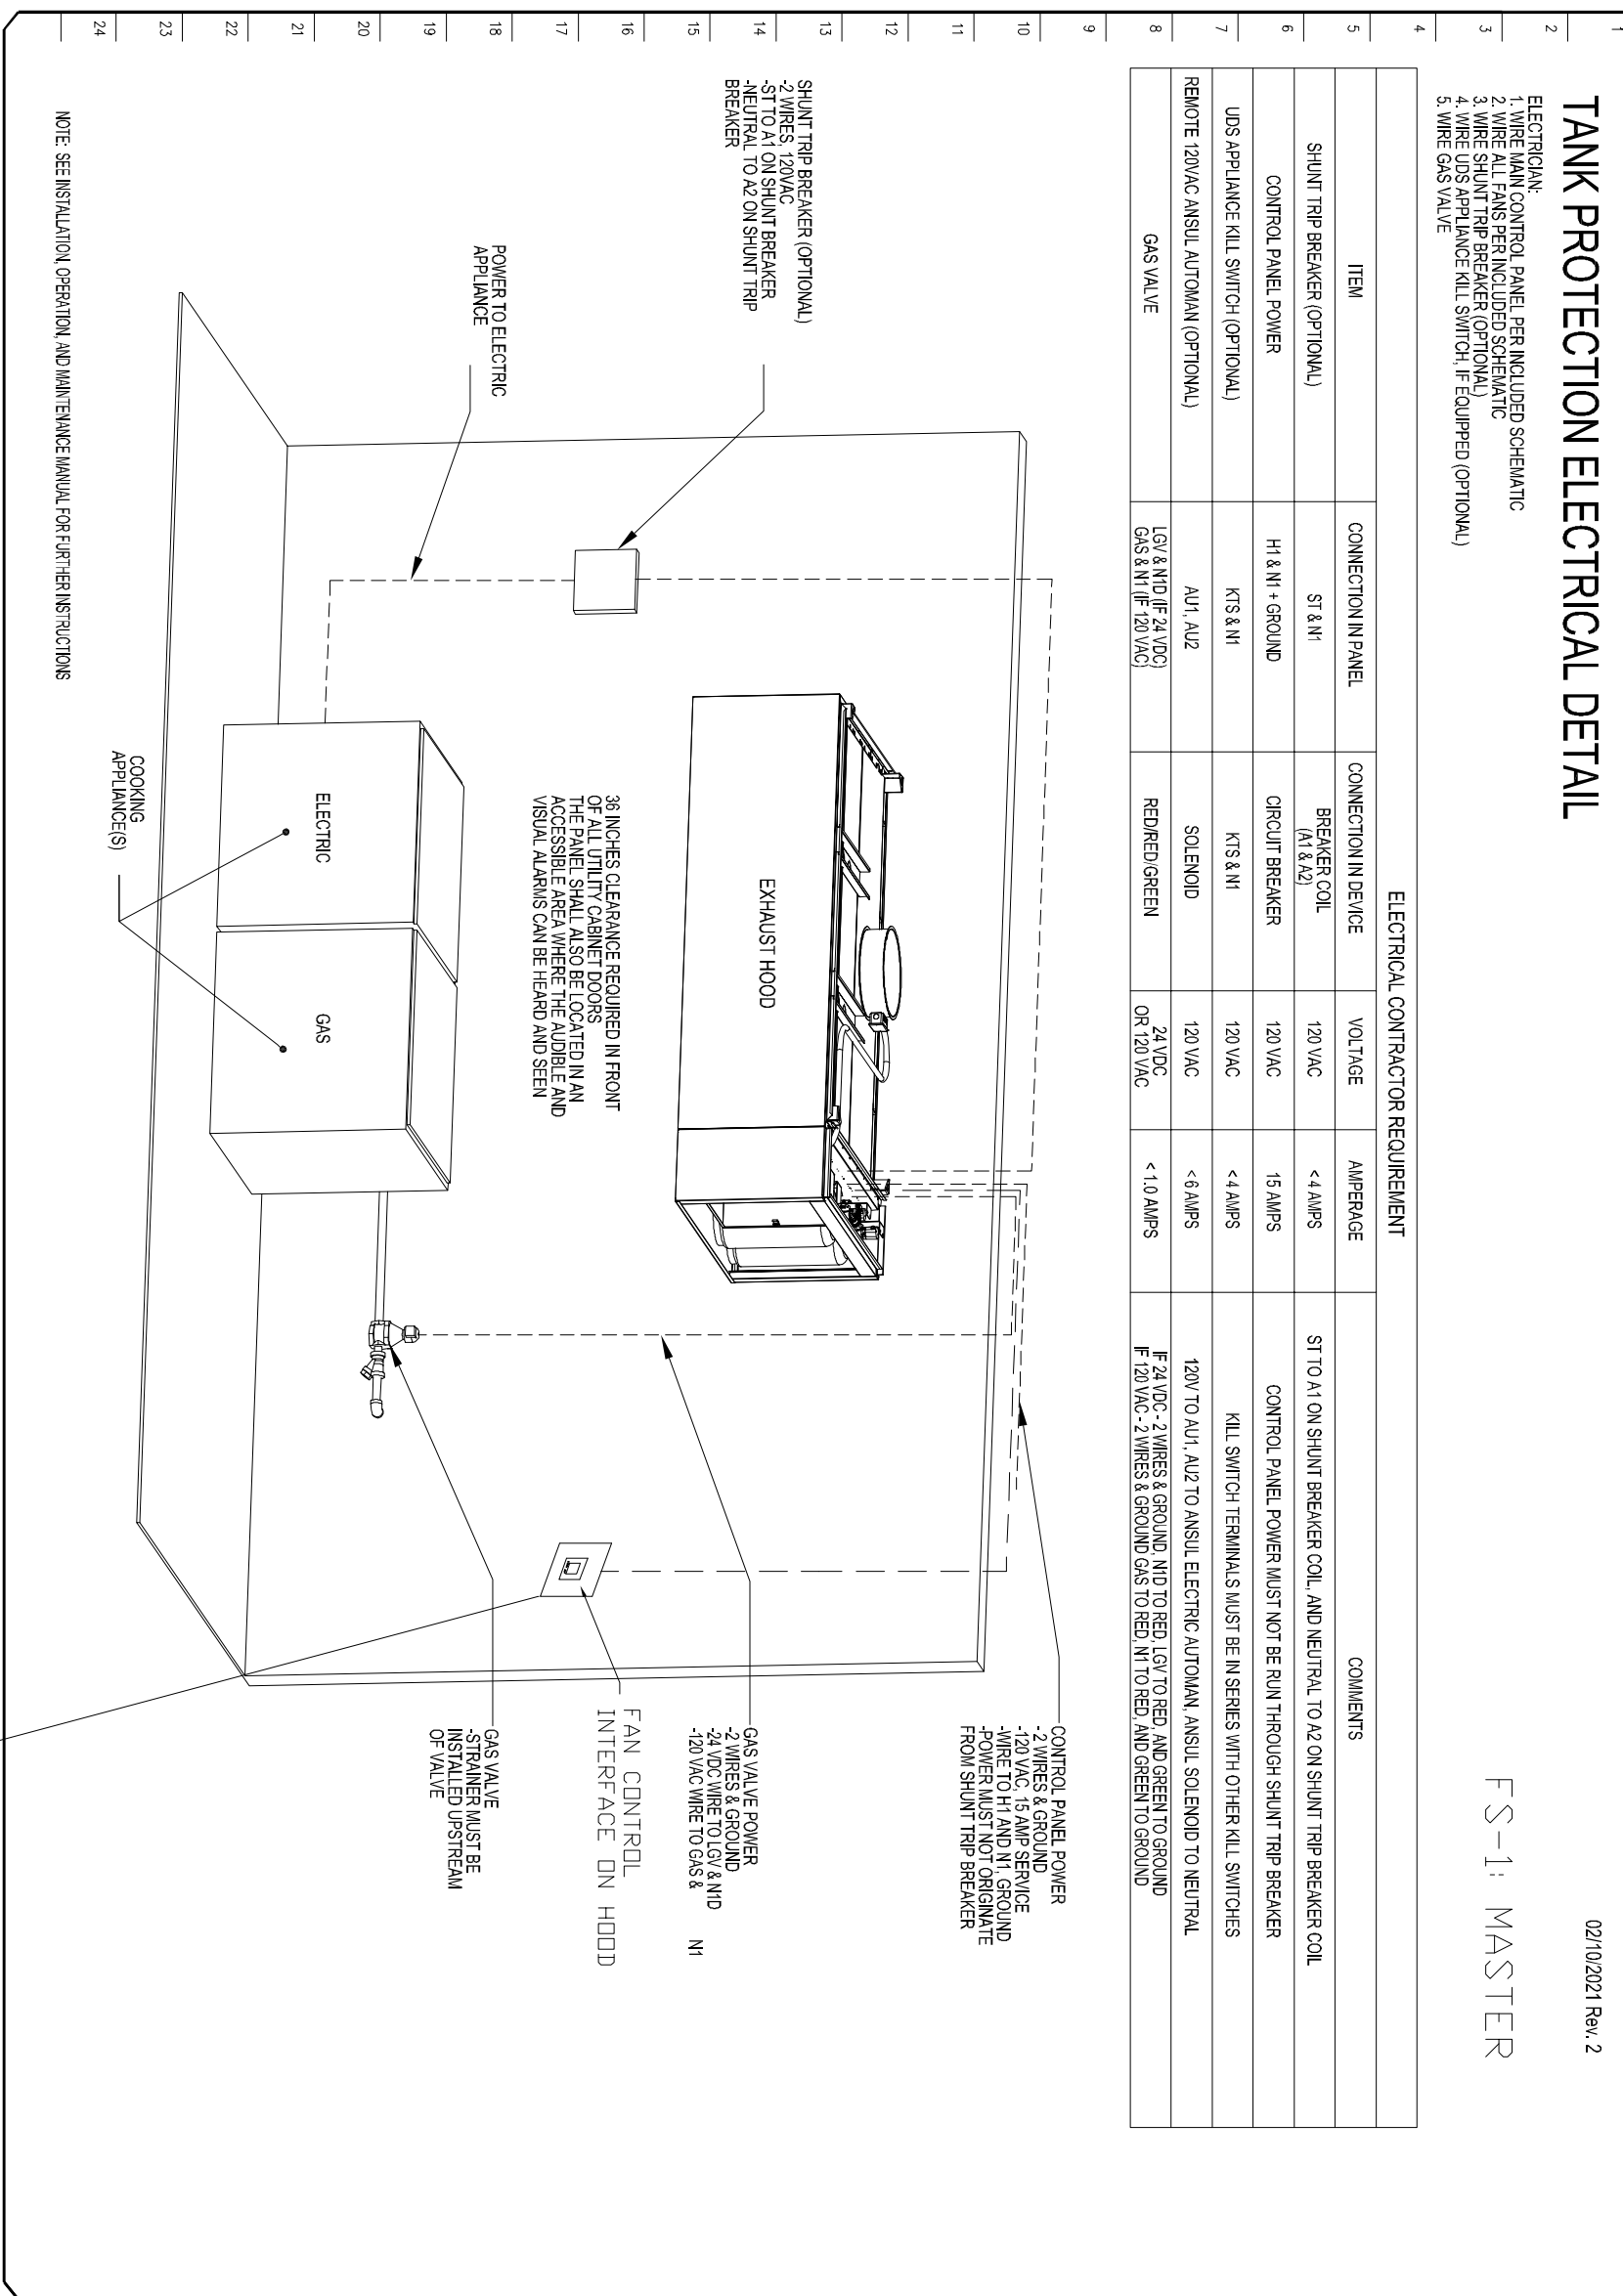


ELECTRICAL PACKAGE - JOB#8170091			
NO	TAG	PACKAGE #	LOCATION
1		SC-311100A	UTILITY CABINET RIGHT HOOD # 1
			SMART CONTROL'S THERMOSTATIC CONTROL V/ RELAY DRIFT WITH SUPPLY
			FAN TAG KEF (ITEM-27)
			EXHAUST SUPPLY
			DDAU (ITEM-27)

FANS CONTROLLED			
NO	TAG	TYPE	HP
1	KEF (ITEM-27)	EXHAUST SUPPLY	194
2	DDAU (ITEM-27)	EXHAUST SUPPLY	85

JOB NO	8170091	MODEL NUMBER	SC-311100A	DESCRIPTION OF OPERATION
JOB NAME	Old School Building	JOB NAME	Old School Building	
DATE	8/12/2025	DATE	8/12/2025	
SCALE	1/4" = 1'-0"	SCALE	1/4" = 1'-0"	
REVISIONS		REVISIONS		

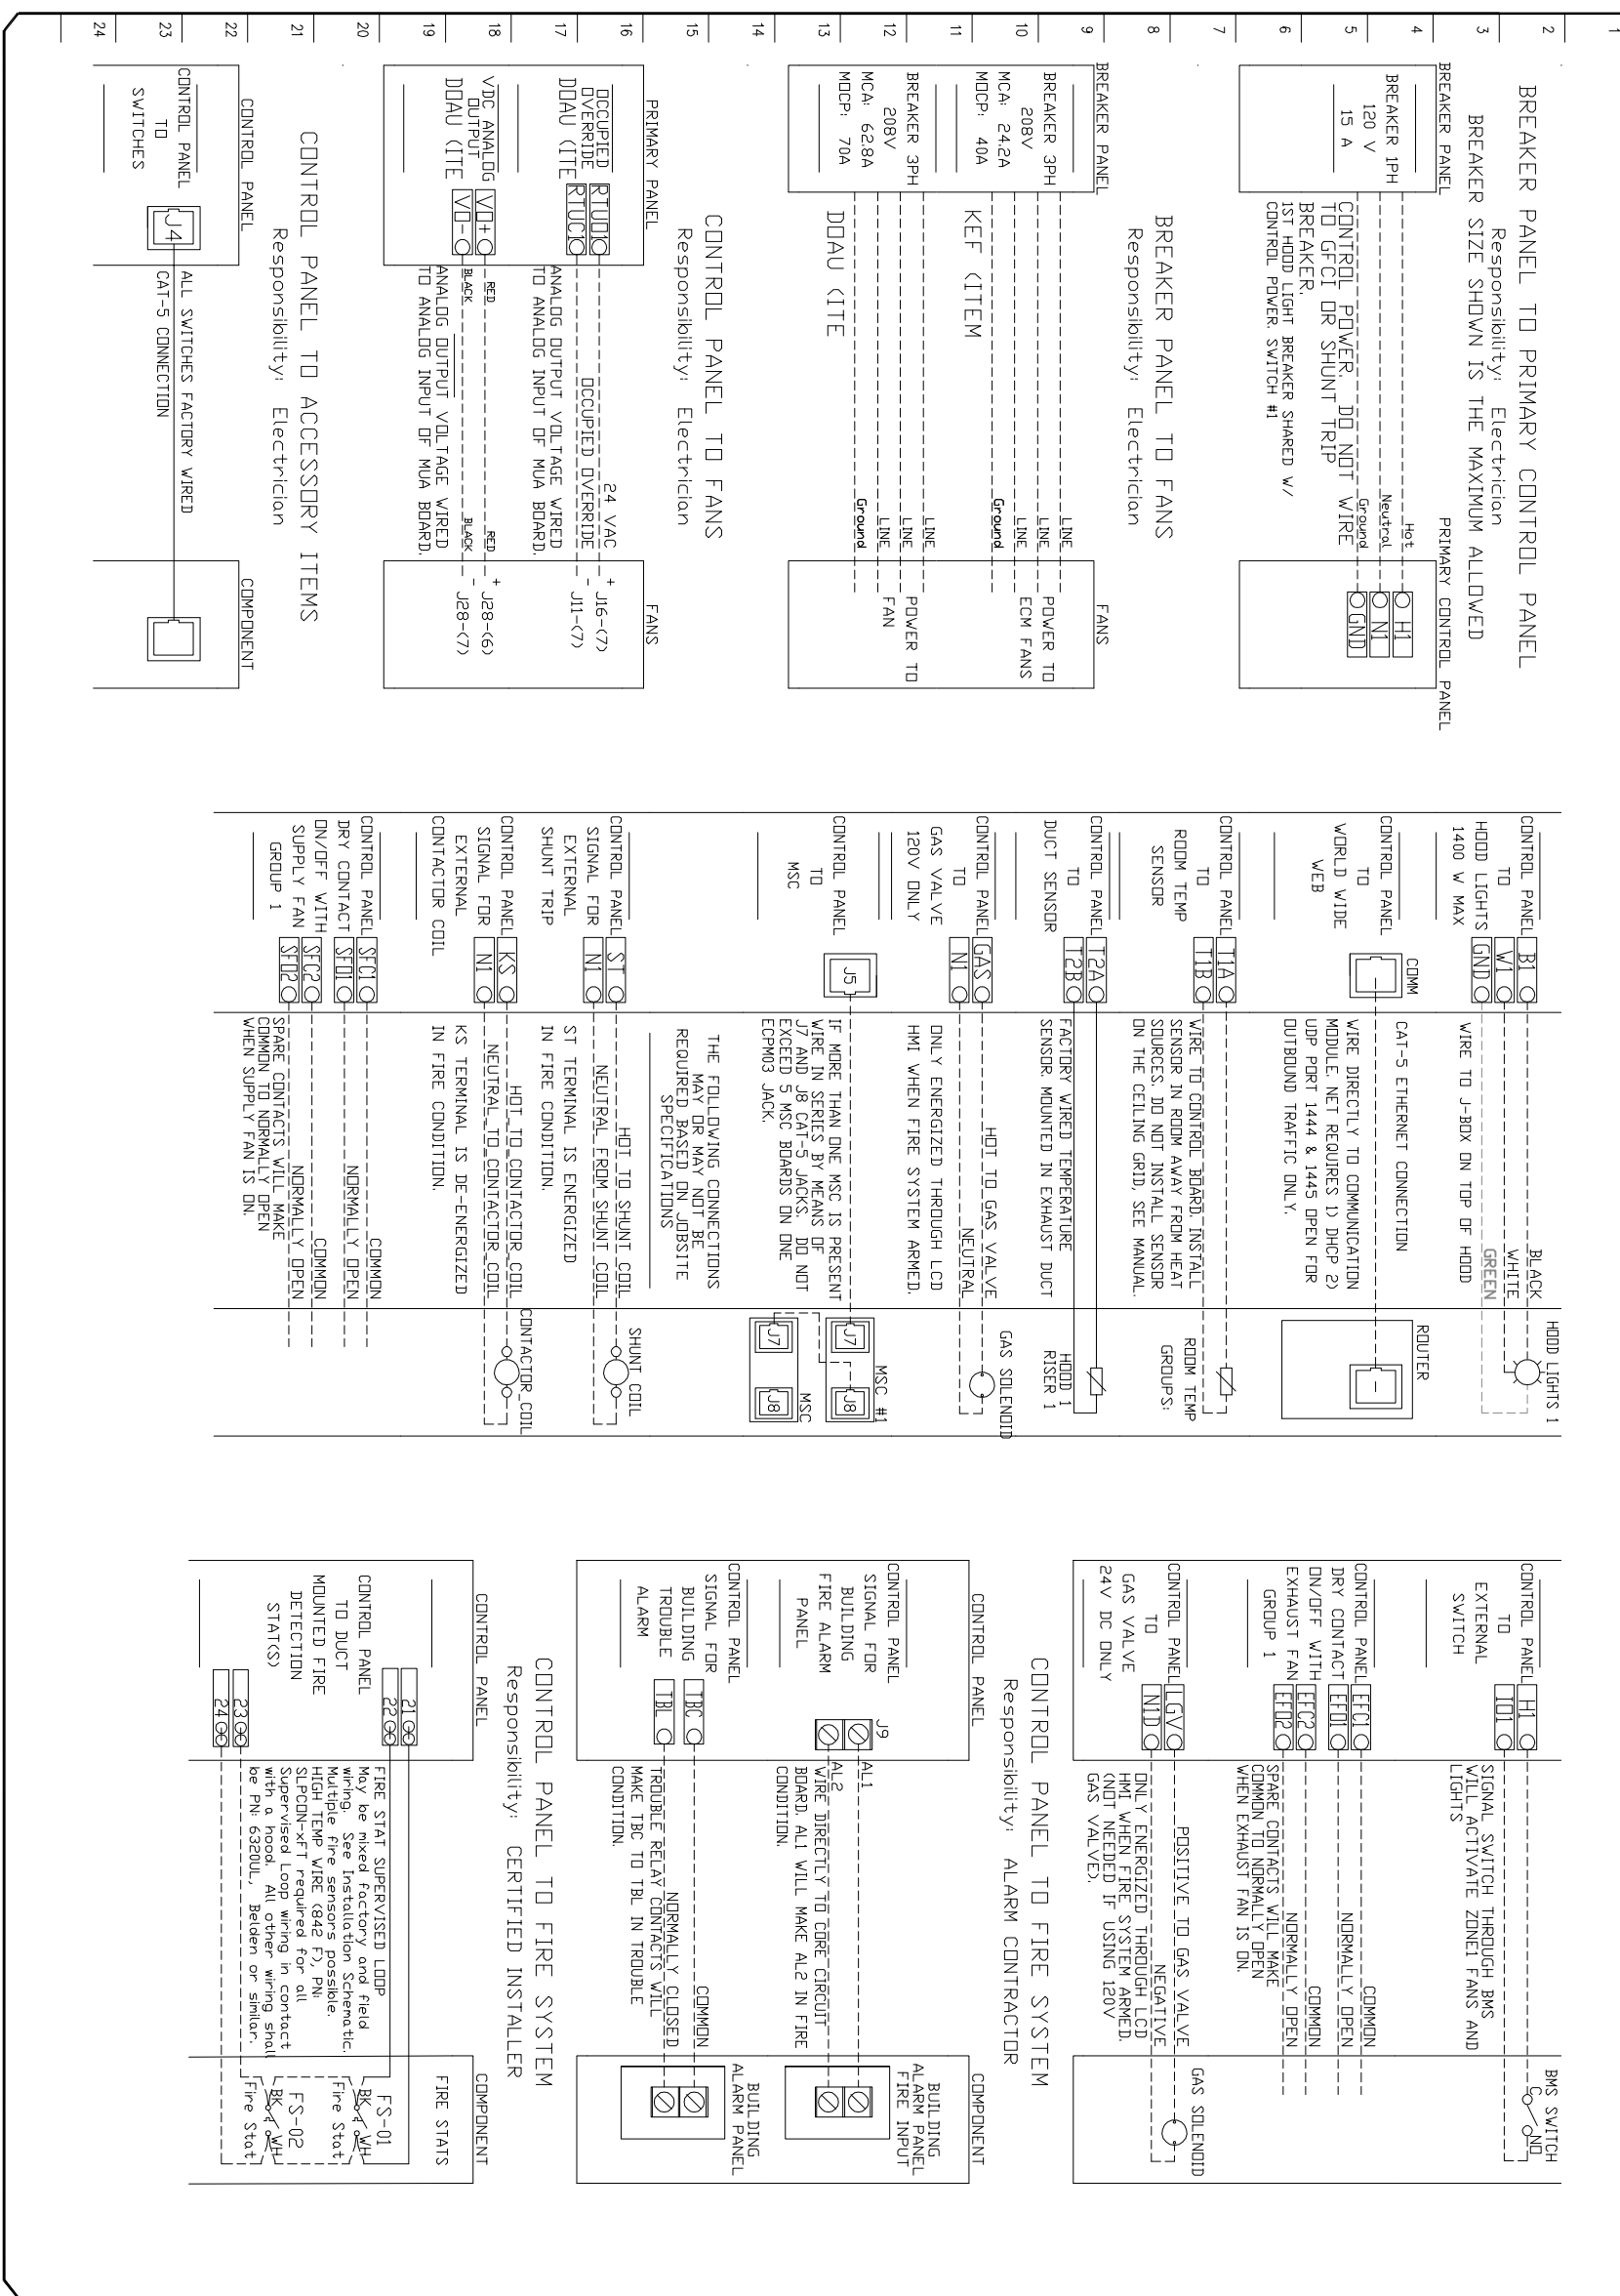

SYSTEM DESIGN VERIFICATION (SDV)

IF ORDERED, GAS SERVICE WILL PERFORM A SYSTEM DESIGN VERIFICATION (SDV) ONCE ALL EQUIPMENT HAS HAD A COMPLETE START UP PER THE OPERATION AND INSTALLATION MANUAL. TYPICALLY, THE SDV WILL BE PERFORMED AFTER ALL INSPECTIONS ARE COMPLETE.

ANY FIELD RELATED DISCREPANCIES THAT ARE DISCOVERED DURING THE SDV WILL BE BROUGHT TO THE ATTENTION OF THE GENERAL CONTRACTOR AND CORRESPONDING TRADES ON SITE. THESE ISSUES WILL BE DOCUMENTED AND FORWARDED TO THE APPROPRIATE SALES OFFICE. IF GAS SERVICE HAS TO RESOLVE A DISCREPANCY THAT IS A FIELD ISSUE, THE GENERAL CONTRACTOR WILL BE NOTIFIED AND BILLED FOR THE WORK. SHOULD A RETURN TRIP BE REQUIRED DUE TO ANY FIELD RELATED DISCREPANCY THAT CANNOT BE RESOLVED DURING THE SDV, THERE WILL BE ADDITIONAL TRIP CHARGES.

DURING THE SDV, GAS SERVICE WILL ADDRESS ANY DISCREPANCY THAT IS THE FAULT OF THE MANUFACTURER. SHOULD A RETURN TRIP BE REQUIRED, THE GENERAL CONTRACTOR AND APPROPRIATE SALES OFFICE WILL BE NOTIFIED. THERE WILL BE NO ADDITIONAL CHARGES FOR MANUFACTURER DISCREPANCIES.

Old School Building
201 N Broadway Ave,
Moore, OK, 73160

DATE: 8/12/2025
DWG#: 8170091
DRAWN BY: RJH-80
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO. 10

Tulsa Office
12101 East 51st Street, Suite 101A, Tulsa, OK, 74146 PHONE: (918) 258 - 0291 FAX: 9192275947 EMAIL: reg80@captiveaire.com

AGP
the Abba Griffin
Partnership L.L.C.

313 S. E. 5th Street
MOORE, OK, 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

REVISIONS

NO	DATE	DESCRIPTION

CDAR CREEK
CIVIL
KFC ENGINEERING
STRUCTURAL
SALAS OBREN
MECHANICAL/ELECTRICAL


FS
drawn by
RS
checked by
November 2025
date
revisions

OLD SCHOOL
UPGRADES

sheet no.

FS507

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESS WRITTEN
CONSENT OF AGP.



1

FOODSERVICE EQUIPMENT VENTILATOR PLAN
1/4" = 1'-0"