


TACTILE SIGNAGE:

- A. WHEN SIGNS IDENTIFY A PERMANENT ROOM OR SPACE OF A BUILDING OR SITE, OR WHEN SIGNS DIRECT OR GIVE INFORMATION ABOUT A PERMANENT ROOM OR SPACE OF A BUILDING OR SITE, CORRESPONDING TACTILE SIGNAGE SHALL BE INSTALLED.
- B. WHEN SIGNS IDENTIFY, OR GIVE INFORMATION ABOUT ACCESSIBLE ELEMENTS AND FEATURE OF A BUILDING OR SITE, THEY SHALL INCLUDE THE APPROPRIATE SYMBOL OF ACCESSIBILITY OR PICTOGRAM, WITH THE EQUIVALENT VISUAL AND TACTILE DESCRIPTION PLACED DIRECTLY BELOW THE PICTOGRAM. THE OUTSIDE BORDER OF THE PICTOGRAM SHALL BE MINIMUM 6" IN HEIGHT.
- C. VISUAL CHARACTERS SHALL BE UPPERCASE, STANDARD SANS SERIF FONT. THE HEIGHT OF VISUAL CHARACTERS SHALL BE A MINIMUM 5/8" PLUS 1/8" PER FOOT OF VIEWING DISTANCE OVER SIX FEET. CHARACTER WIDTH SHALL BE 55% MINIMUM AND 110% MAXIMUM OF THE HEIGHT OF THE CHARACTER. CHARACTER STROKE WIDTH OF VISUAL ONLY CHARACTERS SHALL BE A MINIMUM OF 10% OF THE CHARACTER HEIGHT, AND A MAXIMUM OF 30%. TACTILE SIGNAGE DUPLICATING THE INFORMATION SHALL BE PROVIDED, EITHER AS PART OF THE VISUAL SIGN OR A SEPARATE TACTILE SIGN PROVIDED.
- D. TACTILE CHARACTERS SHALL BE UPPERCASE, STANDARD SANS SERIF FONT, RAISED 1/32" OFF THE BACKGROUND. THE HEIGHT OF TACTILE CHARACTERS SHALL BE BETWEEN 5/8" AND 2". CHARACTER WIDTH SHALL BE 55% MINIMUM AND 110% MAXIMUM OF THE HEIGHT OF THE CHARACTER. CHARACTER STROKE WIDTH SHALL BE A MINIMUM OF 10% OF THE CHARACTER HEIGHT, AND A MAXIMUM OF 15%. CHARACTERS SHALL BE ACCOMPANIED BY GRADE 2 BRAILLE.
- E. GRADE 2 BRAILLE SHALL HAVE DOMED OR ROUNDED DOTS RAISED 1/40" OFF THE BACKGROUND, WITH DOTS SPACED 11/10" WITH-IN CELLS, AND 1/4" BETWEEN CELLS. (OR SPACED PER ANSI TABLE 703.3.1)
- F. TACTILE SIGNS SHALL BE MOUNTED 48" MINIMUM AND 60" MAXIMUM ABOVE THE FLOOR TO THE CENTERLINE OF THE SIGN. AN 18" X 18" CLEAR SPACE IS REQUIRED IN FRONT OF THE TACTILE SIGN, BEYOND THE ARC OF ANY DOOR SWING. WHERE SIGNS ARE MOUNTED AT DOORS, THE SIGN SHALL BE ON THE LATCH SIDE OF THE DOOR. WHERE SIGNS ARE MOUNTED AT DOUBLE DOORS, OR WHERE THERE IS NO WALL SPACE, THE SIGN SHALL BE MOUNTED ON THE NEAREST ADJACENT WALL, PREFERABLY THE RIGHT SIDE.
- G. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND. CHARACTERS, SYMBOLS AND BACKGROUNDS SHALL HAVE A NON-GLARE FINISH.

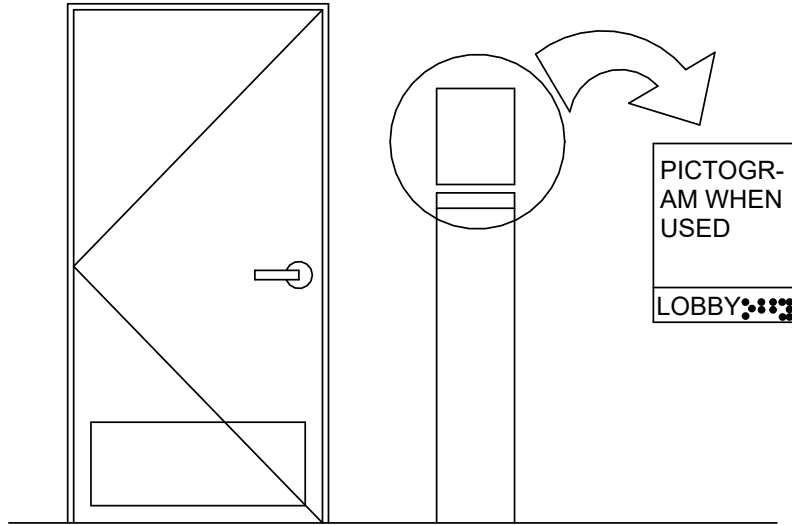

LIFE SAFETY GENERAL NOTES:

- A. ALL EGRESS DOORS SHALL BE READILY OPERABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
- B. PROVIDE SIGN ON OR NEAR THE MAIN EXIT DOOR READING "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED"
- C. REFER TO SHEET G002 FOR REQUIREMENTS ON TACTILE AND ACCESSIBILITY SIGNAGE
- D. PROVIDE (1) ONE FIRE EXTINGUISHER FOR 3,000 S.F. AND VERIFY WITH LOCAL FIRE MARSHAL FOR TYPE & FINAL LOCATIONS PRIOR TO INSTALLATION.

EGRESS LEGEND

A	OCCUPANT LOAD AT THIS EXIT
B	REQUIRED EXIT WIDTH (0.2" PER OCCUPANT)
C	PROVIDED EXIT WIDTH

PLANS, MAPS, SPECIFICATIONS, STUDIES AND REPORTS NOT CONTAINING A SEAL IMPRINT ACCOMPANIED BY AN ORIGINAL SIGNATURE BY THE LICENSED PROFESSIONAL MAY HAVE BEEN FRAUDULENTLY ALTERED AND SHALL NOT BE CONSIDERED AN ORIGINAL COPY. ALL INFORMATION SHOULD BE DISREGARDED UNLESS VERIFIED BY THE PROFESSIONAL WHOSE SIGNATURE APPEARS BELOW. COPYRIGHT PROTECTED © 2025

ISSUE RECORD
DESCRIPTION DATE
ISSUE FOR PERMIT 06/22/2026

NO	DATE	REVISION
1	08/11/26	CITY COMMENTS

PROFESSIONAL SEAL



06/22/26

REMODEL

PROJECT NAME

1100 W. MAIN ST.
NORMAN, OK 73069

PROJECT NUMBER



26-0061

SHEET TITLE

LIFE SAFETY PLANS

SHEET NUMBER

A003

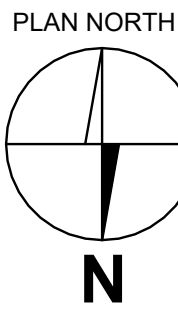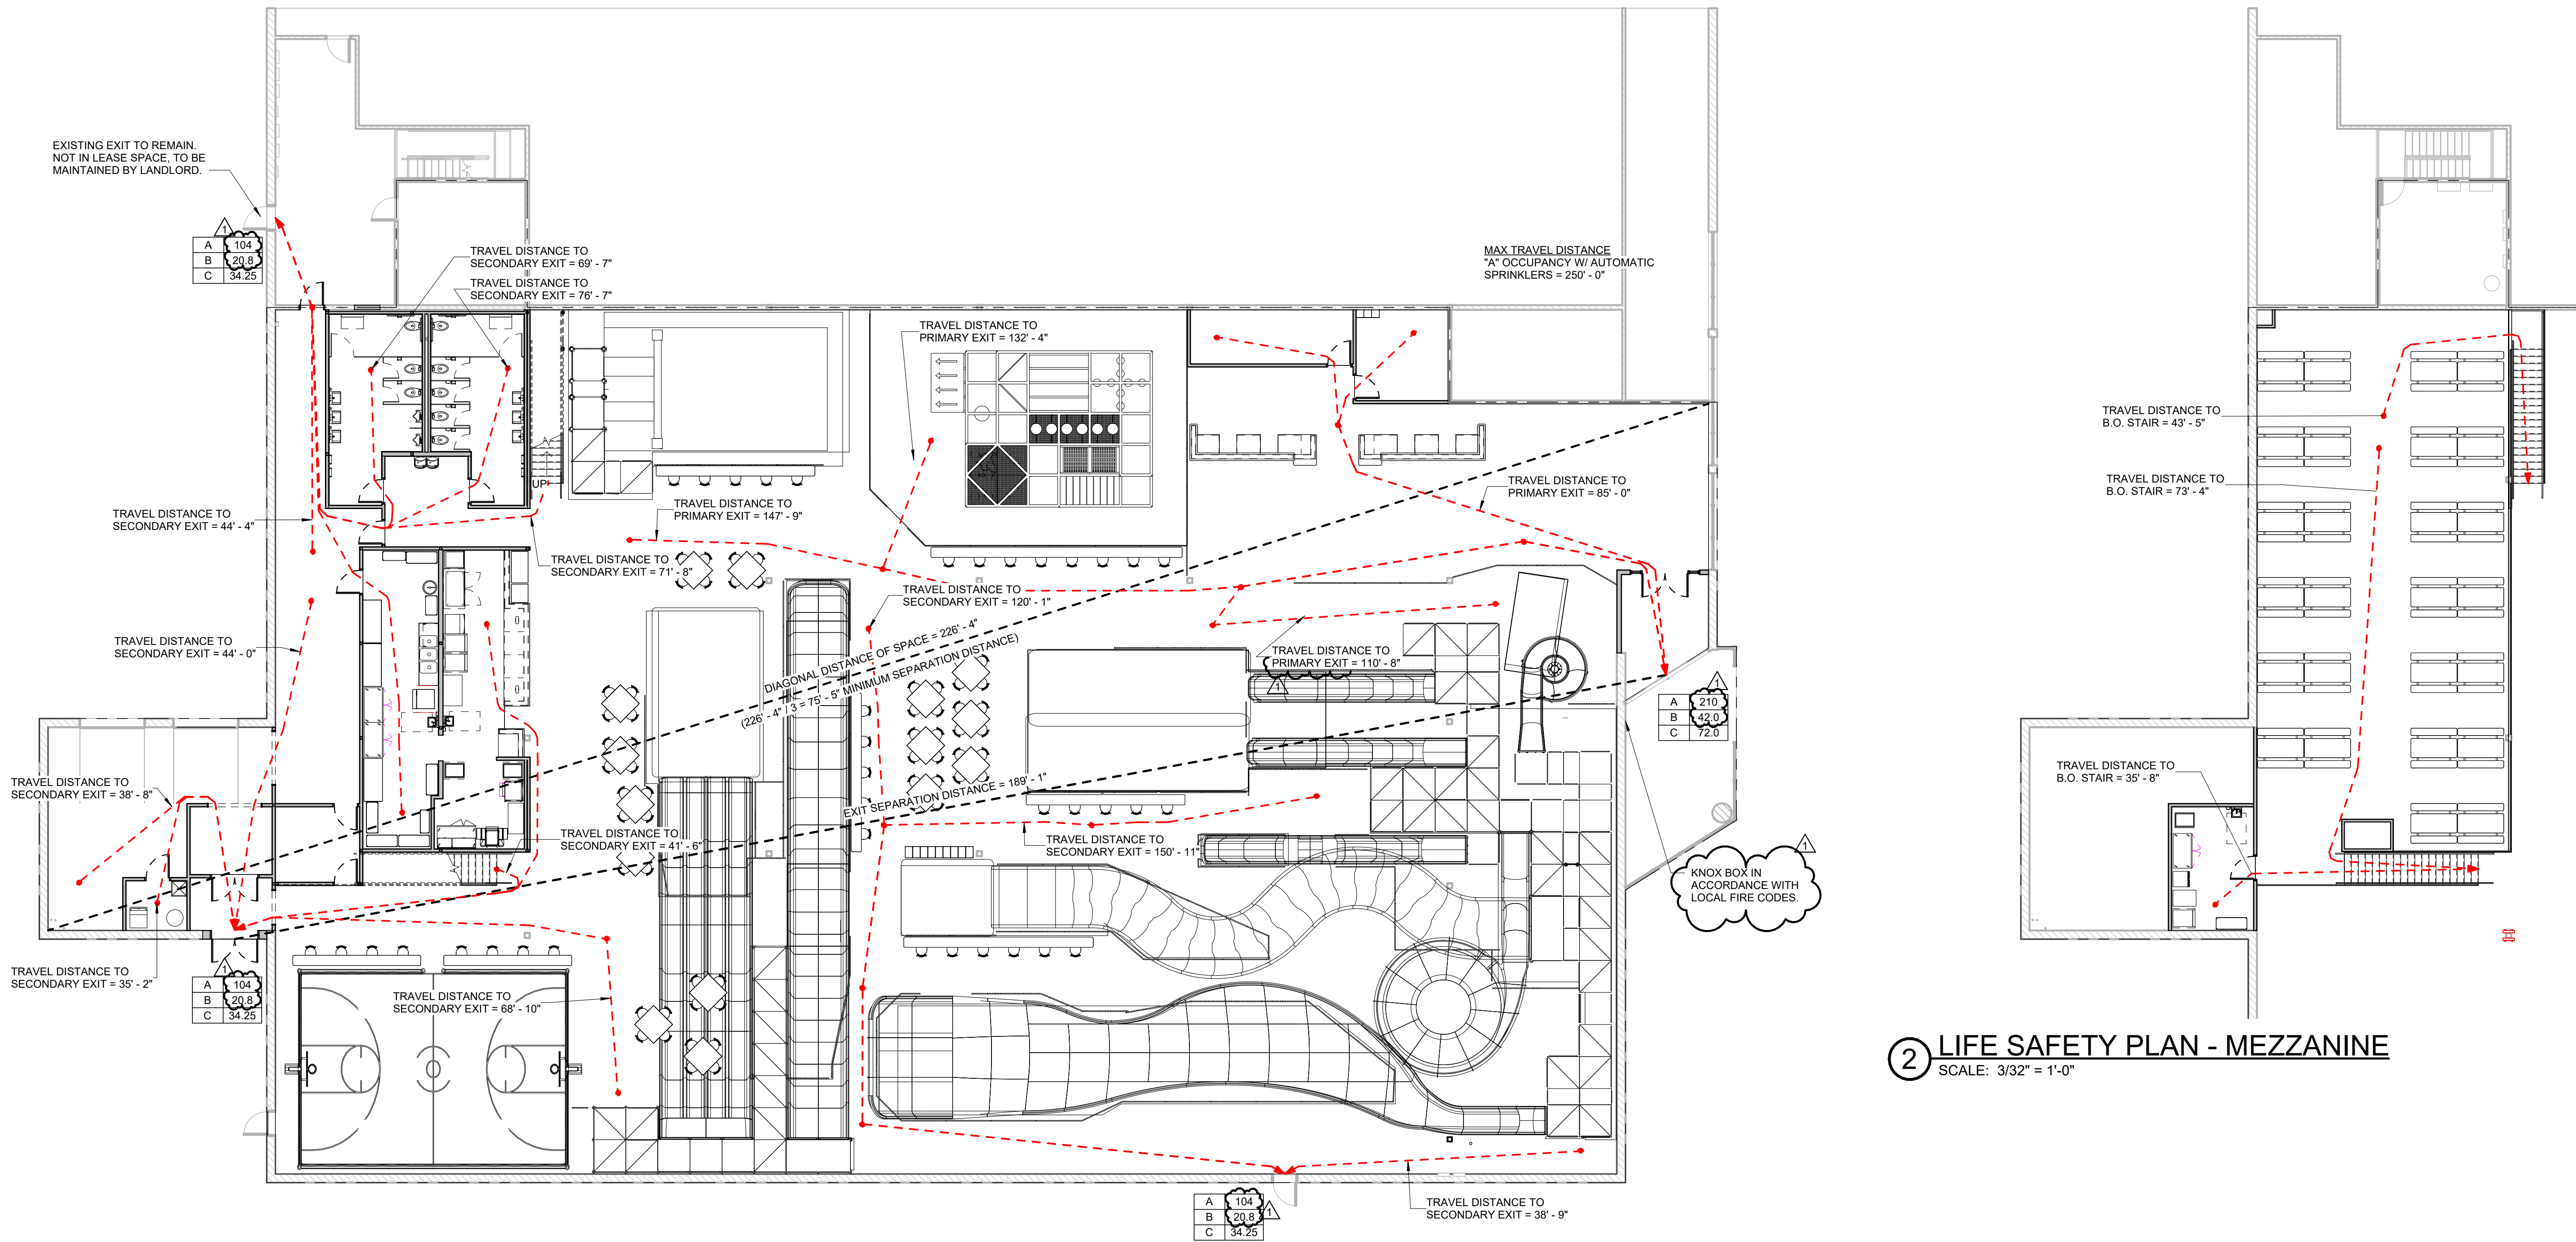

1 LIFE SAFETY PLAN
SCALE: 3/32" = 1'-0"

2 LIFE SAFETY PLAN - MEZZANINE
SCALE: 3/32" = 1'-0"