FOOD SERVICE EQUIPMENT SCHEDULE

ITEM	DESCRIPTION	QUANTITY	AMPS	KW	VOLTAGE	PHASE	CONDUCTOR	CONDUIT	TERMINATION
1	BEVERAGE MERCHANDISER	1	14	-	120	1	2#10,#10G	3/4"	NEMA 5-20R
3	PIZZA WARMER	3	-	1.5	120	1	2#12,#12G	3/4"	NEMA 5-20R
4	PIZZA PREP TABLE	1	7.9	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
5	ICE CREAM MERCHANDISER	1	6.07	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
7	CHEST FREEZER	3	6	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
8	ICE/BEV DISPENSER	2	9	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
9	FROZEN DRINK MACHINE	3	-	4.9	208	1	2#10,#10G	3/4"	NEMA 6-30R
11	REACH-IN FREEZER	1	9.6	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
12	ICE MAKER W/ BIN	2	13.8	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
16	ICE CREAM MERCHANDISER	1	6.07	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
18	COMBO WASHER/DRYER	1	16	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
19	REACH-IN REFRIGERATOR	1	2.6	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
20	OVEN	1	-	9.6	208	3	2#8,#10G	3/4"	NEMA 6-50R
25	POS SYSTEM	2	16	-	120	1	2#12,#12G	3/4"	NEMA 20-R
27	REACH-IN REFRIGERATOR	2	5.4	-	120	1	2#12,#12G	3/4"	NEMA 5-20R
29	CONVEYOR OVEN	1	-	7.5	208	3	2#8,#10G	3/4"	NEMA 6-50R

NOTES:
1. ALL WIRING DEVICE COVER PLATES SHALL BE STAINLESS STEEL. COORDINATE WITH OWNER AND ARCHITECT BEFORE PURCHASE.
2. REFERENCE FOOD SERVICE EQUIPMENT SHEETS FOR TERMINATION REQUIREMENTS.
3. CONTRACTOR SHALL PROVIDE FLEXIBLE EMT AND MAKE FINAL CONNECTIONS. REFERENCE FOOD SERVICE PLANS.
4. COORDINATE MOUNTING HEIGHTS OF ALL FOOD SERVICE EQUIPMENT WIRING DEVICES WITH FOOD SERVICE PLANS.
5. CONTRACTOR SHALL COORDINATE ALL ELECTRICAL REQUIREMENTS OF FOOD SERVICE EQUIPMENT WITH FOOD SERVICE PLANS, EQUIPMENT SUPPLIER AND DATA SHEETS.
6. COORDINATE MOUNTING HEIGHTS OF ALL FOOD SERVICE EQUIPMENT WIRING DEVICES WITH FOOD SERVICE PLANS.
7. CONTRACTOR SHALL PROVIDE WIRING AND CONDUIT FOR CONTROL OF EXHAUST FANS AND MAKEUP AIR FANS.
8. ALL RECEPTACLES IN KITCHEN AREA TO BE GFI AND ACCESSIBLE, OR FED FROM GFI BREAKER PER CEC 210.8. COORDINATE GFCI REQUIREMENTS FOR EQUIPMENT REQUIRING SHUNT-TRIP IN ADDITION TO GFCI.
9. CONTRACTOR SHALL PROVIDE DISCONNECT SWITCHES AS REQUIRED.
10. SEE PLANS FOR CIRCUIT NUMBERS.

GENERAL CONTRACTOR NOTE

ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR SUPPLYING CONDUIT, EMT CONDUIT, J-BOXES, PULLSTRINGS, RECEPTACLES ETC. FOR ALL LOW-VOLTAGE AND SECURITY DEVICES SHOWN IN THE LOW-VOLTAGE PLANS. DEVICES INCLUDES: P.O.S. LOCATIONS, CAMERAS, CAMERA MONITORS, ETC. REFER TO SHEETS LVL-1 - LV-5

GENERAL NOTES

A. VERIFY LOCATION OF ALL EQUIPMENT WITH ARCHITECT AND OTHER TRADES.

B. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFICATION OF ALL CONDITIONS AND IS ALSO RESPONSIBLE FOR REPORTING ANY CONFLICTS TO THE ENGINEER PRIOR TO THE START OF WORK.

C. COORDINATE OUTLET ORIENTATION WITH EQUIPMENT PLUGS SO THAT ALL 90 DEGREE PLUGS WILL HANG CORDDOWN.

D. ALL 120V, 20A RECEPTACLES WITHIN 6 FEET FROM THE OUTSIDE EDGE OF ALL WET SINKS SHALL BE GFCI-PROTECTED.

E. ALL RECEPTACLES WITHIN THE KITCHEN AREA SHALL BE GFCI TYPE. PROVIDE A GFCI CIRCUIT BREAKER IF RECEPTACLE IS NOT READILY ACCESSIBLE. SEE PANEL SCHEDULES FOR MORE DETAILS.

F. CONTRACTOR SHALL VERIFY RECEPTACLE NEMA CONFIGURATION FOR EQUIPMENT WITH EQUIPMENT SUPPLIER PRIOR TO INSTALLATION. NOTIFY ARCH. & ENGINEER OF ANY CONFLICT OR DISCREPANCY.

G. CONTRACTOR SHALL COORDINATE THE EXACT POWER, WIRING & FINAL CONNECTION REQUIREMENTS FOR ALL EQUIPMENT BEFORE ROUGH-IN WITH RESPECTIVE EQUIPMENT PROVIDER AND MAKE ALL REQUIRED FINAL CONNECTIONS.

H. BASED ON T24, GENERAL PURPOSE RECEPTACLES TO BE SPLIT-WIRED FOR 50% OF THE SCOPE AND BE CONTROLLED RECEPTACLES. REFER TO DETAIL 3 ON SHEET E301 FOR WIRING.

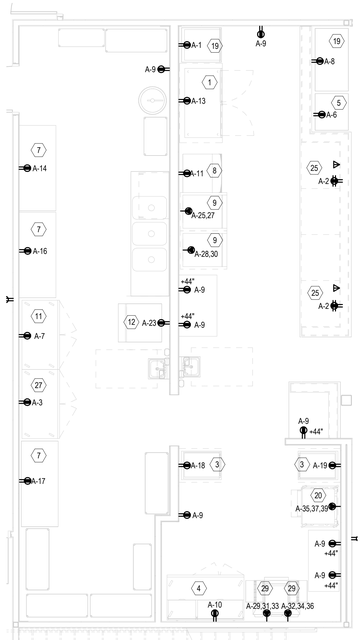

1 E301 ENLARGED KITCHEN PLAN - ELECTRICAL
1/4" = 1'-0"

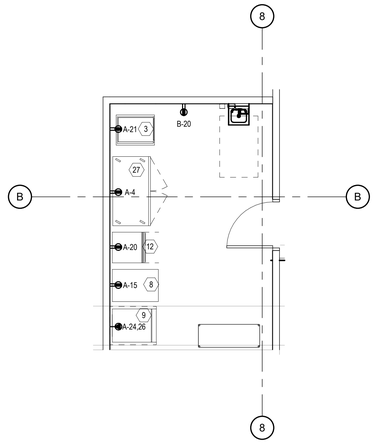

2 E301 ENLARGED KITCHEN PLAN MEZZANINE - ELECTRICAL
1/4" = 1'-0"



3 E301 ENLARGED MOP SINK - ELECTRICAL
1/4" = 1'-0"

Apogee Architectural Partners
A Build Led Company
16775 ADDISON ROAD, SUITE 500
ADDISON, TX 75001
PH: (469) 960-2322

PLANS, MAPS, SPECIFICATIONS, STUDIES AND REPORTS NOT CONTAINING A SEAL IMPRINT ACCOMPANIED BY AN ORIGINAL SIGNATURE BY THE LICENSED PROFESSIONAL MAY HAVE BEEN FRAUDULENTLY ALTERED AND SHALL NOT BE CONSIDERED AN ORIGINAL COPY. ALL INFORMATION SHOULD BE DISREGARDED UNLESS VERIFIED BY THE PROFESSIONAL WHOSE SIGNATURE APPEARS BELOW. COPYRIGHT PROTECTED
© 2025

ISSUE RECORD
DESCRIPTION DATE
ISSUE FOR PERMIT 06/22/2026

REVISION RECORD

NO	DATE	REVISION

PROFESSIONAL SEAL

LICENSED PROFESSIONAL ENGINEER
James Basquette
32963
TEXAS

James R. Basquette P.E.

Digitally signed by James R. Basquette
Email: jbasquette@rtmec.com, O=RTM Engineering Consultants, CN=James R. Basquette
Date: 2026.06.23 11:17:38-05'00'

rtm engineering consultants
14901 Quorum Dr. #565
Dallas, Texas 75254
rtmec.com | 972.387.3500

REMODEL

PROJECT NAME
SLICK CITY

NORMAN, OK

PROJECT NUMBER
NORMAN, OK

SHEET TITLE
ELECTRICAL POWER FLOOR PLAN - ENLARGED

SHEET NUMBER
E301