






VIEW 1

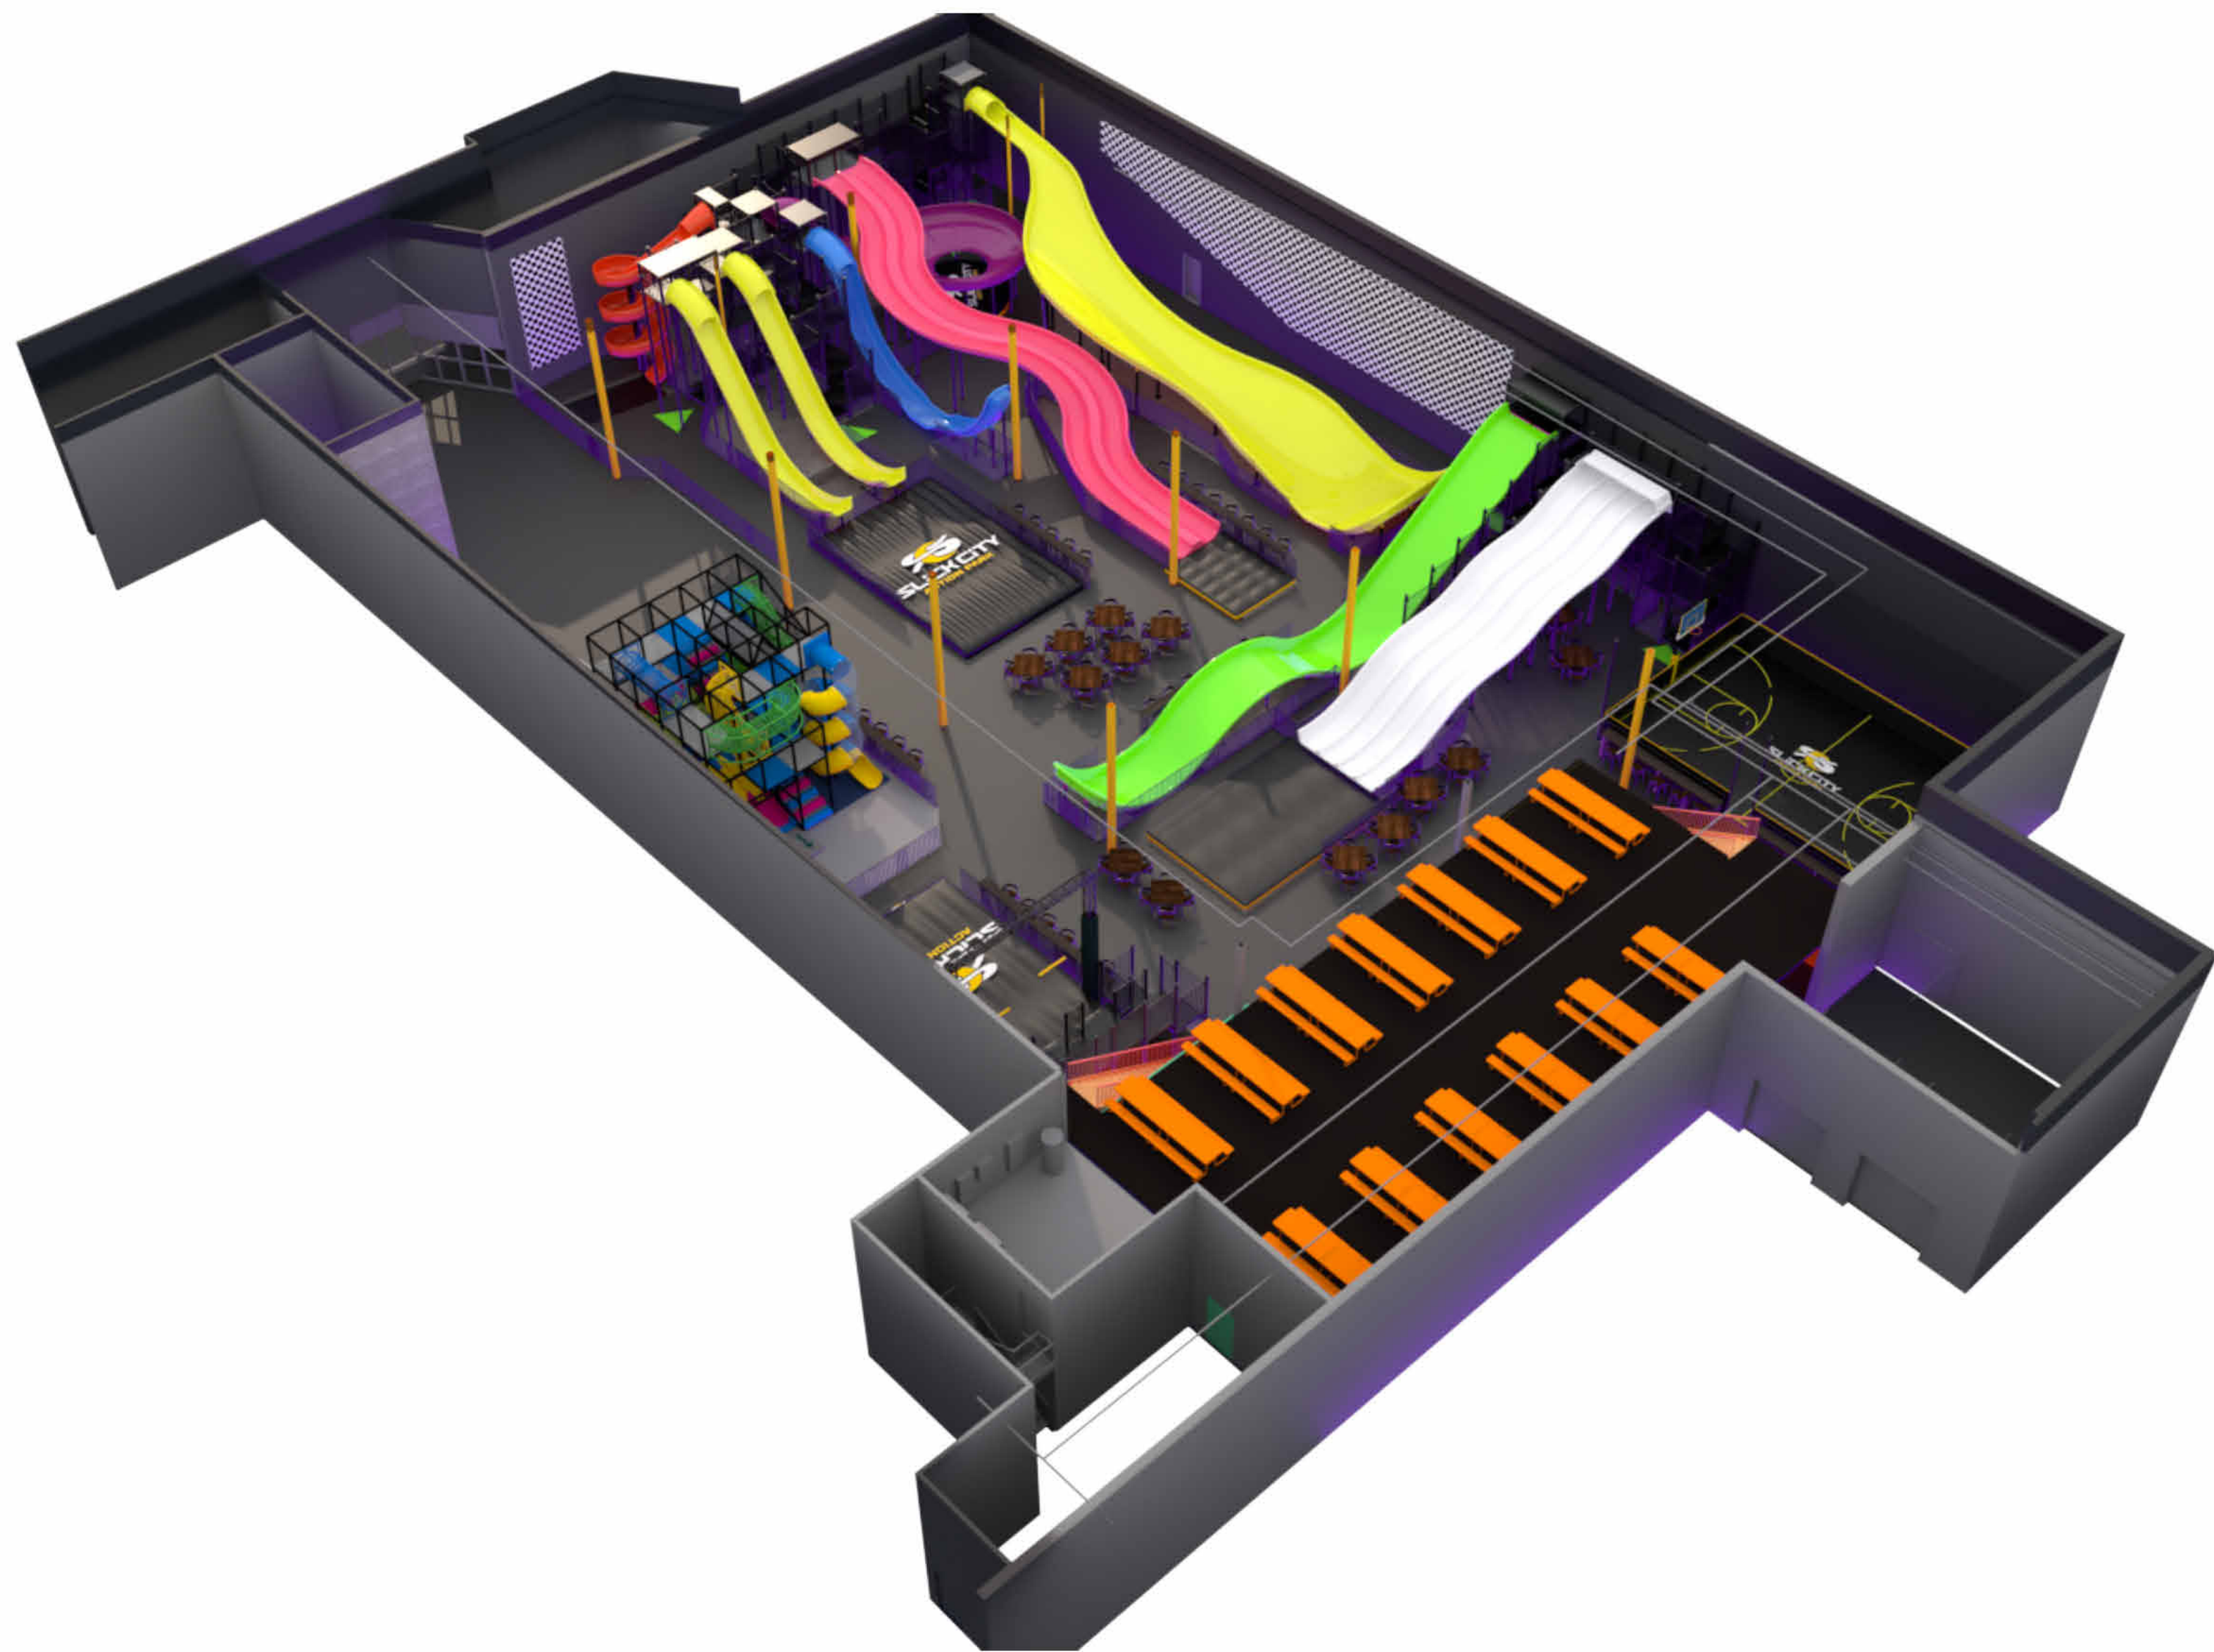

VIEW 2

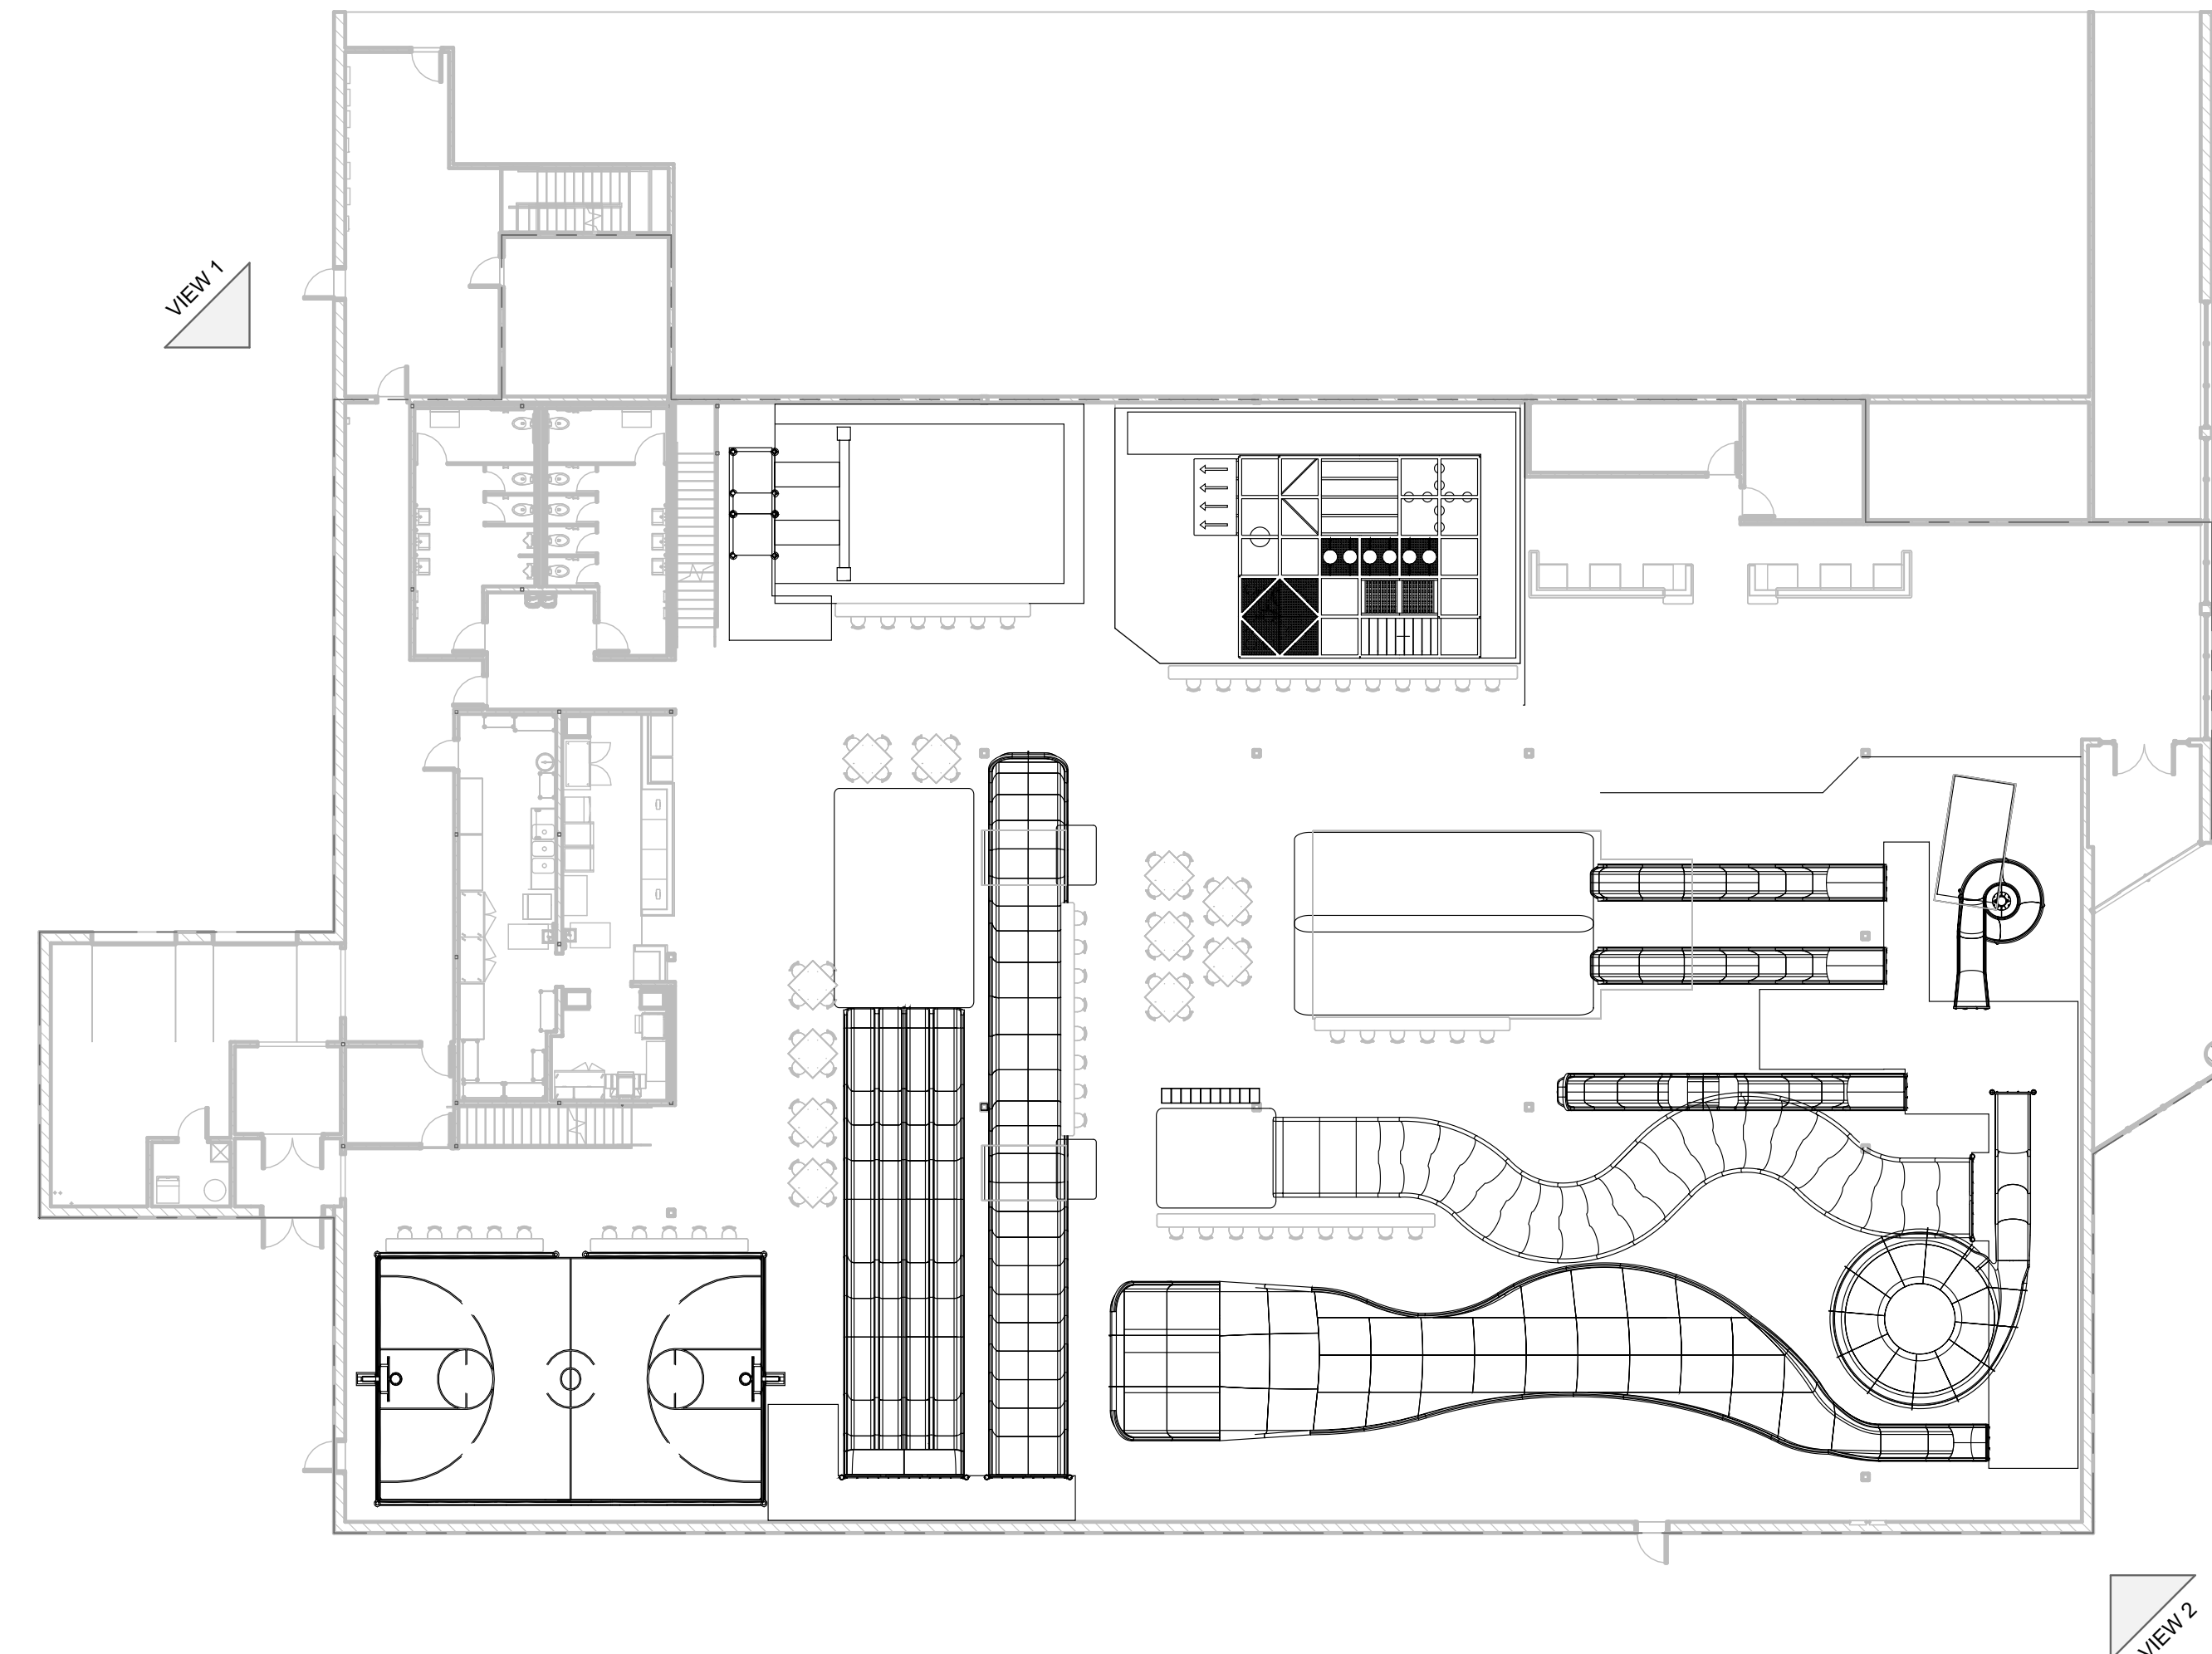

KEY PLAN

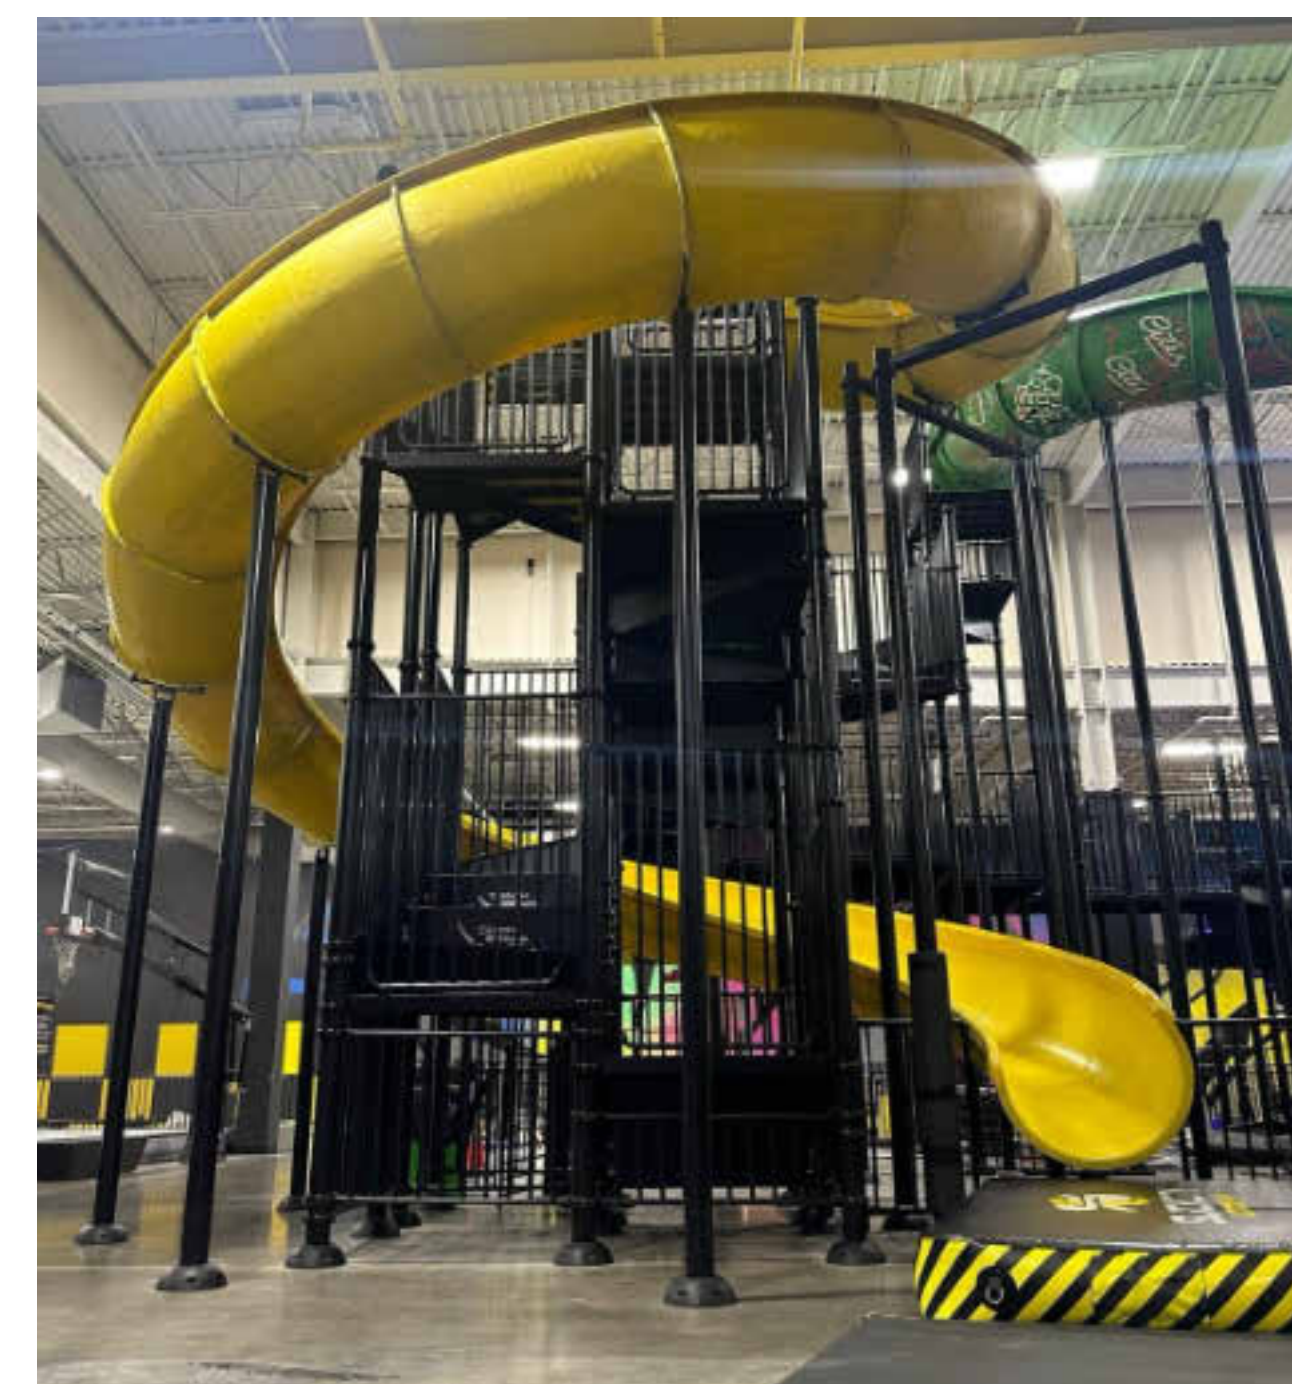

- NOTES
1. SLIDE MATERIALS TO THESE APPROVALS & SPECIFICATIONS:
 - ASTM D3319
 - FLAMMABILITY CLASSIFICATION: CLASS C - FLAME SPREAD INDEX 76-200, SMOKE DEVELOPMENT INDEX OF 450 OR LESS
 - MANUFACTURED IN AN ISO 9001 CERTIFIED PLANT
 - MEETS MINIMUM REQUIREMENTS OF MAJOR MODEL BUILDING CODES FOR CLASS C INTERIOR WALL & CEILING FINISHES OF FLAME SPREAD GREATER THAN OR EQUAL TO 200, SMOKE DEVELOPED INDEX 450 OR LESS (PER ASTM E84)
 - MOLD & MILDEW RESISTANT PER ASTM D3273 & D3274 TEST
 2. MODULAR TOWER SYSTEM IS COMPOSED OF NON-COMBUSTIBLE POWDER COATED STEEL - ADHERES TO THE STRICTEST ASTM STANDARDS CAN ACCOMMODATE VARIOUS ATTRACTIONS (SLIDES, ZIP LINES, TRAPEZE, ETC.)
 3. THE EXISTING TENANT SPACE CONTAINS: EXISTING AUTOMATIC FIRE SPRINKLER PROTECTION, EXISTING AUTOMATIC SMOKE DETECTION, EXISTING EMERGENCY VOICE / ALARM COMMUNICATION SYSTEM, MATERIAL REQUIREMENTS FOR PLAY STRUCTURES & CLASS A INTERIOR FINISHES
 4. REQUIRED TOWER GUARDS TO NOT HAVE OPENINGS THAT ALLOW PASSAGE OF A SPHERE 4 INCHES IN DIAMETER FROM THE WALKING SURFACE TO THE REQUIRED GUARD HEIGHT. THE OPENINGS ARE TYPICALLY 3 1/4 INCHES.
 5. TOWER GUARDS SHALL BE LOCATED ALONG OPEN-SIDED WALKING SURFACES, INCLUDING MEZZANINES, EQUIPMENT PLATFORMS, AISLES, STAIRS, RAMPS & LANDINGS THAT ARE LOCATED MORE THAN 30 INCHES MEASURED VERTICALLY TO THE FLOOR OR GRADE BELOW. AT ANY POINT WITHIN 36 INCHES HORIZONTALLY TO THE EDGE OF THE OPEN SIDE, GUARDS SHALL BE ADEQUATE IN STRENGTH & ATTACHMENT IN ACCORDANCE WITH IBC SECTION 1607.8.