



CJC  
drawn by  
BWB  
checked by  
MARCH 2023  
date

revisions

MOORE PUBLIC SCHOOLS  
BOARD OF EDUCATION  
MOORE, OKLAHOMA




OFFICE  
ADDITION -  
SOUTHGATE  
ELEMENTARY SCHOOL


sheet no.

## S102

OWNERSHIP USE OF DOCUMENTS:  
AGP EXPRESSLY RESERVES ITS  
COPYRIGHT AND OTHER PROPERTY  
RIGHTS OF ALL PLANS AND DRAWINGS  
DESIGNED AND/OR PRODUCED. PLANS  
AND DRAWINGS ARE NOT TO BE  
REPRODUCED IN ANY FORM OR MANNER  
WITHOUT THE EXPRESSED WRITTEN  
CONSENT OF AGP.

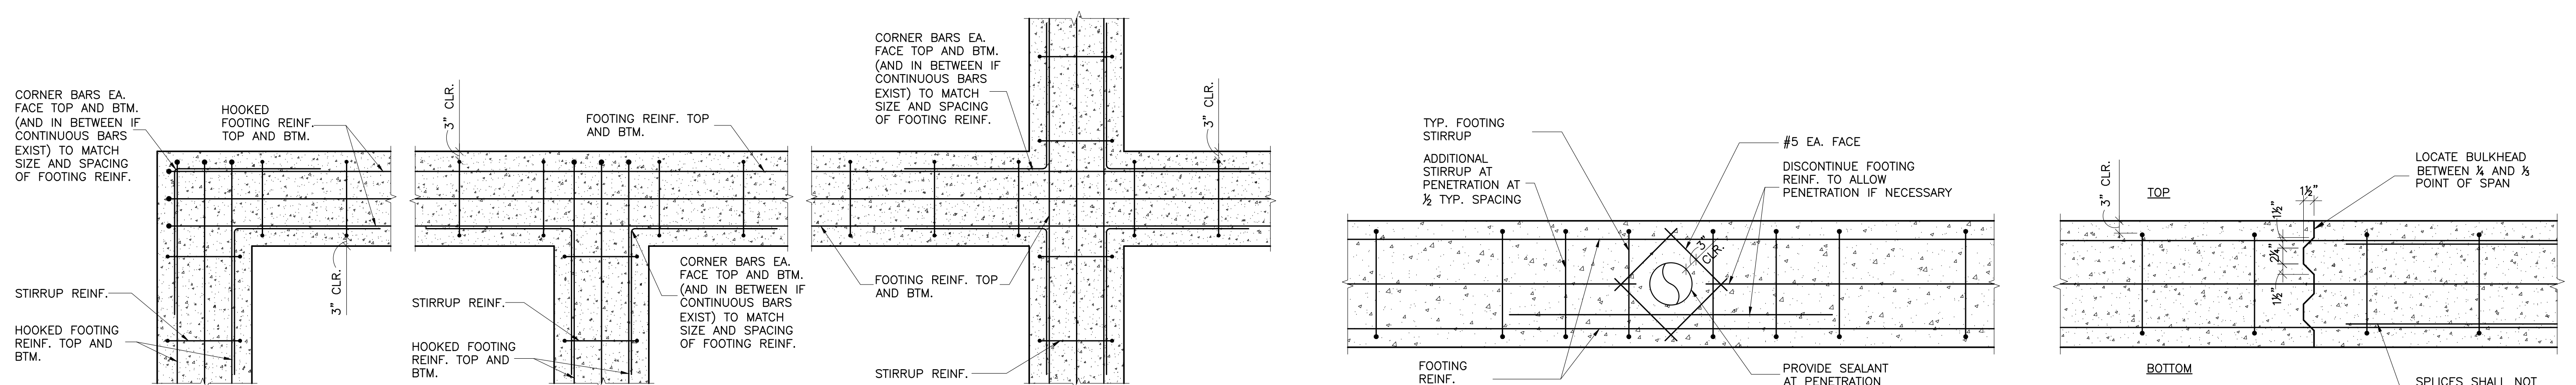


**1 TYP. FOOTING CORNER REINF.** SCALE: NONE  
**2 TYP. FOOTING TEE REINF.** SCALE: NONE  
**3 TYP. REINF. AT FOOTING INTERSECTION** SCALE: NONE  
**4 FOOTING PENETRATION** SCALE: NONE  
**5 CJ THROUGH FOOTING** SCALE: NONE

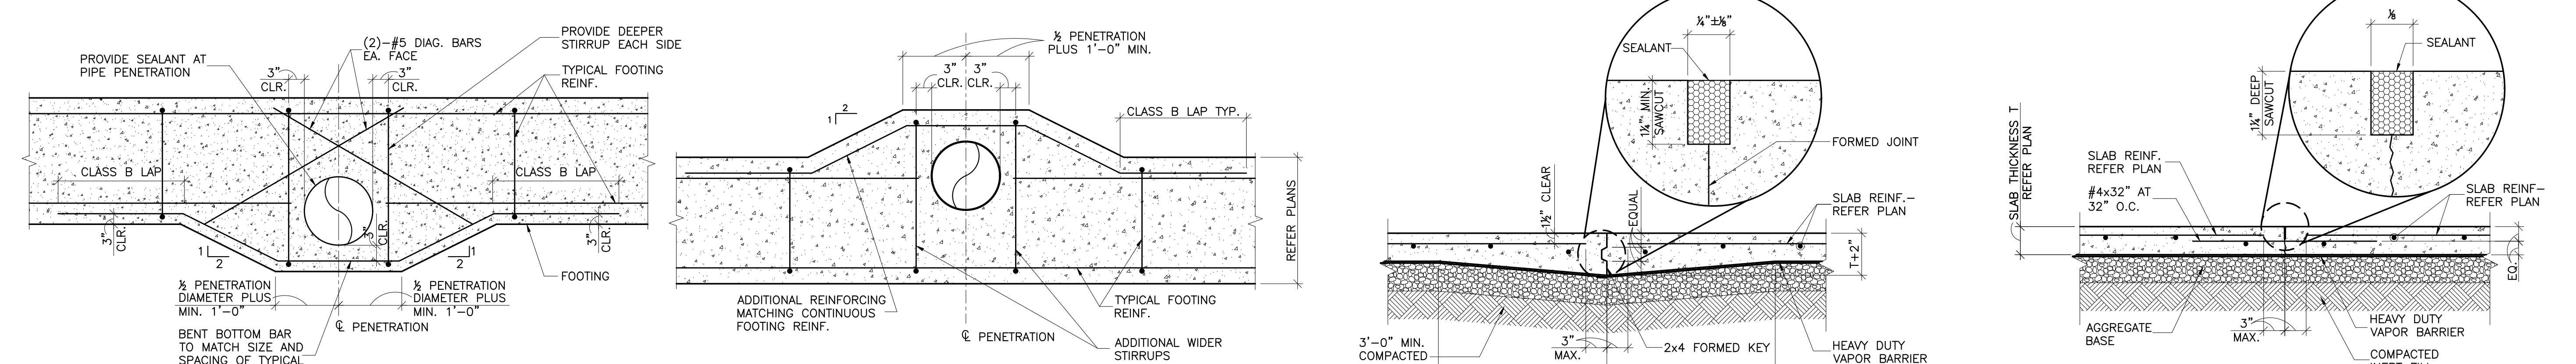

**6 TYP. FOOTING PENETRATION** SCALE: NONE  
**7 PLAN SECTION AT TYPICAL VERTICAL PENETRATION** SCALE: NONE  
**8 TYP. CONSTRUCTION JOINT (CJ)** SCALE: NONE  
**9 TYP. SAWED JOINT (SJ)** SCALE: NONE


**NOTES:**  
 1. COORDINATE ANCHOR BOLT REQUIREMENTS FOR EQUIPMENT PRIOR TO INSTALLATION OF HOUSEKEEPING PAD.  
 2. ALLOW PROPER CURE TIME OF EPOXY PRIOR TO PLACEMENT OF CONCRETE.

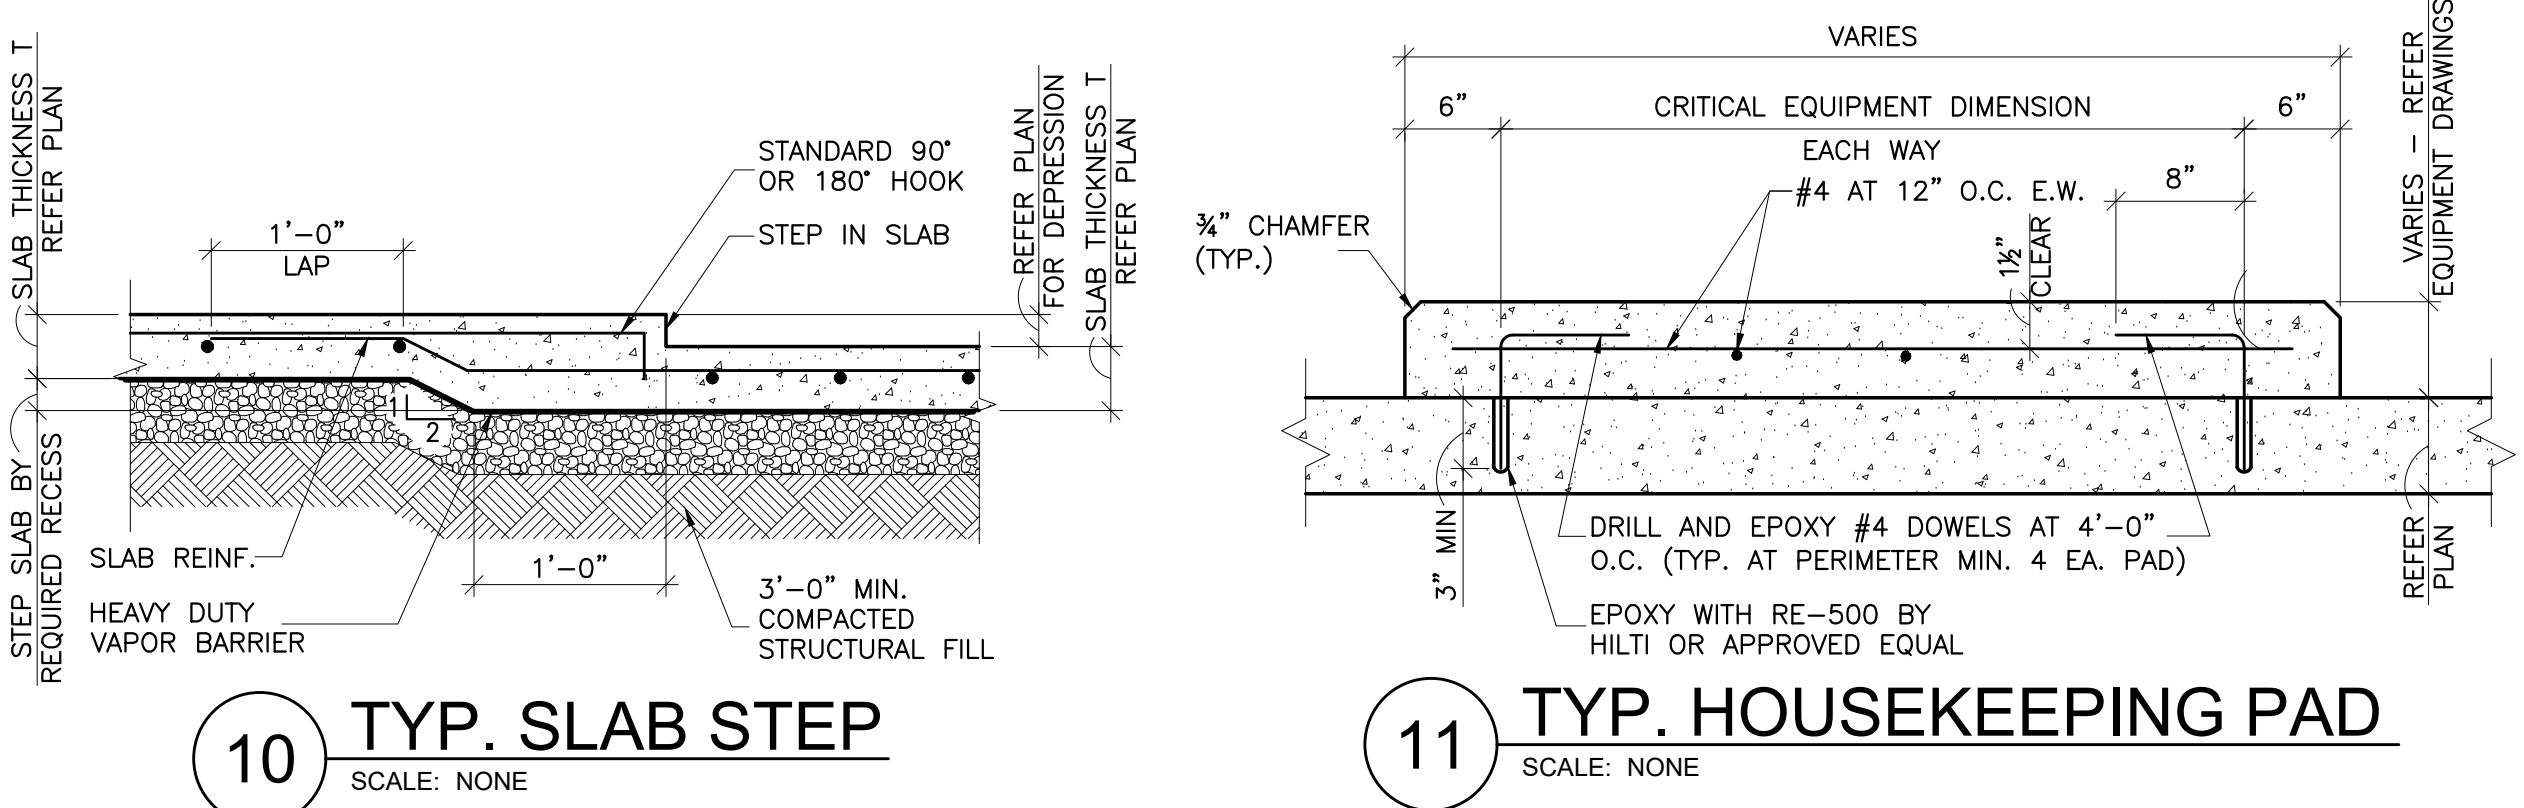

**10 TYP. SLAB STEP** SCALE: NONE  
**11 TYP. HOUSEKEEPING PAD** SCALE: NONE

CONCRETE EXPOSURE	MEMBER	REINFORCEMENTS	SPECIFIED COVER, IN.
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	ALL	ALL	3
EXPOSED TO WEATHER OR IN CONTACT WITH GROUND	ALL	NO. 6 THROUGH NO. 18 BAR	2
		NO. 5 BAR, W31 OR D31 WIRE, AND SMALLER	1-1/2
NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND	SLAB, JOISTS, AND WALLS	NO. 14 AND NO. 18 AND SMALLER	1-1/2
		BEAMS, COLUMNS, PEDESTALS, AND TENSION TIES	PRIMARY REINFORCEMENT, STIRRUPS, TIES, SPIRALS, AND HOOPS

**12 TYP. MIN. CONCRETE COVER** SCALE: NONE

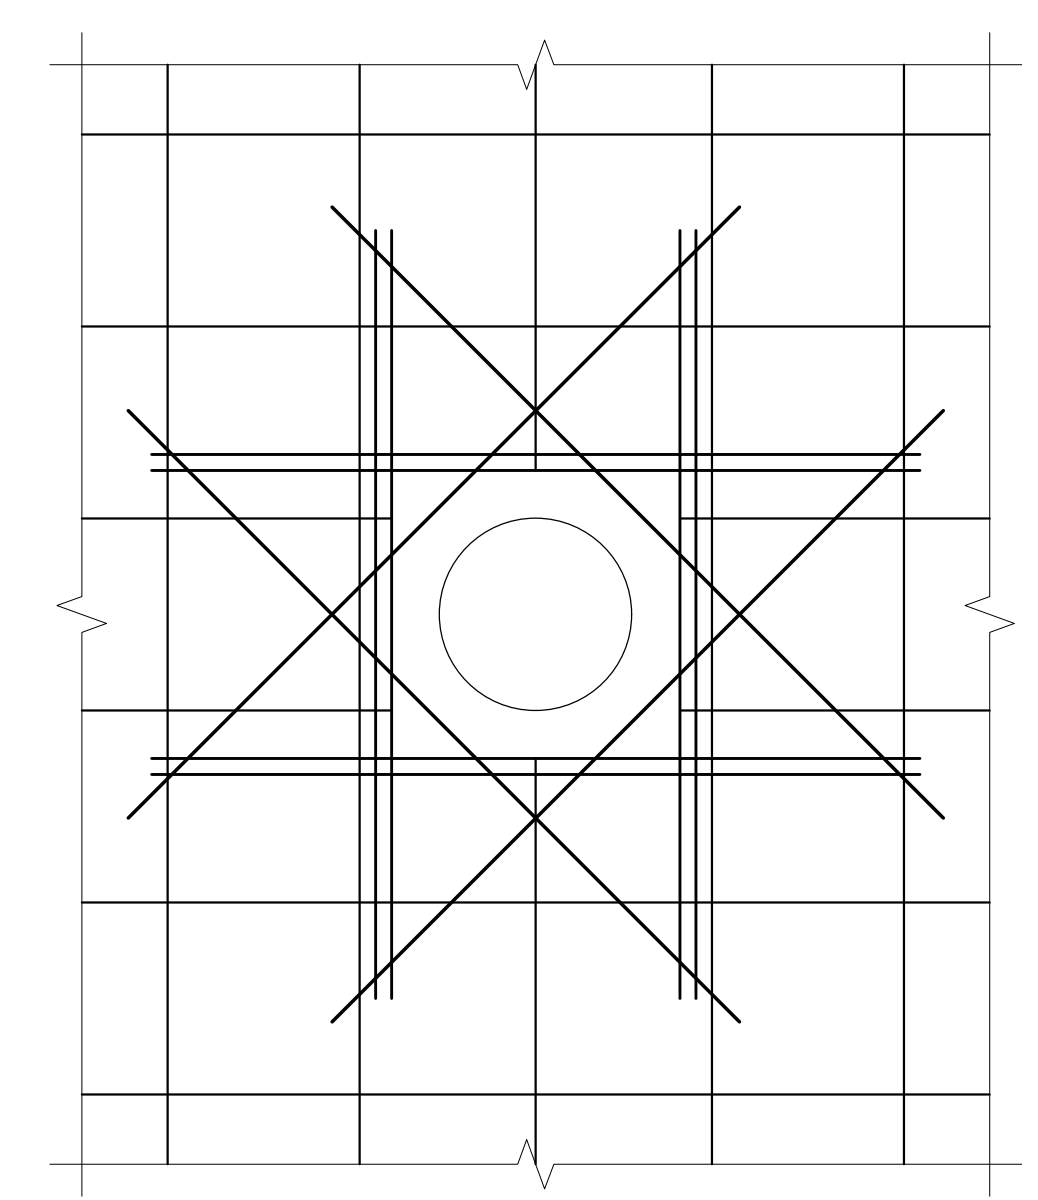

REIN. BARS SPACED LESS THAN 12" O.C. TO BE SPREAD WITHOUT INTERRUPTION TO CLEAR PENETRATIONS LESS THAN 12" DIAM. SIZE OF DIAGONAL AND EXTRA PARALLEL BARS TO EQUAL SIZE OF TYPICAL SLAB OR WALL REINFORCING BARS. NUMBER OF EXTRA PARALLEL BARS PLACED EACH WAY AROUND PENETRATION TO BE EQUAL TO NUMBER OF BARS INTERRUPTED. (TYPICAL FOR EACH FACE OF SLAB OR WALL). MINIMUM OF ONE BAR EACH WAY, EACH FACE OF SLAB OR WALL. FOR PENETRATIONS LESS THAN 12", PROVIDE 4-#4x4'-0" DIAGONAL BARS EACH FACE.

**13 TYP. PENETRATION THRU CONC. SLAB OR WALL** SCALE: NONE

### TENSION DEVELOPMENT AND LAP-SPLICE LENGTHS FOR UNCOATED REINFORCING BARS

BAR SIZE	LAP CLASS	LAP LENGTH (IN.) PER SPACING AND COVER CASE			
		f'c=3500 psi (NORMAL WEIGHT)			
		TOP BARS		OTHER BARS	
#3	A	22	32	17	25
	B	28	42	22	32
#4	A	29	43	22	33
	B	37	56	29	43
#5	A	36	54	28	41
	B	47	70	36	54
#6	A	43	64	33	50
	B	56	84	43	64
#7	A	63	94	48	72
	B	81	122	63	94
#8	A	72	107	55	82
	B	93	139	72	107
#9	A	81	121	62	93
	B	105	157	81	121
#10	A	91	136	70	105
	B	118	177	91	136
#11	A	101	151	78	116
	B	131	196	101	151
#14	N/A	121	181	93	139
#18	N/A	161	241	124	186

### TENSION DEVELOPMENT AND LAP-SPLICE LENGTHS FOR UNCOATED REINFORCING BARS

BAR SIZE	LAP CLASS	LENGTHS (IN.) PER CONCRETE STRENGTH			
		f'c=4000 psi (NORMAL WEIGHT)			
		TOP BARS		OTHER BARS	
#3	A	19	28	15	22
	B	24	36	19	28
#4	A	25	37	19	29
	B	32	48	25	37
#5	A	31	47	24	36
	B	40	60	31	47
#6	A	37	56	29	43
	B	48	72	37	56
#7	A	54	81	42	63
	B	70	106	54	81
#8	A	62	93	48	71
	B	80	121	62	93
#9	A	70	105	54	81
	B	91	136	70	105
#10	A	79	118	61	91
	B	102	153	79	118
#11	A	87	131	67	101
	B	113	170	87	131
#14	N/A	105	157	81	121
#18	N/A	139	209	107	161

**14 REINFORCING LAP LENGTHS** SCALE: NONE

**NOTES:** 1 in.=25.4 mm.  
 1. TABULATED VALUES ARE BASED ON GRADE 60 REINFORCING BARS AND NORMAL WEIGHT CONCRETE. LENGTHS ARE IN INCHES.  
 2. TENSION DEVELOPMENT LENGTHS AND TENSION LAP-SPLICE LENGTHS ARE CALCULATED PER ACI 318, SECTIONS 25.4 AND 25.5, RESPECTIVELY. TABULATED VALUES FOR BEAMS OR COLUMNS ARE BASED ON TRANSVERSE REINFORCEMENT AND CONCRETE COVER MEETING MINIMUM CODE REQUIREMENTS.  
 3. CASES 1 AND 2, WHICH DEPEND ON THE TYPE OF STRUCTURAL ELEMENT, CONCRETE COVER, AND CENTER-TO-CENTER SPACING OF THE BARS, ARE DEFINED AS: BEAMS OR COLUMNS: CASE 1-COVER AT LEAST 1.0d, AND CENTER-TO-CENTER SPACING AT LEAST 2.0d, AND CASE 2-COVER LESS THAN 1.0d, OR CENTER-TO-CENTER SPACING LESS THAN 2.0d, ALL OTHERS: CASE 1-COVER AT LEAST 1.0d, AND CENTER-TO-CENTER SPACING AT LEAST 3.0d, CASE 2-COVER LESS THAN 1.0d, OR CENTER-TO-CENTER SPACING LESS THAN 3.0d.  
 4. LAP SPLICE LENGTHS ARE MULTIPLES OF TENSION DEVELOPMENT LENGTHS; CLASS A=1.0d AND CLASS B=1.3d (ACI 318, SECTION 25.5.2).  
 5. ACI 318 DOES NOT ALLOW TENSION LAP SPLICES OF #14 OR #18 BARS. THE TABULATED VALUES FOR THOSE BAR SIZES ARE THE TENSION DEVELOPMENT LENGTHS.  
 6. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 IN. OF CONCRETE CAST BELOW THE BARS.  
 7. FOR LIGHTWEIGHT-AGGREGATE CONCRETE, MULTIPLY THE TABULATED VALUES BY 1.3.