


**MOORE PUBLIC SCHOOLS -
SOUTH LAKE ELEMENTARY SCHOOL
2022 CLASSROOM ADDITION**
Moore Public Schools - Moore, Oklahoma
AGP - Moore, Oklahoma

ADDENDUM NO. 2
June 7, 2022

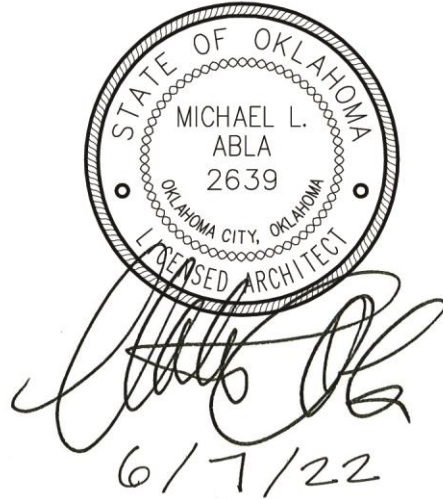

This addendum applicable to work designated herein, shall be understood to be an Addendum, and as such shall be included in the Contract Agreement.

Receipt of this Addendum shall be acknowledged by the Construction Management Firm notifying this office in writing, and by any applicable subcontractor to the CM.

This addendum consists of one (1) page with attachments of one (1) 8.5"x11" page and one (1) 24"x36" sheet.

A. Drawings:

Civil / Structural / Architectural

No changes.

Mechanical, Electrical, and Plumbing

Refer to attachments.

B. Specifications:

No changes.

END OF ADDENDUM NO. 2

ADDENDUM No. 2

Client: Abla Griffin Partnership
Project Name: South Lake Elem Classroom Addition
Project Location: Moore, OK

Issue Date: June 7, 2022

Owner: Moore Public Schools
Engineer: Salas O'Brien

Salas O'Brien Project No. 2021-01376-00

To: Prospective Bidders.

This Addendum forms a part of the Contract Documents and modifies the Bidding Documents dated May 2, 2022, (and any previous Addenda), with amendments and additions noted below. This Addendum consists of (1) pages and (1) attachments.

Index of Attachments
South Lake Elem – Sheet T201

Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may disqualify Bidder.

CHANGES TO BIDDING REQUIREMENTS

A. Drawings:

Technology


1. T201, Add D2 data outlet to north wall of Classroom 1, 2 and 3.
2. T201, Move D2 outlet on east wall of Classroom 1 and 3 further south so it is accessible.
3. T201, Move D2 outlet on west wall of Classroom 3 further south so it is accessible.

END OF ADDENDUM



GENERAL NOTES	
1.	FIRE ALARM: RELOCATE EXISTING FIREPULLS TO NEW EXTERIOR DOORS. CONNECT NEW FIRE ALARM DEVICES TO EXISTING SILENT KNIGHT FIRE ALARM SYSTEM. SUPPLY ALL NAC PANELS, POWER SUPPLIES, ETC. NEEDED TO MAKE A COMPLETE AND CODE COMPLIANT SYSTEM.
2.	SECURITY SYSTEM: CONNECT NEW SECURITY DEVICES TO EXISTING ZONE EXPANDER AND POWER SUPPLY.
3.	INTERCOM: CONNECT NEW INTERCOM DEVICES TO EXISTING TELECOR INTERCOM SYSTEM. INTERCOM WIRE SHALL BE SHIELDED.
4.	CLOCK: CONNECT NEW CLOCK DEVICES TO EXISTING TELECOR CLOCK SYSTEM.
5.	DATA: CONNECT NEW DATA DROPS TO EXISTING IDF.
6.	CAMERA: CONNECT NEW CAMERA DROPS TO EXISTING IDF. EXISTING CAMERA SYSTEM IS AVIGILON. MATCH PER SPECIFICATIONS.
7.	ACCESS CONTROL: CONNECT NEW ACCESS CONTROL DEVICES TO NEW KEYSKAN CONTROLLER. PROVIDE CONTROLLER, READERS, STRIKES, ETC. TO MAKE A COMPLETE AND OPERABLE SYSTEM.
8.	AIPHONE: PROVIDE AND INSTALL AN IX SERIES AIPHONE SYSTEM. DOOR STATION: IX-EA. MASTER STATION: IX-IV7-HB.

KEYED NOTES	
①	RELOCATE EXISTING FIRE PULL.
②	RELOCATING EXISTING PAGING HORN
③	REMOVE EXISTING CAMERA AND RETURN TO MPS TECHNOLOGY. JACK PHILLIP, 405-473-5225

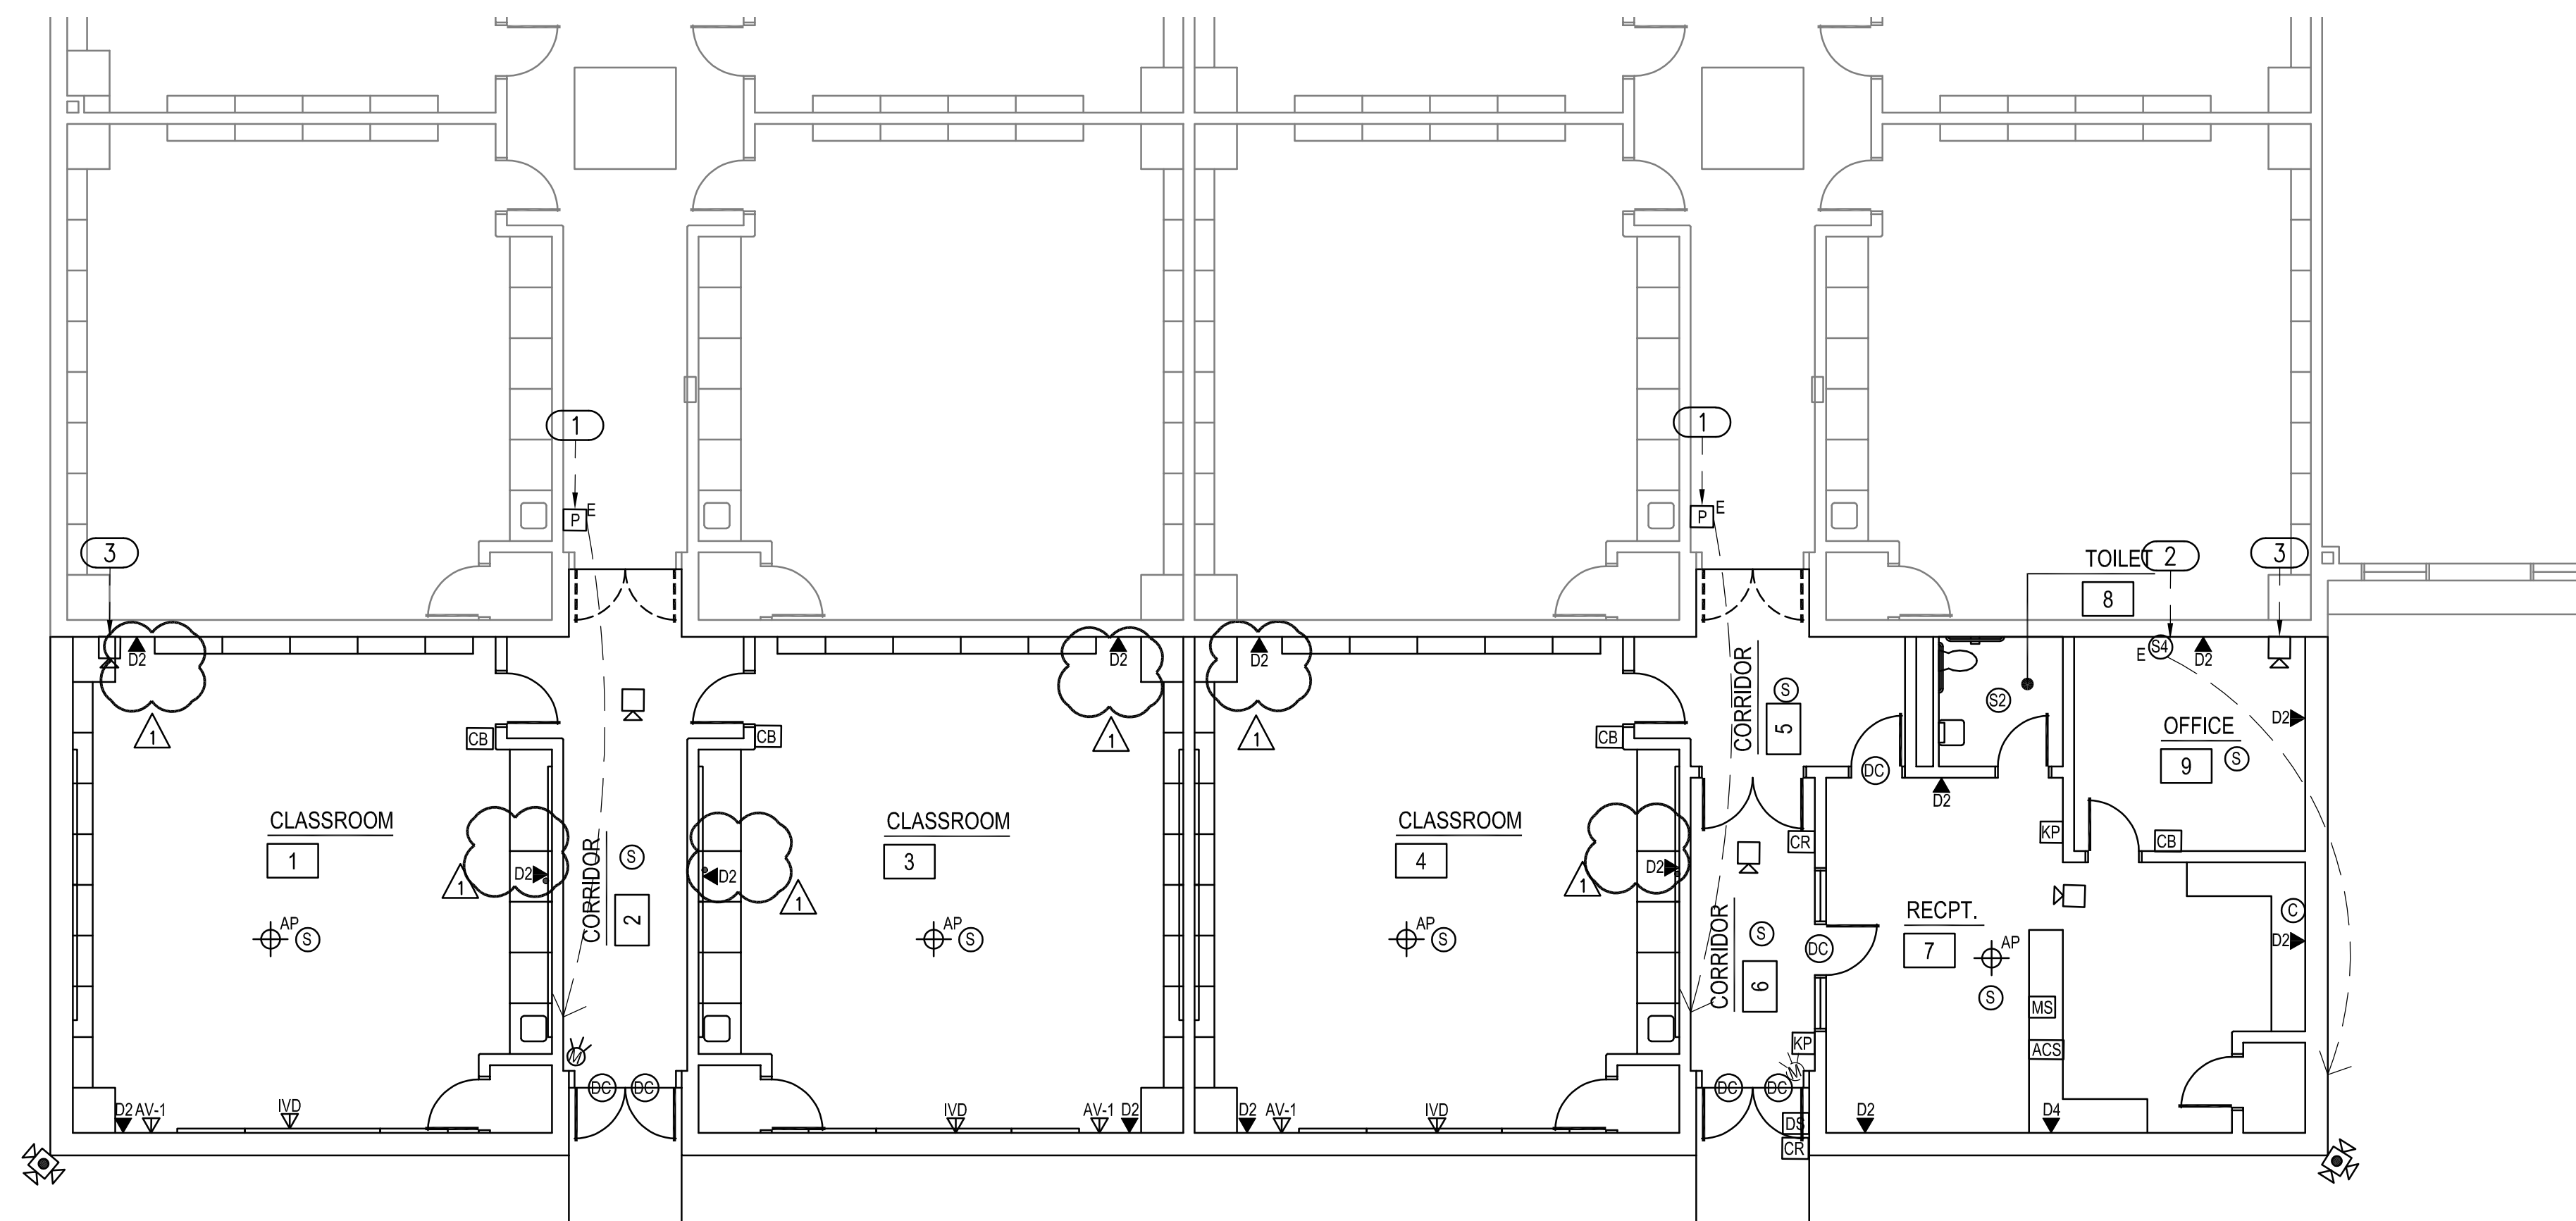

NY	drawn by
NY	checked by
APRIL 2022	date
6/07/22 AD02	revisions

MOORE PUBLIC SCHOOLS
BOARD OF EDUCATION
MOORE, OKLAHOMA



NEW CLASSROOM
ADDITION -
SOUTH LAKE
ELEMENTARY SCHOOL

sheet no:

T201

