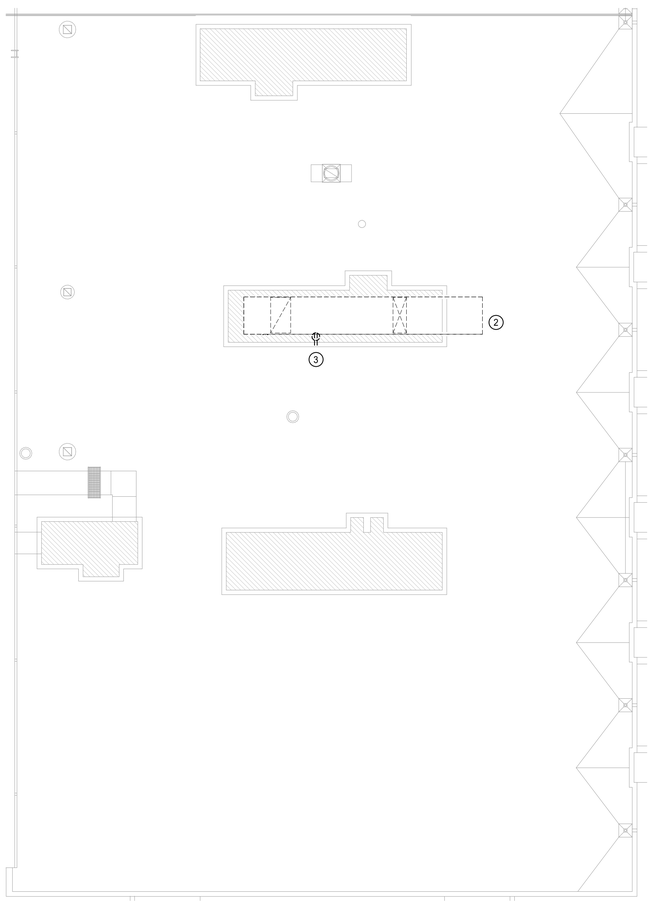

N

2 ELECTRICAL DEMOLITION ROOF PLAN - AHU-H1

Scale: 1/16" = 1'-0"

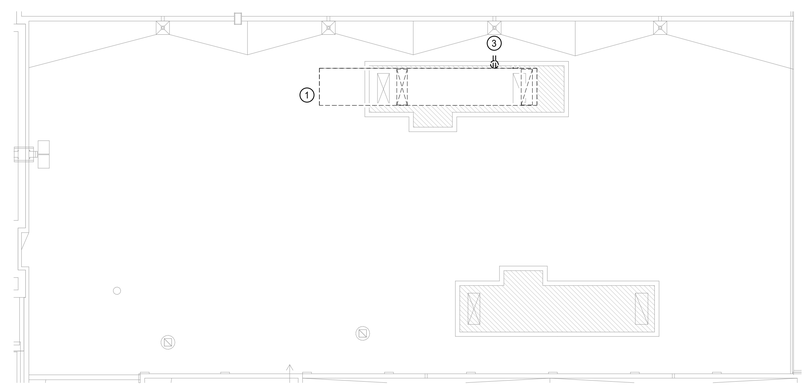

N

1 ELECTRICAL DEMOLITION ROOF PLAN - AHU-G1

Scale: 1/16" = 1'-0"

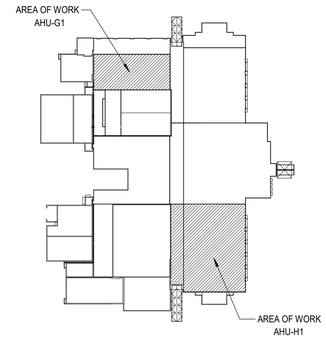

N

KEY PLAN

Scale: 1" = 160'-0"

DEMOLITION GENERAL NOTES

1. THESE DEMOLITION PLANS HAVE BEEN PREPARED TO ASSIST THE CONTRACTOR IN DETERMINING THE SCOPE OF DEMOLITION WORK TO BE INCLUDED IN THIS PROJECT. THE CONTRACTOR SHOULD REVIEW ALL DRAWINGS AND SPECIFICATIONS, INCLUDING DEMOLITION SHOWN FOR OTHER TRADES, AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS, IN ORDER TO DETERMINE THE SCOPE OF DEMOLITION WORK.
2. DEMOLITION PLAN INFORMATION SHOWN AT TIME OF DESIGN. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ANY NECESSARY CHANGES TO COMPLETE THE WORK.
3. REMOVE ALL UNUSED WIRING AND CONDUIT AS PART OF THE DEMOLITION PROCESS.

ELECTRICAL KEYED NOTES

1	EXISTING AIR HANDLER 'AHU G1' TO BE DEMOLISHED AND REPLACED BY MC. RETAIN CONDUIT AND WIRING FOR CONNECTION TO NEW UNIT. REFER TO SHEET 'E201' FOR MORE INFORMATION.
2	EXISTING AIR HANDLER 'AHU H1' TO BE DEMOLISHED AND REPLACED BY MC. RETAIN CONDUIT AND WIRING FOR CONNECTION TO NEW UNIT. REFER TO SHEET 'E201' FOR MORE INFORMATION.
3	DEMO EXISTING RECEPTACLE AND ITS ASSOCIATED CONDUIT AND WIRING BACK TO NEAREST J-BOX. NEW AHU TO HAVE FACTORY-MOUNTED RECEPTACLE POWERED FROM UNIT.

AGP
the Abla Griffin Partnership L.L.C.

313 S. E. 5th Street
MOORE, OK. 73160
405.735.3477
AGP@theAGP.net
www.theAGP.net

CEDAR CREEK
CIVIL

KFC ENGINEERING
STRUCTURAL

SALAS O'BRIEN
MECHANICAL / ELECTRICAL

DWG
drawn by

TVO
checked by

MARCH 2026
date

REVISIONS

Δ	DESCRIPTION	DATE

MOORE PUBLIC SCHOOLS

SOUTHMOORE HIGH SCHOOL HVAC REPLACEMENT

sheet no:

ED201

Salas O'Brien

Salas O'Brien, Inc. - Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA#: 9820 Expiration Date: 06/30/2027

Salas O'Brien Project Number: 2550-02191-00

OWNERSHIP USE OF DOCUMENTS:

AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.