



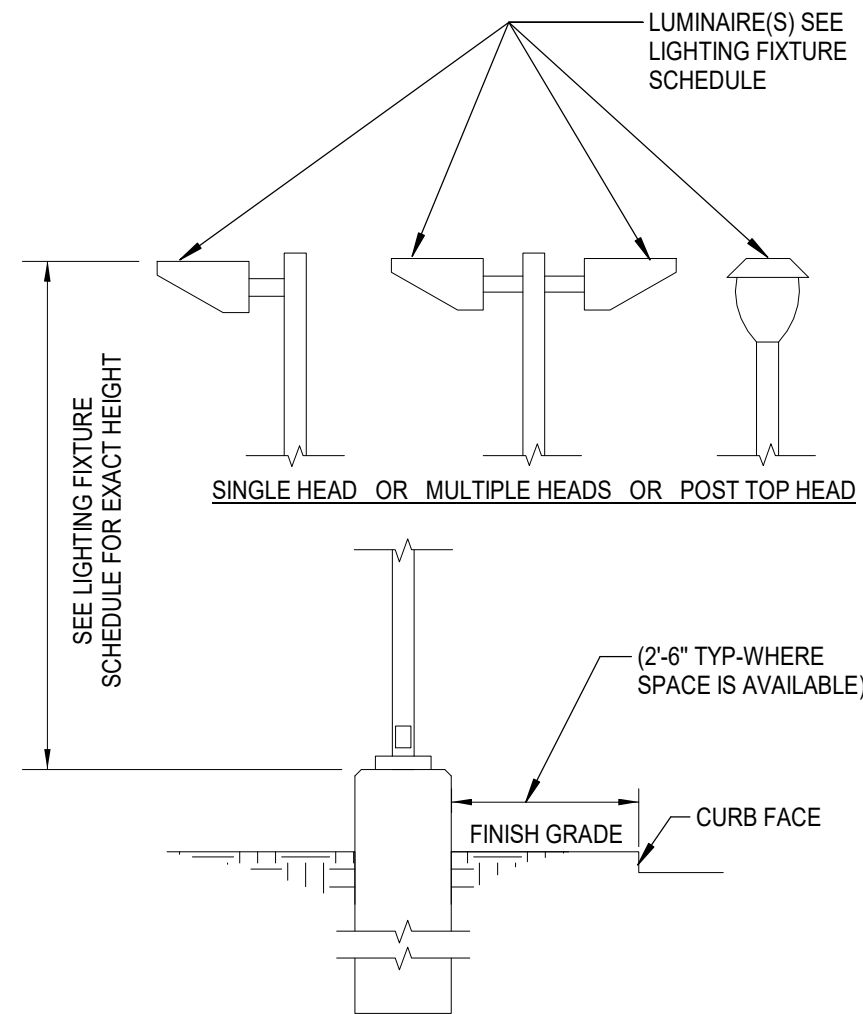


LIGHT POLE - OVERALL

- NOTES:
1. PROVIDE CROWN ON TOP OF CONCRETE BASE TO COMPLETELY SHED WATER. IF WATERSHED IS NOT PROVIDED, THEN GROUTING WITH NON-SHRINK GROUT IS REQUIRED. GROUT UNDER BASE PLATE.
 2. PROVIDE A MINIMUM OF 5/8"x10'-0" LONG COPPER GROUND ROD FOR EACH LIGHTING STANDARD WHERE REQUIRED BY APPLICABLE CODES.
 3. CONTRACTOR TO FIELD VERIFY ALL POLE LOCATIONS MAINTAIN 20' OVERHEAD CLEARANCE MINIMUM. COORDINATE ANY OBSTRUCTIONS WITHIN THIS RADIUS WITH THE ARCHITECT AND ENGINEER PRIOR TO BEGINNING WORK.

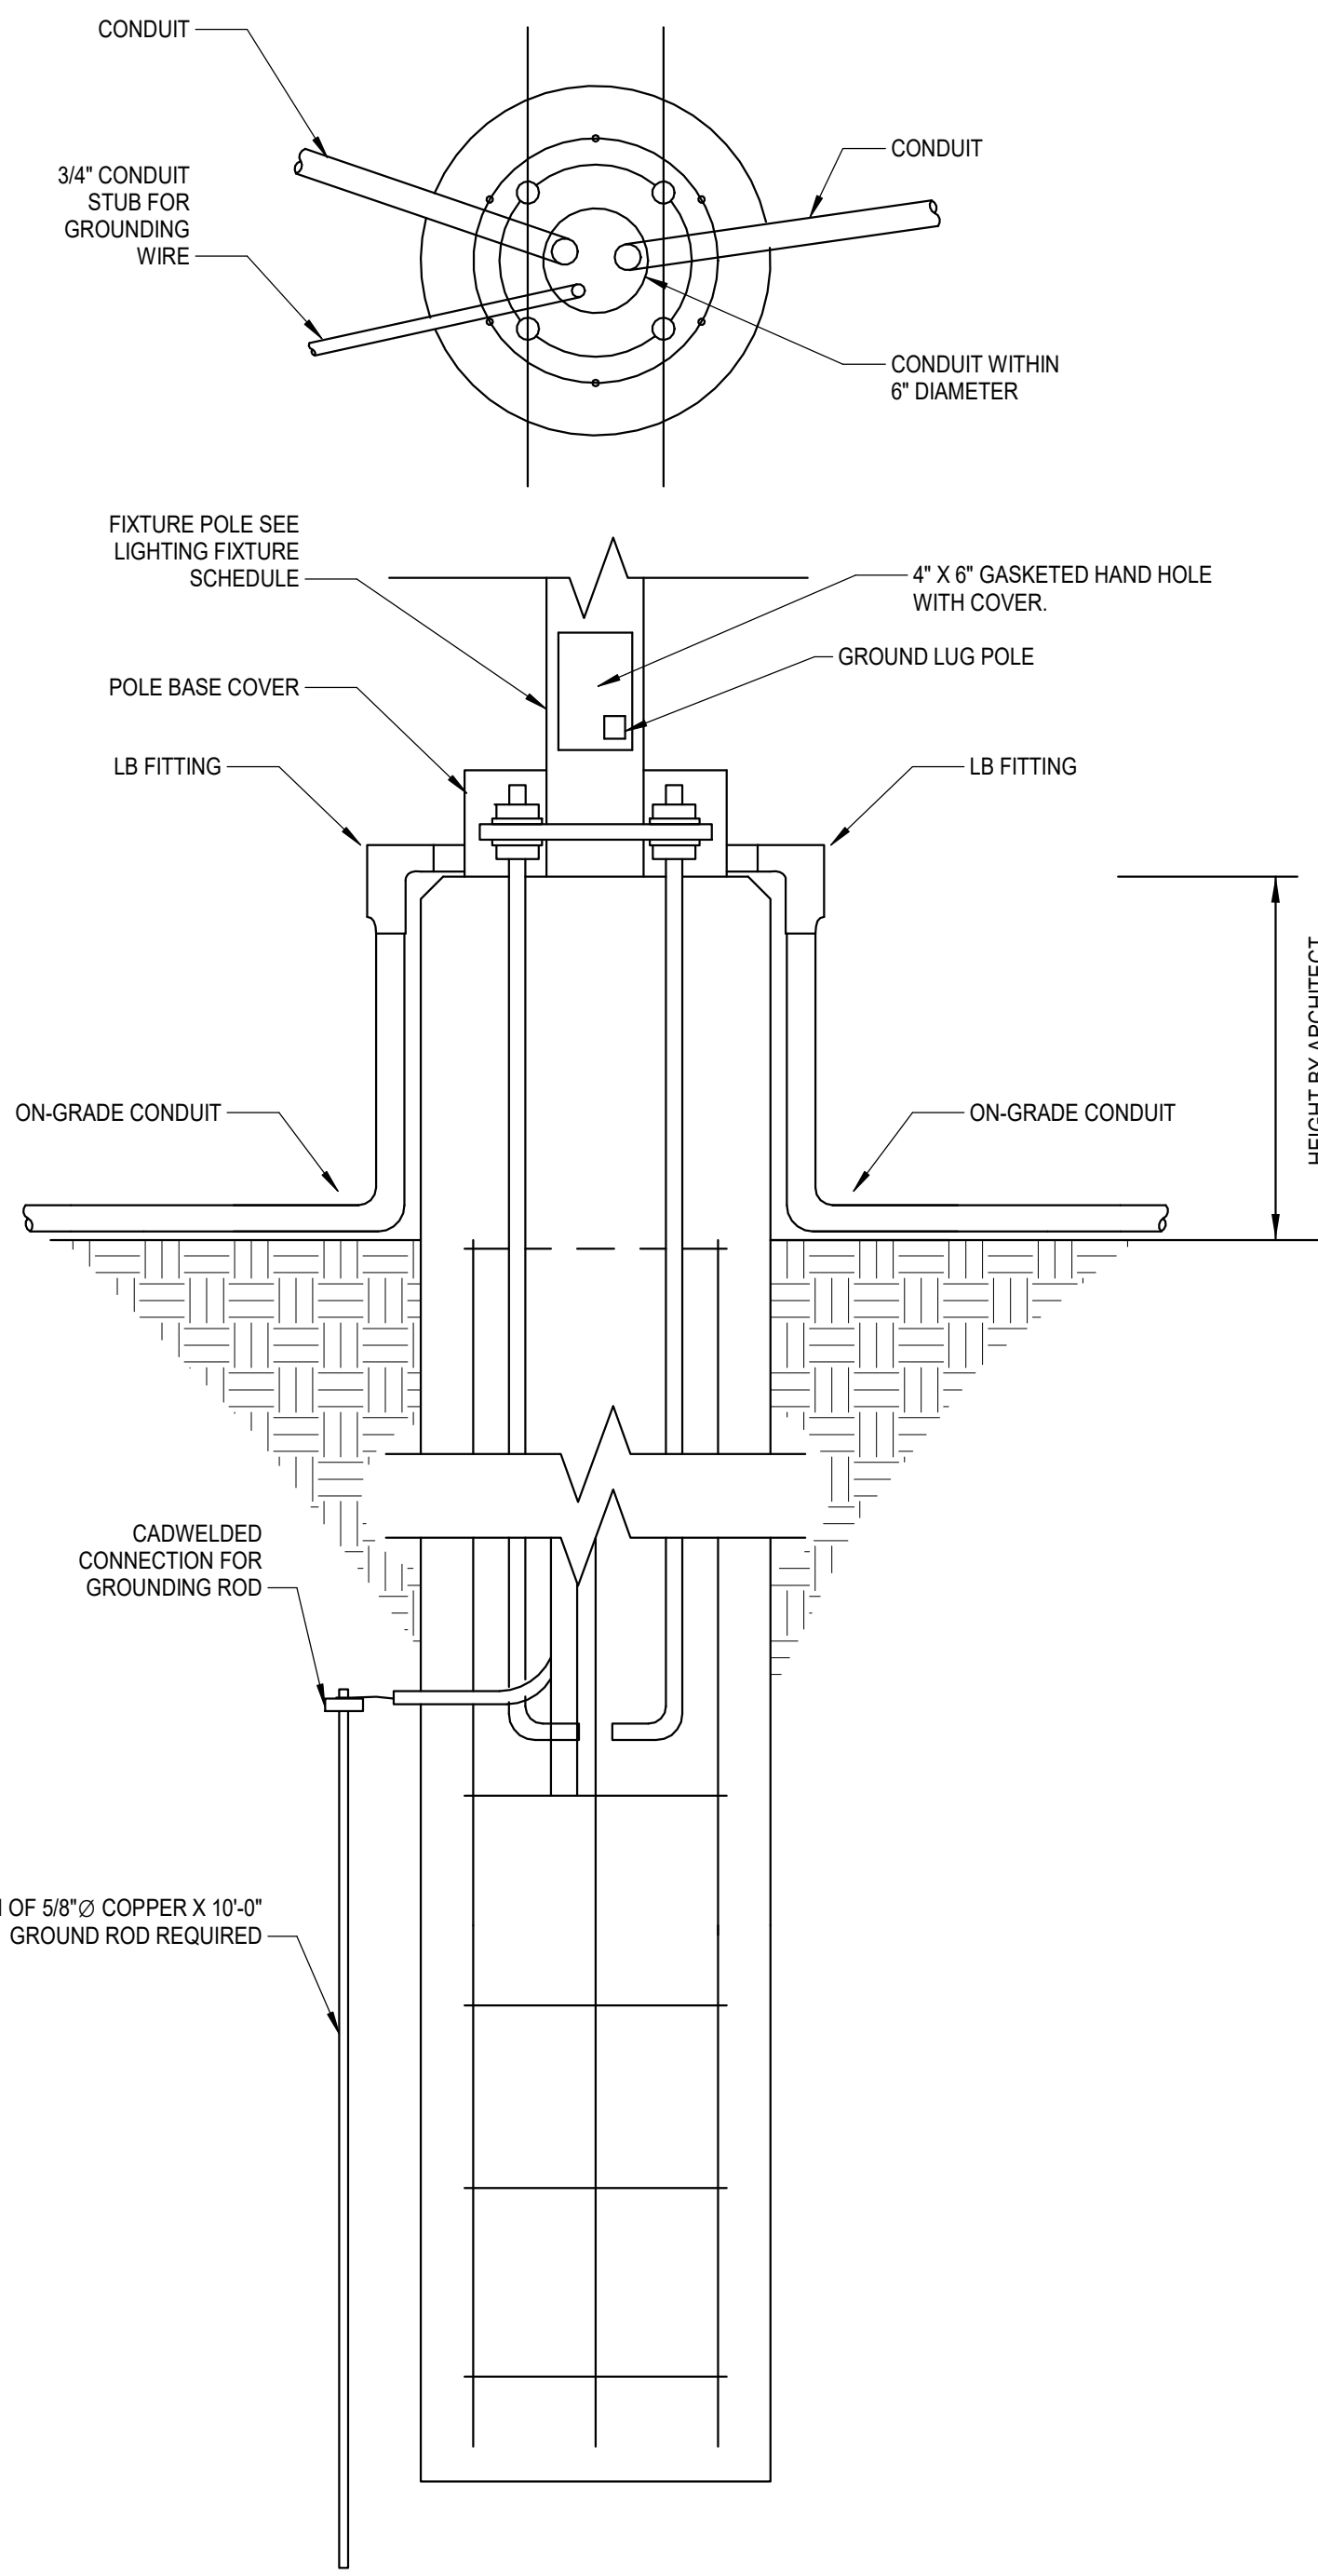


ENLARGED ELECTRICAL

2 TYP. POLE BASE - ON-GRADE CONDUIT
Scale: N.T.S.

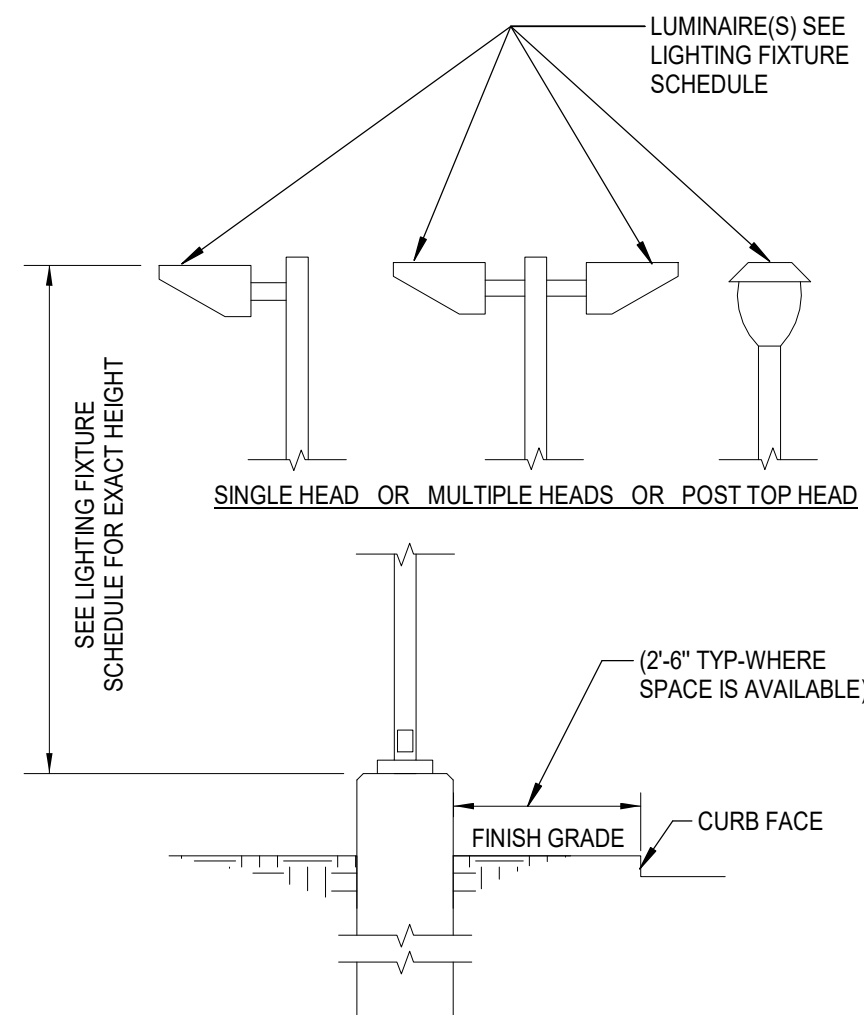


LIGHT POLE - OVERALL

- NOTES:
1. PROVIDE CROWN ON TOP OF CONCRETE BASE TO COMPLETELY SHED WATER. IF WATERSHED IS NOT PROVIDED, THEN GROUTING WITH NON-SHRINK GROUT IS REQUIRED. GROUT UNDER BASE PLATE.
 2. PROVIDE A MINIMUM OF 5/8"x10'-0" LONG COPPER GROUND ROD FOR EACH LIGHTING STANDARD WHERE REQUIRED BY APPLICABLE CODES.
 3. CONTRACTOR TO FIELD VERIFY ALL POLE LOCATIONS MAINTAIN 20' OVERHEAD CLEARANCE MINIMUM. COORDINATE ANY OBSTRUCTIONS WITHIN THIS RADIUS WITH THE ARCHITECT AND ENGINEER PRIOR TO BEGINNING WORK.

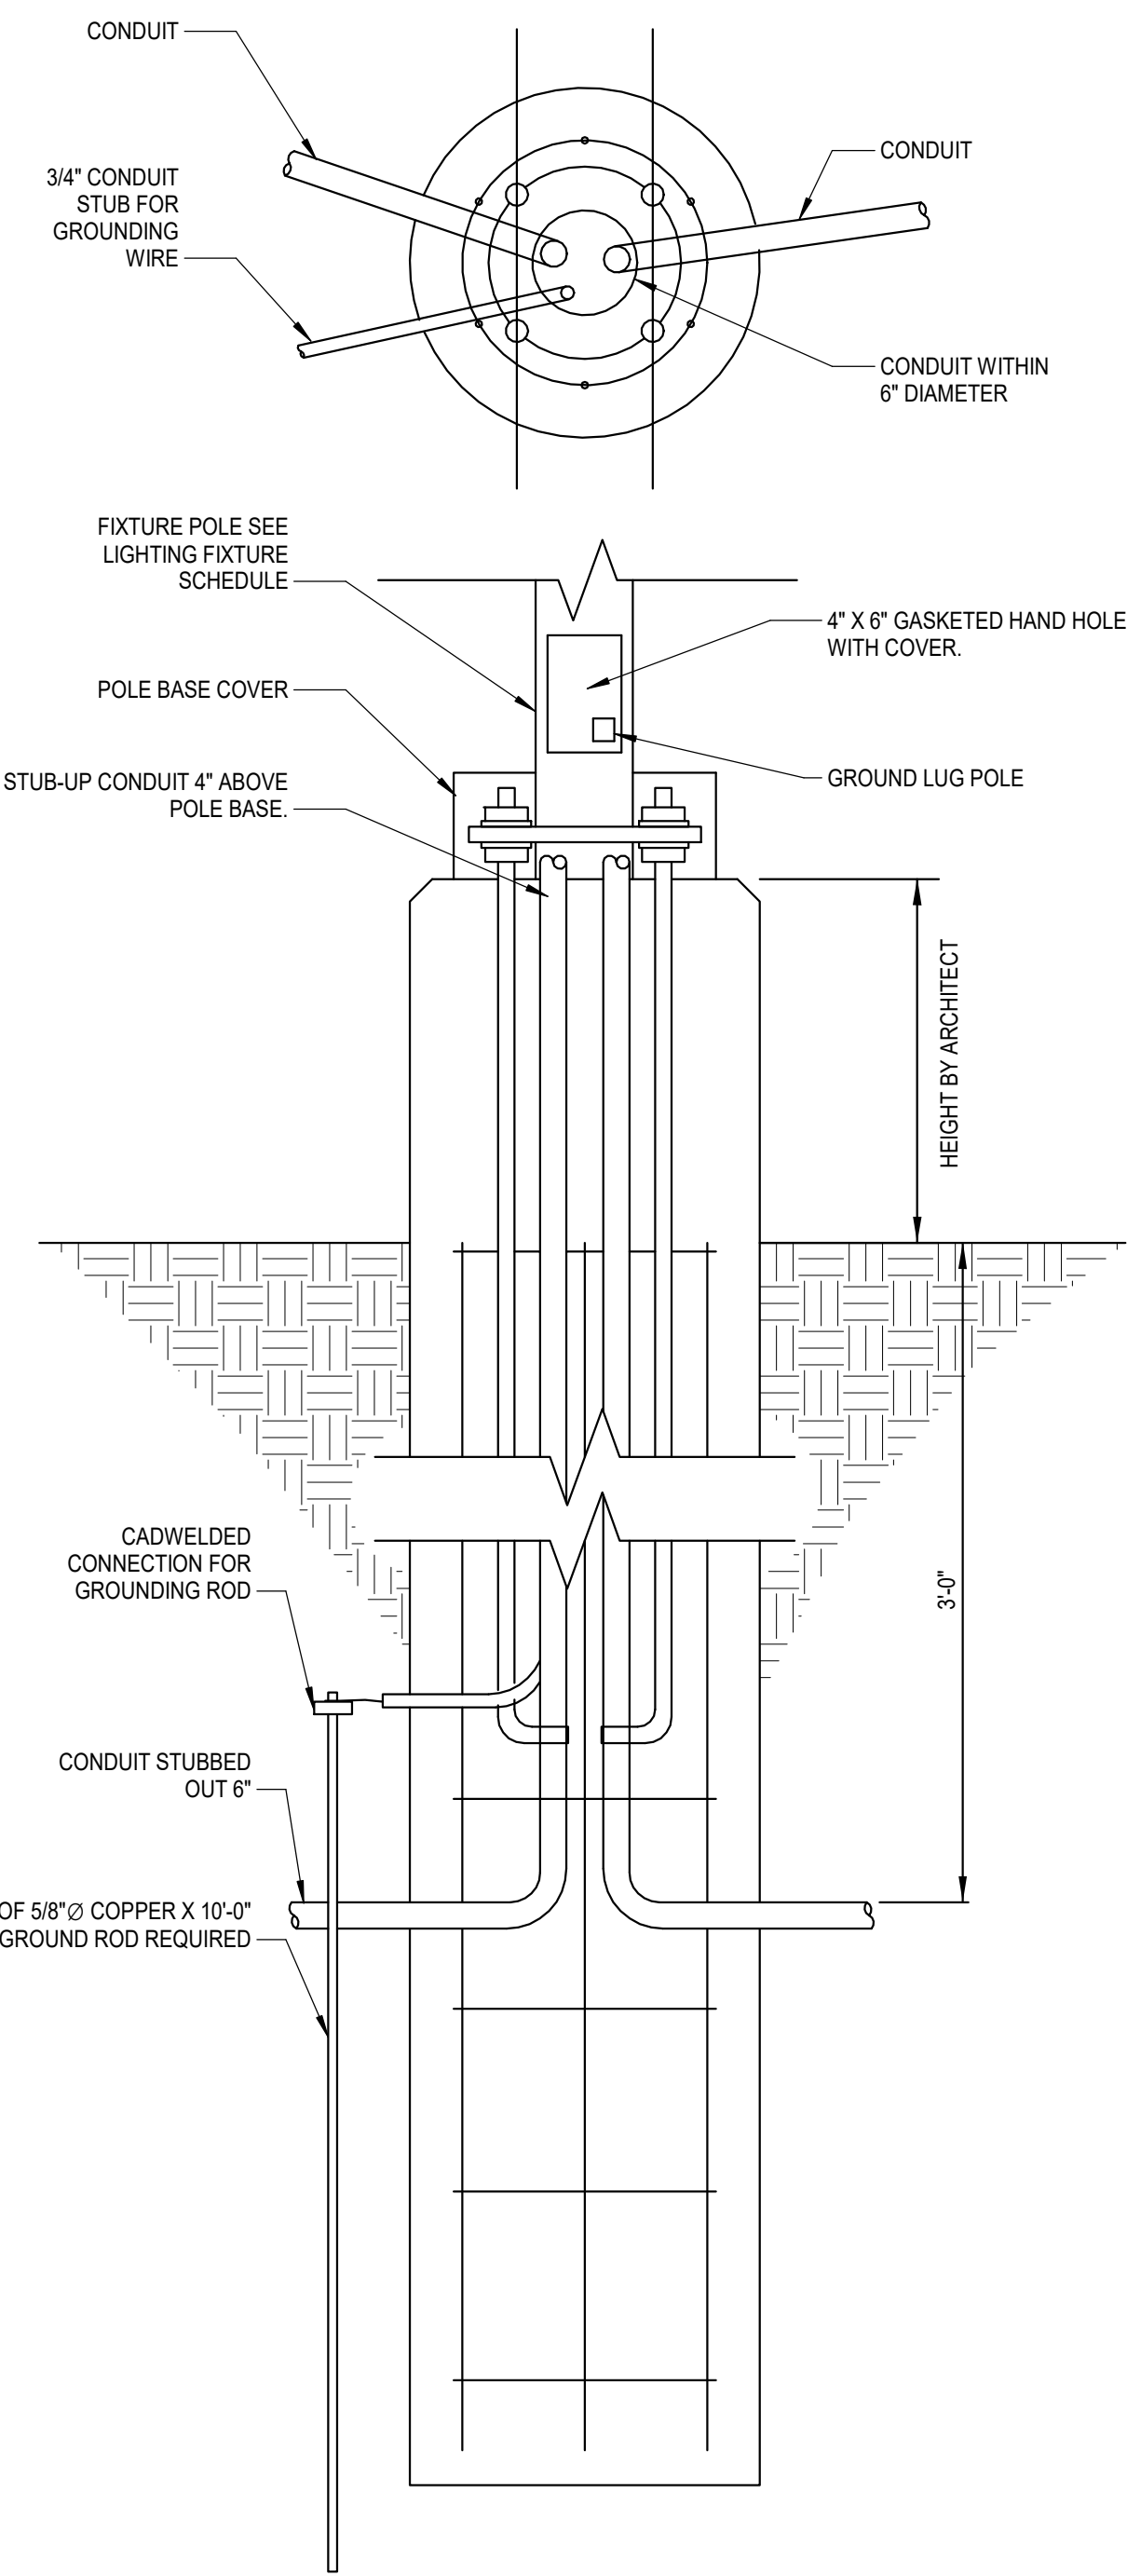

ENLARGED ELECTRICAL

1 TYP. POLE BASE
Scale: N.T.S.

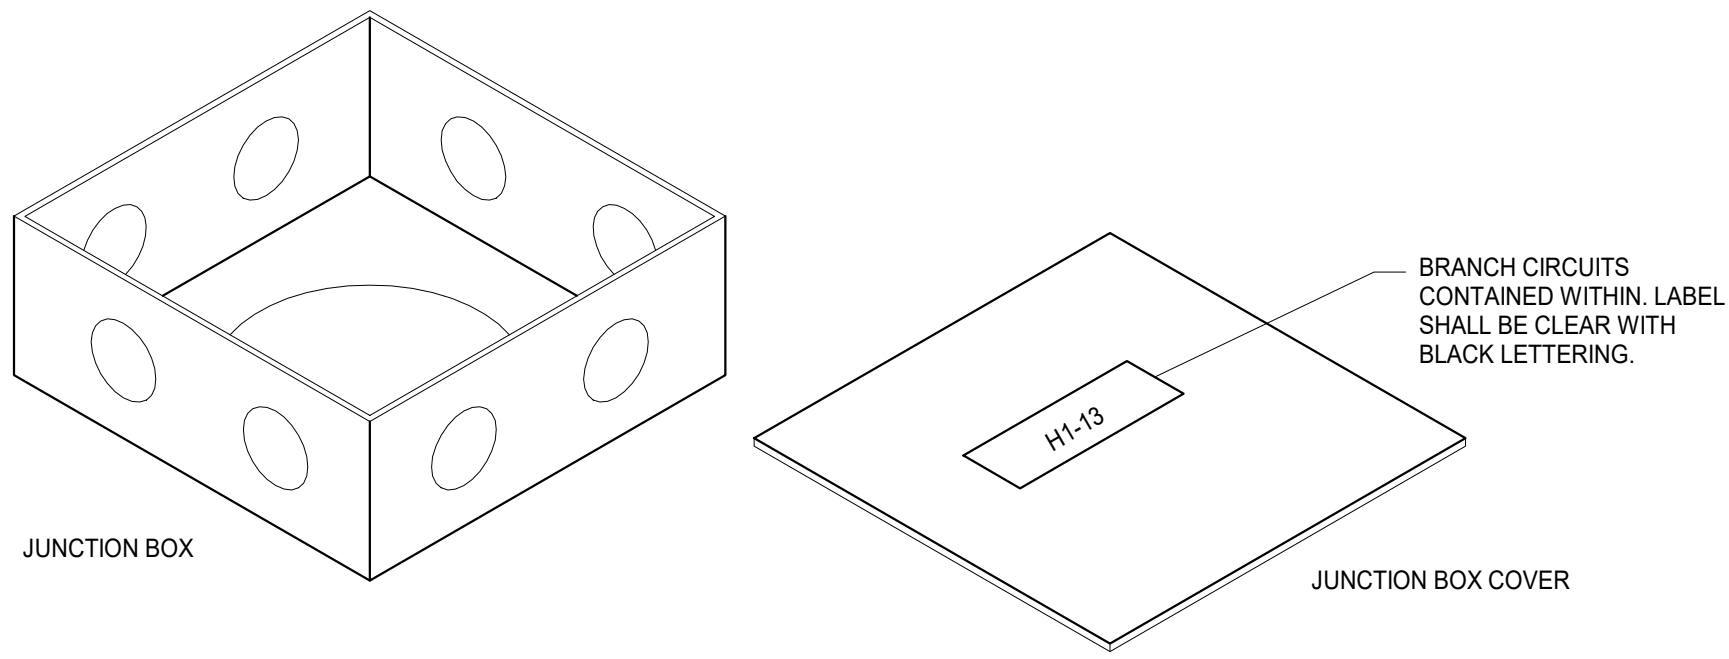

3 TYP. JUNCTION BOX DETAIL
Scale: N.T.S.



JM
drawn by

TVO
checked by

MAY 2026
date

REVISIONS		
Δ	DESCRIPTION	DATE



SOUTHMOORE
HIGH SCHOOL
2026 ATHLETIC PLAZA
UPGRADES

sheet no:

E501