


**MOORE PUBLIC SCHOOLS -
WAYLAND BONDS ELEMENTARY SCHOOL
2025 HVAC UPGRADES**

Moore Public Schools - Moore, Oklahoma
AGP - Moore, Oklahoma

ADDENDUM NO. 3

March 2, 2026

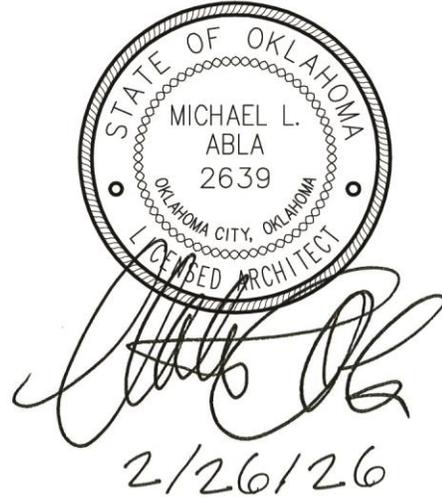

This addendum applicable to work designated herein, shall be understood to be an Addendum, and as such shall be included in the Contract Agreement.

Receipt of this Addendum shall be acknowledged by the Construction Management Firm notifying this office in writing, and by any applicable subcontractor to the CM.

This addendum consists of one (1) page with attachments of one (1) 8.5"x11" pages and two (2) 24"x36" sheets.

A. Drawings:

General, Civil, Structural, and Architectural

No changes.

Mechanical, Electrical, and Plumbing

Refer to attachments.

B. Specifications:

No changes.

END OF ADDENDUM NO. 3

ADDENDUM 03

Issue Date: March 2, 2026

Project Information

Client: Abla Griffin Partnership
Project Name: Wayland Bonds Elem – HVAC
Project Location: OKC, OK
Owner: Moore Public Schools
Engineer: Salas O'Brien, LLC

Project No. 2550-01871-00



To Prospective Bidders

- ▲ This Addendum forms a part of the Contract Documents and modifies the Bidding Documents dated January 28, 2026, (and previous Addenda), with amendments and additions noted below.
- ▲ This Addendum consists of (1) pages and (2) attachments.
 - Index of Attachments
 - ED202
 - E202
- ▲ Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may disqualify Bidder.

CHANGES TO THE DRAWINGS

Revisions have been made to the following drawings and are issued in the form of full-size plans. Edits are indicated by a revision delta and a cloud surrounding the affected portion of the drawing.

- ▲ ED202 – ELECTRICAL DEMOLITION POWER PLAN - WEST
 - Refer to clouds and deltas for changes on plan.
- ▲ E202 – ELECTRICAL POWER PLAN - WEST
 - Refer to clouds and deltas for changes on plan.

END OF ADDENDUM [03]





DEMOLITION GENERAL NOTES

1. THESE DEMOLITION PLANS HAVE BEEN PREPARED TO ASSIST THE CONTRACTOR IN DETERMINING THE SCOPE OF DEMOLITION WORK TO BE INCLUDED IN THIS PROJECT. THE CONTRACTOR SHOULD REVIEW ALL DRAWINGS AND SPECIFICATIONS, INCLUDING DEMOLITION SHOWN FOR OTHER TRADES, AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS, IN ORDER TO DETERMINE THE SCOPE OF DEMOLITION WORK.
2. EXISTING CONDUIT AND WIRING MAYBE REUSED IF IN SERVICEABLE CONDITION. OTHERWISE PROVIDE NEW CONDUIT AND WIRE AS REQUIRED. NEW DEVICES AND FIXTURES SHALL BE CIRCUITED TO NEW PANELS AS INDICATED. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT ANY ANOMALIES TO THE ARCHITECT AND ENGINEER PRIOR TO PROCEEDING.
3. DEMOLITION PLAN INFORMATION SHOWN AT TIME OF DESIGN. EC SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ANY NECESSARY CHANGES TO COMPLETE THE WORK.
4. REMOVE ALL UNUSED WIRING AND CONDUIT AS PART OF THE DEMOLITION PROCESS.

ELECTRICAL KEYED NOTES

1. EXISTING WATER SOURCE HEAT PUMP TO BE DEMOLISHED AND REPLACED WITH NEW. RETAIN CONDUIT/WIRING FOR CONNECTION TO NEW UNIT. REFER TO SHEET 'E202' FOR ADDITIONAL INFORMATION.
2. EXISTING WATER SOURCE HEAT PUMP TO REMAIN. REFER TO SHEET 'E202' FOR ADDITIONAL INFORMATION.

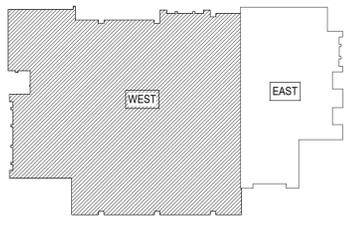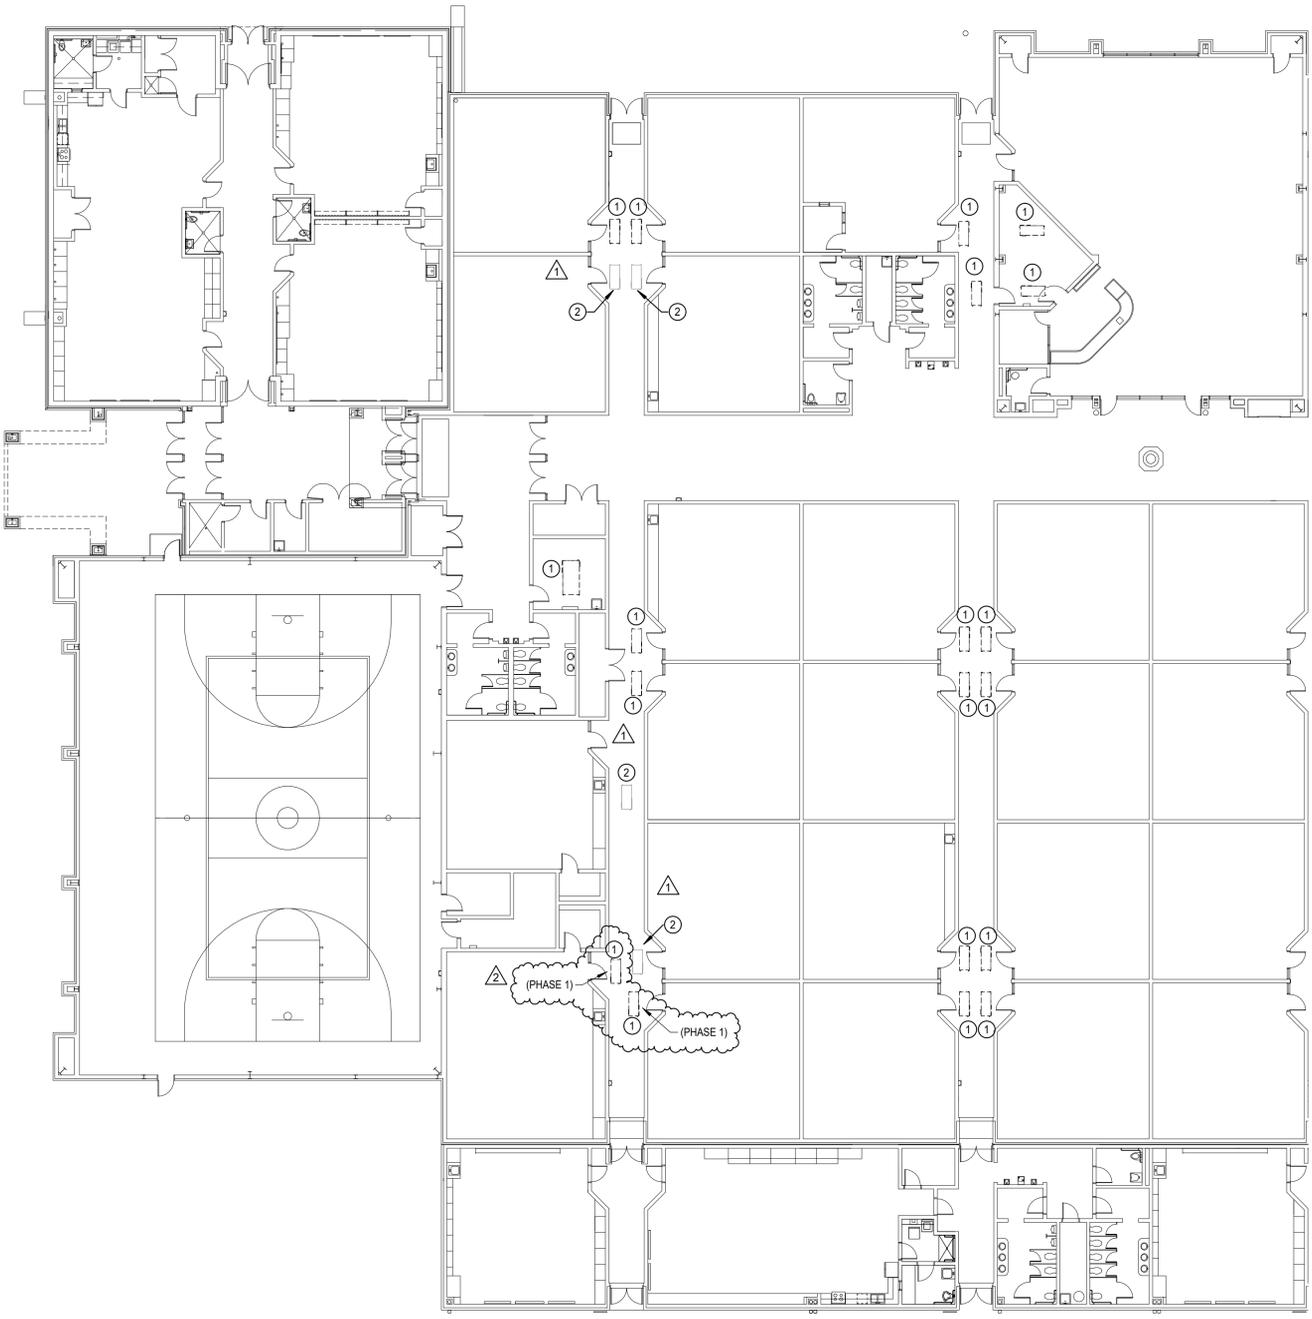

KEY PLAN

1 ELECTRICAL DEMOLITION POWER PLAN - WEST
Scale: 1/16" = 1'-0"

DWG
drawn by
TVO
checked by
JANUARY 2026
date

REVISIONS

Δ	DESCRIPTION	DATE
1	ADD 01	02/24/2026
2	ADD 03	03/02/2026



WAYLAND BONDS
2025 HVAC

sheet no:
ED202

Salas O'Brien
Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA#: 7058 Expiration Date: 06/30/2027
Salas O'Brien Project Number: 2550-01872-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS COPYRIGHT AND OTHER PROPERTY RIGHTS OF ALL PLANS AND DRAWINGS DESIGNED AND/OR PRODUCED. PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED IN ANY FORM OR MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT OF AGP.



DWG
drawn by
TVO
checked by
JANUARY 2026
date

REVISIONS

Δ	DESCRIPTION	DATE
1	ADD 01	02/24/2026
2	ADD 03	03/02/2026



WAYLAND BONDS
2025 HVAC

sheet no:

E202



OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

GENERAL NOTES

- COORDINATE EXACT LOCATIONS OF DEVICES SHOWN WITH OTHER EQUIPMENT. COORDINATE EXACT LOCATION OF CEILING MOUNTED DEVICES WITH LIGHTS, HVAC EQUIPMENT, AND OTHER DEVICES.
- COORDINATE WITH MECHANICAL CONTRACTOR AND PROVIDE ALL RELAYS, CONNECTIONS, AND ALL DEVICES NECESSARY TO INTERLOCK EXHAUST FANS, DAMPERS, ETC WITH PROPER CONTROL DEVICES.
- COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR. REFER TO MECHANICAL PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
- COORDINATE EXACT LOCATION OF PLUMBING EQUIPMENT WITH PLUMBING CONTRACTOR. REFER TO PLUMBING PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
- COORDINATE THE EXACT REQUIREMENTS OF ALL POWER CONNECTION FIXTURES AND DEVICES WITH THE ARCHITECT, OWNER AND MANUFACTURER PRIOR TO ROUGH-IN.
- ALL RECEPTACLES LOCATED AT COUNTERTOP HEIGHT SHALL BE ORIENTED HORIZONTALLY.
- FIRE STOP ALL PENETRATIONS IN FIRE AND SMOKE RATED WALLS. REFER TO ARCHITECTURAL PLANS FOR LOCATIONS AND ADDITIONAL INFORMATION

ELECTRICAL KEYED NOTES

- CONNECT NEW WATER SOURCE HEAT PUMP TO THE REPLACEMENT ELECTRICAL PANEL 'HP'. PROVIDE NEW BREAKER, CONDUIT, AND WIRING AS REQUIRED TO FEED NEW UNIT. EXISTING CONDUIT AND WIRING RETAINED FROM DEMO MAY BE REUSED WHERE IN SERVICEABLE CONDITION AND SIZED APPROPRIATELY FOR NEW UNIT CONNECTION. REFER TO SHEET 'E801' FOR MORE INFORMATION.
- EC TO RECONNECT EXISTING WATER SOURCE HEAT PUMP TO REPLACEMENT ELECTRICAL PANEL 'HP'. PROVIDE BREAKER AS INDICATED ON SHEET 'E602'.

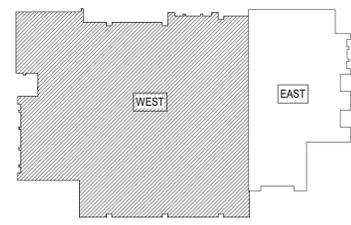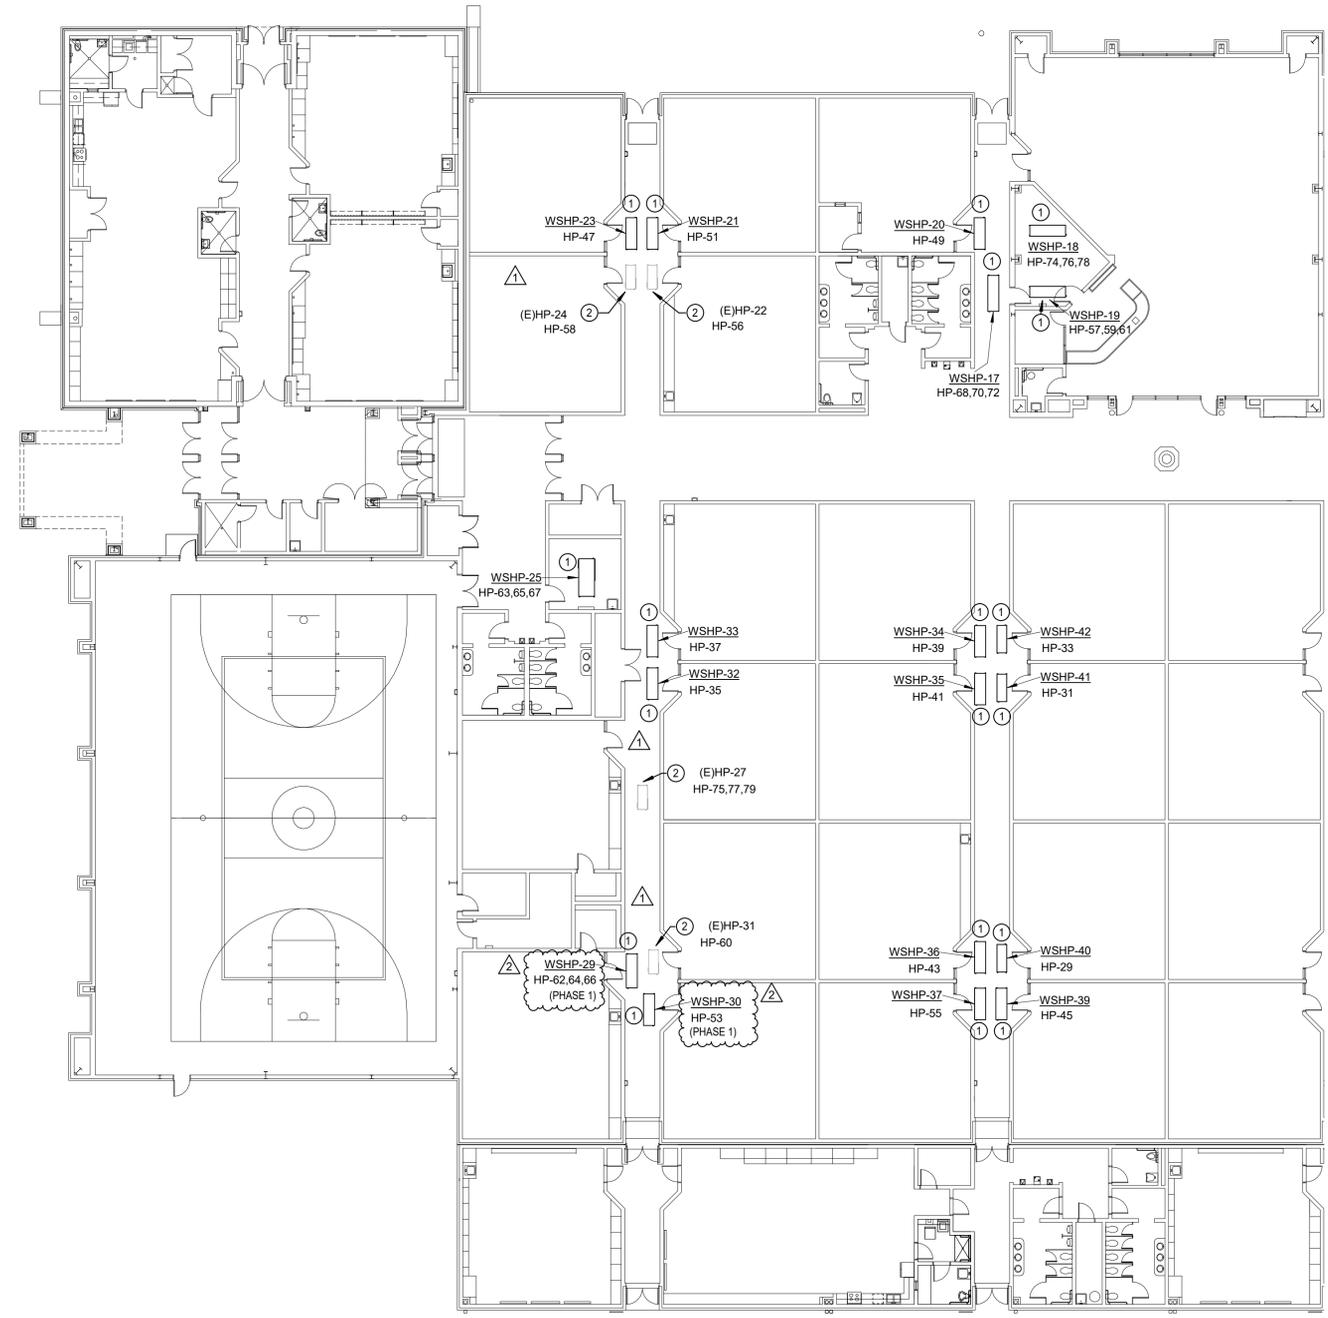

KEY PLAN

1 ELECTRICAL POWER PLAN - WEST

Scale: 1/16" = 1'-0"

Salas O'Brien
Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA#: 7058 Expiration Date: 06/30/2027
Salas O'Brien Project Number: 2550-01872-00