





- ### GENERAL NOTES
- COORDINATE EXACT LOCATIONS OF DEVICES SHOWN WITH OTHER EQUIPMENT. COORDINATE EXACT LOCATION OF CEILING MOUNTED DEVICES WITH LIGHTS, HVAC EQUIPMENT, AND OTHER DEVICES.
 - COORDINATE WITH MECHANICAL CONTRACTOR AND PROVIDE ALL RELAYS, CONNECTIONS, AND ALL DEVICES NECESSARY TO INTERLOCK EXHAUST FANS, DAMPERS, ETC WITH PROPER CONTROL DEVICES.
 - COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR. REFER TO MECHANICAL PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
 - COORDINATE EXACT LOCATION OF PLUMBING EQUIPMENT WITH PLUMBING CONTRACTOR. REFER TO PLUMBING PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
 - COORDINATE THE EXACT REQUIREMENTS OF ALL POWER CONNECTION FIXTURES AND DEVICES WITH THE ARCHITECT, OWNER AND MANUFACTURER PRIOR TO ROUGH-IN.
 - ALL RECEPTACLES LOCATED AT COUNTERTOP HEIGHT SHALL BE ORIENTED HORIZONTALLY.
 - FIRE STOP ALL PENETRATIONS IN FIRE AND SMOKE RATED WALLS. REFER TO ARCHITECTURAL PLANS FOR LOCATIONS AND ADDITIONAL INFORMATION

- ### ELECTRICAL KEYED NOTES
- CONNECT NEW WATER SOURCE HEAT PUMP TO THE REPLACEMENT ELECTRICAL PANEL 'HP'. PROVIDE NEW BREAKER, CONDUIT, AND WIRING AS REQUIRED TO FEED NEW UNIT. EXISTING CONDUIT AND WIRING RETAINED FROM DEMO MAY BE REUSED WHERE IN SERVICEABLE CONDITION AND SIZED APPROPRIATELY FOR NEW UNIT CONNECTION. ALL REUSED MATERIALS SHALL BE WARRANTED AS IF NEW. REFER TO SHEET 'E601' FOR MORE INFORMATION.
 - CONNECT NEW WATER SOURCE HEAT PUMP TO THE REPLACEMENT ELECTRICAL PANEL 'HP'. PROVIDE NEW BREAKER, CONDUIT, AND WIRING AS REQUIRED TO FEED NEW UNIT. REFER TO SHEET 'E601' FOR MORE INFORMATION.
 - PROVIDE MULTIPLE ELECTRICAL CONNECTIONS FOR COOLING TOWER AS INDICATED. INCOMPLETE CONNECTION INFORMATION PROVIDED FROM THE EQUIPMENT MANUFACTURER AT THE TIME OF DESIGN. COORDINATE EXACT CONNECTION REQUIREMENTS WITH MANUFACTURER AND MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. ADJUST CONNECTION QUANTITIES AND RATINGS AS NECESSARY. COORDINATE ANY CHANGES WITH THE ENGINEER PRIOR TO PROCEEDING.
 - INTERCEPT EXISTING FEED BETWEEN CT CABINET AND MSWB TO ADD NEW EXTERIOR RATED SERVICE DISCONNECT. EXISTING CONDUIT AND WIRING MAY BE REUSED WHERE IN SERVICEABLE CONDITION AND RATED APPROPRIATELY. OTHERWISE, PROVIDE NEW CONDUIT AND WIRING AS INDICATED.

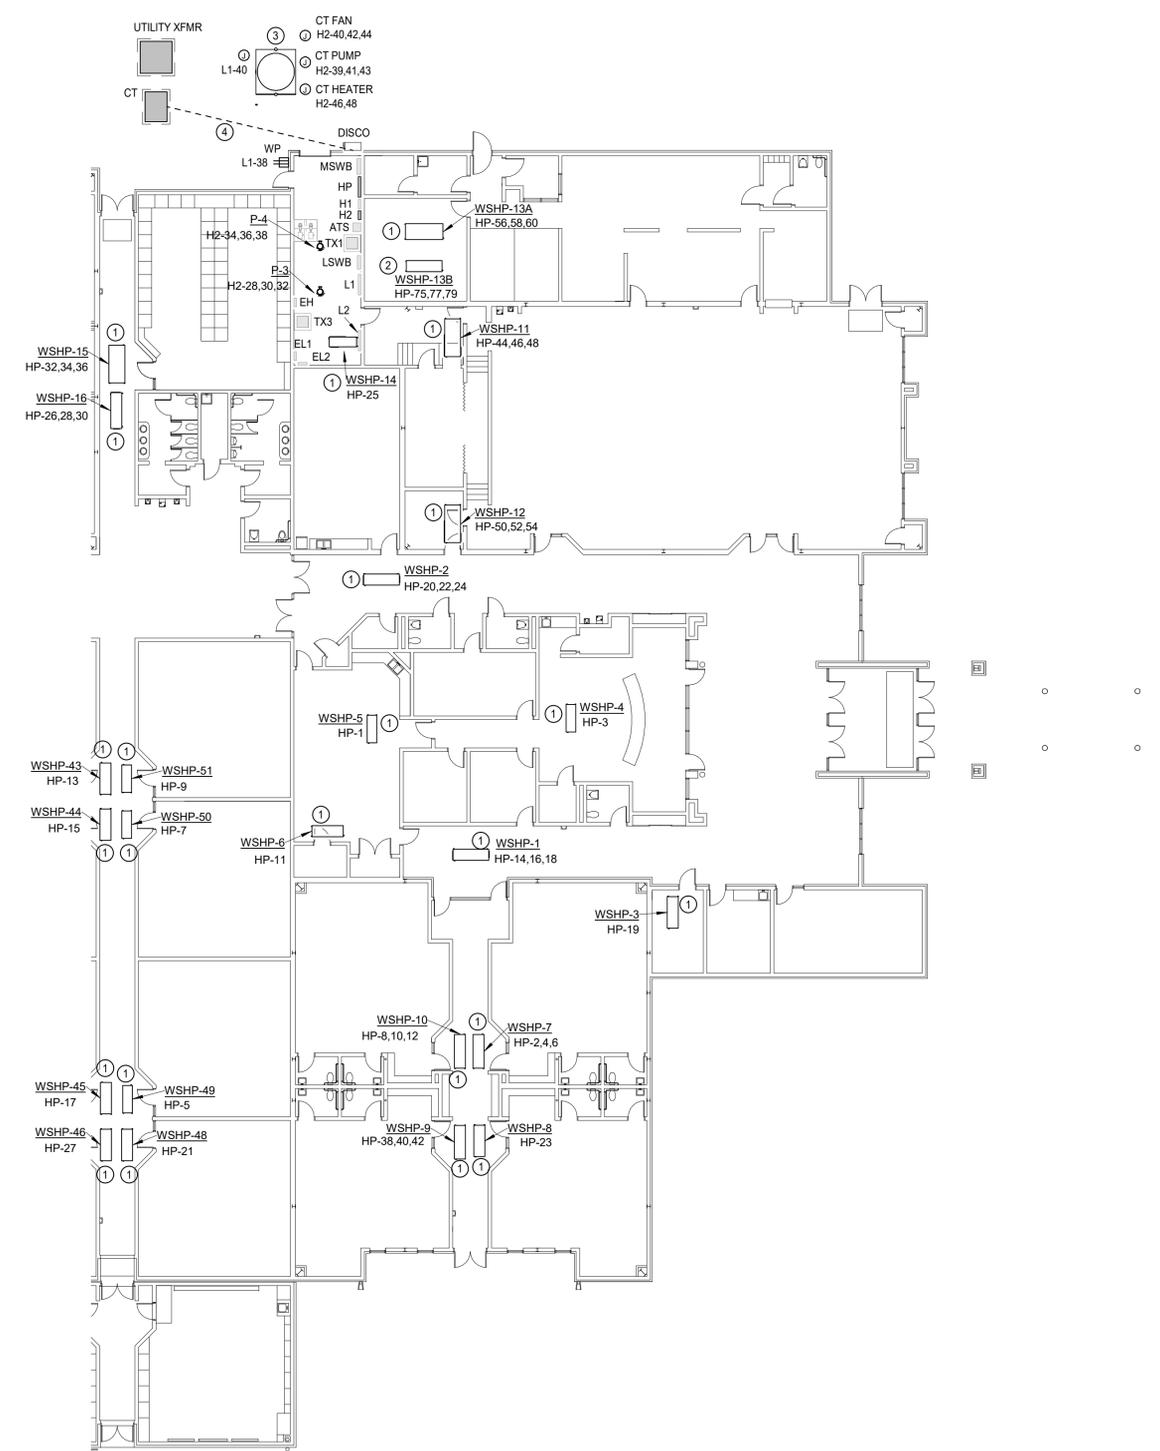

1 ELECTRICAL POWER PLAN - EAST
Scale: 1/16" = 1'-0"

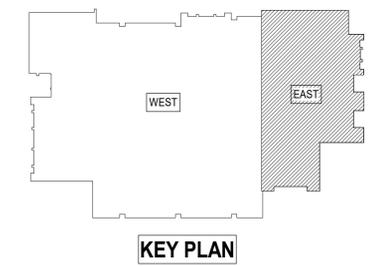

KEY PLAN

DWG
drawn by

TVO
checked by

JANUARY 2026
date

REVISIONS

Δ	DESCRIPTION	DATE



WAYLAND BONDS
2025 HVAC

sheet no:

E201

Salas O'Brien
Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA#: 7058 Expiration Date: 06/30/2027
Salas O'Brien Project Number: 2550-01872-00

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.