



KF
drawn by
DG
checked by
JANUARY 2026
date

REVISIONS

Δ	DESCRIPTION	DATE





WAYLAND BONDS
2025 HVAC

sheet no:

M102

OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

- | GENERAL NOTES | |
|---------------|---|
| 1. | COORDINATE WORK WITH ALL TRADES ON SITE. |
| 2. | COORDINATE LOCATION OF THERMOSTATS AND CARBON MONOXIDE DETECTOR WITH ELECTRICAL CONTRACTOR, ROUGH-IN BY ELECTRICAL CONTRACTOR. |
| 3. | FURNACES TO BE SUSPENDED FROM STRUCTURE ABOVE. MAINTAIN REQUIRED SERVICE CLEARANCE ON ALL SIDES. SEE DETAIL 2/14501 FOR ADDITIONAL INFORMATION. |
| 4. | CEILING SPACE IS LIMITED. COORDINATE EXACT DUCT ROUTING WITH OTHER TRADES PRIOR TO INSTALLATION OF SPRINKLERS, CONDUITS, LIGHTING ETC. |
-
- | MECHANICAL KEYED NOTES | |
|------------------------|---|
| 1 | CONNECT NEW WSHP TO EXISTING HYDRONIC PIPES, CONDENSATE PIPE, AND DUCTWORK. PROVIDE TRANSITION DUCTWORK AS NEEDED TO FIT. |

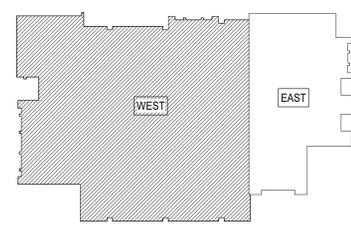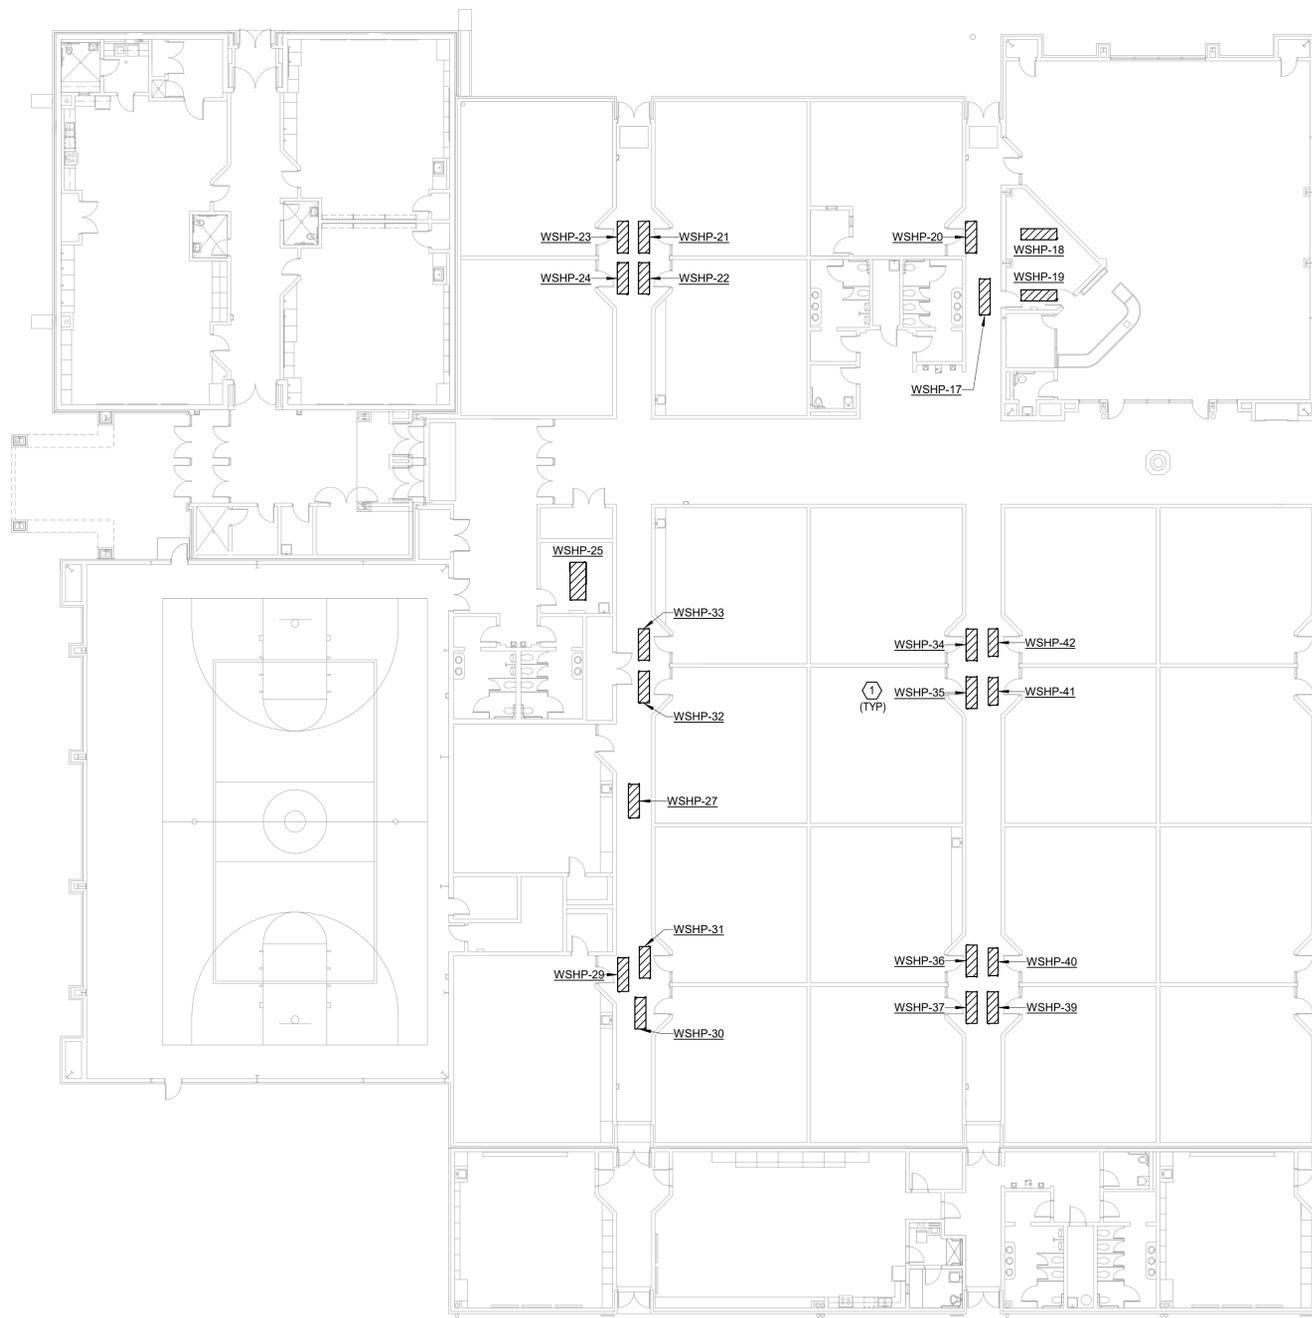

KEY PLAN

1 MECHANICAL PLAN - WEST
Scale: 1/16" = 1'-0"

Salas O'Brien
Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA#: 7058 Expiration Date: 06/30/2027
Salas O'Brien Project Number: 2550-01872-00