



JB
drawn by
TVO
checked by
NOVEMBER 2025
date

REVISIONS

Δ	DESCRIPTION	DATE



WESTMOORE HIGH
SCHOOL 2025
ARENA HVAC

sheet no:

E201


OWNERSHIP USE OF DOCUMENTS:
AGP EXPRESSLY RESERVES ITS
COPYRIGHT AND OTHER PROPERTY
RIGHTS OF ALL PLANS AND DRAWINGS
DESIGNED AND/OR PRODUCED. PLANS
AND DRAWINGS ARE NOT TO BE
REPRODUCED IN ANY FORM OR MANNER
WITHOUT THE EXPRESSED WRITTEN
CONSENT OF AGP.

POWER GENERAL NOTES

- COORDINATE EXACT LOCATIONS OF DEVICES SHOWN WITH OTHER EQUIPMENT.
- COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR. REFER TO MECHANICAL PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
- COORDINATE EXACT LOCATION OF PLUMBING EQUIPMENT WITH PLUMBING CONTRACTOR. REFER TO PLUMBING PLANS AND MANUFACTURER FOR ADDITIONAL INFORMATION.
- COORDINATE THE EXACT REQUIREMENTS OF ALL POWER CONNECTION FIXTURES AND DEVICES WITH THE ARCHITECT, OWNER AND MANUFACTURER PRIOR TO ROUGH-IN.

ELECTRICAL KEYED NOTES

- REMOVE EXISTING SERVICE RECEPTACLE. CONNECT NEW SERVICE RECEPTACLE TO EXISTING CIRCUIT. PROVIDE NEW WIRE, CONDUIT, AND ANY OTHER ITEMS NECESSARY TO EXTEND THE EXISTING CIRCUIT TO THE NEW RECEPTACLE.
- REMOVE EXISTING RTU. CONNECT NEW RTU TO EXISTING CIRCUIT AND PROVIDE NEW BREAKER, CONDUIT, AND WIRE. THE EXISTING CONDUIT AND WIRE MAY BE REUSED WHERE IN SERVICEABLE CONDITION AND RATED APPROPRIATELY FOR THE NEW LOADS AS SPECIFIED. THE CONTRACTOR SHALL WARRANTY ANY REUSED MATERIALS AS IF NEW.
- APPROXIMATE LOCATION OF EXISTING PANELS BELOW.

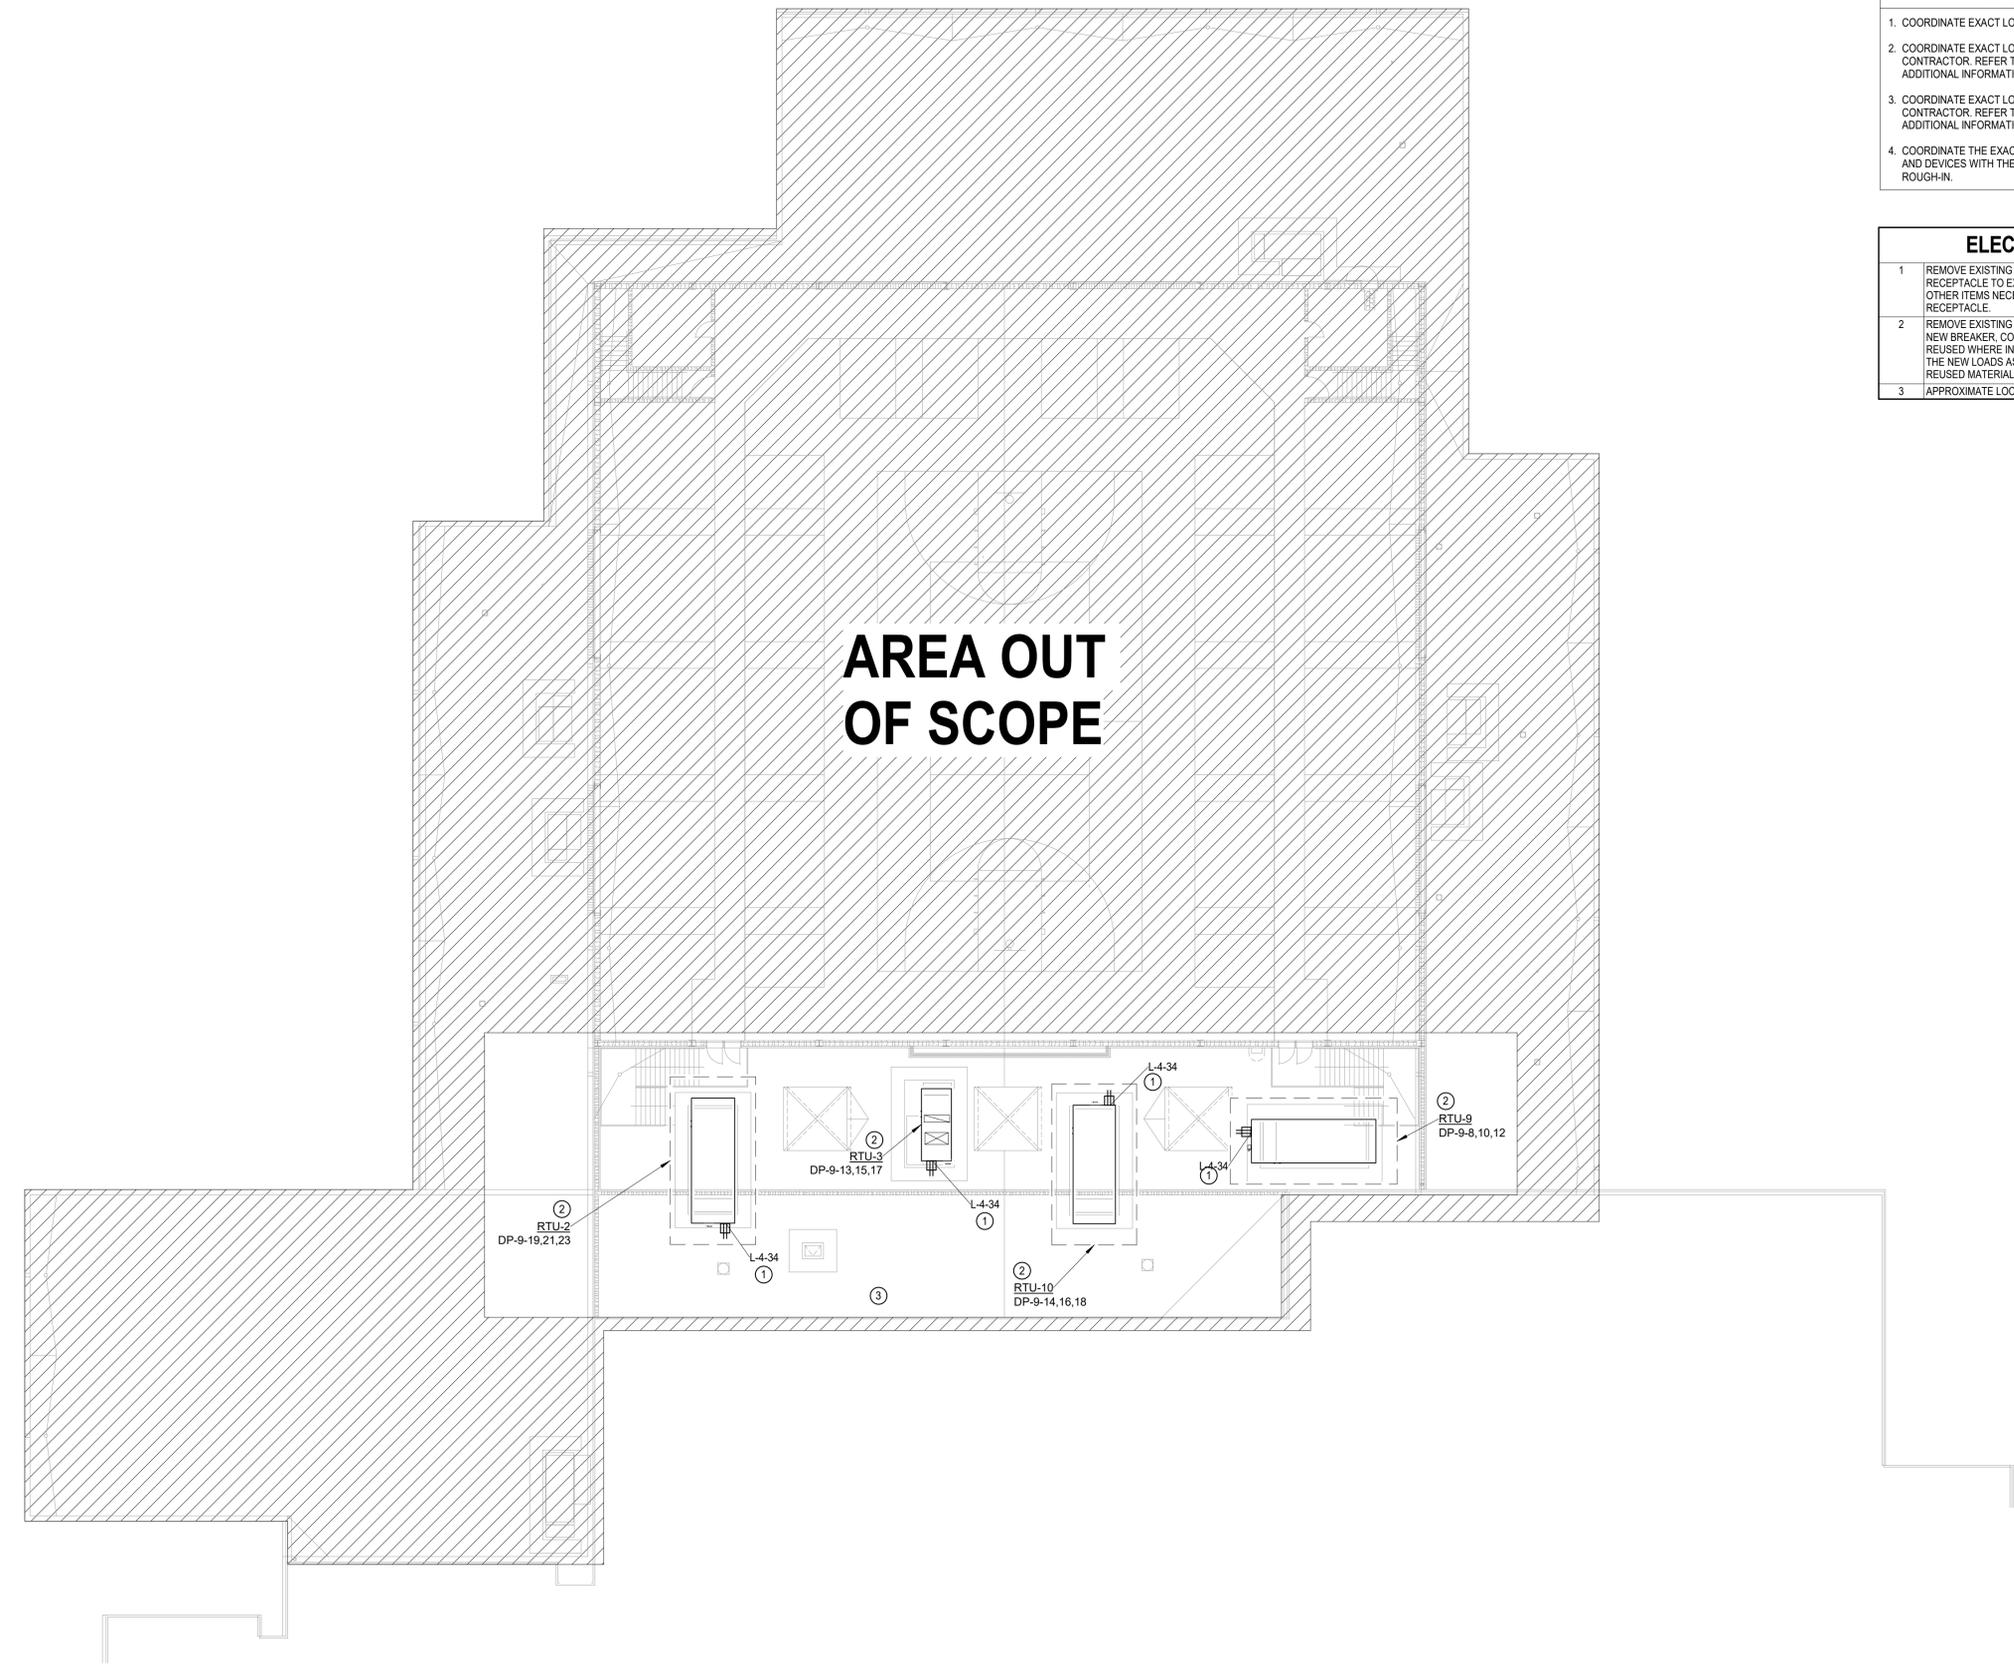

1 ELECTRICAL ROOF PLAN
Scale: 1/16" = 1'-0"

Salas O'Brien
Oklahoma City
2900 S. Telephone Road, Suite 120
Moore, OK 73160
CA# 7058 Expiration Date: 06/30/2027
Salas O'Brien Project Number: 2550-01871-00